Bar R - clear top-down map

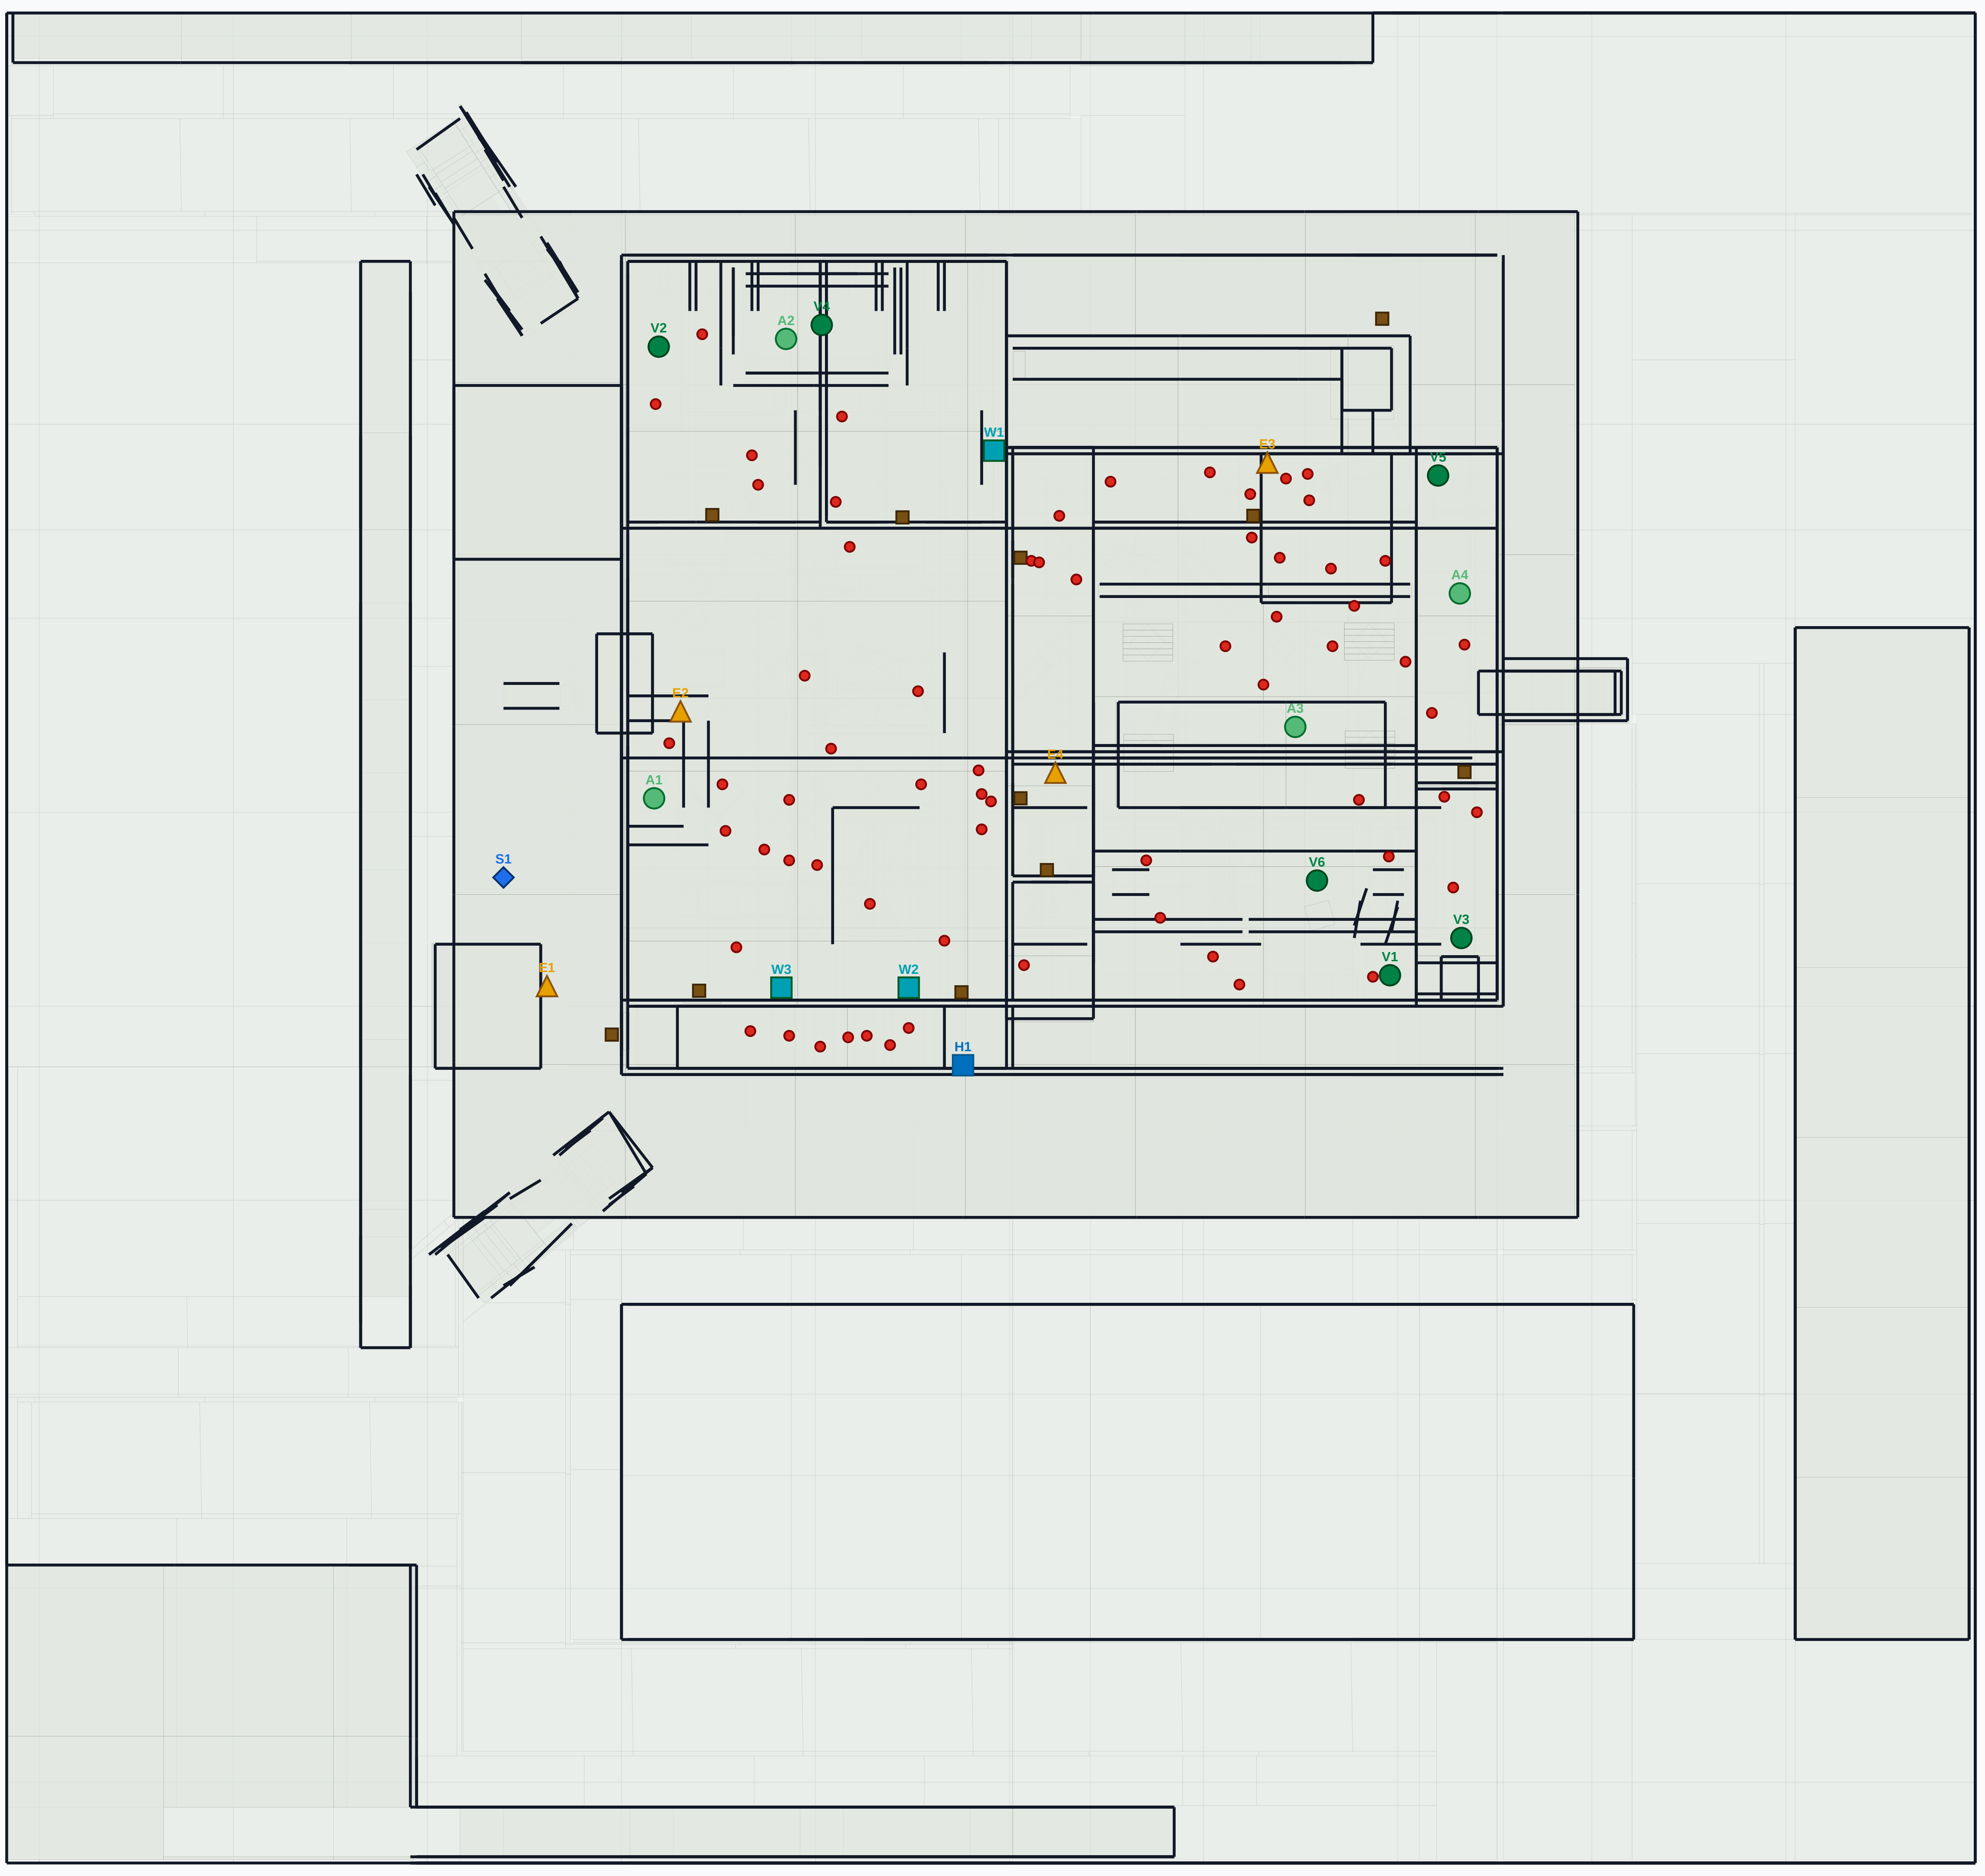

Map uses same decoded entities as topdown_stage_clear.svg; table below is annotated_entities.csv.

Legend

- 🟦 START: Player/start (1)
- 🟩 VICTIM: Survivor base (6)
- 🟩 ALT: RNG alt spot (4)
- 🟥 FIRE: Fire dot (65)
- 🟦 HOSE: Hose (1)
- 🟦 VALVE: Valve (3)
- 🟧 EXIT: Exit arrow (4)
- 🟫 DOOR: Door/model (11)

Label meaning

S# start
V# survivor base
A# RNG alt spot
E# exit
H# hose
W# valve
F# fire
D# door/model

Coordinate bounds

X: -1584 to 3488
Z: -2560 to 2208
Projection: X/Z top-down

Entity Table: annotated_entities.csv

label	category	entity_index	class	name	x	y	z	victim_link	scripts
S1	START	85	RCS_PlayerRescue	RCS_PlayerRescue1	-304.0	128.0	-332.0		equip axe | setashdensity 0
P1	PROP	104	RCS_PropModel	Extinguisher01	28.0	112.0	-292.0		touch: *RefillExt | setscale .2 .2 .2
H1	HOSE	108	RCS_PropModel	hose01	880.0	340.0	152.0		touch: tell player (touchhose 30)
W1	VALVE	109	RCS_PropModel	valve01	960.0	344.0	-1432.0		makevalve
W2	VALVE	110	RCS_PropModel	valve02	740.0	344.0	-48.0		makevalve
T1	TRIGGER	133	RCS_BoundsTrigger	ExitTrigger01	2244.0	368.0	-809.0		touch: tell player escape
V1	VICTIM	134	RCS_VictimRescue	Victim01	1980.0	420.0	-80.0		roam 500
V2	VICTIM	135	RCS_VictimRescue	Victim02	96.0	40.0	-1700.0		roam 300
P2	PROP	154	RCS_PropModel	Extinguisher2	1020.0	112.0	-1300.0		touch: *RefillExt | setscale .2 .2 .2
V3	VICTIM	155	RCS_VictimRescue	Victim03	2164.0	304.0	-176.0		playanim 1 | roam 500
V4	VICTIM	156	RCS_VictimRescue	Victim04	516.0	304.0	-1756.0		setskin 2 | playanim 1 | roam 500
V5	VICTIM	157	RCS_VictimRescue	Victim05	2104.0	40.0	-1368.0		setskin 2 | roam 500
V6	VICTIM	158	RCS_VictimRescue	Victim06	1792.0	40.0	-324.0		setskin 2 | playanim 1 | roam 500
F1	FIRE	163	RCS_FireRescue	PoolRoomFire01	928.0	60.0	-547.0		
F2	FIRE	164	RCS_FireRescue	PoolRoomFire2	832.0	66.0	-169.0		
F3	FIRE	165	RCS_FireRescue	PoolRoomFire3	1037.0	55.0	-106.0		
F4	FIRE	166	RCS_FireRescue	PoolRoomFire4	1900.0	55.0	-532.0		
F5	FIRE	167	RCS_FireRescue	PoolRoomFire5	1977.0	111.0	-386.0		
F6	FIRE	168	RCS_FireRescue	DartRoomFire01	1968.0	88.0	-1148.0		
T2	TRIGGER	170	RCS_BoundsTrigger	ExitTrigger2	-22.0	135.0	64.0		touch: tell player escape
T3	TRIGGER	171	RCS_BoundsTrigger	barzone1	-241.0	51.0	-66.0		makezone (Downtown Bar) | touch: tell player (setashdensity 0)
T4	TRIGGER	172	RCS_BoundsTrigger	barzone2	112.0	156.0	-1036.0		makezone (Pool Room) | touch: tell player (setashdensity .5)
T5	TRIGGER	173	RCS_BoundsTrigger	barzone3	124.0	52.0	-1468.0		makezone (Women's Bathroom) | touch: tell player (setashdensity .7)
T6	TRIGGER	174	RCS_BoundsTrigger	barzone4	644.0	52.0	-1380.0		makezone (Men's Room) | touch: tell player (setashdensity 0)
T7	TRIGGER	175	RCS_BoundsTrigger	barzone5	1060.0	52.0	-1372.0		makezone (Darts Room) | touch: tell player (setashdensity 1)
T8	TRIGGER	176	RCS_BoundsTrigger	barzone6	152.0	336.0	-152.0		makezone (Upstairs Bar) | touch: tell player (setashdensity 1)
T9	TRIGGER	177	RCS_BoundsTrigger	barzone7	1440.0	400.0	-676.0		makezone (Club) | touch: (fogenable 15 500 60 50 50) | untouch: fogdisable | touch: tell player oxyon | untouch: tell player oxyoff
T10	TRIGGER	178	RCS_BoundsTrigger	barzone8	2160.0	412.0	-436.0		makezone (Storage Room) | touch: tell player (setashdensity .75)
T11	TRIGGER	179	RCS_BoundsTrigger	barzone9	136.0	52.0	-1036.0		makezone (Pool Room) | touch: tell player (setashdensity .5)
T12	TRIGGER	180	RCS_BoundsTrigger	Zone_Vents	1823.0	95.0	-1544.0		makezone (Ventilation Shafts) | touch: tell player (setashdensity 0) | touch: tell VentsDoor open | untouch: tell VentsDoor close
T13	TRIGGER	181	RCS_BoundsTrigger	Zone_Hall1	1036.0	452.0	-1403.0		makezone (Upstairs Hallway) | touch: tell player (setashdensity 0.5)
T14	TRIGGER	182	RCS_BoundsTrigger	Zone_Hall2	1060.0	448.0	-1412.0		makezone (Upstairs Hallway) | touch: tell player (setashdensity 0)
T15	TRIGGER	183	RCS_BoundsTrigger	Zone_Hall3	1080.0	452.0	-1400.0		makezone (Upstairs Hallway) | touch: tell player (setashdensity 0)
T16	TRIGGER	184	RCS_BoundsTrigger	Zone_Stairway	978.0	475.0	98.0		makezone (Main Stairway) | touch: tell player (setashdensity 1)
T17	TRIGGER	185	RCS_BoundsTrigger	Hint_GoInside	-266.0	162.0	-1338.0		touch: hint 3 (Get inside and save those people!)
T18	TRIGGER	187	RCS_BoundsTrigger	VentBoom	1788.0	128.0	-1087.0		touch: once (tell DartsVentOpen open) | touch: once(playsnd Explodesmall 0) | touch: once (tell Emmitter_DartsVent turnoff)
T19	TRIGGER	189	RCS_BoundsTrigger	BarVent_Open	1028.0	304.0	-1628.0		touch: once (tell BarVentOpen open) | touch: once(playsnd Explodesmall 0)
F7	FIRE	190	RCS_FireRescue	DartRoomFire2	1888.0	64.0	-1032.0		
F8	FIRE	191	RCS_FireRescue	DartRoomFire3	1832.0	112.0	-928.0		
F9	FIRE	192	RCS_FireRescue	DartRoomFire4	1556.0	96.0	-928.0		
F10	FIRE	193	RCS_FireRescue	DartRoomFire5	88.0	64.0	-1552.0		
F11	FIRE	194	RCS_FireRescue	DartRoomFire6	208.0	108.0	-1732.0		
F12	FIRE	195	RCS_FireRescue	DartRoomFire7	336.0	108.0	-1420.0		
F13	FIRE	196	RCS_FireRescue	DartRoomFire8	1768.0	112.0	-1372.0		
F14	FIRE	197	RCS_FireRescue	DartRoomFire9	1620.0	36.0	-1320.0		
F15	FIRE	198	RCS_FireRescue	DartRoomFire10	1516.0	112.0	-1376.0		
F16	FIRE	199	RCS_FireRescue	DartRoomFire11	1688.0	108.0	-1004.0		
F17	FIRE	200	RCS_FireRescue	DartRoomFire12	1654.0	108.0	-829.0		
F18	FIRE	201	RCS_FireRescue	DartRoomFire13	2020.0	112.0	-888.0		
F19	FIRE	202	RCS_FireRescue	DartRoomFire14	2088.0	108.0	-756.0		
F20	FIRE	203	RCS_FireRescue	DartRoomFire15	2172.0	112.0	-932.0		
T20	TRIGGER	206	RCS_BoundsTrigger	Exit03	-44.0	392.0	-892.0		touch: tell player escape
F21	FIRE	207	RCS_FireRescue	PoolRoomFire6	1388.0	104.0	-228.0		
F22	FIRE	208	RCS_FireRescue	PoolRoomFire7	1352.0	112.0	-376.0		
F23	FIRE	209	RCS_FireRescue	PoolRoomFire8	1936.0	148.0	-76.0		
F24	FIRE	212	RCS_FireRescue	upstairsbar_fire2	920.0	328.0	-608.0		
F25	FIRE	213	RCS_FireRescue	upstairbar_fire1	928.0	320.0	-456.0		
F26	FIRE	214	RCS_FireRescue	upstairsbar_fire3	352.0	300.0	-1344.0		
F27	FIRE	215	RCS_FireRescue	upstairsbar_fire4	772.0	300.0	-572.0		
F28	FIRE	216	RCS_FireRescue	upstairsbar_fire5	472.0	360.0	-852.0		
F29	FIRE	217	RCS_FireRescue	upstairsbar_fire6	540.0	300.0	-664.0		
F30	FIRE	218	RCS_FireRescue	upstairsbar_fire7	568.0	352.0	-1520.0		
F31	FIRE	219	RCS_FireRescue	upstairsbar_fire8	764.0	300.0	-812.0		
F32	FIRE	220	RCS_FireRescue	upstairsbar_fire9	552.0	300.0	-1300.0		
F33	FIRE	221	RCS_FireRescue	upstairsbar_fire10	432.0	352.0	-532.0		
F34	FIRE	222	RCS_FireRescue	upstairsbar_fire11	588.0	300.0	-1184.0		
F35	FIRE	223	RCS_FireRescue	upstairsbar_fire12	432.0	300.0	-376.0		
F36	FIRE	224	RCS_FireRescue	stairwell_fire1	332.0	108.0	64.0		
F37	FIRE	225	RCS_FireRescue	stairwell_fire2	432.0	132.0	76.0		
F38	FIRE	226	RCS_FireRescue	stairwell_fire4	512.0	152.0	104.0		
F39	FIRE	227	RCS_FireRescue	stairwell_fire3	584.0	148.0	80.0		
F40	FIRE	228	RCS_FireRescue	stairwell_fire5	632.0	176.0	76.0		
F41	FIRE	229	RCS_FireRescue	stairwell_fire6	692.0	284.0	100.0		
F42	FIRE	230	RCS_FireRescue	stairwell_fire7	740.0	268.0	56.0		
F43	FIRE	231	RCS_FireRescue	hall_fire1	2120.0	352.0	-540.0		
F44	FIRE	232	RCS_FireRescue	hall_fire2	2204.0	352.0	-500.0		
P3	PROP	233	RCS_PropModel	Extinguisher3	976.0	360.0	-1784.0		touch: *RefillExt | setscale .2 .2 .2
P4	PROP	236	RCS_PropModel	extinguisher4	2244.0	87.0	-64.0		touch: *RefillExt | setscale .2 .2 .2
P5	PROP	237	RCS_PropModel	Extinguisher4	1024.0	368.0	-44.0		touch: *RefillExt | setscale .2 .2 .2
P6	PROP	238	RCS_PropModel	extinguisher5	2240.0	356.0	-1384.0		touch: *RefillExt | setscale .2 .2 .2
W3	VALVE	239	RCS_PropModel	valve3	412.0	88.0	-48.0		makevalve
F45	FIRE	240	RCS_FireRescue	PoolRoomFire9	1524.0	104.0	-128.0		
F46	FIRE	241	RCS_FireRescue	PoolRoomFire10	1592.0	104.0	-56.0		
D1	DOOR	242	RCS_BModel	door15	200.0	152.0	-40.0		*Door
D2	DOOR	243	RCS_BModel	door16	234.0	151.0	-1266.0		*Door
D3	DOOR	244	RCS_BModel	door17	724.0	151.0	-1260.0		*Door
D4	DOOR	245	RCS_BModel	door18	1028.0	152.0	-1156.0		*Door
D5	DOOR	246	RCS_BModel	door19	1028.0	408.0	-536.0		*Door
D6	DOOR	247	RCS_BModel	door20	1096.0	406.0	-351.0		*Door
D7	DOOR	248	RCS_BModel	door21	2172.0	412.0	-604.0		*Door
D8	DOOR	249	RCS_BModel	door22	876.0	407.0	-36.0		*Door
D9	DOOR	250	RCS_BModel	door8	1628.0	408.0	-1264.0		*Door
D10	DOOR	251	RCS_BModel	door23	-25.0	147.0	73.0		*Door
F47	FIRE	259	RCS_FireRescue	poolfire666	123.0	76.0	-678.0		
F48	FIRE	260	RCS_FireRescue	poolfire667	260.0	112.0	-572.0		
F49	FIRE	261	RCS_FireRescue	poolfire668	368.0	112.0	-404.0		
F50	FIRE	262	RCS_FireRescue	poolfire669	504.0	72.0	-364.0		
F51	FIRE	263	RCS_FireRescue	poolfire670	268.0	72.0	-452.0		
F52	FIRE	264	RCS_FireRescue	poolfire671	640.0	72.0	-264.0		
A1	ALT	265	RCS_VictimAltSpot	RCS_VictimAltSpot1	84.0	92.0	-536.0	RCS_VictimRescue6	
A2	ALT	266	RCS_VictimAltSpot	RCS_VictimAltSpot2	424.0	92.0	-1720.0	RCS_VictimRescue2	
A3	ALT	267	RCS_VictimAltSpot	RCS_VictimAltSpot3	1736.0	96.0	-720.0	RCS_VictimRescue5	
A4	ALT	268	RCS_VictimAltSpot	RCS_VictimAltSpot4	2160.0	140.0	-1064.0	RCS_VictimRescue5	
F53	FIRE	269	RCS_FireRescue	clubfire01	1828.0	380.0	-1128.0		
F54	FIRE	270	RCS_FireRescue	clubfire2	1696.0	380.0	-1156.0		
F55	FIRE	271	RCS_FireRescue	clubfire3	1624.0	380.0	-1208.0		
F56	FIRE	272	RCS_FireRescue	clubfire4	1712.0	380.0	-1360.0		
F57	FIRE	273	RCS_FireRescue	clubfire5	1772.0	380.0	-1304.0		
F58	FIRE	274	RCS_FireRescue	clubfire6	1260.0	380.0	-1352.0		
F59	FIRE	275	RCS_FireRescue	clubfire7	1128.0	380.0	-1264.0		
F60	FIRE	276	RCS_FireRescue	clubfire8	1056.0	380.0	-1148.0		
F61	FIRE	277	RCS_FireRescue	clubfire9	1172.0	380.0	-1100.0		
F62	FIRE	278	RCS_FireRescue	clubfire10	1076.0	380.0	-1144.0		
F63	FIRE	279	RCS_FireRescue	upstairsbar_fire13	952.0	328.0	-528.0		
T21	TRIGGER	290	RCS_BoundsTrigger	clubActionTrigger	1312.0	420.0	-564.0		touch: if passedClubOnce 1 (*ClubActions) | touch: inc passedClubOnce | touch: once(playsnd Stress2 0)
F64	FIRE	292	RCS_FireRescue	upstairbar_fire2	296.0	320.0	-152.0		
T22	TRIGGER	299	RCS_BoundsTrigger	ClosetVentTrigEnt	2128.0	498.0	-58.0		touch: once (tell ClosetVentOpen open) | touch: once (tell smoke2 turnoff) | touch: once (tell smoke3 turnoff)
F65	FIRE	300	RCS_FireRescue	seceretFire01	2143.0	592.0	-306.0		
E1	EXIT	304	RCS_EscapeArrow	RCS_EscapeArrow1	-192.0	216.0	-52.0		
E2	EXIT	305	RCS_EscapeArrow	<null>1	152.0	452.0	-760.0		
E3	EXIT	306	RCS_EscapeArrow	<null>2	1664.0	469.0	-1401.0		
E4	EXIT	307	RCS_EscapeArrow	<null>3	1118.0	465.0	-602.0		
D11	DOOR	312	RCS_BModel	VentsDoor	1960.0	220.0	-1772.0		