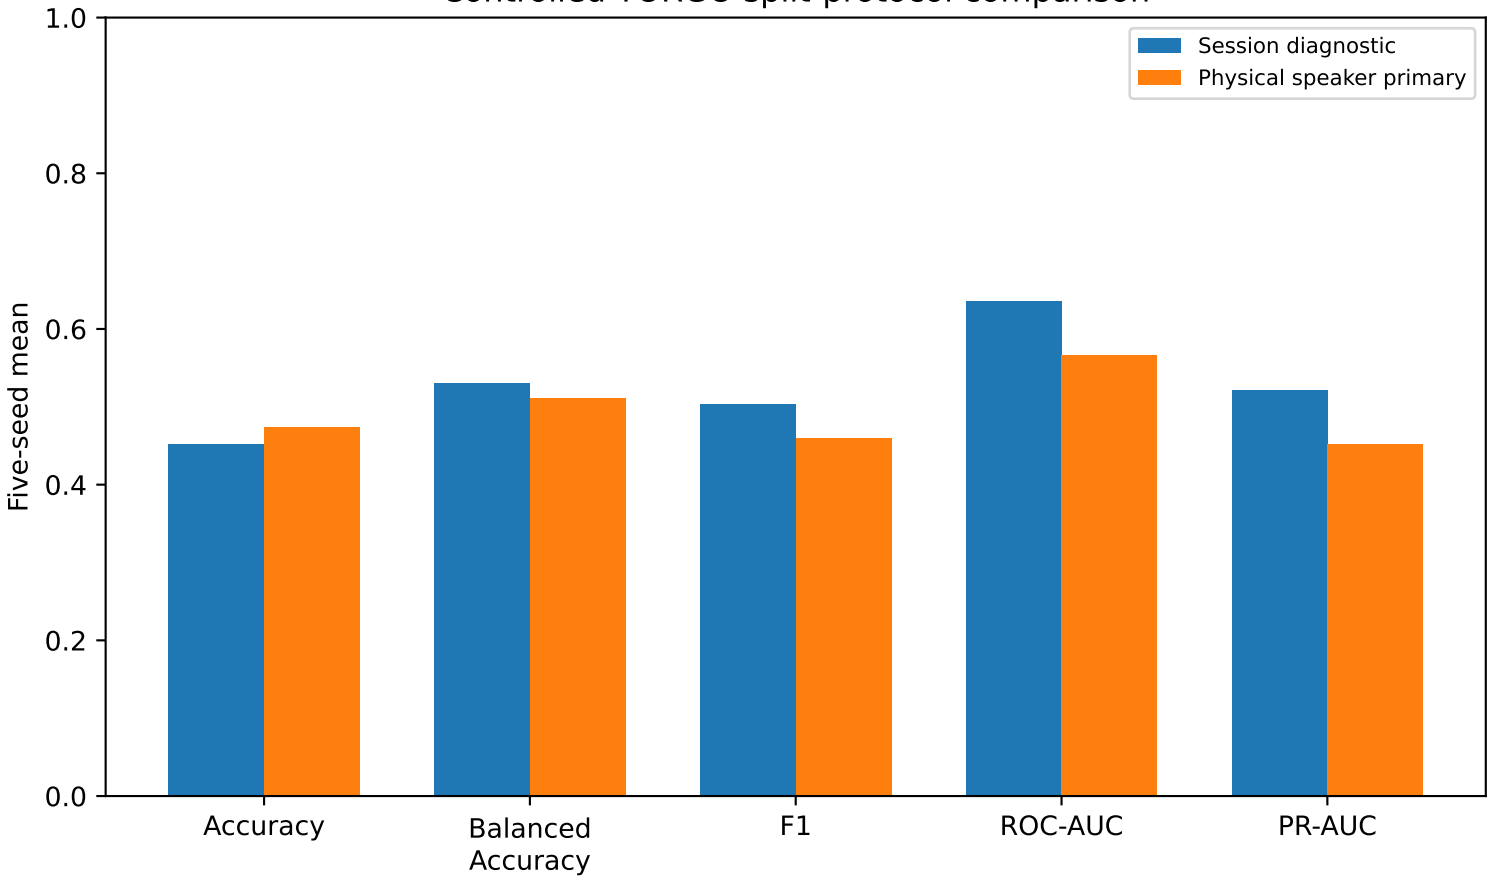
Controlled TORGO split-protocol comparison
Session diagnostic
Physical speaker primary
Five-seed mean
1.0
0.8
0.6
0.4
0.2
0.0
Accuracy
Balanced Accuracy
F1
ROC-AUC
PR-AUC