Consumer Cellular®

8283 S. AKRON ST., SUITE #110, CENTENNIAL, CO 80112

VICINITY PLAN

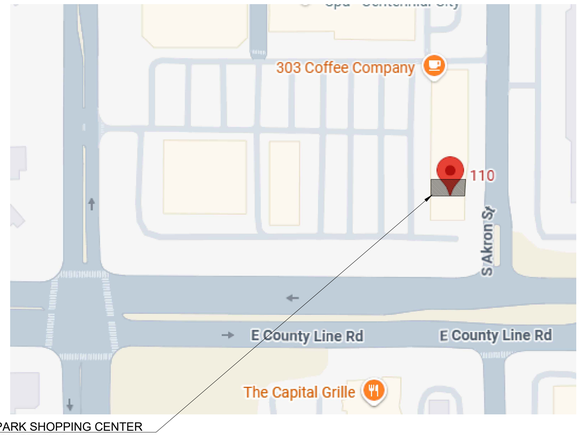

YOSEMITE PARK SHOPPING CENTER
8283 S. AKRON ST. #110
CENTENNIAL, CO 80112

SITE PLAN

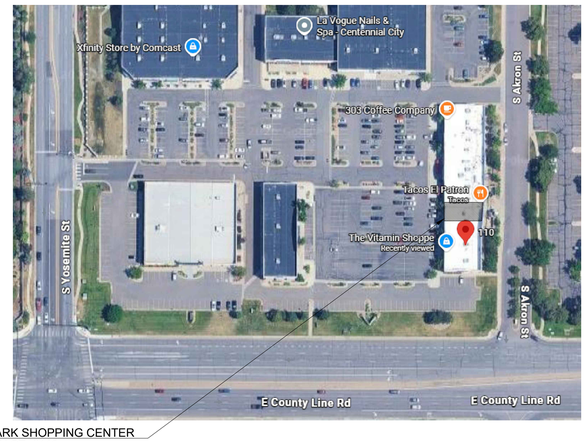

YOSEMITE PARK SHOPPING CENTER
8283 S. AKRON ST. #110
CENTENNIAL, CO 80112

DRAWING INDEX

ARCHITECTURAL	
G000	COVER SHEET
G001	RESPONSIBILITY SCHEDULE
G002	ACCESSIBILITY DETAILS (ADAAG)
G003	CODE ANALYSIS AND EGRESS PLAN
D100	EXISTING CONDITIONS AND DEMOLITION PLAN
D101	TRENCHING LOCATION PLAN
A100	CONSTRUCTION FLOOR PLAN
A101	FINISH PLAN
A102	FURNITURE FLOOR PLAN
A103	MILLWORK FLOOR PLAN
A104	MILLWORK BLOCKING DETAILS
A200	REFLECTED CEILING PLAN
A300	EXTERIOR ELEVATIONS
A301	EXTERIOR ELEVATIONS
A400	INTERIOR ELEVATIONS
A401	INTERIOR ELEVATIONS
A402	ENLARGED UNISEX RESTROOM
A500	PARTITION TYPES AND DETAILS
A501	CEILING DETAILS
A502	FLOORING AND BASE DETAILS
A503	SLAB DETAILS
A504	MOP SINK DETAILS
A600	DOOR SCHEDULE AND DETAILS
A700	ARCHITECTURAL SPECIFICATIONS
MECHANICAL	
M101	MECHANICAL FLOOR PLAN
M102	MECHANICAL SCHEDULES
M501	MECHANICAL DETAILS
M601	ENERGY CALCULATIONS
ELECTRICAL	
E101	ELECTRICAL FLOOR PLAN
E111	LIGHTING FLOOR PLAN
E112	LUMINAIRE SCHEDULES
E301	ELECTRICAL PANELS
E601	ENERGY CALCULATIONS
E701	ELECTRICAL SPECIFICATIONS
PLUMBING	
P101	PLUMBING FLOOR PLAN
P501	PLUMBING DETAILS
FIRE ALARM	
FA101	FIRE ALARM FLOOR PLAN

SEPARATE PERMITS

1. IF THE FIRE ALARM SYSTEM AND SPRINKLER SYSTEM ARE EXISTING IN THIS PROJECT, THE CONTRACTOR SHALL MODIFY THE SYSTEMS AS NECESSARY TO COMPLY WITH LOCAL ORDINANCES, NFPA 72, & NFPA 13.
2. FIRE SPRINKLER SYSTEM WORK AND FIRE ALARM SYSTEM WORK ARE DESIGNED AND BUILT BY THE CONTRACTOR. CONTRACTOR IS RESPONSIBLE FOR PROVIDING SIGNED AND SEALED FIRE ALARM AND FIRE SPRINKLER DRAWINGS AND SUBMITTING DRAWINGS TO THE JURISDICTION (AND LANDLORD AS REQUIRED) AND OBTAINING APPROVAL PRIOR TO BEGINNING ANY WORK ON THE FIRE SPRINKLER OR ALARM SYSTEM. THE FIRE SPRINKLER AND ALARM WORK SHALL BE PERFORMED UNDER A SEPARATE PERMIT WHERE APPLICABLE.
3. IF FIRE ALARM IS EXISTING, GC TO HIRE FA SUB TO VERIFY CODE COMPLIANCE OF EXISTING SYSTEM.
4. NEW SIGNAGE UNDER A SEPARATE PERMIT.

PROJECT SCOPE

- FIXTURES, FURNITURE AND EQUIPMENT
- INTERIOR PARTITIONS AND DOORS
- CEILING IN ALL AREAS
- FINISHES IN ALL AREAS
- LIGHTING IN ALL AREAS
- RESTROOM(S) FIXTURES AND FINISHES
- KITCHENETTE AND MOP SINK

ABBREVIATIONS

ACP.	ACOUSTICAL CEILING	FIN.	FINISH	PNL.	PANEL
ADJ.	ADJACENT	FIXT.	FIXTURE	PROP.	PROPERTY
AL.,ALUM.	ALUMINUM	FLR.	FLOOR	P.T.	PRESSURE TREATED
ALT.	ALTERNATE	F.R.	FIRE RATED/RETARDANT	PWR.	POWER
A.P.	ACCESS PANEL	F.R.P.	FIBERGLASS REINFORCED POLYESTER PANEL	QTY.	QUANTITY
APPX.	APPROXIMATE	F.R.T.	FIRE RETARDANT TREATED	R.	RADIUS
ARCH.	ARCHITECTURAL	GA.	GAUGE	REQ.	REQUIRED
BD.	BOARD	GALV.	GALVANIZED	R.O.	ROUGH OPENING
BLDG.	BUILDING	GND,GRND	GROUND	S.C.	SOLID CORE
BLK.	BLOCK	GYP.	GYPSUM	SCHED.	SCHEDULE
BLKG.	BLOCKING	H.M.	HOLLOW METAL	SECT.	SECTION
BM.	BEAM	HR.	HOUR	SQ.FT.	SQUARE FEET
BOT.	BOTTOM	HT.	HEIGHT	SIM.	SIMILAR
CAB.	CABINET	H.V.A.C.	HEATING, VENTILATING, AIR CONDITIONING	SPEC.	SPECIFICATION
CEM.	CEMENT			SQ.	SQUARE
CKT.	CIRCUIT			STD.	STANDARD
CLG.	CEILING	J.H.A.	JURISDICTION HAVING AUTHORITY	STL.	STEEL
CLR.	CLEAR			STRUCT.	STRUCTURAL
CMU.	CONCRETE MASONRY UNIT	LAM.	LAMINATE	SYM.	SYMMETRICAL
COL.	COLUMN	LAV.	LAVATORY		
CONC.	CONCRETE	LL.	LANDLORD	TEL.	TELEPHONE
CONST.	CONSTRUCTION	LT.	LIGHT	TELCO.	TELE-COMMUNICATIONS
CONT.	CONTINUOUS	L.V.T.	LUXURY VINYL TILE	TMO.	CONSUMER CELLULAR
CPT.	CARPET			TYP.	TYPICAL
CTR.	CENTER	MAX.	MAXIMUM		
DET.	DETAIL	MECH.	MECHANICAL	U.O.N.	UNLESS OTHERWISE NOTED
DIA.	DIAMETER	MTL.	METAL		
DIFF.	DIFFUSER	MFR.	MANUFACTURER	VCT.	VINYL COMPOSITION
DIM.	DIMENSION	MIN.	MINIMUM		
DWG(S).	DRAWING, DRAWINGS	MIR.	MIRROR	W/	WITH
		MISC.	MISCELLANEOUS	WD.	WOOD
EA.	EACH	MTD.	MOUNTED	W/O	WITHOUT
E.I.F.S.	EXTERIOR INSULATION FINISH SYSTEM	MTG.	MOUNTING	WP.	WATERPROOF
ELEC.	ELECTRIC, ELECTRICAL	N.I.C.	NOT IN CONTRACT	W.R.	WATER RESISTANT
EM.	EMERGENCY	NOM.	NOMINAL	WT.	WEIGHT
EQ.	EQUAL	N.T.S.	NOT TO SCALE		
EQUIP.	EQUIPMENT				
EWC.	ELECTRIC WATER COOLER	O.C.	ON CENTER		
EXH.	EXHAUST	O.D.	OUTSIDE DIAMETER		
EXIST.	EXISTING	OPP.	OPPOSITE		
EXTIR.	EXTINGUISHER	PLYWD.	PLYWOOD		

SHEET SYMBOLS

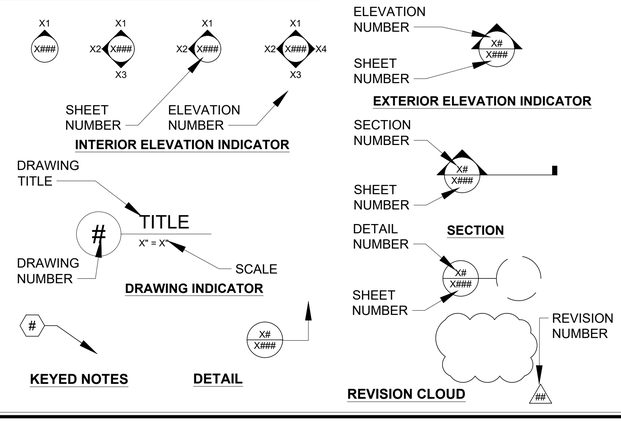

PROJECT TEAM

CLIENT
CONSUMER CELLULAR
CONTACT: JUSTIN HUNTER
PHONE: (815) 910-2568
EMAIL: Justin.Hunter@ConsumerCellular.com

ARCHITECTURE
SARGENTI ARCHITECTS
CONTACT: APRIL NAHM
PHONE: (480) 448-6250
EMAIL: anahm@sargarch.com

MANAGEMENT
GEAR MANAGEMENT
CONTACT: KASIDY SLUSSER
PHONE: (209) 256-4746
EMAIL: kslusser@gearmg.com

ENGINEERING
GEMINI ENGINEERING GROUP
CONTACT: HANS OPLINGER
PHONE: (817) 901-5191
EMAIL: hoplinger@gegmep.com

MILLWORK
K & J WOODWORKS
CONTACT: BOB KENNARD
PHONE: (630) 964-5876
EMAIL: barkpm@comcast.net

LANDLORD
CROSBLE REG
CONTACT: RICH OTTERSTETTER
PHONE: (303) 883-1103
EMAIL: richo@cregincc

GENERAL NOTES

1. ALL WORK AND MATERIALS SHALL BE INSTALLED IN ACCORDANCE WITH ALL CODES HAVING JURISDICTION.
2. ALL WORK SHALL BE PERFORMED IN CONFORMANCE WITH THE BUILDING MANAGEMENTS RULES AND REGULATIONS.
3. MODIFICATIONS TO THE BASE BUILDING STRUCTURE, CORE AREAS, AND UTILITY SYSTEMS ARE NOT IN THIS CONTRACT, EXCEPT AS NOTED ON THESE DRAWINGS OR AS REQUIRED TO COMPLETE THE WORK INDICATED ON THESE DRAWINGS.
4. THE G.C. SHALL MAKE ALL ARRANGEMENTS AND PAY FOR ALL FEES AND PERMITS REQUIRED, AS WELL AS ANY ADDITIONAL CHARGES FOR HAULING, RIGGING, AND TRANSPORTATION CHARGES.
5. THE CONTRACT DOCUMENTS CONSIST OF THE AGREEMENT BETWEEN CONSUMER CELLULAR AND G.C. (HEREINAFTER REFERRED TO AS THE AGREEMENT) WITH CONDITIONS OF THE CONTRACT (GENERAL, SUPPLEMENTARY, AND OTHER CONDITIONS), DRAWINGS, SPECIFICATIONS, ADDENDA ISSUED PRIOR TO THE EXECUTION OF THE AGREEMENT, OTHER DOCUMENTS LISTED IN THE AGREEMENT, AND MODIFICATIONS ISSUED AFTER EXECUTION OF THE AGREEMENT.
6. THE INTENT OF THE CONTRACT DOCUMENTS IS TO INCLUDE ALL ITEMS NECESSARY FOR THE PROPER EXECUTION AND COMPLETION OF THE WORK BY THE CONTRACTORS. PERFORMANCE BY THE G.C. SHALL BE REQUIRED ONLY TO EXTENT CONSISTENT WITH THE CONTRACT DOCUMENTS AND REASONABLY INFERABLE FROM THEM AS BEING NECESSARY TO PRODUCE THE INTENDED RESULTS.
7. THE CONTRACT DOCUMENTS SHALL NOT BE CONSTRUED TO CREATE A CONTRACTUAL RELATIONSHIP OF ANY KIND (1) BETWEEN THE ARCHITECT AND G.C., (2) BETWEEN CONSUMER CELLULAR AND A SUBCONTRACTOR OR SUB-SUBCONTRACTOR, OR (3) BETWEEN ANY PERSONS OR ENTITIES OTHER THAN CONSUMER CELLULAR AND G.C.
8. EXECUTION OF THE CONTRACT BY G.C. IS A REPRESENTATION THAT THE G.C. HAS VISITED THE SITE AND HAS BECOME FAMILIAR WITH THE LOCAL CONDITIONS UNDER WHICH THE WORK IS TO BE PERFORMED. THE CONTRACTOR SHALL VERIFY ALL EXISTING CONDITIONS BEFORE COMMENCING WORK AND SHALL NOTIFY ARCHITECT AND/OR ENGINEER IF A CONDITION EXISTS WHICH PREVENTS THE CONTRACTOR FROM ACCOMPLISHING THE INTENT OF THE DRAWINGS.
9. THE TERM "WORK" MEANS THE CONSTRUCTION AND SERVICES REQUIRED BY THE CONTRACT DOCUMENTS, WHETHER COMPLETED OR PARTIALLY COMPLETED, INCLUDES ALL LABOR, MATERIALS, EQUIPMENT, AND SERVICES PROVIDED (OR TO BE PROVIDED) BY THE G.C. TO FULFILL THE G.C.'S OBLIGATIONS. THE WORK MAY CONSTITUTE THE WHOLE OR PART OF THE PROJECT.
10. G.C. SHALL NOT CUT OR DISTURB EXISTING STRUCTURAL SYSTEM. THE G.C. SHALL X-RAY/PACHOMETER SLAB TO DETERMINE IF POST TENSIONED SLAB OR IF DESIGN IS IN CONFLICT WITH EXISTING STRUCTURAL SYSTEMS WHEN THE FOLLOWING OCCURS:
    - 10.1. TENANT SPACE IS LOCATED ON SECOND FLOOR OR ABOVE
    - 10.2. LOWER LEVEL EXTENDS BELOW THE TENANT SPACE
    - 10.3. ABSENCE OF STRUCTURAL DRAWINGS FROM ARCHITECTS AND/OR LANDLORD
    - 10.4. ABSENCE OF STRUCTURAL DRAWINGS INCLUDED WITH CONTRACT DOCUMENTS
11. G.C. SHALL ONLY INCLUDE AN ALLOWANCE IN HIS BID FOR THE X-RAY/PACHOMETER WHEN ANY OR ALL OF THE ABOVE OCCUR, TYP.
12. PROVIDE CONTROL KEY AND MASTER KEY AS REQUIRED BY CONTRACT. PERFORM ALL REQUIRED CLEANINGS AS PER CONTRACT INCLUDING, BUT NOT LIMITED TO, ALL STOREFRONT WINDOWS, MULLIONS, CEILINGS, SUPPLY/RETURN AIR GRILLS, FLOORING AND FLOOR WAX, TOILET ROOMS, TOILET ROOM CAULKING, AND WALK-OFF MAT. REMOVE ALL TRASH AND DEBRIS FROM THE SITE.
13. ALL REFERENCES HEREAFTER TO CONSTRUCTION PM OR ARCHITECT REFER TO THE CONTACT LISTED IN PROJECT TEAM.
14. PROVIDE OCCUPANCY SIGNS CONFORMING TO APPLICABLE BUILDING CODE REQUIREMENTS.
15. PROVIDE ADDITIONAL EXIT SIGNS AND FIRE EXTINGUISHERS IN TYPE, NUMBER, AND LOCATION AS DIRECTED BY THE FIRE DEPARTMENT FIELD INSPECTOR.

SARGENTI
5840 LEGACY CIR - STE D230, PLANO, TX 75024
T|201.316.5491 ■ WWW.SARGARCH.COM

SEAL:

STATE OF COLORADO
ROBERT J. SARGENTI
305929
LICENSED ARCHITECT

DATE SIGNED: 10/15/2026

CONTRACTOR'S NOTES:

WRITTEN DIMENSIONS HOLD PREFERENCE OVER SCALED DIMENSIONS. DO NOT SCALE THE DRAWINGS. THE CONTRACTORS MUST VISIT JOB SITE TO VERIFY ALL EXISTING CONDITIONS AND DIMENSIONS BEFORE SUBMITTING BIDS. REPORT ANY DISCREPANCIES OF ANY CONDITIONS WHICH MAY INTERFERE WITH THE PROPER EXECUTION OF, THE CONTRACT TO THE TENANT'S REPRESENTATIVE. REPORT DISCREPANCIES DURING BIDDING PROCESS AND BEFORE START OF CONSTRUCTION. CHANGE ORDERS NEED TO BE APPROVED BY THE CONSTRUCTION MANAGER FOR ISSUES ARISING FROM THE FIELD CONDITIONS OR CONFLICTS BETWEEN THE PLANS AND THE EXISTING CONDITIONS PRIOR TO THE COMMENCEMENT OF WORK.

	DATE	ISSUE
△	DATE	REVISION

LOCATION:

Consumer Cellular®

8283 S. AKRON ST.
SUITE #110
CENTENNIAL, CO 80112

STORE NUMBER:

CO2

PROJECT INFORMATION:

DATE: 10/14/2026
PROJECT NUMBER: 15066 - 26
STORE TYPE: TIER 2
DRAWN BY: GV REVIEWED BY: AN

TITLE:

COVER SHEET

SHEET NUMBER:

G000

RESPONSIBILITY SCHEDULE

	DIVISION & SCOPE	FURNISHED BY	INSTALLED BY	COMMENTS
01000 GENERAL				
	PLANS AND SPECIFICATIONS	OWNER	GC	
	SHOP DRAWINGS	GC	GC	
	PERMITS & FEES	OWNER	GC	
	OBTAIN ALL APPLICABLE PERMITS AND CERTIFICATE OF OCCUPANCY	GC	GC	APPLIED FOR BY OWNER/ARCH
	SCHEDULE & OBTAIN APPROVED INSPECTIONS	GC	GC	
	DEMOLITION & DISPOSAL OF MATERIAL	GC	GC	
	ASBESTOS ABATEMENT & DISPOSAL OF MATERIAL	3RD PARTY	3RD PARTY	IF REQUIRED
	ALL HAZARDOUS MATERIALS REPORTS	3RD PARTY	3RD PARTY	IF REQUIRED
	DEMOLITION – SITE/BUILDING	GC	GC	
	INTERIOR TENANT BUILD-OUT	GC	GC	
	DEMOLITION – INTERIOR	GC	GC	
	UTILITY FEES (IF NEW CONSTRUCTION)	OWNER	MUNICIPALITY	
	UTILITY SERVICE(S) AND METER(S)	OWNER	MUNICIPALITY	
	ROOF (REPAIR)	GC	GC	
	STRUCTURE	GC	GC	REQUIRED IF SHOWN ON PLANS
	EXTERIOR WALLS/REPAIRS	GC	GC	REQUIRED IF SHOWN ON PLANS
	TELEPHONE SERVICE TO BUILDING	LANDLORD	LANDLORD	
	PLUMBING MAIN SERVICE	LANDLORD	LANDLORD	
	SPRINKLER MAINS	LANDLORD	LANDLORD	
	FIRE ALARM PANEL	LANDLORD/GC	GC &/OR LANDLORD	
	CLEAN AIR SPECIFICATIONS	GC	GC	
	CLEANING (INTERIOR)	GC	GC	
	FIRE STOPPING	GC	GC	
	LABELING OF NEW & EXISTING FIRE RATED WALLS	GC	GC	
02000 SITE WORK				
	REQUIRED SITE WORK	GC	GC	
	SITE ACCESSIBILITY	GC	GC	
	SIDEWALK	GC	GC	
	PARKING LOT PAVING AND STRIPING	GC	GC	
03000 CONCRETE				
	CONCRETE SLAB	GC	GC	REQUIRED IF SHOWN ON PLANS
	SLAB - LEAVING BACK 15 FEET OF UNPOURED FOR GC TO PERFORM. IF THERE IS A SLAB LEAVE OUT.	SHELL LL	GC	
	CORE & SHELL	GC	GC	REQUIRED IF SHOWN ON PLANS
	TRENCHING FOR CONDUIT	GC	GC	
04000 MASONRY (IF REQUIRED)				
	CLOSE-UP OPENING & NEW OPENING	GC	GC	REQUIRED IF SHOWN ON PLANS
	DEMISING WALL / GYP	GC	GC	
	GYPSUM BOARD CURTAIN WALL(S), CEILING(S), SOFFIT(S), ACCESS PANELS	GC	GC	
	ALL ADDITIONAL PARTITIONS	GC	GC	
05000 METAL				
	METAL STUDS	GC	GC	
	DEMISING WALL STUDS	GC	GC	
	DEMISING WALL SECURITY MESH	GC	GC	REQUIRED IF SHOWN ON PLANS
	ALL ADDITIONAL PARTITIONS	GC	GC	
06000 WOODS AND PLASTICS				
	MILLWORK/FIXTURES	OWNER	OWNER VENDOR	FIXTURE TRUCK TO BE UNLOADED BY NFI
	ACRYLIC CUBES	OWNER	GC	
	MISC. WOOD BLOCKING, FURRING, ETC.	GC	GC	
	KITCHENETTE, SINK AND FAUCET	OWNER	GC	PROVIDED BY THE MILLWORKER
07000 THERMAL & MOISTURE PROTECTION				
	INSULATION & WATERPROOFING	GC	GC	
08000 DOORS AND HARDWARE				
	METAL DOORS & FRAMES	GC	GC	
	WOOD DOORS, FRAMES, & WOOD TRIM	GC	GC	
	EXIT DOOR (AS REQ'D)	GC	GC	
	TRIDENT EXIT DOOR LOCK	OWNER	OWNER	TO BE DONE BY OWNER VENDOR
	TRILOGY LOCK ON BOH PARTITION	GC	GC	
	INVENTORY ROOM CAGE AND DOOR/HDW	OWNER	GC	
	POLICE LOCK AND LEVER SET ON INVENTORY ROOM DOOR	OWNER	OWNER	
	SALES AREA TO BOH PARTITION AND DOOR/HDW	GC	GC	
	FINISH HARDWARE	GC	GC	
	PANIC HARDWARE	GC	GC	
	PERMANENT REMOVABLE CORES	GC	GC	
	WEATHER STRIPPING	GC	GC	
	180 DEGREE VIEWER	GC	GC	
08400 STOREFRONT				
	STOREFRONT GLASS, FRAMING, & DOORS	GC	GC	REQUIRED IF SHOWN ON PLANS
	STOREFRONT SIGNAGE	OWNER	TDI SIGNS	
	EXTERIOR SIGNAGE BLOCKING	GC	GC	
	WINDOW FILM	OWNER	TDI SIGNS	
	VESTIBULE GLASS, FRAMING, & DOORS (IF NEEDED)	GC	GC	
09000 FINISHES				
	SOFFITS	GC	GC	
	CEILING (ACOUSTIC TILE AND GRID)	GC	GC	
	GYP. BOARD WALLS & CEILING	GC	GC	
	PAINTING	GC	GC	
	RUBBER FLOOR BASE	GC	GC	
	VINYL FLOOR BASE	GC	GC	
	FLOOR PREPARATION	GC	GC	INSPECTED AFTER DEMOLITION OF EXISTING FLOORING
	WALK OFF MATS (IF NEEDED)	OWNER	GC	
	LUXURY VINYL TILE (LVT) IN SALES AREA	GC	GC	
	LUXURY VINYL TILE (LVT) IN HALLWAY	GC	GC	
	LUXURY VINYL TILE (LVT) IN RESTROOMS	GC	GC	
	ADHESIVE/ SETTING MATERIALS	GC	GC	
	TRANSITIONS/TRIM	GC	GC	
	FRP IN RESTROOMS AND MOP SINK AREA	GC	GC	
10000 SPECIALTIES				
	TOILET FIXTURES AND ACCESSORIES	GC	GC	
	TELEPHONE SYSTEMS	OWNER	OWNER	
	TELEPHONE CONDUIT	GC	GC	
	TELEPHONE BOARD	GC	GC	
12000 FURNISHINGS				
	TV'S	OWNER	GC	
	COUNTERS	OWNER	OWNER	
	BOH CABINET	OWNER	GC	
	OFFICE FURNITURE	OWNER	OWNER	
	SALES FLOOR FURNITURE	OWNER	OWNER	
	KIOSKS	OWNER	GC	
	RUGS	OWNER	OWNER	
	MILLWORK/FIXTURES	OWNER	OWNER VENDOR	
	BOH FURNITURE (TABLE AND CHAIRS)	OWNER	OWNER	
	REFRIGIRATOR	OWNER	GC	
	MICROWAVE	OWNER	GC	
	LOCKERS	OWNER	GC	
	SHELVES (BOH)	OWNER	GC	
	SHELVES (MOP SINK)	GC	GC	TO BE SOURCED LOCALLY
	MOP HOLDER	GC	GC	TO BE SOURCED LOCALLY
	TRASH CAN (RESTROOM)	GC	GC	
15000 MECHANICAL / PLUMBING				
	SPRINKLER SYSTEM/ MODIFICATIONS	GC	GC	
	SMOKE DETECTORS	GC	GC	
	FIRE EXTINGUISHERS	GC	GC	
	SHOP DRAWINGS	GC	GC	
	WATER METER	LANDLORD	LANDLORD	
	WATER SERVICE TO TENANT	LANDLORD	LANDLORD	
	ROUGH IN FOR EQUIPMENT	GC	GC	
	PLUMBING FIXTURES & FINAL CONNECTION	GC	GC	
	HVAC DUCTWORK & DIFFUSERS	GC	GC	
	HVAC	GC	GC	
	THERMOSTATS	OWNER	GC	
	WATER FILTRATION SYSTEM	GC	GC	
	WATER HEATER	GC	GC	
	HVAC SYSTEM - DISTRIBUTION	GC	GC	
	HVAC SYSTEM - UNIT/T-STAT	OWNER	GC	
	PLUMBING (BRANCH LINES NEW AND\OR MODIFICATIONS)	GC	GC	
	SPRINKLER BRANCH LINES AND HEADS	GC	GC	
16000 ELECTRICAL				
	ELECTRICAL DISTRIBUTION PANELS	GC	GC	REQUIRED IF SHOWN ON PLANS
	DISCONNECT SWITCHES	GC	GC	REQUIRED IF SHOWN ON PLANS
	STEP DOWN TRANSFORMERS	GC	GC	REQUIRED IF SHOWN ON PLANS
	METER	MUNICIPALITY	MUNICIPALITY	ORDER BY OWNER/COORDINATED BY GC
	BALANCED PANEL SCHEDULES	GC	GC	
	WIRING & CONDUIT	GC	GC	
	LIGHTING (CS ILLUMINATION)	OWNER	GC	
	2' X 2' FLOURESCENT LIGHTING	OWNER	GC	
	DECORATIVE LIGHTING	OWNER	GC	
	RECESSED LIGHTING	OWNER	GC	
	EXIT SIGNS	OWNER	GC	
	EMERGENCY LIGHTING	OWNER	GC	
	LED LIGHTS INSIDE FLOOR DISPLAY TABLES	OWNER	GC	
	LED LIGHTS INSIDE SLAT WALL AND LOGO WALL	OWNER	GC	
	ELECTRICAL STUB INS, WHIPS, RECEPTACLES AND COVERS	GC	GC	
	RECEPTACLES	GC	GC	
	P.O.S	OWNER	OWNER	
	ALL ELECTRICAL (WIRING AND OUTLETS)	GC	GC	
	FIRE ALARM DEVICES/CONNECTION TO PANEL	GC	GC	
	EXHAUST FANS	GC	GC	
	FIRE ALARM & DETECTIONS SYSTEM	GC	GC	
	ELECTRICAL TRANSFORMERS	GC	GC	REQUIRED IF SHOWN ON PLANS
	ELECTRICAL SYSTEM - MAIN PANEL	GC	GC	
	ELECTRICAL SYSTEM - SUB PANEL(S)	GC	GC	
	LIGHTING SYSTEM - SALES AREA	GC	GC	
	LIGHTING SYSTEM - BACK OF HOUSE	GC	GC	
	ELECTRICAL WIRING. OUTLETS	GC	GC	
	LIGHTING INVERTER, LCP, SWITCHES, SENSORS, DIMMERS	OWNER	GC	
	ENERGY MANAGEMENT SYSTEM AND SENSORS	GC	GC	
	LOW VOLTAGE CONDUIT	GC	GC	
	LOW VOLTAGE WIRING	OWNER	OWNER	
	TELCO BACKER BOARD	GC	GC	
	JUNCTION BOX FOR SIGNAGE	GC	GC	
	JUNCTION BOX & FINAL CONNECTION (CHECK POINT)	GC	GC	
	WR CONTROL / INTEGRATED SYSTEM	OWNER	OWNER	

SARGENTI

5840 LEGACY CIR - STE D230, PLANO, TX 75024
T|201.316.5491 ■ WWW.SARGARCH.COM

SEAL:

STATE OF COLORADO
ROBERT J. SARGENTI
305929
LICENSED ARCHITECT

DATE SIGNED: 10/15/2026

CONTRACTOR'S NOTES:

WRITTEN DIMENSIONS HOLD PREFERENCE OVER SCALED DIMENSIONS. DO NOT SCALE THE DRAWINGS. THE CONTRACTORS MUST VISIT JOB SITE TO VERIFY ALL EXISTING CONDITIONS AND DIMENSIONS BEFORE SUBMITTING BIDS. REPORT ANY DISCREPANCIES OF ANY CONDITIONS WHICH MAY INTERFERE WITH THE PROPER EXECUTION OF, THE CONTRACT TO THE TENANT'S REPRESENTATIVE. REPORT DISCREPANCIES DURING BIDDING PROCESS AND BEFORE START OF CONSTRUCTION. CHANGE ORDERS NEED TO BE APPROVED BY THE CONSTRUCTION MANAGER FOR ISSUES ARISING FROM THE FIELD CONDITIONS OR CONFLICTS BETWEEN THE PLANS AND THE EXISTING CONDITIONS PRIOR TO THE COMMENCEMENT OF WORK.

	DATE	ISSUE
△	DATE	REVISION

LOCATION:

Consumer Cellular

8283 S. AKRON ST.
SUITE #110
CENTENNIAL, CO 80112

STORE NUMBER:

CO2

PROJECT INFORMATION:

DATE: 10/14/2026
PROJECT NUMBER: 15066 - 26
STORE TYPE: TIER 2
DRAWN BY: GV REVIEWED BY: AN

TITLE:

RESPONSIBILITY SCHEDULE

SHEET NUMBER:

G001

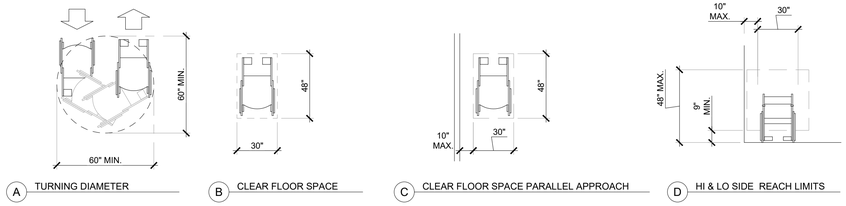

A TURNING DIAMETER | B CLEAR FLOOR SPACE | C CLEAR FLOOR SPACE PARALLEL APPROACH | D HI & LO SIDE REACH LIMITS

E MAX. FORWARD REACH OVER AN OBSTRUCTION | F MAX. SIDE REACH OVER AN OBSTRUCTION | G MAX. SIDE REACH PARALLEL APPROACH

1 WHEELCHAIR CLEAR FLOOR SPACE AND REACH REQUIREMENTS

N.T.S.

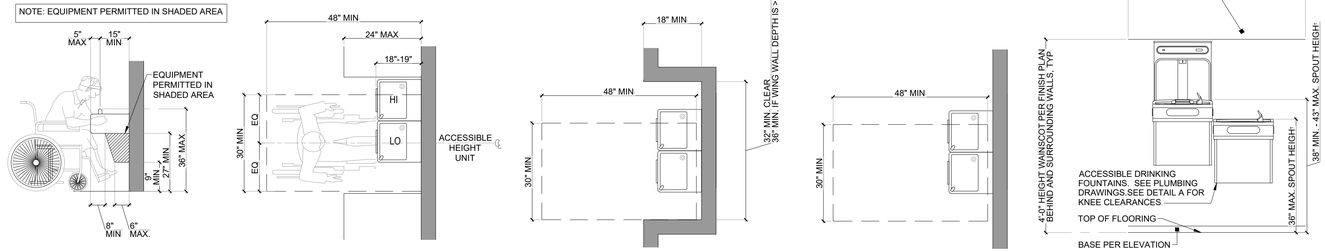

A SPOUT HEIGHT & KNEE CLR. | B CLEAR FLOOR SPACE | C BUILT-IN FOUNTAIN / COOLER | D FREE-STANDING FOUNTAIN / COOLER | E DRINKING FOUNTAIN OUTLET HT.

2 DRINKING FOUNTAIN ADA CLEARANCES

N.T.S.

NOTE:
1. ACCESSIBILITY SIGNAGE: PROVIDE ACRYLIC REVERSE SILK SCREENED SIGNS WITH INTERNATIONAL SYMBOL OF ACCESSIBILITY, RAISED LETTERS, AND BRAILLE, AT ACCESSIBLE TOILET FACILITIES; ONE FOR EACH SEX OR ONE UNISEX.

2. REFER TO ACCESSIBLE SIGNAGE TABLE ON THE ENLARGED RESTROOM SHEETS.



A ELEVATION VIEW



B RESTROOM PLAQUE



C SIGN VIEW

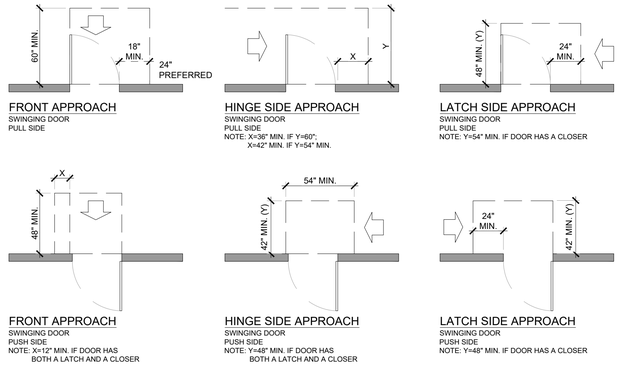

3 ACCESSIBLE RESTROOM SIGNAGE

1/4" = 1'-0"

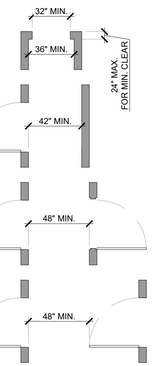

4 MANEUVERING CLEARANCES AT DOORS

N.T.S.

NOTE:
1. TACTILE SIGNAGE SHALL BE ALLOWED ON THE PUSH SIDE OF A DOOR WHEN THE FOLLOWING CONDITIONS EXIST: DOOR HAS A CLOSER, DOOR DOES NOT HAVE A HOLD OPEN DEVICE THAT PREVENTS IT FROM CLOSING.

2. REFER TO ACCESSIBLE SIGNAGE TABLE ON THE ENLARGED RESTROOM SHEETS.



A TACTILE EXIT SIGNAGE (PLASTIC SIGN)



B EXIT SIGN DETAIL

5 TACTILE EXIT SIGNAGE DETAILS

1/4" = 1'-0"

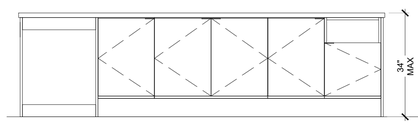

A BEVERAGE COUNTER | A1 BACK COUNTER ELEVATION

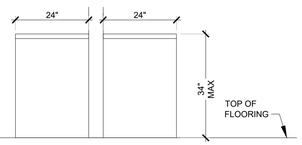

A2 BEVERAGE/BACK COUNTER SIDE ELEVATION

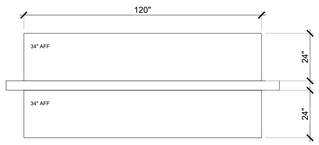

A3 BEVERAGE/BACK COUNTER PLAN VIEW

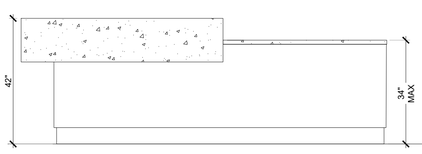

B SALES COUNTER ELEVATION

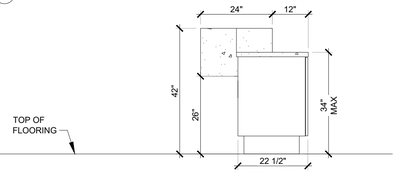

B1 SALES COUNTER SIDE ELEVATION

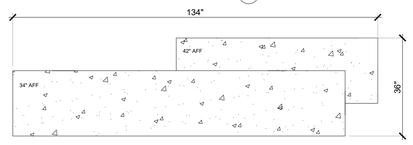

B2 SALES COUNTER PLAN VIEW

6 ADA SERVICE COUNTER ELEVATIONS

N.T.S.

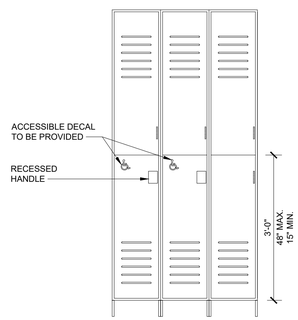

7 ADA COMPLIANT LOCKERS

N.T.S.

NOTE: FIRE EXTINGUISHERS SHALL BE INSTALLED IN ACCORDANCE WITH NFPA 10. OPERABLE PARTS SHALL BE MOUNTED WITHIN ACCESSIBLE REACH RANGES IN ACCORDANCE WITH ANSI A117.1-2009 SECTIONS 308 AND 309. PROVIDE FIRE EXTINGUISHER OPERATING HANDLE AT 48" MAXIMUM A.F.F.



8 FIRE EXTINGUISHER

N.T.S.

TACTILE EXIT SIGNAGE REQUIREMENTS

1. EACH GRADE-LEVEL EXTERIOR DOOR SHALL BE IDENTIFIED BY A TACTILE SIGN WITH THE WORD "EXIT"
2. EACH EXIT DOOR THAT LEADS DIRECTLY TO A GRADE-LEVEL EXTERIOR EXIT BY MEANS OF AN EXIT ENCLOSURE OR AN EXIT PASSAGEWAY IS IDENTIFIED BY A TACTILE EXIT SIGN WITH THE WORDS, "EXIT ROUTE".
3. EACH EXIT DOOR THAT LEADS DIRECTLY TO A GRADE-LEVEL EXTERIOR EXIT BY MEANS OF A STAIRWAY OR RAMP IS IDENTIFIED BY A TACTILE EXIT SIGN THAT STATES "EXIT STAIR DOWN", "EXIT RAMP DOWN", "EXIT STAIR UP" OR "EXIT RAMP UP", AS APPROPRIATE.
4. EACH EXIT ACCESS DOOR FROM AN INTERIOR ROOM OR AREA TO A CORRIDOR OR HALLWAY THAT IS REQUIRED TO HAVE A VISUAL EXIT SIGN IS IDENTIFIED BY A TACTILE EXIT SIGN WITH THE WORDS, "EXIT ROUTE".
5. EACH EXIT DOOR THROUGH A HORIZONTAL EXIT SHALL BE IDENTIFIED BY A SIGN WITH THE WORDS, "TO EXIT".
6. LETTERS ON SIGNS ARE RAISED 1/32", SANS SERIF UPPERCASE CHARACTERS AND ARE ACCOMPANIED BY GRADE 2 BRAILLE.
7. RAISED CHARACTERS ARE BETWEEN 5/8" AND 2" HIGH.
8. BRAILLE DOTS ARE 1/10" ON CENTER IN EACH CELL WITH 2/10" SPACE BETWEEN CELLS, MEASURED FROM THE SECOND COLUMN OF DOTS IN THE FIRST CELL TO THE FIRST COLUMN OF DOTS IN THE SECOND CELL. [NOTE: CA AND OTHER JURISDICTIONS ONLY]
9. BRAILLE DOTS ARE RAISED A MIN. OF 1/40" ABOVE THE BACKGROUND.
10. CHARACTERS AND BACKGROUND OF SIGNS IS EGGSHELL, MATTE, OR OTHER NON-GLARE FINISH.
11. CHARACTERS CONTRAST WITH THEIR BACKGROUND (LIGHT CHARACTERS ON A DARK BACKGROUND, OR DARK CHARACTERS ON A LIGHT BACKGROUND.
12. LETTERS ON SIGNS HAVE A WIDTH-TO-HEIGHT RATIO BETWEEN 3:5 AND 1:1 AND A STROKE WIDTH-TO-HEIGHT BETWEEN 1:5 AND 1:10.
13. SIGNS ARE TO BE INSTALLED ON THE WALL ADJACENT TO THE LATCH SIDE OF THE DOOR. (AT DOUBLE LEAF DOORS AND WHEN THERE IS NO WALL SPACE AT THE LATCH SIDE, SIGNS SHALL BE PLACED ON THE NEAREST ADJACENT WALL, PREFERABLY ON THE RIGHT.)
14. MOUNTING HEIGHT IS 60" MAX. FROM THE FINISHED FLOOR TO THE TOP OF THE SIGN.
15. MOUNTING LOCATION ALLOWS A PERSON TO APPROACH WITHIN 3" OF THE SIGNAGE WITHOUT ENCOUNTERING PROTRUDING OBJECTS OR STANDING WITHIN THE SWING OF A DOOR.

SARGENTI
5840 LEGACY CIR - STE D230, PLANO, TX 75024
T|201.316.5491 ■ WWW.SARGARCH.COM

SEAL:

STATE OF COLORADO ★ ROBERT J. SARGENTI 305929 ★ LICENSED ARCHITECT

DATE SIGNED: 10/15/2026

CONTRACTOR'S NOTES:

WRITTEN DIMENSIONS HOLD PREFERENCE OVER SCALED DIMENSIONS. DO NOT SCALE THE DRAWINGS. THE CONTRACTORS MUST VISIT JOB SITE TO VERIFY ALL EXISTING CONDITIONS AND DIMENSIONS BEFORE SUBMITTING BIDS. REPORT ANY DISCREPANCIES OF ANY CONDITIONS WHICH MAY INTERFERE WITH THE PROPER EXECUTION OF, THE CONTRACT TO THE TENANT'S REPRESENTATIVE. REPORT DISCREPANCIES DURING BIDDING PROCESS AND BEFORE START OF CONSTRUCTION. CHANGE ORDERS NEED TO BE APPROVED BY THE CONSTRUCTION MANAGER FOR ISSUES ARISING FROM THE FIELD CONDITIONS OR CONFLICTS BETWEEN THE PLANS AND THE EXISTING CONDITIONS PRIOR TO THE COMMENCEMENT OF WORK.

	DATE	ISSUE

△	DATE	REVISION

LOCATION:

Consumer Cellular

8283 S. AKRON ST.
SUITE #110
CENTENNIAL, CO 80112

STORE NUMBER:

CO2

PROJECT INFORMATION:

DATE: 10/14/2026
PROJECT NUMBER: 15066 - 26
STORE TYPE: TIER 2
DRAWN BY: GV REVIEWED BY: AN

TITLE:

ACCESSIBILITY DETAILS (ADAAG)

SHEET NUMBER:

G002

CODE ANALYSIS

PROJECT DESCRIPTION

TENANT IMPROVEMENT FOR A NEW CELL PHONE STORE WITH RETAIL MERCHANDISE. NEW LIGHTING AND FIXTURES WITH MIN PLUMBING AND MIN MECHANCIAL SCOPE OF WORK.

PROJECT LOCATION

8283 S. AKRON ST., SUITE #110,

CENTENNIAL, CO 80112

GOVERNING CODES

ALL WORK SHALL BE IN CONFORMANCE WITH, BUT NOT LIMITED TO, ANY STATE AND LOCAL CODES HAVING JURISDICTION AS WELL AS THE REQUIREMENTS OF THE FOLLOWING:

BUILDING	2021	INTERNATIONAL BUILDING CODE
MECHANICAL	2021	INTERNATIONAL MECHANICAL CODE
ELECTRICAL	2023	NATIONAL ELECTRIC CODE
PLUMBING	2021	INTERNATIONAL PLUMBING CODE
FIRE	2021	INTERNATIONAL FIRE CODE
ENERGY	2021	INTERNATIONAL ENERGY CONSERVATION CODE
ACCESSIBILITY	2017	ACCESSIBILITY CODE
	2010	ADA STANDARDS

PROJECT INFORMATION

CONSTRUCTION TYPE	II-B
FULLY SPRINKLERED	NO
OCCUPANCY GROUP	M - MERCANTILE
GROSS LEASED PREMISES	3,103 SQ. FT

OCCUPANT LOAD

ROOM NAME	SQ. FT.		LOAD FACTOR	OCCUPANT LOAD
SALES AREA	1,954	÷	60	33
HALLWAY	150	÷	60	3
UNISEX RESTROOM	60	÷	60	1
UTILITY ROOM	146	÷	60	3
OFFICE	51	÷	150	1
B.O.H.	362	÷	300	2
TOTAL NUMBER OF OCCUPANTS				43

EXIT REQUIREMENTS

TWO EXITS REQUIRED WHEN OCCUPANT LOAD IS GREATER THAN 49 OR COMMON PATH OF TRAVEL EXCEEDS 75FT

	REQUIRED		PROVIDED
TOTAL NUMBER OF EXITS	2		2 (E)
MAXIMUM TRAVEL DISTANCE:	90'-1"	<	200'

FOR EXIT PATH OF TRAVEL SEE EGRESS PLAN ON THIS SHEET

PLUMBING FIXTURE REQUIREMENTS

OCCUPANCY LOAD	43	÷ 2 =	21 M	22 W	
		MIN. # OF FIXTURES			

FIXTURE	LOAD FACTOR	REQUIRED	PROVIDED
WATER CLOSET	1 PER 500	1	1
LAVATORY	1 PER 750	1	1
DRINKING FOUNTAIN	1 PER 1000	1	1
SERVICE SINK	-	1	1

EXIT ILLUMINATION

EMERGENCY EXIT ILLUMINATION SHALL BE PROVIDED AS SHOWN ON ELECTRICAL SHEETS.

MUNICIPAL REVIEW

CITY OF CENTENNIAL, CO

BUILDING DEPARTMENT

13133 E. ARAPAHOE RD.,

CENTENNIAL, CO 80112

(303) 754-3321

GENERAL NOTES

1. SEE SHEET G002 FOR ACCESSIBILITY SIGNAGE AND DETAILS.
2. ACCESSIBILITY ROUTE OF TRAVEL SLOPES NOT TO EXCEED RUNNING SLOPE OF 1:20 (5%) MAXIMUM CROSS SLOPE OF 1:50 (2%).
3. SITE ACCESSIBILITY PROVIDED BY LANDLORD.
4. PROVIDE WALL MOUNTED FIRE EXTINGUISHER(S) PER FIRE MARSHAL'S INSTRUCTION.

EMERGENCY LIGHTING — DIRECTION OF EGRESS

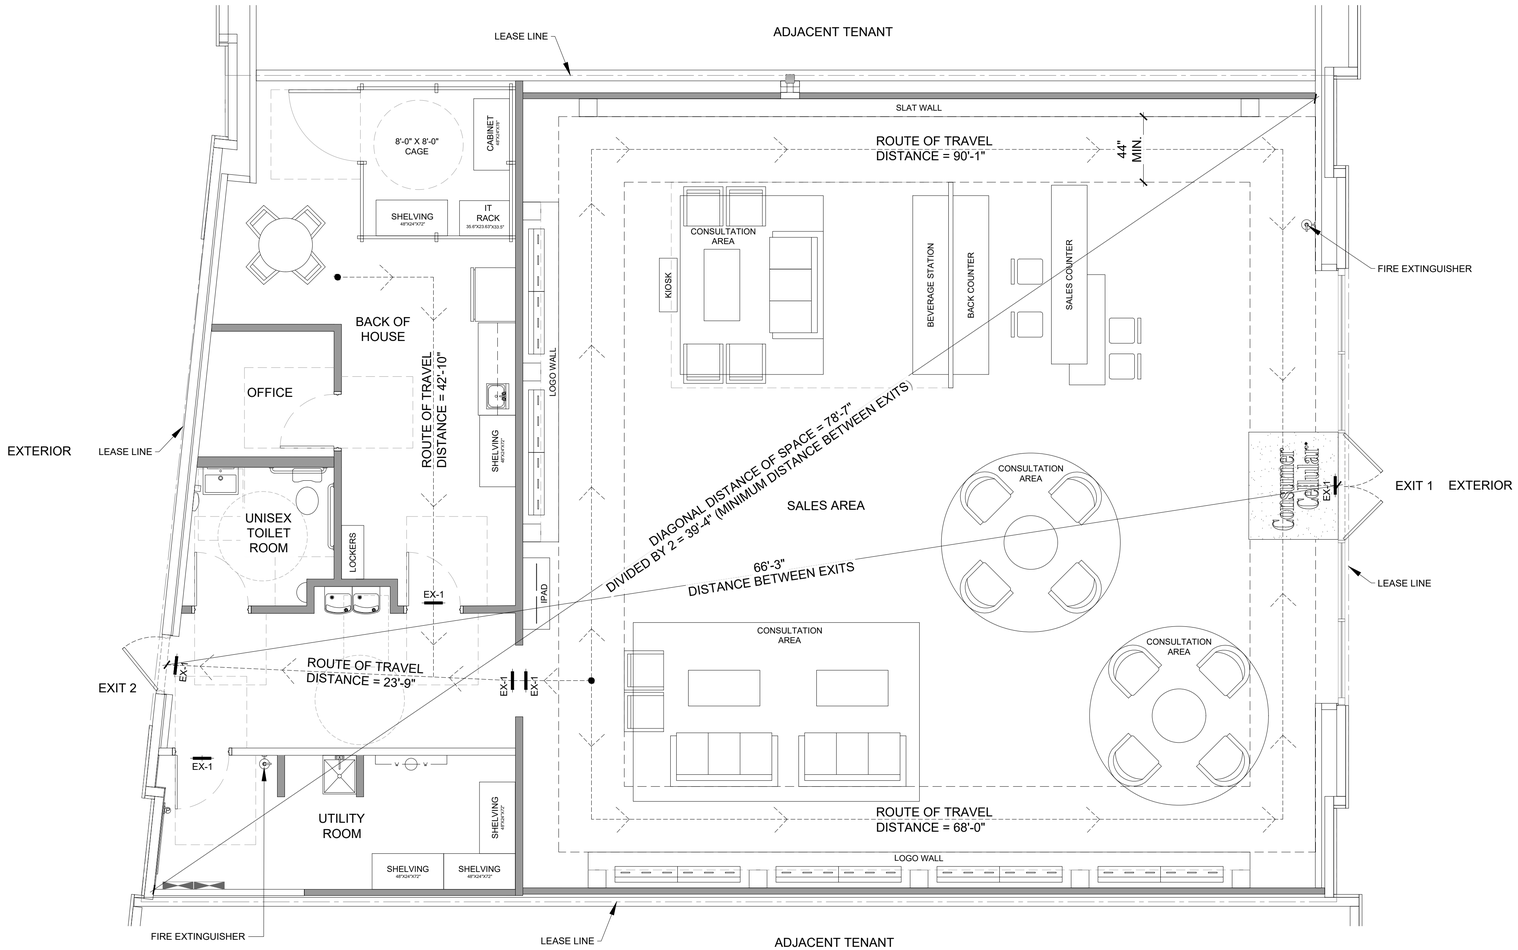

1 EGRESS PLAN

1/4" = 1'-0"

N

SARGENTI

5840 LEGACY CIR - STE D230, PLANO, TX 75024
T|201.316.5491 ■ WWW.SARGARCH.COM

SEAL:

STATE OF COLORADO
ROBERT J. SARGENTI
305929
LICENSED ARCHITECT

DATE SIGNED: 10/15/2026

CONTRACTOR'S NOTES:

WRITTEN DIMENSIONS HOLD PREFERENCE OVER SCALED DIMENSIONS. DO NOT SCALE THE DRAWINGS. THE CONTRACTORS MUST VISIT JOB SITE TO VERIFY ALL EXISTING CONDITIONS AND DIMENSIONS BEFORE SUBMITTING BIDS. REPORT ANY DISCREPANCIES OF ANY CONDITIONS WHICH MAY INTERFERE WITH THE PROPER EXECUTION OF, THE CONTRACT TO THE TENANT'S REPRESENTATIVE. REPORT DISCREPANCIES DURING BIDDING PROCESS AND BEFORE START OF CONSTRUCTION. CHANGE ORDERS NEED TO BE APPROVED BY THE CONSTRUCTION MANAGER FOR ISSUES ARISING FROM THE FIELD CONDITIONS OR CONFLICTS BETWEEN THE PLANS AND THE EXISTING CONDITIONS PRIOR TO THE COMMENCEMENT OF WORK.

	DATE	ISSUE
△	DATE	REVISION

LOCATION:

Consumer Cellular®

8283 S. AKRON ST.
SUITE #110
CENTENNIAL, CO 80112

STORE NUMBER:

CO2

PROJECT INFORMATION:

DATE: 10/14/2026

PROJECT NUMBER: 15066 - 26

STORE TYPE: TIER 2

DRAWN BY: GV REVIEWED BY: AN

TITLE:

CODE ANALYSIS & EGRESS PLAN

SHEET NUMBER:

G003

GENERAL NOTES

1. CHECK MECHANICAL AND ELECTRICAL DRAWINGS PRIOR TO DEMOLITION WITH REGARD TO UTILIZING ANY EXISTING WIRING, LINES, COMPONENTS, ETC.
2. PROVIDE TRASH CONTAINER AS REQUIRED AT LOCATION TO SUIT LANDLORD. REMOVE DEBRIS DAILY AND HAUL FROM THE SITE AT TIME TO SUIT LANDLORD.
3. NOTIFY ARCHITECTS IMMEDIATELY OF ANY DISCREPANCIES OR UNFORESEEN ITEMS NOT SHOWN ON DRAWINGS.
4. ALL REMOVED MATERIAL AND DEBRIS, NOT OTHERWISE DESIGNATED, BECOMES THE PROPERTY OF THE CONTRACTOR, WHO SHALL REMOVE IT FROM THE SITE.
5. G.C. SHALL NOT DEMOLISH ANY LOAD BEARING WALLS OR CONSTRUCTION THAT WILL COMPROMISE THE STRUCTURAL INTEGRITY OF THE EXISTING SPACE. G.C. TO NOTIFY THE ARCHITECT IMMEDIATELY OF ANY STRUCTURAL CONCERNS DURING DEMOLITION.
6. EXISTING EQUIPMENT NOT BEING USED MUST BE COMPLETELY REMOVED / DISPOSED OF PROPERLY. NOTHING CAN BE ABANDONED ABOVE THE CEILING.
7. REMOVE EXISTING ACOUSTICAL CEILING GRID AND TILES, LIGHT FIXTURES, AND GYPSUM WALLBOARD SOFFITS AS SCHEDULED FOR DEMOLITION AND AS REQUIRED BY PARTITION DEMOLITION AND NEW CONSTRUCTION WORK. MAINTAIN EXISTING CEILING WIRE HANGERS FOR FUTURE USE.
8. REMOVE EXISTING ELECTRICAL DEVICES, OUTLETS, TELEPHONE AND DATA JACKS AND THERMOSTATS IN PARTITIONS SCHEDULED FOR DEMOLITION. MODIFY EXISTING WIRING AS REQUIRED BY NEW CONSTRUCTION OR, IF NOT REQUIRED, TERMINATE AND CAP OFF AT NEAREST PANEL OR SOURCE ABOVE CEILING.
9. REMOVE EXISTING FLOOR FINISHES SCHEDULED FOR REMOVAL AND AS REQUIRED BY PARTITION DEMOLITION AND NEW CONSTRUCTION. PREPARE EXISTING FLOOR SURFACE PER MANUFACTURER FOR INSTALLATION OF NEW FLOORING MATERIAL AS INDICATED IN THESE PLANS. G.C. MAY NEED TO PERFORM A MOISTURE TEST PRIOR TO ANY DEMOLITION OR NEW FLOORING INSTALLATION. NEWLY REPLACED OR LIKE-NEW FINISHES MAY REMAIN AT THE DISCRETION OF THE CONSTRUCTION PM. G.C. TO VERIFY PRIOR TO REMOVAL. PROTECT ALL NEW FLOOR FINISHES UNTIL FINAL CLEANING.
10. REMOVE ALL CONSTRUCTION DEBRIS FROM AREA. REPAIR ALL ADJACENT DAMAGED SURFACES, AS NECESSARY. PREPARE ALL DAMAGED SURFACES FOR FINISHES AS SCHEDULED OR REFINISH TO MATCH EXISTING FINISH.
11. PROVIDE A SMOOTH, NEAT, AND CONTINUOUS APPEARANCE WHERE DEMOLITION WORK MEETS ADJACENT EXISTING WORK. REMOVE EXISTING FINISHES AS REQUIRED TO PROVIDE NEAT, STRAIGHT SEAMS AND TRANSITIONS BETWEEN EXISTING AND MATCHING NEW FINISHES.
12. IN ACCORDANCE WITH LOCAL CODES, REPLACE ALL FIRE SUPPRESSION AND FIRE ALARM EQUIPMENT DISTURBED BY DEMOLITION WORK. MAINTAIN INTEGRITY OF FIRE SUPPRESSION AND FIRE ALARM SYSTEMS.
13. IN THE CASE THAT THE EXISTING CABLE LINE, PHONE LINE AND BLOCK, T-1 LINE AND DATA CABLING ARE PRESENT, G.C. SHALL SALVAGE AND REWORK TO FACILITATE NEW INSTALLATION
14. G.C. SHALL CONSTRUCT A BARRICADE WALL AS REQUIRED. G.C. SHALL COORDINATE REQUIREMENTS WITH MALL PROPERTY MANAGEMENT.
15. BARRICADE GRAPHICS SHALL BE PROVIDED BY MALL UNLESS OTHERWISE REQUESTED. G.C. SHALL ENGAGE CONSUMER CELLULAR'S SIGN VENDOR FOR BARRICADE GRAPHICS AS REQUIRED.
16. FIRE SPRINKLER SYSTEM TO REMAIN - G.C. TO RE-WORK/ MODIFY SYSTEM AS REQUIRED FOR NEW CONSTRUCTION.
17. WHERE REQUIRED BY THE LOCAL JURISDICTION, G.C. SHALL PREPARE A "RECYCLING PLAN" TO DIVERT DEBRIS FOR RECYCLING. G.C. SHALL KEEP RECORDS OF DIVERTED MATERIAL AS REQUIRED. G.C. TO VERIFY REQUIREMENTS WITH JURISDICTION AND TO MALL OPERATIONS/ LANDLORD WHERE APPLICABLE.
18. REMOVE ALL EXISTING INTERIOR PARTITIONS, DOORS, AND DOOR FRAMES SCHEDULED FOR DEMOLITION. REMOVE ALL MILLWORK, EQUIPMENT, ETC. THAT IS ATTACHED TO PARTITIONS SCHEDULED FOR DEMOLITION.
19. REMOVE EXISTING HVAC CEILING DIFFUSERS AND RETURN GRILLES AS SCHEDULED FOR DEMOLITION AND AS REQUIRED BY PARTITION DEMOLITION AND NEW CONSTRUCTION. MODIFY EXISTING DUCTWORK AS REQUIRED BY NEW CONSTRUCTION, OR IF NOT REQUIRED, TERMINATE AND CAP OFF SUPPLY AND RETURN DUCTS AT NEAREST SOURCE ABOVE CEILING.
20. REMOVE ALL EXISTING PLUMBING FIXTURES, FITTINGS, AND PIPING AS SCHEDULED FOR DEMOLITION AND AS REQUIRED BY PARTITION DEMOLITION AND NEW CONSTRUCTION. MODIFY EXISTING PIPING AS REQUIRED BY NEW CONSTRUCTION, OR IF NOT REQUIRED, TERMINATE AND CAP OFF AT WET STACK.
21. REMOVAL/RELOCATION OF ALL CEILING EQUIPMENT (TYCO, FIRE ALARM, SPRINKLER, SHOPPER TRAK, ETC.) MUST BE PERFORMED BY THE REQUIRED VENDORS. CONSUMER CELLULAR'S VENDOR TO RELOCATE SECURITY CAMERAS AS NEEDED PER NEW FIXTURE LAYOUT. COORDINATE WITH CONSUMER CELLULAR'S PROJECT MANAGER.
22. G.C. TO CONFIRM FLOOR SLAB IS SMOOTH AND LEVEL AND NOTIFY CONSTRUCTION PM OF ANY DISCREPANCIES.
23. MAINTAIN EXISTING EXITS, EMERGENCY LIGHTING, AND ILLUMINATION MEANS OF EGRESS DURING DEMOLITION AND CONSTRUCTION AS REQUIRED BY JHA AND ALL GOVERNING CODES.
24. SAW-CUTTING SHOWN ON PLANS IS AN INDICATION OF THE INTENDED WORK FOR BIDDING AND COORDINATION PURPOSES ONLY. IT IS NOT INTENDED TO BE A SPECIFICATION OR METHOD.
25. WHEN EXISTING MECHANICAL SYSTEM IS TO REMAIN, G.C. TO CLEAN DUCTWORK, DIFFUSERS, AND REPLACE HVAC AIR FILTERS AFTER CONSTRUCTION AND CLEANUP IS COMPLETE PRIOR TO TURNING PROJECT OVER TO CONSUMER CELLULAR.
26. DURING CONSTRUCTION, THE G.C. IS TO PROVIDE A PORTABLE FIRE EXTINGUISHER WITH A RATING OF NOT LESS THAN 2-A WITHIN 75 FOOT TRAVEL DISTANCE TO ALL PORTIONS OF THE SPACE.

SHEET SYMBOLS

EXISTING WALL TO BE REMOVED

(#) KEYNOTE

SCOPE SUMMARY

1. GENERAL CONTRACTOR AND/OR SUBCONTRACTORS SHALL REVIEW THE EXISTING FACILITY TO DETERMINE THE EXTENT OF DEMOLITION REQUIRED TO INSTALL THE NEW WORK. A WRITTEN OUTLINE OF ALL REQUIRED DEMOLITION SHALL BE SUBMITTED TO THE CONSUMER CELLULAR DESCRIBING THE FOLLOWING (BUT NOT LIMITED TO):
   1.1. CONDITION OF EXISTING POWER PANELS AND TRANSFORMERS; FEASIBILITY FOR RELOCATION AND REFURBISHING, OR NEED FOR REPLACEMENT DUE TO AGE OR EXISTING CONDITION.
   1.2. CONDITION OF EXISTING GYPSUM BOARD ON EXISTING DEMISING WALLS AND RECOMMENDATION OF WHETHER TO REMOVE EXISTING OR REUSE TO BE DETERMINED IN FIELD.
   1.3. SUMMARIZE RECOMMENDATIONS FOR REUSE OF EXISTING MATERIALS, EQUIPMENT AND ACCESSORIES. ONCE REFURBISHED TO A LIKE-NEW CONDITION, ITEMIZE THE CREDIT TO THE CONTRACT.
   1.4. TENANT G.C. SHALL NOTIFY ARCHITECT OF ANY UN-NOTED EXISTING CONDITION WHICH CONFLICTS WITH THE PROJECT REQUIREMENTS AND MAY REQUIRE MODIFICATION, RELOCATION, OR REMOVAL TO COMPLETE THE PROJECT WITHIN 24 HOURS SO THAT THE NECESSARY DRAWING REVISIONS MAY BE INCORPORATED INTO THE PROJECT REQUIREMENTS.
   1.5. IN ADDITION TO THE ABOVE, REFER TO GENERAL DEMOLITION NOTES INDICATED IN SPECIFICATION DIVISION 2 - DEMOLITION / BUILDING ALTERATION.
   1.6. CONDITION OF EXISTING MECHANICAL SYSTEM; FEASIBILITY OF REUSING, RELOCATION, OR REFURBISHING EXISTING EQUIPMENT AND DUCTWORK; AND RECOMMENDATION OF REPLACEMENT, IF NECESSARY, PRIOR TO BID. SEE MECHANICAL DRAWINGS FOR SCOPE OF MECHANICAL WORK
2. WHEN EXISTING CEILING IS TO REMAIN, REPLACE INDIVIDUAL CEILING TILES IF DAMAGED OR NOT MATCHED TO ADJACENT TILES. IF MORE THAN 25% ARE DAMAGED OR NOT MATCHED TO ADJACENT TILES, G.C. TO REPORT CONDITION AND COORDINATE EXTENT OF REPLACEMENT WITH CONSTRUCTION PM.

KEYED NOTES

(##)	NOTES
1	LEASE LINE
2	EXISTING STOREFRONT SYSTEM, GLAZING AND ENTRY DOOR(S) TO REMAIN.
3	EXISTING DEMISING WALL TO REMAIN. PATCH AND REPAIR AS REQUIRED.
4	EXISTING EXTERIOR WALL AND/OR CONSTRUCTION TO REMAIN. PATCH AND REPAIR AS REQUIRED TO LIKE-NEW CONDITION.
5	EXISTING FLOOR SURFACE TO BE REMOVED IN ITS ENTIRETY. PREPARE FOR INSTALLATION OF NEW FLOORING MATERIALS AS INDICATED IN THESE PLANS. SEE SPECIFICATIONS FOR ADDITIONAL INFO.
6	EXISTING THRESHOLD TO REMAIN. REPLACE IF IT EXCEEDS 1/2" IN HEIGHT.
7	G.C TO REMOVE EXISTING GYP. BD. & ACT CEILINGS, SOFFIT, FRAMING, LIGHT FIXTURES & ANY UNUSED WIRES/CONDUITS THROUGHOUT. PREP FOR NEW FINISHES AND COORDINATE WITH RCP.
8	G.C TO REMOVE ALL EXISTING HVAC GRILLES, DIFFUSERS AND DUCTWORK THROUGHOUT. COORDINATE WITH MECHANICAL DRAWINGS.
9	EXISTING INTERIOR WALL OR PORTION OF INTERIOR WALL TO BE REMOVED IN ITS ENTIRETY.
10	EXISTING INTERIOR DOOR TO BE REMOVED IN ITS ENTIRETY.
11	EXISTING DOOR(S) TO REMAIN. REFER TO DOOR SCHEDULE FOR ADDITIONAL INFORMATION.
12	EXISTING ELECTRICAL PANEL(S) TO REMAIN. SEE ELECTRICAL DRAWINGS.
13	EXISTING RESTROOM FIXTURES TO BE REMOVED IN THEIR ENTIRETY. GC TO CAP ANY PLUMBING LINES NOT USED.
14	EXISTING COLUMN TO REMAIN.
15	NOT USED.
16	NOT USED.
17	EXISTING INTERIOR WALL OR PORTION OF EXISTING INTERIOR WALL TO REMAIN. GC TO REMOVE ANY EXISTING FINISHES AND PATCH AND REPAIR AS REQUIRED TO RECEIVE NEW FINISHES
18	EXISTING FLOOR DRAIN TO BE REMOVED. G.C TO CAP PLUMBING AT ITS SOURCE. PATCH AND REPAIR FLOORING AS REQUIRED. REFER TO PLUMBING DRAWINGS FOR MORE INFORMATION.
19	EXISTING MOP SINK TO BE REMOVED IN ITS ENTIRETY. GC TO CAP PLUMBING AT SOURCE.
20	EXISTING FURRING TO REMAIN. PATCH AND REPAIR AS REQUIRED.
21	EXISTING PHONE BOARD AND EQUIPMENT TO BE REMOVED IN ITS ENTIRETY.
22	EXISTING SOFFIT TO REMAIN. PATCH AND REPAIR AS REQUIRED TO RECEIVE NEW FINISHES.

KEYED NOTES

(##)	NOTES
23	EXISTING SECURITY GRILLE TO REMAIN. GC TO CONFIRM GRILLE IS IN PROPER WORKING ORDER.
24	EXISTING STOREFRONT SHADES TO REMAIN.
25	EXISTING WATER METER TO REMAIN. SEE PLUMBING DRAWINGS.
26	EXISTING WATER HEATER TO BE REMOVED IN ITS ENTIRETY. GC TO CAP PLUMBING AT SOURCE.
27	PORTION OF EXISTING FURRING TO BE REMOVED. GC TO PATCH AND REPAIR EXISTING WALL AS REQUIRED.
28	EXISTING WALL MOUNTED FIRE EXTINGUISHER TO BE KEPT AND RELOCATED AS NEEDED. PATCH AND REPAIR WALL AS REQUIRED TO LIKE-NEW CONDITION.
29	GC REMOVE EXISTING FLOOR-MOUNTED SECURITY GRILLE LOCK AND ASSOCIATED HARDWARE. PATCH AND REPAIR FLOOR SURFACE AFTER REMOVAL. COORDINATE WITH EXISTING SECURITY GRILLE INSTALLATION FOR RELOCATION OF LOCK/RELEASE HARDWARE TO ADJACENT WALL.
30	EXISTING ROOF DRAINS TO REMAIN.
31	GC TO CAP AND REMOVE SURFACE MOUNTED ELECTRICAL AND SHUT-OFF WATER VALVE.

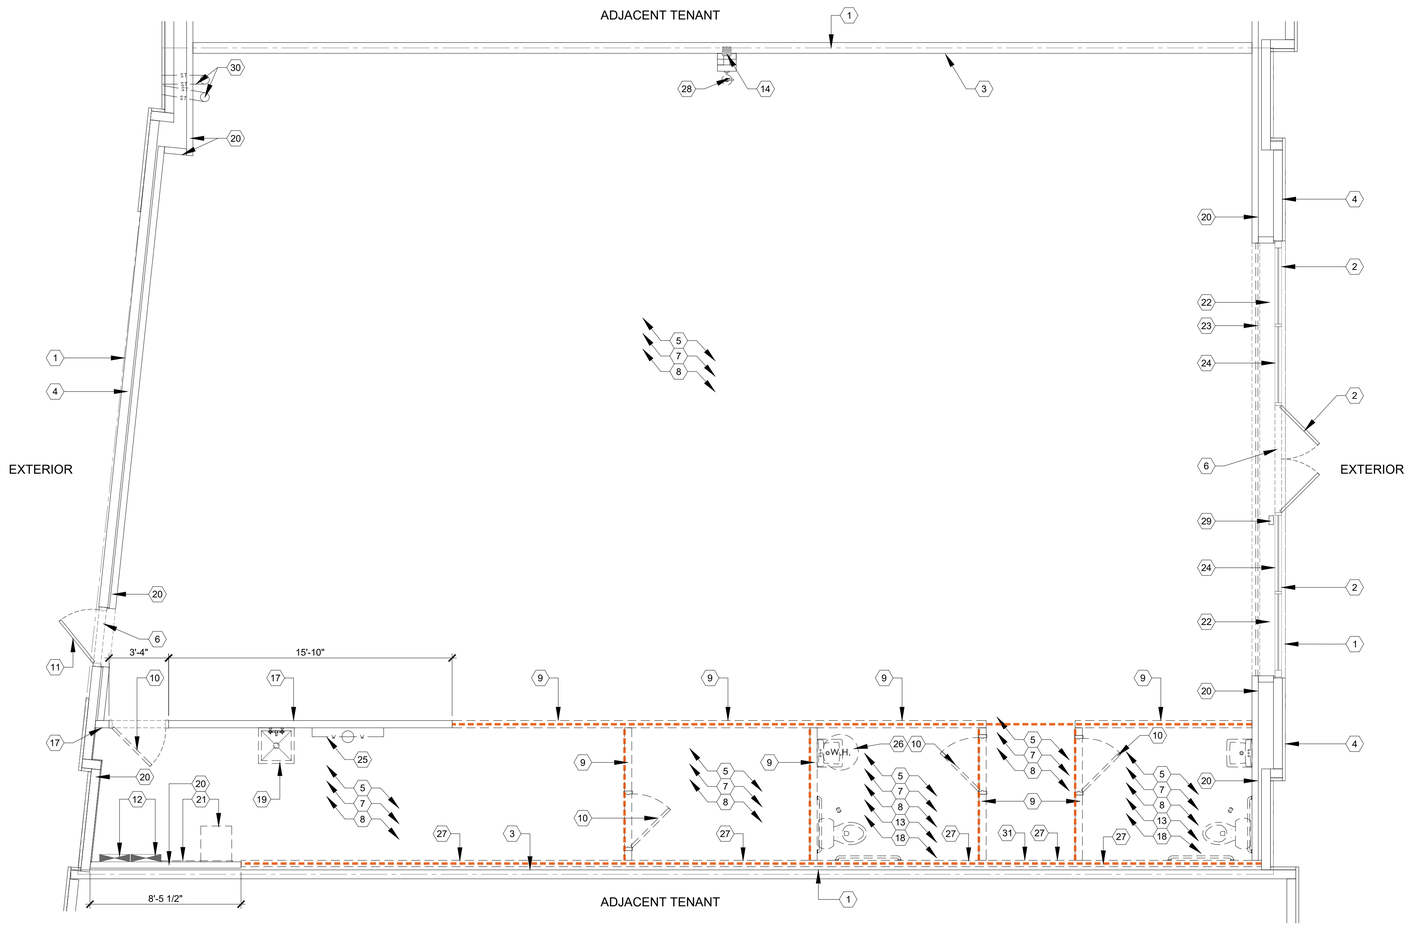

1 EXISTING CONDITIONS AND DEMOLITION PLAN
1/4" = 1'-0"

SARGENTI
5840 LEGACY CIR - STE D230, PLANO, TX 75024
T|201.316.5491 ● WWW.SARGARCH.COM

SEAL:

STATE OF COLORADO
ROBERT J. SARGENTI
305929
LICENSED ARCHITECT

DATE SIGNED: 10/15/2026

CONTRACTOR'S NOTES:

WRITTEN DIMENSIONS HOLD PREFERENCE OVER SCALED DIMENSIONS. DO NOT SCALE THE DRAWINGS. THE CONTRACTORS MUST VISIT JOB SITE TO VERIFY ALL EXISTING CONDITIONS AND DIMENSIONS BEFORE SUBMITTING BIDS. REPORT ANY DISCREPANCIES OF ANY CONDITIONS WHICH MAY INTERFERE WITH THE PROPER EXECUTION OF, THE CONTRACT TO THE TENANT'S REPRESENTATIVE. REPORT DISCREPANCIES DURING BIDDING PROCESS AND BEFORE START OF CONSTRUCTION. CHANGE ORDERS NEED TO BE APPROVED BY THE CONSTRUCTION MANAGER FOR ISSUES ARISING FROM THE FIELD CONDITIONS OR CONFLICTS BETWEEN THE PLANS AND THE EXISTING CONDITIONS PRIOR TO THE COMMENCEMENT OF WORK.

	DATE	ISSUE

△	DATE	REVISION

LOCATION:

Consumer Cellular®

8283 S. AKRON ST.
SUITE #110
CENTENNIAL, CO 80112

STORE NUMBER:

CO2

PROJECT INFORMATION:

DATE: 10/14/2026
PROJECT NUMBER: 15066 - 26
STORE TYPE: TIER 2
DRAWN BY: GV REVIEWED BY: AN

TITLE:

EXISTING CONDITIONS AND DEMOLITION PLAN

SHEET NUMBER:

D100

GENERAL NOTES

1. CHECK MECHANICAL AND ELECTRICAL DRAWINGS PRIOR TO DEMOLITION WITH REGARD TO UTILIZING ANY WIRING, LINES, COMPONENTS, ETC.
2. NOTIFY ARCHITECTS IMMEDIATELY OF ANY DISCREPANCIES OR UNFORESEEN ITEMS NOT SHOWN ON DRAWINGS.
3. ALL REMOVED MATERIAL AND DEBRIS, NOT OTHERWISE DESIGNATED BECOMES THE PROPERTY OF THE CONTRACTOR, WHO SHALL REMOVE IT FROM THE SITE.
4. SAW-CUTTING SHOWN ON PLANS IS AN INDICATION OF THE INTENDED WORK FOR BIDDING AND COORDINATION PURPOSES ONLY. IT IS NOT INTENDED TO BE AS SPECIFICATION OR METHOD.
5. SLAB PENETRATIONS SHALL BE MADE WITH PROPER LOCATION AND X-RAY IDENTIFICATION OF EXISTING REBAR AND/OR POST TENSION CABLES.

KEYED NOTES

##	NOTES
1	DIMENSIONS TO GIVE LOCATION OF SLAB TO BE TRENCHED/CORE DRILLED FOR NEW ELECTRIC. REFER TO THE SLAB DETAILS AND ELECTRICAL DRAWINGS FOR MORE INFORMATION.
2	ELECTRICAL FLOOR BOX. REFER TO ELECTRICAL DRAWINGS FOR MORE INFORMATION.
3	TRENCH TO BE USED FOR BOTH BEVERAGE AND BACK COUNTER CONDUITS. SEE ELECTRICAL DRAWINGS FOR MORE INFORMATION.

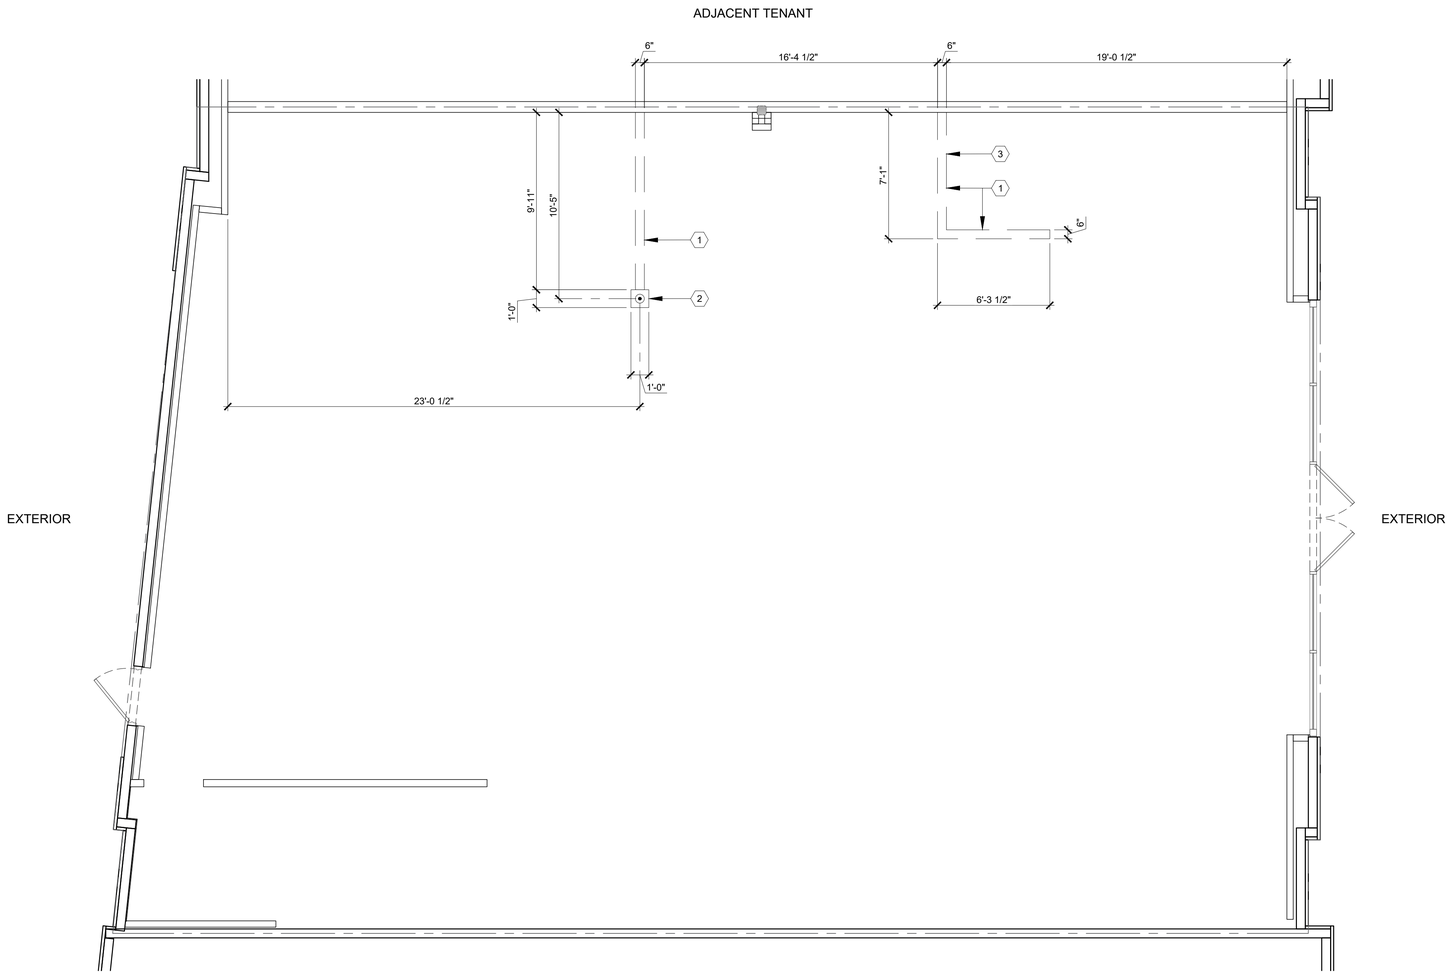

1 TRENCHING LOCATION PLAN

1/4" = 1'-0"

SARGENTI

5840 LEGACY CIR - STE D230, PLANO, TX 75024
T|201.316.5491 ★ WWW.SARGARCH.COM

SEAL:

STATE OF COLORADO ★ ROBERT J. SARGENTI 305929 ★ LICENSED ARCHITECT

DATE SIGNED: 10/15/2026

CONTRACTOR'S NOTES:

WRITTEN DIMENSIONS HOLD PREFERENCE OVER SCALED DIMENSIONS. DO NOT SCALE THE DRAWINGS. THE CONTRACTORS MUST VISIT JOB SITE TO VERIFY ALL EXISTING CONDITIONS AND DIMENSIONS BEFORE SUBMITTING BIDS. REPORT ANY DISCREPANCIES OF ANY CONDITIONS WHICH MAY INTERFERE WITH THE PROPER EXECUTION OF, THE CONTRACT TO THE TENANT'S REPRESENTATIVE. REPORT DISCREPANCIES DURING BIDDING PROCESS AND BEFORE START OF CONSTRUCTION. CHANGE ORDERS NEED TO BE APPROVED BY THE CONSTRUCTION MANAGER FOR ISSUES ARISING FROM THE FIELD CONDITIONS OR CONFLICTS BETWEEN THE PLANS AND THE EXISTING CONDITIONS PRIOR TO THE COMMENCEMENT OF WORK.

	DATE	ISSUE
△	DATE	REVISION

LOCATION:

Consumer Cellular®

8283 S. AKRON ST.
SUITE #110
CENTENNIAL, CO 80112

STORE NUMBER:

CO2

PROJECT INFORMATION:

DATE: 10/14/2026
PROJECT NUMBER: 15066 - 26
STORE TYPE: TIER 2
DRAWN BY: GV REVIEWED BY: AN

TITLE:

TRENCHING LOCATION PLAN

SHEET NUMBER:

D101

SHEET SYMBOLS

- # — SEE SHEET A500 FOR WALL CONFIGURATION, CONSTRUCTION AND INSULATION DETAILS
- EXISTING AREA N.I.C.
- DECK HEIGHT / DECK TYPE @ XX'-X" / DECK TYPE
- EXISTING DOOR. PATCH AND REPAIR TO "AS-NEW" CONDITION AS NECESSARY
- NEW DOOR AS SCHEDULED
- # - DOOR NUMBER / DOOR TYPE

NOTE: SEE SHEET A600 FOR DOOR SCHEDULE AND DETAILS.

GENERAL NOTES

1. G.C. TO FIELD VERIFY ALL DIMENSIONS AND NOTIFY ARCHITECTS IMMEDIATELY OF ANY DISCREPANCIES OR UNFORESEEN ITEMS NOT SHOWN ON DRAWINGS.
2. FOR ALL PARTITION CONNECTION DETAILS (TOP AND BOTTOM) SEE SHEET A500.
3. ALL ANGLED WALLS ARE 45°, 90°, OR 135° U.O.N.
4. MAINTAIN FIRE RESISTANCE RATING FOR ALL TENANT DEMISING WALLS.
5. PROVIDE WATER RESISTANT GYPSUM BOARD AT ALL WET LOCATIONS (UTILITY SINK, KITCHENETTE, DRINKING FOUNTAIN, TOILET ROOM, ETC.)
6. G.C. TO COORDINATE LOCATION OF ELECTRICAL FLOOR BOXES WITH ELECTRICAL DRAWINGS AND FIXTURE PLAN.
7. WHERE EXISTING INSULATION IS REMOVED OR MISSING, PATCH AND REPLACE INSULATION TO MATCH EXISTING CONDITIONS AND MAINTAIN REQUIRED R-VALUES.
8. ALL DOORS TO BE LOCATED 4" FROM PERPENDICULAR WALL UNLESS OTHERWISE NOTED. ALL DOORS DIMENSIONED TO ROUGH OPENING OF DOOR.
9. ALL DIMENSIONS ARE FROM FACE OF GYPSUM BOARD TO FACE OF GYPSUM BOARD UNLESS OTHERWISE NOTED.
10. SLAB PENETRATIONS SHALL BE MADE WITH PROPER LOCATION AND X-RAY IDENTIFICATION OF EXISTING REBAR AND/OR POST TENSION CABLES.
11. GYPSUM BOARD INSTALLED IN WET AREAS SUCH AS KITCHENS AND RESTROOMS SHALL BE AT LEAST WATER RESISTANT (GREEN BOARD) OR AN EQUIVALENT WATERPROOF SHEATHING MATERIAL.

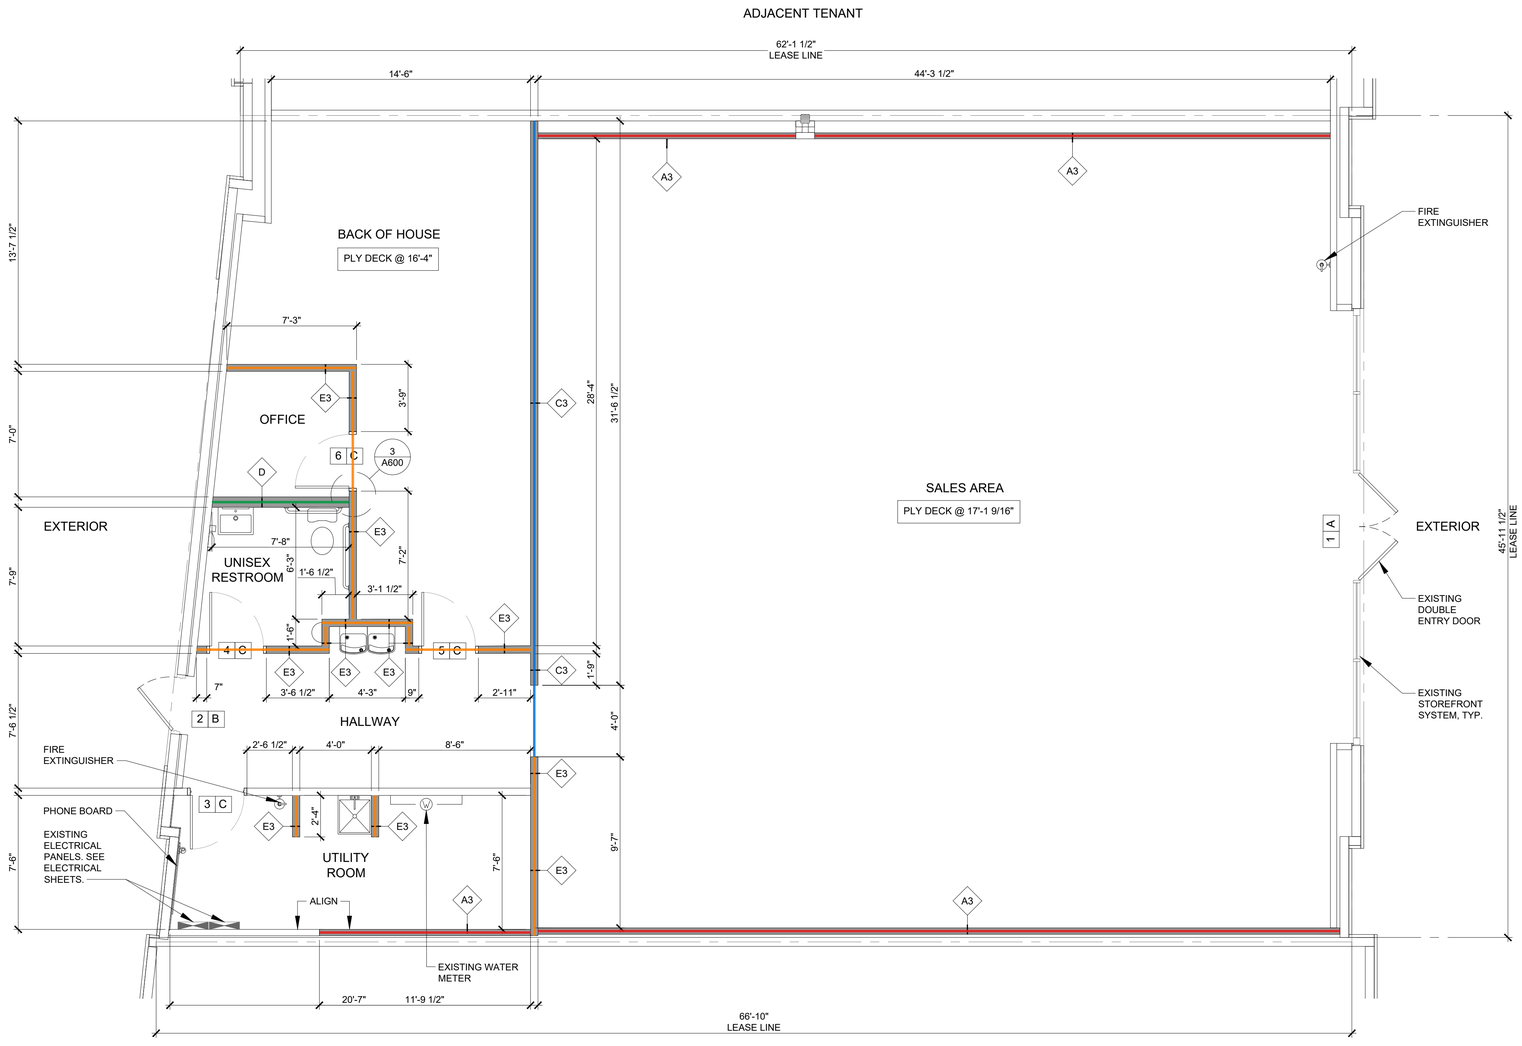

1 CONSTRUCTION FLOOR PLAN
1/4" = 1'-0"

TAKE-OFF LEGEND - A100 (partition schedule order)
A3 - 4 wall(s) - 89.88 LF
C3 - 1 wall(s) - 35.54 LF
D - 1 wall(s) - 7.67 LF
E3 - 13 wall(s) - 57.45 LF

SARGENTI
5840 LEGACY CIR - STE D230, PLANO, TX 75024
T|201.316.5491 ■ WWW.SARGARCH.COM

SEAL:

STATE OF COLORADO
ROBERT J. SARGENTI
305929
LICENSED ARCHITECT

DATE SIGNED: 10/15/2026

CONTRACTOR'S NOTES:

WRITTEN DIMENSIONS HOLD PREFERENCE OVER SCALED DIMENSIONS. DO NOT SCALE THE DRAWINGS. THE CONTRACTORS MUST VISIT JOB SITE TO VERIFY ALL EXISTING CONDITIONS AND DIMENSIONS BEFORE SUBMITTING BIDS. REPORT ANY DISCREPANCIES OF ANY CONDITIONS WHICH MAY INTERFERE WITH THE PROPER EXECUTION OF, THE CONTRACT TO THE TENANT'S REPRESENTATIVE. REPORT DISCREPANCIES DURING BIDDING PROCESS AND BEFORE START OF CONSTRUCTION. CHANGE ORDERS NEED TO BE APPROVED BY THE CONSTRUCTION MANAGER FOR ISSUES ARISING FROM THE FIELD CONDITIONS OR CONFLICTS BETWEEN THE PLANS AND THE EXISTING CONDITIONS PRIOR TO THE COMMENCEMENT OF WORK.

	DATE	ISSUE
△	DATE	REVISION

LOCATION:

Consumer Cellular

8283 S. AKRON ST.
SUITE #110
CENTENNIAL, CO 80112

STORE NUMBER:

CO2

PROJECT INFORMATION:

DATE: 10/14/2026
PROJECT NUMBER: 15066 - 26
STORE TYPE: TIER 2
DRAWN BY: GV
REVIEWED BY: AN

TITLE:

CONSTRUCTION FLOOR PLAN

SHEET NUMBER:

A100

SHEET SYMBOLS

ROOM NAME
FLR-#
B-#
PT-#

FLOOR FINISH TAG
BASE FINISH TAG
WALL FINISH TAG

EXISTING AREA N.I.C.

18"X18" VCT

12"X24" LVT

NOTE: ALL EQUIPMENT, FINISHES, FIXTURES AND FURNITURE TO BE INSTALLED PER MANUFACTURER'S RECOMMENDATIONS. SEE SHEET A700 FOR ALL SCHEDULES.

GENERAL NOTES

1. SEE SHEET A502 FOR FLOOR TRANSITION AND BASE DETAILS.
2. PREPARE EXISTING FLOOR SURFACE PER MANUFACTURER SPECIFICATIONS FOR INSTALLATION OF NEW FLOORING MATERIALS AS INDICATED IN THESE PLANS. SEE SPECIFICATIONS AND MANUFACTURER INSTRUCTIONS FOR ADDITIONAL FLOOR INSTALLATION NOTES. CLEAN AND FINISH FLOOR PER MANUFACTURER INSTRUCTIONS.
3. FOR FLOOR FINISHES, COMPLY WITH THESE RECOMMENDATIONS AT MINIMUM OR NOT LESS THAN MANUFACTURER'S WRITTEN INSTRUCTIONS. REFER TO MANUFACTURER'S INSTALLATION SPECIFICATIONS FOR ALL FINISHES INCLUDING FLOOR LEVELING REQUIREMENTS, EXPANSION SPACES, VAPOR BARRIERS, UNDERLAYMENT, SITE CONDITIONS, ETC.
   - 3.1. SUBFLOOR PREPARATION: GRIND HIGH SPOTS AND FILL LOW SPOTS TO PRODUCE A MAXIMUM 1/8" (3-MM) DEVIATION IN ANY DIRECTION WHEN CHECKED WITH A 10' (3-M) STRAIGHT EDGE
   - 3.2. EXPANSION: PROVIDE EXPANSION SPACE AT WALLS AND OTHER OBSTRUCTIONS AND TERMINATIONS OF FLOORING OF NOT LESS THAN DIRECTED BY MANUFACTURER.
   - 3.3. PROTECTION: PROVIDE FLOOR PROTECTION UP UNTIL FINAL CLEANING.
4. CENTER FLOORING WITHIN EACH ROOM. FIRST PLANK SHOULD BE CENTERED BETWEEN THE DEMISING WALLS AND PLACED SO THAT PARTIAL PLANKS ARE NEAR THE DEMISING WALLS AND UNDERNEATH THE SYSTEM WALL UNLESS OTHERWISE NOTED.

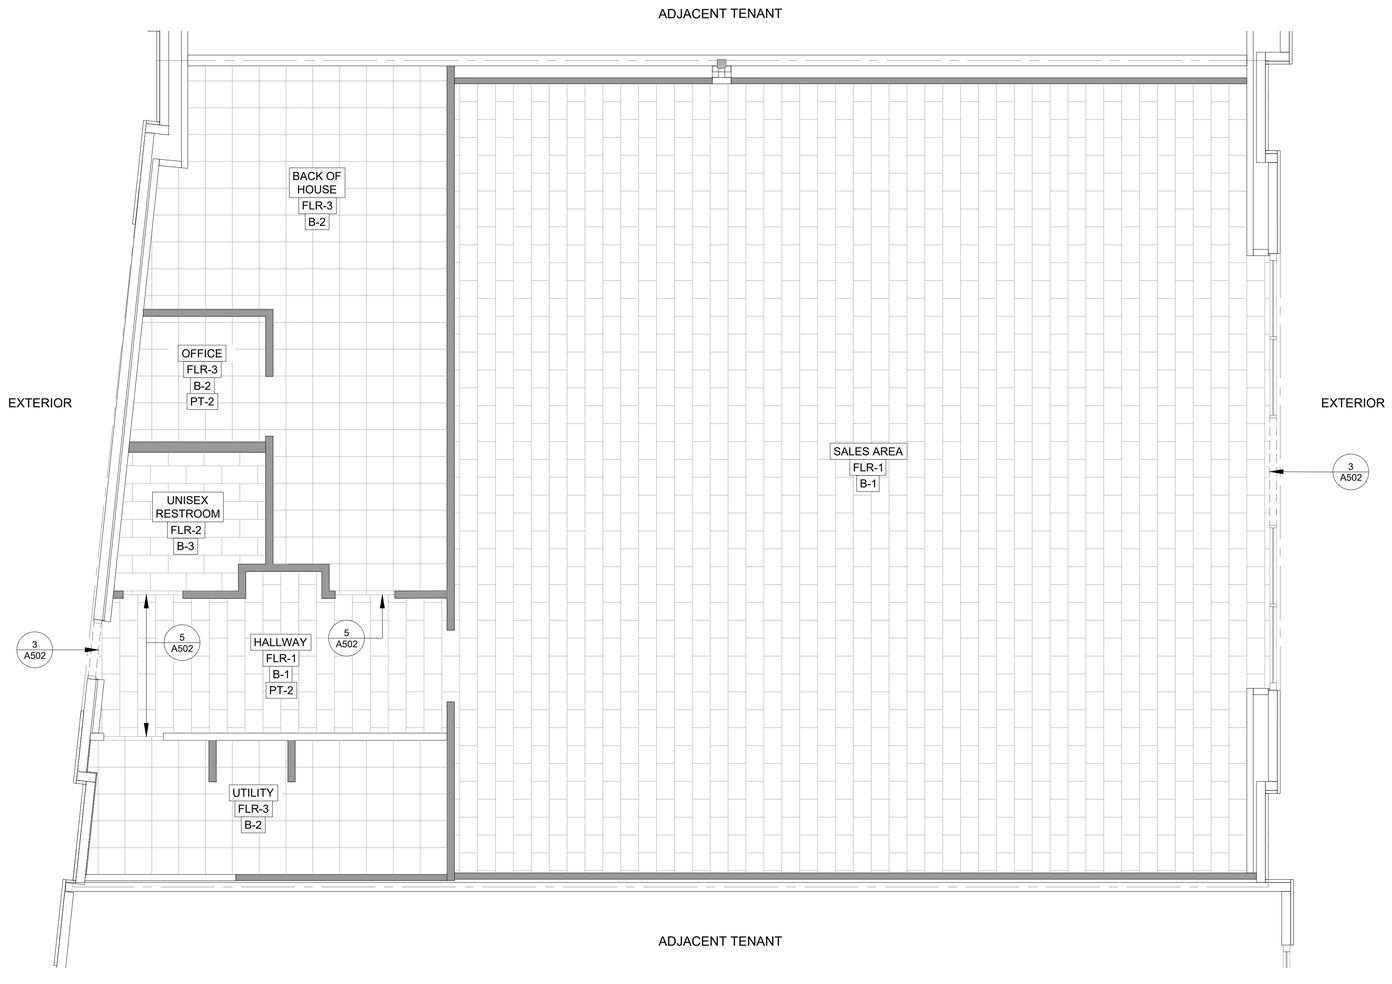

1 FINISH PLAN
1/4" = 1'-0"

SARGENTI
5840 LEGACY CIR - STE D230, PLANO, TX 75024
T|201.316.5491 ★ WWW.SARGARCH.COM

SEAL:

STATE OF COLORADO
ROBERT J. SARGENTI
305929
LICENSED ARCHITECT

DATE SIGNED: 10/15/2026

CONTRACTOR'S NOTES:

WRITTEN DIMENSIONS HOLD PREFERENCE OVER SCALED DIMENSIONS. DO NOT SCALE THE DRAWINGS. THE CONTRACTORS MUST VISIT JOB SITE TO VERIFY ALL EXISTING CONDITIONS AND DIMENSIONS BEFORE SUBMITTING BIDS. REPORT ANY DISCREPANCIES OF ANY CONDITIONS WHICH MAY INTERFERE WITH THE PROPER EXECUTION OF, THE CONTRACT TO THE TENANT'S REPRESENTATIVE. REPORT DISCREPANCIES DURING BIDDING PROCESS AND BEFORE START OF CONSTRUCTION. CHANGE ORDERS NEED TO BE APPROVED BY THE CONSTRUCTION MANAGER FOR ISSUES ARISING FROM THE FIELD CONDITIONS OR CONFLICTS BETWEEN THE PLANS AND THE EXISTING CONDITIONS PRIOR TO THE COMMENCEMENT OF WORK.

	DATE	ISSUE

△	DATE	REVISION

LOCATION:

Consumer Cellular

8283 S. AKRON ST.
SUITE #110
CENTENNIAL, CO 80112

STORE NUMBER:

CO2

PROJECT INFORMATION:

DATE: 10/14/2026
PROJECT NUMBER: 15066 - 26
STORE TYPE: TIER 2
DRAWN BY: GV REVIEWED BY: AN

TITLE:

FINISH PLAN

SHEET NUMBER:

A101

GENERAL NOTES

1. G.C. TO FIELD VERIFY ALL DIMENSIONS AND NOTIFY ARCHITECTS IMMEDIATELY OF ANY DISCREPANCIES OR UNFORESEEN ITEMS NOT SHOWN ON DRAWINGS.
2. G.C. TO VERIFY THAT ADA COUNTERTOPS COMPLY WITH C1/G002
3. FIXTURES FURNISHED BY CONSUMER CELLULAR AND INSTALLED BY G.C. OR FIXTURE VENDOR. REFER TO FIXTURE MANUFACTURER INSTRUCTIONS FOR ALL ATTACHMENTS TO WALL AND FLOOR. PROVIDE ALL BLOCKING AND ANCHORS AS REQUIRED.
4. G.C. TO COORDINATE FLOOR POWER WITH ELECTRICAL SHEETS AND FIXTURE PLAN.
5. RELOCATE ALL THERMOSTATS AND OTHER WALL MOUNTED DEVICES AS PER LOCAL CODE AS REQUIRED PER NEW FIXTURE LAYOUT. COORDINATE WITH CONSTRUCTION PM/ARCHITECT.

SHEET SYMBOLS

EXISTING AREA N.I.C.

LINETYPE INDICATES ACCESSIBLE CLEARANCE

F – 1 FIXTURE TAG

X# / X#### EXTERIOR ELEVATION TAG

X1 / X2 X### X4 / X3 INTERIOR ELEVATION TAG

X# / X### DETAIL TAG

NOTE: ALL EQUIPMENT, FINISHES, FIXTURES AND FURNITURE TO BE INSTALLED PER MANUFACTURER'S RECOMMENDATIONS. SEE SHEET A700 FOR ALL SCHEDULES.

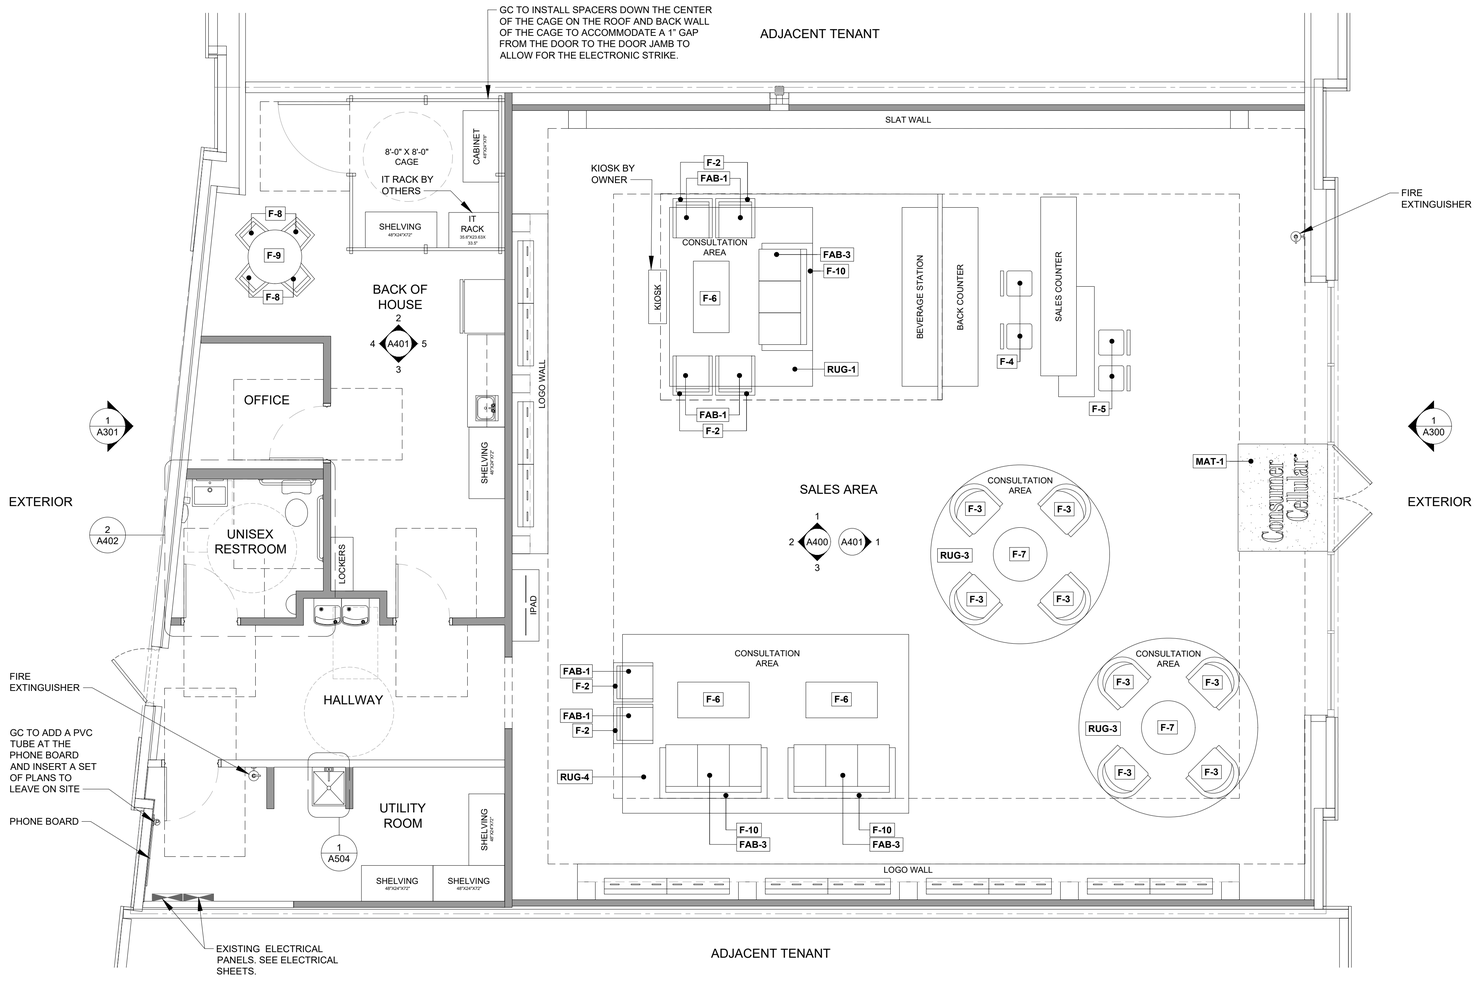

1 FURNITURE FLOOR PLAN

1/4" = 1'-0"

SARGENTI

5840 LEGACY CIR - STE D230, PLANO, TX 75024
T|201.316.5491 ● WWW.SARGARCH.COM

SEAL:

STATE OF COLORADO
ROBERT J. SARGENTI
305929
LICENSED ARCHITECT

DATE SIGNED: 10/15/2026

CONTRACTOR'S NOTES:

WRITTEN DIMENSIONS HOLD PREFERENCE OVER SCALED DIMENSIONS. DO NOT SCALE THE DRAWINGS. THE CONTRACTORS MUST VISIT JOB SITE TO VERIFY ALL EXISTING CONDITIONS AND DIMENSIONS BEFORE SUBMITTING BIDS. REPORT ANY DISCREPANCIES OF ANY CONDITIONS WHICH MAY INTERFERE WITH THE PROPER EXECUTION OF, THE CONTRACT TO THE TENANT'S REPRESENTATIVE. REPORT DISCREPANCIES DURING BIDDING PROCESS AND BEFORE START OF CONSTRUCTION. CHANGE ORDERS NEED TO BE APPROVED BY THE CONSTRUCTION MANAGER FOR ISSUES ARISING FROM THE FIELD CONDITIONS OR CONFLICTS BETWEEN THE PLANS AND THE EXISTING CONDITIONS PRIOR TO THE COMMENCEMENT OF WORK.

	DATE	ISSUE
△	DATE	REVISION

LOCATION:

Consumer Cellular®

8283 S. AKRON ST.
SUITE #110
CENTENNIAL, CO 80112

STORE NUMBER:

CO2

PROJECT INFORMATION:

DATE: 10/14/2026
PROJECT NUMBER: 15066 - 26
STORE TYPE: TIER 2
DRAWN BY: GV REVIEWED BY: AN

TITLE:

FURNITURE FLOOR PLAN

SHEET NUMBER:

A102

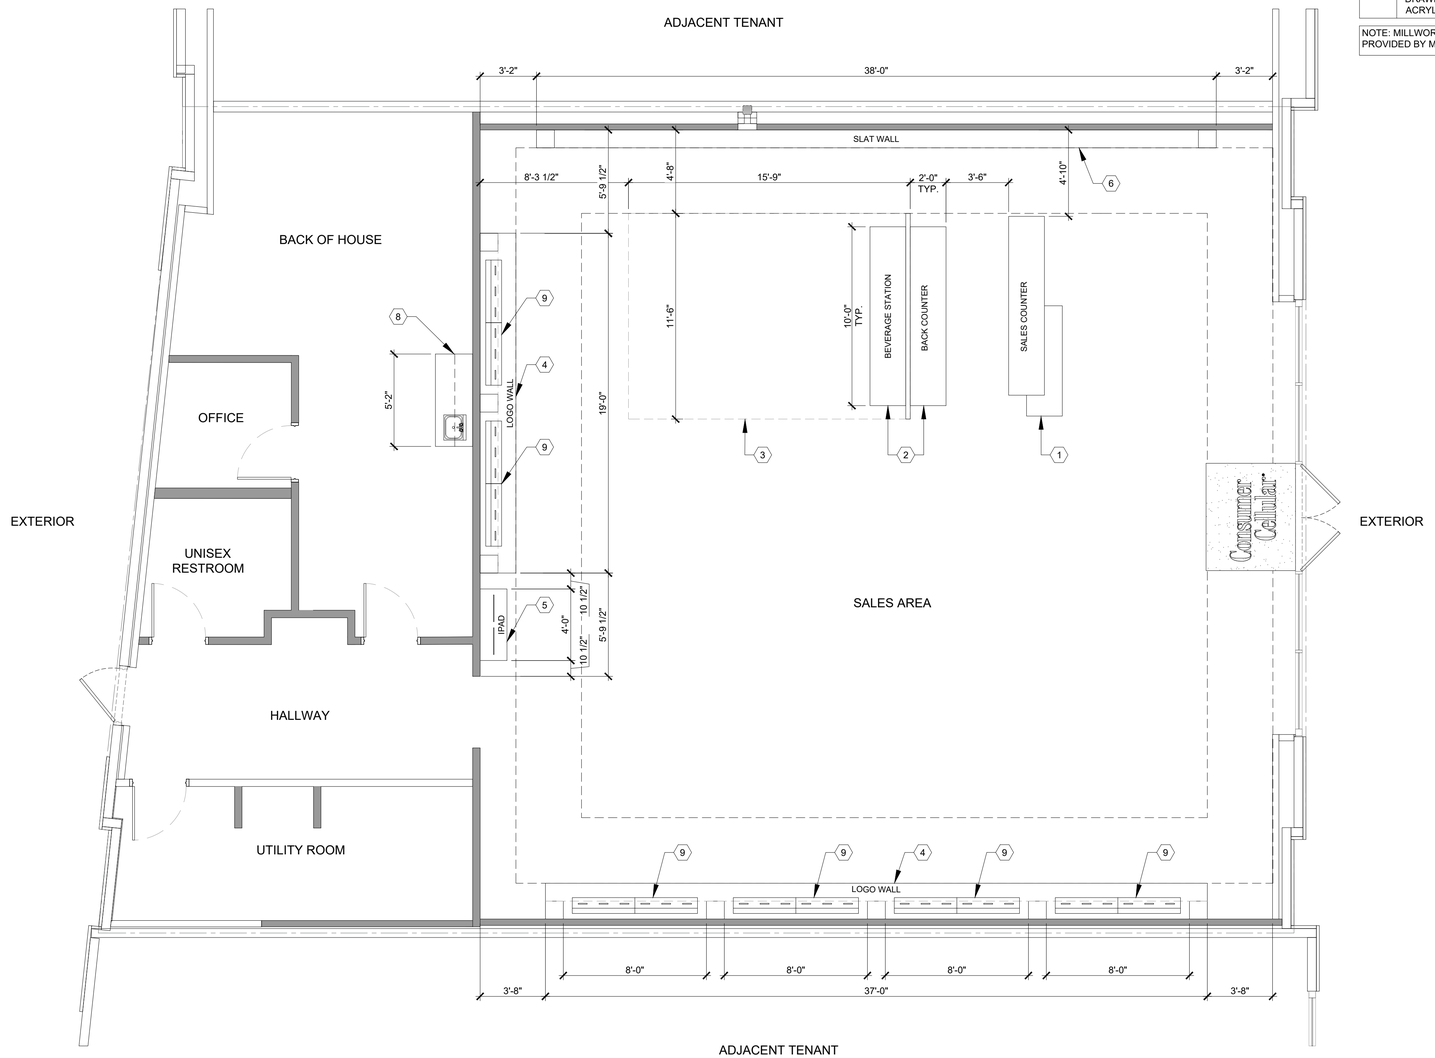

1 MILLWORK FLOOR PLAN

1/4" = 1'-0"

GENERAL NOTES

1. G.C. TO FIELD VERIFY ALL DIMENSIONS AND NOTIFY ARCHITECTS IMMEDIATELY OF ANY DISCREPANCIES OR UNFORESEEN ITEMS NOT SHOWN ON DRAWINGS.
2. G.C. TO VERIFY THAT ADA COUNTERTOPS COMPLY WITH C1/G002
3. FIXTURES FURNISHED BY CONSUMER CELLULAR AND INSTALLED BY G.C. OR FIXTURE VENDOR. REFER TO FIXTURE MANUFACTURER INSTRUCTIONS FOR ALL ATTACHMENTS TO WALL AND FLOOR. PROVIDE ALL BLOCKING AND ANCHORS AS REQUIRED. SEE SHEET A104 FOR ADDITIONAL INFORMATION.
4. G.C. TO COORDINATE FLOOR POWER WITH ELECTRICAL SHEETS AND FIXTURE PLAN.
5. RELOCATE ALL THERMOSTATS AND OTHER WALL MOUNTED DEVICES AS PER LOCAL CODE AS REQUIRED PER NEW FIXTURE LAYOUT. COORDINATE WITH CONSTRUCTION PM/ARCHITECT.

KEYED NOTES

(##)	NOTES
1	POS COUNTER
2	BEVERAGE STATION & BACK COUNTER
3	WOOD TRELLIS TO BE INSTALLED 18" MIN. BELOW ACT CEILING. GC TO PREP ABOVE THE CEILING FOR TRELLIS INSTALL, REACH OUT TO K & J WOODWORKS FOR INSTALL DRAWINGS
4	LOGO WALL
5	IPAD DISPLAY
6	SLAT WALL
7	NOT USED
8	KITCHENETTE
9	ACRYLIC DISPLAY BOXES. G.C. TO ADD A PLUG TO THE POWER SIDE OF THE LIGHT DRIVER TO BE PLUGGED INTO THE QUADS FOR ACRYLIC BOXES AT THE LOGO WALL. SEE ELECTRICAL AND MILLWORK DRAWINGS FOR ADDITIONAL INFORMATION. GC TO MAKE FINAL CONNECTIONS BETWEEN ALL UL-LISTED ACRYLIC BOX EQUIPMENT AND ADJACENT WALL OUTLETS AS SHOWN ON PLANS.

NOTE: MILLWORK DRAWINGS ARE FOR REFERENCE ONLY. G.C. TO REFER TO INSTALL DRAWINGS PROVIDED BY MILLWORK VENDOR FOR ADDITIONAL INFORMATION.

SARGENTI

5840 LEGACY CIR - STE D230, PLANO, TX 75024
T|201.316.5491 ★ WWW.SARGARCH.COM

SEAL:

STATE OF COLORADO ★ ROBERT J. SARGENTI 305929 ★ LICENSED ARCHITECT

DATE SIGNED: 10/15/2026

CONTRACTOR'S NOTES:

WRITTEN DIMENSIONS HOLD PREFERENCE OVER SCALED DIMENSIONS. DO NOT SCALE THE DRAWINGS. THE CONTRACTORS MUST VISIT JOB SITE TO VERIFY ALL EXISTING CONDITIONS AND DIMENSIONS BEFORE SUBMITTING BIDS. REPORT ANY DISCREPANCIES OF ANY CONDITIONS WHICH MAY INTERFERE WITH THE PROPER EXECUTION OF, THE CONTRACT TO THE TENANT'S REPRESENTATIVE. REPORT DISCREPANCIES DURING BIDDING PROCESS AND BEFORE START OF CONSTRUCTION. CHANGE ORDERS NEED TO BE APPROVED BY THE CONSTRUCTION MANAGER FOR ISSUES ARISING FROM THE FIELD CONDITIONS OR CONFLICTS BETWEEN THE PLANS AND THE EXISTING CONDITIONS PRIOR TO THE COMMENCEMENT OF WORK.

	DATE	ISSUE
△	DATE	REVISION

LOCATION:

Consumer Cellular

8283 S. AKRON ST.
SUITE #110
CENTENNIAL, CO 80112

STORE NUMBER:

CO2

PROJECT INFORMATION:

DATE: 10/14/2026
PROJECT NUMBER: 15066 - 26
STORE TYPE: TIER 2
DRAWN BY: GV REVIEWED BY: AN

TITLE:

MILLWORK FLOOR PLAN

SHEET NUMBER:

A103

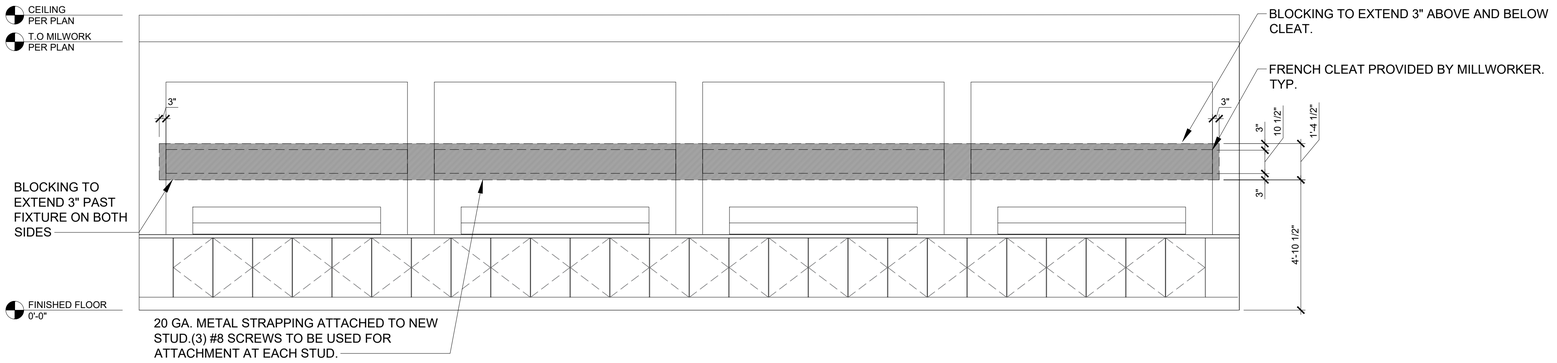

1 TYPICAL LOGO WALL BLOCKING

3/8" = 1'-0"

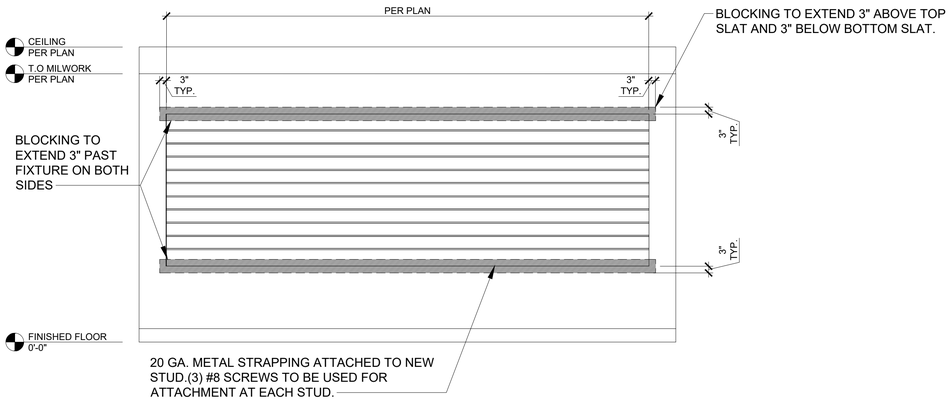

2 TYPICAL SLAT WALL BLOCKING

3/8" = 1'-0"

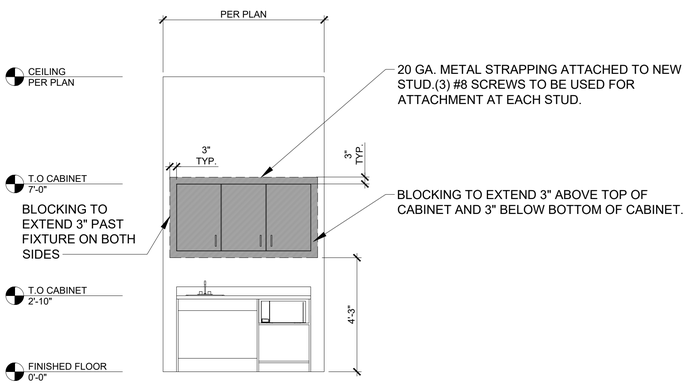

3 TYPICAL KITCHENETTE BLOCKING

3/8" = 1'-0"

GENERAL NOTES

1. ATTACH MILLWORK PER MANUFACTURER'S SPECIFICATIONS.
2. FOR SEISMIC ZONES, CONFIRM SCREWS ARE SUFFICIENT FOR SITE SPECIFIC SEISMIC LOADS.

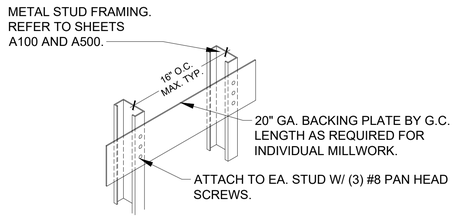

NOTES:

1. THIS BLOCKING IS FOR ELEMENTS WITH A MAXIMUM VERTICAL LOAD OF 40 LBS PER LINEAR FOOT AT A MAXIMUM OF 7" FROM FACE OF WALL.
2. REFER TO INDIVIDUAL DETAILS AND MILLWORK INSTALLATION INSTRUCTIONS FOR REQUIRED SCREW TYPE TO ATTACH ITEMS TO BLOCKING. WHEN NOT SPECIFICALLY INDICATED USE MIN. #8 SELF TAPPING SHEET METAL SCREWS.

4 TYPICAL METAL BLOCKING DETAIL

1" = 1'-0"

SARGENTI
5840 LEGACY CIR - STE D230, PLANO, TX 75024
T|201.316.5491 ■ WWW.SARGARCH.COM

SEAL:

STATE OF COLORADO ★ ROBERT J. SARGENTI 305929 ★ LICENSED ARCHITECT

DATE SIGNED: 10/15/2026

CONTRACTOR'S NOTES:

WRITTEN DIMENSIONS HOLD PREFERENCE OVER SCALED DIMENSIONS. DO NOT SCALE THE DRAWINGS. THE CONTRACTORS MUST VISIT JOB SITE TO VERIFY ALL EXISTING CONDITIONS AND DIMENSIONS BEFORE SUBMITTING BIDS. REPORT ANY DISCREPANCIES OF ANY CONDITIONS WHICH MAY INTERFERE WITH THE PROPER EXECUTION OF, THE CONTRACT TO THE TENANT'S REPRESENTATIVE. REPORT DISCREPANCIES DURING BIDDING PROCESS AND BEFORE START OF CONSTRUCTION. CHANGE ORDERS NEED TO BE APPROVED BY THE CONSTRUCTION MANAGER FOR ISSUES ARISING FROM THE FIELD CONDITIONS OR CONFLICTS BETWEEN THE PLANS AND THE EXISTING CONDITIONS PRIOR TO THE COMMENCEMENT OF WORK.

	DATE	ISSUE
△	DATE	REVISION

LOCATION:

Consumer Cellular®

8283 S. AKRON ST.
SUITE #110
CENTENNIAL, CO 80112

STORE NUMBER:

CO2

PROJECT INFORMATION:

DATE: 10/14/2026
PROJECT NUMBER: 15066 - 26
STORE TYPE: TIER 2
DRAWN BY: GV REVIEWED BY: AN

TITLE:

MILLWORK BLOCKING AND DETAILS

SHEET NUMBER:

A104

TAKE-OFF LEGEND - A200 (gypsum board ceilings / soffits)

blue area = gyp bd ceiling / soffit: 1 areas, 60.49 SF (Contents: board · ceiling tag · room · SF · ceiling height · detail · id)

magenta triangle = lateral bracing cluster (splay wires + compression strut): 1

measure: /Measure at the printed scale of the sheet; SF = Excel row (ceiling id)

GENERAL NOTES

REPANCIES OR UNFORESEEN ITEMS NOT

E LAYOUT GUIDE ON THIS SHEET.
F LIGHT FIXTURES AS REQUIRED BY FIRE

4. REFER TO MECHANICAL DRAWINGS FOR FURTHER INFORMATION ON SCOPE AND LOCATION OF MECHANICAL ITEMS
5. REFER TO VENDOR INSTALLATION GUIDE AND MANUFACTURER INSTRUCTIONS FOR FIXTURE INSTALLATION.
6. REFER TO ELECTRICAL DRAWINGS FOR FIXTURE TYPES AND LIGHT FIXTURE SCHEDULE.

SHEET SYMBOLS

C-1
GYP BOARD CEILING

C-2
CEILING - LAY IN TILE

C-3
CEILING - LAY IN TILE

T	X###
F	X###
H	XX'-XX"

CEILING TYPE
CEILING FINISH
CEILING HEIGHT

2' X 2' LIGHT

2' X 2' EMERGENCY LIGHT

2' X 4' LIGHT

2' X 4' EMERGENCY LIGHT

PENDANT LIGHT

PENDANT LIGHT

RECESSED LIGHT

LED STRIP LIGHT

LINEAR PENDANT LIGHT

EXIT SIGNAGE

WALL SCONCE

EM LIGHT

LIGHTING FIXTURES SPECS

L-1
ITEM: 4" FIXED DOWNLIGHT
MFG.: LOTUS
PRODUCT:
LDNR-30K-HO-4R-WR-WT / LLL-LD20507R / FRP4
FINISH: WHITE
SIZE: 4" DIA

L-2A
ITEM: LINEAR PENDANT LIGHT
MFG.: WAC
PRODUCT: PD-22754-AL
FINISH: BRUSHED ALUMINUM
HEIGHT: 6'-6" A.F.F

L-2B
ITEM: LINEAR PENDANT LIGHT
MFG.: WAC
PRODUCT: PD-22754-AL
FINISH: BRUSHED ALUMINUM
HEIGHT: FLUSH WITH TRELLIS

L-3A
ITEM: LARGE PENDANT LIGHT
MFG.: YLIGHTING
FINISH:WHITE/COPPER
SIZE: LARGE
HEIGHT: 6'-6" A.F.F

L-3B
ITEM: MEDIUM PENDANT LIGHT
MFG.: YLIGHTING
FINISH:WHITE/COPPER
SIZE: MEDIUM
HEIGHT: 7'-6" A.F.F

L-3C
ITEM: SMALL PENDANT LIGHT
MFG.: YLIGHTING
FINISH:WHITE/COPPER
SIZE: SMALL
HEIGHT: 7'-0" A.F.F

L-4
ITEM:LARMES MINI PENDANT
MFG.: ET2 LIGHTING
PRODUCT #: E23111-18
MATERIAL: GLASS, STEEL
FINISH: POLISHED CHROME
HEIGHT: 6'-0"A.F.F

L-5
ITEM: LED STRIP LIGHT
MFG.: DIODE
PRODUCT: DIODE LED
FINISH: ALUMINUM
SIZE: 48",96"

L-6
ITEM: 2'X2' RECESSED FIXTURE
MFG.: VALRIYA
PRODUCT #: VA-TTR-22-30-300K
FINISH: WHITE
SIZE: 24" X 24"

L-6 EM
ITEM:2'X2' RECESSED FIXTURE
MFG.: VALRIYA
PRODUCT #:
VA-TTR-22-30-300K/VA-EDA-L115-50
FINISH: WHITE
SIZE: 24" X 24"

L-6A
ITEM: 2'X4' RECESSED FIXTURE
MFG.: VALRIYA
PRODUCT#:VA-TTR-24-40-3000K
FINISH: WHITE
SIZE: 24" X 48"

L-6A EM
ITEM: 2'X4' RECESSED FIXTURE
MFG.: VALRIYA
PRODUCT #:
VA-TTR-24-40-3000K-VA-EDA-L115-50
FINISH: WHITE
SIZE: 24" X 48"

L-7
ITEM: RECESSED WALL WASHER
MFG.: LUMENTURE
PRODUCT #: RWW160
FINISH:WHITE

L-8
ITEM: BATHROOM SCONCE
MFG.: MAXIM LIGHTING
PRODUCT #: 5200
FINISH: SATIN NICKEL
HEIGHT: 3" ABOVE MIRROR

L-9
ITEM: EMERGENCY LIGHT
MFG.: DUAL-LITE
PRODUCT: LZ SERIES
FINISH:WHITE
HEIGHT: 7'-6" A.F.F

EX1
FINISH: EMERGENCY / EXIT LIGHT
120/277V, 90 MIN. EMERGENCY BATTERY BACKUP, GREEN LED LETTERS
MFG.: EXITRONIX
PRODUCT: S900C-SM-G-WH-R
FINISH: WHITE

*NOTE: NOT ALL FIXTURES LISTED ARE USED AT THIS LOCATION. REFER TO FIXTURE TAGS ON PLAN.



1 2X2 CEILING GRID
CENTER SPRINKLERS AND CEILING MOUNTED EQUIPMENT

2 EQUIPMENT PLACEMENT IN GRID

1/4" = 1'-0"



1 LIGHT PLACEMENT IN GRID
GENERAL LIGHTING

3 LIGHT LAYOUT GUIDE

1/4" = 1'-0"

1 REFLECTED CEILING PLAN

1/4" = 1'-0"

SARGENTI

5840 LEGACY CIR - STE D230, PLANO, TX 75024
T|201.316.5491 ● WWW.SARGARCH.COM

SEAL:

STATE OF COLORADO
ROBERT J. SARGENTI
305929
LICENSED ARCHITECT

DATE SIGNED: 10/15/2026

CONTRACTOR'S NOTES:

WRITTEN DIMENSIONS HOLD PREFERENCE OVER SCALED DIMENSIONS. DO NOT SCALE THE DRAWINGS. THE CONTRACTORS MUST VISIT JOB SITE TO VERIFY ALL EXISTING CONDITIONS AND DIMENSIONS BEFORE SUBMITTING BIDS. REPORT ANY DISCREPANCIES OF ANY CONDITIONS WHICH MAY INTERFERE WITH THE PROPER EXECUTION OF, THE CONTRACT TO THE TENANT'S REPRESENTATIVE. REPORT DISCREPANCIES DURING BIDDING PROCESS AND BEFORE START OF CONSTRUCTION. CHANGE ORDERS NEED TO BE APPROVED BY THE CONSTRUCTION MANAGER FOR ISSUES ARISING FROM THE FIELD CONDITIONS OR CONFLICTS BETWEEN THE PLANS AND THE EXISTING CONDITIONS PRIOR TO THE COMMENCEMENT OF WORK.

	DATE	ISSUE
△	DATE	REVISION

LOCATION:

Consumer Cellular

8283 S. AKRON ST.
SUITE #110
CENTENNIAL, CO 80112

STORE NUMBER:

CO2

PROJECT INFORMATION:

DATE: 10/14/2026
PROJECT NUMBER: 15066 - 26
STORE TYPE: TIER 2
DRAWN BY: GV
REVIEWED BY: AN

TITLE:

REFLECTED CEILING PLAN

SHEET NUMBER:

A200

GENERAL NOTES

1. G.C. TO VERIFY FIELD CONDITIONS AND DIMENSIONS AND NOTIFY ARCHITECTS IMMEDIATELY OF ANY DISCREPANCIES AFTER DEMOLITION AND PRIOR TO RECLADDING OR CONSTRUCTION. G.C. TO FIELD VERIFY ALL DIMENSIONS PRIOR TO ORDERING ANY MATERIALS.
2. G.C. TO VERIFY AND INSTALL BLOCKING FOR EXTERIOR SIGNAGE AS REQUIRED. COORDINATE WITH LANDLORD AND SIGNAGE VENDOR REGARDING LOCATION OF SIGNAGE AND EXISTING SHELL CONSTRUCTION/FINISH CONDITIONS.
3. SIGN MANUFACTURER TO REVIEW THE LANDLORD'S SIGN CRITERIA AND SUBMIT SHOP DRAWINGS FOR THE PROPOSED SIGN TO THE LANDLORD AND ANY OTHER GOVERNING AUTHORITIES. THE SIGN MANUFACTURER SHALL SECURE ANY AND ALL PERMITS REQUIRED FOR THE INSTALLATION AND DISPLAY OF THE PROPOSED SIGNAGE.
4. SIGN MANUFACTURER'S SHOP DRAWINGS SHALL BE REVIEWED UNDER SEPARATE SUBMITTAL.
5. SIGNAGE AS SHOWN IN THESE DRAWINGS IS SCHEMATIC ONLY FOR ILLUSTRATION PURPOSES AND DOES NOT IMPLY OR DESCRIBE ANY MEANS, METHODS, OR DETAILS PERTAINING TO INSTALLATION OF SIGNAGE. IT SHALL BE SOLELY THE SIGN MANUFACTURER'S RESPONSIBILITY TO DESIGN, FABRICATE, AND INSTALL THE SIGN UNDER SEPARATE PERMIT. ANY AND ALL STRUCTURAL CONSIDERATIONS SHALL BE COORDINATED BETWEEN THE SIGN MANUFACTURER, THE LANDLORD, AND HIS DESIGN PROFESSIONALS.
6. SUITE NUMBERS SHOULD BE A MINIMUM OF 3" HIGH, 1/2" STROKE WIDE, AND A CONTRASTING COLOR. PREMISES IDENTIFICATION MUST BE VISIBLE FROM STREET OR DRIVE. ALL EXTERIOR SUITE DOORS SHALL BE LABELED. POST 6" STREET NUMBERS AND 3" SUITE NUMBERS. COORDINATE WITH LANDLORD REPRESENTATIVE AND CONSUMER CELLULAR CONSTRUCTION PM FOR FINAL PLACEMENT OF SUITE NUMBERS.
7. ALL MATERIALS TO BE A CLASS A RATING WITH A FLAME SPREAD INDEX OF 0-25 AND A SMOKE DEVELOPED INDEX OF 0-450.

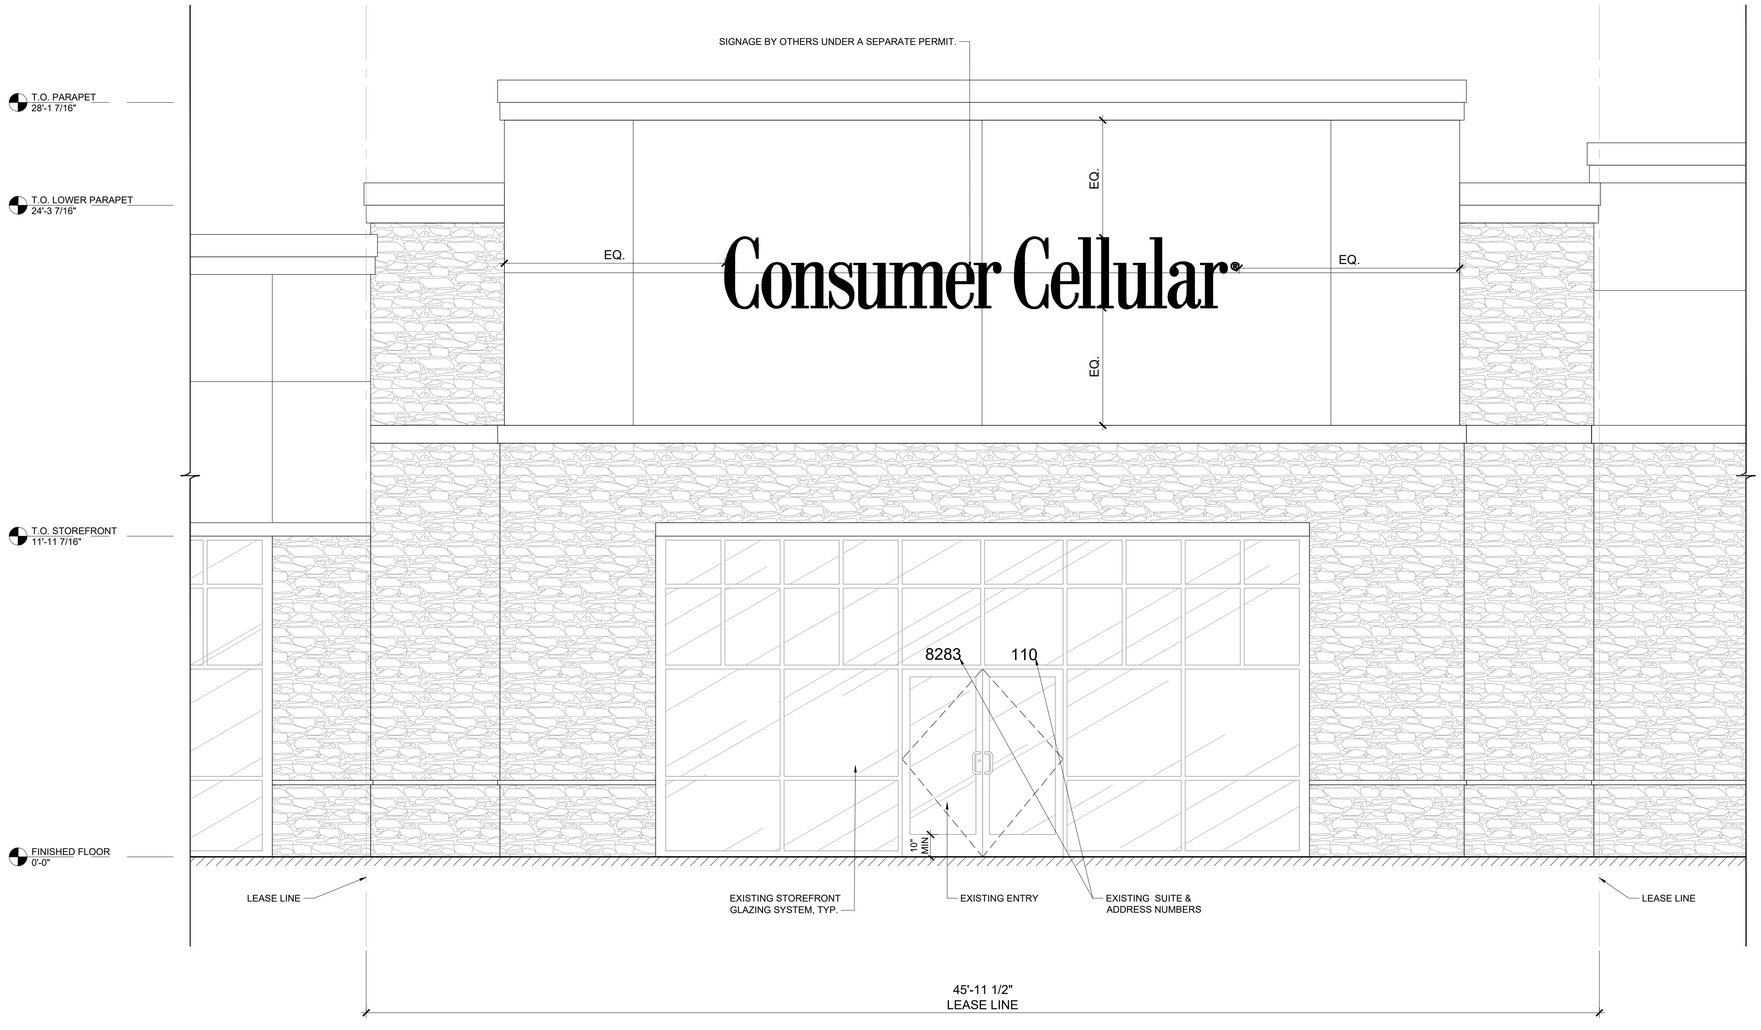

1 EXISTING EXTERIOR ELEVATION

3/8" = 1'-0"

SARGENTI

5840 LEGACY CIR - STE D230, PLANO, TX 75024
T|201.316.5491 ★ WWW.SARGARCH.COM

SEAL:

STATE OF COLORADO
ROBERT J. SARGENTI
305929
LICENSED ARCHITECT

DATE SIGNED: 10/15/2026

CONTRACTOR'S NOTES:

WRITTEN DIMENSIONS HOLD PREFERENCE OVER SCALED DIMENSIONS. DO NOT SCALE THE DRAWINGS. THE CONTRACTORS MUST VISIT JOB SITE TO VERIFY ALL EXISTING CONDITIONS AND DIMENSIONS BEFORE SUBMITTING BIDS. REPORT ANY DISCREPANCIES OF ANY CONDITIONS WHICH MAY INTERFERE WITH THE PROPER EXECUTION OF, THE CONTRACT TO THE TENANT'S REPRESENTATIVE. REPORT DISCREPANCIES DURING BIDDING PROCESS AND BEFORE START OF CONSTRUCTION. CHANGE ORDERS NEED TO BE APPROVED BY THE CONSTRUCTION MANAGER FOR ISSUES ARISING FROM THE FIELD CONDITIONS OR CONFLICTS BETWEEN THE PLANS AND THE EXISTING CONDITIONS PRIOR TO THE COMMENCEMENT OF WORK.

	DATE	ISSUE
△	DATE	REVISION

LOCATION:

Consumer Cellular®

8283 S. AKRON ST.
SUITE #110
CENTENNIAL, CO 80112

STORE NUMBER:

CO2

PROJECT INFORMATION:

DATE: 10/14/2026
PROJECT NUMBER: 15066 - 26
STORE TYPE: TIER 2
DRAWN BY: GV REVIEWED BY: AN

TITLE:

EXTERIOR ELEVATIONS

SHEET NUMBER:

A300

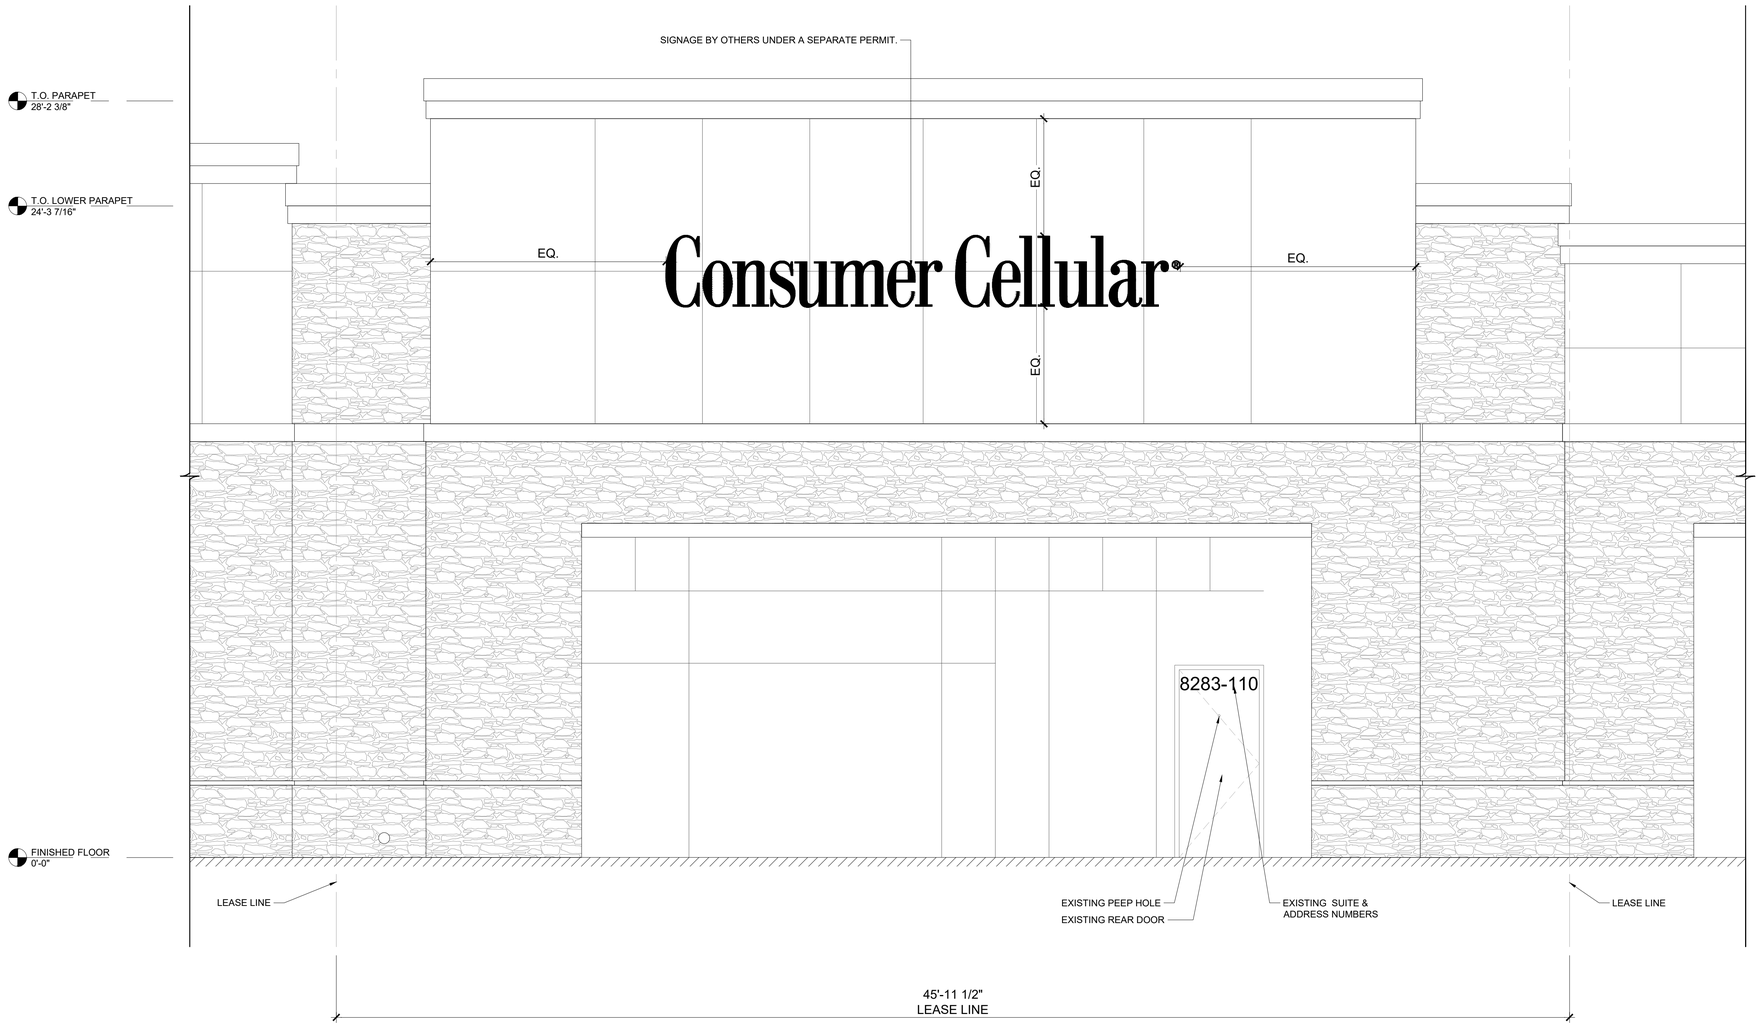

1 EXISTING EXTERIOR ELEVATION

3/8" = 1'-0"

GENERAL NOTES

1. G.C. TO VERIFY FIELD CONDITIONS AND DIMENSIONS AND NOTIFY ARCHITECTS IMMEDIATELY OF ANY DISCREPANCIES AFTER DEMOLITION AND PRIOR TO RECLADDING OR CONSTRUCTION. G.C. TO FIELD VERIFY ALL DIMENSIONS PRIOR TO ORDERING ANY MATERIALS.
2. G.C. TO VERIFY AND INSTALL BLOCKING FOR EXTERIOR SIGNAGE AS REQUIRED. COORDINATE WITH LANDLORD AND SIGNAGE VENDOR REGARDING LOCATION OF SIGNAGE AND EXISTING SHELL CONSTRUCTION/FINISH CONDITIONS.
3. SIGN MANUFACTURER TO REVIEW THE LANDLORD'S SIGN CRITERIA AND SUBMIT SHOP DRAWINGS FOR THE PROPOSED SIGN TO THE LANDLORD AND ANY OTHER GOVERNING AUTHORITIES. THE SIGN MANUFACTURER SHALL SECURE ANY AND ALL PERMITS REQUIRED FOR THE INSTALLATION AND DISPLAY OF THE PROPOSED SIGNAGE.
4. SIGN MANUFACTURER'S SHOP DRAWINGS SHALL BE REVIEWED UNDER SEPARATE SUBMITTAL.
5. SIGNAGE AS SHOWN IN THESE DRAWINGS IS SCHEMATIC ONLY FOR ILLUSTRATION PURPOSES AND DOES NOT IMPLY OR DESCRIBE ANY MEANS, METHODS, OR DETAILS PERTAINING TO INSTALLATION OF SIGNAGE. IT SHALL BE SOLELY THE SIGN MANUFACTURER'S RESPONSIBILITY TO DESIGN, FABRICATE, AND INSTALL THE SIGN UNDER SEPARATE PERMIT. ANY AND ALL STRUCTURAL CONSIDERATIONS SHALL BE COORDINATED BETWEEN THE SIGN MANUFACTURER, THE LANDLORD, AND HIS DESIGN PROFESSIONALS.
6. SUITE NUMBERS SHOULD BE A MINIMUM OF 3" HIGH, 1/2" STROKE WIDE, AND A CONTRASTING COLOR. PREMISES IDENTIFICATION MUST BE VISIBLE FROM STREET OR DRIVE. ALL EXTERIOR SUITE DOORS SHALL BE LABELED. POST 6" STREET NUMBERS AND 3" SUITE NUMBERS. COORDINATE WITH LANDLORD REPRESENTATIVE AND CONSUMER CELLULAR CONSTRUCTION PM FOR FINAL PLACEMENT OF SUITE NUMBERS.
7. ALL MATERIALS TO BE A CLASS A RATING WITH A FLAME SPREAD INDEX OF 0-25 AND A SMOKE DEVELOPED INDEX OF 0-450.

SARGENTI
5840 LEGACY CIR - STE D230, PLANO, TX 75024
T|201.316.5491 ★ WWW.SARGARCH.COM

SEAL:

STATE OF COLORADO
ROBERT J. SARGENTI
305929
LICENSED ARCHITECT

DATE SIGNED: 10/15/2026

CONTRACTOR'S NOTES:

WRITTEN DIMENSIONS HOLD PREFERENCE OVER SCALED DIMENSIONS. DO NOT SCALE THE DRAWINGS. THE CONTRACTORS MUST VISIT JOB SITE TO VERIFY ALL EXISTING CONDITIONS AND DIMENSIONS BEFORE SUBMITTING BIDS. REPORT ANY DISCREPANCIES OF ANY CONDITIONS WHICH MAY INTERFERE WITH THE PROPER EXECUTION OF, THE CONTRACT TO THE TENANT'S REPRESENTATIVE. REPORT DISCREPANCIES DURING BIDDING PROCESS AND BEFORE START OF CONSTRUCTION. CHANGE ORDERS NEED TO BE APPROVED BY THE CONSTRUCTION MANAGER FOR ISSUES ARISING FROM THE FIELD CONDITIONS OR CONFLICTS BETWEEN THE PLANS AND THE EXISTING CONDITIONS PRIOR TO THE COMMENCEMENT OF WORK.

	DATE	ISSUE
△	DATE	REVISION

LOCATION:

Consumer Cellular®

8283 S. AKRON ST.
SUITE #110
CENTENNIAL, CO 80112

STORE NUMBER:

CO2

PROJECT INFORMATION:

DATE: 10/14/2026
PROJECT NUMBER: 15066 - 26
STORE TYPE: TIER 2
DRAWN BY: GV REVIEWED BY: AN

TITLE:

EXTERIOR ELEVATIONS

SHEET NUMBER:

A301

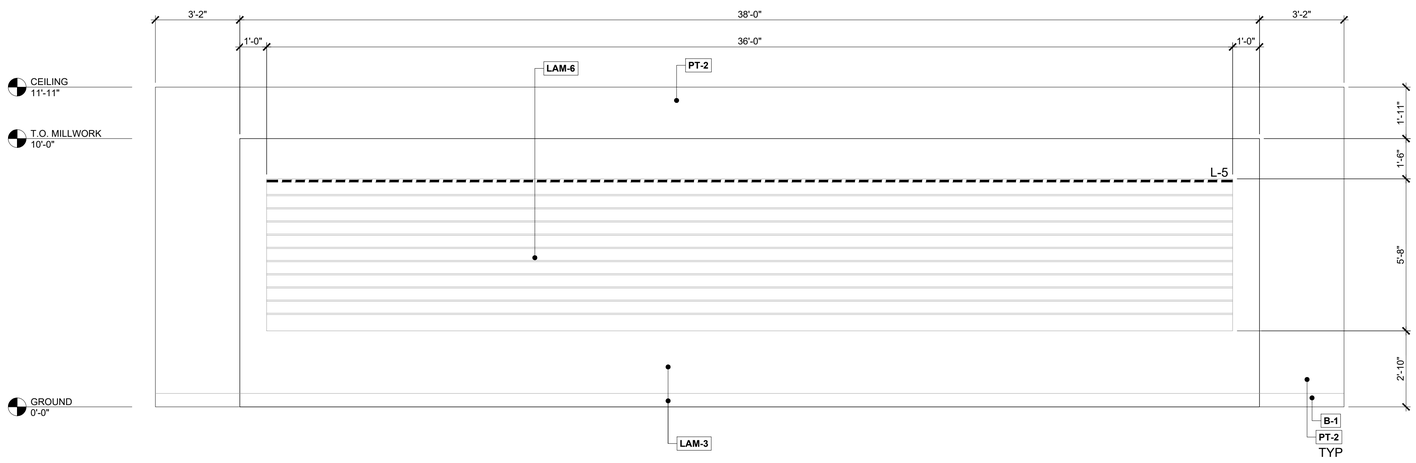

1 INTERIOR ELEVATION

3/8" = 1'-0"

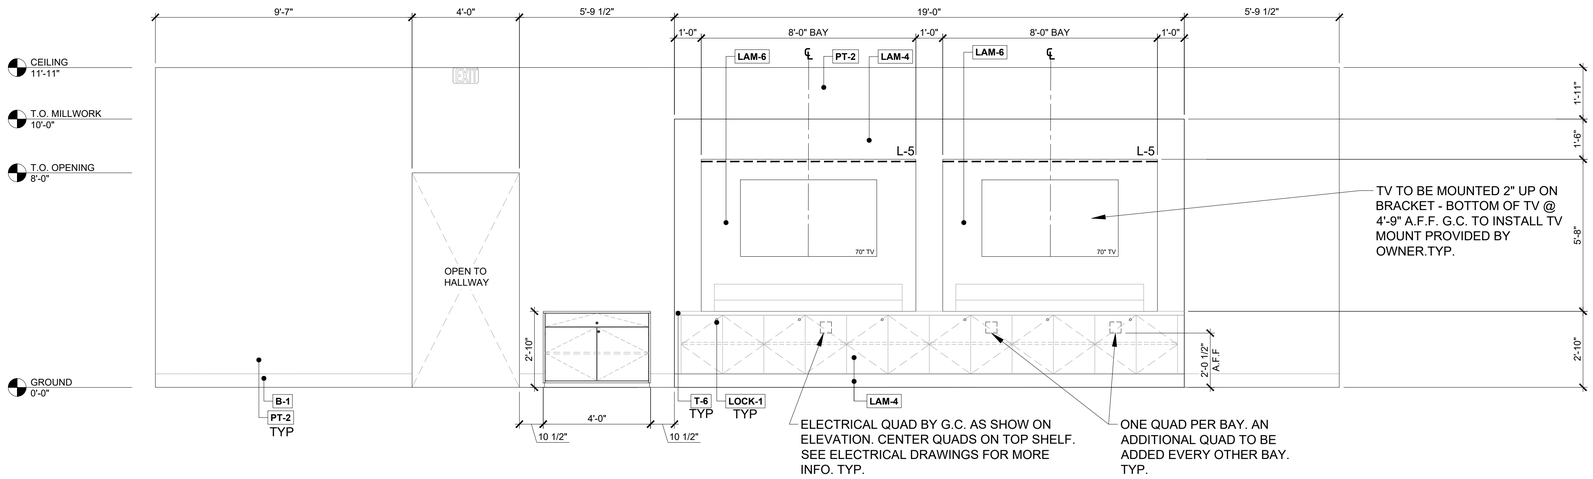

2 INTERIOR ELEVATION LOGO WALL

3/8" = 1'-0"

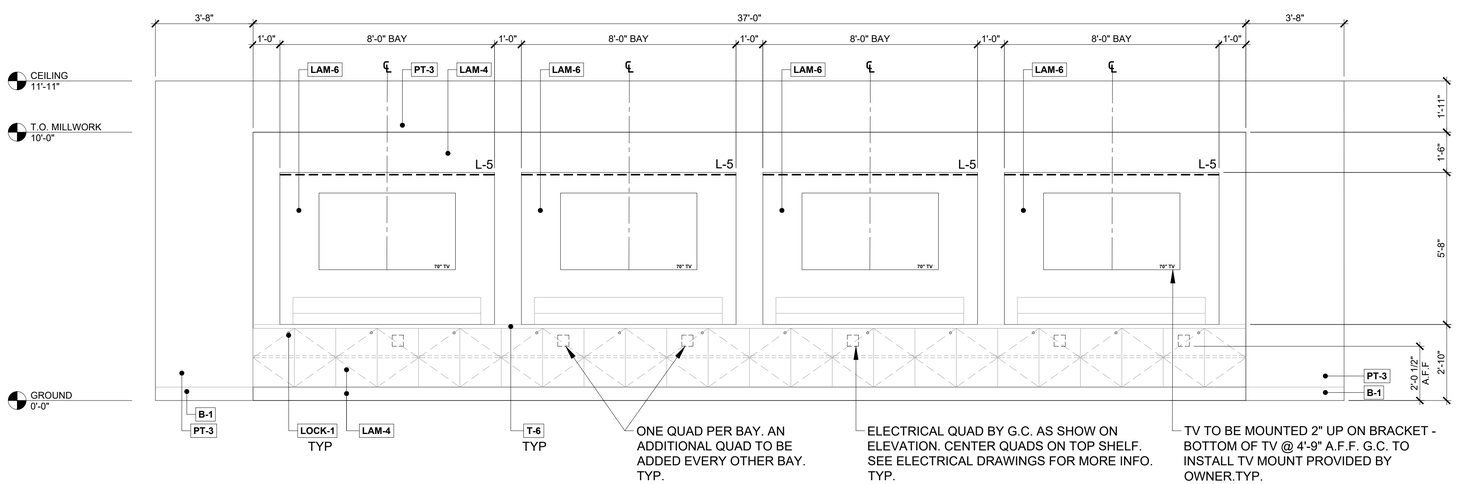

3 INTERIOR ELEVATION

3/8" = 1'-0"

NOTE: ALL MILLWORK BY OWNER, INSTALLED BY G.C. SEE SHEET A-103 FOR MILLWORK LAYOUT.

SARGENTI

5840 LEGACY CIR - STE D230, PLANO, TX 75024
T|201.316.5491 ★ WWW.SARGARCH.COM

SEAL:

STATE OF COLORADO
ROBERT J. SARGENTI
305929
LICENSED ARCHITECT

DATE SIGNED: 10/15/2026

CONTRACTOR'S NOTES:

WRITTEN DIMENSIONS HOLD PREFERENCE OVER SCALED DIMENSIONS. DO NOT SCALE THE DRAWINGS. THE CONTRACTORS MUST VISIT JOB SITE TO VERIFY ALL EXISTING CONDITIONS AND DIMENSIONS BEFORE SUBMITTING BIDS. REPORT ANY DISCREPANCIES OF ANY CONDITIONS WHICH MAY INTERFERE WITH THE PROPER EXECUTION OF, THE CONTRACT TO THE TENANT'S REPRESENTATIVE. REPORT DISCREPANCIES DURING BIDDING PROCESS AND BEFORE START OF CONSTRUCTION. CHANGE ORDERS NEED TO BE APPROVED BY THE CONSTRUCTION MANAGER FOR ISSUES ARISING FROM THE FIELD CONDITIONS OR CONFLICTS BETWEEN THE PLANS AND THE EXISTING CONDITIONS PRIOR TO THE COMMENCEMENT OF WORK.

	DATE	ISSUE
△	DATE	REVISION

LOCATION:

Consumer Cellular

8283 S. AKRON ST.
SUITE #110
CENTENNIAL, CO 80112

STORE NUMBER:

CO2

PROJECT INFORMATION:

DATE: 10/14/2026
PROJECT NUMBER: 15066 - 26
STORE TYPE: TIER 2
DRAWN BY: GV
REVIEWED BY: AN

TITLE:

INTERIOR ELEVATIONS

SHEET NUMBER:

A400

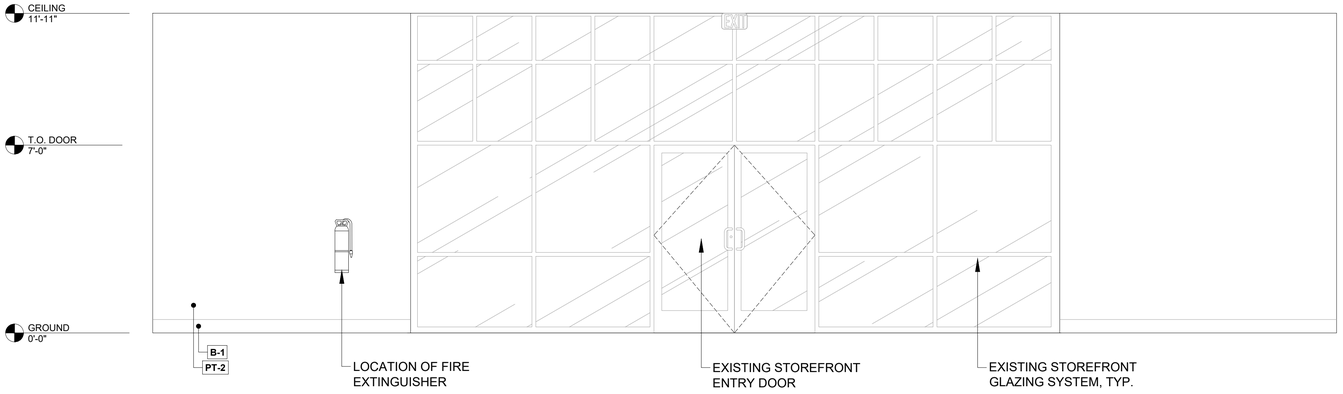

1 INTERIOR ELEVATION
3/8" = 1'-0"

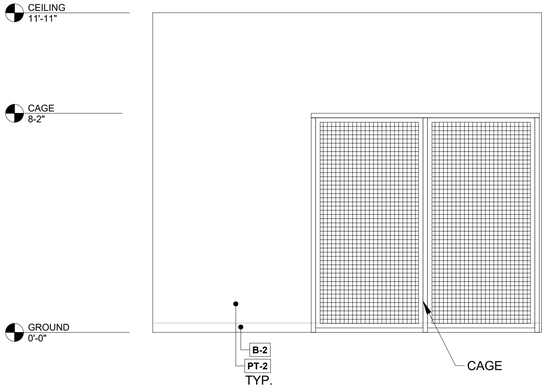

2 INTERIOR ELEVATION
3/8" = 1'-0"

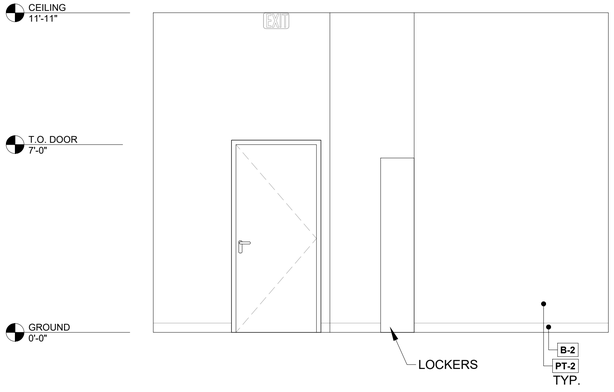

3 INTERIOR ELEVATION
3/8" = 1'-0"

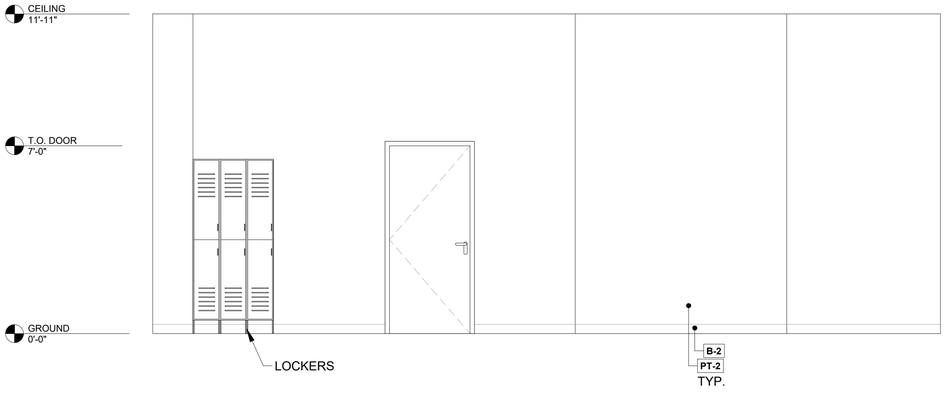

4 INTERIOR ELEVATION
3/8" = 1'-0"

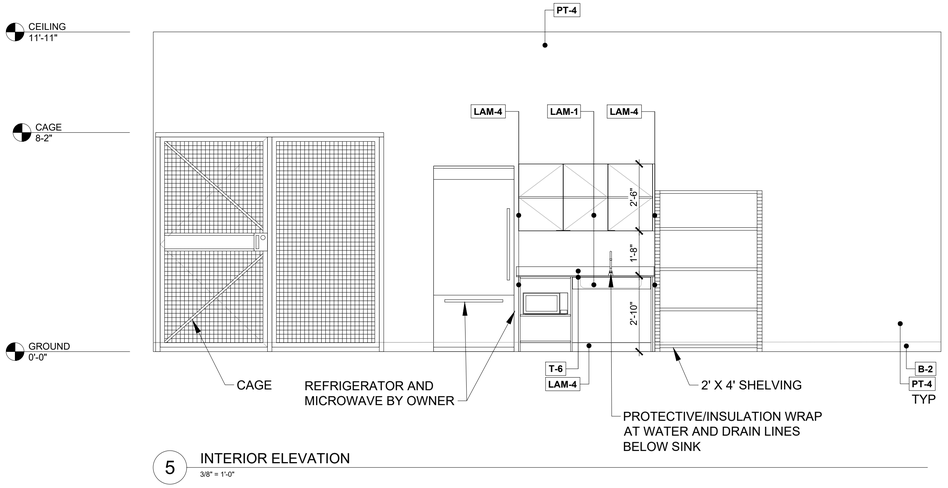

5 INTERIOR ELEVATION
3/8" = 1'-0"

NOTE: ALL MILLWORK BY OWNER, INSTALLED BY G.C. SEE SHEET A-103 FOR MILLWORK LAYOUT.

SARGENTI

5840 LEGACY CIR - STE D230, PLANO, TX 75024
T|201.316.5491 ■ WWW.SARGARCH.COM

SEAL:

STATE OF COLORADO
ROBERT J. SARGENTI
305929
LICENSED ARCHITECT

DATE SIGNED: 10/15/2026

CONTRACTOR'S NOTES:

WRITTEN DIMENSIONS HOLD PREFERENCE OVER SCALED DIMENSIONS. DO NOT SCALE THE DRAWINGS. THE CONTRACTORS MUST VISIT JOB SITE TO VERIFY ALL EXISTING CONDITIONS AND DIMENSIONS BEFORE SUBMITTING BIDS. REPORT ANY DISCREPANCIES OF ANY CONDITIONS WHICH MAY INTERFERE WITH THE PROPER EXECUTION OF, THE CONTRACT TO THE TENANT'S REPRESENTATIVE. REPORT DISCREPANCIES DURING BIDDING PROCESS AND BEFORE START OF CONSTRUCTION. CHANGE ORDERS NEED TO BE APPROVED BY THE CONSTRUCTION MANAGER FOR ISSUES ARISING FROM THE FIELD CONDITIONS OR CONFLICTS BETWEEN THE PLANS AND THE EXISTING CONDITIONS PRIOR TO THE COMMENCEMENT OF WORK.

	DATE	ISSUE
△	DATE	REVISION

LOCATION:

Consumer Cellular

8283 S. AKRON ST.
SUITE #110
CENTENNIAL, CO 80112

STORE NUMBER:

CO2

PROJECT INFORMATION:

DATE: 10/14/2026
PROJECT NUMBER: 15066 - 26
STORE TYPE: TIER 2
DRAWN BY: GV
REVIEWED BY: AN

TITLE:

INTERIOR ELEVATIONS

SHEET NUMBER:

A401

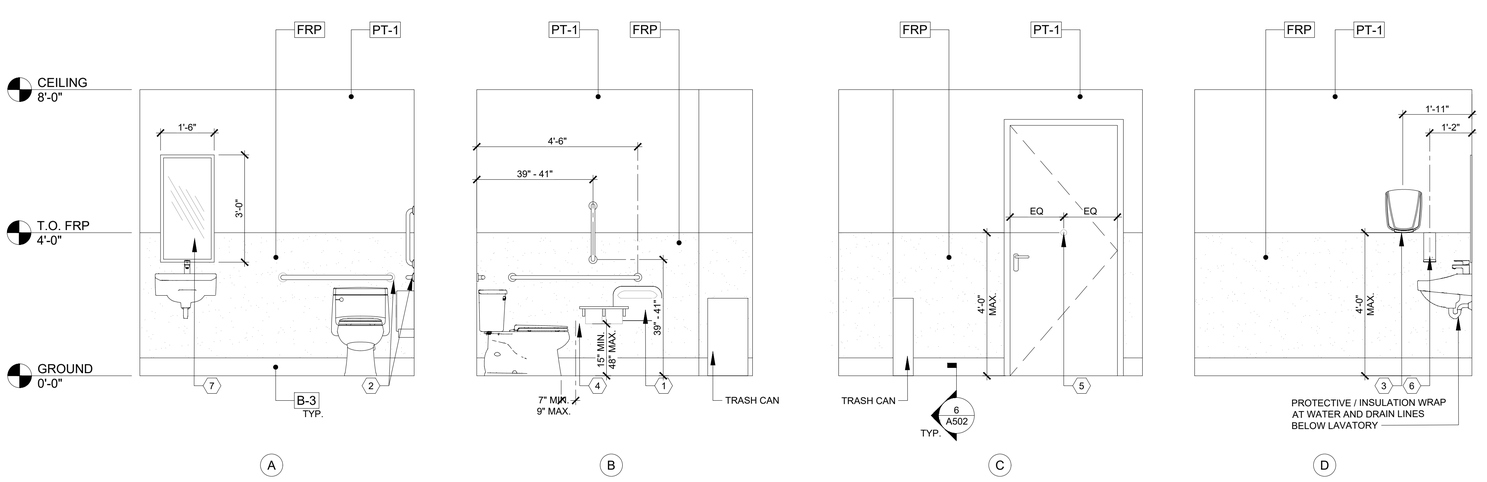

1 RESTROOM ELEVATIONS

1/2" = 1'-0"

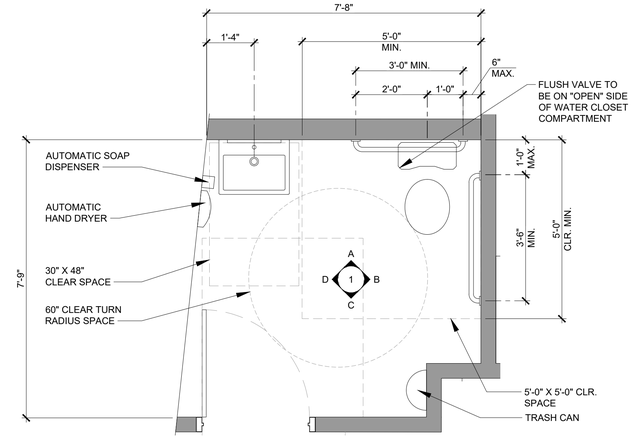

2 ENLARGED UNISEX RESTROOM PLAN

1/2" = 1'-0"

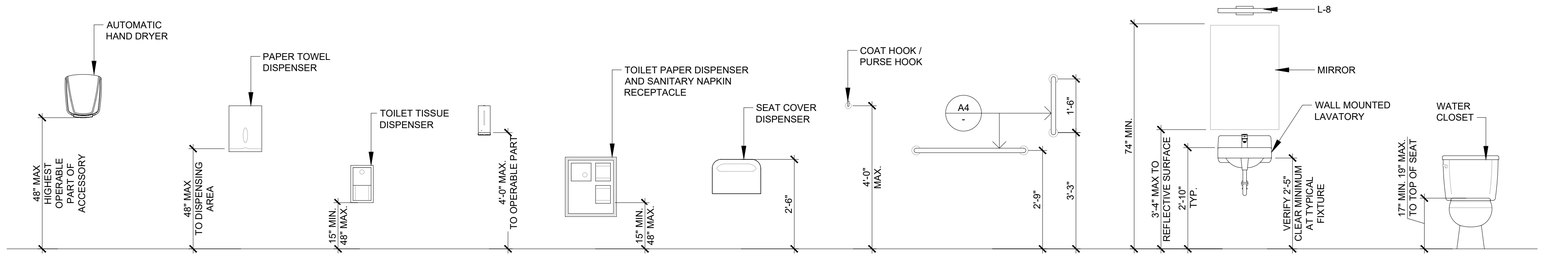

3 TYPICAL MOUNTING HEIGHTS

1/2" = 1'-0"

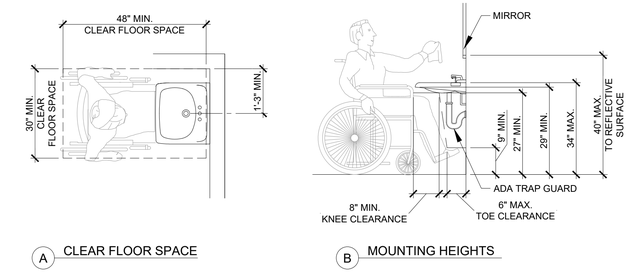

A CLEAR FLOOR SPACE

B MOUNTING HEIGHTS

4 LAVATORY DETAIL

1/2" = 1'-0"

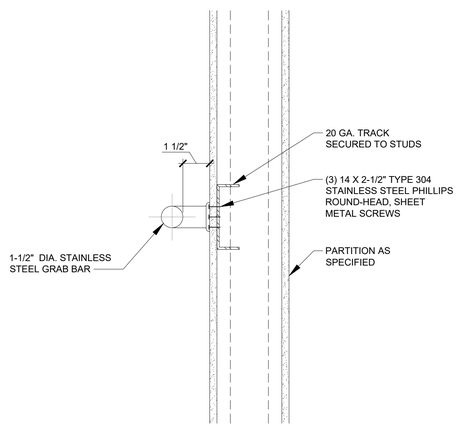

5 GRAB BAR DETAIL

3" = 1'-0"

GRAB BAR NOTES

1) GC TO INSTALL WITH MOUNTING KIT # 252-30.

2) THE STRUCTURAL STRENGTH OF GRAB BARS SHALL MEET THE FOLLOWING SPECIFICATIONS:

(A) BENDING STRESS IN A GRAB BAR INDUCED BY THE MAXIMUM BENDING MOMENT FROM THE APPLICATION OF 250 lbf (1112N) SHALL BE LESS THAN THE ALLOWABLE STRESS FOR THE MATERIAL OF THE GRAB BAR.

(B) SHEAR STRESS INDUCED IN A GRAB BAR BY THE APPLICATION OF 250 lbf (1112N) SHALL BE LESS THAN THE ALLOWABLE SHEAR STRESS FOR THE MATERIAL OF THE GRAB BAR. IF THE CONNECTIONS BETWEEN THE GRAB BAR AND ITS MOUNTING BRACKET OR OTHER SUPPORT IS CONSIDERED TO BE FULLY RESTRAINED, THEN DIRECT AND TORSIONAL SHEAR STRESSES SHALL BE TOTALED FOR THE COMBINED SHEAR STRESS, WHICH SHALL NOT EXCEED THE ALLOWABLE SHEAR STRESS.

(C) SHEAR FORCE INDUCED IN A FASTENER OR MOUNTING DEVICE FROM THE APPLICATION OF 250 lbf (1112N) SHALL BE LESS THAN THE ALLOWABLE LATERAL LOAD OF EITHER THE FASTENER OR MOUNTING DEVICE OR THE SUPPORTING STRUCTURE, WHICHEVER IS THE SMALLER ALLOWABLE LOAD.

(D) TENSILE FORCE INDUCED IN A FASTENER BY A DIRECT TENSION FORCE OF 250 lbf (1112N) PLUS THE MAXIMUM MOMENT FROM THE APPLICATION OF 250 lbf (1112N) SHALL BE LESS THAN THE ALLOWABLE WITHDRAWAL LOAD BETWEEN THE FASTENER AND THE SUPPORTING STRUCTURE.

(E) GRAB BARS SHALL NOT ROTATE WITHIN THEIR FITTINGS.

ACCESSIBLE SIGNAGE

ADA SIGN DESCRIPTION	MODEL#	SIGNAGE
WINDOW / COUNTER DECAL SYMBOL OF ACCESSIBILITY - SIZE: 6" X 6"	ADA-1006	
"EXIT" - SIZE: 6" X 6"; W/ ADA/CBC BRAILLE	ADA-1242	
"EXIT ROUTE" - SIZE: 6" X 6"; W/ ADA/CBC BRAILLE	ADA-1243	
WHEELCHAIR ACCESSIBLE ENTRANCE - SIZE: 6" X 8"	ADA-1070	
"WOMEN" WHEELCHAIR ACCESSIBLE RESTROOM - WALL - SIZE: 6" X 8"	ADA-1024	
"MEN" WHEELCHAIR ACCESSIBLE RESTROOM - WALL - SIZE: 6" X 8"	ADA-1025	
"ALL GENDER" WHEELCHAIR ACCESSIBLE RESTROOM - WALL - SIZE: 8" X 8"	ADA-1026	
"ALL GENDER" ACCESSIBLE RESTROOM - TACTILE BRAILLE - WALL - 8" X 9"	ADA-1245	
"WOMEN" ACCESSIBILE RESTROOM - DOOR - SIZE: 12" DIA. CIRCLE	T24-1001	
"MEN" ACCESSIBLE RESTROOM - DOOR - SIZE: 12" TRIANGLE	T24-1000	
"ALL GENDER" WHEELCHAIR ACCESSIBLE RESTROOM - DOOR - 12" TRIANGLE / CIRCLE	T24-1003	
"ALL GENDER" WHEELCHAIR ACCESSIBLE RESTROOM - DOOR - 12' X 12"	ADA-1251	

G.C IS RESPONSIBLE FOR PROVIDING AND INSTALLING ALL ACCESSIBLE SIGNAGE. SIGNAGE TO BE ADA WHITE ON BLUE AVAILABLE FROM WWW.ADASIGNDEPOT.COM
*NOT ALL USED AT THIS LOCATION

GENERAL NOTES

1. DISPENSERS THAT CONTROL DELIVERY OR THAT DO NOT PERMIT CONTINUOUS PAPER FLOW SHALL NOT BE USED.
2. INTERIOR SURFACES - TOILET ROOM FLOORS SHALL HAVE A SMOOTH, HARD, NON-ABSORBENT SURFACE, SUCH AS PORTLAND CEMENT, CONCRETE, CERAMIC TILE, OR OTHER APPROVED MATERIALS WHICH EXTEND UPWARD ONTO THE WALLS AT LEAST 5".
3. THERE SHALL BE NO SHARP OR ABRASIVE SURFACES UNDER LAVATORIES OR SINKS.
4. PROVIDE BLOCKING AT ALL WALL MOUNTED FIXTURES AND ACCESSORIES.

ACCESSORY KEY NOTES

(##)	NOTES
1	SEAT COVER DISPENSER: BOBRICK - #B-221 - STAINLESS STEEL
2	GRAB BAR: AMERICAN SPECIALTIES - STAINLESS STEEL
3	SURFACE-MOUNTED HAND DRYER: WORLD DRYER - Q-973A2 - BRUSHED STAINLESS STEEL
4	TOILET PAPER DISPENSER: SURFACE-MOUNTED MULTI ROLL TISSUE DISPENSER W/ SHELF BOBRICK - B2840
5	DOOR COAT HOOK: ROCKWOOD - MODEL: RW 828 - STAINLESS STEEL
6	AUTOMATIC SOAP DISPENSER: BOBRICK - #B-2013 - STAINLESS STEEL
7	FRAMES MIRROR: ASI #0600 - STAINLESS STEEL

SARGENTI

5840 LEGACY CIR - STE D230, PLANO, TX 75024
T|201.316.5491 ★ WWW.SARGARCH.COM

SEAL:

STATE OF COLORADO ★ ROBERT J. SARGENTI 305929 ★ LICENSED ARCHITECT

DATE SIGNED: 10/15/2026

CONTRACTOR'S NOTES:

WRITTEN DIMENSIONS HOLD PREFERENCE OVER SCALED DIMENSIONS. DO NOT SCALE THE DRAWINGS. THE CONTRACTORS MUST VISIT JOB SITE TO VERIFY ALL EXISTING CONDITIONS AND DIMENSIONS BEFORE SUBMITTING BIDS. REPORT ANY DISCREPANCIES OF ANY CONDITIONS WHICH MAY INTERFERE WITH THE PROPER EXECUTION OF, THE CONTRACT TO THE TENANT'S REPRESENTATIVE. REPORT DISCREPANCIES DURING BIDDING PROCESS AND BEFORE START OF CONSTRUCTION. CHANGE ORDERS NEED TO BE APPROVED BY THE CONSTRUCTION MANAGER FOR ISSUES ARISING FROM THE FIELD CONDITIONS OR CONFLICTS BETWEEN THE PLANS AND THE EXISTING CONDITIONS PRIOR TO THE COMMENCEMENT OF WORK.

	DATE	ISSUE
△	DATE	REVISION

LOCATION:

Consumer Cellular

8283 S. AKRON ST.
SUITE #110
CENTENNIAL, CO 80112

STORE NUMBER:

CO2

PROJECT INFORMATION:

DATE: 10/14/2026
PROJECT NUMBER: 15066 - 26
STORE TYPE: TIER 2
DRAWN BY: GV REVIEWED BY: AN

TITLE:

ENLARGED UNISEX RESTROOM

SHEET NUMBER:

A402

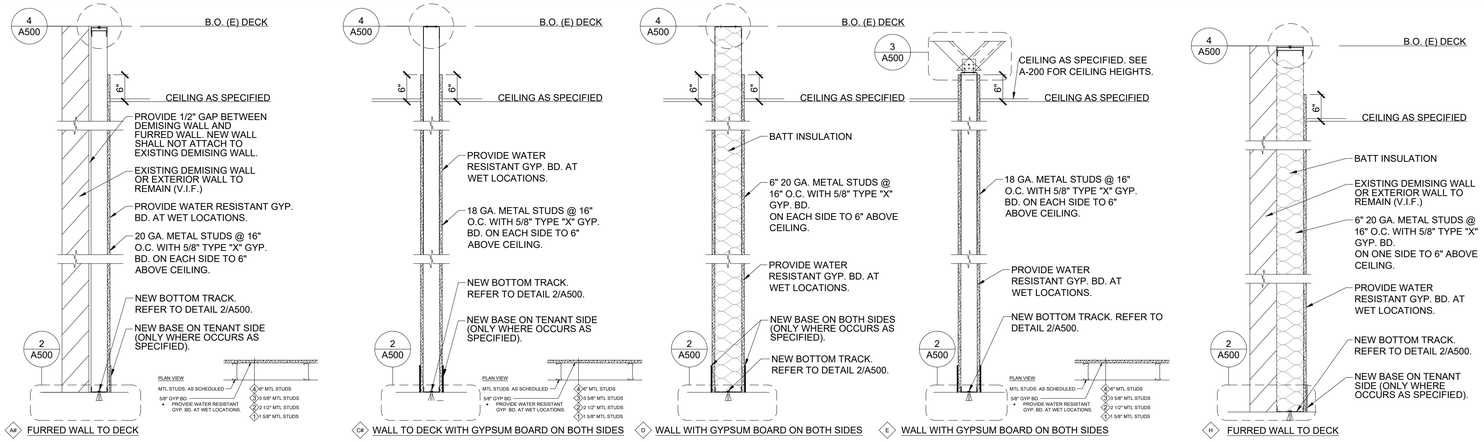

1 PARTITION TYPES

3/4"=1'-0"

FASTENERS:
AT PLYWOOD FLOOR (MIN. 3/4" CDX):
PROVIDE (2) NO. 8 X 3/4" WOOD SCREWS AT 24" O.C. MAX. STAGGERED FOR (1) LAYER GYP. BD. EACH SIDE, 16" O.C. MAX. STAGGERED FOR (2) LAYERS GYP. BD. EACH SIDE.

AT CIP CONCRETE FLOOR:
PROVIDE HILTI X-DNI .145Ø X 1" EMBED (POWDER-ACTUATED FASTENERS PER ES REPORT ESR-1663) AT 24" O.C. MAX. STAGGERED FOR (1) LAYER GYP. BD. EACH SIDE, 16" O.C. MAX. STAGGERED FOR (2) LAYERS GYP. BD. EACH SIDE.

AT POST-TENSIONED CONCRETE FLOOR:
PROVIDE HILTI X-DNI .145Ø X 3/4" EMBED (POWER-ACTUATED FASTENERS PER ES REPORT ESR-1663) AT 24" O.C. MAX. STAGGERED FOR (1) LAYER GYP. BD. EACH SIDE, 16" O.C. MAX. STAGGERED FOR (2) LAYERS GYP. BD. EACH SIDE.

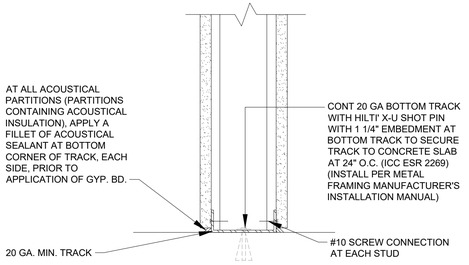

2 PARTITION FLOOR CONNECTION

3" = 1'-0"

FOR WALLS TO 10'-0" - BRACE WITH 362S137-33 AT 48" O.C. MAX. ALTERNATE DIRECTION OF BRACES ALONG LENGTH OF WALL WHERE POSSIBLE.

FOR WALLS TO 15'-0" - BRACE WITH DOUBLED 362S137-33 AT 48" O.C. MAX. ALTERNATE DIRECTION OF BRACES ALONG LENGTH OF WALL. FASTEN DOUBLED STUDS TOGETHER WITH NO. 8 SCREWS AT 24" O.C. MAX.

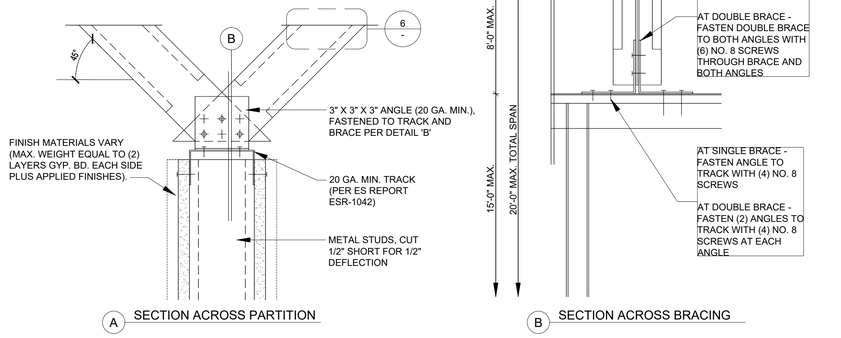

3 TOP OF WALL BRACING DETAIL

3" = 1'-0"

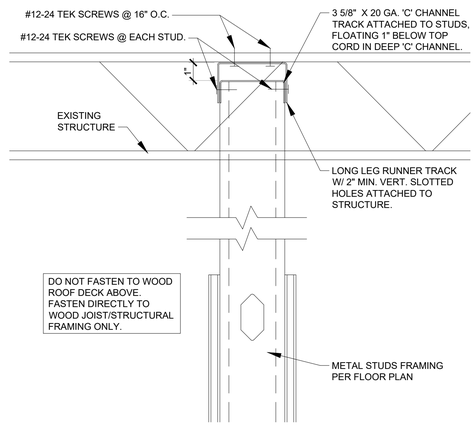

4 ATTACHMENT TO STRUCTURE

3" = 1'-0"

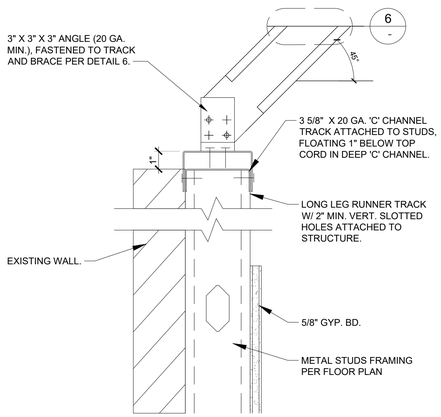

5 ATTACHMENT TO STRUCTURE

3" = 1'-0"

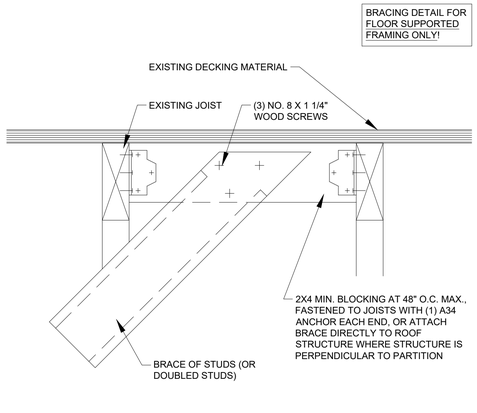

6 ATTACHMENT TO STRUCTURE

3" = 1'-0"

SARGENTI
5840 LEGACY CIR - STE D230, PLANO, TX 75024
T|201.316.5491 ★ WWW.SARGARCH.COM

SEAL:

STATE OF COLORADO ★ ROBERT J. SARGENTI 305929 ★ LICENSED ARCHITECT

DATE SIGNED: 10/15/2026

CONTRACTOR'S NOTES:

WRITTEN DIMENSIONS HOLD PREFERENCE OVER SCALED DIMENSIONS. DO NOT SCALE THE DRAWINGS. THE CONTRACTORS MUST VISIT JOB SITE TO VERIFY ALL EXISTING CONDITIONS AND DIMENSIONS BEFORE SUBMITTING BIDS. REPORT ANY DISCREPANCIES OF ANY CONDITIONS WHICH MAY INTERFERE WITH THE PROPER EXECUTION OF, THE CONTRACT TO THE TENANT'S REPRESENTATIVE. REPORT DISCREPANCIES DURING BIDDING PROCESS AND BEFORE START OF CONSTRUCTION. CHANGE ORDERS NEED TO BE APPROVED BY THE CONSTRUCTION MANAGER FOR ISSUES ARISING FROM THE FIELD CONDITIONS OR CONFLICTS BETWEEN THE PLANS AND THE EXISTING CONDITIONS PRIOR TO THE COMMENCEMENT OF WORK.

	DATE	ISSUE

△	DATE	REVISION

LOCATION:

Consumer Cellular®

8283 S. AKRON ST.
SUITE #110
CENTENNIAL, CO 80112

STORE NUMBER:

CO2

PROJECT INFORMATION:

DATE: 10/14/2026
PROJECT NUMBER: 15066 - 26
STORE TYPE: TIER 2
DRAWN BY: GV
REVIEWED BY: AN

TITLE:

PARTITION TYPES & DETAILS

SHEET NUMBER:

A500

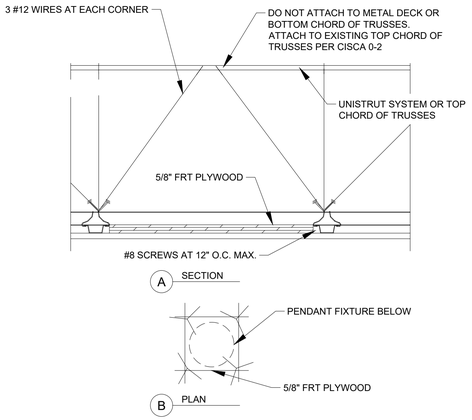

1 BLOCKING AT PENDANT LIGHT

N.T.S.

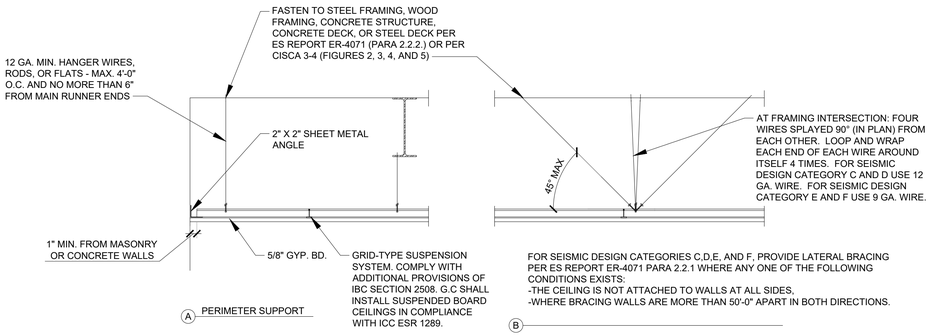

2 INSTALLATION OF SUSPENDED CEILING

USING GRID SUSPENSION SYSTEM

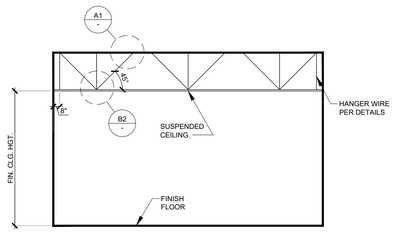

ELEVATION

TIE TWO ADJACENT WALLS TO CEILING MAIN AND CROSS RUNNERS.

3 SUSPENDED CEILING BRACING

3/4" = 1'-0"

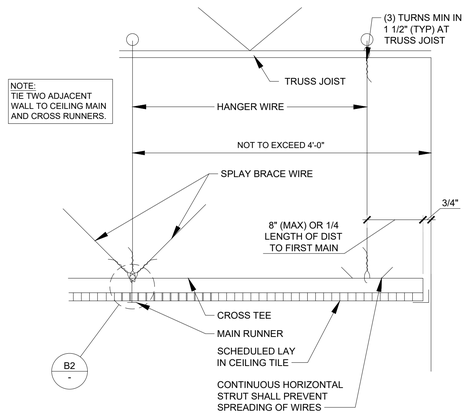

4 SUSPENDED CEILING BRACING

1" = 1'-0"

SARGENTI
5840 LEGACY CIR - STE D230, PLANO, TX 75024
T|201.316.5491 ★ WWW.SARGARCH.COM

SEAL:

STATE OF COLORADO ★ ROBERT J. SARGENTI 305929 ★ LICENSED ARCHITECT

DATE SIGNED: 10/15/2026

CONTRACTOR'S NOTES:

WRITTEN DIMENSIONS HOLD PREFERENCE OVER SCALED DIMENSIONS. DO NOT SCALE THE DRAWINGS. THE CONTRACTORS MUST VISIT JOB SITE TO VERIFY ALL EXISTING CONDITIONS AND DIMENSIONS BEFORE SUBMITTING BIDS. REPORT ANY DISCREPANCIES OF ANY CONDITIONS WHICH MAY INTERFERE WITH THE PROPER EXECUTION OF, THE CONTRACT TO THE TENANT'S REPRESENTATIVE. REPORT DISCREPANCIES DURING BIDDING PROCESS AND BEFORE START OF CONSTRUCTION. CHANGE ORDERS NEED TO BE APPROVED BY THE CONSTRUCTION MANAGER FOR ISSUES ARISING FROM THE FIELD CONDITIONS OR CONFLICTS BETWEEN THE PLANS AND THE EXISTING CONDITIONS PRIOR TO THE COMMENCEMENT OF WORK.

	DATE	ISSUE
△	DATE	REVISION

LOCATION:

Consumer Cellular®

8283 S. AKRON ST.
SUITE #110
CENTENNIAL, CO 80112

STORE NUMBER:

CO2

PROJECT INFORMATION:

DATE: 10/14/2026
PROJECT NUMBER: 15066 - 26
STORE TYPE: TIER 2
DRAWN BY: GV REVIEWED BY: AN

TITLE:

CEILING DETAILS

SHEET NUMBER:

A501

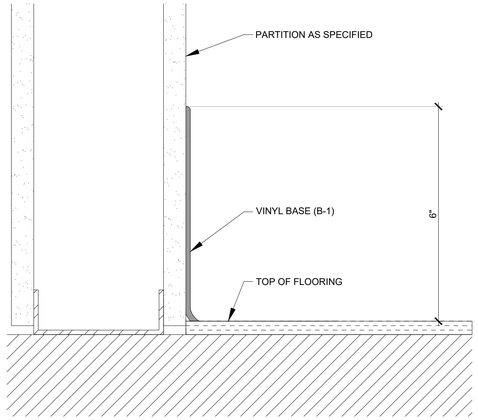

1 VINYL BASE (SALES AREA AND HALLWAY)
6" = 1'-0"

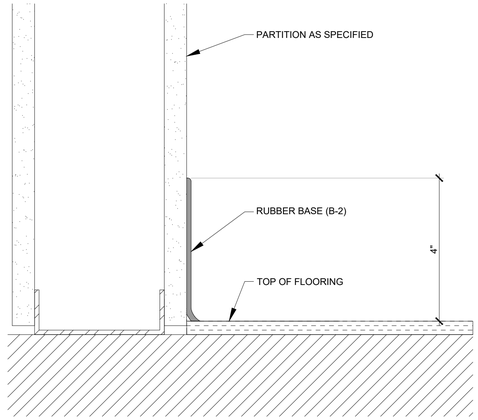

2 RUBBER BASE (BACK OF HOUSE)
6" = 1'-0"

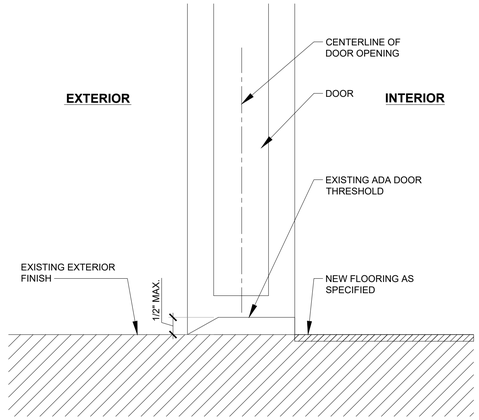

3 FLOOR DETAIL AT ENTRY
6" = 1'-0"

4 NOT USED
6" = 1'-0"

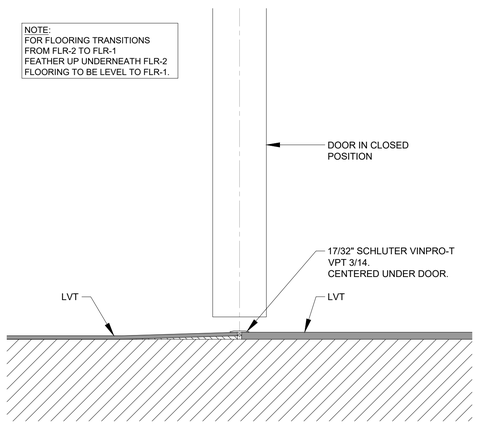

5 LVT TO LVT TRANSITION
6" = 1'-0"

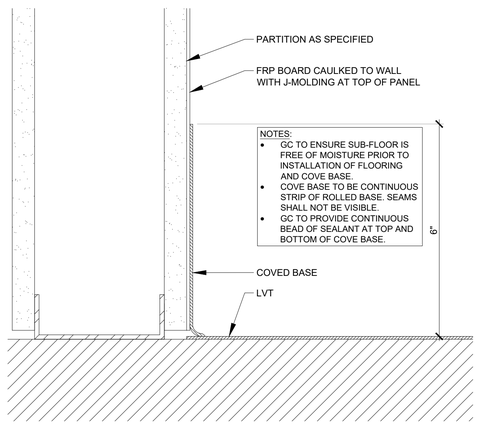

6 RESTROOM COVE BASE
6" = 1'-0"

GENERAL NOTES

1. IF EXISTING CONDITIONS VARY, CONTACT ARCHITECT FOR ALTERNATE TRANSITION PROFILES.
2. FLOORING TRANSITIONS TO BE PROVIDED BY G.C. AS INDICATED IN THE RESPONSIBILITY SCHEDULE ON SHEET G001.
3. PREPARE EXISTING FLOOR SURFACE PER MANUFACTURER SPECIFICATIONS FOR INSTALLATION OF NEW FLOORING MATERIALS AS INDICATED IN THESE PLANS
4. SEE MANUFACTURER SPECIFICATIONS FOR FLOORING EXPANSION

SARGENTI
5840 LEGACY CIR - STE D230, PLANO, TX 75024
T|201.316.5491 ★ WWW.SARGARCH.COM

SEAL:

STATE OF COLORADO ★ ROBERT J. SARGENTI 305929 ★ LICENSED ARCHITECT

DATE SIGNED: 10/15/2026

CONTRACTOR'S NOTES:

WRITTEN DIMENSIONS HOLD PREFERENCE OVER SCALED DIMENSIONS. DO NOT SCALE THE DRAWINGS. THE CONTRACTORS MUST VISIT JOB SITE TO VERIFY ALL EXISTING CONDITIONS AND DIMENSIONS BEFORE SUBMITTING BIDS. REPORT ANY DISCREPANCIES OF ANY CONDITIONS WHICH MAY INTERFERE WITH THE PROPER EXECUTION OF, THE CONTRACT TO THE TENANT'S REPRESENTATIVE. REPORT DISCREPANCIES DURING BIDDING PROCESS AND BEFORE START OF CONSTRUCTION. CHANGE ORDERS NEED TO BE APPROVED BY THE CONSTRUCTION MANAGER FOR ISSUES ARISING FROM THE FIELD CONDITIONS OR CONFLICTS BETWEEN THE PLANS AND THE EXISTING CONDITIONS PRIOR TO THE COMMENCEMENT OF WORK.

	DATE	ISSUE
△	DATE	REVISION

LOCATION:

Consumer Cellular®

8283 S. AKRON ST.
SUITE #110
CENTENNIAL, CO 80112

STORE NUMBER:

CO2

PROJECT INFORMATION:

DATE: 10/14/2026
PROJECT NUMBER: 15066 - 26
STORE TYPE: TIER 2
DRAWN BY: GV REVIEWED BY: AN

TITLE:

FLOORING AND BASE DETAILS

SHEET NUMBER:

A502

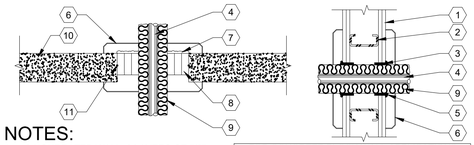

NOTES:

1. 2-HOURRATED WALL, 2 LAYERS OF 5/8" THICK GYPSUM BOARD OR CONCRETE BLOCK WALL, (SEE NOTE 4).
2. STEEL STUD.
3. 1 WRAP OF 2" WIDE FS-195 WRAP/STRIP FLUSH TO EXTERIOR GYPSUM PANEL. (SEE NOTE 1).
4. METAL PIPE.
5. SEAL ENTIRE EDGE AND SEAMS WITH 1/4" LAYER OF CAULK CP-25.
6. CLOSE FITTING METAL ESCUTCHEONS ON EACH SIDE OF WALL OR FLOOR
7. COVER SURFACE AND SEAMS WITH CAULK CP-25 OR PUTTY 303.
8. WRAP INSULATION PIPE WITH FS-195 WRAP/STRIP TO FILL GAP. FRICTION FIT WRAP INTO OPENING (SEE NOTE 1) OR SECURE WRAPS TO PIPE WITH 18 GAUGE STEEL TIE WIRE, THEN SLIDE INTO OPENING FLUSH WITH TOP OF FLOOR SLAB.
9. PIPE INSULATION.
10. 2-HOUR FIRE RATED CONCRETE FLOOR SLAB.
11. TIE WIRE.

- FOR CONCRETE BLOCK WALL APPLICATIONS CENTER WRAP STRIP WITHIN WALL AND SEAL WITH CAULK CP-25 OR PUTTY 303 ON BOTH SIDES OF WALL.
- IT IS NOT NECESSARY TO REMOVE INSULATION AS IT PENETRATES THE WALL OR FLOOR WHEN USING 2M FIRE BARRIER.
- MINIMUM NUMBER OF FS-195 WRAPS DEPENDS ON INSULATION THICKNESS:
  1" OF INSULATION - 1 WRAP
  2" OF INSULATION - 2 WRAPS
  3" OF INSULATION - 3 WRAPS
- RECOMMENDATIONS BASED ON PRODUCT PERFORMANCE ASTM E-814 (UL 1479) TIME TEMPERATURE CURVE FIRE EXPOSURE
- A 28 AWG METAL COVER PLATE IS REQUIRED WHEN ANNULAR SPACE EXCEEDS 2 7/8"
- FOR CONCRETE BLOCK WALL APPLICATIONS, IT IS OPTIONAL TO INSTALL THE FS-195 ON BOTH SIDES OF THE WALL. IT IS RECOMMENDED THAT THE FS-195 BE CENTERED IN THE WALL.

1 2-HOUR RATED INSULATED PIPE

3/4" = 1'-0"

SYSTEM NO. C-AJ-1388
ANSI/UL1479 (ASTM E814)
F RATING = 2-HR
T RATING = 0-HR

CLASSIFIED BY UNDERWRITERS LABORATORIES, INC. TO UL 1479 AND CAN/ULC-S115



SECTION A-A

NOTES

1. FLOOR OR WALL ASSEMBLY MIN 4-1/2 IN. THICK REINFORCED LIGHTWEIGHT OR NORMAL WEIGHT (100-150 PCF) CONCRETE. WALL MAY ALSO BE CONSTRUCTED OF ANY UL CLASSIFIED CONCRETE BLOCKS*. MAX AREA OF OPENING 224 SQ IN. WITH MAX DIMENSION OF 32 IN.
2. SEE CONCRETE BLOCKS (CAZT) IN THE FIRE RESISTANCE DIRECTORY FOR NAMES OF MANUFACTURERS. CONDUIT ONE OR MORE NOM 4 IN DIAM (OR SMALLER) STEEL ELECTRICAL METALLIC TUBING OR STEEL CONDUIT TO BE INSTALLED EITHER CONCENTRICALLY OR ECCENTRICALLY WITHIN THE FIRESTOP SYSTEM. THE SPACE BETWEEN CONDUITS OR TUBES SHALL BE MIN 0 IN. (POINT CONTACT) TO MAX 1/2 IN. THE ANNULAR SPACE BETWEEN THE CONDUIT OR TUBE AND PERIPHERY OF OPENING SHALL BE MIN 0 IN. (POINT CONTACT) TO MAX 2-3/4 IN. CONDUIT OR TUBE TO BE RIGIDLY SUPPORTED ON BOTH SIDES OF FLOOR OR WALL ASSEMBLY.
3. CONDUIT - NOM 4 IN. DIAM (OR SMALLER) STEEL ELECTRICAL METALLIC CONDUIT OR STEEL CONDUIT. FILL, VOID OR CAVITY MATERIAL*- FOAM MIN 5 IN. THICKNESS OF FILL MATERIAL APPLIED WITHIN THE ANNULUS, EXTENDING 1/2 IN. ABOVE THE TOP SURFACE OF THE FLOOR OR BOTH SURFACES OF WALL AND OVERLAPPING THE CONCRETE 1/2 IN. ON ALL SIDES OF THE OPENING. HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC -- CP 620 FIRE FOAM *BEARING THE UL CLASSIFICATION MARK

2 CORED SLAB DETAIL

3" = 1'-0"

SYSTEM NO. C-AJ-1226	
ANSI/UL1479 (ASTM E814)	ANSI/UL1479 (ASTM E814)
F RATING - 3 HR	F RATING - 3 HR
T RATING - 0 HR	FT RATING - 0 HR
L RATING AT AMBIENT - LESS THAN 1 CFM/SQ FT	FH RATING - 3 HR
L RATING AT 400 F - 4 CFM/SQ FT	FTH RATING - 0 HR
	L RATING AT AMBIENT - LESS THAN 1 CFM/SQ FT
	L RATING AT 400 F - 4 CFM/SQ FT

CLASSIFIED BY UNDERWRITERS LABORATORIES, INC. TO UL 1479 AND CAN/ULC-S115



SECTION A-A

NOTES:

1. FLOOR OR WALL ASSEMBLY — MIN 4-1/2 IN. (114 MM) THICK REINFORCED LIGHTWEIGHT OR NORMAL WEIGHT (100-150 PCF OR 1600-2400 KG/M³) CONCRETE. WALL MAY ALSO BE CONSTRUCTED OF ANY UL CLASSIFIED CONCRETE BLOCKS*. MAX DIAM OF OPENING IS 32 IN. (813 MM).
2. METALLIC SLEEVE — (OPTIONAL) NOM 32 IN. (813 MM) DIAM (OR SMALLER) SCHEDULE 40 (OR HEAVIER) STEEL SLEEVE CAST OR GROUTED INTO FLOOR OR WALL ASSEMBLY. FLUSH WITH FLOOR OR WALL SURFACES OR EXTENDING A MAX OF 3 IN. (76 MM) ABOVE FLOOR OR BEYOND BOTH SURFACES OF WALL.
   2.A. SHEET METAL SLEEVE — (OPTIONAL) MAX 6 IN. (152 MM) DIAM, MIN 26 GA. GALV STEEL PROVIDED WITH A 26 GA GALV STEEL SQUARE FLANGE SPOT WELDED TO THE SLEEVE AT APPROX MID-HEIGHT, OR FLUSH WITH BOTTOM OF SLEEVE IN FLOORS, AND SIZED TO BE A MIN OF 2 IN. (51 MM) LARGER THAN THE SLEEVE DIAM. THE SLEEVE IS TO BE CAST IN PLACE AND MAY EXTEND A MAX OF 4 IN. (102 MM) BELOW THE BOTTOM OF THE DECK AND A MAX OF 1 IN. (25 MM) ABOVE THE TOP SURFACE OF THE CONCRETE FLOOR.
   2.1. SHEET METAL SLEEVE — (OPTIONAL) - MAX 12 IN. (305 MM) DIAM, MIN 24 GA GALV STEEL PROVIDED WITH A 24 GA GALV STEEL SQUARE FLANGE SPOT WELDED TO THE SLEEVE AT APPROX MID-HEIGHT, OR FLUSH WITH BOTTOM OF SLEEVE IN FLOORS, AND SIZED TO BE A MIN OF 2 IN. (51 MM) LARGER THAN THE SLEEVE DIAM. THE SLEEVE IS TO BE CAST IN PLACE AND MAY EXTEND A MAX OF 4 IN. (102 MM) BELOW THE BOTTOM OF THE DECK AND A MAX OF 1 IN. (25 MM) ABOVE THE TOP SURFACE OF THE CONCRETE FLOOR.
3. THROUGH-PENETRANT — ONE METALLIC PIPE, TUBE OR CONDUIT TO BE INSTALLED EITHER CONCENTRICALLY OR ECCENTRICALLY WITHIN THE FIRESTOP SYSTEM. THE ANNULAR SPACE BETWEEN PENETRANT AND PERIPHERY OF OPENING SHALL BE MIN 0 IN. (POINT CONTACT) TO MAX 1-7/8 IN. (48 MM). PENETRANT MAY BE INSTALLED WITH CONTINUOUS POINT CONTACT. PENETRANT TO BE RIGIDLY SUPPORTED ON BOTH SIDES OF FLOOR OR WALL ASSEMBLY. THE FOLLOWING TYPES AND SIZES OF METALLIC PENETRANTS MAY BE USED:
   A. STEEL PIPE — NOM 30 IN. (762 MM) DIAM (OR SMALLER) SCHEDULE 10 (OR HEAVIER) STEEL PIPE.
   B. IRON PIPE — NOM 30 IN. (762 MM) DIA (OR SMALLER) CAST OR DUCTILE IRON PIPE.
   C. COPPER PIPE — NOM 6 IN. (152 MM) DIA (OR SMALLER) REGULAR (OR HEAVIER) COPPER PIPE.
   D. COPPER TUBING — NOM 6 IN. (152 MM) DIA (OR SMALLER) TYPE L (OR HEAVIER) COPPER TUBING.
   E. CONDUIT — NOM 6 IN. (152 MM) DIA (OR SMALLER) STEEL CONDUIT.
   F. CONDUIT — NOM 4 IN. (102 MM) DIA (OR SMALLER) STEEL ELECTRICAL METALLIC TUBING (EMT).
4. FIRESTOP SYSTEM — THE FIRESTOP SYSTEM SHALL CONSIST OF THE FOLLOWING:
   A. A. PACKING MATERIAL — MIN 4 IN. (102 MM) THICKNESS OF MIN 4 PCF (64 KG/M³) MINERAL WOOL BATT INSULATION FIRMLY PACKED INTO OPENING AS A PERMANENT FORM. PACKING MATERIAL TO BE RECESSED FROM TOP SURFACE OF FLOOR OR SLEEVE OR FROM BOTH SURFACES OF WALL OR SLEEVE AS REQUIRED TO ACCOMMODATE THE REQUIRED THICKNESS OF FILL MATERIAL.
   B. FILL, VOID OR CAVITY MATERIAL* — SEALANT — MIN 1/4 IN. (6 MM) THICKNESS OF FILL MATERIAL APPLIED WITHIN THE ANNULUS, FLUSH WITH TOP SURFACE OF FLOOR OR SLEEVE OR WITH BOTH SURFACES OF WALL OR SLEEVE. AT THE POINT OR CONTINUOUS CONTACT LOCATIONS BETWEEN PENETRANT AND CONCRETE OR SLEEVE, A MIN 1/4 IN. (6 MM) DIAM BEAD OF FILL MATERIAL SHALL BE APPLIED AT THE CONCRETE OR SLEEVE/ PIPE PENETRANT INTERFACE ON THE TOP SURFACE OF FLOOR AND ON BOTH SURFACES OF WALL.

HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC — FS-ONE SEALANT OR FS-ONE MAX INTUMESCENT SEALANT
* INDICATES SUCH PRODUCTS SHALL BEAR THE UL OR CUL CERTIFICATION MARK FOR JURISDICTIONS EMPLOYING THE UL OR CUL CERTIFICATION (SUCH AS CANADA), RESPECTIVELY.

5 CORED SLAB SLEEVE DETAIL

3" = 1'-0"

SYSTEM NO. F-A-1105	
ANSI/UL1479 (ASTM E814)	ANSI/UL1479 (ASTM E814)
F RATING - 2 HR	F RATING - 2 HR
T RATING - 2 HR	FT RATING - 2 HR
L RATING AT AMBIENT - LESS THAN 1 CFM/SQ FT	FH RATING - 2 HR
L RATING AT 400 F - 4 CFM/SQ FT	FTH RATING - 2 HR
W RATING - CLASS 1 (SEE ITEM 3B)	L RATING AT AMBIENT - LESS THAN 1 CFM/SQ FT
	L RATING AT 400 F - 4 CFM/SQ FT

CLASSIFIED BY UNDERWRITERS LABORATORIES, INC. TO UL 1479 AND CAN/ULC-S115

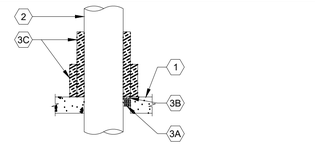

SECTION A-A

NOTES:

1. FLOOR ASSEMBLY — MIN 4-1/2 IN. (114 MM) THICK REINFORCED LIGHTWEIGHT OR NORMAL WEIGHT (100-150 PCF OR 1600-2400 KG/M³) CONCRETE. AS AN ALTERNATE, ANY MIN 2 HR FIRE RATED D700, D800 OR D900 SERIES FLOOR-CEILING DESIGN IN THE UL FIRE RESISTANCE DIRECTORY HAVING A MIN 2-1/2 IN. (64 MM) THICKNESS OF LIGHTWEIGHT OR NORMAL WEIGHT (100-150 PCF OR 1600-2400 KG/M³) CONCRETE TOPPING OVER THE STEEL DECK MAY BE USED. MAX DIAM OF OPENING IS 12-3/4 IN. (324 MM).
2. THROUGH-PENETRANT — ONE METALLIC PIPE INSTALLED CONCENTRICALLY OR ECCENTRICALLY WITHIN OPENING. ANNULAR SPACE BETWEEN PENETRANT AND PERIPHERY OF OPENING SHALL BE MIN OF 0 IN. (POINT CONTACT) TO MAX 2 IN. (51 MM). PENETRANT TO BE RIGIDLY SUPPORTED ON BOTH SIDES OF FLOOR ASSEMBLY. THE FOLLOWING TYPES AND SIZES OF PENETRANTS MAY BE USED:
   A. STEEL PIPE — NOM 10 IN. (254 MM) DIAM (OR SMALLER) SCHEDULE 40 (OR HEAVIER) STEEL PIPE.
   B. IRON PIPE — NOM 10 IN. (254 MM) DIAM (OR SMALLER) CAST OR DUCTILE IRON PIPE.
   C. CONDUIT — NOM 4 IN. (102 MM) DIAM (OR SMALLER) STEEL ELECTRICAL METALLIC TUBING OR NOM 6 IN. (152 MM) DIAM (OR SMALLER) RIGID STEEL CONDUIT.
3. FIRESTOP SYSTEM — THE FIRESTOP SYSTEM SHALL CONSIST OF THE FOLLOWING:
   A. PACKING MATERIAL — MIN 2 IN. (51 MM) THICKNESS OF MIN 4 PCF (64 KG/M³) MINERAL WOOL BATT INSULATION FIRMLY PACKED INTO OPENING AS A PERMANENT FORM. WHEN CP 604, CFS-S SIL GG OR CFS-S SIL SL SEALANT IS USED (SEE ITEM 3B), MIN THICKNESS OF PACKING MATERIAL IS 4 IN. (102 MM) AND MIN THICKNESS OF FLOOR IS 4-1/2 IN. (114 MM). PACKING MATERIAL TO BE RECESSED FROM TOP SURFACE OF FLOOR TO ACCOMMODATE THE REQUIRED THICKNESS OF FILL MATERIAL.
   B. FILL, VOID OR CAVITY MATERIALS* - SEALANT — MIN 1/2 IN. (13 MM) THICKNESS OF SEALANT APPLIED WITHIN THE ANNULUS, FLUSH WITH TOP SURFACE OF FLOOR. HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC — FS-ONE SEALANT, FS-ONE MAX INTUMESCENT SEALANT OR CP 604 SELF-LEVELING FIRESTOP SEALANT. CFS-S SIL GG OR CFS-S SIL SL SEALANT. W RATING APPLIES ONLY WHEN CP 604, CFS-S SIL GG OR CFS-S SIL SL SEALANT IS USED.
   C. DUCT WRAP MATERIAL* — ENCAPSULATED DUCT WRAP TIGHTLY WRAPPED AROUND PENETRANT TO EXTEND 24 IN. (610 MM) ABOVE THE FLOOR FOR PENETRANTS OF NOM 4 IN. (102 MM) DIAM OR SMALLER, AND 36 IN. (914 MM) ABOVE FLOOR FOR PENETRANTS GREATER THAN A NOM 4 IN. (102 MM) DIAM. AN ADDITIONAL LAYER OF ENCAPSULATED DUCT WRAP TIGHTLY WRAPPED AROUND THE FIRST LAYER OF DUCT WRAP TO EXTEND 12 IN. (305 MM) (914 MM) ABOVE FLOOR. ALL LONGITUDINAL SEAMS OF BOTH LAYERS OF DUCT WRAP AND JOINTS BETWEEN LAYERS OF DUCT WRAP ARE SEALED WITH FOIL TAPE. ONE OF THE FOLLOWING TYPES AND THICKNESSES OF DUCT WRAP MAY BE USED:
      C.1. NOM 1-1/2 IN. (38 MM) OR 2 IN. (51 MM) THICK ENCAPSULATED DUCT WRAP. UNIFRAX I LLC — FYREWRAP DUCT INSULATION OR FIREWRAP DUCT 1.5 INSULATION
      C.2. NOM 1-1/2 IN. (38 MM) THICK ENCAPSULATED DUCT WRAP. THERMAL CERAMICS INC — FIREMASTER FASTWRAP XL DUCT INSULATION

* INDICATES SUCH PRODUCTS SHALL BEAR THE UL OR CUL CERTIFICATION MARK FOR JURISDICTIONS EMPLOYING THE UL OR CUL CERTIFICATION (SUCH AS CANADA), RESPECTIVELY.

6 CORED PIPE SUPPORT/SLEEVE

3" = 1'-0"

SYSTEM NO. F-C-1104
F RATING = 1-HR
T RATING = 1-HR

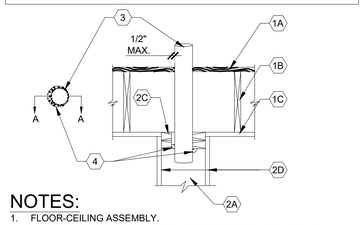

NOTES:

1. FLOOR-CEILING ASSEMBLY.
   A. WOOD FLOORING SYSTEM 1B. WOOD JOIST 1C. 5/8" TYPE 'X' GYPSUM WALLBOARD
2. CHASE WALL
   A. STUDS
   B. SOLE PLATES
   C. TOP PLATE
   D. GYPSUM WALLBOARD
3. THROUGH PENETRANTS
4. FIRESTOP SYSTEM - RECTORSEAL FIRESEAL BIOSTOP BF150+

3 CORED WOOD FLOOR DETAIL

3" = 1'-0"

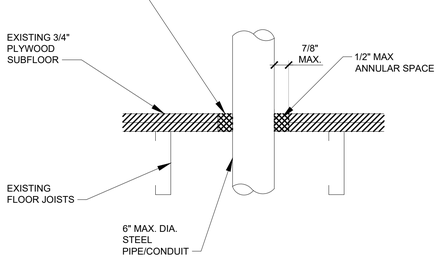

4 CORED WOOD SUBFLOOR DETAIL

3" = 1'-0"

SYSTEM NO. F-C-8008
F RATING = 1-HR
T RATING = 1-HR



SECTION A-A

NOTES

1. FLOOR-CEILING ASSEMBLY.
   1.A. FLOORING SYSTEM
   1.B. WOOD JOIST
   1.C. GYPSUM WALLBOARD
2. THROUGH PENETRANTS
3. TUBE INSTALATION-PLASTICS
4. FIRESTOP SYSTEM - RECTORSEAL FIRESEAL BIOSTOP BF150+

7 CORED WOOD FLOOR DETAIL

3" = 1'-0"

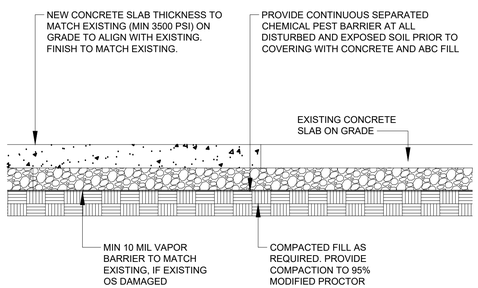

8 SLAB INFILL AT SUPPLY/WASTE

3" = 1'-0"

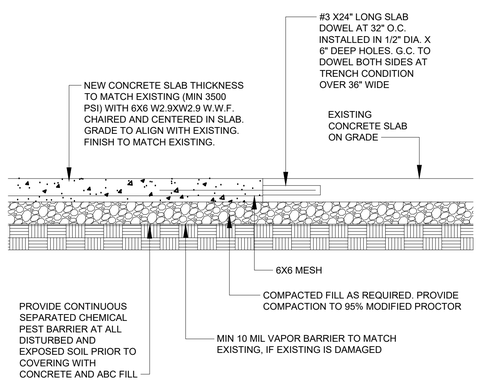

9 SLAB INFILL AT LEAVE OUT

3" = 1'-0"

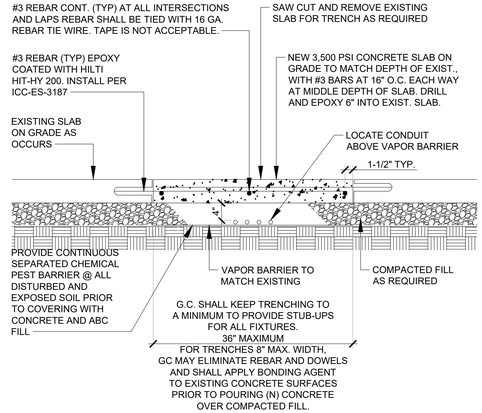

10 SLAB DOWELING AT TRENCH

3" = 1'-0"

SARGENTI

5840 LEGACY CIR - STE D230, PLANO, TX 75024
T|201.316.5491 ■ WWW.SARGARCH.COM

SEAL:

STATE OF COLORADO
ROBERT J. SARGENTI
305929
LICENSED ARCHITECT

DATE SIGNED: 10/15/2026

CONTRACTOR'S NOTES:

WRITTEN DIMENSIONS HOLD PREFERENCE OVER SCALED DIMENSIONS. DO NOT SCALE THE DRAWINGS. THE CONTRACTORS MUST VISIT JOB SITE TO VERIFY ALL EXISTING CONDITIONS AND DIMENSIONS BEFORE SUBMITTING BIDS. REPORT ANY DISCREPANCIES OF ANY CONDITIONS WHICH MAY INTERFERE WITH THE PROPER EXECUTION OF, THE CONTRACT TO THE TENANT'S REPRESENTATIVE. REPORT DISCREPANCIES DURING BIDDING PROCESS AND BEFORE START OF CONSTRUCTION. CHANGE ORDERS NEED TO BE APPROVED BY THE CONSTRUCTION MANAGER FOR ISSUES ARISING FROM THE FIELD CONDITIONS OR CONFLICTS BETWEEN THE PLANS AND THE EXISTING CONDITIONS PRIOR TO THE COMMENCEMENT OF WORK.

	DATE	ISSUE
△	DATE	REVISION

LOCATION:

Consumer Cellular®

8283 S. AKRON ST.
SUITE #110
CENTENNIAL, CO 80112

STORE NUMBER:

CO2

PROJECT INFORMATION:

DATE: 10/14/2026
PROJECT NUMBER: 15066 - 26
STORE TYPE: TIER 2
DRAWN BY: GV REVIEWED BY: AN

TITLE:

SLAB DETAILS

SHEET NUMBER:

A503

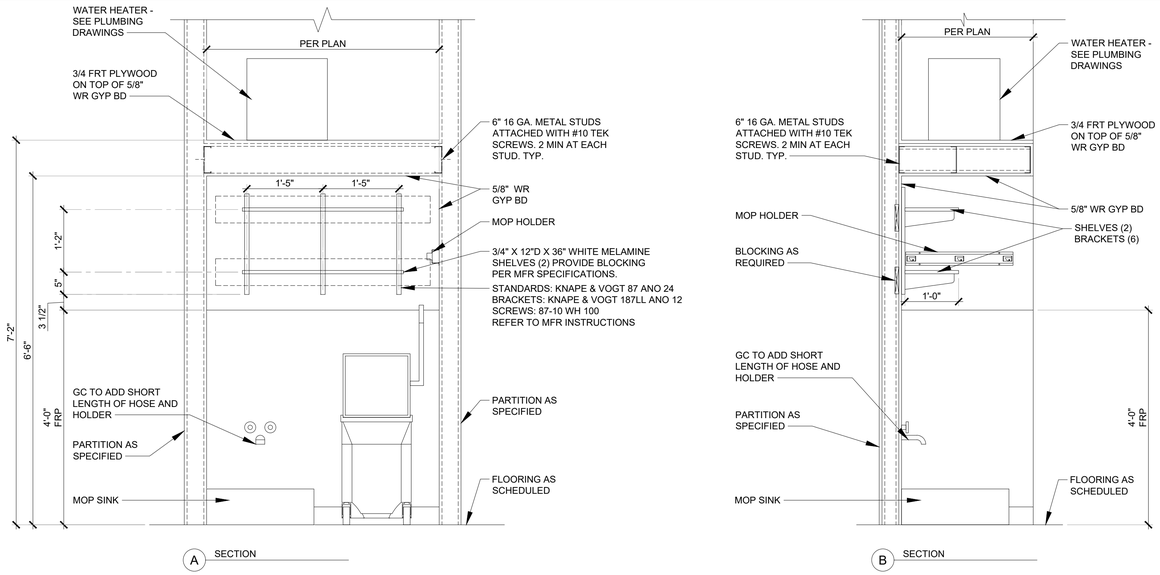

1 MOP SINK DETAILS (FOR REFERENCE ONLY)

3/4"=1'-0"

SARGENTI
5840 LEGACY CIR - STE D230, PLANO, TX 75024
T|201.316.5491 ■ WWW.SARGARCH.COM

SEAL:

STATE OF COLORADO
ROBERT J. SARGENTI
305929
LICENSED ARCHITECT

DATE SIGNED: 10/15/2026

CONTRACTOR'S NOTES:

WRITTEN DIMENSIONS HOLD PREFERENCE OVER SCALED DIMENSIONS. DO NOT SCALE THE DRAWINGS. THE CONTRACTORS MUST VISIT JOB SITE TO VERIFY ALL EXISTING CONDITIONS AND DIMENSIONS BEFORE SUBMITTING BIDS. REPORT ANY DISCREPANCIES OF ANY CONDITIONS WHICH MAY INTERFERE WITH THE PROPER EXECUTION OF, THE CONTRACT TO THE TENANT'S REPRESENTATIVE. REPORT DISCREPANCIES DURING BIDDING PROCESS AND BEFORE START OF CONSTRUCTION. CHANGE ORDERS NEED TO BE APPROVED BY THE CONSTRUCTION MANAGER FOR ISSUES ARISING FROM THE FIELD CONDITIONS OR CONFLICTS BETWEEN THE PLANS AND THE EXISTING CONDITIONS PRIOR TO THE COMMENCEMENT OF WORK.

	DATE	ISSUE
△	DATE	REVISION

LOCATION:

Consumer Cellular®

8283 S. AKRON ST.
SUITE #110
CENTENNIAL, CO 80112

STORE NUMBER:

CO2

PROJECT INFORMATION:

DATE: 10/14/2026
PROJECT NUMBER: 15066 - 26
STORE TYPE: TIER 2
DRAWN BY: GV REVIEWED BY: AN

TITLE:

MOP SINK DETAILS

SHEET NUMBER:

A504

DOOR SCHEDULE

DOOR #	DESCRIPTION	DOOR				FRAME		DETAILS			FIRE RATING	HARDWARE	FURNISHED BY	INSTALLED BY	NOTES
		SIZE	TYPE	MATERIAL	FINISH	MATERIAL	FINISH	SILL	JAMB	HEAD					
1A	(E) EXTERIOR MAIN ENTRY/EXIT	(2) 3'-0"X7'-0"X1 3/4" V.I.F.	A	EXISTING	EXISTING	EXISTING	EXISTING	EXISTING	EXISTING	EXISTING	-	EXISTING	EXISTING	EXISTING	1, 2, 3, 4, 5, 6, 29, 30, 31,32, 33
2B	(E) EXTERIOR HALLWAY	3'-0"X7'-0"X1 3/4" V.I.F.	B	EXISTING	PAINT PT-2	EXISTING	PAINT PT-2	EXISTING	EXISTING	EXISTING	-	A6, C2, H1, P1	EXISTING	EXISTING	3, 5, 6, 7, 8, 9, 10, 26, 34
3C	UTILITY	3'-0"X7'-0"X1 3/4"	C	WOOD (WHITE BIRCH)	CLEAR SATIN STAIN	HOLLOW METAL	P-2 SEMI GLOSS	A502	3/A600	2/A600	-	A10, C3, G2, H1, L6	G.C	G.C	
4C	UNISEX RESTROOM	3'-0"X7'-0"X1 3/4"	C	WOOD (WHITE BIRCH)	CLEAR SATIN STAIN	HOLLOW METAL	P-2 SEMI GLOSS	A502	3/A600	2/A600	-	A10, C3, G2, H1, L6	G.C	G.C	
5C	BOH	3'-0"X7'-0"X1 3/4"	C	WOOD (WHITE BIRCH)	CLEAR SATIN STAIN	HOLLOW METAL	P-2 SEMI GLOSS	A502	3/A600	2/A600	-	A10, C3, E3, G2, H1	G.C	G.C	
6C	OFFICE	3'-0"X7'-0"X1 3/4"	C	WOOD (WHITE BIRCH)	CLEAR SATIN STAIN	HOLLOW METAL	P-2 SEMI GLOSS	A502	3/A600	2/A600	-	A10, C3, G2, H1, L6	G.C	G.C	

DOOR HARDWARE LEGEND

ACCESSORIES				CLOSERS		ELECTRONIC HARDWARE		GASKETS		HINGES		LOCKSET		PANIC ALARM	
A1	PUSH/PULL BARS - ROCKWOOD BF 15847-1	A9	IVES 10 X 34 8400 KICK PLATE	C1	LCN 6030	E1	SECURITECH TEL-210S*	G1	IVES FS436 DOORSTOP	H1	MCKINNEY TA2714 NRP 4.5X4.5 HINGE	L1	BEST CYLINDER LOCK	P1	YALE 6100ED A-ALR 36 BSP 6000 SERIES
A2	INTERMEDIATE PIVOT - RIXON #M19 - OFFSET	A10	IVES #20 SILENCERS	C2	LCN 5010	E2	SECURITECH 4850-TTBG-37 5-POINT LOCK	G2	IVES WS406 CCV DOORSTOP	H2	HAGER 253** 4 1/2 " WIDE PIVOT HINGE	L2	QMI CYLINDER SILVER SHUTTER CURTAIN - LOCK OUTSIDE		
A3	TOP PIVOT - RIXON #180 - OFFSET	A11	TOP PIVOT - RIXSON 340	C3	LCN 4000 SERIES	E3	TRILOGY DL2700IC-26D	G3	DOOR SWEEP	H3	HAGER BB1191 NRP HINGE	L3	QMI CYLINDER SILVER SHUTTER CURTAIN - LOCK INSIDE-OUTSIDE		
A4	BOTTOM PIVOT - RIXON #147 - OFFSET	A12	CENTER HUNG PIVOT SET - RIXSON 370	C4		E4	SECURITECH DETEX V40-EB-HD-AL-REW-IC7-99	G4		H4	BOTTOM PIVOT - RIXSON #147 - OFFSET	L4	FALCON ND10S RHODES PASSAGE LATCH SET		
A5	NATIONAL GUARD US32D, US28, US15 FINISH THRESHOLD	A13	IVES U696 PEEP HOLE	C5		E5		G5		H5		L5	FALCON T581 AVALON STOREROOM LOCKSET		
A6	NATIONAL GUARD MILL FINISH THRESHOLD	A14	CRL BRUSHED STAINLESS 48" EXTRA LENGTH LADDER STYLE BACK-TO-BACK PULL	C6		E6		G6		H6		L6	FALCON TM301S AVALON PRIVACY LATCH SET		
A7	NATIONAL GUARD CRL8010ADJ THRESHOLD	A15	DOOR CLOSERS USA - STOREFRONT DOOR ADA COMPLIANT OFFSET PULL HANDLE AND SINGLE BEND PUSH BAR SET, CLEAR ANODIZED FINISH	C7		E7		G7		H7		L7	SCHLAGE D70PD RHODES OFFICE LOCKSET		
A8	IVES SR-64 SILENCERS	A16	BEA 10PBS451 STAINLESS STEEL PUSH PLATE, 4.5 IN. SQUARE, BLUE HANDICAP LOGO AND TEXT	C8		E8		G8		H8		L8	FALCON 8242-AL AUTOMATIC DOOR OPENER		

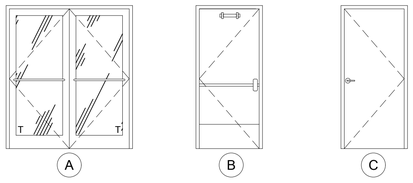

1 DOOR TYPES

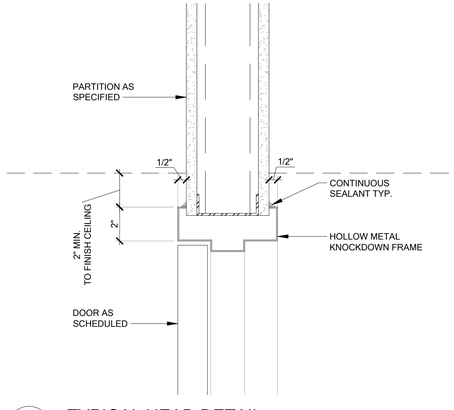

2 TYPICAL HEAD DETAIL
3" = 1'-0"

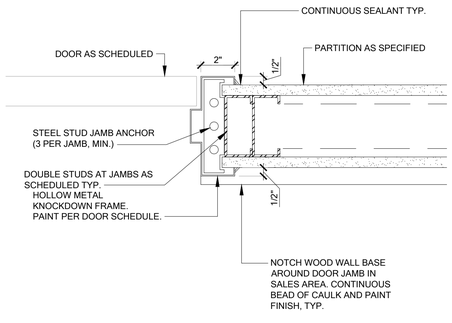

3 TYPICAL JAMB DETAIL
3" = 1'-0"

DOOR NOTES LEGEND

1. SIGNAGE BY G.C.; PROVIDE SIGNAGE ABOVE DOOR(S), SEE SHEET G002.
2. POSTAL ADDRESS NUMBERS PER LANDLORD REQUIREMENTS.
3. ADA PANIC HARDWARE TO BE INSTALLED ON INSIDE WHEN REQUIRED BY LOCAL JURISDICTION.
4. LOCKS SHALL BE KEY-OPERATED WITH INDICATOR TO BE READILY DISTINGUISHABLE AS LOCKED.
5. WEATHER STRIPPING AND SWEEPS TO BE INSTALLED AS REQUIRED.
6. EXISTING DOOR - VERIFY EXISTING HARDWARE MEETS REQUIREMENTS OF, OR IS EQUAL TO SPECIFIED HARDWARE. REPLACE WITH SPECIFIED HARDWARE AS REQUIRED.
7. KICK PLATE TO BE PROVIDED ON PUSH SIDE. IF NOT, PROVIDE AND INSTALL NEW KICK PLATE ON PUSH SIDE OF DOOR: IVES 8400 10"X2" LDW630.
8. VERIFY ALL EXISTING DOOR HARDWARE TO COMPLY WITH CURRENT CODE.
9. HARDWARE PURCHASED AND INSTALLED BY G.C., DOOR PREP BY G.C..
10. PROVIDE NON REMOVABLE PINS (NRP), PIANO TYPE HINGE OR GEARED HINGE (ROTON) AS APPROVED BY CONSUMER CELLULAR ON IN-SWINGING DOOR.
11. ROLL DOWN SHUTTER SHALL BE OPERABLE FROM INSIDE WITHOUT THE USE OF A KEY OR SPECIAL KNOWLEDGE OR EFFORT WHILE THE SPACE IS OCCUPIED.
12. SHUTTER SHALL REMAIN SECURED IN THE FULL OPEN POSITION DURING THE PERIOD OF OCCUPANCY BY THE GENERAL PUBLIC.
13. MAX SHUTTER SIZE: 160 SF OR 150" HIGH.
14. PROVIDE RISER AS REQUIRED FOR CARPET INSTALLATION.
15. PROVIDE LATCH GUARD USE "BG" GUARD PLATE.
16. PROVIDE 5 1/2" THROAT.
17. VERTICALLY STIFFED HOLLOW METAL DOOR RECOMMENDED FOR SECURITY AND EASE OF INSTALLATION.
18. LOCK HARDWARE PURCHASED AND INSTALLED BY G.C. THROUGH APPROVED VENDOR, SECURITY SOURCE.
19. MOUNT AT UPPER CORNER OF DOOR AND JAMB.
20. PROVIDE APPROPRIATE RESTROOM SIGNAGE, SEE SHEET G002 & THE ENLARGED RESTROOMS PLANS.
21. LOCK HARDWARE PURCHASED AND INSTALLED BY SECURITY SOURCE (VENDOR), DOOR PREP BY G.C..
22. ORDER 6" BOTTOM BAR WITH 60° BEVEL (ALTERNATE OPTION: 10" BOTTOM BAR), 7-PIN KEYED CYLINDERS (CONSTRUCTION CORES) WITH THUMBTURNS ON INSIDE, AND PATCH HINGES WITH DOOR.
23. PROVIDE LOUVRE VENT IN DOOR U.O.N. SEE MECHANICAL SHEETS.
24. G.C. TO PAINT 4 INCH "NO STORAGE" ON DOOR.
25. PROVIDE IC-7PIN MORTISE HOUSING AND INSTAKEY CORE.
26. G.C. TO ADD HAGER 1756 PEEPHOLE TO REAR EXIT DOOR WHEN NONE IS EXISTING. VIEWER TO BE INSTALLED APPROXIMATELY 60" AFF, CENTERED HORIZONTALLY ON DOOR AND SUITABLE FOR METAL DOOR INSTALLATION WITH WIDE ANGLE LENS. SEAL AND SECURE VIEWER TIGHTLY TO MAINTAIN DOOR INTEGRITY. UL LISTED FOR 90 MINUTE FIRE DOOR (UL10B).
27. SELF-LATCHING LOCK HARDWARE PURCHASED AND INSTALLED THROUGH SECURITY SOURCE (VENDOR) BY G.C. DOOR PREP BY G.C.
28. SUPPLY COMPLETE EXIT DEVICE PART NUMBER BASED ON DOOR SIZE AS REQUIRED. 36" DOOR = 36, NARROW STILE = NS, DOUBLE DOOR = 94. FOR NARROW STILE, ADD NARROW STILE KIT #101879-1.
29. PROVIDE ADDITIONAL INTERMEDIATE PIVOT FOR DOORS 8'-0" AND TALLER.
30. DO NOT PROVIDE HOLD OPEN DEVICE ON DOOR IF TACTILE SIGNAGE IS MOUNTED TO DOOR.
31. G.C. TO FIELD VERIFY CONDITION OF EXISTING DOOR HARDWARE AND COORDINATE WITH OWNER IF REPLACEMENT IS REQUIRED.
32. G.C. TO CLEAN EXISTING DOORS TO LIKE NEW CONDITION. G.C. TO INSTALL BOTTOM RAIL ADAPTER (CRL #10AD, DOOR CLOSERS USA #SF-ADA-36KIT-A OR EQ) TO EXTEND BOTTOM RAIL TO 10" MIN. TO MEET CODE WHEN REQUIRED.
33. GC TO ADD ADDRESS/SUITE NUMBERS TO ENTRY/ EXIT DOORS WHEN NOT EXISTING. NUMBERS HAVE HIGH CONTRAST WITH DOOR SURFACE. NUMBER TO BE 4" IN HEIGHT AND INSTALLED 60" AFF CENTERED ON DOOR.
34. GC TO INSTALL BLANK PLATE TO EXTERIOR SIDE OF DOOR AT HARDWARE LOCATION, IF REQUIRED.

GENERAL NOTES

A. HARDWARE FINISHES SHALL BE SATIN CHROME 626 UNLESS NOTED OTHERWISE.
B. ALL LOCKSETS AND LATCH SETS SHALL BE LEVER HANDLES.
C. VERIFY ALL EXISTING DOOR HARDWARE TO COMPLY WITH CURRENT CODE. SHALL NOT REQUIRE TIGHT GRASPING, TIGHT PINCHING OR TWISTING OF THE WRIST TO OPERATE. VERIFY EXISTING DOOR HANDLES, PULLS, LATCHES, LOCKS AND OTHER OPERATING DEVICES ARE INSTALLED BETWEEN 34" - 48" AFF.
D. G.C. TO PURCHASE AND INSTALL CORES PER HARDWARE SCHEDULE FROM CONSUMER CELLULAR'S VENDOR AT TIME OF STORE TURNOVER.
E. AT EXISTING DOORS TO REMAIN, VERIFY THAT EXISTING DOOR AND HARDWARE MEETS OR EXCEEDS THE REQUIREMENTS OF THESE SPECIFICATIONS. REPLACE AS REQUIRED.
F. DOORS WITH CLOSERS SHALL COMPLY WITH THE FOLLOWING:
   1. 5LBF MAXIMUM FORCE FOR OPENING DOOR
   2. FROM AN OPEN POSITION OF 70°, DOOR SHALL TAKE AT LEAST 3 SECONDS TO MOVE TO A POINT 3 INCHES FROM THE LATCH, MEASURED TO THE LEADING EDGE OF THE DOOR.
G. DOORS/FRAMES SHALL BE "TIMELY" (OR EQUAL) FACTORY FINISH TO MATCH P1.
H. LEVER SETS TO BE FALCON GRADE 1 WITH INTERCHANGEABLE CORES. T-SERIES OR APPROVED EQUAL LEVER TO BE AVALON STYLE.
I. SECURITECH TRIDENT EXIT DEVICES SUPPLIED BY LP NETWORK INC., DBA SECURITY SOURCE (888) 836-2137
J. EXIT DOORS SHALL BE READILY OPENABLE FROM THE EGRESS SIDE, WITHOUT THE USE OF A KEY OR SPECIAL KNOWLEDGE OR EFFORT. THE UNLATCHING OF ANY EXIT DOOR SHALL NOT REQUIRE MORE THAN ONE OPERATION. INSTALL ALL PANIC HARDWARE PER PLANS.
K. ALL DOORS EXCEPT THE MAIN ENTRANCE DOORS SHALL COMPLY WITH ICC / ANSI A-117.1 2009 SECTION 309.4 AND 404 2.6, AND IBC SECTION 1008.1.9. THE OPERABLE PARTS OF THE DOOR HARDWARE SHALL HAVE A SHAPE THAT IS EASY TO GRASP WITH ONE HAND AND DOES NOT REQUIRE TIGHT GRASPING, PINCHING OR THE TWISTING OF THE WRIST. THE FORCE TO ACTIVATE THE DOOR HARDWARE SHALL BE 5.0 POUNDS MAXIMUM.

SARGENTI
5840 LEGACY CIR - STE D230, PLANO, TX 75024
T|201.316.5491 ■ WWW.SARGARCH.COM

SEAL:

DATE SIGNED: 10/15/2026

CONTRACTOR'S NOTES:

WRITTEN DIMENSIONS HOLD PREFERENCE OVER SCALED DIMENSIONS. DO NOT SCALE THE DRAWINGS. THE CONTRACTORS MUST VISIT JOB SITE TO VERIFY ALL EXISTING CONDITIONS AND DIMENSIONS BEFORE SUBMITTING BIDS. REPORT ANY DISCREPANCIES OF ANY CONDITIONS WHICH MAY INTERFERE WITH THE PROPER EXECUTION OF, THE CONTRACT TO THE TENANT'S REPRESENTATIVE. REPORT DISCREPANCIES DURING BIDDING PROCESS AND BEFORE START OF CONSTRUCTION. CHANGE ORDERS NEED TO BE APPROVED BY THE CONSTRUCTION MANAGER FOR ISSUES ARISING FROM THE FIELD CONDITIONS OR CONFLICTS BETWEEN THE PLANS AND THE EXISTING CONDITIONS PRIOR TO THE COMMENCEMENT OF WORK.

	DATE	ISSUE
△	DATE	REVISION

LOCATION:

Consumer Cellular

8283 S. AKRON ST.
SUITE #110
CENTENNIAL, CO 80112

STORE NUMBER:

CO2

PROJECT INFORMATION:

DATE: 10/14/2026
PROJECT NUMBER: 15066 - 26
STORE TYPE: TIER 2
DRAWN BY: GV REVIEWED BY: AN

TITLE:

DOOR SCHEDULE AND DETAILS

SHEET NUMBER:

A600

FINISH SCHEDULE

	TAG	LOCATION USED	PRODUCT #/ NAME	DESCRIPTION	MANUFACTURER	COLOR/FINISH	SIZE	CONTACT		NOTES
PAINT	PT-1	SEE ELEVATIONS	SW 6070	PAINT	SHERWIN WILLIAMS	HERON PLUME / EGGSHELL		BRETT HUCKELBERRY	O | 214.553.3940 C | 214.728.6695	REFER TO ELEVATIONS
	PT-2	SEE ELEVATIONS	SW 7650	PAINT	SHERWIN WILLIAMS	ELLIE GRAY / EGGSHELL				REFER TO ELEVATIONS
	PT-3	SEE ELEVATIONS	SW 7674	PAINT	SHERWIN WILLIAMS	PEPPERCORN / EGGSHELL				REFER TO ELEVATIONS
	PT-4	SEE ELEVATIONS	SW 6885	PAINT	SHERWIN WILLIAMS	KNOCKOUT ORANGE / EGGSHELL				REFER TO ELEVATIONS
FLOORING/ SURFACES	FLR-1	SALES FLOOR & HALLWAY	EARTHEN I834V	LVT	PATCRAFT	DUSK 00520	12"X24"	BRAD TORNABENE	O | 800-241-4014 C | 480.276.8355 brad.tornabene@patcraft.com	4MM 20 MIL
	FLR-2	RESTROOMS	STONES 2.5 C2119	LVT	MOHAWK GROUP	989 VALLE DE BOVE	12"X24"	SHANAN KOPLAN	C | 561.866.5973 shanan_koplan@mohawkind.com	HALF LAP INSTALLATION
	FLR-3	BOH	CHALK 930 IND	VINYL TILE	EMSER	CHALK 930 IND	18" X 18"	MICHELLE OSBORNE	O | 480-443-8453 C | 480.285.9716 michelleosborne@emser.com	GC TO SUBSTITUTE WITH SLAB 921 IF CHALK 930 IND IS NOT IN STOCK.
	T-6	SALES, BOH	243150 / DEKTON NATURA	SOLID SURFACE COUNTERTOP	COSENTINO	NATURA 18		213.265.0756	213.265.0756	
LAMINATE	LAM-1	SEE ELEVATIONS	7197-58	LAMINATE	FORMICA	DOVER WHITE/ MATTE		SCOTT PETRO	623.225.8941	
	LAM-3	SEE ELEVATIONS	2297-PX	LAMINATE	FORMICA	TERRIL / PLEX		SCOTT PETRO	623.225.8943	
	LAM-4	SEE ELEVATIONS	8208K-16	LAMINATE	WILSONART	FAWN CYPRESS / MATTE		JOSEPH KLUGER	469.616.4958	
	LAM-6	SEE ELEVATIONS	1573-60	LAMINATE	WILSONART	FROSTY WHITE MATTE				
BASE & TRIM	B-1	SALES	MANDALAY MW-40-H6	VINYL BASE	TARKETT	BLACK	6"			
	B-2	BOH	700 SERIES WALL BASE	RUBBER COVE BASE	ROPPE	193 BLACK BROWN	4"			
	B-3	RESTROOMS	WALL BASE MOLDING - 820NA1 / 76174	THERMOPLASTIC COVE BASE	GRAINGER	SNOW WHITE	6"			GC TO SUBSTITUTE BLACK 6" TRIM IF WHITE IS OUT OF STOCK
	FRP	MOP SINK AREA / RESTROOMS	P100	PEBBLED FRP	MARLITE	WHITE				FRP TRIM TO BE: EDGE M370, OUTSIDE CORNER M360 AND INSIDE CORNER M350
CEILING	C-1	SEE PLANS		GYP BOARD CEILING						
	C-2	SEE PLANS	GRID: 15/16" STANDARD / TILE: CANYON 1492	ACT CEILING TILE	ARMSTRONG	WHITE / SMOOTHE	24"		1.877.276.7876	BEVELED TEGULAR EDGE

FURNITURE, FIXTURES AND EQUIPMENT SCHEDULE

	TAG	LOCATION USED	PRODUCT #/ NAME	DESCRIPTION	MANUFACTURER	COLOR/FINISH	SIZE	CONTACT		NOTES
FURNITURE	F-1	SALES AREA	SF0726	ELEMENT SOFA	ANDREU WORLD	FAB-3	67.32W" X 31.10" D X 32.28" H	MARY BLANCHARD	602.515.2736	
	F-2	SALES AREA	783	LOUNGE CHAIR	ACCERAY	FAB-1	31'' H x 27.5'' W x 27.5'' D	MELANINE VINDIVICH	MELANIE@SALESWESTGROUP.COM	
	F-3	SALES AREA	SOLO N CHAIR	LOUNGE CHAIR	ACCERAY	SEE NOTES	29"W x 31" D x 34" H	MELANINE VINDIVICH	MELANIE@SALESWESTGROUP.COM	
	F-4	SALES AREA	109592	COUNTER STOOL	ZUO	VINTAGE BLACK	18.9" W x 22.4" D x 36.2" H			
	F-5	SALES AREA	109590	BARSTOOL	ZUO	VINTAGE BLACK	18.9" W x 22.4" D x 40.2" H			
	F-6	SALES AREA	GTAB1025MTB	RECTANGULAR COFFEE TABLE	NOIR	BLACK STEEL WITH WHITE MARBLE TOP	64" W x 32"D x18" H	PEGGY HICKLIN	PEGGYH@BASSMANBAINE.COM	
	F-7	SALES AREA	11537/11269-CTB	ROUND COFFEE TABLE	MITCHELL GOLD + BOBBY WILLIAMS	VIENNA ROUND WHITE MARBLE PEWTER BASE	38" W x 38" D x 12" H			
	F-8	BOH AREA	TACHIC PARSONS CHAIR	BREAK ROOM CHAIRS	LATITUDE RUN	BLACK	21.1"D x 20.1" x 30.1 H			
	F-9	BOH AREA	PEDESTAL DINING TABLE	BREAK ROOM TABLE	ORREN ELLIS	WHITE	29.75" H x 41.38" D x 41.38" L			
	F-10	SALES AREA	SF2067	RAGLAN SOFA	ANDREU WORLD	FAB-3	76.77" W x 29.53" D x 28.35" H	MARY BLANCHARD	602.515.2736	
	F-11	SALES AREA	SPEC TBD BY OWNER	TABLE	SPEC TBD BY OWNER	SPEC TBD BY OWNER	SPEC TBD BY OWNER			
FABRICS	FAB-1	LOUNGE CHAIR	PATTERN: VECTOR	FABRIC	CONCERTEX	CHARCOAL / GRAFFITI-FREE	54"W	KRISTEN BENKO		
	FAB-3	SOFA	PATTERN: LYON	FABRIC	CONCERTEX	SADDLE	54"W	KRISTEN BENKO		
B.O.H FIXTURES	SHELVES	BOH AREA	H-3913	HEAVY-DUTY STEEL SHELVING	ULINE	TOUGH-POWDER COAT FINISH	48" X 24" X 72"			SHELVING ABOVE MOP SINK IS ON DETAIL 6/A500
	CABINET	BOH AREA	H-1871GR	JUMBO HEAVY DUTY STORAGE CABINET	ULINE	GRAY	48" X 24" X 78"			
	LOCKERS	BOH AREA	H-4808GR	DOUBLE TIER LOCKERS- 3 WIDE	ULINE	GRAY	36" x 12" x 72"			
	IT RACK	BOH AREA	SR18UB	SMARTRACK 18U MID-DEPTH HALF-HEIGHT RACK ENCLOSURE	TRIPP.LITE	BLACK				
	CAGE	BOH AREA	H-8297-4	WIRE SECURITY ROOM WITH ROOF (4 SIDED)	ULINE		8'X8', 4 SIDED			BUILT IN CYLINDER LOCK WITH KEYS INCLUDED. GC TO INSTALL SPACERS DOWN THE CENTER OF THE CAGE ON THE ROOF AND BACK WALL OF THE CAGE TO ACCOMMODATE A 1" GAP FROM THE DOOR TO THE DOOR JAMB TO ALLOW FOR THE ELECTRONIC STRIKE.
RUGS	RUG-1	SALES FLOOR	CT47977 / PATINA	AREA RUG WITH ADA EDGING	PATCRAFT	COLORWAY : CUSTOM	8' X 10'	CHANTEL WOLTERS	702.888.2071	Colors: ZF1507, 57900, C1726, CI553, C1752
	RUG-2	SALES FLOOR	YF83331 1095388	AREA RUG WITH ADA EDGING	PATCRAFT	COLORWAY : CUSTOM	8' X 10'	CHANTEL WOLTERS	702.888.2071	
	RUG-3	SALES FLOOR	CUBE AND COLOUR	ROUND AREA RUG WITH ADA EDGING	PATCRAFT	TANGERINE 00650	10' DIAMETER	CHANTEL WOLTERS	702.888.2071	INSTALL: HERRINBONE PATTERN
	RUG-4	SALES FLOOR	YF83331 1095388	AREA RUG WITH ADA EDGING	PATCRAFT	COLORWAY : CUSTOM	10' X 16'	CHANTEL WOLTERS	702.888.2071	Colors: A:CI752, B:CJ553, C:CB216, D:CI726
	MAT-1	SALES FLOOR		WALK OFF MAT	MAD MATTER INC.	291 RICH CHARCOAL-BACKGROUND/ 233 MANDARIN ORANGE-LETTERS	5'X6'	BEN STORZ	benjamin@madmatter.com	
RESTROOM FIXTURES	P-1	RESTROOM	0356.421 / LUCERNE WALL-HUNG LAVATOTY	WALL MOUNTED SINK	AMERICAN STANDARD	WHITE				
	P-2	RESTROOM	K-97282-4-CP	LAVATORY FAUCET	KOHLER	SINGLE HOLE COMMERCIAL FAUCET	POLISHED CHROME			
	P-4	RESTROOM	B-2013	SOAP DISPENSER	BOBRICK	STAINLESS STEEL / SATIN	10" X 4-1/4"			
	P-5	RESTROOM	0600 / INTEROLOK STAINLESS STEEL FRAMED MIRROR	MIRROR	ASI	STAINLESS STEEL				
	P-6	RESTROOM	K-3505-0 / WELLWORTH CLASSIC	TOILET	KOHLER	WHITE		DANNY HOWE	DANNY.HOWE@KOHLER.COM	
	P-7	RESTROOM	VERDEDRI Q-973A2	SURFACE MOUNTED ADA COMPLIANT HAND DRYER	WORLD DRYER	BRUSHED STAINLESS STEEL				
	P-8	RESTROOM	780929	8 GALLON HALF ROUND TRASH CAN	COMMERCIAL ZONE	STAINLESS STEEL				
HARDWARE	LOCK-1	SEE ELEVATIONS	C8053 SERIES / C SERIES	CAM LOCK	HAFELE	NICKEL	30MM		800.423.3531	PROVIDE KEYED FLUSH MOUNT LOCKS
	PULL-1	SALES AREA	BP98988030	CABINET PULLS	RICHELIEU	WHITE			1.800.619.5446	

LIGHTING SCHEDULE

	TAG	LOCATION USED	MFG	PRODUCT #/ NAME	DESCRIPTION	COLOR/FINISH	SIZE	CONTACT		NOTES
LIGHTING SCHEDULE	L-1	SALES / REF. TO PLANS	LOTUS	LD4R-30K-HO-4R-WR-WT / LLL-LD2050TR / FRP4	4" RECESSED DOWNLIGHT	WHITE	4" DIA	CS ILLUMINATION	O | 760-477-1244x2230 D | 860.968.3879 alewis@csillumination.com	ADD ELV DIMMER
	L-2A	SALES / REF. TO PLANS	WAC LIGHTING	PD-22754-AL	LED LINEAR PENDANT	BRUSHED ALUMINUM	54"	CS ILLUMINATION	O | 760-477-1244x2230 D | 860.968.3879 alewis@csillumination.com	6'-6" A.F.F
	L-2B	SALES / REF. TO PLANS	WAC LIGHTING	PD-22754-AL	LED LINEAR PENDANT	BRUSHED ALUMINUM	54"	CS ILLUMINATION	O | 760-477-1244x2230 D | 860.968.3879 alewis@csillumination.com	FLUSH WITH TRELLIS
	L-3A	SALES / REF. TO PLANS	Y-LIGHTING	HERE COMES THE SUN MEDIUM PENDANT LIGHT/SIZE LARGE	PENDANT LIGHT	WHITE/COPPER				
	L-3B	SALES / REF. TO PLANS	Y-LIGHTING	HERE COMES THE SUN MEDIUM PENDANT LIGHT/SIZE MEDIUM	PENDANT LIGHT	WHITE/COPPER				
	L-3C	SALES / REF. TO PLANS	Y-LIGHTING	HERE COMES THE SUN MEDIUM PENDANT LIGHT/SIZE SMALL	PENDANT LIGHT	WHITE/COPPER	6.88", 9.84", 13.77"	CS ILLUMINATION	O | 760-477-1244x2230 D | 860.968.3879 alewis@csillumination.com	
	L-4	SALES / REF. TO PLANS	ET2 LIGHTING	E23111-18 / LARMES LINEAR	PENDANT LIGHT	POLISHED CHROME	5"W X 8"H	CS ILLUMINATION	O | 760-477-1244x2230 D | 860.968.3879 alewis@csillumination.com	
	L-5	SALES / REF. TO PLANS	DIODE	D1-24V-BLBSC2-30 / LED TAPE LIGHT	LED STRIP		CUTTING SIZE: EVERY 2.8"	CS ILLUMINATION	O | 760-477-1244x2230 D | 860.968.3879 alewis@csillumination.com	
	L-6	SALES / REF. TO PLANS	VALRIYA	VA-BPL-22-30-3000K	RECESSED 2'X2' AREA LIGHT GRID			CS ILLUMINATION	O | 760-477-1244x2230 D | 860.968.3879 alewis@csillumination.com	
	L-6 EM	SALES / REF. TO PLANS	VALRIYA	VA-BPL-22-30-3000K / VA EDA-LI15-50	RECESSED 2'X2' AREA LIGHT GRID 90 MINUTE BATTERY BACKUP			CS ILLUMINATION	O | 760-477-1244x2230 D | 860.968.3879 alewis@csillumination.com	
	L-6A	SALES / REF. TO PLANS	VALRIYA	VA-TTR-24-40-3000K	RECESSED 2'X4' AREA LIGHT GRID			CS ILLUMINATION	O | 760-477-1244x2230 D | 860.968.3879 alewis@csillumination.com	
	L-6A EM	SALES / REF. TO PLANS	VALRIYA	VA-TTR-24-40-3000K-VA-EDA-L115-50	RECESSED 2'X4' AREA LIGHT GRID 90 MINUTE BATTERY BACKUP			CS ILLUMINATION	O | 760-477-1244x2230 D | 860.968.3879 alewis@csillumination.com	
	L-7	SALES / REF. TO PLANS	LUMENTURE	RWW160-30H-W-W	RECESSED WALL WASHER		3-1/8" X 7-3/8"	CS ILLUMINATION	O | 760-477-1244x2230 D | 860.968.3879 alewis@csillumination.com	
	L-8	RESTROOM / REF. TO PLANS	MAXIM LIGHTING	52000	WALL SCONCE	SATIN NICKEL	18"W x 1.75"H x 2.25"	CS ILLUMINATION	O | 760-477-1244x2230 D | 860.968.3879 alewis@csillumination.com	
	L-9	SALES / REF. TO PLANS	DUAL LITE	LZ-2-03L	SURFACE MOUNT EM FIXTURE	WHITE		CS ILLUMINATION	O | 760-477-1244x2230 D | 860.968.3879 alewis@csillumination.com	
	EX	EXTERIOR/ REF. TO PLANS	BEST	2RL52-WH	DUAL LED REMOTE HEAD	WHITE		CS ILLUMINATION	O | 760-477-1244x2230 D | 860.968.3879 alewis@csillumination.com	90 MIN. EMERGENCY BATTERY BACKUP
	EX1	SALES / REF. TO PLANS	EXITRONIX	S900C-SM-G-WH-R	LED EXIT SIGN	GREEN LETTERS, WHITE HOUSING		CS ILLUMINATION	O | 760-477-1244x2230 D | 860.968.3879 alewis@csillumination.com	90 MIN. EMERGENCY BATTERY BACKUP

NOTE:
NOT ALL ITEMS LISTED ARE USED AT THIS LOCATION. PLEASE REFER TO SHEETS A101, A102 & THE INTERIOR ELEVATIONS FOR SITE SPECIFIC FINISHES.

SARGENTI

5840 LEGACY CIR - STE D230, PLANO, TX 75024
T|201.316.5491 ■ WWW.SARGARCH.COM

SEAL:

STATE OF COLORADO
ROBERT J. SARGENTI
305929
LICENSED ARCHITECT

DATE SIGNED: 10/15/2026

CONTRACTOR'S NOTES:

WRITTEN DIMENSIONS HOLD PREFERENCE OVER SCALED DIMENSIONS. DO NOT SCALE THE DRAWINGS. THE CONTRACTORS MUST VISIT JOB SITE TO VERIFY ALL EXISTING CONDITIONS AND DIMENSIONS BEFORE SUBMITTING BIDS. REPORT ANY DISCREPANCIES OF ANY CONDITIONS WHICH MAY INTERFERE WITH THE PROPER EXECUTION OF, THE CONTRACT TO THE TENANT'S REPRESENTATIVE. REPORT DISCREPANCIES DURING BIDDING PROCESS AND BEFORE START OF CONSTRUCTION. CHANGE ORDERS NEED TO BE APPROVED BY THE CONSTRUCTION MANAGER FOR ISSUES ARISING FROM THE FIELD CONDITIONS OR CONFLICTS BETWEEN THE PLANS AND THE EXISTING CONDITIONS PRIOR TO THE COMMENCEMENT OF WORK.

	DATE	ISSUE
△	DATE	REVISION

LOCATION:

Consumer Cellular®

8283 S. AKRON ST.
SUITE #110
CENTENNIAL, CO 80112

STORE NUMBER:

CO2

PROJECT INFORMATION:

DATE: 10/14/2026
PROJECT NUMBER: 15066 - 26
STORE TYPE: TIER 2
DRAWN BY: GV REVIEWED BY: AN

TITLE:

ARCHITECTURAL SPECIFICATIONS

SHEET NUMBER:

A700

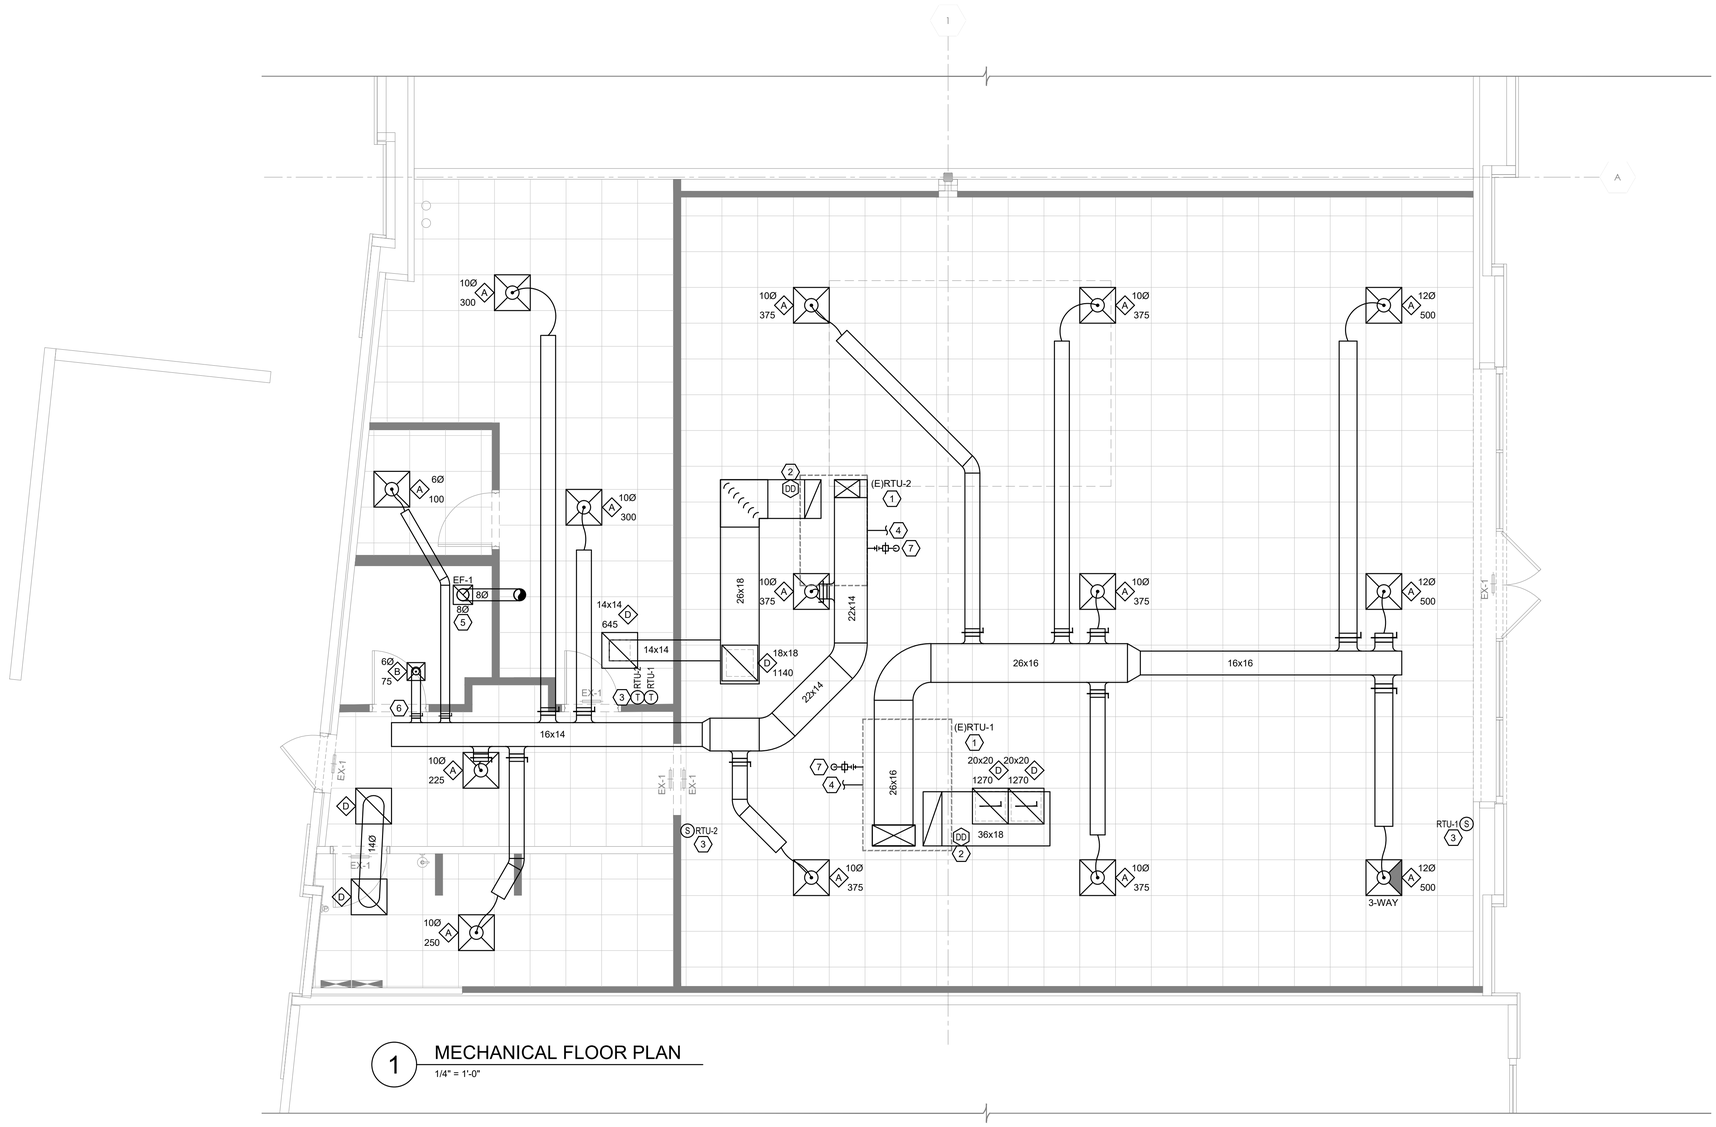

1 MECHANICAL FLOOR PLAN

1/4" = 1'-0"

FIELD VERIFY ALL CONDITIONS

DESIGN DRAWINGS ARE DIAGRAMMATIC. CONTRACTOR SHALL VISIT THE SITE PRIOR TO BIDDING OR AWARD OF CONTRACT TO INSPECT EXISTING FIELD CONDITIONS. CONTRACT SHALL INCLUDE ALL LABOR AND MATERIALS NECESSARY FOR FIELD MODIFICATIONS DUE TO EXISTING CONDITIONS. WHERE EXISTING CONDITIONS EXIST THAT PREVENT COMPLETION OF WORK, CONTRACTOR SHALL NOTIFY ENGINEER OF RECORD.

THE CONTRACTOR SHALL CONTACT THE ARCHITECT, ENGINEER OR OWNER PRIOR TO BIDDING FOR INTERPRETATIONS AND CLARIFICATIONS OF THE DESIGN AND INCLUDE IN HIS BID ALL COSTS TO MEET THE DESIGN INTENT. CLARIFICATIONS MADE BY THE ARCHITECT, ENGINEER OR OWNER AFTER BIDDING WILL BE FINAL AND SHALL BE IMPLEMENTED AT CONTRACTOR'S COST.

BIDDING CONTRACTORS SHALL HAVE A WORKING KNOWLEDGE OF LOCAL CODES AND ORDINANCES AND SHALL INCLUDE IN THEIR BIDS THE COSTS FOR ALL WORK INSTALLED IN STRICT ACCORDANCE WITH GOVERNING CODES. THE PLANS AND SPECIFICATIONS NOT WITHSTANDING, THE CONTRACTOR SHALL ALERT ARCHITECT, ENGINEER OR OWNER OF ANY APPARENT DISCREPANCIES BETWEEN GOVERNING CODES AND DESIGN INTENT.

MECHANICAL LEGEND

MANUAL BALANCING DAMPER TO BE PLACED IN ACCESSIBLE LOCATION

NOTE: SEE SHEET M102 FOR MECHANICAL SCHEDULES AND SHEET M501 FOR MECHANICAL DETAILS

KEYED NOTES

(##)	NOTES
1	EXISTING ROOFTOP UNIT. CONNECT NEW DUCTWORK TO SUPPLY AND RETURN DROPS DOWN THRU ROOF. VERIFY EXACT LOCATION IN FIELD.
2	PROVIDE NEW DUCT MOUNTED SMOKE DETECTOR WITH REMOTE TEST STATION IN THE RETURN DUCT UPSTREAM OF ANY FILTERS. DETECTOR SHALL SHUT DOWN UNIT UPON DETECTION OF SMOKE. INSTALL REMOTE TEST STATION IN CEILING GRID BENEATH UNIT.
3	PROVIDE NEW "HONEYWELL" MODEL TH8321WF1001 OR EQUAL WALL MOUNTED PROGRAMMABLE THERMOSTAT. MOUNT AT 48" A.F.F. PROVIDE REMOTE SENSORS MOUNTED AT 60" A.F.F. FOR TEMPERATURE BALANCING. CONFIRM THERMOSTAT IS COMPATIBLE WITH EXISTING RTU BEFORE ORDERING.
4	EXISTING CONDENSATE LINE TO REMAIN.
5	NEW CEILING MOUNTED EXHAUST FAN. ROUTE EXHAUST DUCT UP THROUGH ROOF. MAINTAIN 10'-0" FROM ANY FRESH AIR INTAKE. PROVIDE GOOSENECK FITTING WITH INSECT SCREEN AT DISCHARGE. PROVIDE INSULATED DUCT CURB AT ROOF PENETRATION. SEE EXHAUST FAN SCHEDULE ON SHEET M102 AND DETAIL A2 ON SHEET M501.
6	UNDERCUT DOOR A MINIMUM OF 1" (MAXIMUM 1-1/4".)
7	EXISTING GAS LINE AND METER TO REMAIN.

GENERAL NOTES

A. ALL ROOF WORK IS TO BE DONE BY THE LANDLORD'S ROOFING CONTRACTOR AND AT THE TENANT'S EXPENSE.

B. ALL DUCTWORK SHALL BE GALVANIZED SHEETMETAL PER SMACNA STANDARDS. NO DUCTBOARD PERMITTED.

C. ALL DUCT WORK SHALL BE INSULATED WITH A MINIMUM R-6 INSULATION FOR INTERIOR DUCTWORK AND A MINIMUM R-8 INSULATION FOR EXTERIOR DUCTWORK PER IECC (IN CALIFORNIA PROVIDE MINIMUM R-8 INTERIOR / EXTERIOR.)

D. PROVIDE INSULATED FLEXIBLE DUCT CONNECTIONS TO DIFFUSERS. FLEX DUCT LENGTH NOT TO EXCEED 5 FT.

E. VERIFY THE EXACT MOUNTING FRAME REQUIRED FOR EACH DIFFUSER.

F. PROVIDE ALL MANUAL BALANCE DAMPERS REQUIRED TO BALANCE THE ENTIRE SYSTEM.

G. ALL NEW RESTROOM DOORS SHALL BE UNDERCUT A MINIMUM 1". TENANT GENERAL CONTRACTOR SHALL ENSURE THAT EXISTING DOORS COMPLY.

H. PROVIDE AND SIZE CONDENSATE LINES AS REQUIRED. ROUTE TO NEAREST ROOF DRAIN WHERE PERMITTED, ELSE TO THE NEAREST APPROVED RECEPTOR.

I. REPLACE FILTERS PRIOR TO TURNOVER.

J. PROVIDE RFI/RFQ TO P.M. & ARCHITECT FOR ALL DISCREPANCIES PRIOR TO COMMENCING WORK.

K. TENANT GENERAL CONTRACTOR SUB TO PROVIDE REDLINES OF ALL DEVIATIONS FROM THE PLANS AND PROVIDE A COMPLETE TEST & BALANCE REPORT AS REQUIRED BY THE CONTRACT.

WHEN REQUIRED, IT IS THE OWNER'S RESPONSIBILITY TO CONTRACT WITH A COMMISSIONING AUTHORITY TO COMPLY WITH LOCAL CODES.

SARGENTI
5840 LEGACY CIR - STE D230, PLANO, TX 75024
T|201.316.5491 ■ WWW.SARGARCH.COM

GEMINI ENGINEERING GROUP
101 Nightlinger Lane
Millsap, TX 76066
(817) 672-7562

SEAL:

COLORADO LICENSED
CLAYTON LUCAS
63118
PROFESSIONAL ENGINEER
10/15/2026

CONTRACTOR'S NOTES:

WRITTEN DIMENSIONS HOLD PREFERENCE OVER SCALED DIMENSIONS. DO NOT SCALE THE DRAWINGS. THE CONTRACTORS MUST VISIT JOB SITE TO VERIFY ALL EXISTING CONDITIONS AND DIMENSIONS BEFORE SUBMITTING BIDS. REPORT ANY DISCREPANCIES OF ANY CONDITIONS WHICH MAY INTERFERE WITH THE PROPER EXECUTION OF, THE CONTRACT TO THE TENANT'S REPRESENTATIVE. REPORT DISCREPANCIES DURING BIDDING PROCESS AND BEFORE START OF CONSTRUCTION. CHANGE ORDERS NEED TO BE APPROVED BY THE CONSTRUCTION MANAGER FOR ISSUES ARISING FROM THE FIELD CONDITIONS OR CONFLICTS BETWEEN THE PLANS AND THE EXISTING CONDITIONS PRIOR TO THE COMMENCEMENT OF WORK.

	DATE	ISSUE
△	DATE	REVISION

LOCATION:

Consumer Cellular

8283 S. AKRON ST.
SUITE #110
CENTENNIAL, CO 80112

STORE NUMBER:

CO2

PROJECT INFORMATION:

DATE: 10/15/2026
PROJECT NUMBER: 15066 - 26
STORE TYPE: TIER 2
DRAWN BY: HO REVIEWED BY: CL

TITLE:

MECHANICAL FLOOR PLAN

SHEET NUMBER:

M101

MECHANICAL SYMBOLS

NOTE: NOT ALL USED AT THIS LOCATION

SINGLE LINE	DESCRIPTION	DOUBLE LINE
	90° ELBOW DOWN	
	90° ELBOW UP	
	ROUND RADIUS ELBOW	
	90° STRAIGHT TEE	
	90° CONICAL TEE	
	45° BRANCH	
	45° CONICAL TEE	
	SIZE OR SHAPE TRANSITION	
	ROUND FLEXIBLE DUCT	
	90° ELBOW DOWN	
	90° ELBOW UP	
	RECTANGULAR RADIUS ELBOW	
	RECTANGULAR ELBOW WITH TURNING VANES	
	BRANCH TAKE-OFF WITH 45° TAP	
	LINED DUCTWORK (UNLESS NOTED OTHERWISE)	
	SIDEWALL SUPPLY GRILLE OR REGISTER WITH AIR EXTRACTOR	
	SUPPLY DUCT RISER	
	RETURN, EXHAUST OR OUTSIDE AIR DUCT RISER	
	DOOR GRILLE	
	MANUAL BALANCING DAMPER	
MD	MOTORIZED DAMPER	MD
FD	FIRE DAMPER	FD
FSD	COMBINATION FIRE AND SMOKE DAMPER WITH SMOKE DETECTOR	FSD
SD	SMOKE DAMPER (AUTOMATIC) WITH SMOKE DETECTOR	SD
S	DUCT MOUNTED SMOKE DETECTOR	S
	RETURN AIR DUCT / CEILING RETURN AIR GRILLE OR REGISTER	AND/ OR
	SUPPLY AIR DUCT / SUPPLY DIFFUSER LINEAR DIFFUSER	AND/ OR
	EXHAUST AIR DUCT / CEILING MOUNTED EXHAUST FAN	AND/ OR
	CANVAS CONNECTOR WITH VIBRATION	
	CONNECT TO EXISTING	
	REMOVE TO THIS POINT	
	FLEXIBLE CONNECTION	
T	THERMOSTAT	T
S	SENSOR	S
	UNIT HEATER	
	EXHAUST FAN	
	CONDENSING UNIT	
	FAN COIL UNIT / AIR HANDLER UNIT	
	ROOFTOP AIR CONDITIONING UNIT	
O.A.	OUTSIDE AIR INTAKE	O.A.
	TRANSFER GRILLE	
	DUCT SLEEVE	

MECHANICAL ABREVIATIONS

NOTE: NOT ALL USED AT THIS LOCATION

A.C.U. OR A.C.	AIR CONDITIONING UNIT (SPLIT-DX OR WATER COOLED)
A.F.F.	ABOVE FINISHED FLOOR
A.H.U.	AIR HANDLING UNIT
B.O.H.	BACK OF HOUSE
B.T.U.H.	BRITISH THERMAL UNIT / HOUR
C.H.	CABINET HEATER
C.U.	CONDENSING UNIT (SPLIT-DX SYSTEMS)
C.F.M.	CUBIC FEET PER MINUTE
E.A.T.	ENTERING AIR TEMPERATURE
E.B.H.	ELECTRIC BASEBOARD HEATER
E.D.H.	ELECTRIC DUCT HEATER
E.E.R.	ENERGY EFFICIENCY RATIO
E.F.	EXHAUST FAN
E.S.P.	EXTERNAL STATIC PRESSURE
F.C.U.	FAN COIL UNIT
F.F.C.H.	FORCED FLOW CABINET HEATER
F.L.A.	FULL LOAD AMPS
G.F.I.	GROUND FAULT INTERRUPTER
I.O.M.	INSTALLATION AND OPERATION MANUAL
K.W.	KILOWATT
L.A.T.	LEAVING AIR TEMPERATURE
M.C.A.	MINIMUM CIRCUIT AMPACITY
N.C.	NOISE CRITERIA
O.A.	OUTSIDE AIR
P.S.I.	POUNDS PER SQUARE INCH
R.L.A.	RUNNING LOAD AMPS
R.T.U.	ROOF TOP UNIT
S.E.E.R.	SEASONAL ENERGY EFFICIENCY RATIO
T.G.C.	TENANT GENERAL CONTRACTOR
U.H.	UNIT HEATER
U.N.O.	UNTIL NOTED OTHERWISE
V.F.	VENTILATION FAN
W.C.	WATER COLUMN
W.G.	WATER GAUGE

EXISITNG PACKAGED GAS HEAT ROOFTOP UNIT SCHEDULE

SYMBOL	BASIS FOR DESIGN	AIR FLOW (CFM)	O.A. FLOW (CFM)	EXT. S.P. (IN W.C.)	DX COOLING COIL			GAS HEAT			ELECTRICAL					APPROX. WEIGHT (LBS.)	NOTES
					TONS	TOTAL LOAD (MBH)	SENSIBLE LOAD (MBH)	INPUT (MBH)	OUTPUT (MBH/HR)	STAGES	VOLTS/Ø/HZ.	MCA	MOCP	IEER	SEER		
(E)RTU-1	CARRIER 48FEFM08	3,000	460	.70	7.5	86.0	EX	224	181	2	208/3/60	38	50	15.0	--	EXISTING	1
(E)RTU-2	CARRIER 48FCFA06	2,000	215	.70	5	58.5	EX	150	120	2	208/3/60	31	45	--	14.0	EXISTING	1

NOTES

1. SEE EXISTING SYSTEM NOTES THIS SHEET

VENTILATION REQUIREMENT CALCULATION

PER IMC TABLE 403.3

ROOM NAME	UNIT SERVICING	PEOPLE	CFM/PERSON	CFM/SF	AREA (SF)	PEOPLE X CFM/PERSON	SF X CFM/SF	TOTAL O.A. CFM	ZONE AIR DIST EFF TABLE 403.2.1.2	REQUIRED O.A. CFM	PROVIDED O.A. CFM
SALES	RTU-1,2	30	7.5	0.12	1985	225	238	463	0.8	579	580
CORRIDOR	RTU-2	-	-	0.06	150	-	9	9	0.8	11	15
BOH	RTU-2	2	5	0.06	362	10	22	32	0.8	40	40
OFFICE	RTU-2	1	5	0.06	51	5	3	8	0.8	10	15
STORAGE	RTU-2	-	-	0.12	149	-	18	18	0.8	22	25
RESTROOMS		-	-	-	60	-	-	-	0.8		-
							MINIMUM FRESH AIR CFM REQUIRED PER CODE				675
							TOTAL O.A. PROVIDED				675
RESTROOMS	70 CFM / FIXTURE			# FIXTURES=	1		CFM EXHAUST REQ'D	70	CFM EXHAUST PROVIDED	110	CFM EXHAUST PROVIDED

NOTES: REPRESENTS CONDITIONS DURING NORMAL OPERATIONS AND NOT CONSIDERING ECONOMIZER OPERATION.

GRILLE, REGISTER AND DIFFUSER SCHEDULE

SYMBOL	MANUFACTURER	MODEL	SERVICE	MODULE (L" X W")	FACE SIZE (L" X W")	FRAME TYPE	FINISH	MOUNTING	N.C.	NOTES
A	TITUS	TMS	SUPPLY DIFFUSER	24" X 24"	24" X 24"	SEE PLANS	#26 WHITE	CEILING	<35	A, B, C, D
B	TITUS	TMS	SUPPLY DIFFUSER	12" X 12"	12" X 12"	SEE PLANS	#26 WHITE	CEILING	<35	A, B, C, D
C	TITUS	350RL	RETURN GRILLE	14" X 14"	14" X 14"	SEE PLANS	#26 WHITE	WALL	<35	A
D	TITUS	50F	RETURN GRILLE	24" X 24"	24" X 24"	SEE PLANS	#26 WHITE	CEILING	<35	A, B, C

NOTES:
A. BOH FRAME AND FACE BLADES SHALL HAVE BAKED ENAMEL OFF- WHITE FINISH.
B. COORDINATE EXACT FRAME MOUNTING TYPE WITH ARCHITECTURAL CEILING PLAN.
C. BRANCH DUCT SIZE SHALL BE SAME AS NECK SIZE UNLESS OTHERWISE NOTED.
D. SELECT TMSA DIFFUSER PER NECK SIZE. SEE PLANS.
E. MOUNT TOP OF GRILLE 6" BELOW FINISHED CEILING.

EXHAUST FAN SCHEDULE

SYMBOL	MANUFACTURER	MODEL	TYPE	DRIVE TYPE	PERFORMANCE				ELECTRICAL		APPROX. WEIGHT (LBS.)	NOTES
					AIR FLOW (CFM)	EXT. STATIC (IN W.C.)	FAN SPEED (RPM)	SONES	VOLTS/Ø/HZ.	WATTS		
EF-1	BROAN	QTXEG110	CEILING	DIRECT	110	0.10	-	.4	115/1/60	23.9	12	1,2,3

NOTES: 1. PROVIDE INSULATED ROOF CURB FOR MOUNTING. 2. PROVIDE WITH BACKDRAFT DAMPER. 3. PROVIDE GOOSENECK FITTING/INSECT SCREEN AT DISCHARGE ON ROOF.

EXISTING SYSTEM NOTES

A. T.G.C. SHALL PROVIDE THE FOLLOWING (BUT NOT LIMITED TO)
B. THE COMPLETE LUBRICATION OF ALL SHAFTS AND BEARINGS THAT HAVE LUBRICATION ZERTS.
C. THE REPLACEMENT OF ALL BELTS, HOSES AND FABRIC/RIBBER COATED ITEMS THAT ARE SUBJECT TO WEAR.
D. REPLACE FILTERS
E. CHECK AMPS OF THE INDOOR, OUTDOOR MOTORS, AND COMPRESSORS
F. TURN UNIT POWER OFF - TIGHTEN ALL ELECTRICAL CONNECTIONS, CONTACTORS, ETC.
G. EXAMINE AND REPAIR ALL ELECTRICAL WIRING, CONTROLS, STARTERS, RELAYS, CAPACITORS AND LIKE ITEMS THAT TEND TO DETERIORATE OVER TIME OR BECOME NON-OPERATIONAL. THIS INCLUDES SMOKE DETECTORS.
H. CHECK REFRIGERANT CHARGE (GUAGES OR RETURN/SUPPLY TEMPERATURE VARIANCE).
I. CHECK POWER EXHAUST FAN AND RESTROOM FAN MOTORS
J. ENSURE DRAIN PAN AND DRAIN LINES ARE CLEAN AND FREE OF BLOCKAGE.
K. GREASE ALL FITTINGS
L. CLEAN EVAPORATOR AND CONDENSER COILS. THE STRAIGHTENING (COMBING) OF ALL LOUVERS & FINS.
M. VERIFY ANY WORK REQUIRED BY THE LANDLORD PRIOR TO BID.
N. ALL FINDINGS AND VALUES TO BE NOTED AND PROVIDED TO TENANT'S CONSTRUCTION MANAGER & OR TENANT'S MAINTENANCE DIRECTOR.

SARGENTI
5840 LEGACY CIR - STE D230, PLANO, TX 75024
T|201.316.5491 ■ WWW.SARGARCH.COM

GEMINI ENGINEERING GROUP
101 Nightlinger Lane
Millsap, TX 76066
(817) 672-7562

SEAL:

COLORADO LICENSED
CLAYTON LUCAS
63118
PROFESSIONAL ENGINEER
10/15/2026

CONTRACTOR'S NOTES:

WRITTEN DIMENSIONS HOLD PREFERENCE OVER SCALED DIMENSIONS. DO NOT SCALE THE DRAWINGS. THE CONTRACTORS MUST VISIT JOB SITE TO VERIFY ALL EXISTING CONDITIONS AND DIMENSIONS BEFORE SUBMITTING BIDS. REPORT ANY DISCREPANCIES OF ANY CONDITIONS WHICH MAY INTERFERE WITH THE PROPER EXECUTION OF, THE CONTRACT TO THE TENANT'S REPRESENTATIVE. REPORT DISCREPANCIES DURING BIDDING PROCESS AND BEFORE START OF CONSTRUCTION. CHANGE ORDERS NEED TO BE APPROVED BY THE CONSTRUCTION MANAGER FOR ISSUES ARISING FROM THE FIELD CONDITIONS OR CONFLICTS BETWEEN THE PLANS AND THE EXISTING CONDITIONS PRIOR TO THE COMMENCEMENT OF WORK.

	DATE	ISSUE
△	DATE	REVISION

LOCATION:

Consumer Cellular

8283 S. AKRON ST.
SUITE #110
CENTENNIAL, CO 80112

STORE NUMBER:

CO2

PROJECT INFORMATION:

DATE: 10/15/2026
PROJECT NUMBER: 15066 - 26
STORE TYPE: TIER 2
DRAWN BY: HO REVIEWED BY: CL

TITLE:

MECHANICAL SCHEDULES

SHEET NUMBER:

M102

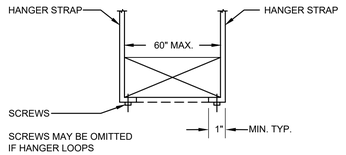

7 DUCT HANGING
NTS

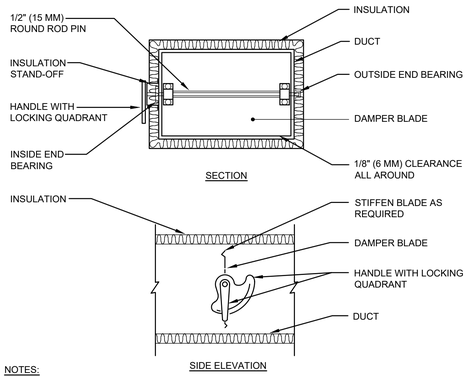

NOTES:

1. DETAIL SHOWS SINGLE BLADE DAMPER. DAMPER INSTALLATION SHALL BE SIMILAR FOR MULTI-BLADE DAMPERS & ROUND DAMPERS.

6 MANUAL DAMPER DETAIL
NTS

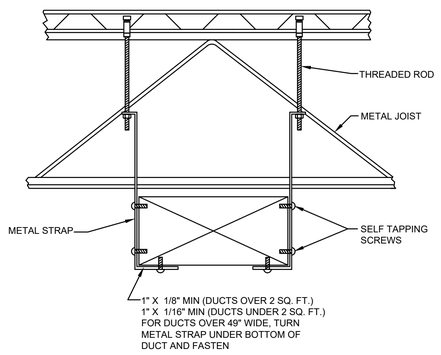

5 DUCT SUPPORT DETAIL
NTS

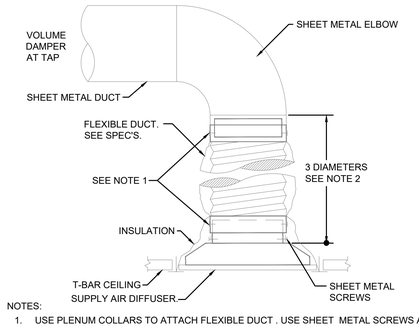

NOTES:

1. USE PLENUM COLLARS TO ATTACH FLEXIBLE DUCT , USE SHEET METAL SCREWS AND (2) WRAPS OF TAPE TO SECURE PLENUM COLLARS. ALTERNATE METHOD: BANDING DEVICE OR PANDUIT STRAP, IN LIEU OF SHEET METAL SCREWS. ALL TAPES AND SEALING MATERIALS SHALL COMPLY WITH UL181A FOR RIGID DUCT AND UL181B FOR FLEXIBLE DUCT.
2. SECURE SHEET METAL DROP TO DIFFUSER NECK WITH A MIN. OF (3) SHEET METAL SCREWS AND (2) FULL WRAPS OF TAPE PER UL REQUIREMENTS LISTED IN NOTE 1.
3. ALL FLEX DUCT SHALL BE INSTALLED WITHOUT KINKS, SAGGING, OR SHORT-RADIUS BENDS.

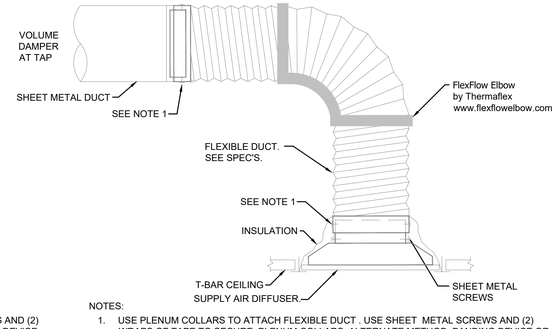

NOTES:

1. USE PLENUM COLLARS TO ATTACH FLEXIBLE DUCT , USE SHEET METAL SCREWS AND (2) WRAPS OF TAPE TO SECURE PLENUM COLLARS. ALTERNATE METHOD: BANDING DEVICE OR PANDUIT STRAP, IN LIEU OF SHEET METAL SCREWS. ALL TAPES AND SEALING MATERIALS SHALL COMPLY WITH UL181A FOR RIGID DUCT AND UL181B FOR FLEXIBLE DUCT.
2. IF A MINIMUM OF 2 DIAMETERS OF STRAIGHT RUN IS NOT AVAILABLE ABOVE THE REGISTER USE HARD DUCT SHORT RADIUS CONNECTION.
3. ALL FLEX DUCT SHALL BE INSTALLED WITHOUT KINKS, SAGGING, OR SHORT-RADIUS BENDS.

3 SUPPLY DIFFUSER
NTS

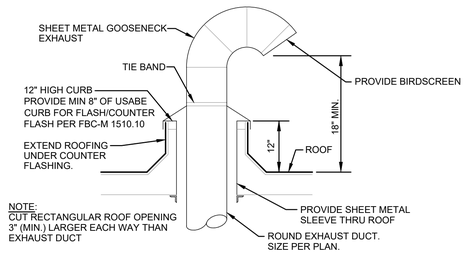

NOTE:
CUT RECTANGULAR ROOF OPENING 3" (MIN.) LARGER EACH WAY THAN EXHAUST DUCT

2 GOOSENECK EXHAUST FAN DETAIL
NTS

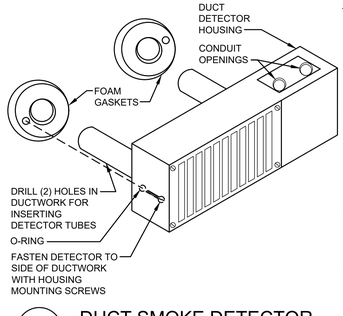

NOTES:

1. TOTALINE MODEL #P270-20001 UL 268A LISTED OR EQUIVALENT.
2. RUGGED NORYL HOUSING WITH STRONG CLEAR POLYCARBONATE INSPECTION COVER.
3. ACCOMMODATES ION (IONIZATION) OR PHOTO HEADS (PHOTOELECTRIC).
4. SUITABLE FOR 4 WIRE 14-18 AWG WIRE, 24VAC/DC OR 120/220 VAC OPERATION.
5. REMOTE TEST STATION OPTION.
6. POWERED OUTPUTS FOR REMOTE LED AND AUDIBLE ALARM.
7. AIR VELOCITY RATING FROM 300 TO 4000 FPM.
8. EQUIPPED WITH A DPDT AUXILIARY RELAY.

1 DUCT SMOKE DETECTOR
NTS

SARGENTI
5840 LEGACY CIR - STE D230, PLANO, TX 75024
T|201.316.5491 ■ WWW.SARGARCH.COM

GEMINI ENGINEERING GROUP
101 Nightlinger Lane
Millsap, TX 76066
(817) 672-7562

SEAL:

COLORADO LICENSED CLAYTON LUCAS 63118 PROFESSIONAL ENGINEER
10/15/2026

CONTRACTOR'S NOTES:

WRITTEN DIMENSIONS HOLD PREFERENCE OVER SCALED DIMENSIONS. DO NOT SCALE THE DRAWINGS. THE CONTRACTORS MUST VISIT JOB SITE TO VERIFY ALL EXISTING CONDITIONS AND DIMENSIONS BEFORE SUBMITTING BIDS. REPORT ANY DISCREPANCIES OF ANY CONDITIONS WHICH MAY INTERFERE WITH THE PROPER EXECUTION OF, THE CONTRACT TO THE TENANT'S REPRESENTATIVE. REPORT DISCREPANCIES DURING BIDDING PROCESS AND BEFORE START OF CONSTRUCTION. CHANGE ORDERS NEED TO BE APPROVED BY THE CONSTRUCTION MANAGER FOR ISSUES ARISING FROM THE FIELD CONDITIONS OR CONFLICTS BETWEEN THE PLANS AND THE EXISTING CONDITIONS PRIOR TO THE COMMENCEMENT OF WORK.

	DATE	ISSUE
△	DATE	REVISION

LOCATION:

Consumer Cellular

8283 S. AKRON ST.
SUITE #110
CENTENNIAL, CO 80112

STORE NUMBER:

CO2

PROJECT INFORMATION:

DATE: 10/15/2026
PROJECT NUMBER: 15066 - 26
STORE TYPE: TIER 2
DRAWN BY: HO REVIEWED BY: CL

TITLE:

MECHANICAL DETAILS

SHEET NUMBER:

M501

COMcheck Software Version COMcheckWeb

Mechanical Compliance Certificate

Project Information

Energy Code:	2021 IECC
Project Title:	CC Centennial, CO
Location:	Denver, Colorado
Climate Zone:	5b
Project Type:	Alteration

Construction Site:
8283 S. Akron St., Suite 110
Centennial, Colorado 80112

Owner/Agent:

Designer/Contractor:
Clayton Lucas, P.E.
Gemini Engineering Group
101 Nightlinger Lane
Milsap, Texas 76066
817.672.7562

Mechanical Systems List

Quantity **System Type & Description**

1 Water Heater:
Electric Storage Water Heater, Capacity: 10 gallons w/ Circulation Pump
No minimum efficiency requirement applies

Mechanical Compliance Statement

Compliance Statement: The proposed mechanical alteration project represented in this document is consistent with the building plans, specifications, and other calculations submitted with this permit application. The proposed mechanical systems have been designed to meet the 2021 IECC requirements in COMcheck Version COMcheckWeb and to comply with any applicable mandatory requirements listed in the Inspection Checklist.

CLAYTON LUCAS, P.E. — Name - Title
Signature
10/15/2026 — Date

COMcheck Software Version COMcheckWeb

Inspection Checklist

Energy Code: 2021 IECC

Requirements: 100.0% were addressed directly in the COMcheck software

Text in the "Comments/Assumptions" column is provided by the user in the COMcheck Requirements screen. For each requirement, the user certifies that a code requirement will be met and how that is documented, or that an exception is being claimed. Where compliance is itemized in a separate table, a reference to that table is provided.

Section # & Req.ID	Plumbing Rough-In Inspection	Complies?	Comments/Assumptions
C404.5, C404.5.1, C404.5.2 [PL6][3]	Heated water supply piping conforms to pipe length and volume requirements. Refer to section details.	☐Complies ☐Does Not ☐Not Observable ☐Not Applicable	Requirement will be met. **Location on plans/spec:** P101, P501
C404.6.1, C404.6.2 [PL3][3]	Automatic time switches installed to automatically switch off the recirculating hot-water system or heat trace.	☐Complies ☐Does Not ☐Not Observable ☐Not Applicable	Requirement will be met. **Location on plans/spec:** P101, P501
C404.6.3 [PL7][3]	Pumps that circulate water between a heater and storage tank have controls that limit operation from startup to <= 5 minutes after end of heating cycle.	☐Complies ☐Does Not ☐Not Observable ☐Not Applicable	Requirement will be met.
C404.6.1, C404.6.1.1 [PL8][3]	Demand recirculation water systems have controls that start the pump upon receiving a signal from the action of a user of a fixture or appliance and limits the temperature of the water entering the cold-water piping to 104°F.	☐Complies ☐Does Not ☐Not Observable ☐Not Applicable	Requirement will be met. **Location on plans/spec:** P101

Additional Comments/Assumptions:

1 High Impact (Tier 1) 2 Medium Impact (Tier 2) 3 Low Impact (Tier 3)

Section # & Req.ID	Mechanical Rough-In Inspection	Complies?	Comments/Assumptions
C402.2.6 [ME41][3]	Thermally ineffective panel surfaces of sensible heating panels have insulation >= R-3.5.	☐Complies ☐Does Not ☐Not Observable ☐Not Applicable	**Exception:** Requirement does not apply.
C403.9 [ME144][2]	Large diameter fans where installed shall be tested and labeled in accordance with AMCA 230.	☐Complies ☐Does Not ☐Not Observable ☐Not Applicable	**Exception:** Requirement does not apply.
C403.7.2 [ME115][3]	Enclosed parking garage ventilation has automatic contaminant detection and capacity to stage or modulate fans to 50% or less of design capacity.	☐Complies ☐Does Not ☐Not Observable ☐Not Applicable	**Exception:** Requirement does not apply.
C403.7.5 [ME116][3]	Kitchen exhaust systems comply with replacement air and conditioned supply air limitations, and satisfy hood rating requirements and maximum exhaust rate criteria.	☐Complies ☐Does Not ☐Not Observable ☐Not Applicable	**Exception:** Requirement does not apply.
C403.4.1.4 [ME63][2]	Heating for vestibules and air curtains with integral heating include automatic controls that shut off the heating system when outdoor air temperatures > 45F. Vestibule heating and cooling systems controlled by a thermostat in the vestibule with heating setpoint <= 60F and cooling setpoint >= 80F.	☐Complies ☐Does Not ☐Not Observable ☐Not Applicable	**Exception:** Requirement does not apply.
C408.2.2.1 [ME53][3]	Air outlets and zone terminal devices have means for air balancing.	☐Complies ☐Does Not ☐Not Observable ☐Not Applicable	Requirement will be met. **Location on plans/spec:** M101
C403.11.3 C403.11.3.1; C403.11.3.2 [ME123][3]	Refrigerated display cases, walk-in coolers or walk-in freezers served by remote compressors and remote condensers not located in a condensing unit, have fan-powered condensers that comply with Sections C403.11.3.1 and refrigeration compressor systems that comply with C403.11.3.2..	☐Complies ☐Does Not ☐Not Observable ☐Not Applicable	**Exception:** Requirement does not apply.

Additional Comments/Assumptions:

1 High Impact (Tier 1) 2 Medium Impact (Tier 2) 3 Low Impact (Tier 3)

Section # & Req.ID	Rough-In Electrical Inspection	Complies?	Comments/Assumptions
C405.7 [EL26][3]	Low-voltage dry-type distribution electric transformers meet the minimum efficiency requirements of Table C405.6.	☐Complies ☐Does Not ☐Not Observable ☐Not Applicable	**Exception:** Requirement does not apply.
C405.8 [EL27][3]	Electric motors meet the minimum efficiency requirements of Tables C405.7(1) through C405.7(4). Efficiency verified through certification under an approved certification program or the equipment efficiency ratings shall be provided by motor manufacturer (where certification programs do not exist).	☐Complies ☐Does Not ☐Not Observable ☐Not Applicable	**Exception:** Requirement does not apply.
C405.9.1, C405.9.2 [EL28][3]	Escalators and moving walks comply with ASME A17.1/CSA B44 and have automatic controls configured to reduce speed to the minimum permitted speed in accordance with ASME A17.1/CSA B44 or applicable local code when not conveying passengers.	☐Complies ☐Does Not ☐Not Observable ☐Not Applicable	**Exception:** Requirement does not apply.
C405.10 [EL29][3]	Total voltage drop across the combination of feeders and branch circuits <= 5%.	☐Complies ☐Does Not ☐Not Observable ☐Not Applicable	Requirement will be met. **Location on plans/spec:** E301
C405.1.1 [EL30][3]	At least 90% of dwelling unit permanently installed lighting shall have lamp efficacy >= 65 lm/W or luminaires with efficacy >= 45 lm/W or comply with C405.2.4 or C405.3.	☐Complies ☐Does Not ☐Not Observable ☐Not Applicable	**Exception:** Requirement does not apply.
C405.11, C405.11.1 [EL31][3]	50% of 15/20 amp receptacles installed in enclosed offices, conference rooms, copy rooms, break rooms, classrooms and workstations and > 25% of branch circuit feeders for modular furniture will have automatic receptacle control in accordance with C405.11.1.	☐Complies ☐Does Not ☐Not Observable ☐Not Applicable	**Exception:** Requirement does not apply.

Additional Comments/Assumptions:

1 High Impact (Tier 1) 2 Medium Impact (Tier 2) 3 Low Impact (Tier 3)

Section # & Req.ID	Final Inspection	Complies?	Comments/Assumptions
C404.3 [FI11][3]	Heat traps installed on supply and discharge piping of non-circulating systems.	☐Complies ☐Does Not ☐Not Observable ☐Not Applicable	**Exception:** Requirement does not apply.
C404.4 [FI25][2]	All piping insulated in accordance with section details and Table C403.12.3.	☐Complies ☐Does Not ☐Not Observable ☐Not Applicable	Requirement will be met. **Location on plans/spec:** M101
C404.6.1 [FI12][3]	Controls are installed that limit the operation of a recirculation pump installed to maintain temperature of a storage tank. System return pipe is a dedicated return pipe or a cold water supply pipe.	☐Complies ☐Does Not ☐Not Observable ☐Not Applicable	Requirement will be met. **Location on plans/spec:** P101, P501
C408.1.1 [FI57][3]	Building operations and maintenance documents will be provided to the owner. Documents will cover manufacturers' information, specifications, programming procedures and means of illustrating to owner how building, equipment and systems are intended to be installed, maintained, and operated.	☐Complies ☐Does Not ☐Not Observable ☐Not Applicable	Requirement will be met.

Additional Comments/Assumptions:

1 High Impact (Tier 1) 2 Medium Impact (Tier 2) 3 Low Impact (Tier 3)

SARGENTI
5840 LEGACY CIR - STE D230, PLANO, TX 75024
T|201.316.5491 ■ WWW.SARGARCH.COM

GEMINI ENGINEERING GROUP
101 Nightlinger Lane
Millsap, TX 76066
(817) 672-7562

SEAL:

COLORADO LICENSED
CLAYTON LUCAS
63118
PROFESSIONAL ENGINEER
10/15/2026

CONTRACTOR'S NOTES:

WRITTEN DIMENSIONS HOLD PREFERENCE OVER SCALED DIMENSIONS. DO NOT SCALE THE DRAWINGS. THE CONTRACTORS MUST VISIT JOB SITE TO VERIFY ALL EXISTING CONDITIONS AND DIMENSIONS BEFORE SUBMITTING BIDS. REPORT ANY DISCREPANCIES OF ANY CONDITIONS WHICH MAY INTERFERE WITH THE PROPER EXECUTION OF, THE CONTRACT TO THE TENANT'S REPRESENTATIVE. REPORT DISCREPANCIES DURING BIDDING PROCESS AND BEFORE START OF CONSTRUCTION. CHANGE ORDERS NEED TO BE APPROVED BY THE CONSTRUCTION MANAGER FOR ISSUES ARISING FROM THE FIELD CONDITIONS OR CONFLICTS BETWEEN THE PLANS AND THE EXISTING CONDITIONS PRIOR TO THE COMMENCEMENT OF WORK.

	DATE	ISSUE
△	DATE	REVISION

LOCATION:

Consumer Cellular®

8283 S. AKRON ST.
SUITE #110
CENTENNIAL, CO 80112

STORE NUMBER:

CO2

PROJECT INFORMATION:

DATE: 10/15/2026
PROJECT NUMBER: 13066 - 26
STORE TYPE: TIER 2
DRAWN BY: HO REVIEWED BY: CL

TITLE:

ENERGY CALCULATIONS

SHEET NUMBER:

M601

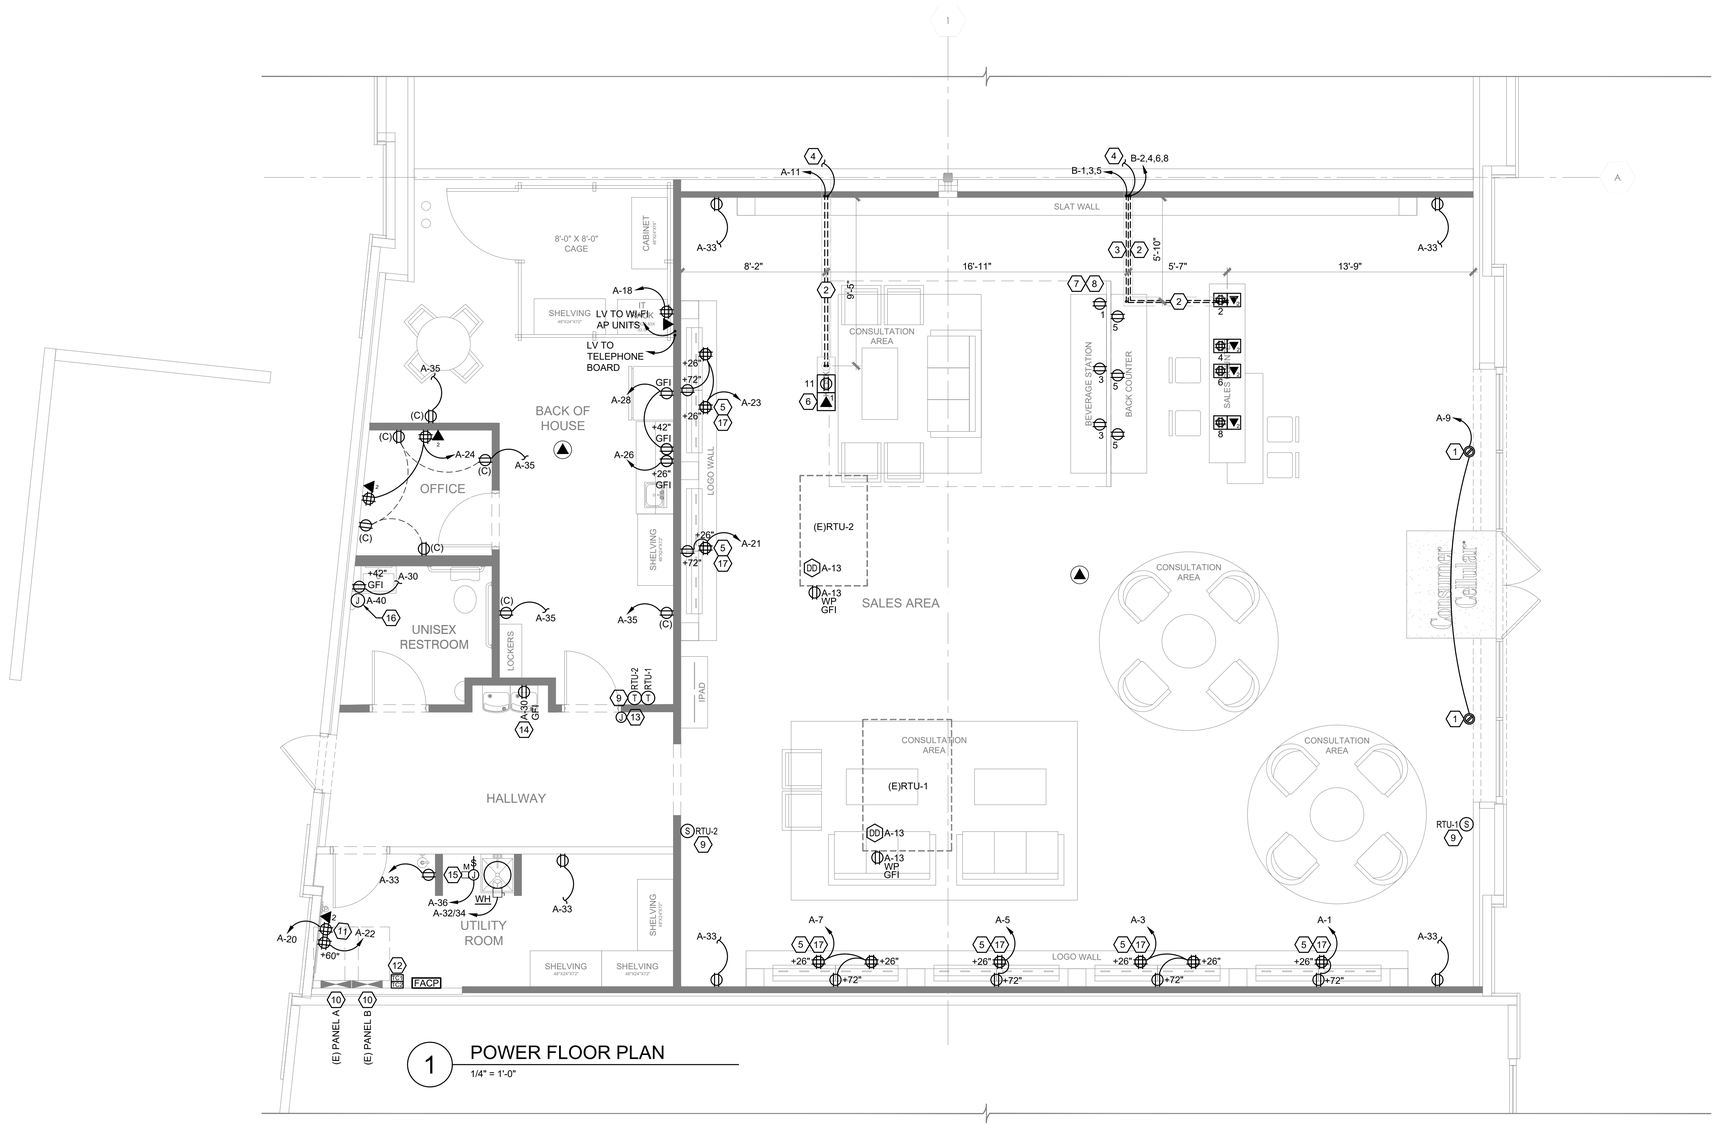

KEYED NOTES

##	NOTES
1	SHOW WINDOW RECEPTACLE(S). LOCATE 18" FROM TOP OF WINDOW (NEC 210.62).
2	PROVIDE (2) 1" EMT CONDUITS: (1) FOR POWER CIRCUIT AND (1) FOR DATA CABLES. COORDINATE EXACT LOCATION OF CONDUIT STUB-INS WITH GC PRIOR TO START OF WORK. PROVIDE POWER FROM PANEL TO FIXTURE.
3	PROVIDE (1) 1" EMT CONDUIT FOR POWER CIRCUIT. COORDINATE EXACT LOCATION OF CONDUIT STUB-INS WITH GC PRIOR TO START OF WORK. PROVIDE POWER FROM PANEL TO FIXTURE.
4	PROVIDE DATA CABLES TO TELEPHONE DATA BOARD.
5	PROVIDE QUAD RECEPTACLE, POWER CIRCUIT AND WIRING TO EACH RECEPTACLE. SEE ARCHITECTURAL INTERIOR ELEVATIONS.
6	LEGRAND WIREMOLD OMNIBOX SERIES SPECIFICATION: (1) 880CS2-1 TWO-GANG CAST IRON FLOOR BOX (1) 828TCAL TWO-GANG BRUSHED ALUMINUM RECTANGULAR FLANGE. (2) 828GFITCAL BRUSHED ALUMINUM COVER PLATE
7	VERIFY EXACT LOCATION OF STUB-IN FOR POWER AND DATA CONNECTION TO BACKWRAP AND BEVERAGE STATION. COORDINATE WITH MILLWORK VENDOR PRIOR TO START OF WORK,
8	ROUTE CONDUIT/WIRES WITHIN MILLWORK. CONDUIT/WIRES MUST NOT BE EXPOSED OR VISIBLE TO THE PUPLIC. COORDINATE LOCATION OF RECEPTACLES AND DATA OUTLETS WITH MILLWORK VENDOR PRIOR TO INSTALLATION.
9	PROVIDE NEW "HONEYWELL" MODEL TH8321WF1001 OR EQUAL WALL MOUNTED PROGRAMMABLE THERMOSTAT. MOUNT AT 48" A.F.F. PROVIDE REMOTE SENSORS MOUNTED AT 60" A.F.F. FOR TEMPERATURE BALANCING. CONFIRM THERMOSTAT IS COMPATIBLE WITH EXISTING RTU BEFORE ORDERING.

KEYED NOTES

##	NOTES
10	ELECTRICAL PANEL. SEE ONE-LINE DIAGRAM ON SHEET E301. MAINTAIN ALL NEC CLEARANCES.
11	VERIFY LOCATION OF TELEPHONE/DATA BOARD IN FIELD PRIOR TO START OF WORK. COORDINATE FINAL LOCATION WITH TENANT REPRESENTATIVE.
12	TIMECLOCK (TC). INSTALL ON WALL ADJACENT TO ELECTRICAL PANEL AND MOUNT NO HIGHER THAN 6'-7" A.F.F. SEE WIRING DETAIL ON SHEET E112.
13	PROVIDE J-BOX AND POWER FOR KEYPAD LOCK. COORDINATE LOCATION W/ MANUFACTURE'S RECOMMENDATIONS.
14	MOUNT GFI RECEPTACLE PER MANUFACTURER'S RECOMMENDATION/ TEMPLATE.
15	PROVIDE MOTOR RATED SWITCH FOR RECIRCULATION PUMP DISCONNECT. CONNECT TO CIRCUIT INDICATED USING 2#12, #12G, IN 3/4" CONDUIT AND PROVIDE FINAL CONNECTIONS AFTER PLUMBER INSTALLATION.
16	PROVIDE CONNECTION TO AUTOMATIC HAND DRYER AT 51-1/4" A.F.F. (HAND DRYER FURNISHED BY GC). SEE ARCH DETAILS FOR LOCATION.
17	ACRYLIC DISPLAY BOXES. E.C. TO ADD A PLUG TO THE POWER SIDE OF THE LIGHT DRIVER TO BE PLUGGED INTO THE QUADS FOR ACRYLIC BOXES AT THE LOGO WALL. SEE ARCHITECTURAL AND MILLWORK DRAWINGS FOR ADDITIONAL INFORMATION. EC TO MAKE FINAL CONNECTIONS BETWEEN ALL UL-LISTED ACRYLIC BOX EQUIPMENT AND ADJACENT WALL OUTLETS AS SHOWN ON PLANS.

WIRING SYMBOLS

- DUPLEX RJ45 JACK W/ 1 CAT5e WIRE
- 2 DUPLEX RJ45 JACK W/ 2 CAT5e WIRES
- OVERHEAD ACESS POINT CABLING
- (C) CONTROLLED RECEPTACLES (TIMECLOCK)

GENERAL NOTES

A. ELECTRICAL CONTRACTOR TO LABEL ALL RECEPTACLES AND PROVIDE A TYPE-WRITTEN PANEL SCHEDULE INSIDE THE ELECTRICAL PANEL.

B. ALL WORK SHALL COMPLY WITH THE CURRENTLY ADOPTED CODES, ORDINANCES, AND AMENDMENTS.

C. ALL EQUIPMENT SHALL BE LISTED BY A RECOGNIZED TESTING LAB (i.e. U.L., ETC.)

D. PROVIDE PLENUM RATED WIRING WHERE REQUIRED. COMPLY WITH NEC 300.22.

E. PROPERLY GROUND RECEPTACLES, BOXES AND COVER PLATES INSTALLED IN FIXTURES PER NEC 250 AND 406.

F. NO BX, AC OR ROMEX TYPE WIRING ALLOWED IN WALLS.

G. ALL LOW VOLTAGE WIRING TO BE IN CONDUIT UNLESS OTHERWISE APPROVED BY AUTHORITY HAVING JURISDICTION.

WHEN REQUIRED, IT IS THE OWNER'S RESPONSIBILITY TO CONTRACT WITH A COMMISSIONING AUTHORITY TO COMPLY WITH LOCAL CODES.

SARGENTI
5840 LEGACY CIR - STE D230, PLANO, TX 75024
T|201.316.5491 ■ WWW.SARGARCH.COM

GEMINI ENGINEERING GROUP
101 Nightlinger Lane
Millsap, TX 76066
(817) 672-7562

SEAL:

COLORADO LICENSED
CLAYTON LUCAS
63118
PROFESSIONAL ENGINEER
10/15/2026

CONTRACTOR'S NOTES:

WRITTEN DIMENSIONS HOLD PREFERENCE OVER SCALED DIMENSIONS. DO NOT SCALE THE DRAWINGS. THE CONTRACTORS MUST VISIT JOB SITE TO VERIFY ALL EXISTING CONDITIONS AND DIMENSIONS BEFORE SUBMITTING BIDS. REPORT ANY DISCREPANCIES OF ANY CONDITIONS WHICH MAY INTERFERE WITH THE PROPER EXECUTION OF, THE CONTRACT TO THE TENANT'S REPRESENTATIVE. REPORT DISCREPANCIES DURING BIDDING PROCESS AND BEFORE START OF CONSTRUCTION. CHANGE ORDERS NEED TO BE APPROVED BY THE CONSTRUCTION MANAGER FOR ISSUES ARISING FROM THE FIELD CONDITIONS OR CONFLICTS BETWEEN THE PLANS AND THE EXISTING CONDITIONS PRIOR TO THE COMMENCEMENT OF WORK.

	DATE	ISSUE
△	DATE	REVISION

LOCATION:

Consumer Cellular

8283 S. AKRON ST.
SUITE #110
CENTENNIAL, CO 80112

STORE NUMBER:

CO2

PROJECT INFORMATION:

DATE: 10/15/2026
PROJECT NUMBER: 15066 - 26
STORE TYPE: TIER 2
DRAWN BY: HO REVIEWED BY: CL

TITLE:

ELECTRICAL FLOOR PLAN

SHEET NUMBER:

E101

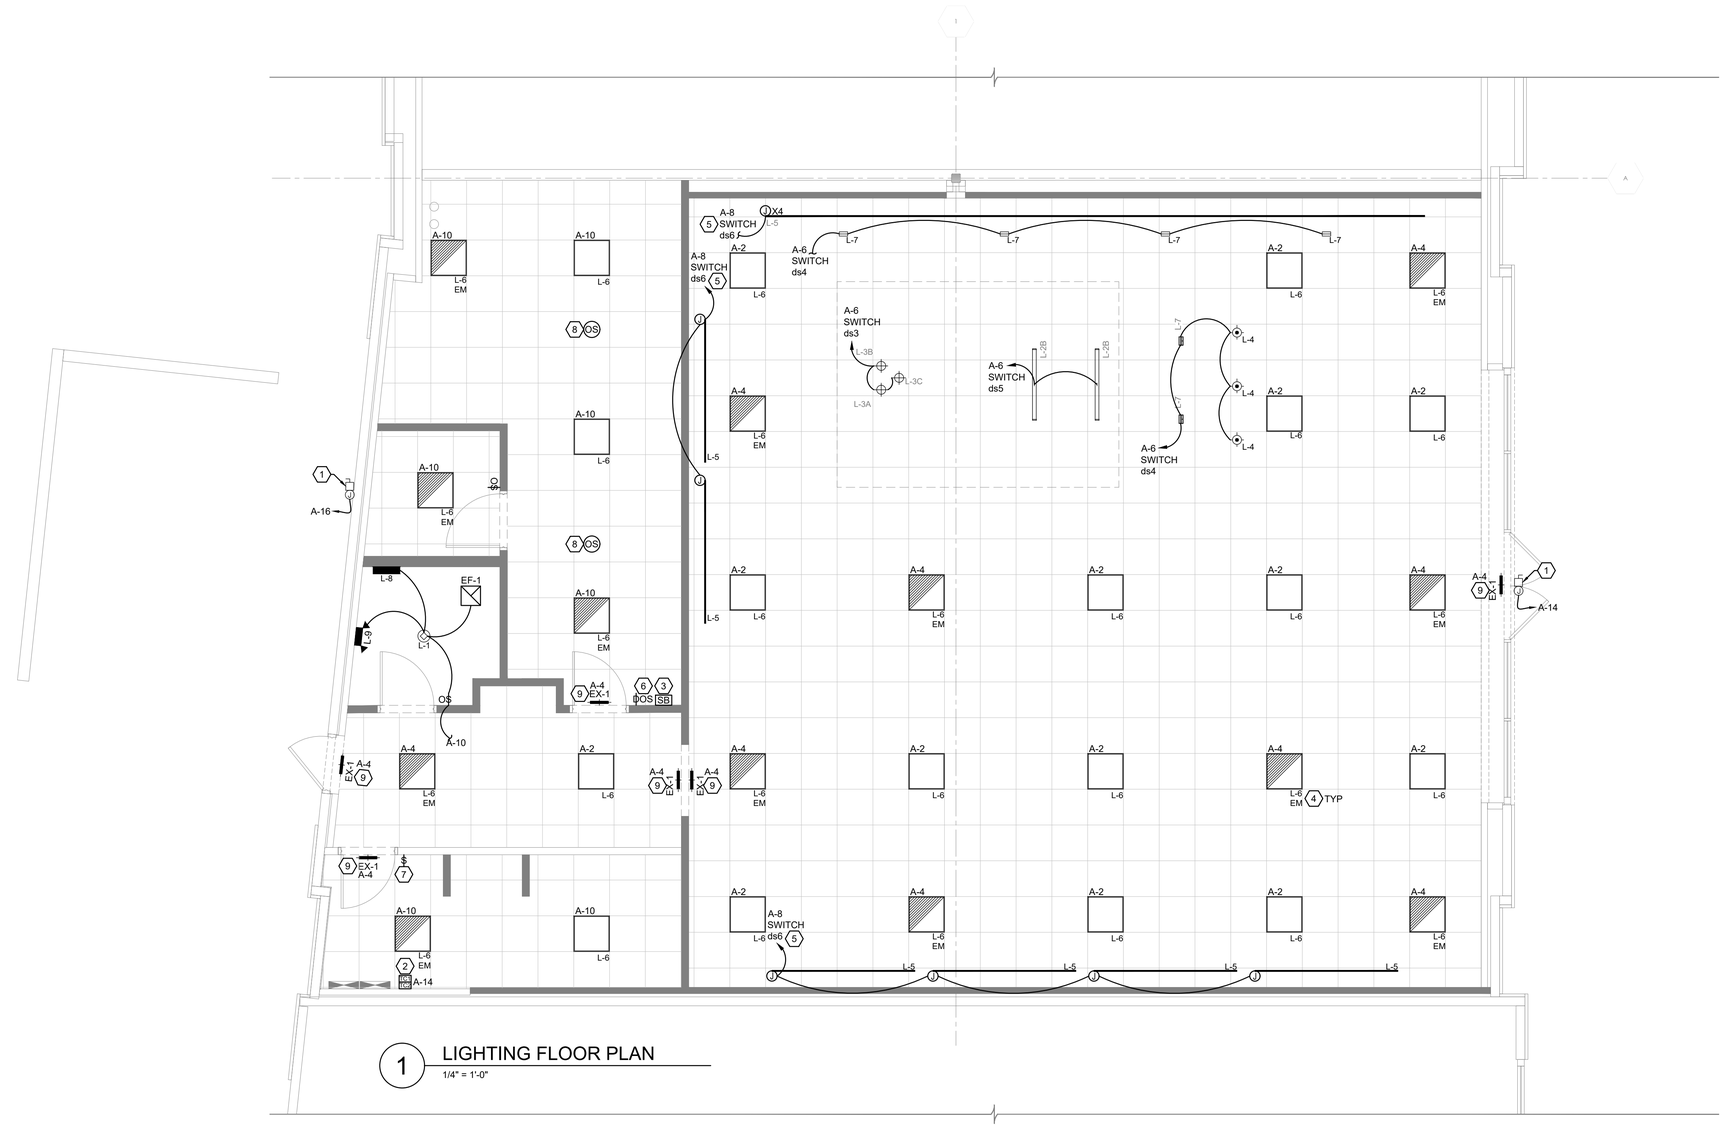

1 LIGHTING FLOOR PLAN

1/4" = 1'-0"

KEYED NOTES

##	NOTES
1	PROVIDE AND INSTALL JUNCTION BOX FOR EXTERIOR SIGNAGE. COORDINATE LOCATION WITH SIGN VENDER. PROVIDE POWER FROM TIMECLOCK (TC) TO JUNCTION BOX. JUNCTION BOX SHOULD BE NO FURTHER THAN 5 FEET FROM SIGNAGE. PROVIDE DISCONNECT AS REQUIRED.
2	TIMECLOCK (TC). INSTALL ON WALL ADJACENT TO ELECTRICAL PANEL AND MOUNT NO HIGHER THAN 6'-7" A.F.F. SEE WIRING DETAIL ON SHEET E112.
3	SWITCHBANK LOCATION. SEE DETAIL ON SHEET E112.
4	SALES FLOOR LIGHT FIXTURES LABELED EM (EMERGENCY EGRESS) ARE PROVIDED WITH A 90 MINUTE BATTERY BACK-UP.
5	PROVIDE J-BOX FOR LED TAPE LIGHT DRIVERS. COORDINATE DRIVER LOCATION WITH MILLWORK AND LIGHTING VENDORS. SEE SHEET E101.
6	WALL MOUNTED 0-10V DIMMER OCCUPANCY SENSOR. ADJUST AUTO ON LIGHT LEVEL TO AUTOMATICALLY TURN LIGHTS ON TO NO MORE THAN 50% PERCENT POWER PER SECTION C405.2.1.1.
7	PROVIDE LINE VOLTAGE WALL SWITCH TO OVERRIDE LIGHTING CONTROLS AT LIGHT FIXTURE ADJACENT TO THE ELECTRICAL EQUIPMENT PER NEC 110.26(D).
8	CEILING MOUNTED OCCUPANCY SENSOR. REQUIRED LOAD CONTROLLER. SEE CONTROL SCHEDULE ON E112.
9	ALL EXIT SIGNS ARE TO BE WIRED TO LOCAL CIRCUIT ON AN UNSWITCHED LEG AHEAD OF ANY LOCAL SWITCHING OR CONTROLS. EXIT SIGNS ARE PROVIDED WITH A 90 MINUTE BATTERY BACK-UP.

GENERAL NOTES

A. ALL EQUIPMENT SHALL BE LISTED BY A RECOGNIZED TESTING LAB (i.e. U.L., ETC.).

B. LUMINAIRES IN CONTACT WITH INSULATION SHALL BE U.L. LISTED FOR THERMAL BARRIER OR PROVIDED WITH 3" MINIMUM CLEARANCE.

C. CONTRACTOR TO ENSURE THAT ALL LIGHTING EXPOSED TO THE PLENUM IS PLENUM RATED.

D. ALL RECESSED LUMINAIRES IN SALES AREA SHALL BE CENTERED IN/ON CEILING TILE. PROVIDE ADDITIONAL SUPPORT PER MFG. RECOMMENDATIONS FROM STRUCTURE ABOVE FOR ALL LUMINAIRES ATTACHED TO HUNG CEILINGS.

E. SEE REFLECTED CEILING PLAN FOR ACTUAL LUMINAIRE LOCATIONS AND DIMENSIONS.

F. ALL EXIT SIGNS AND DUAL HEAD EMERGENCY LIGHTS TO HAVE 90 MIN. BATTERY BACKUP.

G. T.G.C. TO VERIFY EXIT DISCHARGE LIGHTING MEETS CODE. WHERE REQUIRED T.G.C. SHALL PROVIDE CODE COMPLIANT EXIT DISCHARGE LIGHTING IF NOT PRESENT.

WHEN REQUIRED, IT IS THE OWNER'S RESPONSIBILITY TO CONTRACT WITH A COMMISSIONING AUTHORITY TO COMPLY WITH LOCAL CODES.

SARGENTI
5840 LEGACY CIR - STE D230, PLANO, TX 75024
T|201.316.5491 ■ WWW.SARGARCH.COM

GEMINI ENGINEERING GROUP
101 Nightlinger Lane
Millsap, TX 76066
(817) 672-7562

SEAL:

COLORADO LICENSED
CLAYTON LUCAS
63118
PROFESSIONAL ENGINEER
10/15/2026

CONTRACTOR'S NOTES:

WRITTEN DIMENSIONS HOLD PREFERENCE OVER SCALED DIMENSIONS. DO NOT SCALE THE DRAWINGS. THE CONTRACTORS MUST VISIT JOB SITE TO VERIFY ALL EXISTING CONDITIONS AND DIMENSIONS BEFORE SUBMITTING BIDS. REPORT ANY DISCREPANCIES OF ANY CONDITIONS WHICH MAY INTERFERE WITH THE PROPER EXECUTION OF, THE CONTRACT TO THE TENANT'S REPRESENTATIVE. REPORT DISCREPANCIES DURING BIDDING PROCESS AND BEFORE START OF CONSTRUCTION. CHANGE ORDERS NEED TO BE APPROVED BY THE CONSTRUCTION MANAGER FOR ISSUES ARISING FROM THE FIELD CONDITIONS OR CONFLICTS BETWEEN THE PLANS AND THE EXISTING CONDITIONS PRIOR TO THE COMMENCEMENT OF WORK.

	DATE	ISSUE
△	DATE	REVISION

LOCATION:

Consumer Cellular

8283 S. AKRON ST.
SUITE #110
CENTENNIAL, CO 80112

STORE NUMBER:

CO2

PROJECT INFORMATION:

DATE: 10/15/2026
PROJECT NUMBER: 15066 - 26
STORE TYPE: TIER 2
DRAWN BY: HO REVIEWED BY: CL

TITLE:

LIGHTING FLOOR PLAN

SHEET NUMBER:

E111

TIMECLOCK DETAIL

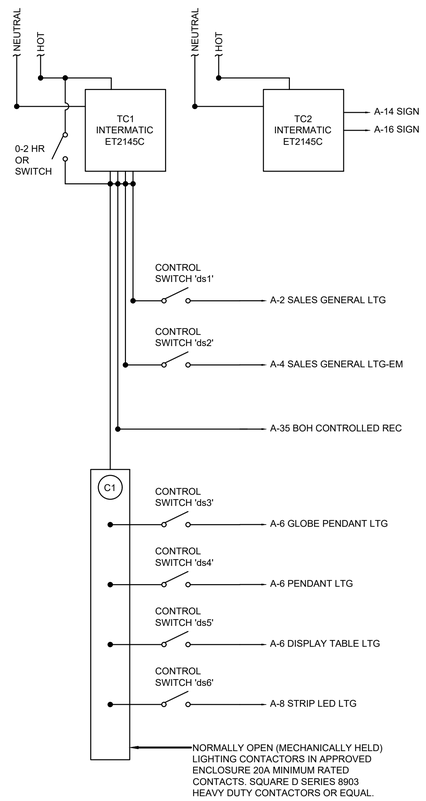

BOH LIGHTING CONTROL SCHEDULES

CALLOUT	SYMBOL	DESCRIPTION	MODEL	NOTES
ON/OFF SP	$	LUTRON DIVA SINGLE-POLE SWITCH	CA-1SP-WH	s7
RV DIMMER	$_{RV}	LUTRON DIVA SINGLE-POLE REVERSE-PHASE DIMMER	DVRP-253P-WH	ds3, ds4
0-10V DIMMER	$_{0-10V}	LUTRON DIVA SINGLE-POLE 0-10V DIMMER	DVSTV-WH	ds1, ds2, ds5, ds6 8 AMP 50 mA MAX SINK
OCCUPANCY SENSOR	O$	LUTRON MAESTRO OCCUPANCY SENSOR SWITCH	MS-A102-WH	TOILET ROOM
0-10V DIMMER SENSOR	$_{OS}	LUTRON MAESTRO RF 0-10V DIMMER OCCUPANCY SENSOR	MRF2S-8SD010 -WH	BOH 8 AMP 50 Ma MAX SINK
CEILING OCCUPANCY SENSOR	(OS)	LUTRON VIVE CEILING MOUNTED OCCUPANCY SENSOR	LRF2-OCR2B-P -WH	BOH REQUIRES LOAD CONTROLLER

SWITCHBANK DETAIL

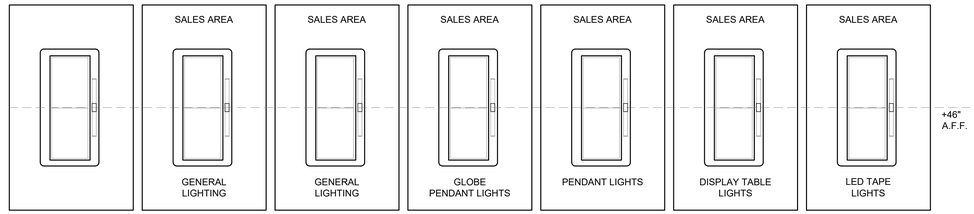

LED LUMINAIRE SCHEDULE

CALLOUT	SYMBOL	DESCRIPTION	MANUFACTURE	MODEL	LAMP	INPUT WATTS	BALLAST	VOLTS	MOUNTING	NOTES
L-1	◈	RECESSED DOWNLIGHT	LOTUS	LD4R-30K-HO-4R-WR-WT / LLL-LD2050TR / FRP4	LED 0-10V DIMMING	18W	ELECTRONIC	120/277V	RECESSED	
L-2B	▬	LINEAR PENDANT	WAC LIGHTING	PD-22754-AL	LED 0-10V DIMMING	24W	ELECTRONIC	120/277V	PENDANT	
L-3A	⊙	GLOBE PENDANT SMALL	DCW	HCS-250-ETL-WH-COP	LED 120V DIMMING	40W	ELECTRONIC	120V	PENDANT	OUTSIDE - WHITE INSIDE - COPPER
L-3B	⊙	GLOBE PENDANT MEDIUM	DCW	HCS-350-ETL-WH-COP	LED 120V DIMMING	60W	ELECTRONIC	120V	PENDANT	OUTSIDE - WHITE INSIDE - COPPER
L-3C	⊙	GLOBE PENDANT LARGE	DCW	HCS-450-ETL-WH-COP	LED 120V DIMMING	60W	ELECTRONIC	120V	PENDANT	OUTSIDE - WHITE INSIDE - COPPER
L-4	⊙	TEARDROP PENDANT	ET2 CONTEMPORARY LIGHTING	E23111-18	XENON 12V G4 ELV DIMMING	20W	ELECTRONIC	120V	PENDANT	
L-5	▭▭▭	LED TAPE LIGHT W/ DIMMABLE DRIVER	DIODE	D1-24V-BLBSC2-30 / DI-CPCHB-SL-LENGTH DRIVER: D1-ODX-24V96W-J	LED 0-10V DIMMING	2.93W/FT	ELECTRONIC	120/277V	SURFACE	
L-6	◪	LED 2x2	VALRIYA	VA-BPL-22-30-3000K	LED 0-10V DIMMING	30W	ELECTRONIC	120/277V	RECESSED	
L-6 EM	◪	LED 2x2	VALRIYA	VA-BPL-22-30-3000K EM DRIVER: VA-EDA-LI15-50	LED 0-10V DIMMING	30W	ELECTRONIC	120/277V	RECESSED	90 MIN. EMERGENCY BATTERY BACKUP
L-7	▭	RECESSED WALL WASHER	LUMENTURE	RWW160-30H-W-W	LED ELV DIMMING	14W	ELECTRONIC	120/277V	RECESSED	
L-8	▭	LED BATH	MAXIM LIGHTING	52000-1140 LUMENS-3000K	LED ELV DIMMING	12W	ELECTRONIC	120/277V	RECESSED	SATIN NICKEL (SN)
L-9	▬	EMERGENCY LIGHT	DUAL LITE	LZ-2-03L	LED	(2)3W	ELECTRONIC	120V	SURFACE	90 MIN. EMERGENCY BATTERY BACKUP
EX-1	▮	SURFACE MOUNT SINGLE FACE EDGELIT EXIT SIGN, CLEAR PANEL W/ GREEN LETTERS, WHITE FINISH.	EXITRONIX	S900C-SMG-WH-G	LED	2.5W	ELECTRONIC	120/277V	SURFACE	90 MIN. EMERGENCY BATTERY BACKUP

CONTRACTOR TO ENSURE THAT ALL LIGHTING EXPOSED TO THE PLENUM IS PLENUM RATED.

SARGENTI

5840 LEGACY CIR - STE D230, PLANO, TX 75024
T|201.316.5491 ■ WWW.SARGARCH.COM

GEMINI ENGINEERING GROUP
101 Nightlinger Lane
Millsap, TX 76066
(817) 672-7562

SEAL:

COLORADO LICENSED
CLAYTON LUCAS
63118
PROFESSIONAL ENGINEER
10/15/2026

CONTRACTOR'S NOTES:

WRITTEN DIMENSIONS HOLD PREFERENCE OVER SCALED DIMENSIONS. DO NOT SCALE THE DRAWINGS. THE CONTRACTORS MUST VISIT JOB SITE TO VERIFY ALL EXISTING CONDITIONS AND DIMENSIONS BEFORE SUBMITTING BIDS. REPORT ANY DISCREPANCIES OF ANY CONDITIONS WHICH MAY INTERFERE WITH THE PROPER EXECUTION OF, THE CONTRACT TO THE TENANT'S REPRESENTATIVE. REPORT DISCREPANCIES DURING BIDDING PROCESS AND BEFORE START OF CONSTRUCTION. CHANGE ORDERS NEED TO BE APPROVED BY THE CONSTRUCTION MANAGER FOR ISSUES ARISING FROM THE FIELD CONDITIONS OR CONFLICTS BETWEEN THE PLANS AND THE EXISTING CONDITIONS PRIOR TO THE COMMENCEMENT OF WORK.

	DATE	ISSUE
△	DATE	REVISION

LOCATION:

Consumer Cellular®

8283 S. AKRON ST.
SUITE #110
CENTENNIAL, CO 80112

STORE NUMBER:

CO2

PROJECT INFORMATION:

DATE: 10/15/2026
PROJECT NUMBER: 15066 - 26
STORE TYPE: TIER 2
DRAWN BY: HO REVIEWED BY: CL

TITLE:

LUMINAIRE SCHEDULES

SHEET NUMBER:

E112

PANEL B (EXISTING)

Service: 120/208 Volts 3 Phase 4 Wire Cabinets: Recessed
Mains: 225 Amp MLO Total Watts: 2,660 NEMA 1

REM	CKT			WIRE	BKR	A	B	C	BKR	WIRE			CKT	REM
	1	COFFEE REC	180	12	1/20	X			1/20	12	CASHWRAP REC	360	2	IG
	3	UNDER COUNTER REC	500	12	1/20		X		1/20	12	CASHWRAP REC	360	4	IG
	5	BACKWRAP OUTLET	540	12	1/20			X	1/20	12	CASHWRAP REC	360	6	IG
	7	SPARE			1/20	X			1/20	12	CASHWRAP REC	360	8	IG
	9	SPARE			1/20		X		1/20		SPARE		10	
	11	SPARE			1/20			X	1/20		SPARE		12	
	13	SPARE			1/20	X			1/20		SPARE		14	
	15	SPARE			1/20		X		1/20		SPARE		16	
	17	SPARE			1/20			X	1/20		SPARE		18	
	19	SPARE			1/20	X			1/20		SPARE		20	
	21	SPARE			1/20		X		1/20		SPARE		22	
	23	SPARE			1/20			X	1/20		SPARE		24	
	25	SPARE			1/20	X			1/20		SPARE		26	
	27	SPARE			1/20		X		1/20		SPARE		28	
	29	SPARE			1/20			X	1/20		SPARE		30	
	31	SPARE			1/20	X			1/20		SPARE		32	
	33	SPARE			1/20		X		1/20		SPARE		34	
	35	SPARE			1/20			X	1/20		SPARE		36	
	37	SPACE				X			1/20		SPARE		38	
	39	SPACE					X		1/20		SPARE		40	
	41	SPACE						X	1/20		SPARE		42	

TOTAL LOAD PHASE 'A' 900
TOTAL LOAD PHASE 'B' 860
TOTAL LOAD PHASE 'C' 900

TOTAL LOAD ALL PHASES 2660 WATTS
7.39 AMPS

REMARKS
(TC/C#) TIMECLOCK/LIGHTING CONTACTOR
(LO) LOCK-OFF DEVICE
(HR) HACR RATED CB
(IG) ISOLATED GROUND
(EX) EXISTING CIRCUIT
ALL BREAKERS TO BE 20A BOLT-ON UNLESS NOTED OTHERWISE

PANEL A (EXISTING)

Service: 120/208 Volts 3 Phase 4 Wire Cabinets: Recessed
Mains: 400 Amp MLO Total Watts: 49,470 NEMA 1

REM	CKT			WIRE	BKR	A	B	C	BKR	WIRE			CKT	REM
	1	LOGO WALL REC	540	12	1/20	X			1/20	12	LTG-SALES GENERAL	420	2	TC1
	3	LOGO WALL REC	900	12	1/20		X		1/20	12	LTG-SALES GENERAL-EM	270	4	TC1
	5	LOGO WALL REC	540	12	1/20			X	1/20	12	LTG-SALES DISPLAY	352	6	C1
	7	LOGO WALL REC	900	12	1/20	X			1/20	12	LTG-SALES DISPLAY	960	8	C1
	9	SHOW WINDOW REC	1200	12	1/20		X		1/20	12	LTG-BOH	258	10	
	11	FLOOR BOX REC	360	12	1/20			X	1/20		SPARE		12	
	13	RTU GFCI REC/DUCT DET	280	12	1/20	X			1/20	12	SIGN/TIMECLOCKS	1200	14	TC2
	15		4560				X		1/20	12	SIGN	1200	16	TC2
HR	17	EX RTU-1	4560	EX	3/60			X	1/20	12	IT RACK REC	720	18	
	19		4560			X			1/20	12	TELEPHONE BOARD REC	360	20	
	21	LOGO WALL REC	540	12	1/20		X		1/20	12	TELEPHONE BOARD REC	360	22	
	23	LOGO WALL REC	900	12	1/20			X	1/20	12	OFFICE REC	900	24	
	25		3720			X			1/20	12	MICROWAVE REC	1200	26	
HR	27	EX RTU-2	3720	EX	3/50		X		1/20	12	CNTR/REFRIGERATOR REC	680	28	
	29		3720					X	1/20	12	EWC/RESTROOM REC	360	30	
	31	SPARE			1/20	X			1/20		SPARE		32	
	33	GENERAL REC	1080	12	1/20		X		1/20	12	RECIRCULATION PUMP	100	34	
	35	BOH CONTROLLED REC	1440	12	1/20			X	2/30	10	WATER HEATER	1500	36	
	37	SPARE			1/20	X						1500	38	
	39	SPARE			1/20		X		1/20	12	HAND DRYER	950	40	LO
	41	SPARE			1/20			X	1/20		SPARE		42	
						X						900		
							X		3/200	EX	PANEL B	860		
								X				900		

TOTAL LOAD PHASE 'A' 16540
TOTAL LOAD PHASE 'B' 16678
TOTAL LOAD PHASE 'C' 16252

TOTAL LOAD ALL PHASES 49470 WATTS
137.42 AMPS

REMARKS
(TC/C#) TIMECLOCK/LIGHTING CONTACTOR
(LO) LOCK-OFF DEVICE
(HR) HACR RATED CB
(IG) ISOLATED GROUND
(EX) EXISTING CIRCUIT
ALL BREAKERS TO BE 20A BOLT-ON UNLESS NOTED OTHERWISE

ELECTRICAL LOAD SUMMARY

120/208 3PH - 4W

LOAD DESCRIPTION	CONNECTED LOAD (WATTS)	DEMAND FACTOR	DEMAND LOAD (WATTS)	DEMAND LOAD (AMPS)
LIGHTING	2260	1.25	2825	8
RECEPTACLES	16020	NOTE #1	13010	36
WATER HEATERS	3000	1.25	3750	10
SIGNAGE	2400	1.25	3000	8
MISC.	950	1.00	950	3
HVAC	24840	NOTE #2	31050	86
TOTAL	49470		54585	152

NOTES:
1. 100% OF FIRST 10,000 WATTS , PLUS 50% OF REMAINING LOAD.
2. 100% OF A/C LOAD, PLUS 25% OF HIGHEST LOAD.

1 PANEL SCHEDULES

NTS

DIAGRAM BASED ON INFORMATION AVAILABLE AT TIME OF DESIGN. FIELD VERIFY ALL EXISTING CONDITIONS PRIOR TO ROUGH-IN. CONTACT ENGINEER IF CONDITIONS ARE DIFFERENT THAN AS SHOWN PRIOR TO COMMENCING WORK

(E) - EXISTING
(N) - NEW

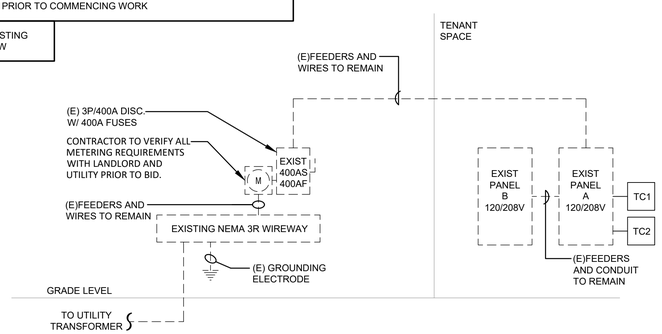

2 ONE LINE DIAGRAM

NTS

GENERAL NOTES

NOTE REGARDING EXAMINATION OF PREMISES/FIELD CONDITIONS:

DESIGN DRAWINGS ARE SCHEMATIC. ONCE ONSITE GENERAL CONTRACTOR IS TO INSPECT EXISTING FIELD CONDITIONS AND FAMILIARIZE THEMSELVES WITH ANY CONDITIONS THAT MAY AFFECT THEIR WORK IN ANY MANNER PRIOR TO START OF CONSTRUCTION.

IF THE GENERAL CONTRACTOR FINDS THAT THERE ARE DISCREPANCIES BETWEEN THE EXISTING CONDITIONS AND THE INFORMATION SHOWN ON THESE DRAWINGS, GC IS TO NOTIFY THE TENANT'S REPRESENTATIVE AND ARCHITECT OF THOSE DISCREPANCIES PRIOR TO COMMENCEMENT OF WORK.

RFI SHALL BE SUBMITTED FOR ALL LABOR AND MATERIALS NECESSARY FOR FIELD MODIFICATIONS DUE TO EXISTING CONDITIONS.

NOTE REGARDING ELECTRICAL DISTRIBUTION SYSTEM:

THE ELECTRICAL RISER DIAGRAM INDICATED HAS BEEN PROPERLY DESIGNED TO ACCOMMODATE TENANT'S POWER REQUIREMENTS AND MEETS ALL APPLICABLE BUILDING CODES. IT IS THE RESPONSIBILITY OF THE GC TO VERIFY ALL EXISTING CONDITIONS AND DETERMINE IF ANY EXISTING EQUIPMENT AND WIRING IS SUITABLE FOR REUSE IN THE SYSTEM PRIOR TO START OF CONSTRUCTION.

ELECTRICAL CONTRACTOR SHALL PERFORM ALL WORK NECESSARY TO RESULT IN A COMPLETE AND LEGAL INSTALLATION INCLUDING THE UPGRADING AND/OR MODIFICATION OF THE EXISTING SERVICE FEEDERS, CONDUITS AND TAP-INS EXTENDED TO PROPER POINT OF ORIGIN AS COORDINATED WITH THE LANDLORD.

1. GENERAL CONTRACTOR TO VERIFY ALL METERING REQUIREMENTS WITH LANDLORD AND UTILITY PRIOR TO START OF CONSTRUCTION.
2. CONTRACTOR TO VERIFY EXACT DISTANCE AND ROUTING OF SERVICE FEEDERS FROM LANDLORD DISTRIBUTION/SERVICE ENTRANCE EQUIPMENT TO TENANT SPACE.
3. PROVIDE COMPLIANCE WITH NEC 110.26 "SPACES ABOUT ELECTRICAL EQUIPMENT."
4. PROVIDE COMPLIANCE WITH NEC 408.4 "CIRCUIT DIRECTORY OR CIRCUIT IDENTIFICATION."
5. IT IS THE ELECTRICAL CONTRACTOR'S RESPONSIBILITY TO PROPERLY BALANCE ALL BRANCH CIRCUITS BETWEEN THE PHASES OF THE SYSTEM REGARDLESS OF THE CIRCUITING INDICATED.
6. "ALL LOW VOLTAGE WIRING TO BE IN CONDUIT UNLESS OTHERWISE APPROVED BY AUTHORITY HAVING JURISDICTION."
7. GENERAL CONTRACTOR SHALL VERIFY ANY THIRD PARTY INSPECTIONS REQUIRED BY THE LOCAL JURISDICTION PRIOR TO START OF CONSTRUCTION.

SARGENTI
5840 LEGACY CIR - STE D230, PLANO, TX 75024
T|201.316.5491 ■ WWW.SARGARCH.COM

GEMINI ENGINEERING GROUP
101 Nightlinger Lane
Millsap, TX 76066
(817) 672-7562

SEAL:

COLORADO LICENSED
CLAYTON LUCAS
63118
PROFESSIONAL ENGINEER
10/15/2026

CONTRACTOR'S NOTES:

WRITTEN DIMENSIONS HOLD PREFERENCE OVER SCALED DIMENSIONS. DO NOT SCALE THE DRAWINGS. THE CONTRACTORS MUST VISIT JOB SITE TO VERIFY ALL EXISTING CONDITIONS AND DIMENSIONS BEFORE SUBMITTING BIDS. REPORT ANY DISCREPANCIES OF ANY CONDITIONS WHICH MAY INTERFERE WITH THE PROPER EXECUTION OF, THE CONTRACT TO THE TENANT'S REPRESENTATIVE. REPORT DISCREPANCIES DURING BIDDING PROCESS AND BEFORE START OF CONSTRUCTION. CHANGE ORDERS NEED TO BE APPROVED BY THE CONSTRUCTION MANAGER FOR ISSUES ARISING FROM THE FIELD CONDITIONS OR CONFLICTS BETWEEN THE PLANS AND THE EXISTING CONDITIONS PRIOR TO THE COMMENCEMENT OF WORK.

	DATE	ISSUE
△	DATE	REVISION

LOCATION:

Consumer Cellular

8283 S. AKRON ST.
SUITE #110
CENTENNIAL, CO 80112

STORE NUMBER:

CO2

PROJECT INFORMATION:

DATE: 10/15/2026
PROJECT NUMBER: 15066 - 26
STORE TYPE: TIER 2
DRAWN BY: HO REVIEWED BY: CL

TITLE:

ELECTRICAL PANELS

SHEET NUMBER:

E301

COMcheck Software Version COMcheckWeb

Interior Lighting Compliance Certificate

Project Information

Energy Code: 2021 IECC
Project Title: CC Centennial, CO
Project Type: Alteration

Construction Site:
8283 S. Akron St., Suite 110
Centennial, Colorado 80112

Owner/Agent:

Designer/Contractor:
Clayton Lucas, P.E.
Gemini Engineering Group
101 Nightlinger Lane
Milsap, Texas 76066
817.672.7562

Allowed Interior Lighting Power

A Area Category	B Floor Area (ft2)	C Allowed Watts / ft2	D Allowed Watts
1-Break Room (Common Space Types:Lounge/Breakroom)	362	0.59	214
2-Office (Common Space Types:Office - Enclosed)	51	0.74	38
3-Electrical Room (Common Space Types:Electrical/Mechanical)	149	0.43	64
4-Restroom (Common Space Types:Restrooms)	60	0.63	38
5-Hallway (Common Space Types:Corridor/Transition <8 ft wide)	150	0.41	62
6-Sales (Retail:Sales Area)	1985	1.05	2084
Allowance: Vehicles, sporting goods, small electronics highlighting / Fix. ID: L-S	240 (a)	0.45	108 (b)
		Supplemental Allowed Watts (null) =	852
		Total Allowed Watts =	3459

(a) Area claimed may exceed total floor area when Retail Merchandise Highlighting allowance(s) are specified.
(b) Allowance is (B x C) or the actual wattage of the fixtures given in Proposed Power section, whichever is less.
(c) Supplemental watts must be associated with retail merchandise highlighting fixtures.

Proposed Interior Lighting Power

A Fixture ID : Description / Lamp / Wattage Per Lamp / Ballast	B Lamps/ Fixture	C # of Fixture	D Fixture Watt.	E (C X D)
Break Room (Common Space Types: Lounge/Breakroom, 362 sq.ft.)				
L-6: L-6: LED Panel: Other:	1	4	30	120
Office (Common Space Types: Office - Enclosed, 51 sq.ft.)				
L-6: L-6: LED Panel: Other:	1	1	30	30
Electrical Room (Common Space Types: Electrical/Mechanical, 149 sq.ft.)				
L-6: L-6: LED Panel: Other:	1	2	30	60
Restroom (Common Space Types: Restrooms, 60 sq.ft.)				
L-1: L-1: LED Downlight: Other:	1	1	11	11
L-8: L-8: LED Sconce: Other:	1	1	22	22
Hallway (Common Space Types: Corridor/Transition <8 ft wide, 150 sq.ft.)				
L-6: L-6: LED Panel: Other:	1	2	30	60

A Fixture ID : Description / Lamp / Wattage Per Lamp / Ballast	B Lamps/ Fixture	C # of Fixture	D Fixture Watt.	E (C X D)
Sales (Retail: Sales Area, 1985 sq.ft.)				
L-6: L-6: LED Panel: Other:	1	21	30	630
L-2: L-2: LED Pendant: Other:	1	2	24	48
L-3A: L-3A: LED Pendant: Other:	1	1	40	40
L-3B: L-3B: LED Pendant: Other:	1	1	40	40
L-3C: L-3C: LED Pendant: Other:	1	1	40	40
L-4: L-4: LED Pendant: Other:	1	3	40	120
L-5: L-5: LED Tape Driver: Other:	1	10	96	960
L-7: LED Wall Washer: Other:	1	6	14	84
			Total Proposed Watts =	2265

Interior Lighting PASSES

Interior Lighting Compliance Statement

Compliance Statement: The proposed interior lighting alteration project represented in this document is consistent with the building plans, specifications, and other calculations submitted with this permit application. The proposed interior lighting systems have been designed to meet the 2021 IECC requirements in COMcheck Version COMcheckWeb and to comply with any applicable mandatory requirements listed in the Inspection Checklist.

Clayton Lucas, PE — Name - Title
Signature
10/15/2026 — Date

COMcheck Software Version COMcheckWeb

Inspection Checklist

Energy Code: 2021 IECC

Requirements: 100.0% were addressed directly in the COMcheck software

Text in the "Comments/Assumptions" column is provided by the user in the COMcheck Requirements screen. For each requirement, the user certifies that a code requirement will be met and how that is documented, or that an exception is being claimed. Where compliance is itemized in a separate table, a reference to that table is provided.

Section # & Req.ID	Plan Review	Complies?	Comments/Assumptions
C103.2 [PR4][1]	Plans, specifications, and/or calculations provide all information with which compliance can be determined for the interior lighting and electrical systems and equipment and document where exceptions to the standard are claimed. Information provided should include interior lighting power calculations, wattage of bulbs and ballasts, transformers and control devices.	☐Complies ☐Does Not ☐Not Observable ☐Not Applicable	Requirement will be met. **Location on plans/spec:** E111, E112

Additional Comments/Assumptions:

1 High Impact (Tier 1) 2 Medium Impact (Tier 2) 3 Low Impact (Tier 3)

Section # & Req.ID	Rough-In Electrical Inspection	Complies?	Comments/Assumptions
C405.2.3.1 [EL22][1]	Spaces required to have light-reduction controls have a manual control that allows the occupant to reduce the connected lighting load in a reasonably uniform illumination pattern >= 50 percent.	☐Complies ☐Does Not ☐Not Observable ☐Not Applicable	Requirement will be met. **Location on plans/spec:** E111, E112
C405.2.1, C405.2.1.1 [EL18][1]	Occupancy sensors installed in classrooms/lecture/training rooms, conference/meeting/multipurpose rooms, copy/print rooms, lounges/breakrooms, enclosed offices, open plan office areas, restrooms, storage rooms, locker rooms, corridors, warehouse storage areas, and other spaces <= 300 sqft that are enclosed by floor-to-ceiling height partitions. Reference section language C405.2.1.2 for control function in warehouses and section C405.2.1.3 for open plan office spaces.	☐Complies ☐Does Not ☐Not Observable ☐Not Applicable	Requirement will be met. **Location on plans/spec:** E111, E112
C405.2.1.2 [EL19][1]	Occupancy sensors control function in warehouses: In warehouses, the lighting in aisleways and open areas is controlled with occupant sensors that automatically reduce lighting power by 50% or more within 20 minutes of when the areas are unoccupied. The occupant sensors control lighting in each aisleway independently and do not control lighting beyond the aisleway being controlled by the sensor. Lights not turned off by occupant sensors is done so by time-switch.	☐Complies ☐Does Not ☐Not Observable ☐Not Applicable	Requirement will be met. **Location on plans/spec:** E111, E112
C405.2.1.3 [EL20][1]	Occupant sensor control function in open plan office areas: Occupant sensor controls in open office spaces >= 300 sq.ft. have controls 1) configured so that general lighting can be controlled separately in control zones with floor areas <= 600 sq.ft. within the space, 2) general lighting in each zone permitted to turn on upon occupancy in control zone, 3) automatically turn off general lighting in all control zones within 20 minutes after all occupants have left the space, 4) are configured so that general lighting power in each control zone is reduced by >= 80% of the full zone general lighting power within 20 minutes of all occupants leaving that control zone.	☐Complies ☐Does Not ☐Not Observable ☐Not Applicable	Requirement will be met. **Location on plans/spec:** E111, E112
C405.2.2.1 [EL21][1]	Each area not served by occupancy sensors (per C405.2.1.1) have time-switch controls and functions detailed in sections C405.2.2.1.	☐Complies ☐Does Not ☐Not Observable ☐Not Applicable	Requirement will be met. **Location on plans/spec:** E111, E112

1 High Impact (Tier 1) 2 Medium Impact (Tier 2) 3 Low Impact (Tier 3)

Section # & Req.ID	Rough-In Electrical Inspection	Complies?	Comments/Assumptions
C405.2.4, C405.2.4.1, C405.2.4.2 [EL23][1]	Daylight zones provided with individual controls that control the lights independent of general area lighting. See code section C405.2.3 Daylight-responsive controls for applicable spaces, C405.2.3.1 Daylight responsive control function and section C405.2.3.2 Sidelit zone.	☐Complies ☐Does Not ☐Not Observable ☐Not Applicable	**Exception:** Sidelit zones on first floor in Group A-2 and M occupancies.
C405.2.5 [EL27][1]	Additional interior lighting power allowed for special functions per the approved lighting plans and is automatically controlled and separated from general lighting.	☐Complies ☐Does Not ☐Not Observable ☐Not Applicable	Requirement will be met. **Location on plans/spec:** E111, E112
C405.7 [EL26][1]	Low-voltage dry-type distribution electric transformers meet the minimum efficiency requirements of Table C405.6.	☐Complies ☐Does Not ☐Not Observable ☐Not Applicable	**Exception:** Requirement does not apply.
C405.8 [EL27][1]	Electric motors meet the minimum efficiency requirements of Tables C405.7(1) through C405.7(4). Efficiency verified through certification under an approved certification program or the equipment efficiency ratings shall be provided by motor manufacturer (where certification programs do not exist).	☐Complies ☐Does Not ☐Not Observable ☐Not Applicable	**Exception:** Requirement does not apply.
C405.9.1, C405.9.2 [EL28][1]	Escalators and moving walks comply with ASME A17.1/CSA B44 and have automatic controls configured to reduce speed to the minimum permitted speed in accordance with ASME A17.1/CSA B44 or applicable local code when not conveying passengers.	☐Complies ☐Does Not ☐Not Observable ☐Not Applicable	**Exception:** Requirement does not apply.
C405.10 [EL29][1]	Total voltage drop across the combination of feeders and branch circuits <= 5%.	☐Complies ☐Does Not ☐Not Observable ☐Not Applicable	Requirement will be met. **Location on plans/spec:** E301
C405.1.1 [EL30][1]	At least 90% of dwelling unit permanently installed lighting shall have lamp efficacy >= 65 lm/W or luminaires with efficacy >= 45 lm/W or comply with C405.2.4 or C405.3.	☐Complies ☐Does Not ☐Not Observable ☐Not Applicable	**Exception:** Requirement does not apply.
C405.11, C405.11.1 [EL31][1]	50% of 15/20 amp receptacles installed in enclosed offices, conference rooms, copy rooms, break rooms, classrooms and workstations and > 25% of branch circuit feeders for modular furniture will have automatic receptacle control in accordance with C405.11.1.	☐Complies ☐Does Not ☐Not Observable ☐Not Applicable	Requirement will be met. **Location on plans/spec:** E101, E112

Additional Comments/Assumptions:

1 High Impact (Tier 1) 2 Medium Impact (Tier 2) 3 Low Impact (Tier 3)

Section # & Req.ID	Final Inspection	Complies?	Comments/Assumptions
C303.3, C408.2.5.2 [FI17][1]	Furnished O&M instructions for systems and equipment to the building owner or designated representative.	☐Complies ☐Does Not ☐Not Observable ☐Not Applicable	Requirement will be met.
C408.1.1 [FI57][1]	Building operations and maintenance documents will be provided to the owner. Documents will cover manufacturers' information, specifications, programming procedures and means of illustrating to owner how building, equipment and systems are intended to be installed, maintained, and operated.	☐Complies ☐Does Not ☐Not Observable ☐Not Applicable	Requirement will be met.
C408.2.5 [FI16][1]	Furnished as-built drawings for electric power systems within 90 days of system acceptance.	☐Complies ☐Does Not ☐Not Observable ☐Not Applicable	Requirement will be met.
C408.3 [FI33][1]	Lighting systems have been tested to ensure proper calibration, adjustment, programming, and operation.	☐Complies ☐Does Not ☐Not Observable ☐Not Applicable	Requirement will be met. **Location on plans/spec:** E111, E112

Additional Comments/Assumptions:

1 High Impact (Tier 1) 2 Medium Impact (Tier 2) 3 Low Impact (Tier 3)

SARGENTI
5840 LEGACY CIR - STE D230, PLANO, TX 75024
T|201.316.5491 ■ WWW.SARGARCH.COM

GEMINI ENGINEERING GROUP
101 Nightlinger Lane
Millsap, TX 76066
(817) 672-7562

SEAL:

COLORADO LICENSED
CLAYTON LUCAS
63118
PROFESSIONAL ENGINEER
10/15/2026

CONTRACTOR'S NOTES:

WRITTEN DIMENSIONS HOLD PREFERENCE OVER SCALED DIMENSIONS. DO NOT SCALE THE DRAWINGS. THE CONTRACTORS MUST VISIT JOB SITE TO VERIFY ALL EXISTING CONDITIONS AND DIMENSIONS BEFORE SUBMITTING BIDS. REPORT ANY DISCREPANCIES OF ANY CONDITIONS WHICH MAY INTERFERE WITH THE PROPER EXECUTION OF, THE CONTRACT TO THE TENANT'S REPRESENTATIVE. REPORT DISCREPANCIES DURING BIDDING PROCESS AND BEFORE START OF CONSTRUCTION. CHANGE ORDERS NEED TO BE APPROVED BY THE CONSTRUCTION MANAGER FOR ISSUES ARISING FROM THE FIELD CONDITIONS OR CONFLICTS BETWEEN THE PLANS AND THE EXISTING CONDITIONS PRIOR TO THE COMMENCEMENT OF WORK.

	DATE	ISSUE
△	DATE	REVISION

LOCATION:

Consumer Cellular®
8283 S. AKRON ST.
SUITE #110
CENTENNIAL, CO 80112

STORE NUMBER:
CO2

PROJECT INFORMATION:
DATE: 10/15/2026
PROJECT NUMBER: 15066 - 26
STORE TYPE: TIER 2
DRAWN BY: HO REVIEWED BY: CL

TITLE:
ENERGY CALCULATIONS

SHEET NUMBER:
E601

ELECTRICAL SPECIFICATIONS DIVISION 1600

1.0 SCOPE

1.1 THE COMPLETE INSTALLATION SHALL BE MADE IN STRICT ACCORDANCE WITH THE LANDLORD'S REQUIREMENTS. CONSULT LANDLORD'S DESIGN CRITERIA.

1.2 THE DRAWINGS AND THE SPECIFICATIONS SHALL BE CONSIDERED ADDITIONAL TO ARCHITECT AND MECHANICAL ENGINEER'S SPECIFICATIONS. ANY DISCREPANCY OR CONTRADICTION SHALL BE BROUGHT TO THE ATTENTION OF THE ENGINEER.

1.3 ARCHITECT'S GENERAL REQUIREMENTS ARE PART OF THIS CONTRACT. AND THEY SHALL BE APPLIED BY THE GENERAL CONTRACTOR AND SUBCONTRACTORS (ELECTRICAL,ETC..).

1.4 ONCE ONSITE GENERAL CONTRACTOR SHALL FAMILIARIZE HIMSELF WITH ANY CONDITIONS THAT MAY AFFECT HIS WORK IN ANY MANNER PRIOR TO START OF CONSTRUCTION. (MEASUREMENTS - PARTICULAR CONDITIONS, ETC...) GENERAL CONTRACTOR SHALL NOTIFY TENANT REPRESENTATIVE AND ARCHITECT OF ANY SUCH CONDITIONS PRIOR TO COMMENCEMENT OF WORK.

1.5 GENERAL CONTRACTOR SHALL MAKE ALL NECESSARY CHECKING AND ADJUSTMENTS TO COMPLY WITH THE INTENT OF SPECIFICATIONS.

1.6 THE DRAWINGS SHOW THE APPROXIMATE LOCATION OF THE EQUIPMENT. EACH SUBCONTRACTOR SHALL VERIFY THESE LOCATIONS BEFORE INSTALLATION.

1.7 GENERAL CONTRACTOR'S TENDER SHALL INCLUDE THE COST OF ALL NECESSARY PERMITS AND CERTIFICATES, ALL DRAWINGS APPROVAL COSTS AND ALL INSPECTION COSTS REQUIRED BY ALL AUTHORITIES HAVING JURISDICTION.

1.8 EACH SUBCONTRACTOR SHALL COMPLETE THE WORK IN EVERY DETAIL. EVEN THOUGH NOT SHOWN ON DRAWINGS OR CALLED FOR IN THIS SPECIFICATION.

1.9 THE ELECTRICAL TRADE SHALL PROVIDE ALL LABOR AND MATERIALS NECESSARY FOR A COMPLETE AND OPERATING ELECTRICAL SYSTEM AS INDICATED ON THE DRAWINGS. THE TRADE SHALL ALSO PROVIDE ANY ITEMS AND/OR LABOR THAT ARE OBVIOUSLY NECESSARY OR REASONABLY IMPLIED TO COMPLETE ALL WORK.

1.10 ALL ELECTRICAL WORK TO BE DONE IN ACCORDANCE WITH CURRENT EDITIONS AND AMENDMENTS OF THE NATIONAL ELECTRICAL CODE (NEC), NFPA AND ALL LOCAL CODES ADOPTED BY THE LOCAL JURISDICTION HAVING AUTHORITY.

1.11 ALL RUBBISH'S AND GARBAGE SHALL BE REMOVED FROM THE JOB SITE AT THE END OF EVERY WORKDAY. AT THE CONTRACT COMPLETION, ALL TOOLS AND EQUIPMENT SHALL BE REMOVED AND THE JOB SITE SHALL BE LEFT IN A CLEAN CONDITION.

2.0 GUARANTEE

2.1 EACH SUBCONTRACTOR SHALL GUARANTEE HIS WORK AND INSTALLATION REGARDING HIS CONTRACT. THE ELECTRICAL CONTRACTOR SHALL REPAIR OR REPLACE, AT HIS OWN EXPENSE, ALL DEFECTS AND THIS DURING A TWELVE MONTHS PERIOD, STARTING AT THE PROVISIONAL ACCEPTANCE BY THE TENANT. AS LONG AS THE DEFECTS IS NOT DUE TO A BAD USE OR NORMAL WEAR.

3.0 TAXES

3.1 EACH SUBCONTRACTOR SHALL PAY ALL APPLICABLE TAXES, FOR LABOR AND MATERIAL INCLUDED IN HIS TENDER

4.0 TEMPORARY SERVICES

4.1 ALL TEMPORARY LIGHTING (MIN. 200LUX WITH MH HALIDE FIXTURE) AND POWER DURING CONSTRUCTION SHALL BE BY GENERAL CONTRACTOR AFTER AGREEMENT WITH ELECTRICAL CONTRACTOR AND SHALL BE TAKEN FROM EXISTING PANEL SERVING THE SPACE, SUPPLY VOLTAGE AND AMPS AS REQUIRED.

5.0 SHOP DRAWINGS

5.1 PRIOR TO ORDERING OR INSTALLING ANY EQUIPMENT SUBMIT TO ENGINEER FOR APPROVAL A MINIMUM OF TWO (2) COPIES OF SHOP DRAWINGS FOR EACH ITEM OF EQUIPMENT.

6.0 ALTERNATE EQUIPMENT

6.1 PROPOSAL SHALL BE BASED ON SPECIFIED EQUIPMENT AND MATERIAL.

6.2 PROPOSAL FOR ALTERNATE TO SPECIFICATION SHALL INCLUDE MANUFACTURER NAME, MODEL AND COST MODIFICATION.

6.3 COST OF ANY CHANGE REQUIRED TO OTHER TRADES WORK DUE TO SUBSTITUTION OF ALTERNATE EQUIPMENT, SHALL BE INCLUDED IN THE SUBCONTRACTOR'S PROPOSAL CALLING FOR THIS SUBSTITUTION. EVEN IF THESE CHANGES APPEAR AFTER THE DEMAND FOR SUBSTITUTION.

6.4 ALTERNATE PROPOSALS WILL BE ACCEPTED OR REJECTED BEFORE CONTRACTS ARE AWARDED. NO CHANGES WILL BE ALLOWED AFTER THE CONTRACT IS SIGNED.

7.0 IDENTIFICATION

7.1 ALL ELECTRICAL EQUIPMENT (SWITCHES, PANELS, CIRCUITS ETC..) MUST BE PROPERLY IDENTIFIED WITH LAMICOID NAME PLATES SCREWED ON PANELS AND HAVE A TYPED DIRECTORY AND INDICATE LOAD ON EACH CIRCUIT.

8.0 GROUND

8.1 THE GROUND SHALL BE CONTINUOUS AND SHALL BE CONFORM TO NATIONAL ELECTRICAL CODE.

9.0 PULLING AND JUNCTION BOXES

9.1 TRADE WILL PROVIDE PULLING AND JUNCTION BOXES WITH SCREWED PLATED COLOR MATCHED FOR WALL AND CEILING FINISHES.

9.2 ALL BOXES SHALL BE ACCESSIBLE.

9.3 BACK TO BACK BOXES WILL NOT BE ACCEPTED.

9.4 PULL BOXES SHALL BE LOCATED EVERY 100 FEET (30m) AND EVERY TWO 90 DEG. ELBOW.

9.5 ALL SURFACE MOUNTED BOXES FOR JUNCTION, SOCKETS, SWITCHES, FIXTURES ETC...,SHALL BE F.S. TYPE.

10.0 DRILLING

10.1 ELECTRICAL CONTRACTOR SHALL DRILL OR CHIP THE FLOOR WHERE REQUIRED. ELECTRICAL CONTRACTOR SHALL PROVIDE AND INSTALL SLEEVES IN CONCRETE SLAB, WHERE REQUIRED.

10.2 NO ELECTRICAL OR PNEUMATIC HAMMER SHOULD BE USED.

10.3 EXISTING CONCRETE COLUMNS ARE NOT TO BE CHANNELED OR NOTCHED.

11.0 WIRING AND CONDUIT

11.1 ALL WIRING, WILL BE COPPER TYPE, No.12 AWG MINIMUM, UNLESS OTHERWISE NOTED.

11.2 ALL SURFACE WIRING, SHALL BE THWN TYPE IN E.M.T. CONDUIT. ALL COUPLINGS TO BE RAIN TIGHT OR GALVANIZED SET CREW TYPE.

11.3 ALL WIRING AND CONDUIT, WILL BE RECESSED IN WALL OR CEILING (INCLUDING EXISTING ARCHITECTURAL ELEMENTS) UNLESS APPROVED BY LOCAL INSPECTOR AND JHA. ELECTRICAL CONTRACTOR TO VERIFY.

11.4 ALL WIRING SHALL BE PARALLEL WITH ARCHITECTURAL LINES AND DESIGN.

11.5 FOR SUSPENDED CEILING, MC CABLE FOR 15 FEET (4.5m) IS ACCEPTED. MAIN WIRING TO BE THWN IN E.M.T. CONDUIT.

11.6 ALL EMPTY CONDUIT SHALL INCLUDE A PULLING WIRE No.12 AWG. - MAX. 6'-0" FLEXIBLE CONDUIT MAY BE USED FOR FIXTURE AND EQUIPMENT CONNECTIONS ONLY. PLASTIC CONDUIT IS NOT ACCEPTED.

12.0 FIRE BARRIER

12.1 IN CASE OF CROSSING A FIRE BARRIER (FLOOR, WALL, OR CEILING) FILL GAP WITH APPROPRIATE MATERIAL. THIS MATERIAL SHALL BE EFFICIENT BARRIER FOR FLAME, FUME AND GAS. SEAL AT SMOKE WALL.

13.0 EXPANSION JOINT

13.1 EACH TIME ELECTRICAL CONDUIT PASS THROUGH AN EXPANSION JOINT OF THE BUILDING USE GALVANIZED STEEL SLIDING TYPE EXPANSION JOINT WITH CONTINUOUS COPPER GROUNDING. FLEXIBLE AT THESE LOCATIONS.

14.0 FIXTURES AND LAMPS

14.1 COMPLETE LIGHTING PACKAGE IS OWNER (OR LANDLORD) FURNISHED (REFER TO LEASE AGREEMENT), GC INSTALLED. ELECTRICAL CONTRACTOR SHALL INSTALL ALL FIXTURES, LAMPS AND CONTROLS PER MANUFACTURER SPECS AND EDSS (ENERGY DESIGN SERVICE SYSTEMS) INSTALLATION INSTRUCTIONS.

15.0 FIELD CONDITIONS

15.1 ENGINEER CAN RELOCATE ALL EQUIPMENT (FIXTURES, OUTLETS, ETC...), AT NO COST, IF DISPLACEMENT IS LESS THAN 10 FEET (3m), AND WRITTEN NOTICE IS SENT TO CONTRACTOR PRIOR TO INSTALLATION.

15.2 CONFER WITH ALL OTHER TRADES AND ARRANGE EQUIPMENT IN PROPER RELATION WITH OTHER APPARATUS, DUCTS, PIPES, ETC. AND WITH BUILDING CONSTRUCTION AND ARCHITECTURAL FINISHES.

16.0 EXISTING CONDITIONS

16.1 ELECTRICAL CONTRACTOR WORK AFFECTING OTHER TENANT SHALL BE DONE OFF BUSINESS HOURS (NIGHT OR WEEKEND). COORDINATE WITH THE LANDLORD.

16.2 ELECTRICAL CONTRACTOR SHALL REMOVE AND DISPOSE ANY UNUSED MATERIAL.

16.3 ANY NON REUSED MATERIAL SHALL BE GIVEN BACK IN GOOD CONDITION TO LANDLORD

16.4 ANY DAMAGED WALL, FLOOR, CEILING, FINISHES SHALL BE REPAIRED BY GENERAL CONTRACTOR THOSE REPAIRS SHALL MATCH EXISTING FINISHES.

17.0 COMMUNICATIONS

17.1 TENANT IS IN CHARGE FOR ANY COMMUNICATIONS SYSTEMS.

17.2 ELECTRICAL CONTRACTOR SHALL PROVIDE AND INSTALL, IF REQUIRED, TELEPHONE TERMINAL BOARD, 24"x24" PLYWOOD 3/4" THICK, AND CONDUIT AS INDICATED ON DRAWINGS.

17.3 ALL WIRING, INCLUDING INSTALLATION AND CONNECTION TO EQUIPMENT SHALL BE PERFORMED BY A SPECIALIZED CONTRACTOR, IN CHARGE OF THE TENANT.

18.0 FIRE ALARMS

18.1 NEW FIRE ALARM PANEL TO BE INSTALLED. VERIFY ALL REQUIREMENTS WITH LANDLORD.

18.2 ALL REQUIRED WORK RELATED TO LIFE SAFETY SYSTEMS SHALL BE DONE AT NO EXTRA COST. RETAIN THE SYSTEM MANUFACTURER'S FORCES TO PERFORM FINAL CONNECTIONS, MODIFICATIONS AND PROVISION OF NEW INTERFACING DEVICES IN THE SYSTEM PANELS, ETC.

18.3 ENSURE FULL COMPATIBILITY OF ALL NEW DEVICES WITH EXISTING LIFE SAFETY SYSTEMS.

18.4 TENANT'S FIRE ALARM CONTRACTOR SHALL HAVE SYSTEM MANUFACTURER TEST AND CERTIFY LIFE SAFETY SYSTEMS FOR PROPER OPERATION AT COMPLETION OF WORK.

19.0 COLOR CODE

	120/208V	120/240V HIGH LEG 3P 4W	277/480V
PHASE A	BLACK	BLACK	BROWN
PHASE B	RED	ORANGE	ORANGE
PHASE C	BLUE	BLUE	YELLOW
NEUTRAL	WHITE	WHITE	GREY
GROUND	GREEN	GREEN	GREEN

20.0 SPECIAL NOTES

20.1 ELECTRICAL CONTRACTOR TO PROVIDE UNDERGROUND CONDUIT TO EC PROVIDED SURFACE MOUNTED J-BOXES, RECESSED FLOOR BOXES AND POKE-THRU BOXES AS INDICATED AND PROVIDE APPROVED FLEX CONNECTION ASSEMBLY. LEAVE FLEX CONNECTION ASSEMBLY COILED AND TAPED AS REQ'D UNTIL FIXTURE INSTALLATION. AFTER FIXTURE INSTALLATION EC TO INSTALL POWER RECEPTACLES IN BLANK BOXES INSIDE FIXTURE, PROVIDE POWER CIRCUIT FROM PANEL TO RECEPTACLES AND CONNECTION POWER SOURCE. EC TO PROVIDE PULL STRING FROM TELEPHONE BOARD TO ALL FIXTURE DESIGNATIONS FOR CAT5E DATA CABLING AND RJ45 JACKS.

20.2 ON ALL OUTLETS LOCATED IN POS COUNTERS, ETC..., ELECTRICAL TRADE SHALL ATTACH ALL CONDUITS TO THE FLOOR WITH APPROPRIATE CONNECTORS. GC MUST OBTAIN WRITTEN APPROVAL FROM THE LANDLORD PRIOR TO ANY TRENCHING OR CORE DRILLING.

20.3 RECEPTACLES, OUTLETS, ETC..., LOCATED AT THE CASH COUNTERS SHALL BE INSTALLED IN COMMON BOXES. USE 1 GANG, 2 GANG, 3 GANG OR 4 GANG, ETC..., BOXES C/W SEPARATIONS AS PER CODE, AS REQUIRED. BOXES SUPPLIED, INSTALLED AND CONNECTED BY THE ELECTRICAL CONTRACTOR.

21.0 DEMOLITION

21.1 REMOVE AND TRANSPORT OUT OF THE CONSTRUCTION SITE ALL EQUIPMENT MADE OBSOLETE CONSECUTIVE TO THE WORK, INCLUDING WIRING, CONDUITS, BOXES, OUTLETS, SWITCHES, LIGHTING FIXTURES, DISTRIBUTION EQUIPMENT, SUPERVISORY AND COMMUNICATION EQUIPMENT. ALL ACCESSORIES BEING PART OF THE ELECTRICAL INSTALLATION.

21.2 REMOVE THE WIRING AND THE CONDUIT UP TO THE LAST PANEL OR BOX KEPT IN THE NETWORK.

21.3 PUT BACK IN SERVICE ALL FEEDERS, CONTROL OR COMMUNICATION CABLES WHEN THE CONTINUITY OF THOSE SERVICES IS INTERRUPTED BY THE WORK.

22.0 SPECIFICATIONS

22.1 DISCONNECT AS PER CUTLER-HAMMER

MODEL	FUSE	INSTALLATION
HD	WITH	INTERIOR
HD	WITHOUT	INTERIOR
RD	WITH	EXTERIOR
RD	WITHOUT	EXTERIOR

22.2 FUSES AS PER GOULD

GAGE	MODEL	SPARE QTY.
0-600A	AJT	10% (MINIMUM 6)

22.3 SPLITTER BOXES AND TROUGHS, AS PER BEL, 14 GA STEEL WITH HINGED COVER CLOSED WITH SCREWS, TINNED COPPER BUS BARS, COMPLETE WITH SOLDERLESS TERMINALS. BARS SUPPORTED BY ISOLATORS.

22.4 TRANSFORMERS AS PER DELTA, DT (TRIPLE PHASE).

22.5 PANELS C/W DOORS AND LOCKS, AS PER CUTLER-HAMMER

USAGE	VOLTAGE	MODEL
LIGHTING	120/208V 3PH	PRL-1
BREAKERS WITH 10,000 A SYMMETRICAL INTERRUPTING CAPACITY, UNLESS OTHERWISE NOTED.		

22.6 OUTLETS AS PER LEVITON, MODEL NO. 5262, WHITE.

22.7 SWITCH

TYPE	MODEL
UNIPOLAR	5401/001
BIPOLAR	54502/001
THREE WAY	54503/001
FOUR WAY	54504/001

SYMBOLS LEGEND

NOTE: NOT ALL SYMBOLS LISTED BELOW ARE SHOWN ON PLANS

SWITCHING

TC	TC - TIME CLOCK
SB	SWITCH BANK
S	SWITCH
$_D$	DIMMER SWITCH
OC	OCCUPANCY SENSOR - CEILING MOUNTED
O$	OCCUPANCY SENSOR - WALL MOUNTED

TAGS

AA / BB	DETAIL DESIGNATION: AA - DETAIL NUMBER BB - SHEET NUMBER
X	SHEET NOTE
AA / BB	SECTION DESIGNATION: AA - DETAIL NUMBER BB - SHEET NUMBER

POWER DISTRIBUTION DEVICES

	PANELBOARD SURFACE MOUNTED MAXIMUM 72" TO TOP OF OVERCURRENT PROTECTION
T	TRANSFORMER
	DISCONNECT SWITCH
M	METER
	DUPLEX RECEPTACLE - 20A 18" AFF UNO
	QUADPLEX RECEPTACLE - 20A 18" AFF UNO
GFI	RECEPTACLE WITH GROUND FAULT INTERRUPTER
WP	WEATHERPROOF RECEPTACLE 18" AFF UNO
	SHOW WINDOW RECEPTACLE
J	JUNCTION BOX

DATA / COMMUNICATION

	TELEPHONE / DATA
T	THERMOSTAT
S	ZONE TEMPERATURE SENSOR
DD	DUCT SMOKE DETECTOR

GENERAL WIRING

	HOMERUN - CONDUIT SYSTEM TO PANEL AS NOTED ON DRAWINGS
— —	CONDUIT SYSTEM UNDER FLOOR
— —	CONDUIT UP
	TELEPHONE TERMINAL BOARD SEE DETAIL ON SHEET E101
	JUNCTION BOX

ABBREVIATIONS

BOH	BACK OF HOUSE
CB	CIRCUIT BREAKER
DL	DAYLIGHT
EC	ELECTRICAL CONTRACTOR
EM	EMERGENCY
GC	GENERAL CONTRACTOR
IG	ISOLATED GROUND
JB	JUNCTION BOX (J-BOX)
JHA	JURISDICTION HAVING AUTHORITY
LL	LANDLORD
MLO	MAIN LUG ONLY
MCB	MAIN CIRCUIT BREAKER
OR	ORANGE
SW	SHOW WINDOW
TGC	TENANT GENERAL CONTRACTOR
WH	WHITE

GENERAL ELECTRICAL NOTES

A. FIELD VERIFY ALL CONDITIONS.

B. DESIGN DRAWINGS ARE SCHEMATIC. ONCE ONSITE GENERAL CONTRACTOR IS TO INSPECT EXISTING FIELD CONDITIONS. RFI SHALL BE SUBMITTED FOR ALL LABOR AND MATERIALS NECESSARY FOR FIELD MODIFICATIONS DUE TO EXISTING CONDITIONS.

C. THE CONTRACTOR SHALL CONTACT THE ARCHITECT, ENGINEER OR OWNER ONCE ONSITE FOR INTERPRETATIONS AND CLARIFICATIONS OF THE DESIGN INTENT PRIOR TO COMMENCEMENT OF WORK.

D. BIDDING CONTRACTORS SHALL HAVE A WORKING KNOWLEDGE OF LOCAL CODES AND ORDINANCES AND SHALL INCLUDE IN THEIR BIDS THE COSTS FOR ALL WORK INSTALLED IN STRICT ACCORDANCE WITH GOVERNING CODES, THE PLANS AND SPECIFICATIONS NOT WITHSTANDING. THE CONTRACTOR SHALL ALERT ARCHITECT, ENGINEER OR OWNER OF ANY APPARENT DISCREPANCIES BETWEEN GOVERNING CODES AND DESIGN INTENT.

E. RFI SHALL BE SUBMITTED FOR ANY UNFORESEEN CONDITIONS THAT MAY EFFECT THE CONTRACTOR'S SCOPE OF WORK. MINOR VARIATIONS REQUIRED FOR ACCOMPLISHING THE INTENT OF THIS DESIGN SHALL BE INCLUDED IN THE RFI.

F. PROVIDE ALL REQUIRED PERMITS. CONTRACTOR'S INSTALLATION SHALL CONFORM TO ALL LOCAL CODE REQUIREMENTS.

G. VERIFY EXACT PLACEMENT OF ALL DEVICES SHOWN ON THE DOCUMENTS WITH ARCHITECTURAL, MECHANICAL AND PLUMBING DRAWINGS PRIOR TO FINAL PLACEMENT.

H. BECOME FAMILIAR WITH REQUIRED DEMOLITION WORK PRIOR TO BIDDING AND START OF WORK. CONTRACTOR SHALL BE RESPONSIBLE TO PROVIDE ALL DEMOLITION AS REQUIRED FOR INSTALLATION OF NEW WORK.

I. COORDINATE INSTALLATION OF ELECTRICAL WORK ABOVE THE CEILING TO PROVIDE THE GREATEST POSSIBLE CLEARANCE FOR INSTALLATION OF PLUMBING AND MECHANICAL. CONDUIT RUNS SHALL BE RUN THROUGH TRUSSES WHERE POSSIBLE.

J. COORDINATE EXACT LOCATION OF DEVICES SERVING CASEWORK WITH FIXTURE CONTRACTOR.

K. COORDINATE ALL LOW VOLTAGE CONDUIT AND ROUGH-IN REQUIREMENTS WITH LOW VOLTAGE CONTRACTORS.

L. SWITCHBOARDS, PANELBOARDS, DISCONNECT SWITCHES, TRANSFORMERS AND CONTACTORS SHALL BE "LISTED" AND "IDENTIFIED" AS RATED FOR A MINIMUM OF 75°C CONDUCTOR TERMINATION.

M. INCLUDE A COPPER EQUIPMENT GROUND CONDUCTOR IN ALL RACEWAYS. SIZE RACEWAYS AS NECESSARY TO COMPLY WITH NEC.

N. ALL EMPTY CONDUITS SHALL BE PROVIDED WITH A PULL WIRE.

O. ALL 20A BRANCH CIRCUITS BETWEEN 100' AND 150' IN LENGTH, #10 AWG COPPER WIRE SHALL BE USED. FOR ALL 20A BRANCH CIRCUITS OVER 150' IN LENGTH, #8 AWG COPPER WIRE SHALL BE USED.

P. ALL 20A BRANCH CIRCUITS LESS THAN 100' IN LENGTH, SHALL BE #12 COPPER CONDUCTORS, #12 GND., 3/4" UNLESS NOTED OTHERWISE. TYPE MC CABLE MAY BE USED FOR BRANCH CIRCUITS ABOVE CEILINGS AND FOR FINAL FIXTURE CONNECTIONS. DO NOT USE TYPE MC EXPOSED UNLESS APPROVED BY LOCAL INSPECTOR AND JHA. ELECTRICAL CONTRACTOR TO VERIFY.

Q. CIRCUITING INDICATED ON PLAN IS DIAGRAMMATIC FOR CLARITY. CIRCUITING SHALL BE "THRU-WIRING" WHERE/WHEN POSSIBLE. MULTI-CONNECTIONS TO A SINGLE LIGHT FIXTURE FOR FIELD CONDITIONS OR VOLTAGE DROP FACTORS MAY BE REQUIRED (FIXTURES SHALL BE MANUFACTURED TO ACCOMMODATE "THRU-WIRING"), AND RELATED COSTS SHALL BE INCLUDED IN BID.

R. MAKE ALL FINAL ELECTRICAL CONNECTIONS AS REQUIRED FOR A COMPLETE AND OPERATING SYSTEM.

S. WHERE DRYWALL CEILINGS ARE USED, CONTRACTOR SHALL ARRANGE CIRCUITING SO THAT JUNCTION/BOXES ACCESS PANELS ARE NOT INSTALLED IN THESE DRYWALL CEILING AREAS. (THE USE OF JUNCTION BOXES IN THESE DRYWALL CEILINGS IS NOT PERMITTED, ARRANGE CIRCUITS TO AVOID THIS SITUATION). FIELD COORDINATE WITH TENANT'S CONSTRUCTION MANAGER PRIOR TO ROUGH-IN TO AVOID CONFLICTS. JUNCTION BOXES MAY BE PLACED ABOVE LAY-IN CEILINGS.

T. FIELD VERIFY EXACT LOCATION AND ELECTRICAL REQUIREMENTS OF ALL HVAC EQUIPMENT WITH MECHANICAL CONTRACTOR, PRIOR TO ORDERING RELATED ELECTRICAL EQUIPMENT.

U. PLACEMENT OF ALL RECEPTACLES SHALL BE INTENTIONAL (I.E. CENTERED ON COLUMNS OR WALL FEATURES, OR TIGHT TO CORNER). IF RECEPTACLE IS NOT SHOWN IN A DESIRABLE LOCATION, FIELD VERIFY EXACT PLACEMENT OF RECEPTACLE WITH TENANT'S CONSTRUCTION MANAGER PRIOR TO ROUGH-IN.

V. PROVIDE ALL NECESSARY COMPONENTS TO MAKE A COMPLETE WORKING SYSTEM. VERIFY ROW LENGTHS, FEED POINT AND MOUNTING REQUIREMENTS PRIOR TO ORDERING.

W. TAKE ADEQUATE CARE TO CORRECTLY LOCATE ALL ELECTRICAL STUB OUTS, FLOOR BOXES, J-BOXES, TRACK, ETC. PRECISE LOCATIONS OF FLOOR OUTLETS AND J-BOXES IS VERY IMPORTANT.

X. NO PIPING, DUCTS OR EQUIPMENT FOREIGN TO ELECTRICAL EQUIPMENT SHALL BE PERMITTED TO BE LOCATED WITHIN THE DEDICATED SPACE ABOVE THE ELECTRICAL EQUIPMENT. NEC 110.34(f).

Y. FUSES SHALL BE PROVIDED WITH REJECTION TYPE FUSE HOLDERS. NEC 240.60B.

Z. PROVIDE LOCK-ON DEVICE FOR CIRCUITS SUPPLYING EMERGENCY UNIT EQUIPMENT. NEC 700.18.

AA. ATTAIN EXISTING BUILDING LOAD INFORMATION AND VERIFY AMPACITY AND DEMAND FOR BUILDING TO ENSURE THAT ALL LOADS (EXISTING AND NEW) DO NOT EXCEED THE AMPACITY OF THE SERVICE FEEDER(S) OR RATING OF THE SERVICE, PER NEC 220.40.

AB. ALL DEDICATED RECEPTACLES SHALL BE RATED TO NOT LESS THAN THE RATING OF THE BRANCH CIRCUIT SERVING THE RECEPTACLE.

AC. SUPPORT VERTICAL CABLE RUNS PER NEC 300.19.

AD. ELECTRICAL CONTRACTOR TO LABEL ALL RECEPTACLES AND PROVIDE A TYPE-WRITTEN PANEL SCHEDULE INSIDE THE ELECTRICAL PANEL.

SARGENTI

5840 LEGACY CIR - STE D230, PLANO, TX 75024
T|201.316.5491 ■ WWW.SARGARCH.COM

GEMINI ENGINEERING GROUP
101 Nightlinger Lane
Millsap, TX 76066
(817) 672-7562

SEAL:

COLORADO LICENSED
CLAYTON LUCAS
63118
PROFESSIONAL ENGINEER
10/15/2026

CONTRACTOR'S NOTES:

WRITTEN DIMENSIONS HOLD PREFERENCE OVER SCALED DIMENSIONS. DO NOT SCALE THE DRAWINGS. THE CONTRACTORS MUST VISIT JOB SITE TO VERIFY ALL EXISTING CONDITIONS AND DIMENSIONS BEFORE SUBMITTING BIDS. REPORT ANY DISCREPANCIES OF ANY CONDITIONS WHICH MAY INTERFERE WITH THE PROPER EXECUTION OF, THE CONTRACT TO THE TENANT'S REPRESENTATIVE. REPORT DISCREPANCIES DURING BIDDING PROCESS AND BEFORE START OF CONSTRUCTION. CHANGE ORDERS NEED TO BE APPROVED BY THE CONSTRUCTION MANAGER FOR ISSUES ARISING FROM THE FIELD CONDITIONS OR CONFLICTS BETWEEN THE PLANS AND THE EXISTING CONDITIONS PRIOR TO THE COMMENCEMENT OF WORK.

	DATE	ISSUE

△	DATE	REVISION

LOCATION:

Consumer Cellular

8283 S. AKRON ST.
SUITE #110
CENTENNIAL, CO 80112

STORE NUMBER:

CO2

PROJECT INFORMATION:

DATE: 10/15/2026
PROJECT NUMBER: 15066 - 26
STORE TYPE: TIER 2
DRAWN BY: HO REVIEWED BY: CL

TITLE:

ELECTRICAL SPECIFICATIONS

SHEET NUMBER:

E701

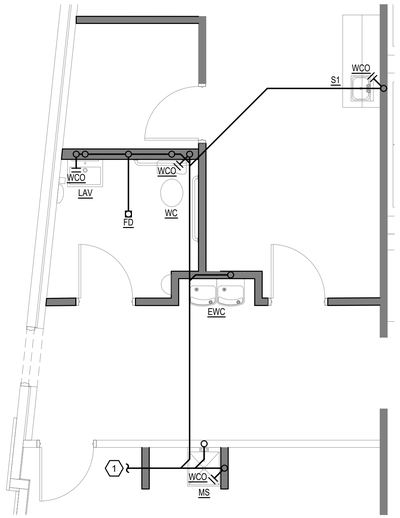

GC TO CAMERA PLUMBING LINES TO THE TOILETS DURING THE DEMO OR RELOCATION OF THE PIPE TO THE TOILETS AND PROVIDE FOOTAGE TO CONSUMER BEFORE TURNOVER.

1 PLUMBING SANITARY FLOOR PLAN

NTS

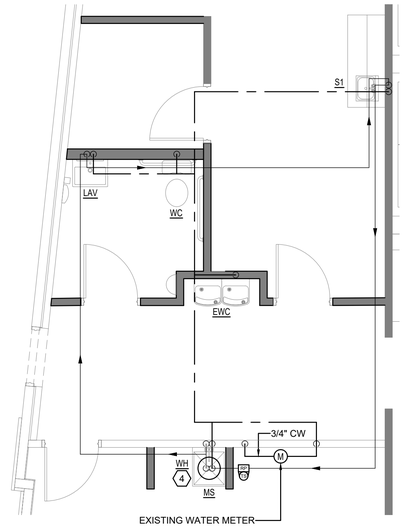

EXISTING WATER METER
VERIFY ALL METERING REQUIREMENTS WITH LANDLORD

PROVIDE BACKFLOW PREVENTOR AS REQUIRED

2 PLUMBING DOMESTIC WATER FLOOR PLAN

NTS

SUPPLY FIXTURE UNITS

TAG	QUANTITY	UNITS PER FIXT	COLD FU'S	HOT FU'S
WC	1	2.5	2.5	-
LAV	1	2	2	2
S1	1	1.5	1	1
MS	1	3.0	2.25	2.25
EWC	1	0.5	0.25	-
TOTALS			8.0	5.25

DRAINAGE FIXTURE UNITS

TAG	QUANTITY	UNITS PER FIXT	TOTAL DRAINAGE FU'S
WC	1	4	4
LAV	1	1	1
FD (EM)	1	0.0	0.0
S1	1	2	2
MS	1	3	3
EWC	1	0.5	0.5
TOTALS			10.5

KEYED NOTES

(##)	NOTES
1	PROVIDE SANITARY PIPING TO NEW PLUMBING FIXTURES. CONNECT NEW PIPING TO EXISTING SANITARY LINE SERVING THE SPACE. FIELD VERIFY CONNECTION LOCATION, INVERT, AND DIRECTION OF FLOW PRIOR TO BID.
2	PROVIDE NEW DOMESTIC HOT/COLD WATER DISTRIBUTION PIPING. CONNECT TO EXISTING WATER LINES SERVING THE SPACE. FIELD VERIFY LOCATION PRIOR TO BID. COORDINATE ALL METER REQUIREMENTS AND METER LOCATION WITH LANDLORD REPRESENTATIVE.
3	PROVIDE NEW VENT PIPING TO ROOF. SEE DETAIL 1/P501. VERIFY THE POSSIBLE RE-USE OF EXISTING ROOF VENT AND CONNECT TO EXISTING VENT PIPING SYSTEM IF EXISTING CAN BE RE-USED. FIELD VERIFY CONNECTION LOCATION PRIOR TO BID.
4	PROVIDE NEW SHELF MOUNTED ELECTRIC WATER HEATER. CONNECT TO EXISTING WATER PIPING. PIPE PRESSURE RELIEF VALVE TO MOP SINK. SEE DETAIL ON SHEET P501.
5	PROVIDE NEW AUTOMATIC TRAP PRIMER FOR TOILET ROOM FLOOR DRAIN(S). TRAP SEAL PRIMER VALVE NEEDS TO BE ASSE 1018 -2001.
6	PROVIDE ASSE 1070 THERMOSTATIC MIXING VALVES AT ALL LAVS SET AT 110° F. HOT WATER LOOP SHALL DROP FROM OVERHEAD TO WITHIN 6 INCHES OF LAVATORY CONNECTION AS DIRECTED BY IECC C404.5.1(b).

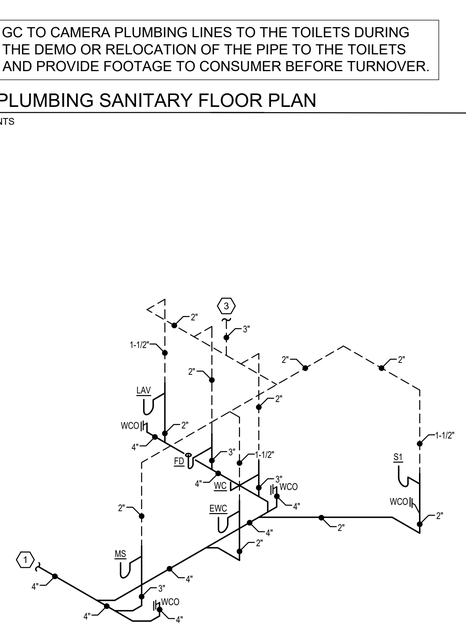

3 WASTE & VENT ISOMETRIC

NTS

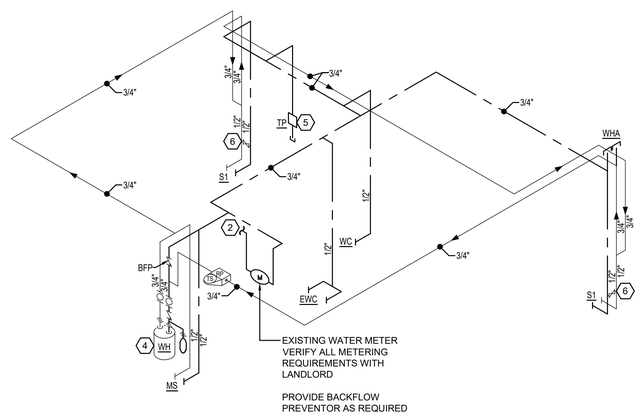

EXISTING WATER METER
VERIFY ALL METERING REQUIREMENTS WITH LANDLORD

PROVIDE BACKFLOW PREVENTOR AS REQUIRED

4 WATER RISER DIAGRAM

NTS



TYPICAL ASSE 1070 APPLICATION

5 THERMOSTATIC MIXING VALVE

NTS

PIPING MATERIALS

SANITARY (BELOW GRADE) - PVC SCHEDULE 40 OR SERVICE WEIGHT CAST IRON.
JOINING - SOLVENT WELDED ASTM D2564

WATER PIPING (ABOVE GRADE) - ASTM B88, TYPE L HARD DRAWN COPPER.
JOINING - ANSI/ASTM B32, "LEAD-FREE" SOLDER
INSULATION - 3/4" OR LESS, 1/2" THICK FIBERGLASS, 1" OR MORE, 1" FIBERGLASS

CONDENSATE PIPING (WHERE REQUIRED) - ASTM B306, COPPER.
JOINING - SOLDER GRADE 50B INSULATION -1/2" THICK ARMAFLEX THREADED ON PIPE

GENERAL NOTES

A. CONTRACTOR SHALL VISIT THE SITE PRIOR TO BID AND VERIFY ALL WORKING CONDITIONS, CLEARANCES, AND REQUIREMENTS FOR PROVIDING A COMPLETE AND FUNCTIONAL SYSTEM. NO CHANGES IN THE CONTRACT OR CONTRACT SUM WILL BE MADE DUE TO THE FAILURE TO THOROUGHLY EXAMINE THE SITE AND CONDITIONS.

B. CONTRACTOR SHALL BE RESPONSIBLE FOR ALL SAW CUTTING REQUIRED FOR THIS JOB. COORDINATE BACKFILLING AND CONCRETE PATCHING RESPONSIBILITIES WITH THE GENERAL CONTRACTOR.

WHEN REQUIRED, IT IS THE OWNER'S RESPONSIBILITY TO CONTRACT WITH A COMMISSIONING AUTHORITY TO COMPLY WITH LOCAL CODES.

SARGENTI

5840 LEGACY CIR - STE D230, PLANO, TX 75024
T|201.316.5491 ■ WWW.SARGARCH.COM

GEMINI ENGINEERING GROUP
101 Nightlinger Lane
Millsap, TX 76066
(817) 672-7562

SEAL:

COLORADO LICENSED
CLAYTON LUCAS
63118
PROFESSIONAL ENGINEER
10/15/2026

CONTRACTOR'S NOTES:

WRITTEN DIMENSIONS HOLD PREFERENCE OVER SCALED DIMENSIONS. DO NOT SCALE THE DRAWINGS. THE CONTRACTORS MUST VISIT JOB SITE TO VERIFY ALL EXISTING CONDITIONS AND DIMENSIONS BEFORE SUBMITTING BIDS. REPORT ANY DISCREPANCIES OF ANY CONDITIONS WHICH MAY INTERFERE WITH THE PROPER EXECUTION OF, THE CONTRACT TO THE TENANT'S REPRESENTATIVE. REPORT DISCREPANCIES DURING BIDDING PROCESS AND BEFORE START OF CONSTRUCTION. CHANGE ORDERS NEED TO BE APPROVED BY THE CONSTRUCTION MANAGER FOR ISSUES ARISING FROM THE FIELD CONDITIONS OR CONFLICTS BETWEEN THE PLANS AND THE EXISTING CONDITIONS PRIOR TO THE COMMENCEMENT OF WORK.

	DATE	ISSUE
△	DATE	REVISION

LOCATION:

Consumer Cellular

8283 S. AKRON ST.
SUITE #110
CENTENNIAL, CO 80112

STORE NUMBER:

CO2

PROJECT INFORMATION:

DATE: 10/15/2026
PROJECT NUMBER: 15066 - 26
STORE TYPE: TIER 2
DRAWN BY: HO
REVIEWED BY: CL

TITLE:

PLUMBING FLOOR PLAN

SHEET NUMBER:

P101

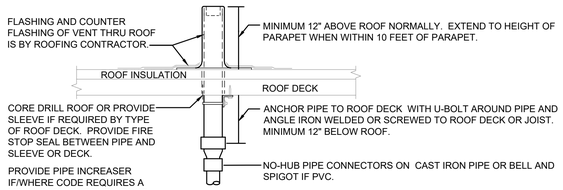

REFER TO PLANS FOR VENT THRU ROOF PIPE SIZES AND LOCATIONS. LOCATE VENT THRU ROOF MINIMUM THREE FEET FROM PROPERTY LINE, OR TEN FEET HORIZONTAL OR THREE FEET VERTICAL ABOVE ANY BUILDING OPENING OR FRESH AIR INTAKE, OR ONE FOOT FROM ANY VERTICAL SURFACE. LOCATE VENT THRU ROOF MINIMUM 18" FROM PARAPET, EXPANSION JOINT, EQUIPMENT CURB, ETC. OFFSET IN CEILING SPACE WHERE REQUIRED TO MEET THESE CONDITIONS.

1 VENT THROUGH ROOF

NTS

MODEL	PDI SIZE	MNPT THREAD		DIMENSIONS (approximate) A				FIXTURE UNIT CAPACITY	PIPE SIZE in.
				A		B			
		in.	mm.	in.	mm.	in.	mm.		
1260XL-A	A	1/2	15	6 1/4	159	7/8	22	1 - 11	1/2
1260XL-B	B	3/4	20	7 1/4	184	7/8	22	12 - 32	3/4
1260XL-C	C	1	25	9 1/4	235	1 1/8	28.6	33 - 60	1
1260XL-D	D	1	25	9 1/2	241	1 3/4	44	61 - 113	1 1/4
1260XL-E	E	1	25	11 1/4	286	2 1/2	64	114 - 154	1 1/2
1260XL-F	F	1	25	12	305	2 7/8	73	155 - 330	2



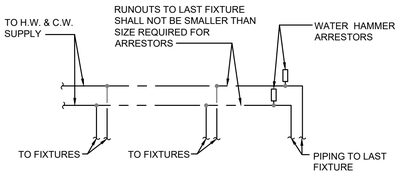

NOTE: USE TABLE 10-1 UNIFORM PLUMBING CODE FOR FIXTURE UNITS, FOR SIZING WATER HAMMER ARRESTORS. TABLE APPLIES TO BOTH UPC & IPC.

2 WATER HAMMER ARRESTOR

NTS

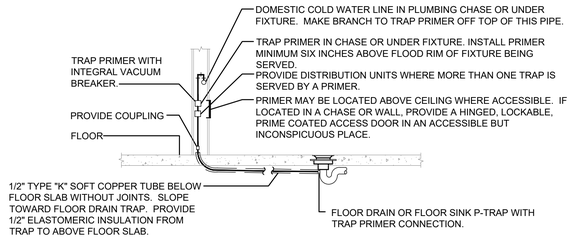

DETAIL SHOWS TRAP PRIMER INSTALLATION CONCEALED FOR PUBLIC AREAS, SUCH AS TOILETS. IN NON-PUBLIC AREAS, SUCH AS EQUIPMENT ROOMS, TRAP PRIMERS MAY BE INSTALLED THIS WAY ALSO, OR IN EASILY-ACCESSIBLE, EXPOSED BUT INCONSPICUOUS LOCATIONS, THEREBY OMITTING THE ACCESS DOOR. INSULATION ONLY ABOVE GROUND ON "M" OR "L" COPPER.

3 AUTOMATIC TRAP PRIMER

NTS

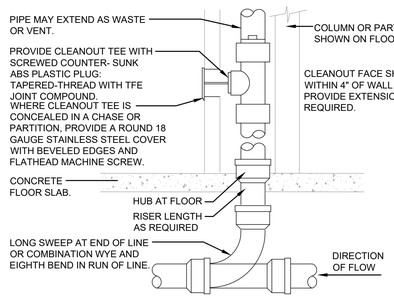

PROVIDE WCO WHERE SHOWN ON PLAN, AND ON SANITARY WASTE BRANCHES NOT SERVED WITH A FLOOR CLEANOUT: LOCATE ABOVE FIXTURE FLOOD RIM WITHIN 4' OF FLOOR. CONSULT LOCAL CODES FOR OTHER WCO REQUIREMENTS.

4 WALL CLEAN OUT

NTS

NOTE:
1. FIRST 8'-0" OF OUTLET PIPING TO BE INSULATED.
2. ALL HEAT TRACED OR EXTERNALLY HEATED PIPING TO BE INSULATED.

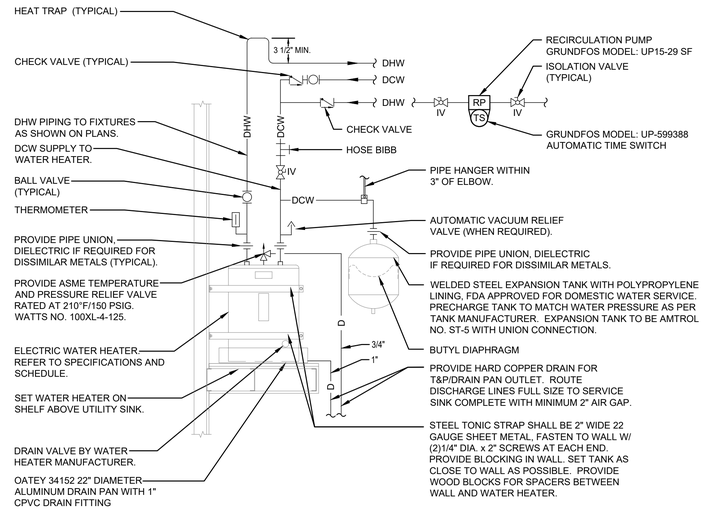

REFER TO SPECIFICATIONS, SCHEDULES AND NOTES FOR ADDITIONAL INFORMATION. PIPING ARRANGEMENT SHOWN IS SCHEMATIC. VERIFY ALL CONNECTION SIZES AND LOCATIONS PER MANUFACTURER'S REQUIREMENTS. ADJUST TO SUIT FIELD CONDITIONS. FOLLOW MANUFACTURER'S INSTRUCTIONS FOR INSTALLATION OF EXPANSION TANK. REFER TO FLOOR PLANS FOR PIPE SIZES. PROVIDE SEISMIC STRAP OR BRACING, HEAT TRAP AND AUTOMATIC VACUUM RELIEF VALVE WHEN REQUIRED BY LOCAL AUTHORITIES.

5 ELECTRIC DOMESTIC WATER HEATER

NTS

PLUMBING FIXTURE SCHEDULE

MARK	SYMBOL	FIXTURE DESCRIPTION	MANUFACTURER	CATALOG NUMBER	COLD	HOT	WASTE	VENT	REMARKS
WC		WATER CLOSET	KOHLER	K-3519	1/2"	--	3"	2"	KOHLER "HIGHLINE PRESSURE LITE" MODEL NO. K-3519, 1.0 GPF, PRESSURE ASSISTED WHITE WATER CLOSET WITH ELONGATED VITREOUS CHINA BOWL, (OR ZURN MODEL Z5561, 1.0 GPF WITH HIGH PERFORMANCE ECOFLUSH TECHNOLOGY), 17⅝" HIGH, WHITE OPEN FRONT SEAT AND COVER #K-4650. FURNISH WITH BOLT CAPS AND CHROME SUPPLY STOP. (FOR PUBLIC AND NON-PUBLIC RESTROOMS). FLUSH LEVER SHALL BE LOCATED ON THE WIDE SIDE OF THE TOILET. MIN STATIC PRESSURE 35 PSI. GC/PC TO CONFIRM EXISTING WATER PRESSURE PRIOR TO ORDERING.
LAV		LAVATORY	AMERICAN STANDARD	LUCERN 0356.421	1/2"	1/2"	2"	1-1/2"	SINGLE HOLE ADA COMPLIANT, WALL MOUNTED. PROVIDE WITH "KOHLER" K-97282-4 SINGLE HOLE LAVATORY FAUCET (0.5 GPM). OFFSET TRAP WITH INSULATED "TRAP WRAP" PROTECTIVE KIT 500R BY BROCAR. PROVIDE THERMOSTATIC MIXING VALVE 605XTMV1070 (ASSE 1070 CERTIFIED DOWN TO 0.35 GPM). SET MAXIMUM TEMPERATURE TO 100° F.
FD		FLOOR DRAIN	ZURN	FD-2212-P	1/2"	--	3"	2"	CAST IRON, POLISHED BRONZE. INSTALL FLUSH WITH FLOOR. PROVIDE "PRECISION PLUMBING PRODUCTS" P2-500 AUTOMATIC TRAP PRIMER WITH ANTI SIPHON PORTS, SERVES 2 FLOOR DRAINS EA., 1/2" CONNECTION.
S1		SINK	ALLORA	KSN-2016	1/2"	1/2"	2"	1-1/2"	PROVIDED BY FIXTURE MANUFACTURE WITH MILLWORK PACKAGE. PLUMBING CONTRACTOR TO MAKE ALL FINAL CONNECTIONS. SINGLE BOWL UNDERMOUNT SINK WITH PFISTER LADERA BAR & PREP FAUCET MODEL F072-LRGS (1.8 GPM). PROVIDE "POWERS" E480 THERMOSTATIC MIXING VALVE (ASSE 1070, CSA B125.3 CERTIFIED). SET MAX. TEMP. TO 100° F.
EWC		ELECTRIC WATER COOLER	HALSEY TAYLOR	HTHB-HAC8BLPV-WF	1/2"	--	2"	1-1/2"	PROVIDE CHROME SUPPLY STOP AND P-TRAP. SEE MANUFACTURER'S INSTRUCTIONS FOR PROPER INSTALLATION PER ACCESSIBILITY REQUIREMENTS. UNIT TO BE INSTALLED WITH ACCESSORY APRON LKAPREZL FOR ADA COMPLIANCE IF MNTD. IN EXPOSED WALL. CONTRACTOR TO CONFIRM EXACT MAKE,MODEL, AND COLOR OF DRINKING FOUNTAIN WITH OWNER.
MS		MOP SINK	FLORESTONE	MSR-2424	1/2"	1/2"	3"	2"	MOLDED MOP RECEPTOR WITH "CHICAGO FAUCET" 911-IS369CP LEVER HANDLES. RCF FAUCET WITH 892-GABCP ELEVATED VACUUM BREAKER.
WH		WATER HEATER	A.O.SMITH	DEL10	3/4"	3/4"	--	--	10 GALLON, 208/1Ø, 3000W ELEMENT, 18-1/4" TALL, 18" DIA., 3/4" INLET/OUTLET, 35 LBS.
RP	RP TS	RECIRCULATION PUMP	GRUNDFOS	UP15-29 SF	--	3/4"	--	--	FOR HOT WATER LOOP. PROVIDE GRUNDFOS UP-599388 AUTOMATIC TIME SWITCH SET TO SWITCH OFF THE TEMPERATURE MAINTENANCE SYSTEM DURING EXTENDED PERIODS WHEN HOT WATER IS NOT REQUIRED.
WCO		WALL CLEAN OUT	JOSAM	58910	--	--	--	--	TEE CLEANOUT FOR USE IN WALLS. PROVIDE WITH JOSAM SERIES 58600-VP SECURE WALL ACCESS COVER WITH VANDAL-PROOF SCREWS. SEE PLUMBING PLAN AND ISOMETRICS FOR SIZE.

SARGENTI
5840 LEGACY CIR - STE D230, PLANO, TX 75024
T|201.316.5491 ■ WWW.SARGARCH.COM

GEMINI ENGINEERING GROUP
101 Nightlinger Lane
Millsap, TX 76066
(817) 672-7562

SEAL:

COLORADO LICENSED
CLAYTON LUCAS
63118
PROFESSIONAL ENGINEER
10/15/2026

CONTRACTOR'S NOTES:

WRITTEN DIMENSIONS HOLD PREFERENCE OVER SCALED DIMENSIONS. DO NOT SCALE THE DRAWINGS. THE CONTRACTORS MUST VISIT JOB SITE TO VERIFY ALL EXISTING CONDITIONS AND DIMENSIONS BEFORE SUBMITTING BIDS. REPORT ANY DISCREPANCIES OF ANY CONDITIONS WHICH MAY INTERFERE WITH THE PROPER EXECUTION OF, THE CONTRACT TO THE TENANT'S REPRESENTATIVE. REPORT DISCREPANCIES DURING BIDDING PROCESS AND BEFORE START OF CONSTRUCTION. CHANGE ORDERS NEED TO BE APPROVED BY THE CONSTRUCTION MANAGER FOR ISSUES ARISING FROM THE FIELD CONDITIONS OR CONFLICTS BETWEEN THE PLANS AND THE EXISTING CONDITIONS PRIOR TO THE COMMENCEMENT OF WORK.

	DATE	ISSUE
△	DATE	REVISION

LOCATION:

Consumer Cellular

8283 S. AKRON ST.
SUITE #110
CENTENNIAL, CO 80112

STORE NUMBER:

CO2

PROJECT INFORMATION:

DATE: 10/15/2026
PROJECT NUMBER: 15066 - 26
STORE TYPE: TIER 2
DRAWN BY: HO
REVIEWED BY: CL

TITLE:

PLUMBING DETAILS

SHEET NUMBER:

P501

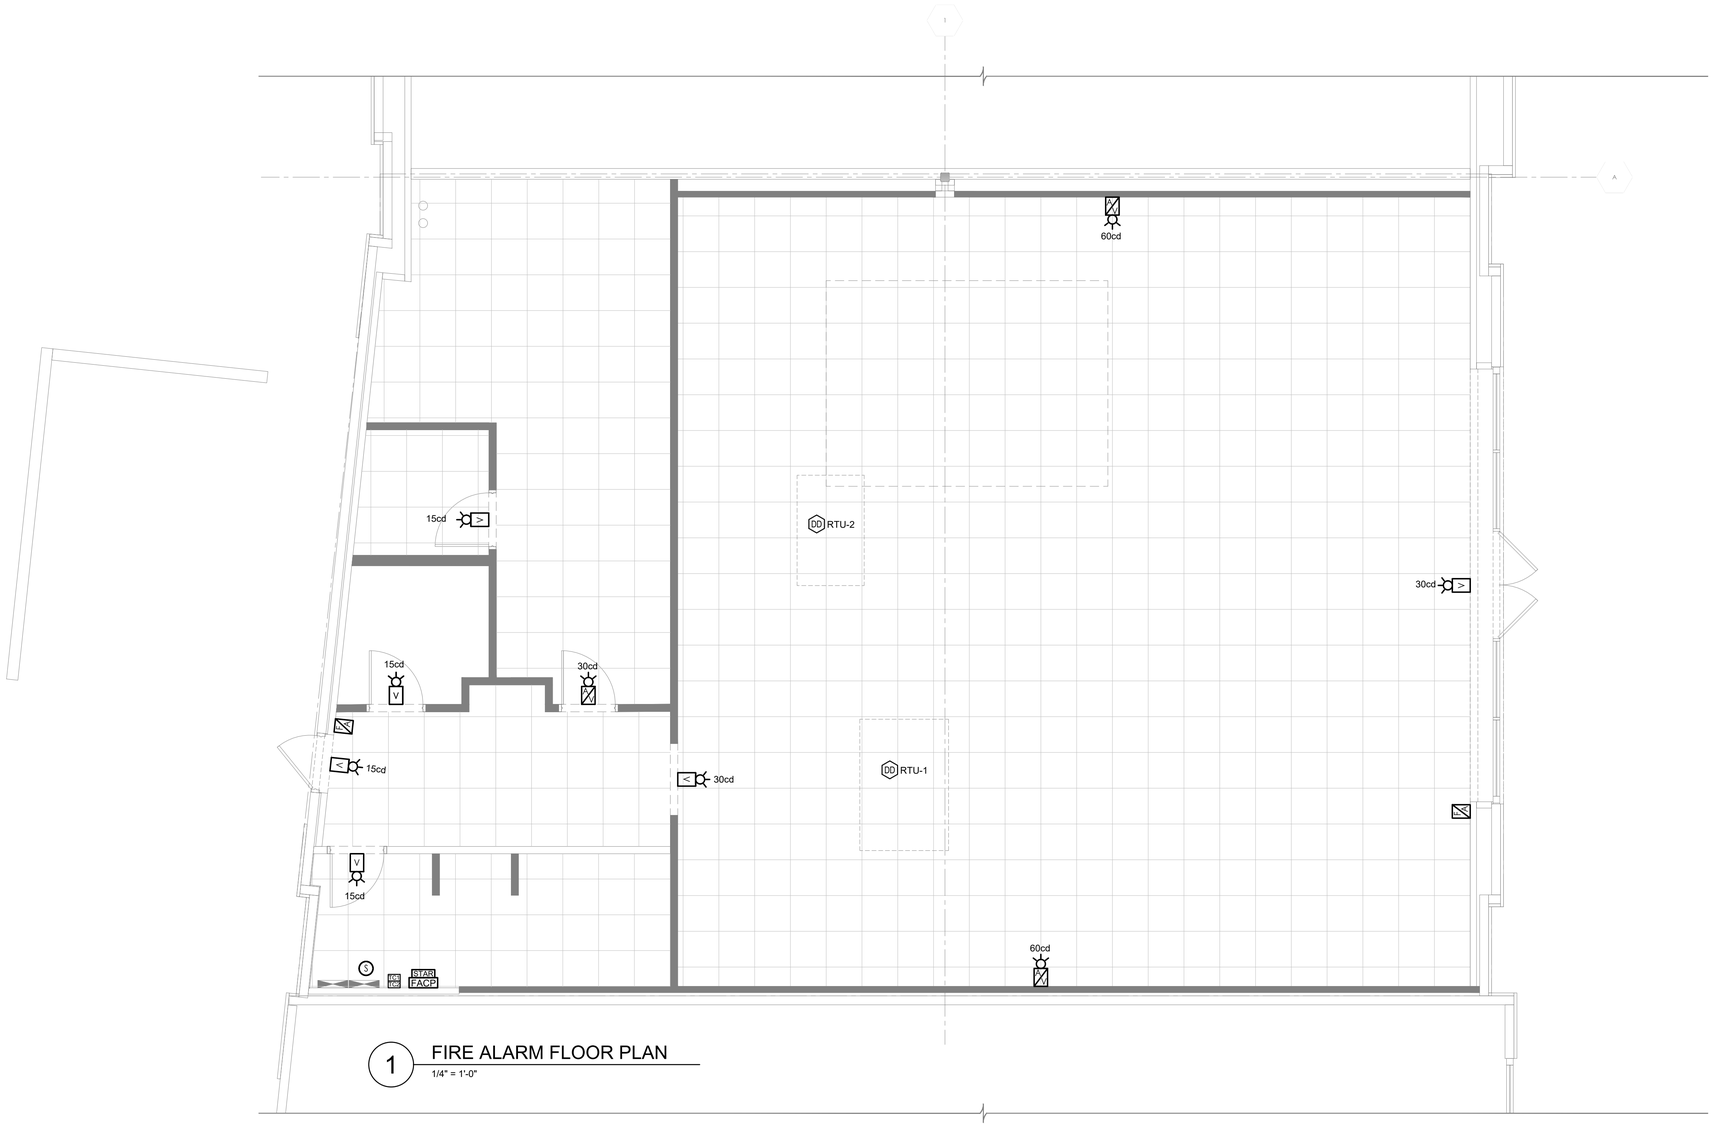

1 FIRE ALARM FLOOR PLAN
1/4" = 1'-0"

FIRE ALARM NOTES

SEC. 18-5.2 RETENTION OF PLANS
ONE SET OF APPROVED PLANS, SPECIFICATIONS, AND COMPUTATIONS SHALL BE RETAINED BY THE BUILDING OFFICIAL FOR A PERIOD OF NOT LESS THAN 90 DAYS FROM DATE OF COMPLETION OF THE WORK COVERED THEREIN, AND ONE SET OF APPROVED PLANS SHALL BE RETURNED TO THE APPLICANT, AND SAID SET SHALL BE KEPT ON THE SITE OF THE BUILDING OR WORK AT ALL TIMES DURING WHICH THE WORK AUTHORIZED THEREBY IS IN PROGRESS. (SEC. 18-5.2 R.O. 1978 (1983 ED.); AM. ORD. 93-59)

FIRE SAFETY NOTE
16.1.1 STRUCTURES UNDERGOING CONSTRUCTION, ALTERATION, OR DEMOLITION OPERATIONS, INCLUDING THOSE IN UNDERGROUND LOCATIONS, SHALL COMPLY WITH NFPA 241, STANDARD FOR SAFEGUARDING CONSTRUCTION, ALTERATION, AND DEMOLITION OPERATIONS, AND THIS CHAPTER. 2021 SCFC AND 2019 NFPA 72.

ALTERATION OF BUILDINGS
16.4.4.1 WHERE THE BUILDING IS PROTECTED BY FIRE PROTECTION SYSTEMS, SUCH SYSTEMS SHALL BE MAINTAINED OPERATIONAL AT ALL TIMES DURING ALTERATION.

16.4.4.2 WHERE ALTERATION REQUIRES MODIFICATION OF A PORTION OF THE FIRE PROTECTION SYSTEM, THE REMAINDER OF THE SYSTEM SHALL BE KEPT IN SERVICE AND THE FIRE DEPARTMENT SHALL BE NOTIFIED.

16.4.4.3 WHEN IT IS NECESSARY TO SHUT DOWN THE SYSTEM, THE AHJ SHALL HAVE THE AUTHORITY TO REQUIRE ALTERNATE MEASURES OF PROTECTION UNTIL THE SYSTEM IS RETURNED TO SERVICE.

16.4.4.4 THE FIRE DEPARTMENT SHALL BE NOTIFIED WHEN THE SYSTEM IS SHUT DOWN AND WHEN THE SYSTEM IS RETURNED TO SERVICE.

10.8.1.1 AS NECESSARY DURING EMERGENCIES, MAINTENANCE, DRILLS, PRESCRIBED TESTING, ALTERATIONS, OR RENOVATIONS, PORTABLE OR FIXED FIRE-EXTINGUISHING SYSTEMS OR DEVICES OR ANY FIRE-WARNING SYSTEM SHALL BE PERMITTED TO BE MADE INOPERATIVE OR INACCESSIBLE. A FIRE WATCH SHALL BE REQUIRED AS SPECIFIED IN SECTIONS 13.3.4.3.5.2(3), 13.7.1.4.4, 16.5.4, 20.2.3.6, 34.6.3.3, 41.2.2.5, 41.2.2.6, 41.2.4, 41.3.4, 41.4.1, 34.5.4.3, AND 25.1.8 AT NO COST TO THE AHJ. 2021 SCFC AND 2019 NFPA 72.

DETECTION, ALARM, AND COMMUNICATIONS SYSTEMS
13.7.1.1 WHERE BUILDING FIRE ALARM SYSTEMS OR AUTOMATIC FIRE DETECTORS ARE REQUIRED BY OTHER SECTIONS OF THIS CODE, THEY SHALL BE PROVIDED AND INSTALLED IN ACCORDANCE WITH NFPA 70, NFPA 72, NATIONAL FIRE ALARM AND SIGNALING CODE, AND SECTION 13.7.

13.7.1.4.10.5 UNLESS OTHERWISE PROVIDED IN 13.7.1.4.10.5.1 THROUGH 13.7.1.4.10.5.8, NOTIFICATION SIGNALS FOR OCCUPANTS TO EVACUATE SHALL BE AUDIBLE AND VISIBLE SIGNALS IN ACCORDANCE WITH NFPA 72 AND ICC/ANSI A117.1, AMERICAN NATIONAL STANDARD FOR ACCESSIBLE AND USABLE BUILDINGS AND FACILITIES, OR OTHER MEANS OF NOTIFICATION ACCEPTABLE TO THE AHJ SHALL BE PROVIDED.

PROTECTION OF FIRE ALARM SYSTEMS
72.10.15 IN AREAS THAT ARE NOT CONTINUOUSLY OCCUPIED, AUTOMATIC SMOKE DETECTION SHALL BE PROVIDED AT THE LOCATION OF EACH FIRE ALARM CONTROL UNIT(S), NOTIFICATION APPLIANCE CIRCUIT POWER EXTENDERS, AND SUPERVISING TRANSMITTING EQUIPMENT TO PROVIDE NOTIFICATION OF FIRE AT THAT LOCATION

ENSURE FIRE ALARM SYSTEM AUDIBILITY AND VISIBILITY IS ADEQUATE THROUGH ALL OCCUPIABLE AREAS AND SPACES. THIS WILL BE THOROUGHLY CHECKED AT TIME OF FIRE ALARM ACCEPTANCE TESTING.

FIRE ALARM SYMBOLS AND NOTES

SYMBOL	DESCRIPTION	MANUFACTURE MODEL #	OPERATING VOLTAGE	MOUNTING	REMARKS
FACP	ADDRESSABLE FIRE ALARM CONTROL PANEL	HONEYWELL 6700	120V AC	WALL MOUNTED	TOP OF CABINET AT 6FT A.F.F. OR CENTER AT 5FT A.F.F. WHICHEVER IS LOWER
STAR	STARLINK FIREMAX 2 - DUAL SIM, DUAL PATH AT&T and VERIZON CELL &/or IP UNIVERSAL 5G COMMERCIAL FIRE LTE-M COMMUNICATOR	NAPCO SLE-MAX2-FIRE	10-24VDC	WALL MOUNTED	www.StarLinkFire.com
S	PHOTOELECTRIC SMOKE DETECTOR WITH THERMAL (135° FIXED TEMPERATURE)	HONEYWELL SK-PHOTO	15.2-19.95V DC	CEILING MOUNTED	NOT LESS THAN 4" TO CORNERS OR BETWEEN 4" TO 12" FOR WALL MOUNTING
	ADDRESSABLE SINGLE ACTION MANUAL PULL STATION	HONEYWELL SK-PULL-SA	15.2-19.95V DC	WALL MOUNTED	48" A.F.F. TO TOP OF DEVICE
XXcd	WALL MOUNTED HORN STROBE, RED HOUSING, CLEAR LENS, "FIRE" LABEL XXcd = CANDELLA RATING (SEE PLAN)	HONEYWELL P2RL/P2WL	16-33V DC	WALL MOUNTED	80" A.F.F. TO BOTTOM OF DEVICE OR 6" FROM CEILING WHICHEVER IS LOWER.
XXcd	CEILING MOUNTED HORN STROBE, RED HOUSING, CLEAR LENS, "FIRE" LABEL XXcd = CANDELLA RATING (SEE PLAN)	HONEYWELL PC2RL/PC2WL	16-33V DC	CEILING MOUNTED	
V	WALL MOUNTED STROBE, WHITE HOUSING, CLEAR LENS	HONEYWELL SRL/SWL	16-33V DC	WALL MOUNTED	80" A.F.F. TO BOTTOM OF DEVICE OR 6" FROM CEILING WHICHEVER IS LOWER.
V	CEILING MOUNTED STROBE, WHITE HOUSING, CLEAR LENS	HONEYWELL SCRL/SCWL	16-33V DC	CEILING MOUNTED	
DD	PHOTOELECTRONIC DUCT DETECTOR	HONEYWELL SK-DUCT	15.2-19.95V DC	DUCT MOUNTED	

SARGENTI
5840 LEGACY CIR - STE D230, PLANO, TX 75024
T|201.316.5491 ■ WWW.SARGARCH.COM

GEMINI ENGINEERING GROUP
101 Nightlinger Lane
Millsap, TX 76066
(817) 672-7562

SEAL:

COLORADO LICENSED
CLAYTON LUCAS
63118
PROFESSIONAL ENGINEER
10/15/2026

CONTRACTOR'S NOTES:

WRITTEN DIMENSIONS HOLD PREFERENCE OVER SCALED DIMENSIONS. DO NOT SCALE THE DRAWINGS. THE CONTRACTORS MUST VISIT JOB SITE TO VERIFY ALL EXISTING CONDITIONS AND DIMENSIONS BEFORE SUBMITTING BIDS. REPORT ANY DISCREPANCIES OF ANY CONDITIONS WHICH MAY INTERFERE WITH THE PROPER EXECUTION OF, THE CONTRACT TO THE TENANT'S REPRESENTATIVE. REPORT DISCREPANCIES DURING BIDDING PROCESS AND BEFORE START OF CONSTRUCTION. CHANGE ORDERS NEED TO BE APPROVED BY THE CONSTRUCTION MANAGER FOR ISSUES ARISING FROM THE FIELD CONDITIONS OR CONFLICTS BETWEEN THE PLANS AND THE EXISTING CONDITIONS PRIOR TO THE COMMENCEMENT OF WORK.

	DATE	ISSUE
△	DATE	REVISION

LOCATION:

Consumer Cellular®

8283 S. AKRON ST.
SUITE #110
CENTENNIAL, CO 80112

STORE NUMBER:

CO2

PROJECT INFORMATION:

DATE: 10/15/2026
PROJECT NUMBER: 15066 - 26
STORE TYPE: TIER 2
DRAWN BY: HO REVIEWED BY: CL

TITLE:

FIRE ALARM FLOOR PLAN

SHEET NUMBER:

FA101

TAKE-OFF MARKUPS - LEGEND

Source: the take-off Excel (Partition Takeoff) · one PDF annotation (Line / PolyLine) per wall on the plan sheet where it was measured · Subject = type · Contents = TYPE · LF · H · SF · DETAIL · id

Sample	Type	Walls	LF	Marked	No geometry	Walls without geometry (not marked): 0
	A3	4	99.86	4	0	
	C3	1	35.54	1	0	
	D	1	7.67	1	0	
	E3	13	57.45	13	0	
	TOTAL	**19**	**200.52**	**19**	**0**	