

## PROJECT INTRODUCTION



**Project Name:** OBH012 COMBO-Z 3200 48V UPS

**Objective-** Export Sales team required Static UPS 2800W with 48V battery bank and Some new different looks like New Bezel and Graphical LCD with Multi color.

**Scope-On** battery voltage range 42V to 58V, Maintain output current more than and equal to 9A at full load 2800w . Chassis must be compact from existing system.

**Measurement Goals** - Schedule Variance: $\pm 20\%$ , Product Defect Density: $0.10 \pm 0.02$ , Project's Process Defect Density: $0.20 \pm 0.02$ .

**Link to Project Data** : [http://192.168.100.9:8080/svn/LKVA\\_inv/OBH012/](http://192.168.100.9:8080/svn/LKVA_inv/OBH012/)

**Team Size:** 11 Nos.

**Effort Size:** 195 .28 hrs.

**Timeline :** 08-09-2022 to 27-10-2022


**Actual Scheduled Start to Finish Date:** 08-9-2022 to 31-10-22

**Target Customer :** Export Market

OBH012


1

## Requirement Development and Management Flow

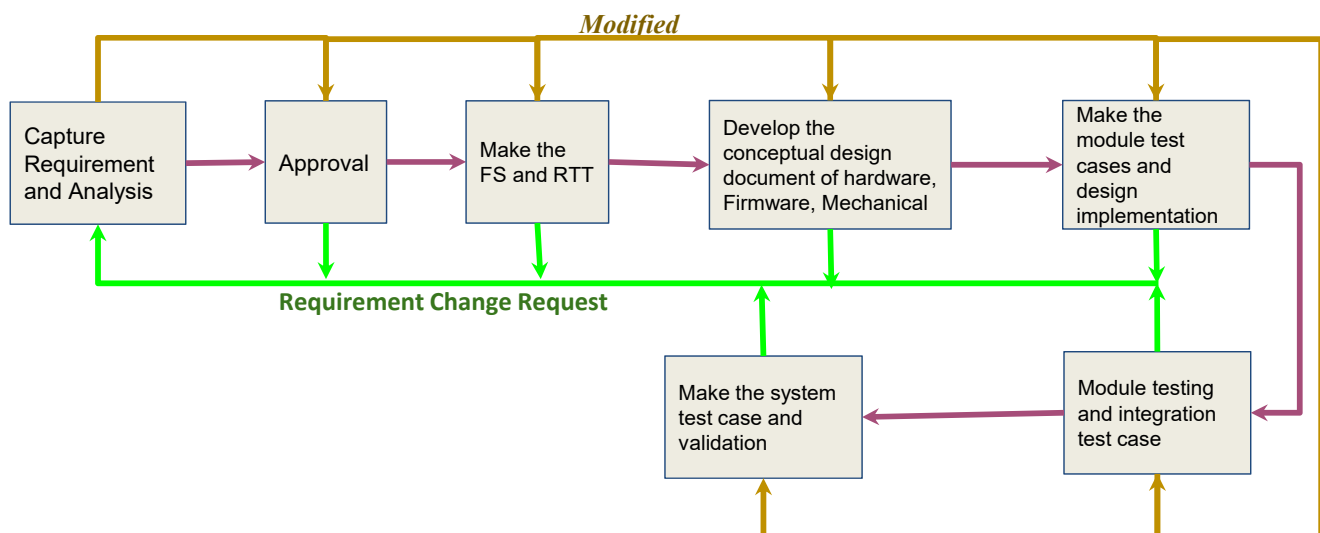


2

## Verification & Validation

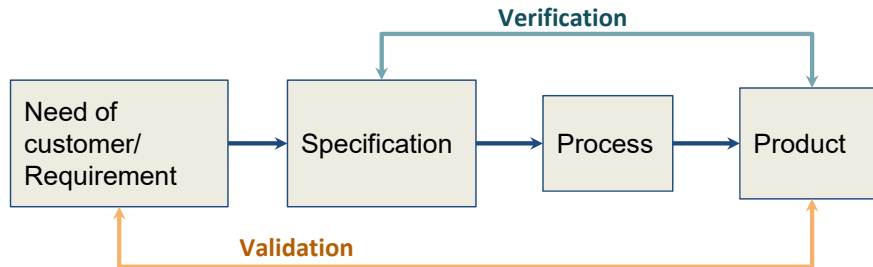

3

## Peer Review

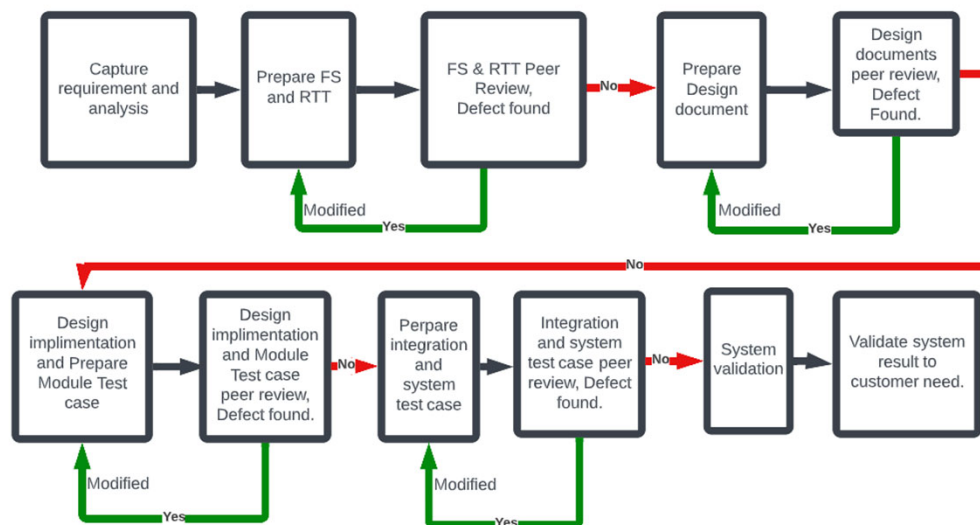

OBH012

4