



Obvodová schémata - Honeywell

Archivní číslo:

D261493301.OS2

Název projektu:

PP3 redundancy of IOs as FSC
to SM Migration Part

Stupeň : Realizační projekt

Datum: 07/2026

Revize:

Schválil : Ing.Sikora

Přezkoumal : Ing.Běhálek

Zpracoval : Ing.Bílý
Bc.Mitrenga
Ing.Běhálek



GENERAL DRAWINGS

PP3 UNIT ESD

				CUSTOMER : SLOVNAFT PLANT : BRATISLAVA : SLOVAKIA REQ/ORDER NO. : SRA7011259	GENERAL DRAWINGS: PP3 UNIT ESD – 82AC023,24 COVERSHEET															
C	12–10–24	FSC–SM MIGRATION	PKO		SECTION–1 AND 2															
B	20–02–04	AS BUILD			 Honeywell Safety Management Systems 's–Hertogenbosch The Netherlands DATE: 30–10–03 BY: Bdj DRAWING NUMBER <table><tr><td>G1</td><td>530225</td><td>1</td><td>2</td></tr><tr><td>SERIAL CODE</td><td>PROJECT</td><td>SHEET</td><td>CONT'D</td></tr></table>								G1	530225	1	2	SERIAL CODE	PROJECT	SHEET	CONT'D
G1	530225	1	2																	
SERIAL CODE	PROJECT	SHEET	CONT'D																	
A	02–12–03	REVISED																		
O	30–10–03	FOR APPROVAL																		
REV:	DATE:	DESCRIPTION	CHK'D																	

DESCRIPTION	PAGE	REVISION												EXTRA INFORMATION	DESCRIPTION	PAGE	REVISION												EXTRA INFORMATION
		0	A	B	C	D	E	F	G	H	I	J	K				0	A	B	C	D	E	F	G	H	I	J	K	
COVERSHEET	1	X	X	X	X											51													
LEGEND OF DRAWINGS	2	X	X	X	X											52													
LAY-OUT CABINET	3	X	X	X	X											53													
LAY-OUT CABINET	4	X	X	X	X											54													
LAY-OUT CABINET	5	X	X	X	X											55													
LAY-OUT CABINET	6	X	X	X	X											56													
LAY-OUT CABINET	7	X	X	X	X											57													
LAY-OUT CABINET	8	X	X	X	X											58													
LAY-OUT CABINET	9	X	X	X	X											59													
LAY-OUT CABINET	10	X	X	X	X											60													
	11															61													
	12															62													
	13															63													
	14															64													
	15															65													
	16															66													
	17															67													
	18															68													
	19															69													
	20															70													
	21															71													
	22															72													
	23															73													
	24															74													
	25															75													
	26															76													
	27															77													
	28															78													
	29															79													
LAY-OUT PLINTH	30	X	X	X	X											80													
	31															81													
	32															82													
	33															83													
	34															84													
	35															85													
	36															86													
	37															87													
	38															88													
	39															89													
	40															90													
	41															91													
	42															92													
	43															93													
	44															94													
	45															95													
	46															96													
	47															97													
	48															98													
	49															99													
	50															100													
	DATE	30-10-03	02-12-03	20-02-04	12-10-24											DATE													

				CUSTOMER : SLOVNAFT	GENERAL DRAWINGS: PP3 UNIT ESD – 82AC023,24			
				PLANT : BRATISLAVA				
					REQ/ORDER NO. : SRA7011259			
C	12-10-24	FSC-SM MIGRATION	PKO		DATE:	30-10-03	BY:	BdJ
B	20-02-04	AS BUILD			DRAWING NUMBER			
A	02-12-03	REVISED			G1	530225	2	3
0	30-10-03	FOR APPROVAL			SERIAL CODE	PROJECT	SHEET	CONT'D
REV:	DATE:	DESCRIPTION	CHK'D					

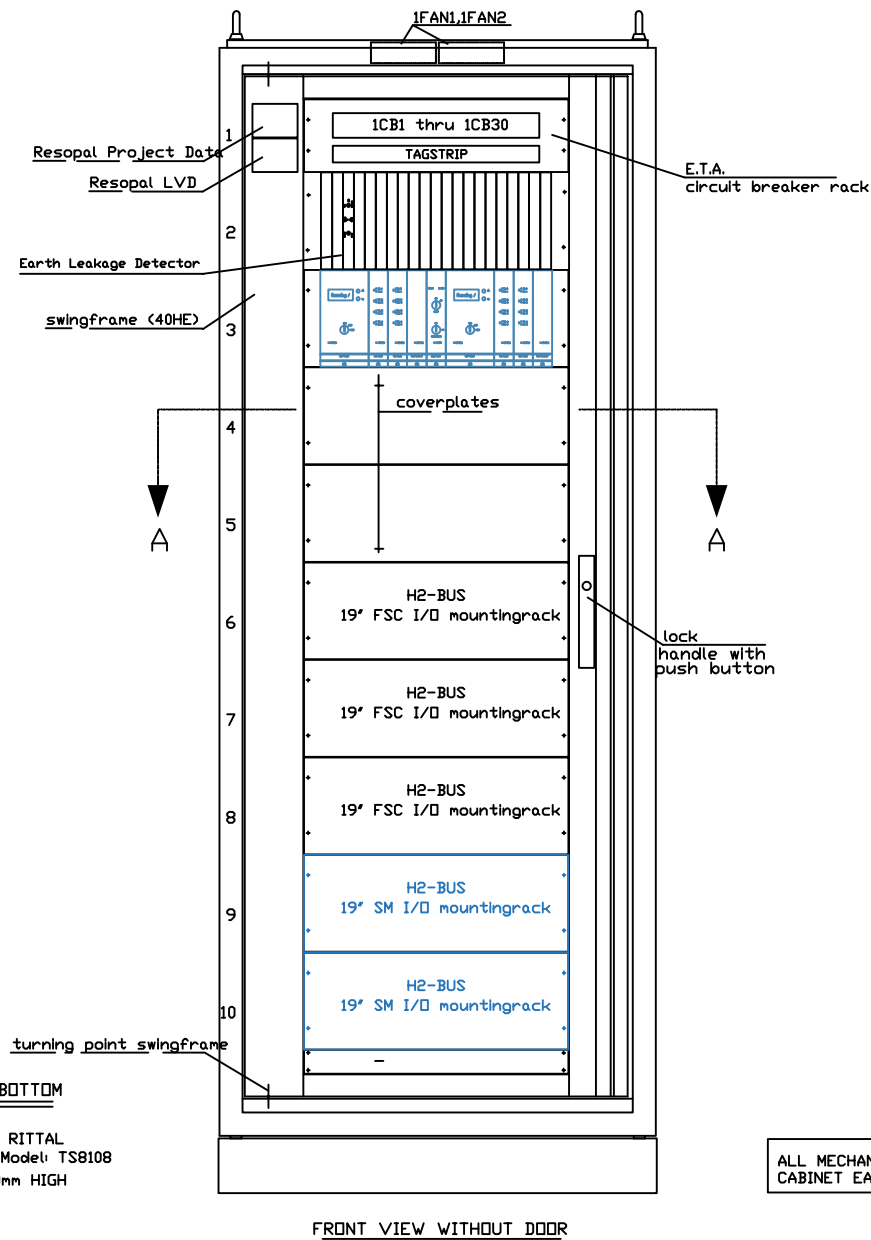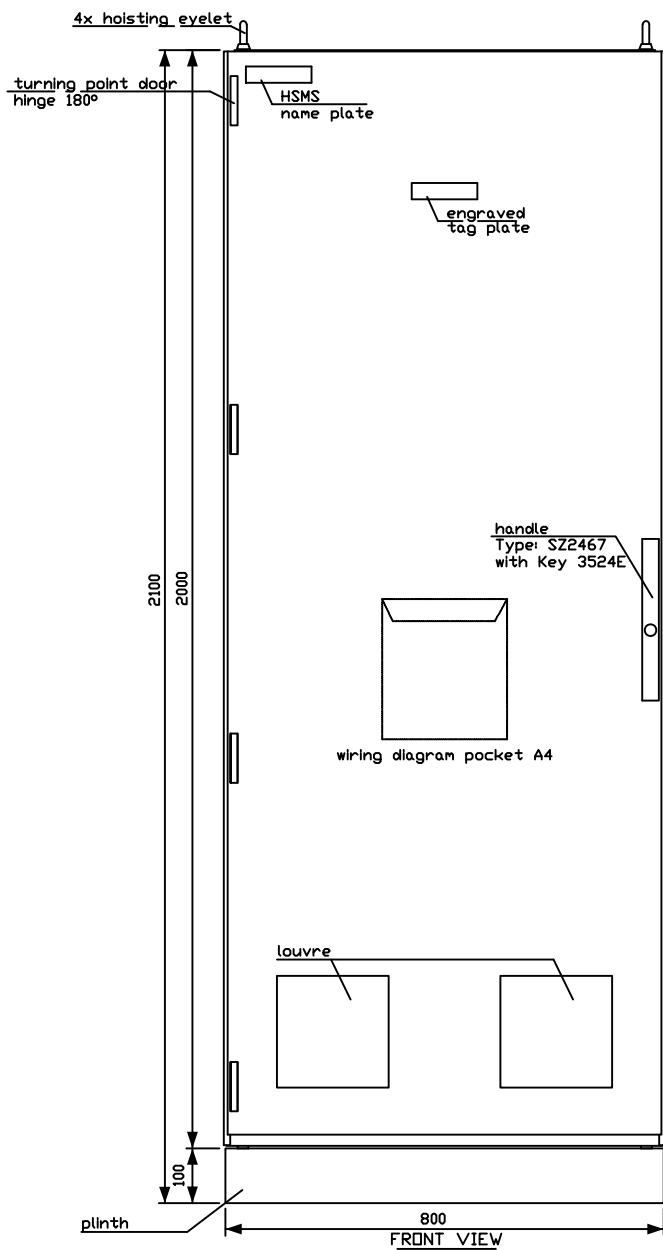

CABINET Model: TS8808 Make: RITTAL
complete with: -1 sideplate Model: TS8108
- plinth 100mm HIGH

ALL MECHANICAL PARTS OF
CABINET EARTHED

REV:	DATE:	DESCRIPTION	CHK'D
D	30-09-26	INPUT REDUNDANCY	PKO
C	12-10-24	FSC-SM MIGRATION	PKO
B	20-02-04	AS BUILD	
A	02-12-03	REVISED	
O	30-10-03	FOR APPROVAL	

CUSTOMER : SLOVNAFT
PLANT : BRATISLAVA
: SLOVAKIA


REQ/ORDER NO. : SRA7011259

GENERAL DRAWINGS: PP3 UNIT ESD - 82AC023
LAY-OUT CABINET SECTION-1 AND 2



Honeywell
Safety Management Systems
's-Hertogenbosch The Netherlands

DATE:	30-10-03	BY:	BdJ
DRAWING NUMBER			
G1	530225	3	4
SERIAL CODE	PROJECT	SHEET	CONT'D

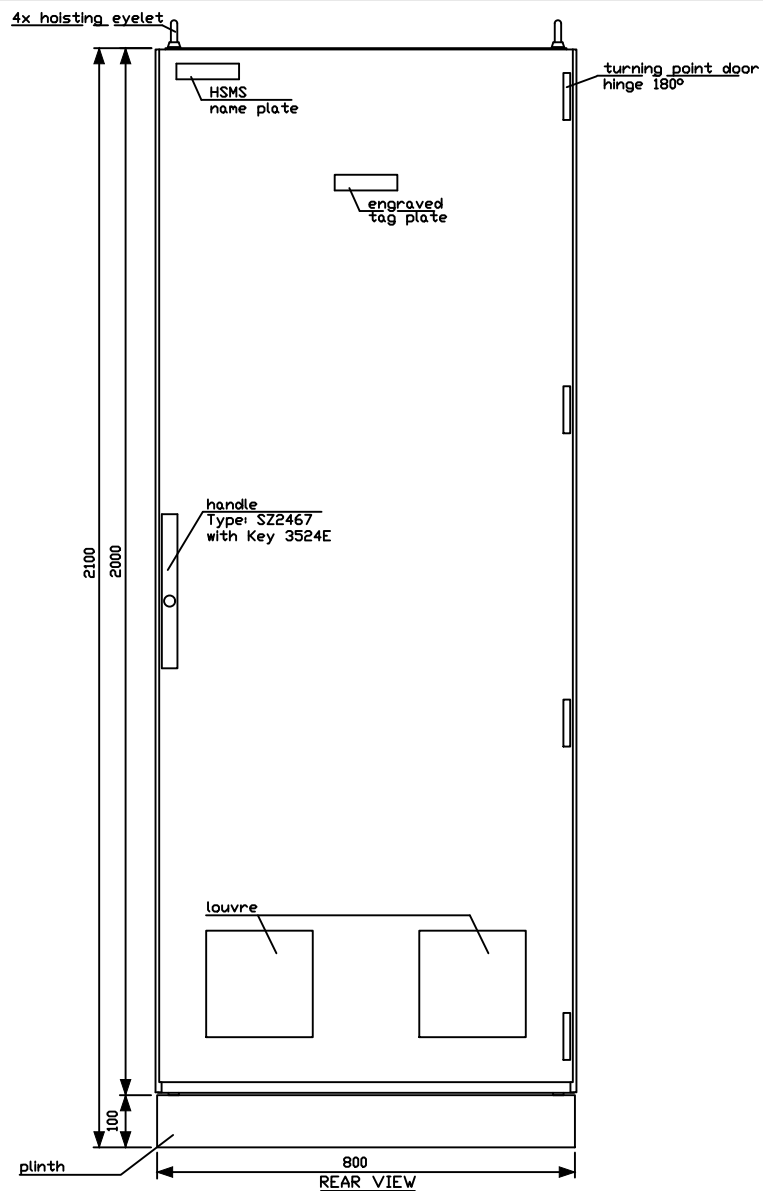

C	12-10-24	FSC-SM MIGRATION	PKO
B	20-02-04	AS BUILD	
A	02-12-03	REVISED	
O	30-10-03	FOR APPROVAL	
REV:	DATE:	DESCRIPTION	CHK'D


CUSTOMER : SLOVNAFT
 PLANT : BRATISLAVA
 : SLOVAKIA
 REQ/ORDER NO. : SRA7011259

GENERAL DRAWINGS: PP3 UNIT ESD - 82AC023,24
 LAY-OUT CABINET SECTION-1 AND 2




Honeywell
Safety Management Systems
 's-Hertogenbosch The Netherlands

DATE:	30-10-03	BY:	BdJ
DRAWING NUMBER			
G1	530225	4	5
SERIAL CODE	PROJECT	SHEET	CONT'D

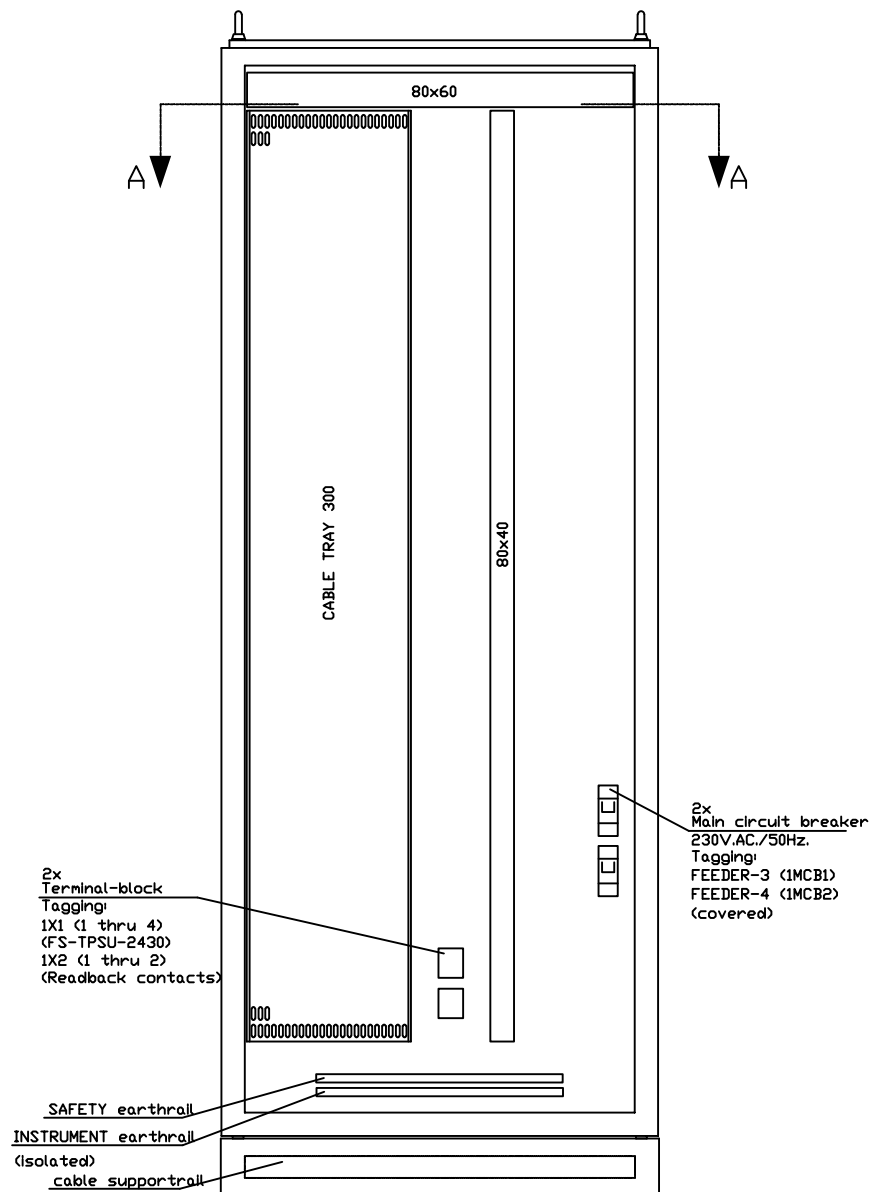

FRONT VIEW WITHOUT SWINGFRAME

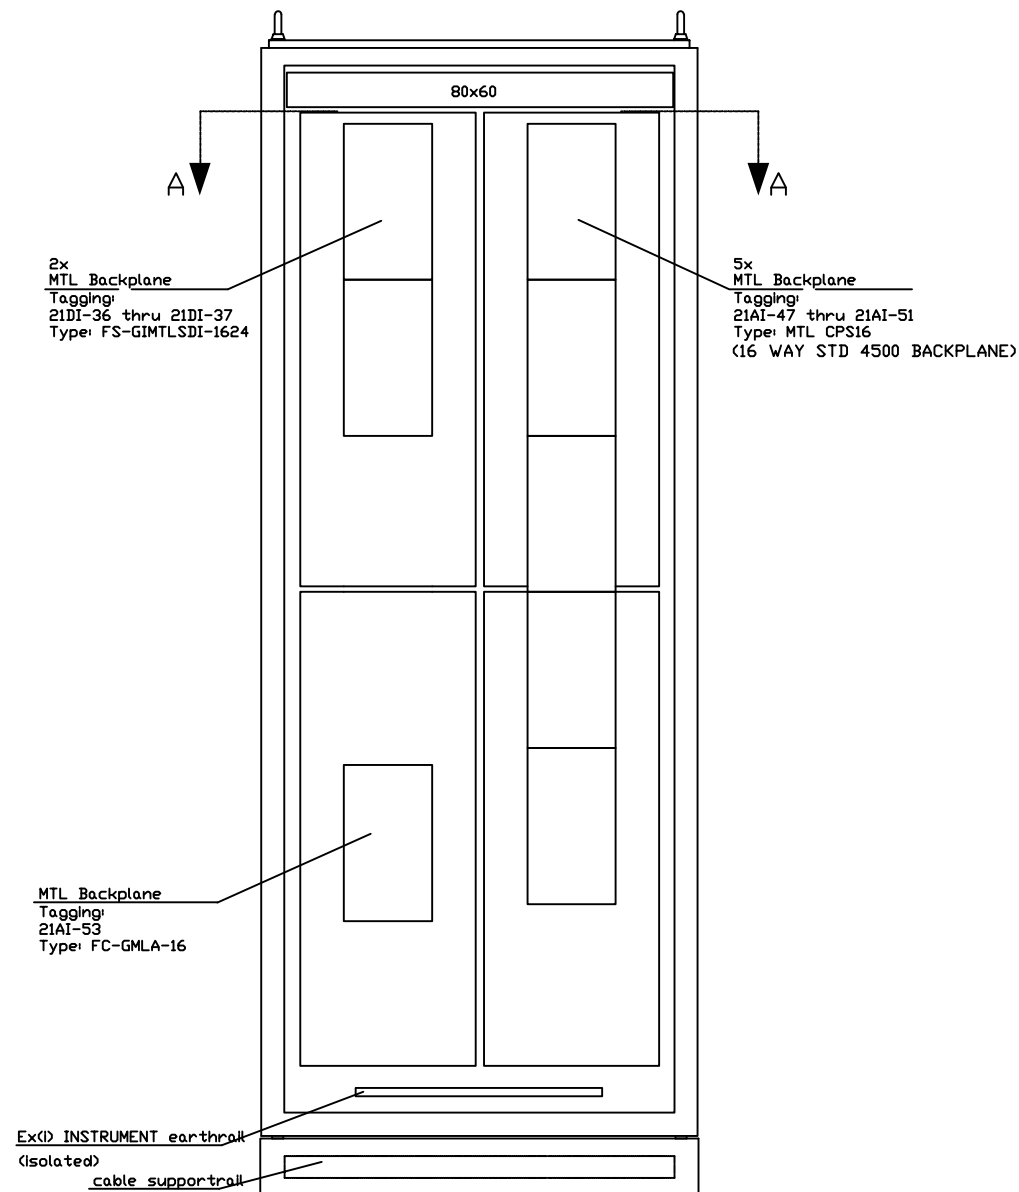

REAR VIEW WITHOUT DOOR(S)

D	30-09-26	INPUT REDUNDANCY	PKO
C	12-10-24	FSC-SM MIGRATION	PKO
B	20-02-04	AS BUILD	
A	02-12-03	REVISED	
O	30-10-03	FOR APPROVAL	
REV:	DATE:	DESCRIPTION	CHK'D


CUSTOMER : SLOVNAFT
PLANT : BRATISLAVA
: SLOVAKIA
REQ/ORDER NO. : SRA7011259

GENERAL DRAWINGS: PP3 UNIT ESD - 82AC023
LAY-OUT CABINET SECTION-1 AND 2



Honeywell
Safety Management Systems
's-Hertogenbosch The Netherlands

DATE:	30-10-03	BY:	BdJ
DRAWING NUMBER			
G1	530225	5	6
SERIAL CODE	PROJECT	SHEET	CONT'D

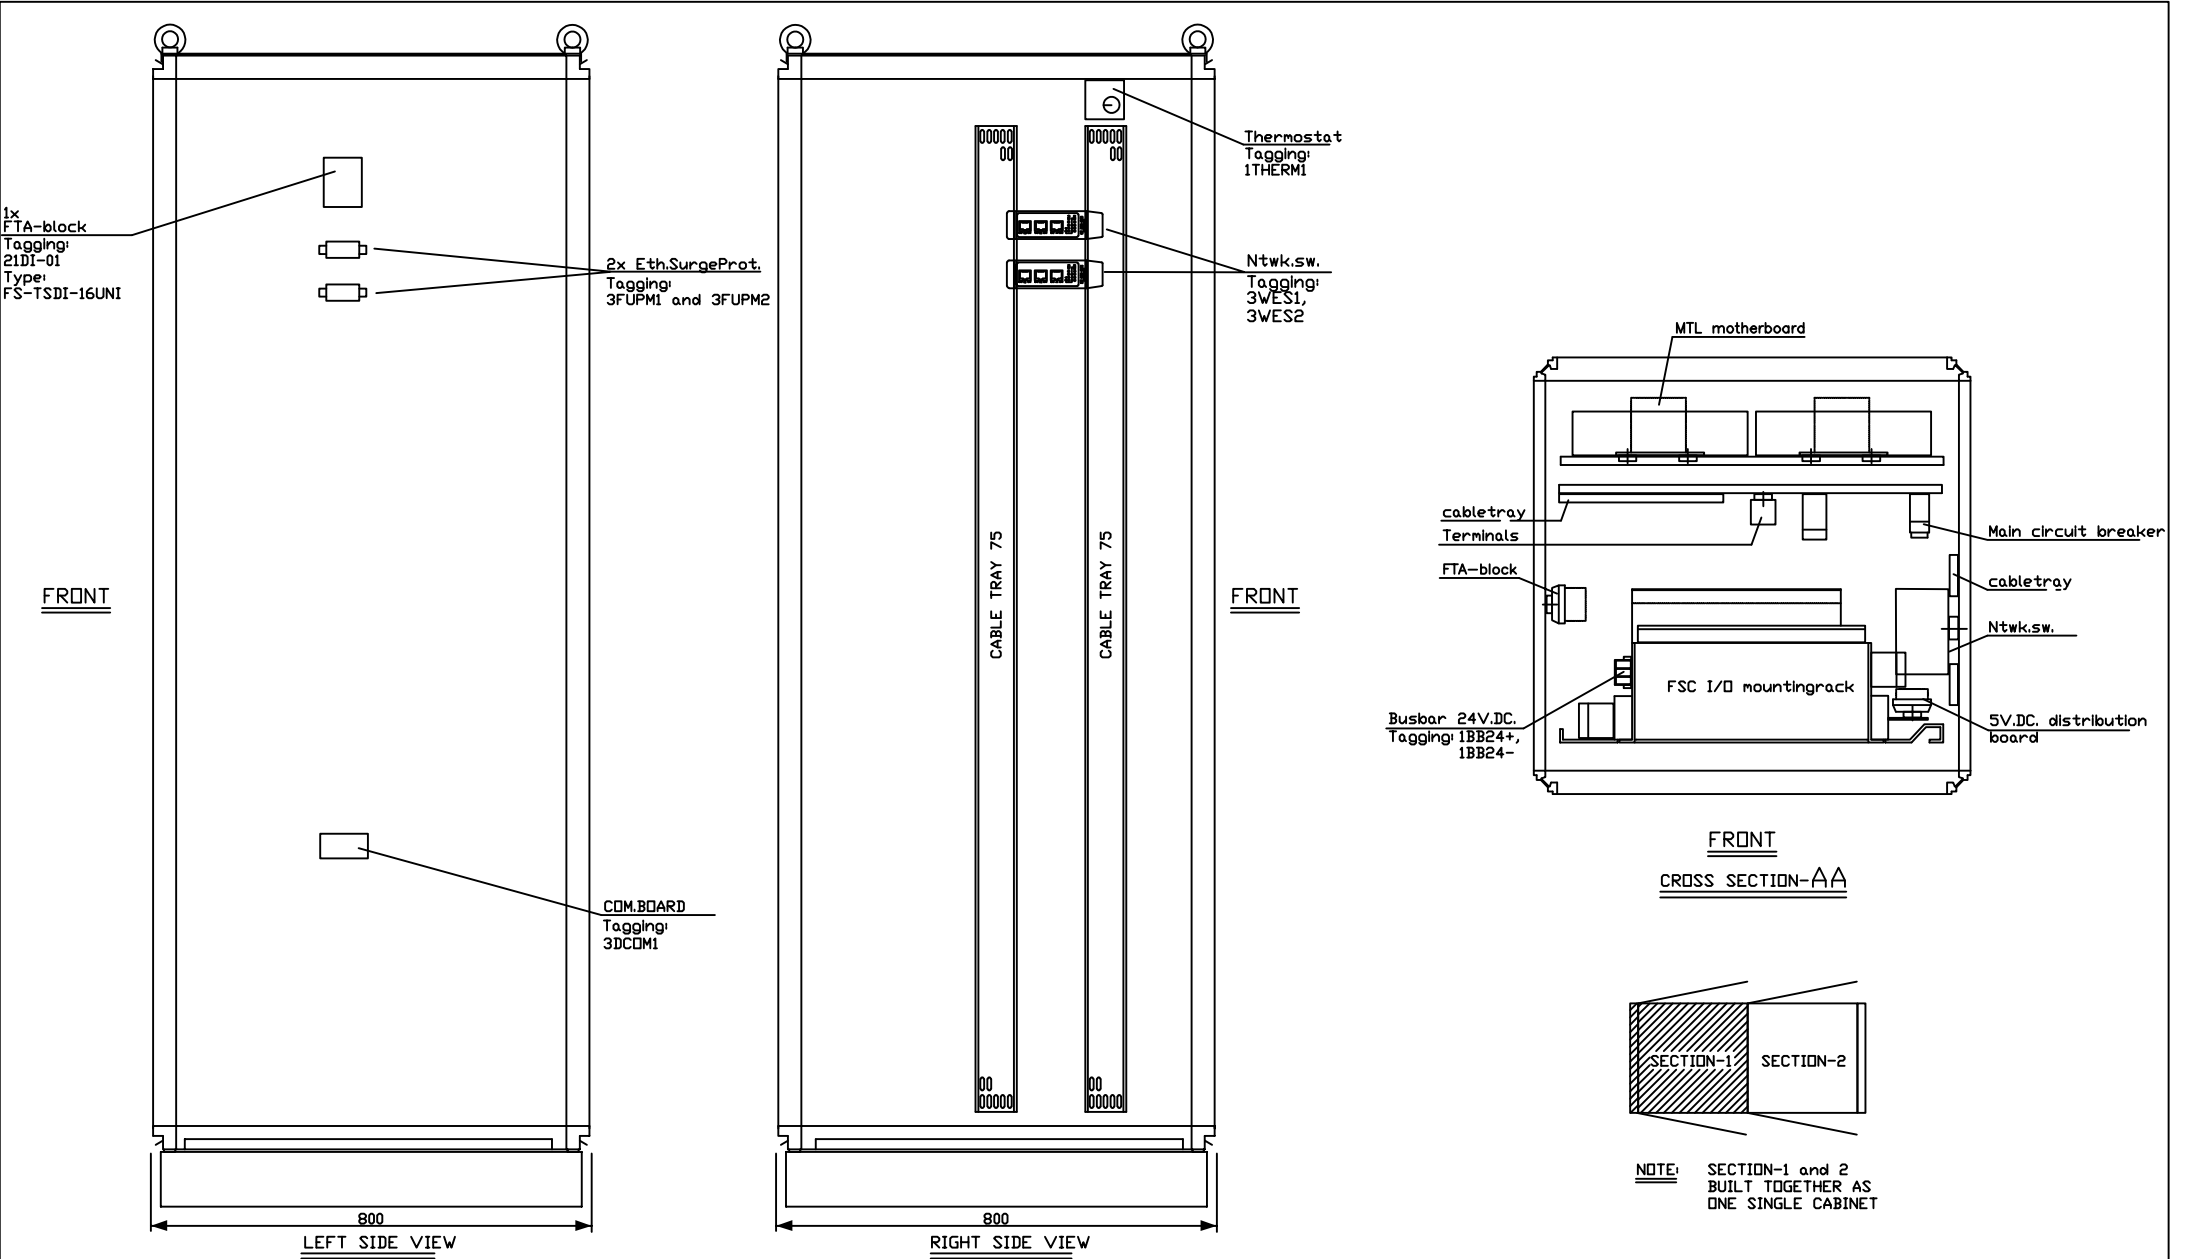

REV:	DATE:	DESCRIPTION	CHK'D
C	12-10-24	FSC-SM MIGRATION	PKO
B	20-02-04	AS BUILT	
A	02-12-03	REVISED	
0	30-10-03	FOR APPROVAL	

CUSTOMER : SLOVNAFT
PLANT : BRATISLAVA
: SLOVAKIA

REQ/ORDER NO. : SRA7011259

GENERAL DRAWINGS: PP3 UNIT ESD – 82AC023
LAY-OUT CABINET



Honeywell

Safety Management Systems

's-Hertogenbosch The Netherlands



DATE: 30-10-03

BY: BdJ

DRAWING NUMBER

G153022567

SERIAL CODEPROJECTSHEETCONT'D

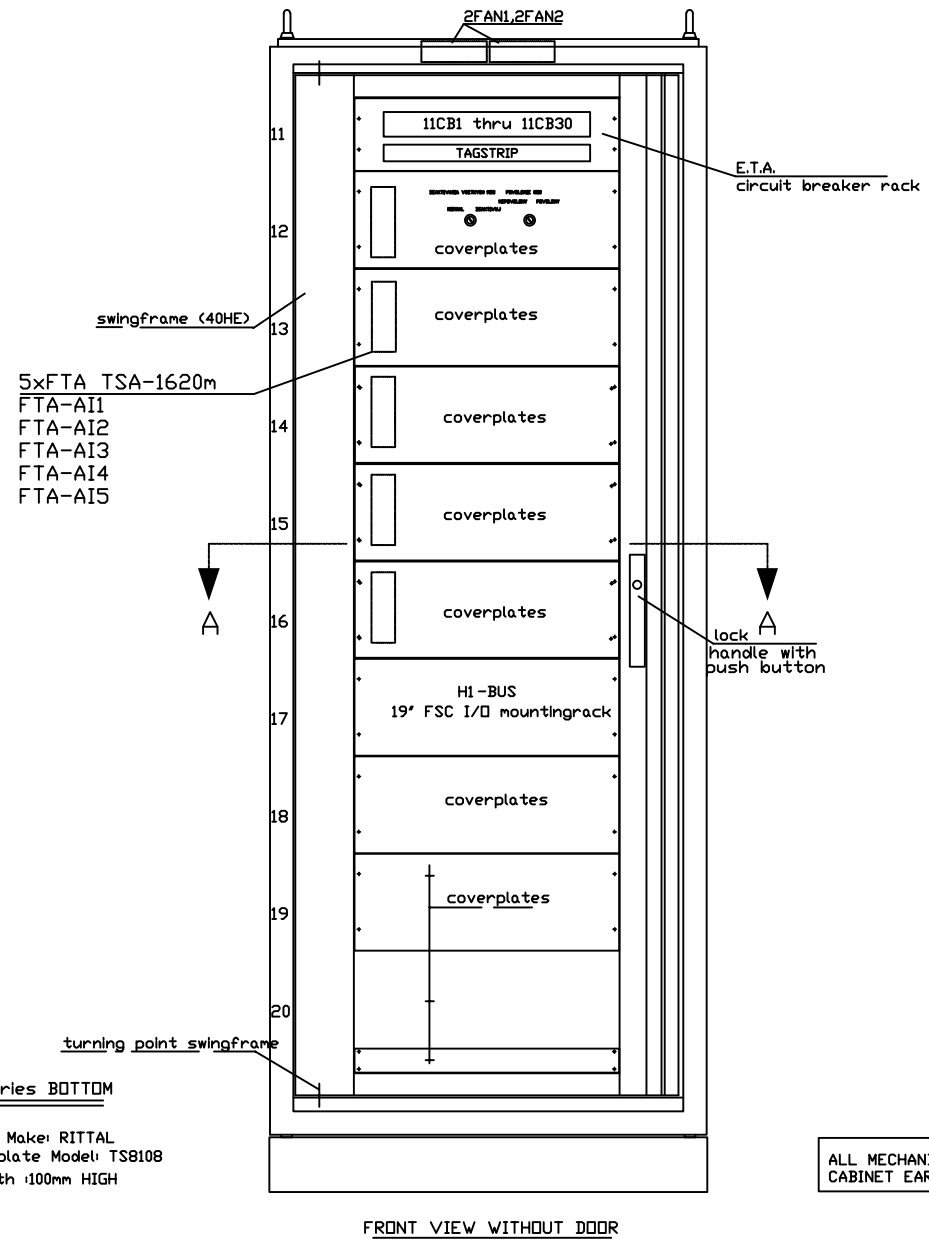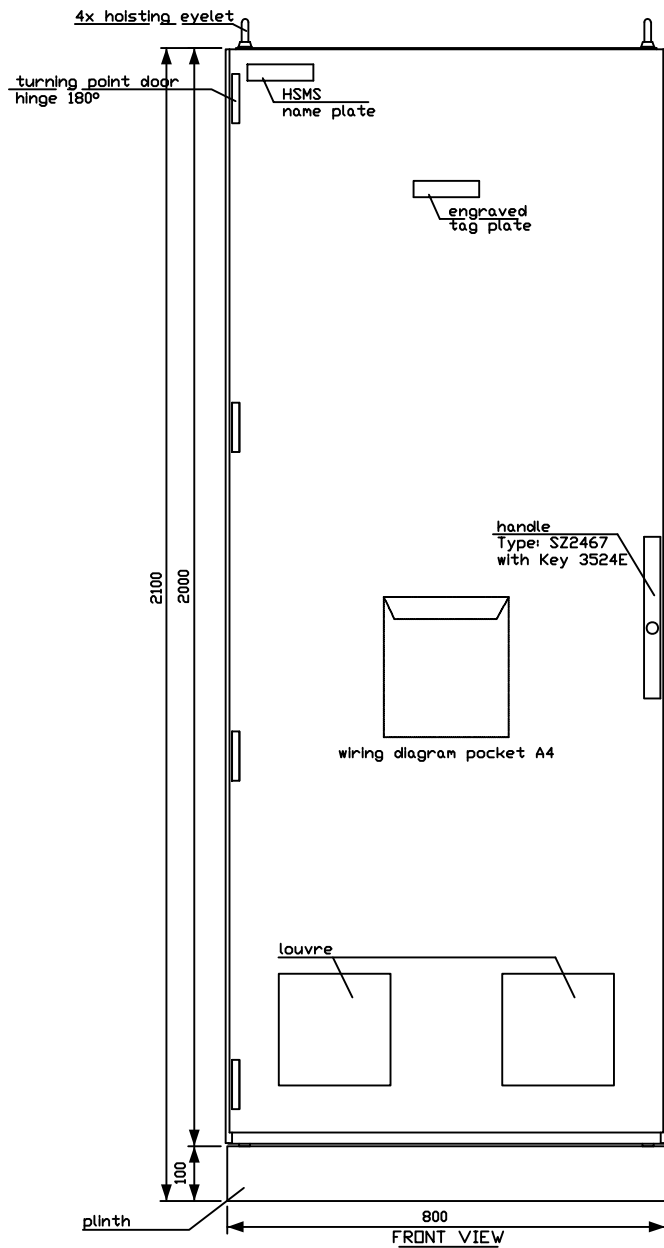

CABINET Model: TS8808 Make: RITTAL
complete with: -1 sideplate Model: TS8108
- plinth 100mm HIGH

ALL MECHANICAL PARTS OF
CABINET EARTHED

REV:	DATE:	DESCRIPTION	CHK'D
D	30-09-26	INPUT REDUNDANCY	PKO
C	12-10-24	FSC-SM MIGRATION	PKO
B	20-02-04	AS BUILD	
A	02-12-03	REVISED	
O	30-10-03	FOR APPROVAL	

CUSTOMER : SLOVNAFT
PLANT : BRATISLAVA
: SLOVAKIA


REQ/ORDER NO. : SRA7011259

GENERAL DRAWINGS: PP3 UNIT ESD - 82AC024
LAY-OUT CABINET SECTION-1 AND 2



Honeywell
Safety Management Systems
's-Hertogenbosch The Netherlands

DATE:	30-10-03	BY:	BdJ
DRAWING NUMBER			
G1	530225	7	8
SERIAL CODE	PROJECT	SHEET	CONT'D

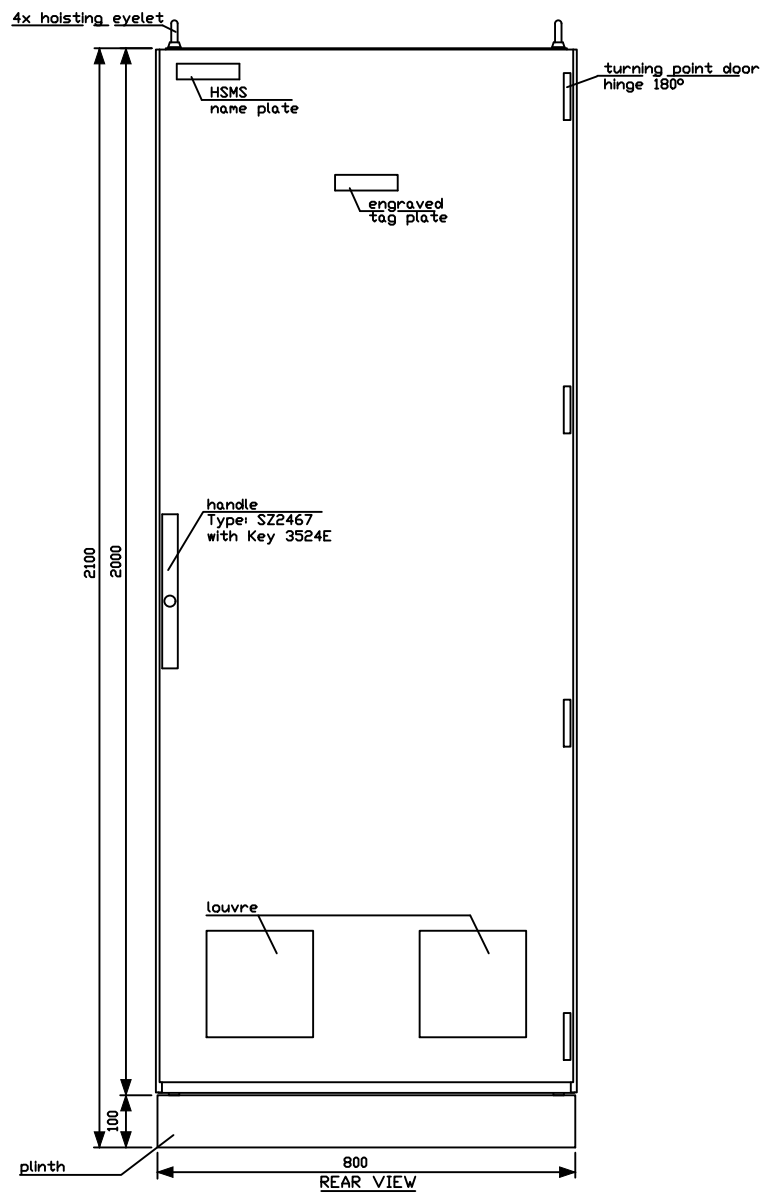


CUSTOMER : SLOVNAFT
PLANT : BRATISLAVA
: SLOVAKIA
REQ/ORDER NO. : SRA7011259


GENERAL DRAWINGS: PP3 UNIT ESD - 82AC023,24
LAY-OUT CABINET SECTION-1 AND 2

	Honeywell		DATE: 30-10-03		BY: BdJ	
	Safety Management Systems		DRAWING NUMBER			
	's-Hertogenbosch The Netherlands		G1	530225	8	9
			SERIAL CODE	PROJECT	SHEET	CONT'D

C	12-10-24	FSC-SM MIGRATION	PKO
B	20-02-04	AS BUILD	
A	02-12-03	REVISED	
O	30-10-03	FOR APPROVAL	
REV:	DATE:	DESCRIPTION	CHK'D

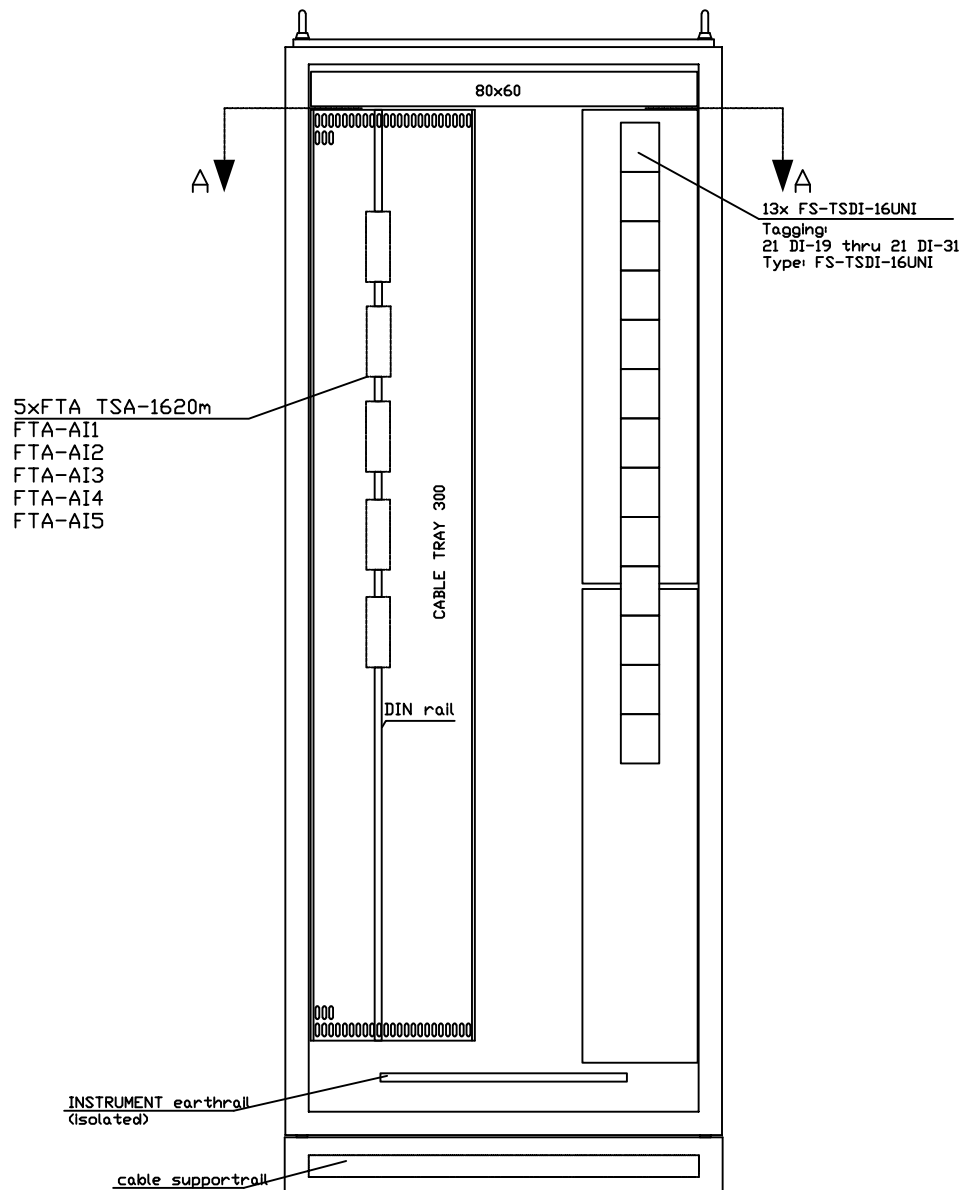

FRONT VIEW WITHOUT SWINGFRAME

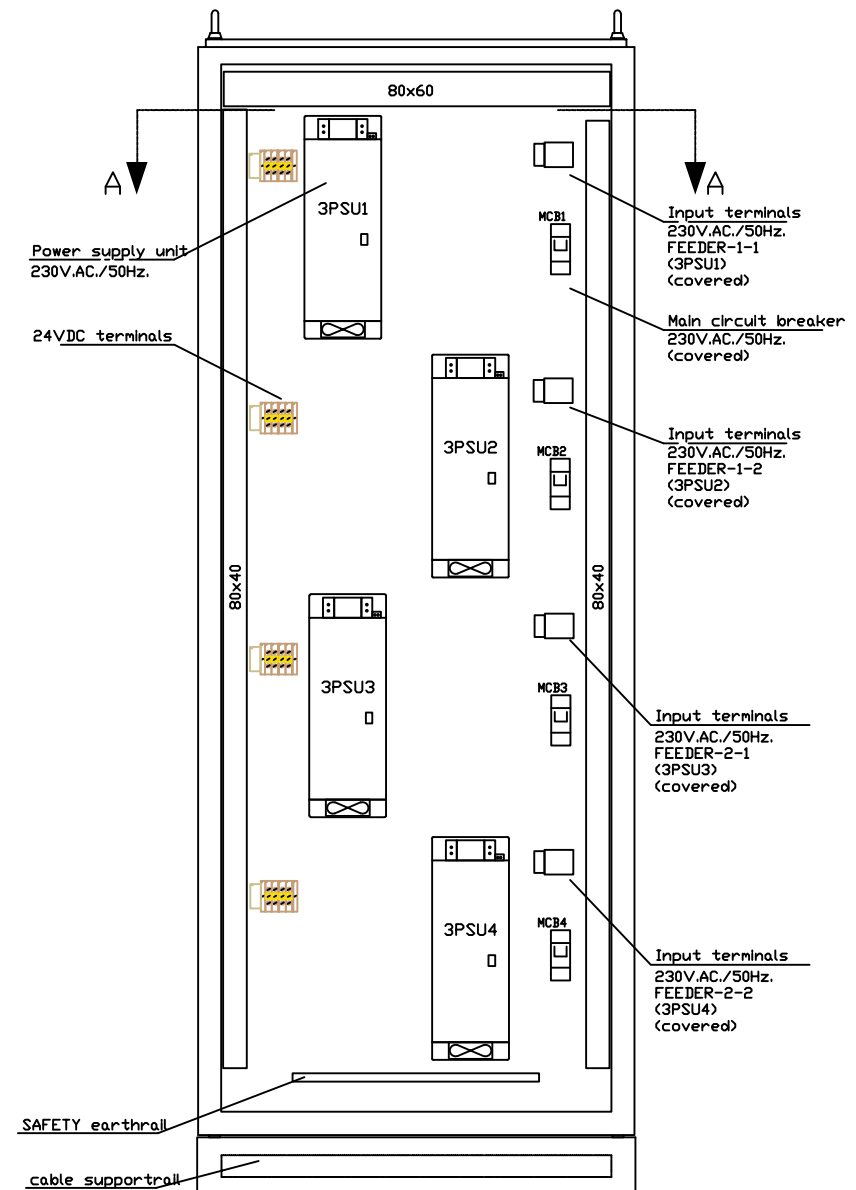

REAR VIEW WITHOUT DOOR(S)

REV:	DATE:	DESCRIPTION	CHK'D
D	30-09-26	INPUT REDUNDANCY	PKO
C	12-10-24	FSC-SM MIGRATION	PKO
B	20-02-04	AS BUILD	
A	02-12-03	REVISED	
O	30-10-03	FOR APPROVAL	

CUSTOMER : SLOVNAFT
PLANT : BRATISLAVA
: SLOVAKIA

REQ/ORDER NO. : SRA7011259


GENERAL DRAWINGS: PP3 UNIT ESD - 82AC024
LAY-OUT CABINET SECTION-1 AND 2



Honeywell
Safety Management Systems
's-Hertogenbosch The Netherlands


DATE:	30-10-03	BY:	BdJ
DRAWING NUMBER			
G1	530225	9	10
SERIAL CODE	PROJECT	SHEET	CONT'D

FRONT

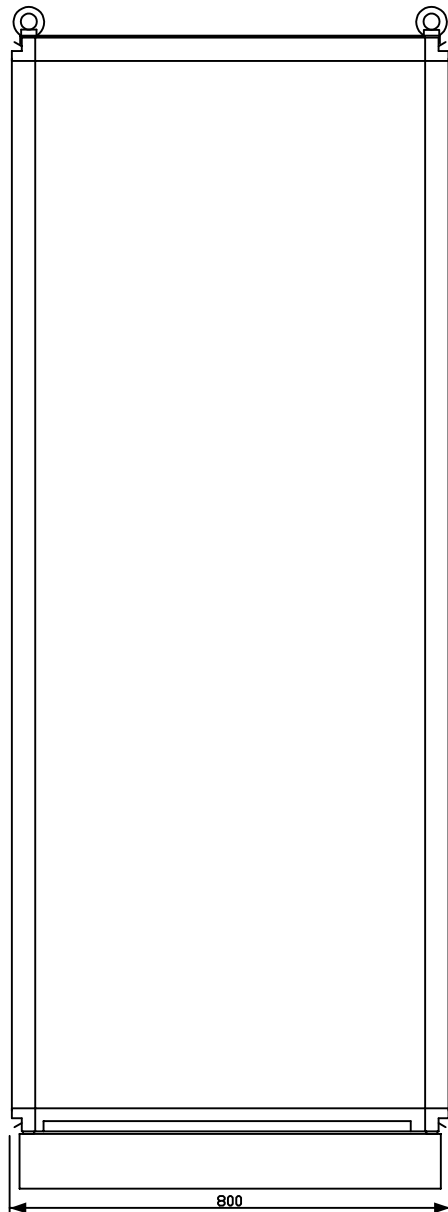


LEFT SIDE VIEW


FRONT

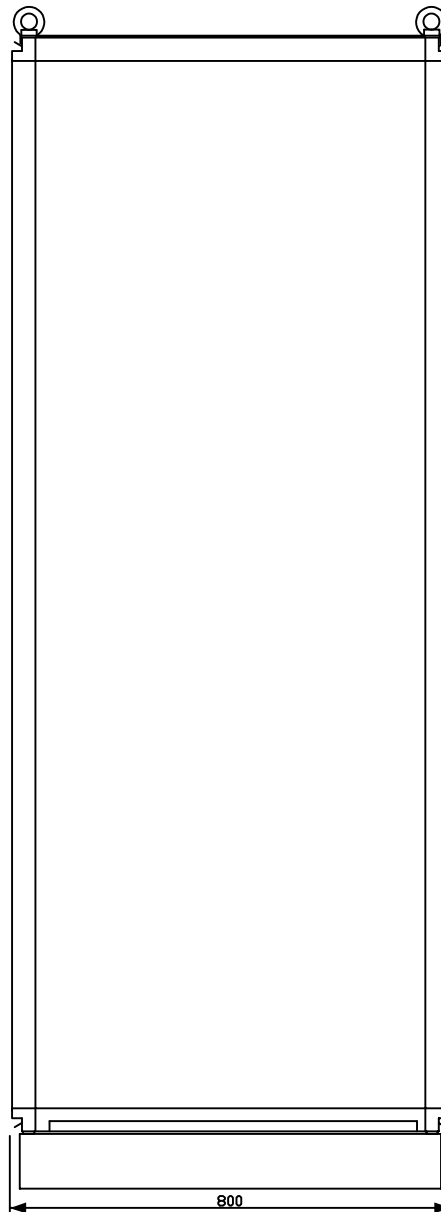

RIGHT SIDE VIEW

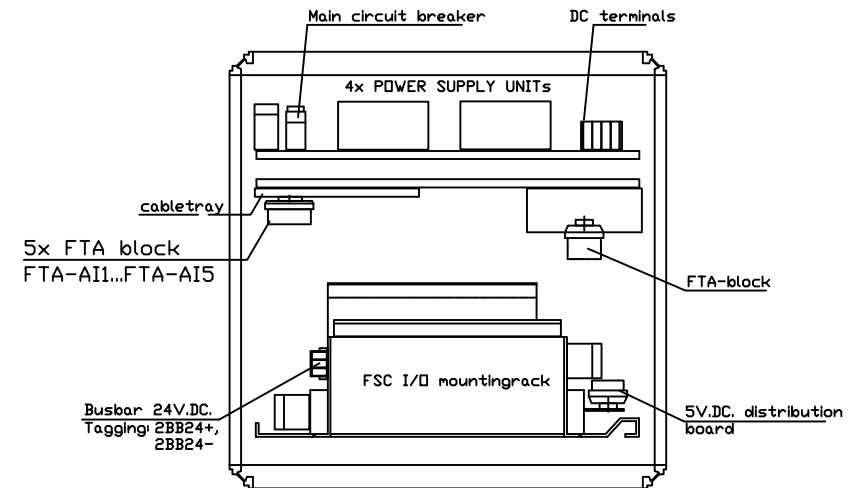

FRONT
CROSS SECTION-AA



NOTE: SECTION-1 and 2
BUILT TOGETHER AS
ONE SINGLE CABINET

D	30-09-26	INPUT REDUNDANCY	PKO
C	12-10-24	FSC-SM MIGRATION	PKO
B	20-02-04	AS BUILD	
A	02-12-03	REVISED	
O	30-10-03	FOR APPROVAL	
REV:	DATE:	DESCRIPTION	CHK'D



CUSTOMER : SLOVNAFT
PLANT : BRATISLAVA
: SLOVAKIA
REQ/ORDER NO. : SRA7011259

GENERAL DRAWINGS: PP3 UNIT ESD - 82AC024
LAY-OUT CABINET SECTION-1 AND 2



Honeywell
Safety Management Systems
's-Hertogenbosch The Netherlands

DATE: 30-10-03		BY: BdJ	
DRAWING NUMBER			
G1	530225	10	30
SERIAL CODE	PROJECT	SHEET	CONT'D

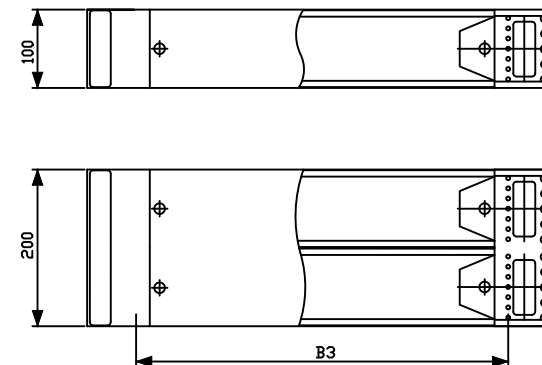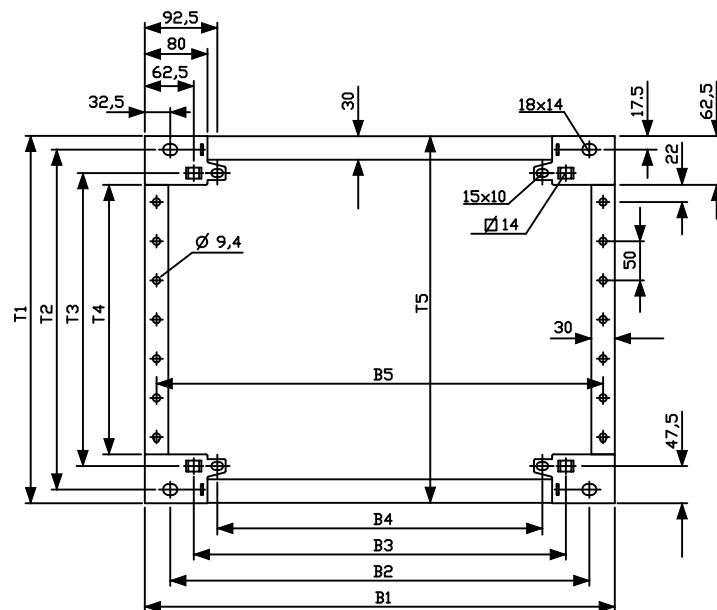

Plinth for TS8 cabinets

Description of the hole patterns

B1/T1 = External dimension

B2/T2= For screw-fixing in the thread of the enclosure corner piece from below

B3/T3= For screw-fixing with captive nuts to the enclosure base from below or above

All holes (B2 - B4 / T2 - T4) may be used for screw-fixing to the base.

Base/plinth components front/rear						Base/plinth trim, side					
Width mm	B1	B2	B3	B4	B5	Depth mm	T1	T2	T3	T4	T5
400	400	335	275	215	370	400	369	334	274	244	368
-	-	-	-	-	-	500	469	434	374	344	468
600	600	535	475	415	570	600	569	534	474	444	568
800	800	735	675	615	770	800	769	734	674	644	768
1000	1000	935	875	815	970	-	-	-	-	-	-
1200	1200	1135	1075	1015	1170	-	-	-	-	-	-

C	12-10-24	FSC-SM MIGRATION	PKO
B	20-02-04	AS BUILD	
A	02-12-03	REVISED	
O	30-10-03	FOR APPROVAL	
REV:	DATE:	DESCRIPTION	CHK'D

CUSTOMER : SLOVNAFT
PLANT : BRATISLAVA
: SLOVAKIA
REQ/ORDER NO. : SRA7011259

GENERAL DRAWINGS: PP3 UNIT ESD - 82AC023,24
LAY-OUT PLYNTH SECTION-1 AND 2



Honeywell
Safety Management Systems
's-Hertogenbosch The Netherlands

DATE:	30-10-03	BY:	BdJ
DRAWING NUMBER			
G1	530225	30	-
SERIAL CODE	PROJECT	SHEET	CONT'D

COMMUNICATION
PP3 ESD SYSTEM


NOTE: New made COM-drawing

				CUSTOMER : SLOVNAFT PLANT : BRATISLAVA : SLOVAKIA REQ/ORDER NO. :SRA7011259	COMMUNICATION		PP3 UNIT ESD	
					COVERSHEET			
B	12-10-24	FSC-SM MIGRATION	PKO		 Honeywell Safety Management Systems 's-Hertogenbosch The Netherlands	DATE: 10-11-2003		BY: JH
A	20-02-04	AS BUILD				DRAWING NUMBER		
O	03-12-03	FOR APPROVAL	JH			CM1	530225	1 2
REV:	DATE:	DESCRIPTION	CHK'D			SERIAL CODE	PROJECT	SHEET CONT'D

SHEET	REVISIONS			PAGE DESCRIPTION	DESCRIPTION
1	0	A	B	COVERSHEET	
2	0	A	B	INDEX SHEET	
5	0	A	B	LEGEND OF SYMBOLS	
6	0	A	B	LEGEND OF SYMBOLS	
11	0	A	B	COMMUNICATIONS ESD	


SHEET	REVISIONS			PAGE DESCRIPTION	DESCRIPTION
-------	-----------	--	--	------------------	-------------

				CUSTOMER : SLOVNAFT	COMMUNICATION INDEX SHEET	PP3 UNIT ESD
				PLANT : BRATISLAVA		
				: SLOVAKIA		
				REQ/ORDER NO. :SRA7011259		
B	12-10-24	FSC-SM MIGRATION	PKO		 Honeywell Safety Management Systems 's-Hertogenbosch The Netherlands	DATE: 10-11-2003 BY: JH
A	20-02-04	AS BUILD				DRAWING NUMBER
O	03-12-03	FOR APPROVAL	JH			CM1 530225 2 5
REV:	DATE:	DESCRIPTION	CHK'D			SERIAL CODE PROJECT SHEET CONT'D

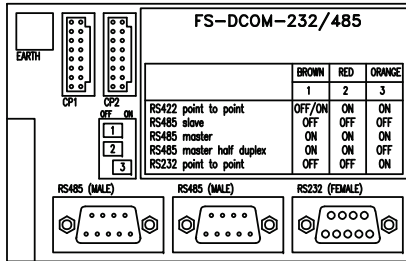

WHEN USING STANDARD ONE-ON-ONE CABLES (E.G. CABLE FS-CCE-485-01/LX), DIPSWITCH 1 OF THE DCOM-232/485 ON ONE SIDE MUST BE "ON" AND DIPSWITCH 1 OF THE OTHER DCOM-232/485 MUST BE OFF.

WHEN USING A CROSS-CABLE, DIPSWITCH 1 OF BOTH DCOM-232/485'S MUST BE OFF.





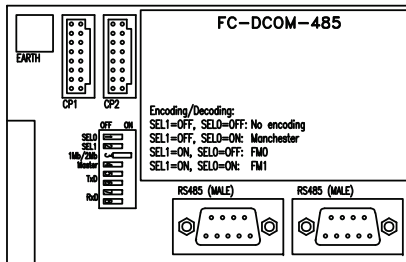


MODULATION/DEMULATION:
SWITCH 3 OFF: 1MBAUD MODULATION/DEMULATION
SWITCH 3 ON: ALL OTHER BAUD RATES

MASTER/SLAVE SELECTION:
SWITCH 4 OFF: NORMAL / SLAVE
SWITCH 4 ON: MASTER

LINE CONDITIONER:
SWITCH 5: PULL-DOWN ON PIN 7
SWITCH 6: PULL-UP ON PIN 3
SWITCH 7: PULL-DOWN ON PIN 8
SWITCH 8: PULL-UP ON PIN 4

ONLY THE LINE CONDITIONERS OF THE MASTER ARE CLOSED (ON); THE LINE CONDITIONERS ON ALL SLAVES STAY OPEN (OFF).
IN HALF DUPLEX MODE (2 WIRE) ONLY, SWITCH 5 AND 6 OF THE MASTER ARE CLOSED (ON); SWITCH 7 AND 8 STAY OPEN (OFF).

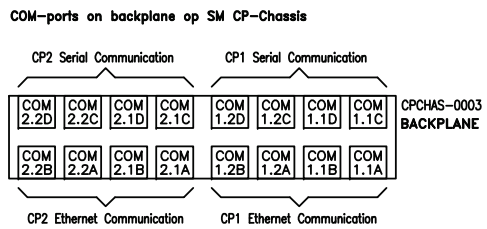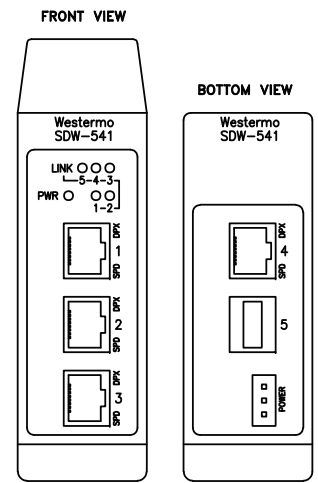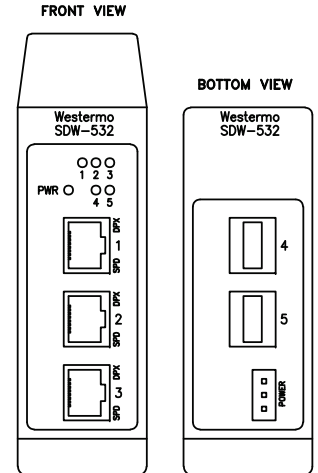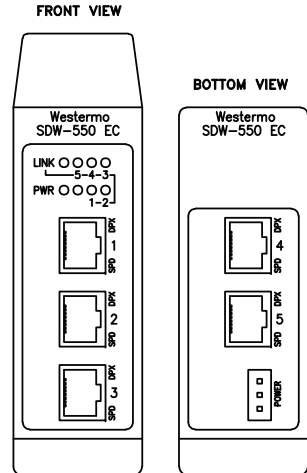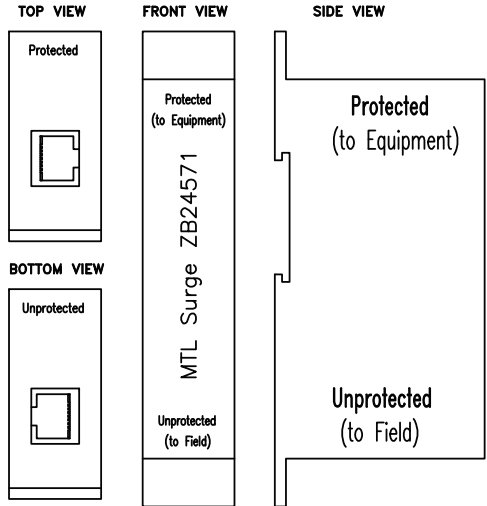

B	12-10-24	FSC-SM MIGRATION	PKO
A	20-02-04	AS BUILD	
O	03-12-03	FOR APPROVAL	JH
REV:	DATE:	DESCRIPTION	CHK'D

CUSTOMER PLANT : SLOVNAFT
: BRATISLAVA
: SLOVAKIA

REQ/ORDER NO. :SRA7011259

COMMUNICATION LEGEND OF SYMBOLS

Honeywell
Safety Management Systems
's-Hertogenbosch The Netherlands

DATE: 10-11-2003		BY: JH	
DRAWING NUMBER			
CM1	530225	5	6
SERIAL CODE	PROJECT	SHEET	CONT'D

PP3 UNIT ESD

DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL
TRI-STATE RS232C INTERFACE		CONVERTOR		RESISTOR		PROTECTIVE EARTH (SAFETY EARTH)			
GLASS FIBER INTERFACE		PC				INSTRUMENT EARTH			
RS422 INTERFACE WITH READ BACK		PRINTER				SHEET REFERENCE NUMBER			
ISOLATED RS485/422 INTERFACE		EXTERNAL DEVICE				CROSSING CONDUCTORS WITHOUT ELECTRIC CONNECTION			
FSC-SMM COMMUNICATION MODULE		UCN-TAB				JUNCTION OF CONDUCTORS			
ETHERNET COMMUNICATION MODULE		CONNECTOR UCN				JUNCTION OF CONDUCTORS WITH WIRE DIRECTION			
ETHERNET COMMUNICATION MODULE		CONNECTOR UCN							
COMMUNICATION BOARD RS232		END OF LINE TERMINATOR UCN							
COMMUNICATION BOARD RS485		ETHERNET-TAB							
JUMPER COMMUNICATION BOARD RS485		END OF LINE TERMINATOR ETHERNET WITH 50E RESISTOR							
COMMUNICATION CONNECTOR		END OF LINE TERMINATOR ETHERNET WITH 50E RESISTOR							
END OF LINE TERMINATOR RS485		DIPSWITCH IN EXAMPLE: S1,2,3=ON S4,5=OFF							
BYPASS TERMINATOR RS485									

B	12-10-24	FSC-SM MIGRATION	PKO
A	20-02-04	AS BUILD	
O	03-12-03	FOR APPROVAL	JH
REV:	DATE:	DESCRIPTION	CHK'D

CUSTOMER : SLOVNAFT
PLANT : BRATISLAVA
: SLOVAKIA
REQ/ORDER NO. :SRA7011259

COMMUNICATION LEGEND OF SYMBOLS




Honeywell
Safety Management Systems
's-Hertogenbosch The Netherlands

PP3 UNIT ESD

DATE:	10-11-2003	BY:	JH
DRAWING NUMBER			
CM1	530225	6	11
SERIAL CODE	PROJECT	SHEET	CONT'D

PP3 ESD

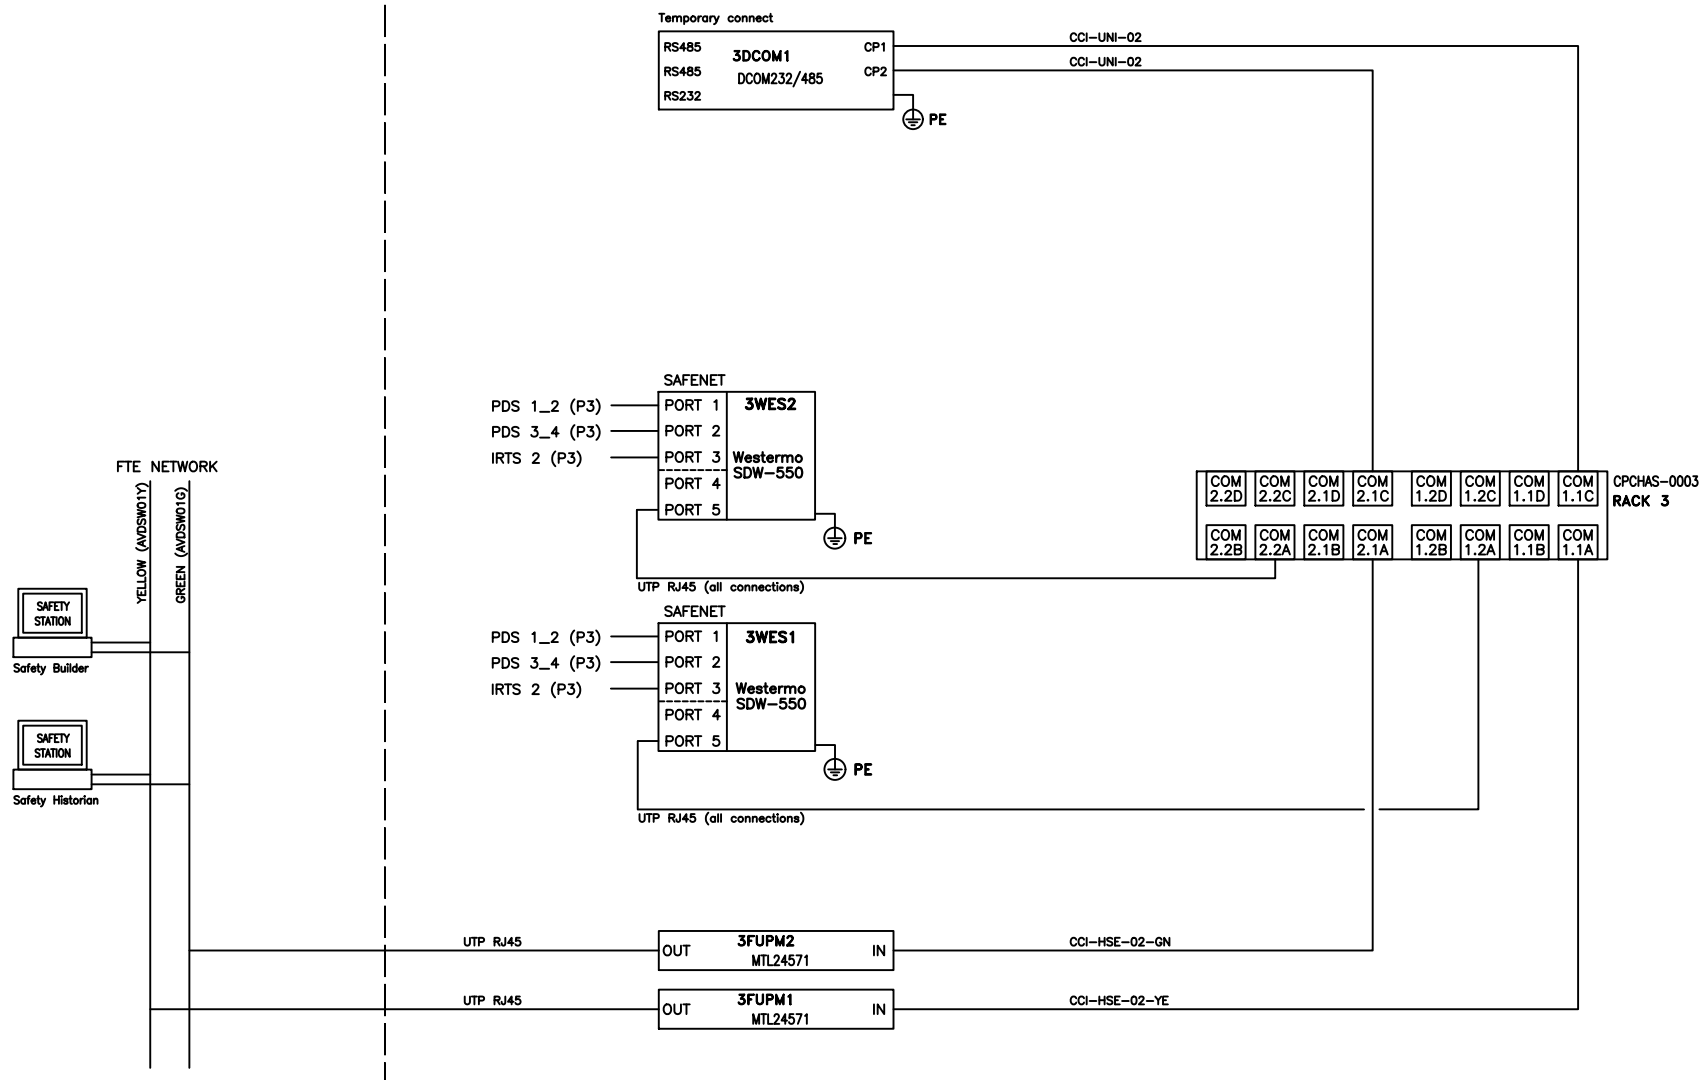

REV:	DATE:	DESCRIPTION	CHK'D
B	12-10-24	FSC-SM MIGRATION	PKO
A	20-02-04	AS BUILD	
0	03-12-03	FOR APPROVAL	JH

CUSTOMER : SLOVNAFT
PLANT : BRATISLAVA
: SLOVAKIA
REQ/ORDER NO. :SRA7011259

COMMUNICATION COMMUNICATIONS ESD

PP3 UNIT ESD



Honeywell
Safety Management Systems
's-Hertogenbosch The Netherlands

DATE:	10-11-2003	BY:	JH
DRAWING NUMBER			
CM1	530225	11	-
SERIAL CODE	PROJECT	SHEET	CONT'D

POWER DISTRIBUTION

PP3 UNIT ESD

				CUSTOMER : SLOVNAFT PLANT : BRATISLAVA : SLOVAKIA REQ/ORDER NO. :SRA7011259	POWER DISTRIBUTION COVERSHEET				PP3 UNIT ESD			
B	12-10-24	FSC-SM MIGRATION	PKO		 Honeywell Safety Management Systems 's-Hertogenbosch The Netherlands	DATE: 02-12-03		BY: BdJ				
A	20-02-03	AS BUILD				DRAWING NUMBER						
0	02-12-03	FOR APPROVAL				PD1	530225	1	2			
REV:	DATE:	DESCRIPTION	CHK'D			SERIAL CODE	PROJECT	SHEET	CONT'D			

SHEET	REVISIONS		PAGE DESCRIPTION
1	0	A	COVERSHEET
2	0	A	INDEX SHEET
6	0	A	LEGEND OF SYMBOLS
7	0	A	LEGEND OF SYMBOLS
8	0	A	LEGEND OF SYMBOLS
11	0	A	230 VAC 50 Hz / 24 VDC
12	0	A	24 VDC
21	0	A	24 VDC
22	0	A	24 VDC
23	0	A	24 VDC
24	0	A	24 VDC
31	0	A	5 VDC
32	0	A	5 VDC
36	0	A	CABINET UTILITY ALARMS
41	0	A	EARTHING
46	0	A	VERTICAL BUS FLATCABLES

SHEET	REVISIONS		PAGE DESCRIPTION
-------	-----------	--	------------------

B	12-10-24	FSC-SM MIGRATION	PKO
A	20-02-03	AS BUILD	
0	02-12-03	FOR APPROVAL	
REV:	DATE:	DESCRIPTION	CHK'D

CUSTOMER : SLOVNAFT
PLANT : BRATISLAVA
: SLOVAKIA
REQ/ORDER NO. :SRA7011259

POWER DISTRIBUTION INDEX SHEET

PP3 UNIT ESD



Honeywell
Safety Management Systems
's-Hertogenbosch The Netherlands

DATE:	02-12-03	BY:	BdJ
DRAWING NUMBER			
PD1	530225	2	6
SERIAL CODE	PROJECT	SHEET	CONT'D

GENERAL NOTES:

RELAY SOLENOIDS AND ALL INSTRUMENT SWITCHES
ARE SHOWN IN THE FOLLOWING STATUS:

A RELAY CONTACTS AND SOLENOIDS ARE SHOWN
IN DE-ENERGIZED STATE.

B ALL INSTRUMENT SWITCHES ARE SHOWN IN
POSITIONS CORRESPONDING TO:
– NO FLOW, NO LEVEL, NO SMOKE, NO GAS, NO FIRE
– AMBIENT TEMPERATURE
– AMBIENT PRESSURE

C OVERRIDE SWITCHES ARE SHOWN IN NON-OVERRIDING
POSITION

D TRIP SWITCHES ARE SHOWN IN NORMAL POSITION

CODES:

AI = ANALOG INPUT
AO = ANALOG OUTPUT
BB = BUSBAR
CB = CIRCUIT BREAKER
CBR = CIRCUIT BREAKER RACK
CN = I/O BACKPLANE CONNECTOR
COM = COMMUNICATION MODULE
COMB = COMMUNICATION BOARD
DI = DIGITAL INPUT
DO = DIGITAL OUTPUT
DS = DOOR SWITCH
EI = INTRINSICALLY SAFE INPUT
EL = ENCLOSURE LIGHT
ELD = EARTH LEAKAGE DETECTOR
EO = INTRINSICALLY SAFE OUTPUT

CODES:

FT = FUSED TERMINAL
FO = FIBER OPTIC CONVERTER
HBD = HORIZONTAL BUS DRIVER
L = LED/LAMP
MCB = MAIN CIRCUIT BREAKER
MB = MAIN BUSBAR
OL = OUTLET SOCKET
P = PROGRAMMING CONNECTOR
PB = PUSH-BUTTON
PSD = POWER SUPPLY DISTRIBUTION
PSU = POWER SUPPLY UNIT
R = RACK
RA = ANALOG INPUT CONVERTER
RB = RELAY BOARD
RO = RELAY OUTPUT

CODES:

S = SWITCH
SB = SYSTEM BUS
SIF = SUPPLY INPUT FILTER
SW = SYSTEM SWITCH
T = BACKPLANE FASTON
TB = TERMINAL BLOCK
V = VOLTAGE MONITORING
VBD = VERTICAL BUS DRIVER
WD = WATCHDOG
WDR = WATCHDOG REPEATER
WDD = WATCHDOG DISTRIBUTION MODULE
X = TERMINAL

COLOUR CODE WIRING:

5 VDC = PINK
0 VDC (5 VDC) = PURPLE
WATCHDOG = GREY

24 VDC = RED
0 VDC (24 VDC) = BLACK

48 VDC = ORANGE
0 VDC (48 VDC) = BLACK

PHASE = BROWN
NEUTRAL = LIGHT BLUE
SAFETY EARTH = GREEN/YELLOW
INSTRUMENT EARTH = YELLOW/BLACK

SIGNAL WIRING:

NON-I.S. = GREY
I.S. = BLUE

CIRCUIT BREAKER RACK NUMBERING:

11 CB
EQUIPMENT CODE
RACK NUMBER

MODULE IDENTIFICATION:

2 WD 14
POSITION
MODULE CODE
RACK NUMBER

**BACKPLANE CONNECTION NUMBERING
(FOR POWER CONNECTION):**

R3 / T12-2
FASTON NUMBER
RACK NUMBER

VERTICAL BUS NUMBERING:

VBUSx/x/xx
SEE HARDWARE MANUAL

WIRE INFO:

2.5 GAUGE

WIRE GAUGE:

0.44 = 0.44 mm2
1 = 1.0 mm2
2.5 = 2.5 mm2
4 = 4.0 mm2
6 = 6.0 mm2
16 = 16.0 mm2
35 = 35.0 mm2

A21 = AWG21 (± 0.44 mm2)
A18 = AWG18 (± 0.75 mm2)
A16 = AWG16 (± 1.0 mm2)
A14 = AWG14 (± 2.5 mm2)
A12 = AWG12 (± 4.0 mm2)
A10 = AWG10 (± 6.0 mm2)
A8 = AWG8 (± 10.0 mm2)
A6 = AWG6 (± 16.0 mm2)
A4 = AWG4 (± 20.0 mm2)

CIRCUIT BREAKER NUMBERING:

11 CB 1
SEQUENCE NUMBER
EQUIPMENT CODE
RACK NUMBER

EQUIPMENT IDENTIFICATION:

1 PSU 1
SEQUENCE NUMBER
EQUIPMENT CODE
CABINET NUMBER

**BACKPLANE CONNECTION NUMBERING
(FOR POWER CONNECTION):**

R6 / CN15
CONNECTOR NUMBER
RACK NUMBER

SHEET TRANSFER:

S 11 / 23 1
SEQUENCE NUMBER
REFERENCE SHEET NUMBER
SHEET NUMBER

B	12-10-24	FSC-SM MIGRATION	PKO
A	20-02-03	AS BUILD	
0	02-12-03	FOR APPROVAL	
REV:	DATE:	DESCRIPTION	CHK'D

CUSTOMER : SLOVNAFT
PLANT : BRATISLAVA
: SLOVAKIA
REQ/ORDER NO. : SRA7011259









**POWER DISTRIBUTION
LEGEND OF SYMBOLS**

Honeywell
Safety Management Systems
's-Hertogenbosch The Netherlands

PP3 UNIT ESD

DATE:	02-12-03	BY:	BdJ
DRAWING NUMBER			
PD1	530225	7	8
SERIAL CODE	PROJECT	SHEET	CONT'D

NUMBER	NAME	CONNECTION	LENGTH	METER (FEET)
1	WD1/125	10313/1/1 - 10314/1/1	1.25m	(±4.10ft)
2	WD1/175	10313/1/1 - 10314/1/1	1.75m	(±5.74ft)
3	WD2/125	10313/1/1 - 10315/1/1	1.25m	(±4.10ft)
4	WD2/175	10313/1/1 - 10315/1/1	1.75m	(±5.74ft)
5	WD-WD	10313/1/1 - 10313/1/1	4.00m	(±13.12ft)
6	WDR	10313/1/1 - 10302/2/1	2.00m	(±6.56ft)
7	WDG-C	10313/1/1 - 10005/0/2	1.00m	(±3.28ft)
7	WDG-C	10313/1/1 - 10005/0/3	1.00m	(±3.28ft)
8	ESD/RESET	10005/0/2 - 10311/2/1	1.50m	(±4.92ft)
8	ESD/RESET	10005/0/3 - 10311/2/1	1.50m	(±4.92ft)

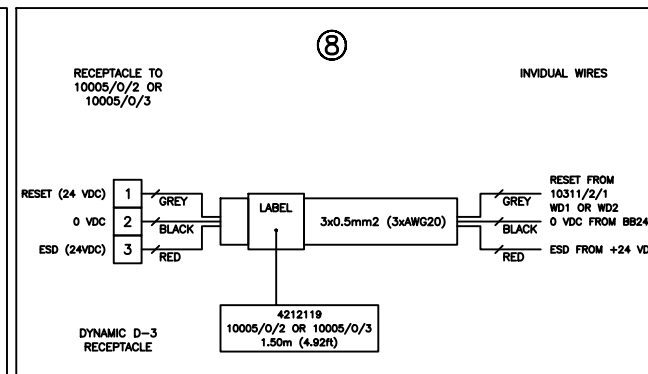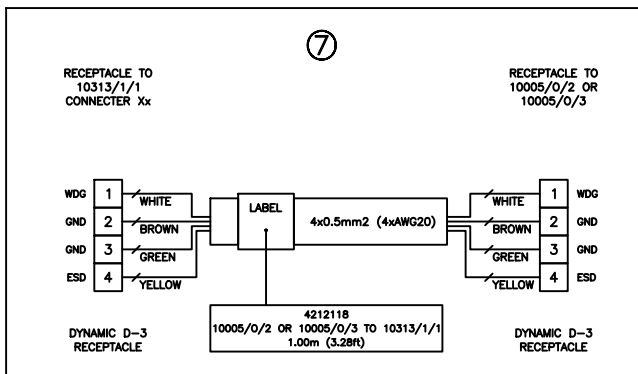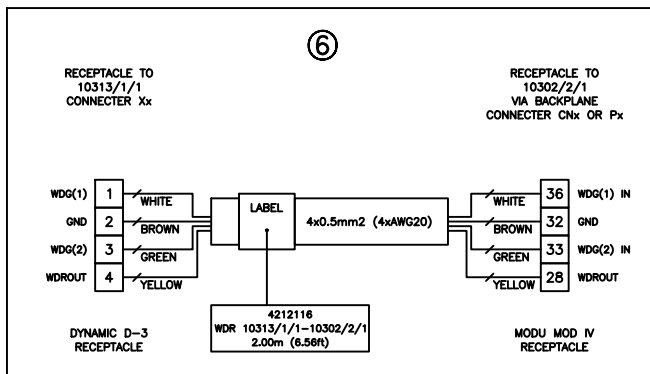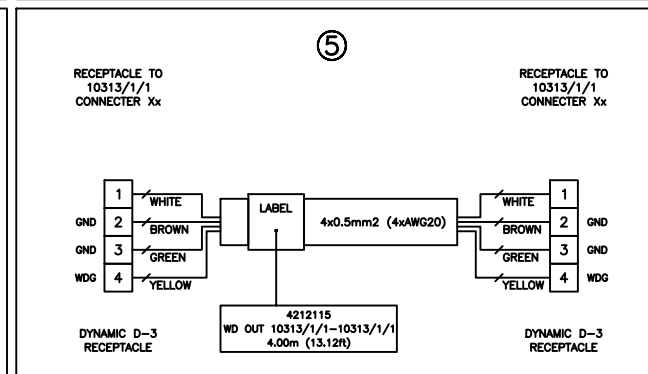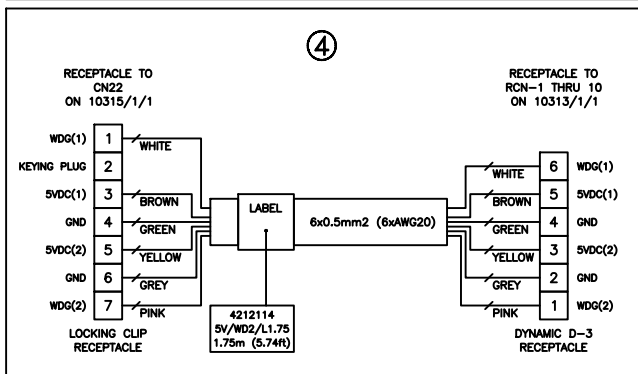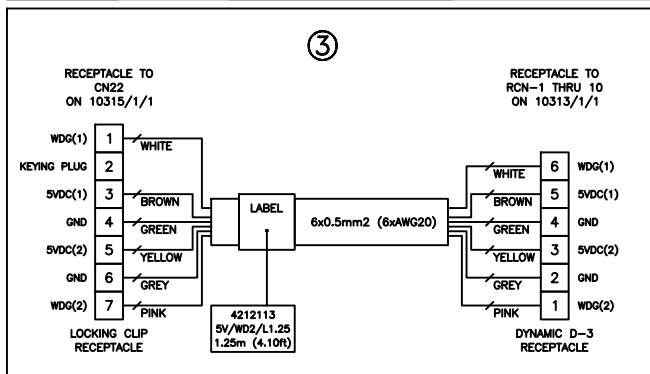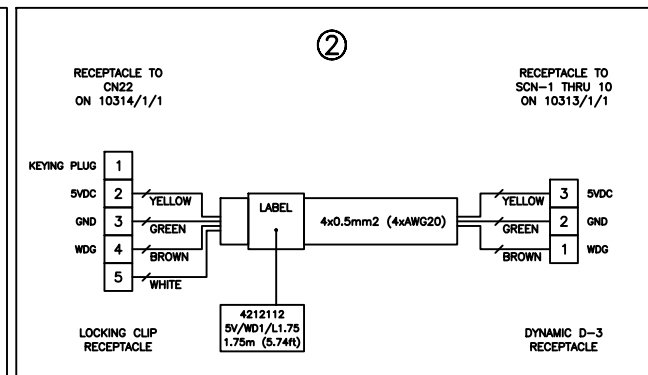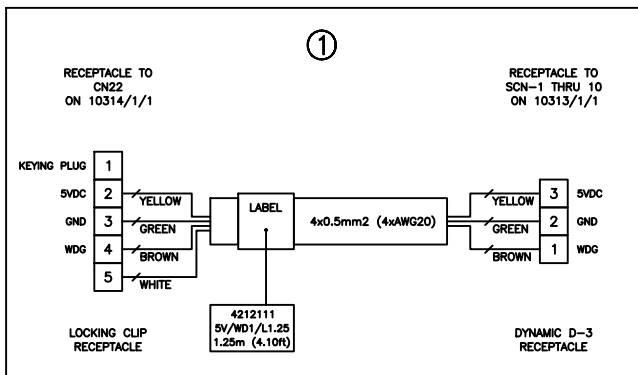

B	12-10-24	FSC-SM MIGRATION	PKO
A	20-02-03	AS BUILD	
O	02-12-03	FOR APPROVAL	
REV:	DATE:	DESCRIPTION	CHK'D

CUSTOMER : SLOVNAFT
PLANT : BRATISLAVA
: SLOVAKIA
REQ/ORDER NO. :SRA7011259


POWER DISTRIBUTION LEGEND OF SYMBOLS



Honeywell
Safety Management Systems
's-Hertogenbosch The Netherlands


PP3 UNIT ESD

DATE:	02-12-03	BY:	BdJ
DRAWING NUMBER			
PD1	530225	8	11
SERIAL CODE	PROJECT	SHEET	CONT'D

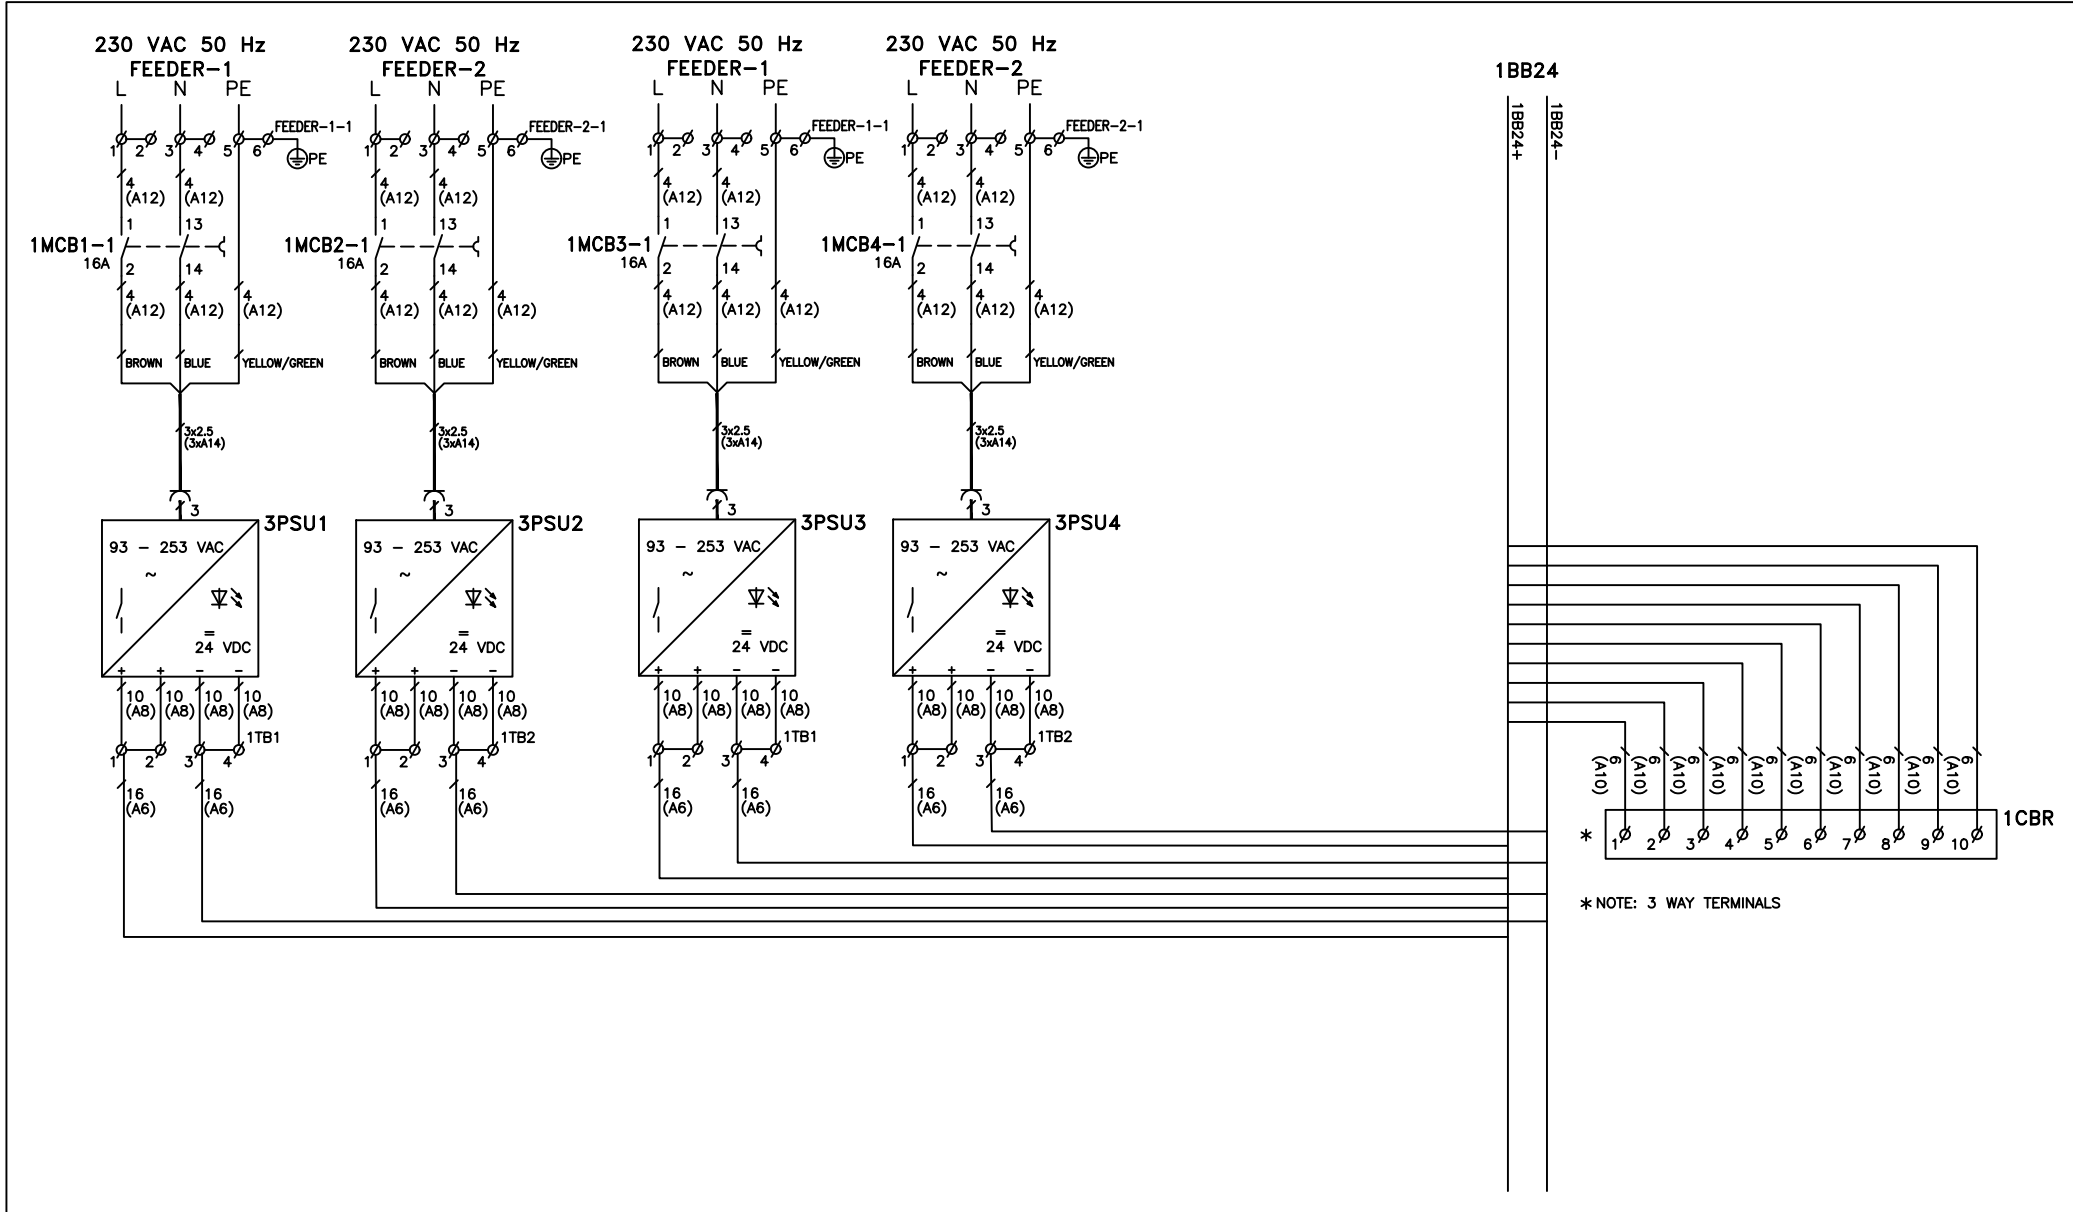


				CUSTOMER	: SLOVNAFT	POWER DISTRIBUTION	PP3 UNIT ESD
				PLANT	: BRATISLAVA	230 VAC 50 Hz / 24 VDC	
					: SLOVAKIA		
B	12-10-24	FSC-SM MIGRATION	PKO	REQ/ORDER NO.	:SRA7011259		
A	20-02-03	AS BUILD					
O	02-12-03	FOR APPROVAL					
REV:	DATE:	DESCRIPTION	CHK'D				

 Honeywell Safety Management Systems 's-Hertogenbosch The Netherlands	DATE:	02-12-03	BY:	BdJ
	DRAWING NUMBER			
	PD1	530225	11	12
	SERIAL CODE	PROJECT	SHEET	CONT'D

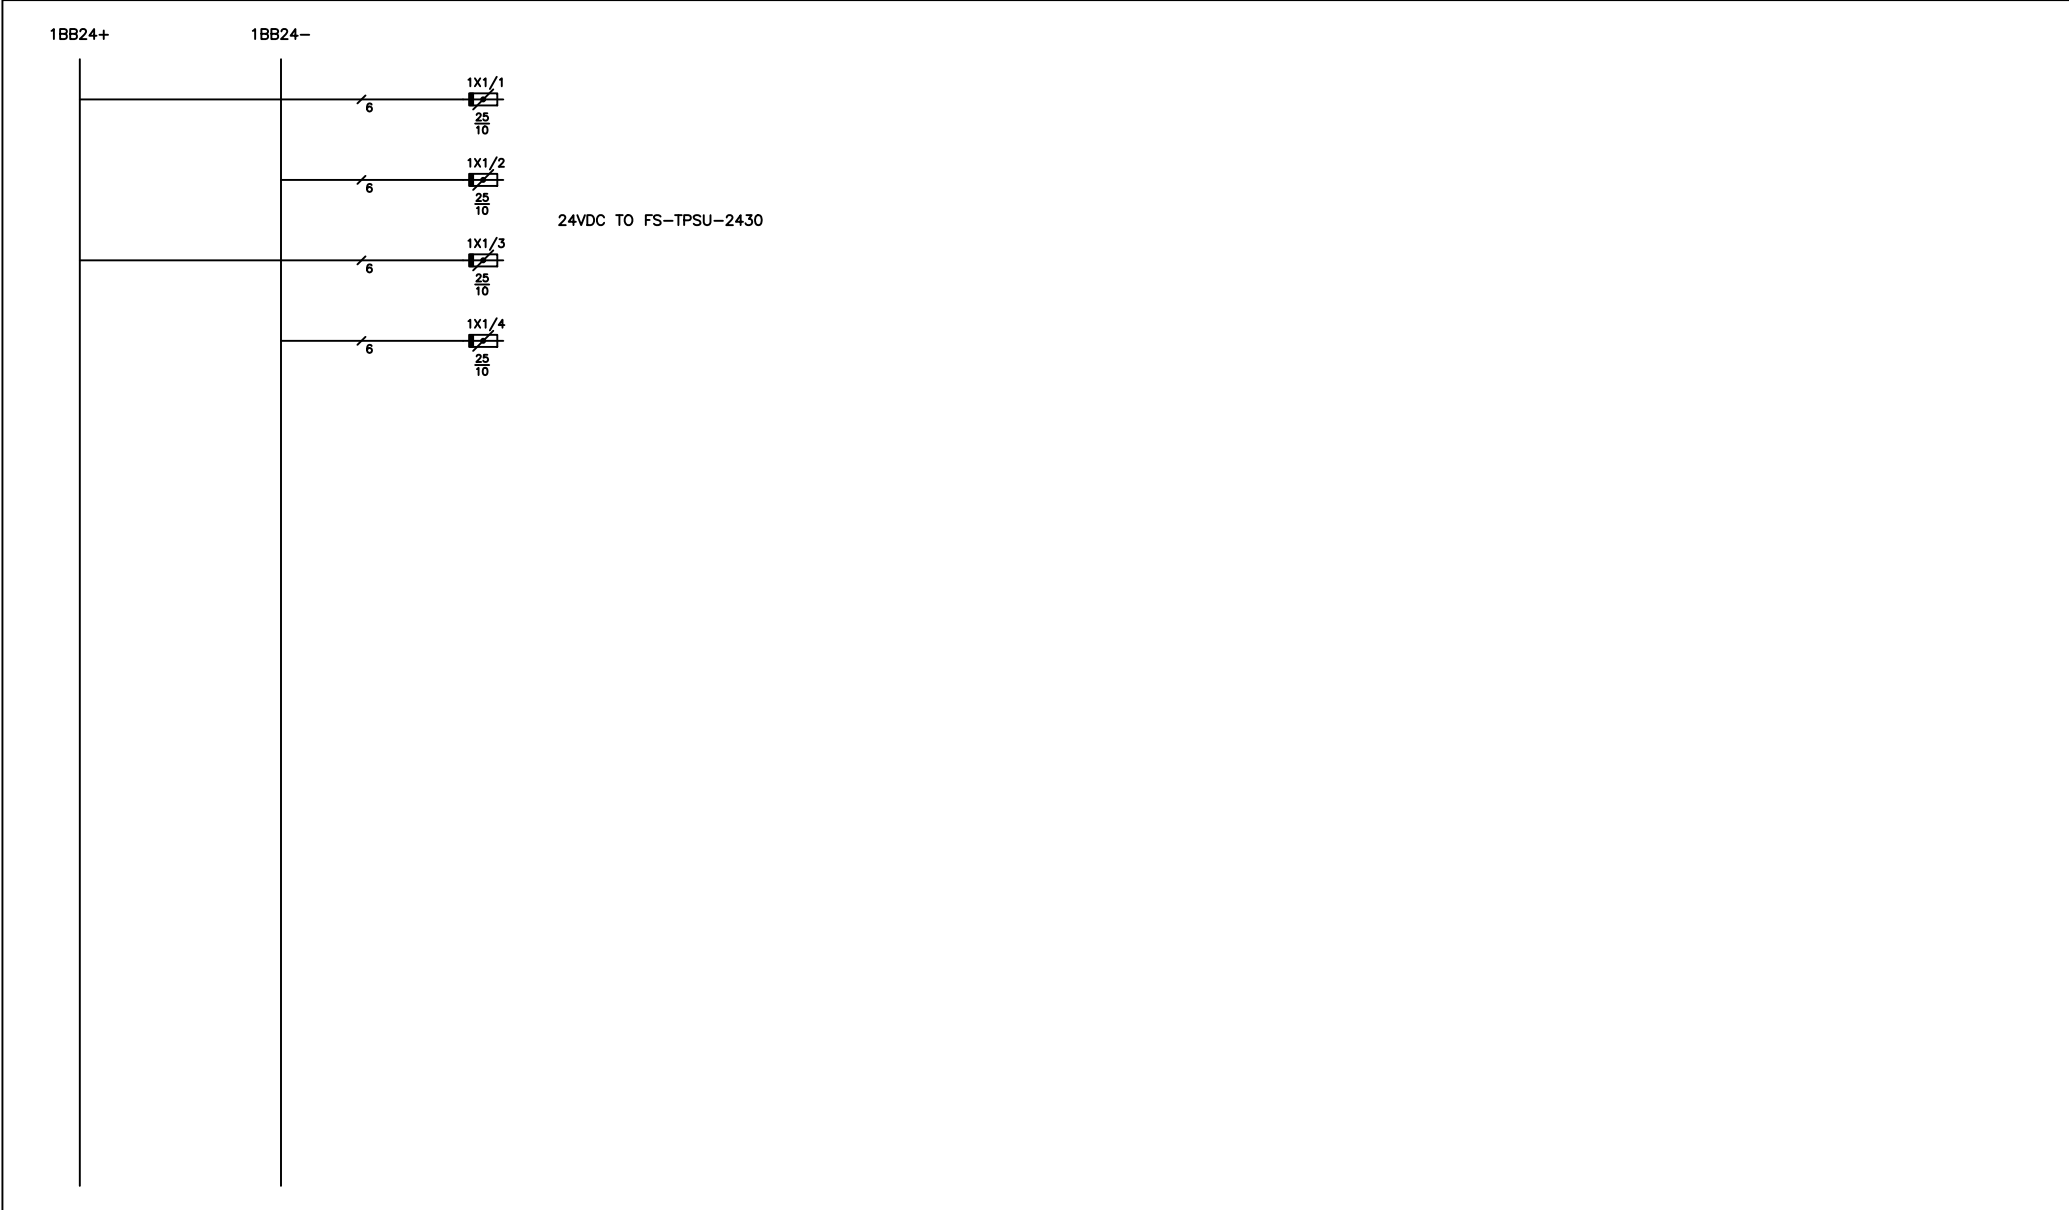

				CUSTOMER : SLOVNAFT PLANT : BRATISLAVA : SLOVAKIA REQ/ORDER NO. :SRA7011259	POWER DISTRIBUTION		PP3 UNIT ESD	
					24 VDC			
B	12-10-24	FSC-SM MIGRATION	PKO		 Honeywell Safety Management Systems 's-Hertogenbosch The Netherlands	DATE: 02-12-03		BY: BdJ
A	20-02-03	AS BUILD				DRAWING NUMBER		
0	02-12-03	FOR APPROVAL				PD1	530225	12 21
REV:	DATE:	DESCRIPTION	CHK'D			SERIAL CODE	PROJECT	SHEET CONT'D

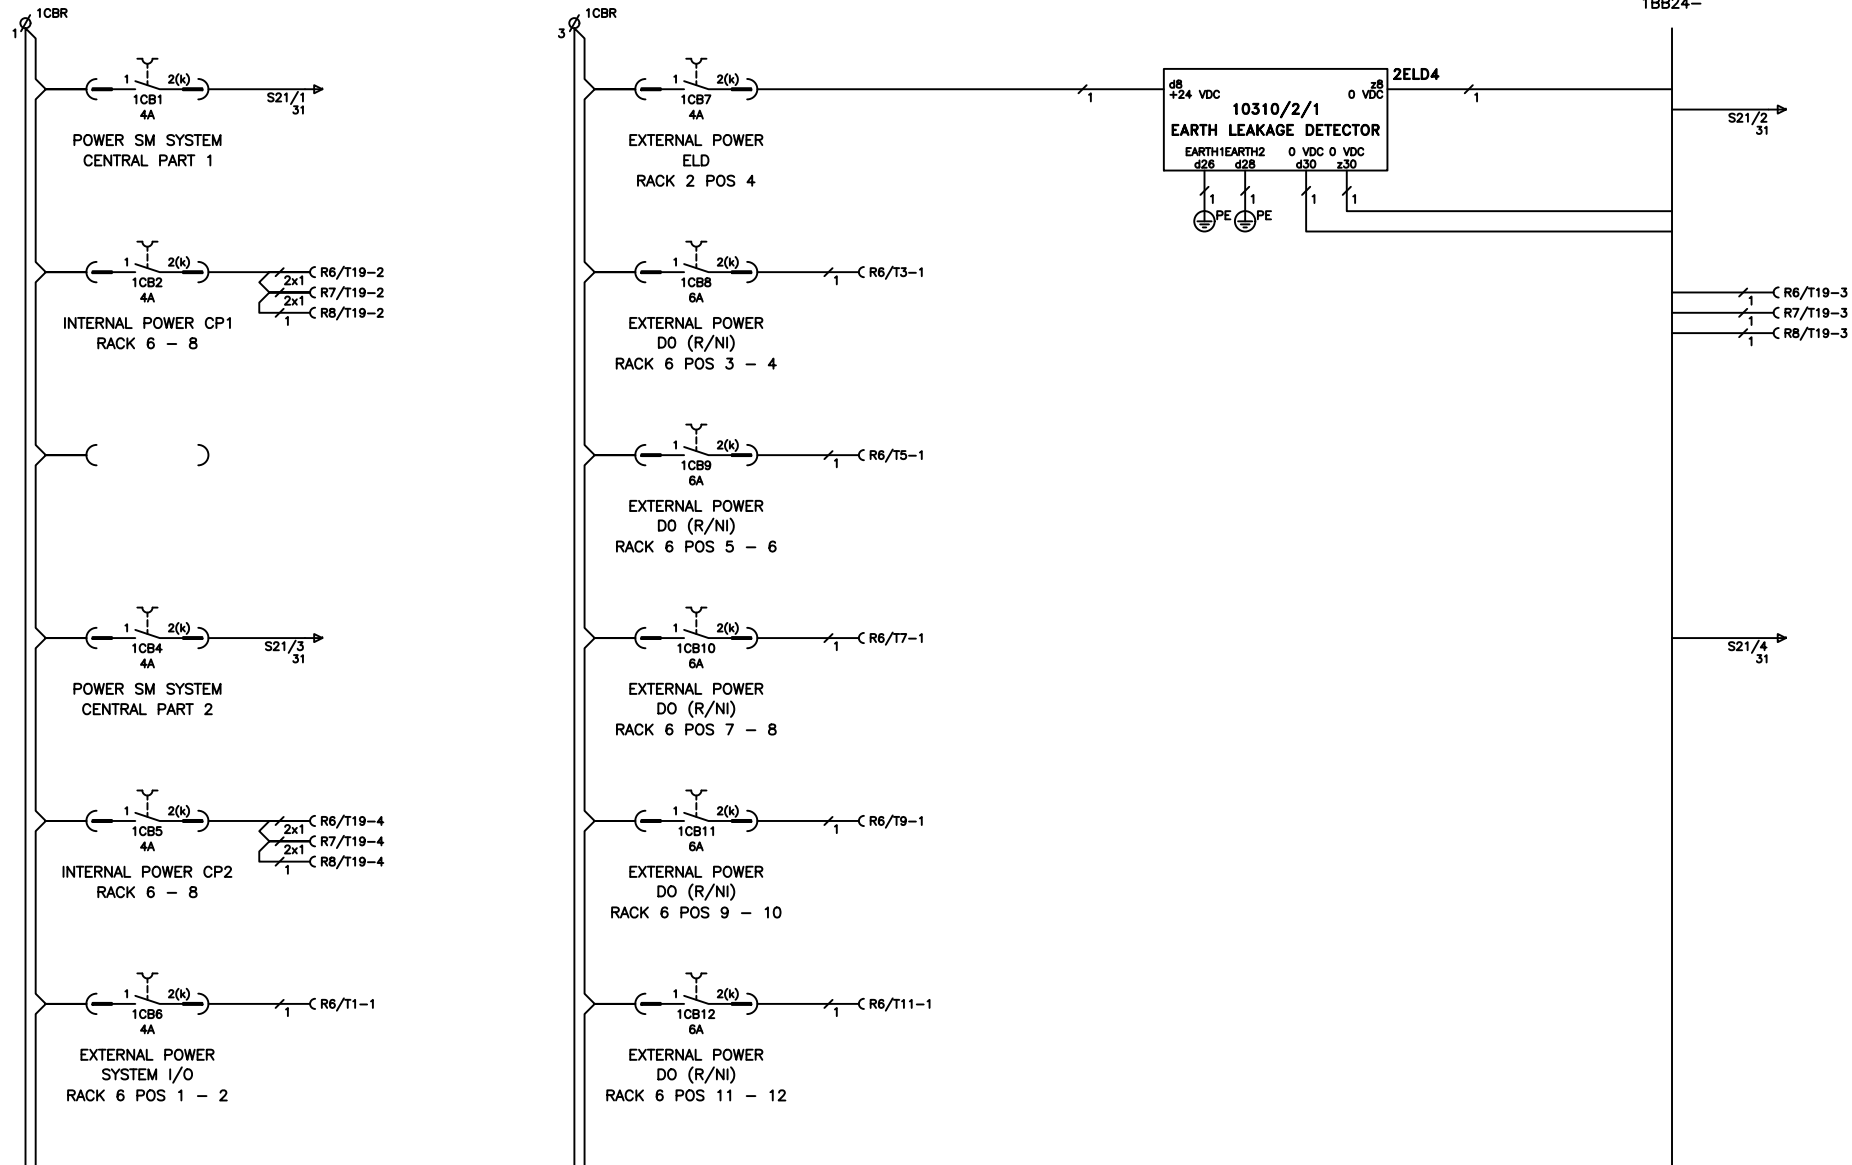

B	12-10-24	FSC-SM MIGRATION	PKO
A	20-02-03	AS BUILD	
O	02-12-03	FOR APPROVAL	
REV:	DATE:	DESCRIPTION	CHK'D

CUSTOMER : SLOVNAFT
PLANT : BRATISLAVA
: SLOVAKIA
REQ/ORDER NO. : SRA7011259





POWER DISTRIBUTION
24 VDC

PP3 UNIT ESD



Honeywell
Safety Management Systems
's-Hertogenbosch The Netherlands

DATE:	02-12-03	BY:	BdJ
DRAWING NUMBER			
PD1	530225	21	22
SERIAL CODE	PROJECT	SHEET	CONT'D

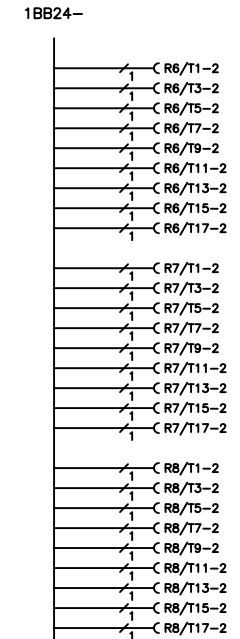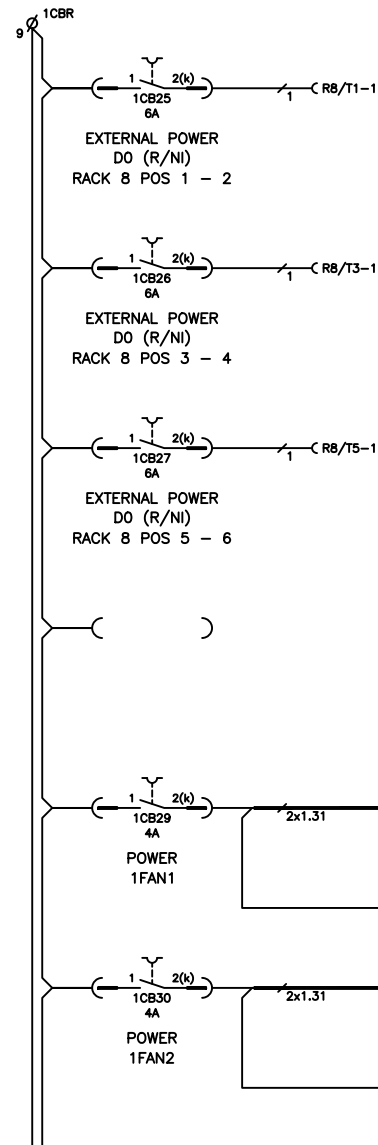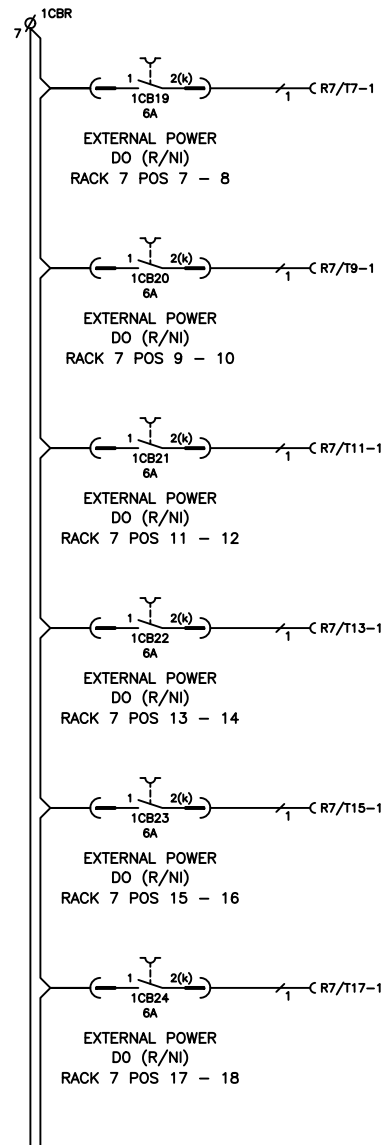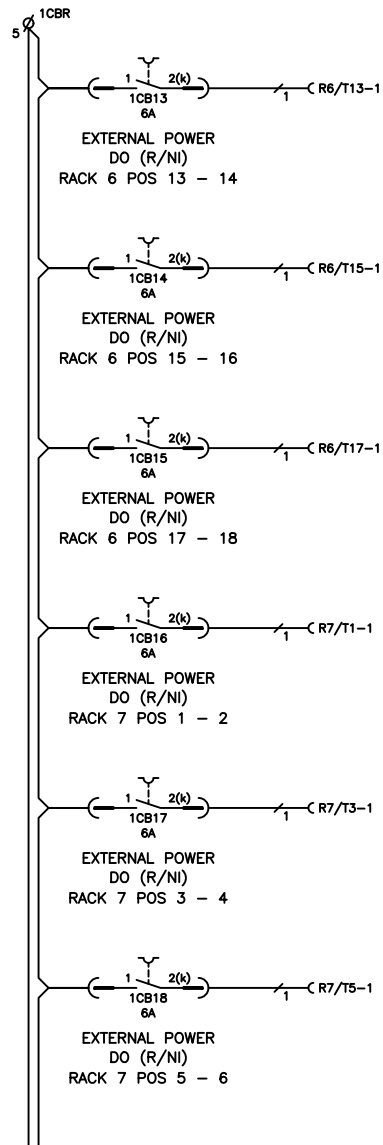

B	12-10-24	FSC-SM MIGRATION	PKO
A	20-02-03	AS BUILD	
O	02-12-03	FOR APPROVAL	
REV:	DATE:	DESCRIPTION	CHK'D

CUSTOMER : SLOVNAFT
PLANT : BRATISLAVA
: SLOVAKIA

REQ/ORDER NO. : SRA7011259



POWER DISTRIBUTION
24 VDC

PP3 UNIT ESD




Honeywell
Safety Management Systems
's-Hertogenbosch The Netherlands

DATE:	02-12-03	BY:	BdJ
DRAWING NUMBER			
PD1	530225	22	23
SERIAL CODE	PROJECT	SHEET	CONT'D

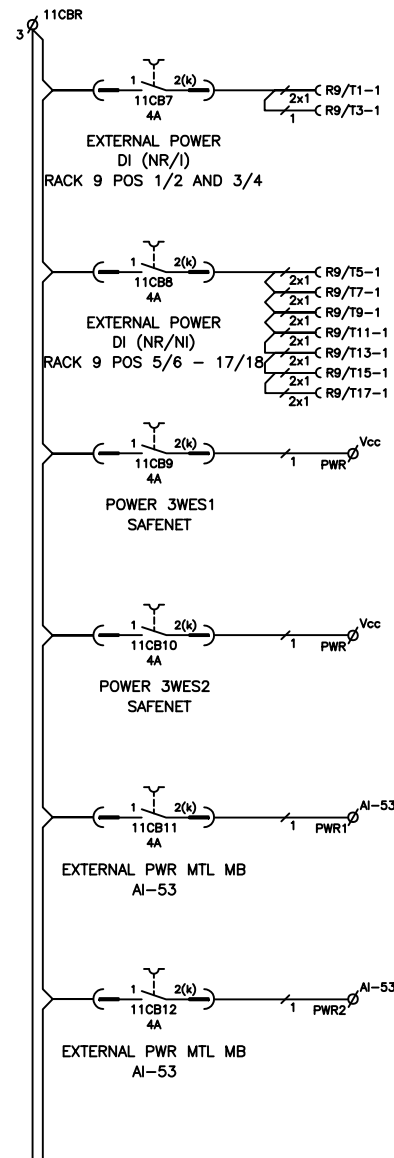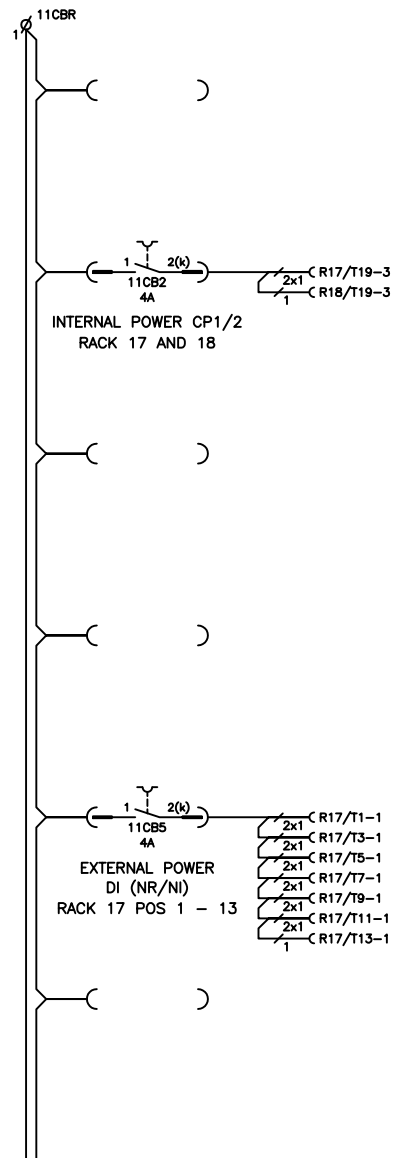

2BB24-

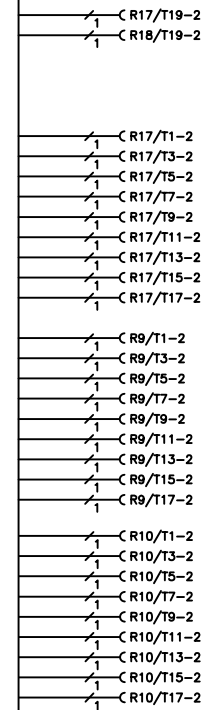

REV:	DATE:	DESCRIPTION	CHK'D
C	30-09-26	INPUT REDUNDANCY	PKO
B	12-10-24	FSC-SM MIGRATION	PKO
A	20-02-03	AS BUILD	
0	02-12-03	FOR APPROVAL	

CUSTOMER : SLOVNAFT
PLANT : BRATISLAVA
: SLOVAKIA
REQ/ORDER NO. :SRA7011259




POWER DISTRIBUTION
24 VDC

PP3 UNIT ESD




Honeywell
Safety Management Systems
's-Hertogenbosch The Netherlands

DATE:	02-12-03	BY:	BdJ
DRAWING NUMBER			
PD1	530225	23	24
SERIAL CODE	PROJECT	SHEET	CONT'D

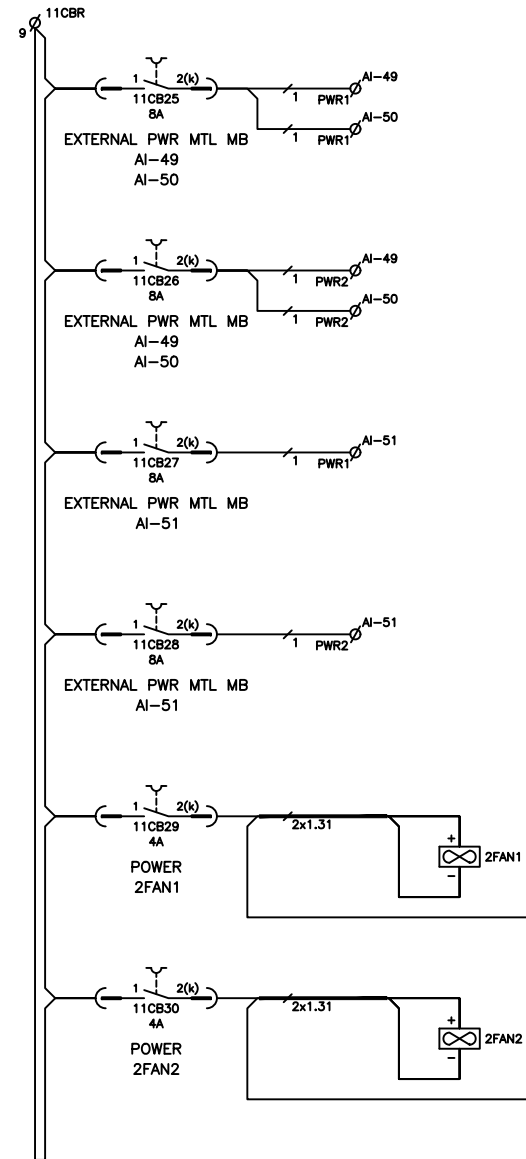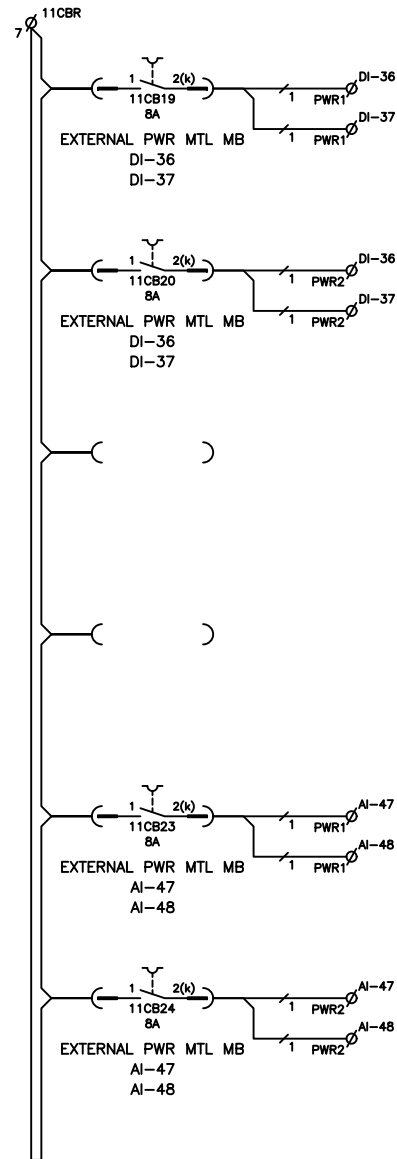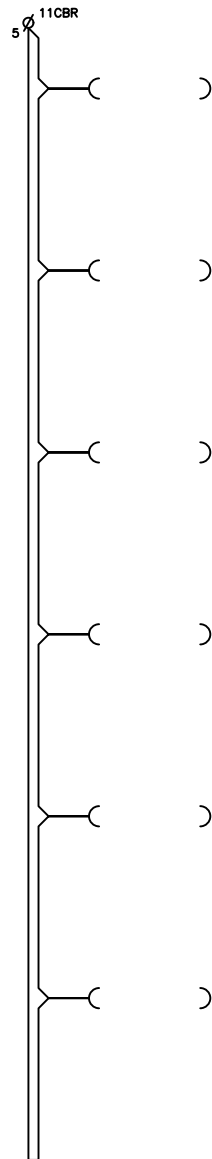

2BB24-

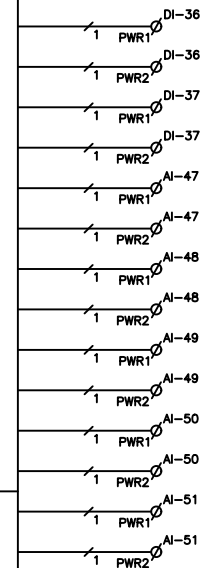

REV:	DATE:	DESCRIPTION	CHK'D
B	12-10-24	FSC-SM MIGRATION	PKO
A	20-02-03	AS BUILD	
O	02-12-03	FOR APPROVAL	

CUSTOMER : SLOVNAFT
PLANT : BRATISLAVA
: SLOVAKIA
REQ/ORDER NO. : SRA7011259


POWER DISTRIBUTION
24 VDC

PP3 UNIT ESD



Honeywell
Safety Management Systems
's-Hertogenbosch The Netherlands

DATE:	02-12-03	BY:	BdJ
DRAWING NUMBER			
PD1	530225	24	31
SERIAL CODE	PROJECT	SHEET	CONT'D

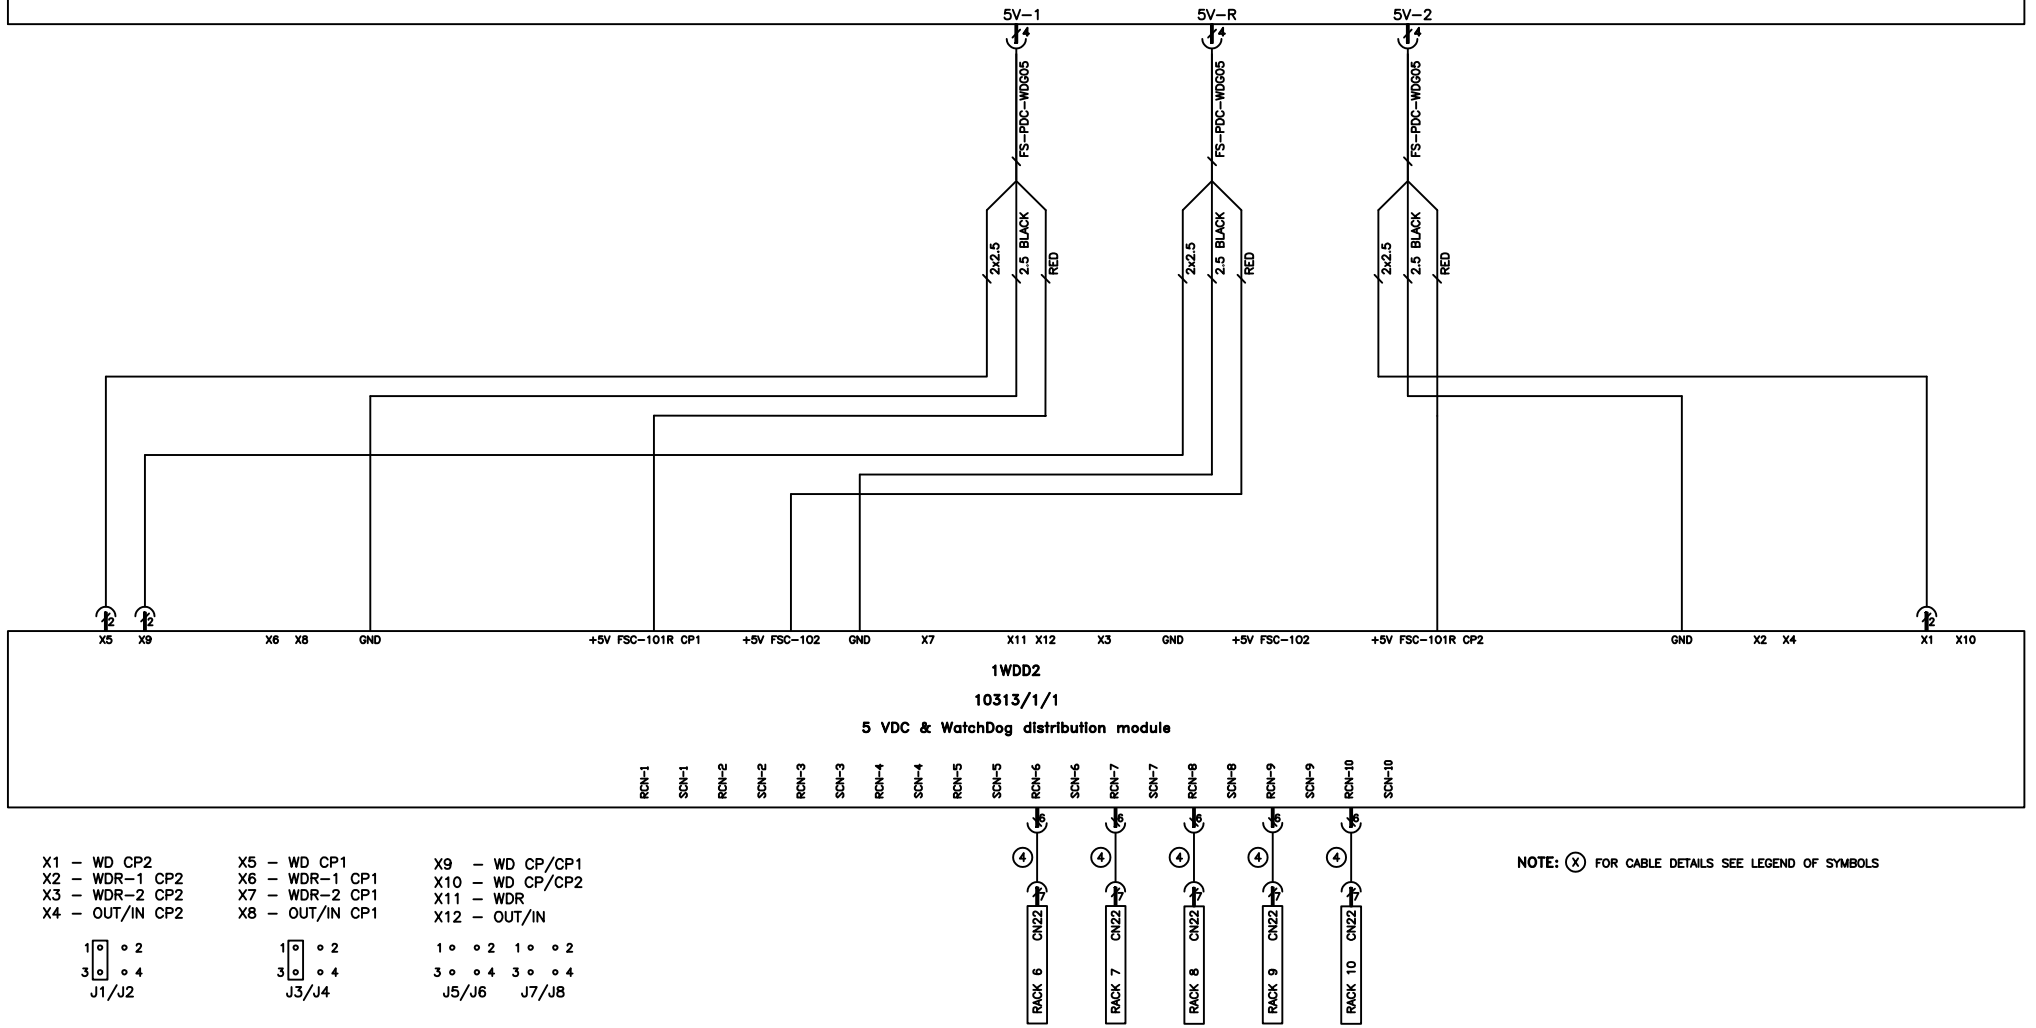

FOR JUMPER SETTINGS SEE FSC-HARDWARE MANUAL

C	30-09-26	INPUT REDUNDANCY	PKO
B	12-10-24	FSC-SM MIGRATION	PKO
A	20-02-03	AS BUILD	
0	02-12-03	FOR APPROVAL	
REV:	DATE:	DESCRIPTION	CHK'D

CUSTOMER : SLOVNAFT
PLANT : BRATISLAVA
: SLOVAKIA
REQ/ORDER NO. :SRA7011259


POWER DISTRIBUTION
5 VDC

PP3 UNIT ESD



Honeywell
Safety Management Systems
's-Hertogenbosch The Netherlands

DATE:	02-12-03	BY:	BdJ
DRAWING NUMBER			
PD1	530225	31	32
SERIAL CODE	PROJECT	SHEET	CONT'D


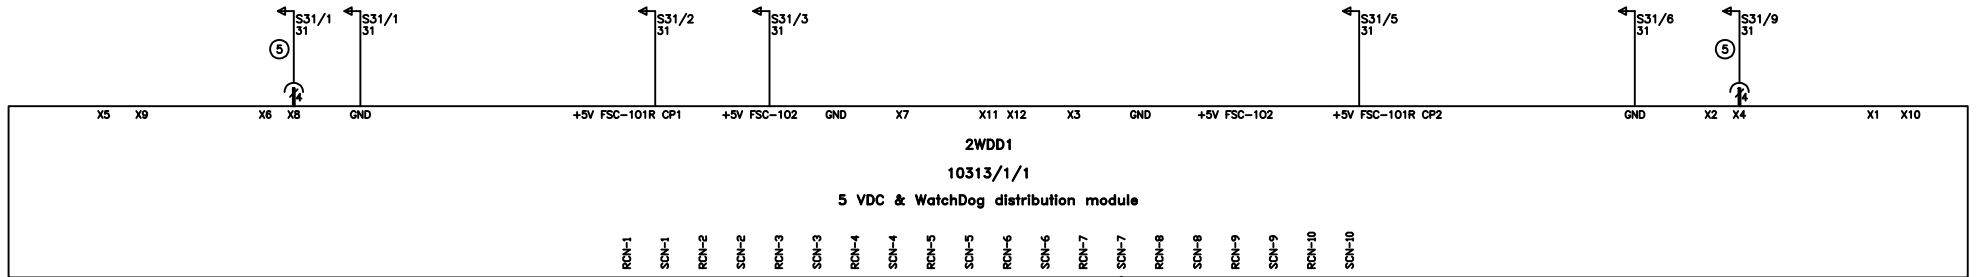


X1 - WD CP2
 X2 - WDR-1 CP2
 X3 - WDR-2 CP2
 X4 - OUT/IN CP2
 X5 - WD CP1
 X6 - WDR-1 CP1
 X7 - WDR-2 CP1
 X8 - OUT/IN CP1
 X9 - WD CP/CP1
 X10 - WD CP/CP2
 X11 - WDR
 X12 - OUT/IN
 J1/J2
 J3/J4
 J5/J6 J7/J8

NOTE: (X) FOR CABLE DETAILS SEE LEGEND OF SYMBOLS

FOR JUMPER SETTINGS SEE FSC-HARDWARE MANUAL


				CUSTOMER : SLOVNAFT	POWER DISTRIBUTION	PP3 UNIT ESD
				PLANT : BRATISLAVA	5 VDC	
				: SLOVAKIA		
C	30-09-26	INPUT REDUNDANCY	PKO	REQ/ORDER NO. :SRA7011259	 Honeywell Safety Management Systems 's-Hertogenbosch The Netherlands	DATE: 02-12-03 BY: BdJ
B	12-10-24	FSC-SM MIGRATION	PKO			DRAWING NUMBER
A	20-02-03	AS BUILD				PD1 530225 32 36
0	02-12-03	FOR APPROVAL				SERIAL CODE PROJECT SHEET CONT'D
REV:	DATE:	DESCRIPTION	CHK'D			

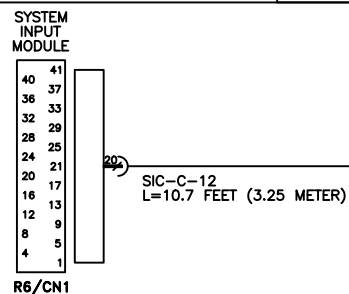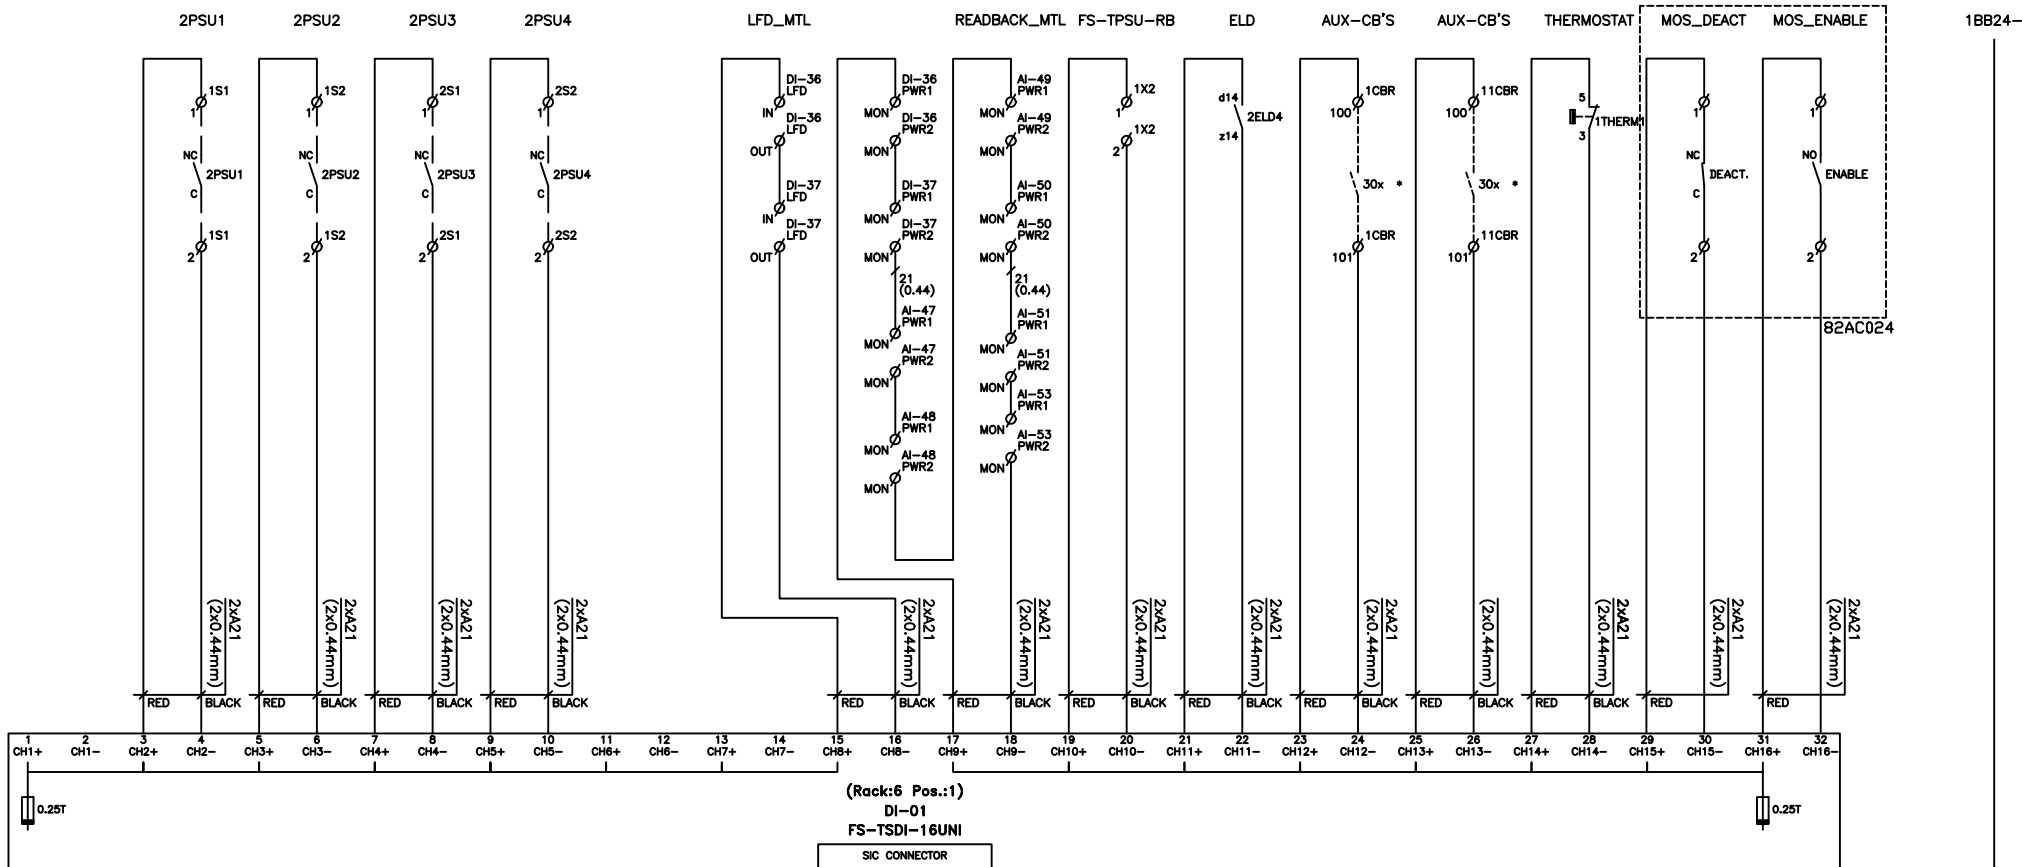

JUMPERS TO BE REMOVED FOR SYSTEM INPUT AND OUTPUT MODULES		
CARD POSITION	JUMPER CHAN 1	JUMPER CHAN 5
1- 2	J3	J4
11-12	J5	J6
13-14	J7	J8
15-16	J9	J10
17-18	J11	J12

* NOTE: LINK INSTALLED FOR NOT USED POSITIONS

				CUSTOMER : SLOVNAFT PLANT : BRATISLAVA : SLOVAKIA REQ/ORDER NO. :SRA7011259	POWER DISTRIBUTION CABINET UTILITY ALARMS								PP3 UNIT ESD			
B	12-10-24	FSC-SM MIGRATION	PKO		 Honeywell Safety Management Systems 's-Hertogenbosch The Netherlands					DATE: 02-12-03		BY: BdJ				
A	20-02-03	AS BUILD				DRAWING NUMBER										
0	02-12-03	FOR APPROVAL				PD1		530225		36		41				
REV:	DATE:	DESCRIPTION	CHK'D			SERIAL CODE		PROJECT		SHEET		CONT'D				

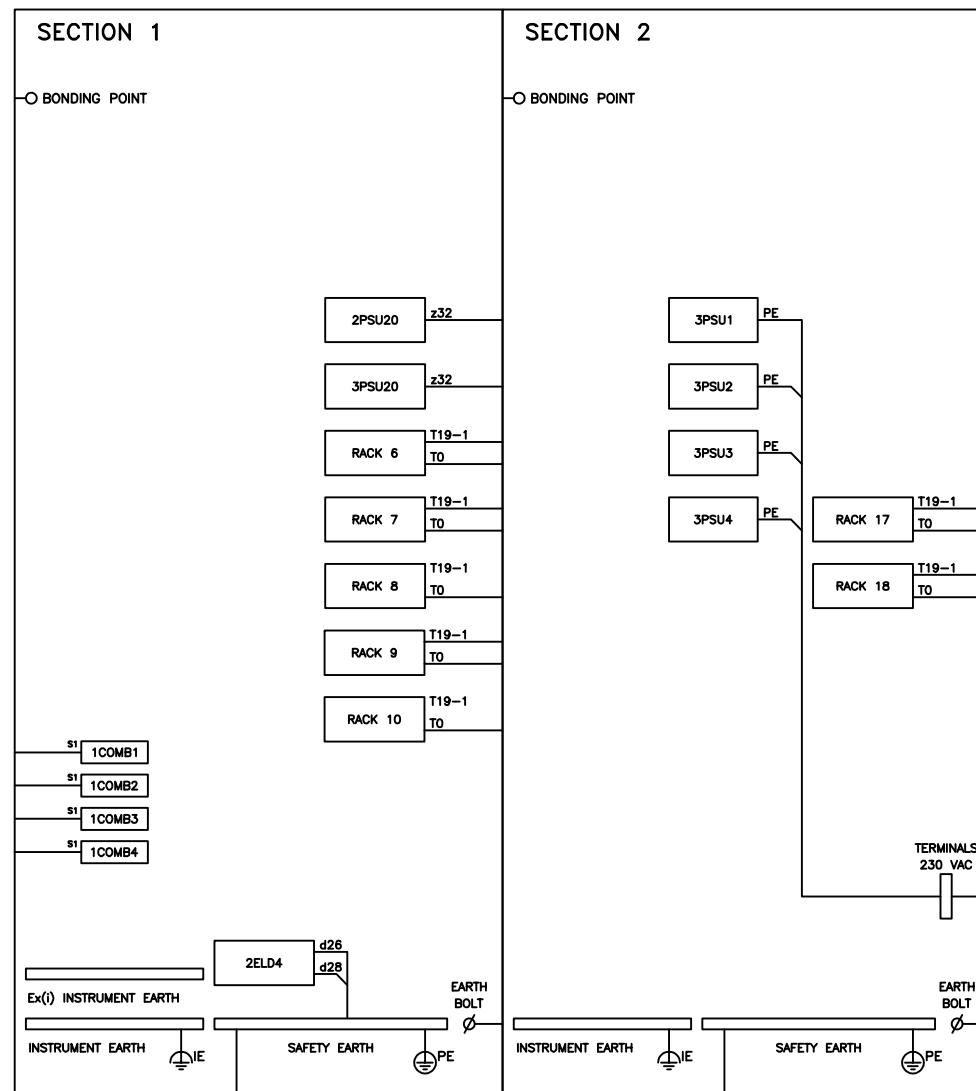

C	30-09-26	INPUT REDUNDANCY	PKO
B	12-10-24	FSC-SM MIGRATION	PKO
A	20-02-03	AS BUILD	
0	02-12-03	FOR APPROVAL	
REV:	DATE:	DESCRIPTION	CHK'D

CUSTOMER : SLOVNAFT
PLANT : BRATISLAVA
: SLOVAKIA
REQ/ORDER NO. : SRA7011259


POWER DISTRIBUTION EARTHING

PP3 UNIT ESD



Honeywell
Safety Management Systems
's-Hertogenbosch The Netherlands

DATE:	02-12-03	BY:	BdJ
DRAWING NUMBER			
PD1	530225	41	46
SERIAL CODE	PROJECT	SHEET	CONT'D

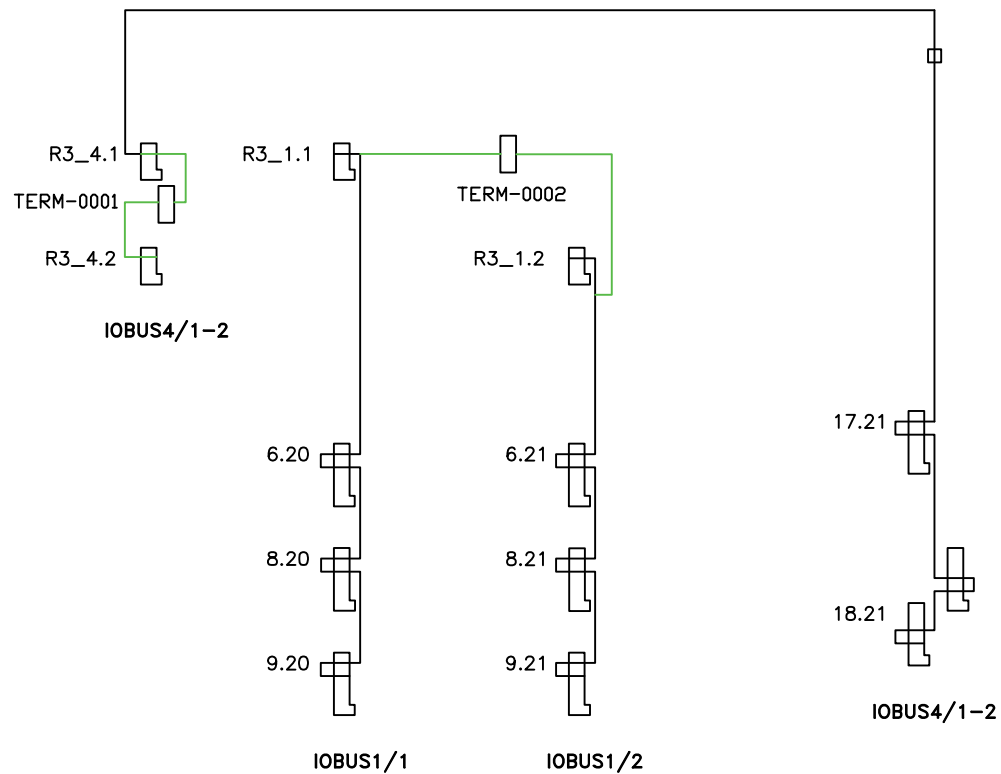

C	30-09-26	INPUT REDUNDANCY	PKO
B	12-10-24	FSC-SM MIGRATION	PKO
A	20-02-03	AS BUILD	
0	02-12-03	FOR APPROVAL	
REV:	DATE:	DESCRIPTION	CHK'D

CUSTOMER : SLOVNAFT
 PLANT : BRATISLAVA
 : SLOVAKIA
 REQ/ORDER NO. :SRA7011259

POWER DISTRIBUTION VERTICAL BUS FLATCABLES

PP3 UNIT ESD



Honeywell
Safety Management Systems
 's-Hertogenbosch The Netherlands

DATE:	02-12-03	BY:	BdJ
DRAWING NUMBER			
PD1	530225	46	-
SERIAL CODE	PROJECT	SHEET	CONT'D

Rack Layout
PP3 UNIT ESD

				CUSTOMER : SLOVNAFT PLANT : BRATISLAVA : SLOVAKIA REQ/ORDER NO. :SRA7011259	RACK LAYOUT COVERSHEET				PP3 UNIT ESD			
C	12-10-24	FSC-SM MIGRATION	PKO		 Honeywell Safety Management Systems 's-Hertogenbosch The Netherlands	DATE: 31-10-2003		BY: JH				
B	20-02-04	AS BUILD				DRAWING NUMBER						
A	01-12-03	REVISED				R1	530225	1	2			
0	31-10-03	FOR APPROVAL	JH			SERIAL CODE	PROJECT	SHEET	CONT'D			
REV:	DATE:	DESCRIPTION	CHK'D									

DRAWING NO.: R1-530225		
SHEET	REVISIONS	DESCRIPTION

001	0	A	B	COVER SHEET
002	0	A	B	INDEX SHEET
011	0	A	B	Rack 1 Circuit Breaker Rack
012	0	A	B	Rack 2 FSC rack with ELD
013	0	A	B	Rack 3 SM CP-Chassis
016	0	A	B	Rack 6 Redundant I/O
017	0	A	B	Rack 7 Redundant I/O
018	0	A	B	Rack 8 Redundant I/O
021	0	A	B	Rack 11 Circuit Breaker Rack
024	0	A	B	Rack 14 NON FSC I/O - REMOVED
025	0	A	B	Rack 15 NON FSC I/O - REMOVED
026	0	A	B	Rack 16 NON FSC I/O - REMOVED
027	0	A	B	Rack 17 Single I/O
028	0	A	B	Rack 18 Single I/O

				CUSTOMER : SLOVNAFT PLANT : BRATISLAVA : SLOVAKIA REQ/ORDER NO. :SRA7011259	RACK LAYOUT INDEX SHEET				PP3 UNIT ESD				
C	12-10-24	FSC-SM MIGRATION	PKO		 Honeywell Safety Management Systems 's-Hertogenbosch The Netherlands	DATE: 31-10-2003		BY: JH					
B	20-02-04	AS BUILD				DRAWING NUMBER							
A	01-12-03	REVISED				R1	530225	2	11				
O	31-10-03	FOR APPROVAL	JH			SERIAL CODE	PROJECT	SHEET	CONT'D				
REV:	DATE:	DESCRIPTION	CHK'D										

Circuit Breaker Rack

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	
4 A	4 A		4 A	4 A	4 A	4 A	6 A	6 A	6 A	6 A	6 A	6 A	6 A	6 A	
1CB1 PWR SM SYS. CP1	1CB2 INT. PWR CP1 R6-8	1CB3	1CB4 PWR SM SYS. CP2	1CB5 INT. PWR CP2 R6-8	1CB6 EXT. PWR SYS.I/O R6 P1-2	1CB7 EXT. PWR 2ELD4	1CB8 EXT. PWR DO (R/Ni) R6 P3-4	1CB9 EXT. PWR DO (R/Ni) R6 P5-6	1CB10 EXT. PWR DO (R/Ni) R6 P7-8	1CB11 EXT. PWR DO (R/Ni) R6 P9-10	1CB12 EXT. PWR DO (R/Ni) R6 P11-12	1CB13 EXT. PWR DO (R/Ni) R6 P13-14	1CB14 EXT. PWR DO (R/Ni) R6 P15-16	1CB15 EXT. PWR DO (R/Ni) R6 P17-18	

SystemNo:1 Cabinet:1 Rack:1

	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30
	6 A	6 A	6 A	6 A	6 A	6 A	6 A	6 A	6 A	6 A	6 A	6 A		4 A	4 A
	1CB16 EXT. PWR DO (R/Ni) R7 P1-2	1CB17 EXT. PWR DO (R/Ni) R7 P3-4	1CB18 EXT. PWR DO (R/Ni) R7 P5-6	1CB19 EXT. PWR DO (R/Ni) R7 P7-8	1CB20 EXT. PWR DO (R/Ni) R7 P9-10	1CB21 EXT. PWR DO (R/Ni) R7 P11-12	1CB22 EXT. PWR DO (R/Ni) R7 P13-14	1CB23 EXT. PWR DO (R/Ni) R7 P15-16	1CB24 EXT. PWR DO (R/Ni) R7 P17-18	1CB25 EXT. PWR DO (R/Ni) R8 P1-2	1CB26 EXT. PWR DO (R/Ni) R8 P3-4	1CB27 EXT. PWR DO (R/Ni) R8 P5-6	1CB28	1CB29 1FAN1	1CB30 1FAN2

				CUSTOMER : SLOVNAFT	RACK LAYOUT				PP3 UNIT ESD			
				PLANT : BRATISLAVA	Rack 1 Circuit Breaker Rack							
				: SLOVAKIA								
C	12-10-24	FSC-SM MIGRATION	PKO	REQ/ORDER NO. :SRA7011259	 Honeywell Safety Management Systems 's-Hertogenbosch The Netherlands				DATE:	31-10-2003	BY:	JH
B	20-02-04	AS BUILD							DRAWING NUMBER			
A	01-12-03	REVISED							R1	530225	11	12
O	31-10-03	FOR APPROVAL	JH						SERIAL CODE	PROJECT	SHEET	CONT'D
REV:	DATE:	DESCRIPTION	CHK'D									

[illegible]

				CUSTOMER : SLOVNAFT PLANT : BRATISLAVA : SLOVAKIA REQ/ORDER NO. :SRA7011259	RACK LAYOUT				PP3 UNIT ESD			
C	12-10-24	FSC-SM MIGRATION	PKO		Rack 3 FSC rack with ELD							
B	20-02-04	AS BUILD			 Honeywell Safety Management Systems 's-Hertogenbosch The Netherlands	DATE: 31-10-2003		BY: JH				
A	01-12-03	REVISED				DRAWING NUMBER						
0	31-10-03	FOR APPROVAL	JH			R1	530225	12	13			
REV:	DATE:	DESCRIPTION	CHK'D			SERIAL CODE	PROJECT	SHEET	CONT'D			

CPCHAS-0003

SystemNo : 1
Cabinet : 1
Chassis : 3

CPM Type	1 QPP-0002	2 USI-0002	3 BLIND-COM	4 PSU-240516	5 BKM-0001	6 QPP-0002	7 USI-0002	8 BLIND-COM	9 PSU-240516
	Honeywell 10:59:27 ☐▲ ☐▼ RUNIDLE - STOP ☐ STATUS	☐ Tx 1 ☐ Rx 1 ☐ Tx 2 ☐ Rx 2 ☐ Tx 3 ☐ Rx 3 ☐ Tx 4 ☐ Rx 4 ☐ STATUS			◀ CP 1 CP 2 ▶ OFFON RESET OFF- ON FORCE ENABLE ☐ STATUS	Honeywell 10:59:27 ☐▲ ☐▼ RUNIDLE - STOP ☐ STATUS	☐ Tx 1 ☐ Rx 1 ☐ Tx 2 ☐ Rx 2 ☐ Tx 3 ☐ Rx 3 ☐ Tx 4 ☐ Rx 4 ☐ STATUS		☐ STATUS

				CUSTOMER : SLOVNAFT PLANT : BRATISLAVA : SLOVAKIA	RACK LAYOUT Rack 3 SM CP-Chassis	PP3 UNIT ESD
C	12-10-24	FSC-SM MIGRATION	PKO	REQ/ORDER NO. :SRA7011259	Honeywell Safety Management Systems 's-Hertogenbosch The Netherlands	DATE: 31-10-2003 BY: JH
B	20-02-04	AS BUILD				DRAWING NUMBER
A	01-12-03	REVISED				R1 530225 13 16
O	31-10-03	FOR APPROVAL	JH			SERIAL CODE PROJECT SHEET CONT'D
REV:	DATE:	DESCRIPTION	CHK'D			

FSC Redundant I/O Rack with 10315/1/1 BackPlane

Internal Power CB: CP1=1CB2, CP2=1CB5

SystemNo : 1
Cabinet : 1
Rack : 6

External Power CB

	1CB6	1CB6	1CB8	1CB8	1CB9	1CB9	1CB10	1CB10	1CB11	1CB11	1CB12	1CB12	1CB13	1CB13	1CB14	1CB14	1CB15	1CB15			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21
	10101/2/1	10101/2/1	10201/2/1	10201/2/1	10201/2/1	10201/2/1	10201/2/1	10201/2/1	10201/2/1	10201/2/1	10201/2/1	10201/2/1	10201/2/1	10201/2/1	10201/2/1	10201/2/1	10201/2/1	10201/2/1	Blank	10100/2/1 HBD 1.1.1	10100/2/1 HBD 2.1.1
1																					
2																					
3																					
4																					
5																					
6																					
7																					
8																					
9																					
10																					
11																					
12																					
13																					
14																					
15																					
16																					

GR	System I/O	DO (R/NI)	Central Part 1	Central Part 2
----	------------	-----------	----------------	----------------

SIC	SIC-C-12/L325	SIC-C-12/L15	SIC-C-12/L15	SIC-C-12/L15	SIC-C-12/L15	SIC-C-12/L15	SIC-C-12/L15	SIC-C-12/L15	SIC-C-12/L15
FTA	DI_01	DO_02	DO_03	DO_04	DO_05	DO_06	DO_07	DO_08	DO_09
TYP	FS-TSDI-16UNI	FS-TSDO-0824	FS-TSDO-0824	FS-TSDO-0824	FS-TSDO-0824	FS-TSDO-0824	FS-TSDO-0824	FS-TSDO-0824	FS-TSDO-0824

C

12-10-24

FSC-SM MIGRATION

PKO

B

20-02-04

AS BUILD

A

01-12-03

REVISED

O

31-10-03

FOR APPROVAL

JH

REV:

DATE:

DESCRIPTION

CHK'D

CUSTOMER : SLOVNAFT

PLANT : BRATISLAVA

: SLOVAKIA

REQ/ORDER NO. :SRA7011259

RACK LAYOUT

Rack 6 Redundant I/O

PP3 UNIT ESD

FSC

Honeywell

Safety Management Systems

's-Hertogenbosch The Netherlands

DATE: 31-10-2003

BY: JH

DRAWING NUMBER

R1

530225

16

17

SERIAL CODE

PROJECT

SHEET

CONT'D

FSC Redundant I/O Rack with 10315/1/1 BackPlane

Internal Power CB: CP1=1CB2, CP2=1CB5

SystemNo : 1
Cabinet : 1
Rack : 7

External Power CB

Rack 7 controlled by HBDs in rack 6

	1CB16	1CB16	1CB17	1CB17	1CB18	1CB18	1CB19	1CB19	1CB20	1CB20	1CB21	1CB21	1CB22	1CB22	1CB23	1CB23	1CB24	1CB24			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21
	10201/2/1	10201/2/1	10201/2/1	10201/2/1	10201/2/1	10201/2/1	10201/2/1	10201/2/1	10201/2/1	10201/2/1	10201/2/1	10201/2/1	10201/2/1	10201/2/1	10201/2/1	10201/2/1	10201/2/1	10201/2/1	Blank	Blank	Blank
1																					
2																					
3																					
4																					
5																					
6																					
7																					
8																					
9																					
10																					
11																					
12																					
13																					
14																					
15																					
16																					

GR DO (R/Ni)

SIC	SIC-C-12/L15	SIC-C-12/L15	SIC-C-12/L15	SIC-C-12/L15	SIC-C-12/L15	SIC-C-12/L15	SIC-C-12/L15	SIC-C-12/L15	SIC-C-12/L15
FTA	DO_10	DO_11	DO_12	DO_13	DO_14	DO_15	DO_16	DO_17	DO_18
TYP	FS-TSD0-0824	FS-TSD0-0824	FS-TSD0-0824	FS-TSD0-0824	FS-TSD0-0824	FS-TSD0-0824	FS-TSD0-0824	FS-TSD0-0824	FS-TSD0-0824

C	12-10-24	FSC-SM MIGRATION	PKO
B	20-02-04	AS BUILD	
A	01-12-03	REVISED	
O	31-10-03	FOR APPROVAL	JH
REV:	DATE:	DESCRIPTION	CHK'D

CUSTOMER : SLOVNAFT
PLANT : BRATISLAVA
: SLOVAKIA
REQ/ORDER NO. :SRA7011259

RACK LAYOUT
Rack 7 Redundant I/O

PP3 UNIT ESD



Honeywell
Safety Management Systems
's-Hertogenbosch The Netherlands

DATE:	31-10-2003	BY:	JH
DRAWING NUMBER			
R1	530225	17	18
SERIAL CODE	PROJECT	SHEET	CONT'D

FSC Redundant I/O Rack with 10315/1/1 BackPlane

Internal Power CB: CP1=1CB2, CP2=1CB5

SystemNo : 1
Cabinet : 1
Rack : 8

External Power CB																					
	1CB25	1CB25	1CB26	1CB26	1CB27	1CB27															
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21
	10201/2/1	10201/2/1	10201/2/1	10201/2/1	10201/2/1	10201/2/1	Blank	Blank	Blank	Blank	Blank	Blank	Blank	Blank	Blank	Blank	Blank	Blank	Blank	10100/2/1 HBD 1.1.2	10100/2/1 HBD 2.1.2
1																					
2																					
3																					
4																					
5																					
6																					
7																					
8																					
9																					
10																					
11																					
12																					
13																					
14																					
15																					
16																					

GR

DO (R/Ni)

Central Part 1

Central Part 2

SIC	SIC-C-12/L15	SIC-C-12/L15	SIC-C-12/L15
FTA	DO_19	DO_20	DO_21
TYP	FS-TSD0-0824	FS-TSD0-0824	FS-TSD0-0824

C	12-10-24	FSC-SM MIGRATION	PKO
B	20-02-04	AS BUILD	
A	01-12-03	REVISED	
O	31-10-03	FOR APPROVAL	JH
REV:	DATE:	DESCRIPTION	CHK'D

CUSTOMER : SLOVNAFT
PLANT : BRATISLAVA
 : SLOVAKIA

REQ/ORDER NO. :SRA7011259

RACK LAYOUT
Rack 8 Redundant I/O



Honeywell

Safety Management Systems

's-HertogenboschThe Netherlands

DATE:	31-10-2003	BY:	JH
DRAWING NUMBER			
R1	530225	18	19
SERIAL CODE	PROJECT	SHEET	CONT'D

PP3 UNIT ESD

FSC Redundant I/O Rack with 10315/1/1 BackPlane

Internal Power CB: CP1=1CB2, CP2=1CB5

SystemNo : 1
Cabinet : 1
Rack : 9

External Power CB

	11CB7		11CB7		11CB8		11CB8		11CB8		11CB8		11CB8		11CB8		11CB8		19	20	21
	1 10101/2/1	2 10101/2/1	3 10101/2/1	4 10101/2/1	5 10101/2/1	6 10101/2/1	7 10101/2/1	8 10101/2/1	9 10101/2/1	10 10101/2/1	11 10101/2/1	12 10101/2/1	13 10101/2/1	14 10101/2/1	15 10101/2/1	16 10101/2/1	17 10101/2/1	18 10101/2/1	Blank	10100/2/1 HBD 1.2.2	10100/2/1 HBD 1.2.2
1																					
2																					
3																					
4																					
5																					
6																					
7																					
8																					
9																					
10																					
11																					
12																					
13																					
14																					
15																					
16																					

GR	DI (NR/I)	DI (NR/NI)
----	-----------	------------

Central Part 1	Central Part 2
----------------	----------------

SIC	SIC-C-12/L3.25	SIC-C-12/L3.25	SIC-C-12/L15	SIC-C-12/L15	SIC-C-12/L15	SIC-C-12/L15	SIC-C-12/L15	SIC-C-12/L15	SIC-C-12/L15
FTA	DI_36	DI_37	DI_38	DI_39	DI_40	DI_41	DI_42	DI_43	DI_44
TYP	FS-GMILSDI-1624+MIL4113	FS-GMILSDI-1624+MIL4113	FS-TSDI-16UNI	FS-TSDI-16UNI	FS-TSDI-16UNI	FS-TSDI-16UNI	FS-TSDI-16UNI	FS-TSDI-16UNI	FS-TSDI-16UNI

CUSTOMER : SLOVNAFT
PLANT : BRATISLAVA
: SLOVAKIA
REQ/ORDER NO. :SRA7011259

RACK LAYOUT
Rack 9 Redundant I/O

PP3 UNIT ESD



Honeywell
Safety Management Systems
's-Hertogenbosch The Netherlands

DATE:	31-10-2003	BY:	PKO
DRAWING NUMBER			
R1	530225	19	20
SERIAL CODE	PROJECT	SHEET	CONT'D

0	30-09-26	INPUT REDUNDANCY	PKO
REV:	DATE:	DESCRIPTION	CHK'D

FSC Redundant I/O Rack with 10315/1/1 BackPlane

Internal Power CB: CP1/2=11CB2

SystemNo : 1
Cabinet : 1
Rack : 10

External Power CB

	11CB7		11CB8		11CB8		11CB8		11CB8		11CB8		11CB8		11CB8		11CB8		19	20	21
	1 10101/2/1	2 10101/2/1	3 10101/2/1	4 10101/2/1	5 10105/2/1	6 10105/2/1	7 10105/2/1	8 10105/2/1	9 10105/2/1	10 10105/2/1	11 10105/2/1	12 10105/2/1	13 10105/2/1	14 10105/2/1	15 10105/2/1	16 10105/2/1	17 10105/2/1	18 10105/2/1	Blank	Blank	Blank
1																					
2																					
3																					
4																					
5																					
6																					
7																					
8																					
9																					
10																					
11																					
12																					
13																					
14																					
15																					
16																					

GR	DI (NR/NI)	AI (NR/I)	AI (NR/NI)	AI (NR/I)
----	------------	-----------	------------	-----------

SIC	SIC-C-12/L15	SIC-C-12/L15	SIC-C-12/L3.25	SIC-C-12/L3.25	SIC-C-12/L3.25	SIC-C-12/L3.25	SIC-C-12/L3.25	SIC-C-12/L15	SIC-C-12/L3.25
FTA	DI_45	DI_46	AI_47	AI_48	AI_49	AI_50	AI_51	AI_52	AI_53
TYP	FS-TSDI-16UNI	FS-TSDI-16UNI	FS-GIMTLRI-16 20m+MTL4041B	FS-GIMTLRI-16 20m+MTL4041B	FS-GIMTLRI-16 20m+MTL4041B	FS-GIMTLRI-16 20m+MTL4041B	FS-GIMTLRI-16 20m+MTL4041B	FS-TSA-1620m	FC-GMLA-16 +MTL4541B

CUSTOMER : SLOVNAFT
PLANT : BRATISLAVA
: SLOVAKIA
REQ/ORDER NO. :SRA7011259

RACK LAYOUT
Rack 10 Redundant I/O

PP3 UNIT ESD



Honeywell
Safety Management Systems
's-Hertogenbosch The Netherlands

DATE:	31-10-2003	BY:	PKO
DRAWING NUMBER			
R1	530225	20	21
SERIAL CODE	PROJECT	SHEET	CONT'D

0	30-09-26	INPUT REDUNDANCY	PKO
REV:	DATE:	DESCRIPTION	CHK'D

Circuit Breaker Rack

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	
	4 A			4 A		4 A	4 A								
11CB1	11CB2 INT. PWR CP1/2 R17-18	11CB3	11CB4	11CB5 EXT. PWR DI (NR/NI) R17 P1-13	11CB6	11CB7 EXT. PWR DI (NR/I) R18 P1-2	11CB8 EXT. PWR DI (NR/NI) R18 P3-11	11CB9 EXT. PWR1 MTL MB AI_53	11CB10 EXT. PWR2 MTL MB AI_53	11CB11 PWR 3WES1 SAFENET	11CB12 PWR 3WES2 SAFENET	11CB13	11CB14	11CB15	

SystemNo:1 Cabinet:2 Rack:11

	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30
				8 A	8 A			8 A	8 A	8 A	8 A	8 A	8 A	4 A	4 A
	11CB16	11CB17	11CB18	11CB19 EXT. PWR MTL MB DI_36 DI_37	11CB20 EXT. PWR MTL MB DI_36 DI_37	11CB21	11CB22	11CB23 EXT. PWR MTL MB AI_47 AI_48	11CB24 EXT. PWR MTL MB AI_47 AI_48	11CB25 EXT. PWR MTL MB AI_49 AI_50	11CB26 EXT. PWR MTL MB AI_49 AI_50	11CB27 EXT. PWR MTL MB AI_51	11CB28 EXT. PWR MTL MB AI_51	11CB29 2FAN1	11CB30 2FAN2

				CUSTOMER : SLOVNAFT	RACK LAYOUT	PP3 UNIT ESD
				PLANT : BRATISLAVA	Rack 11 Circuit Breaker Rack	
				: SLOVAKIA		
C	12-10-24	FSC-SM MIGRATION	PKO	REQ/ORDER NO. :SRA7011259	 Honeywell Safety Management Systems 's-Hertogenbosch The Netherlands	DATE: 31-10-2003 BY: JH
B	20-02-04	AS BUILD				DRAWING NUMBER
A	01-12-03	REVISED				R1 530225 21 24
O	31-10-03	FOR APPROVAL	JH			SERIAL CODE PROJECT SHEET CONT'D
REV:	DATE:	DESCRIPTION	CHK'D			

4HE Coverplate
(former position of MOS switches rack)

				CUSTOMER : SLOVNAFT PLANT : BRATISLAVA : SLOVAKIA REQ/ORDER NO. :SRA7011259	RACK LAYOUT				PP3 UNIT ESD					
					Rack 14 NON FSC I/O – REMOVED									
C	12-10-24	FSC-SM MIGRATION	PKO			Honeywell Safety Management Systems 's-Hertogenbosch The Netherlands			DATE:		31-10-2003		BY: JH	
B	20-02-04	AS BUILD							DRAWING NUMBER					
A	01-12-03	REVISED							R1	530225	24	25		
O	31-10-03	FOR APPROVAL	JH						SERIAL CODE	PROJECT	SHEET	CONT'D		
REV:	DATE:	DESCRIPTION	CHK'D											

4HE Coverplate
(former position of MOS switches rack)

				CUSTOMER : SLOVNAFT PLANT : BRATISLAVA : SLOVAKIA REQ/ORDER NO. :SRA7011259	RACK LAYOUT				PP3 UNIT ESD			
C	12-10-24	FSC-SM MIGRATION	PKO		Rack 15 NON FSC I/O - REMOVED							
B	20-02-04	AS BUILD			 Honeywell Safety Management Systems 's-Hertogenbosch The Netherlands	DATE: 31-10-2003			BY: JH			
A	01-12-03	REVISED				DRAWING NUMBER						
O	31-10-03	FOR APPROVAL	JH			R1	530225	25	26			
REV:	DATE:	DESCRIPTION	CHK'D		SERIAL CODE	PROJECT	SHEET	CONT'D				

4HE Coverplate
(former position of MOS switches rack)

The diagram shows a rectangular coverplate with four rounded corners. In the center, there is text indicating the former position of the MOS switches rack. The corners are marked with small circles, likely representing mounting holes.

				CUSTOMER : SLOVNAFT PLANT : BRATISLAVA : SLOVAKIA REQ/ORDER NO. :SRA7011259	RACK LAYOUT Rack 16 NON FSC I/O – REMOVED								PP3 UNIT ESD			
C	12–10–24	FSC–SM MIGRATION	PKO		 Honeywell Safety Management Systems 's–Hertogenbosch The Netherlands	DATE: 31–10–2003		BY: JH								
B	20–02–04	AS BUILD				DRAWING NUMBER										
A	01–12–03	REVISED				R1	530225	26	27							
O	31–10–03	FOR APPROVAL	JH			SERIAL CODE	PROJECT	SHEET	CONT'D							
REV:	DATE:	DESCRIPTION	CHK'D													

FSC Single I/O Rack with 10314/1/1 BackPlane

Internal Power CB: CP1/2=11CB2

SystemNo : 1
Cabinet : 2
Rack : 17

External Power CB

	11CB5	11CB5	11CB5	11CB5	11CB5	11CB5	11CB5	11CB5	11CB5	11CB5	11CB5	11CB5	11CB5	11CB5							
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21
	10101/2/1	10101/2/1	10101/2/1	10101/2/1	10101/2/1	10101/2/1	10101/2/1	10101/2/1	10101/2/1	10101/2/1	10101/2/1	10101/2/1	10101/2/1	Blank	Blank	Blank	Blank	Blank	Blank	Blank	10100/2/1 HBD 1.2.1
1																					
2																					
3																					
4																					
5																					
6																					
7																					
8																					
9																					
10																					
11																					
12																					
13																					
14																					
15																					
16																					

GR DI (NR/NI)

Central Part 1/2

SIC	SIC-C-12/L3.25	SIC-C-12/L3.25	SIC-C-12/L3.25	SIC-C-12/L3.25	SIC-C-12/L3.25	SIC-C-12/L3.25	SIC-C-12/L3.25	SIC-C-12/L3.25	SIC-C-12/L3.25	SIC-C-12/L3.25	SIC-C-12/L3.25	SIC-C-12/L3.25	SIC-C-12/L3.25	SIC-C-12/L3.25
FTA	DI_19	DI_20	DI_21	DI_22	DI_23	DI_24	DI_25	DI_26	DI_27	DI_28	DI_29	DI_30	DI_31	
TYP	FS-TSDI-16UNI	FS-TSDI-16UNI	FS-TSDI-16UNI	FS-TSDI-16UNI	FS-TSDI-16UNI	FS-TSDI-16UNI	FS-TSDI-16UNI	FS-TSDI-16UNI	FS-TSDI-16UNI	FS-TSDI-16UNI	FS-TSDI-16UNI	FS-TSDI-16UNI	FS-TSDI-16UNI	FS-TSDI-16UNI

C	12-10-24	FSC-SM MIGRATION	PKO
B	20-02-04	AS BUILD	
A	01-12-03	REVISED	
O	31-10-03	FOR APPROVAL	JH
REV:	DATE:	DESCRIPTION	CHK'D

CUSTOMER : SLOVNAFT
PLANT : BRATISLAVA
: SLOVAKIA
REQ/ORDER NO. :SRA7011259RACK LAYOUT
Rack 17 Single I/O

PP3 UNIT ESD

**Honeywell**
Safety Management Systems
's-Hertogenbosch The Netherlands

DATE:	31-10-2003	BY:	JH
DRAWING NUMBER			
R1	530225	27	-
SERIAL CODE	PROJECT	SHEET	CONT'D