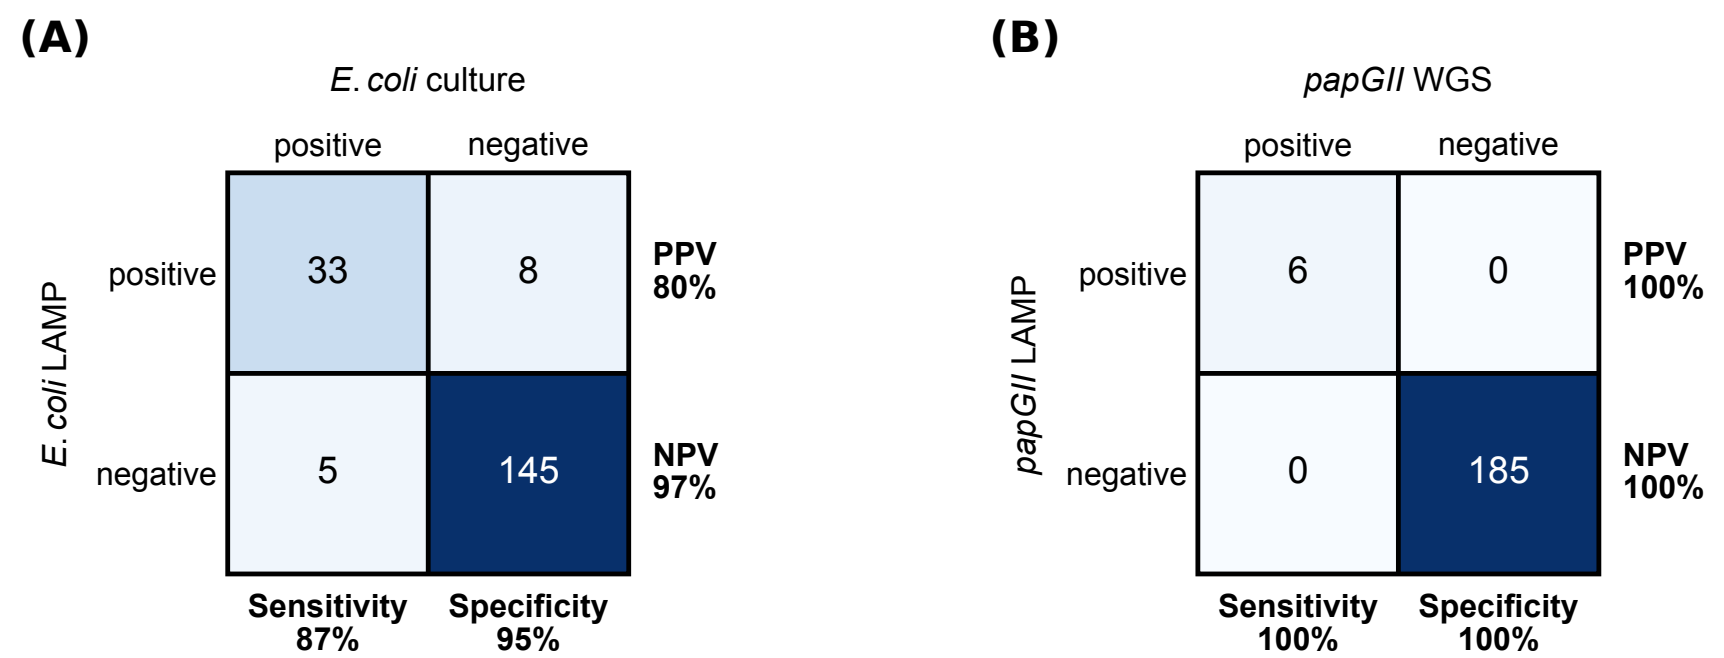
(A)
E. coli culture
positive
negative
E. coli LAMP
positive
negative
33
8
5
145
PPV
80%
NPV
97%
Sensitivity
87%
Specificity
95%
(B)
papGII WGS
positive
negative
papGII LAMP
positive
negative
6
0
0
185
PPV
100%
NPV
100%
Sensitivity
100%
Specificity
100%