

Reliability Performance Report, Reporting Year 2025

Sedgewater Energy Holdings | Reliability Engineering and Performance | 2026-03-20

This report sets out Sedgewater Electric Delivery's distribution reliability for calendar year 2025: system and district indices, causes, the June 2025 major event and the worst-performing feeder list. Figures follow version 3.1 of the Reliability Metric Definitions and Calculation Standard and match the annual service quality report filed on February 12, 2026.

Summary

Excluding major events, planned interruptions and outside causes, 2025 system SAIDI was 118.0 minutes, SAIFI 1.210 and CAIDI 97.5 minutes. Both indices are within the commission-set standards of 124 minutes and 1.28, before the 5% tolerance the rule allows.

Including the June 11-13 wind event, SAIDI was 305.7 minutes and SAIFI 1.365. The event met the major-event test and is reported separately below.

Measurement basis

The indices use 4,560 sustained forced interruptions from the outage management system and a denominator of 673,614 delivery points, the average of the twelve month-end counts for 2025. Six feeders moved from Crossroads to Bayou on July 1, 2025; interruptions are reported under the district that owned the feeder on the day they occurred, so district figures before and after July are not fully comparable.

Results by district

Prairie, with long rural overhead feeders, had the highest SAIDI; Harbor, the densest district, the lowest.

SAIDI / SAIFI excluding major events: Harbor 94.9 minutes / 1.085; Crossroads 107.4 minutes / 1.184; Bayou 123.8 minutes / 1.269; Prairie 159.2 minutes / 1.308.

Causes


Vegetation was the largest cause of forced customer minutes (26%), followed by overhead equipment (22%) and underground equipment (16%). Lightning and animals each contributed 10%, wind 9%, vehicles and public contact 4%, and unknown causes 3%. Cause was recorded as unknown for 4% of events; field crews are asked to update the cause code when the repair is closed.

June 11-13, 2025 wind event

Straight-line winds on June 11 mainly affected Prairie and Bayou. The event met the major-event test (loss of power to 10% or more of customers in a region over 24 hours, with not all restored within 24 hours). It accounted for 355 sustained interruptions affecting 104,000 customers and 126.4 million customer minutes. These interruptions are excluded from the headline indices.

Customer minutes by month, all interruption classes

The chart and the totals that follow cover every sustained interruption in the 2025 extract, including planned, outside-cause and major-event interruptions, so they are higher than the headline indices. June stands out because of the wind event.

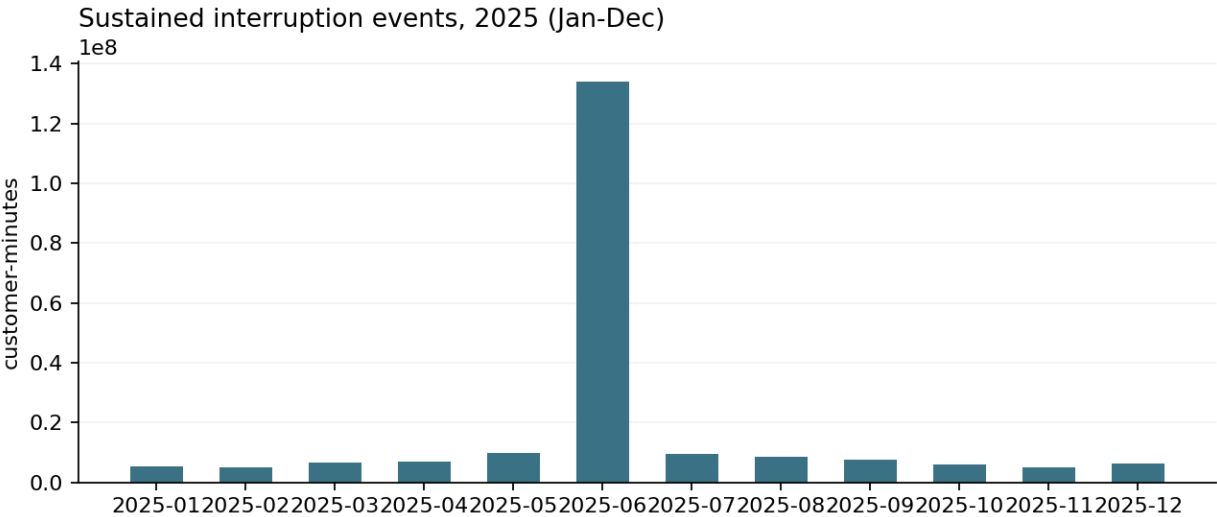

Measure	customer_minutes
Unit	customer-minutes
Total	211922230.0
Mean	40220.5789
Records	5269
Period	2025-01-01 to 2025-12-31

Measure	customers_interrupted
Unit	customers
Total	994701
Mean	188.7836
Records	5269
Period	2025-01-01 to 2025-12-31

Measure	duration_minutes
Unit	minutes

Total	1045435
Mean	198.4124
Records	5269
Period	2025-01-01 to 2025-12-31

Worst-performing feeders

The 2025 list has 32 feeders: the 22 with the highest SAIDI and the 22 with the highest SAIFI, each 5% of eligible feeders, with overlap. The current rule text uses a 300% threshold over two consecutive years; legislation passed in 2025 set a 200% threshold over any two-year period, and Sedgewater screens against both until the rule is amended.

Eighteen feeders had a 2025 SAIDI or SAIFI more than 200% above the feeder average (114.3 minutes and 1.12). Three of them were also above that level in 2024. Each listed feeder gets a remediation plan within 90 days: patrol and infrared scan, vegetation hot-spot work, fuse coordination and, where needed, recloser or automation.