

URS

USERS

- 2 ... New Features in Newly-Released EnergyPlus 1.0.3
- 2 ... EnergyPlus Training for Experienced Modelers
- 3 ... Ask an EnergyPlus Expert
 - Surface Vertices
- 3 ... Are You an EnergyPlus Consultant?
- 5 ... VisualDOE 3.1 – A New Tool for Green Building Design
- 11 ... DOE-2 Puzzler
 - MIN-SUPPLY-SCH vs. MIN-AIR-SCH
 - Control of Relative Humidity
 - Outside Air Intake
- 13 ... Release of DrawBDL 3.0
- 13 ... Minutes of the TC 4.7 Meeting from ASHRAE Honolulu
- 14 ... Release of WINDOW 5.1, THERM 5.1 and Optics 5.1
- 18 ... Changes to DOE-2.1E
- 19 ... Revised article: *Underground Surfaces: How to Get a Better Underground Surface Heat Transfer Calculation in DOE-2.1E.*

- 29 ... **BLAST News**
- 10 ... **Building Design Advisor 3.0**
- 17 ... **DOE-2.1E**
 - 18 Training, Help Desk
 - 29 Software and Services
- 27 ... **ENERGY-10 1.5**
- 3 ... **EnergyPlus 1.0.3**
 - 4 Weather Data
 - 13 User Group
 - 28 Software and Services
- 4 ... **GenOpt 1.1.2**
- 27 ... **Building Simulation Software from Lawrence Berkeley Laboratory**
- 43 ... **Support Tools for EnergyPlus and DOE-2 from The Deringer Group**
- 18 ... **VisualSPARK 1.0.2**

10 ... BLDG-SIM Mailing List
30 ... Meetings, Conferences, Symposia

EnergyPlus Version 1.0.3 Released

To download a free copy of the program go to
www.energyplus.gov



New Features in EnergyPlus Version 1.0.3

- Composite Constructions data set
- Variable-Speed Fans
- Cooling Tower improvements
- Many COMIS improvements (e.g., air flow through interzone windows and doors, venting through openable doors, add "no vent" strategy)
- Pond heat exchanger
- Ground surface heat exchanger
- Coldest-Zone supply air set point strategy
- Atmospheric pollution calculation
- Design Day "inputs" from weather files
- Entire Design Conditions produced as Location-Design Day combo dataset file
- New input file example for each new feature
- Weather data interpolation (from hourly to time step)
- Improved reporting (e.g., Weather statistics)
- Search capability (Acrobat index) for all documentation
- Improved documentation (Output Details document, expanded Input Output Reference and Engineering Reference, Auxiliary Programs)

EnergyPlus Training for Experienced Modelers

January 29-31, 2003, Chicago, Illinois, USA

An EnergyPlus training course is being offered immediately following the Chicago ASHRAE meeting in January.

The course schedule is:

Wednesday, January 29, 2:00 to 6:00 pm

Thursday, January 30, 8:30 am to 5:30 pm

Friday, January 31, 8:30 am to 1:00 pm

This workshop will introduce EnergyPlus to experienced modelers who are familiar with the basic concepts of energy simulation. The course will cover the mechanics of using EnergyPlus with an emphasis on aspects of EnergyPlus that differ substantially from other common modeling tools (e.g., DOE-2 and BLAST), such as the use of a sub-hour time-steps, the integrated simulation of loads, systems and plant; and defining fluid and air loops. Bring your own laptop for the hands-on workshop sessions. The course will be held in "the loop" in Chicago at the Crowne Plaza Silversmith, 10 South Wabash Avenue (1 block north of the Palmer House Hilton which is the ASHRAE headquarters hotel). For more details please see <http://www.gard.com/training.htm>



Ask An EnergyPlus Expert



Question: Surface Vertices

Following the convention in the object SurfaceGeometry, from which side do the surfaces need to be faced: inside or outside? And what about floor and ceiling?

Answer:

The surface geometry rules are applied when viewing a surface from its exterior side, as if you are standing outside the zone looking at a surface.

For ceilings, view from above, for floors, view from below. The choice of which vertex is the starting point is arbitrary. Any corner may be selected, but you must follow the correct clockwise or counterclockwise order for the remaining vertices. An implied azimuth is computed based on your selection of starting vertex.

To verify your geometry, request the surface details report: REPORT, Surfaces, Details;

This produces a summary of all surfaces with length, width, tilt, and azimuth in the eio output file. For ease of reading, paste the report into a spreadsheet program and separate on commas.

The IOReference states:

Field: VertexEntry

Surfaces are always specified as being viewed from the outside of the zone to which they belong. (Shading surfaces are specified slightly differently and are discussed under the particular types). EnergyPlus needs to know whether the surfaces are being specified in counterclockwise or clockwise order (from the SurfaceStartingPosition). EnergyPlus uses this to determine the outward facing normal for the surface (which is the facing angle of the surface very important in shading and shadowing calculations).

Surfaces are always specified from the "outside" of the surface.

EnergyPlus is being developed by University of Illinois, CERL, and Lawrence Berkeley National Laboratory, with the assistance of the Florida Solar Energy Center, GARD Analytics, the University of Wisconsin, Oklahoma State University and others. Development of EnergyPlus is supported by the U. S. Department of Energy, Dru Crawley, Program Manager.

Are you an EnergyPlus Consultant ?


If you are engaged in EnergyPlus consulting, and would like to be listed in the *Building Energy Simulation User News* and on our website (<http://SimulationResearch.lbl.gov>), please send email to klellington@lbl.gov.



The developers of EnergyPlus have formed a support group to foster discussion and maintain an archive of information for program Users. We invite questions about program usage and suggestions for improvement to the code. Go to groups.yahoo.com/group/EnergyPlus_Support/

EnergyPlus Weather Data

The EnergyPlus development team is pleased to announce that our web site now offers more than 570 weather locations available for download and ready to use with EnergyPlus. There are 275 locations in the United States, 16 California thermal zones, 55 Canadian locations, and 233 international locations in more than 80 countries.



Go to www.energyplus.gov

On the right side, under Weather Data, click on one of the following links:
USA, California, Canada or International.

We recommend that you also download the weather utility RPT file for each location. The RPT file includes design data where available, statistics for the weather file, including typical and extreme periods (hottest summer week, coldest winter week, typical spring week, etc), Koppen climate classification, heating and cooling degree days, monthly average minimum and maximum dry bulb and dew point temperatures, undisturbed ground temperatures, direct and diffuse solar radiation, relative humidity, and wind speed and direction.

GenOpt 1.1.2

Generic Optimization Program

GenOpt is a multi-parameter optimization program; it automatically finds the values of user-selected design parameters that minimize a cost function, such as annual energy use, calculated by an external simulation program like EnergyPlus, SPARK, DOE-2, BLAST, TRACE, TRNSYS, etc.

GenOpt can be used with any simulation program that has text-based input and output. It also offers an interface for adding custom optimization algorithms to its library.

Release of GenOpt 1.1.2

GenOpt 1.1.2 fixes problems in reading simulation output files where the objective function value is followed by a comma. Such output strings can be found, for example, in some EnergyPlus outputs.

Also, a method called 'postProcessObjectiveFunction(int, double[] f)' has been added to the file named 'Optimizer.java'. You can modify this function to easily implement post-processing of the objective function value, such as adding two outputs to seek the minimum of the sum of the two outputs.

Example files have been added to the **GenOpt** web page (<http://SimulationResearch.lbl.gov> > GenOpt) to help users set up the program to optimize EnergyPlus simulations. **GenOpt** input files still have the same syntax as in version 1.1.1. Therefore, your **GenOpt** input files are compatible with the new version.

GenOpt 1.1.2 (with user manual) may be downloaded free of charge from
<http://SimulationResearch.lbl.gov> > **GenOpt**

VisualDOE 3.1 – A New Tool for Green Building Design

Eley Associates is pleased to announce Version 3.1 of VisualDOE, a program for performing whole-building energy analysis using DOE-2.1E on PCs running MS Windows 95/98/NT/Me/2000/XP.

VisualDOE 3.1 is a new green-building design tool that allows users to evaluate energy and demand impacts of design alternatives. The program covers all major building systems, including building envelope, lighting, daylighting, water heating, HVAC and central plant.

The first release of VisualDOE in 1994 dramatically reduced the time required to perform accurate energy simulations. Version 3.1 takes this ease-of-use and power to a new level. The program is targeted for architects, engineers, MEP firms, energy consultants, utilities, national laboratories, universities, energy service companies, HVAC equipment manufacturers, and building product manufacturers.

Features in VisualDOE 3.1

- Faster modeling and easier simulation results diagnosis
- LEED style end-use report
- Life-cycle cost analysis of design alternatives
- Supports both SI (metric) and IP units. All reports are revised for SI units
- Free LiveUpdate via the internet to download and install new features
- Modeling Tips to save your time and help diagnose simulation results
- Create up to 99 design alternatives within a project file
- Weather File Converter to pack and unpack DOE-2 weather files
- Create a big energy model with up to 1024 zones and 256 systems
- Re-use data from libraries, templates, and previous projects
- Show building statistics while you build an energy model
- Improved custom block editor and DXF file import to create complicated building shapes
- New 3D view controls
- Enhanced VisualDOE Reports for more useful information of the building, zones and systems
- Share library file to make VisualDOE network compatible
- Export simulation reports to RTF or PDF files
- Complete PDF documentation of DOE-2.1E and VisualDOE
- One-stop editor showing files of input, BDL, output, hourly reports, and weather statistics
- Flexible data input of room internal heat gains in either power density or total power use
- Flexible data input of zone air flow. Air flow autosized or manually sized
- Autosize or manually size systems and central plants
- Define source energy use and process loads of a room
- Adds escalation rate at the utility rate editor for life-cycle cost calculation
- Adds emissivity to the outside surface of a construction under construction editor
- Timely updated user resources and online technical support
- Hundreds of weather files for US and international countries
- Share your VisualDOE experience with ~1,500 users in more than 35 countries
- Periodic professional training seminars
- Future integration of other calculation engines like EnergyPlus

Ordering Information

Eley Associates offers a flexible licensing policy for different types of users. For license details, free demo download and ordering, please visit www.eley.com or contact:

Eley Associates

142 Minna Street, Second Floor

San Francisco, CA 94105

Phone: (415) 957-1977 Fax: (415) 957-1381

Email: sales@eley.com, support@eley.com

VisualDOE 3.1 Interface – Sample Screen Shots

VisualDOE 3.1 - Training Exercise

File Edit Alternatives Simulation Organizers Tools Help

Project Blocks Rooms Facades Systems Zones

Project Name: Training Exercise Energy Analyst: moi

Address: Address

Description: This is a 19-story hotel

Era Built: 1989 to present Front Azimuth: 0 degrees

Climate Zone: CZ03RV2 Site Elevation: 50 ft

Holiday Set: Official US Discount Rate: 10 %

Project Life Cycle: 20 years

Energy Resources

#of Meters	Utility Rates
Electricity: 1	Elec Rate 66
Fuel: 1	Gas Rate 67

Building statistics (accurate after simulations are run)

Gross Floor Area: 492200	Conditioned Floor Area: 492200
Window Area: 32528	Skylight Area: 0
Window-Wall-Ratio: 0.212	Skylight-Roof-Ratio: 0

Area in m² for SI and ft² for IP units.

Refresh 3D Image Show 3D View

C:\Dev\VISDOE\Training\2002\Training Files\Exercise.gph Base Case X = 196 Y = -4 IP Units 11/16/2002


VisualDOE 3.1 Main Form

End-Use Summary for Base Case


Component	Type	Annual Energy Use (MBtu)	Annual Energy Use per Conditioned Floor Area (kBtu/ft ²)	Peak Demand (kBtu/h)
Lighting	Electricity	7053.1	14.33	1772.37
Office Equipment	Electricity	3664.6	7.45	910.93
Space Cooling	Electricity	3568.2	7.25	1266.22
Heat Rejection	Electricity	645.3	1.31	159.05
Pumps	Electricity	220.7	0.45	44.37
Fans	Electricity	8102.7	16.46	1019.46
Space Heating	Gas	2374.2	4.82	2301
Service Water Heating	Gas	95.3	0.19	20

Copy OK


Reports – LEED Style

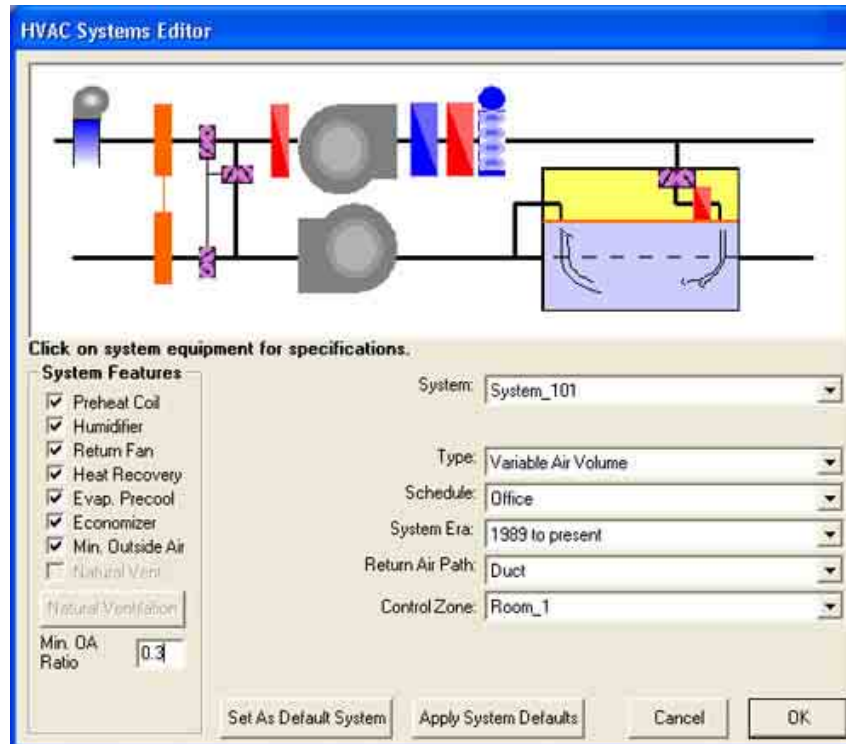


HVAC System Editor

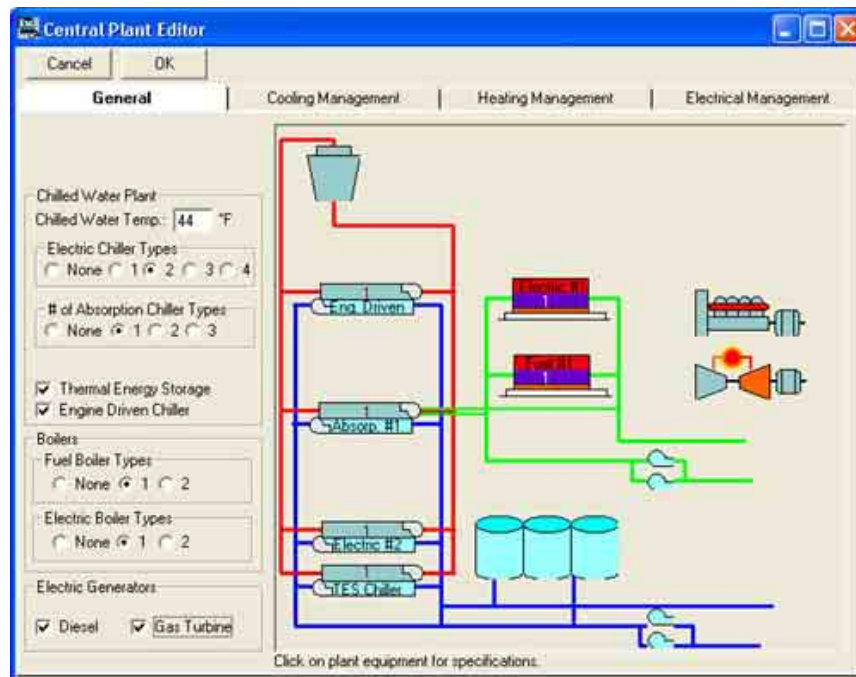

Central Plant Editor

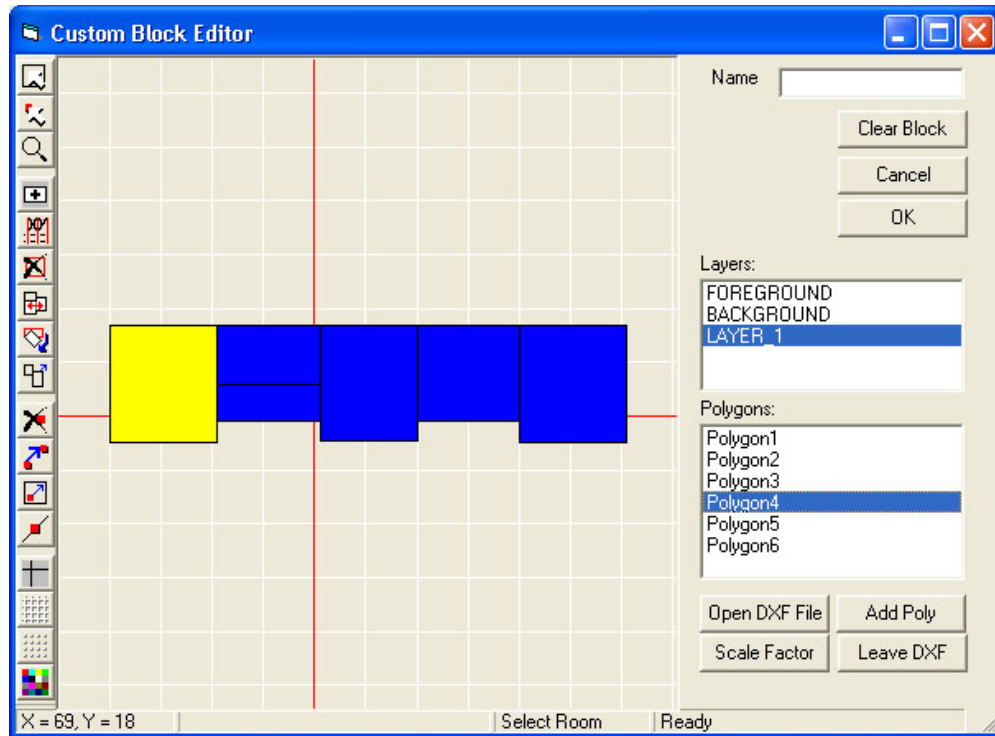

Custom Block Editor – DXF Import

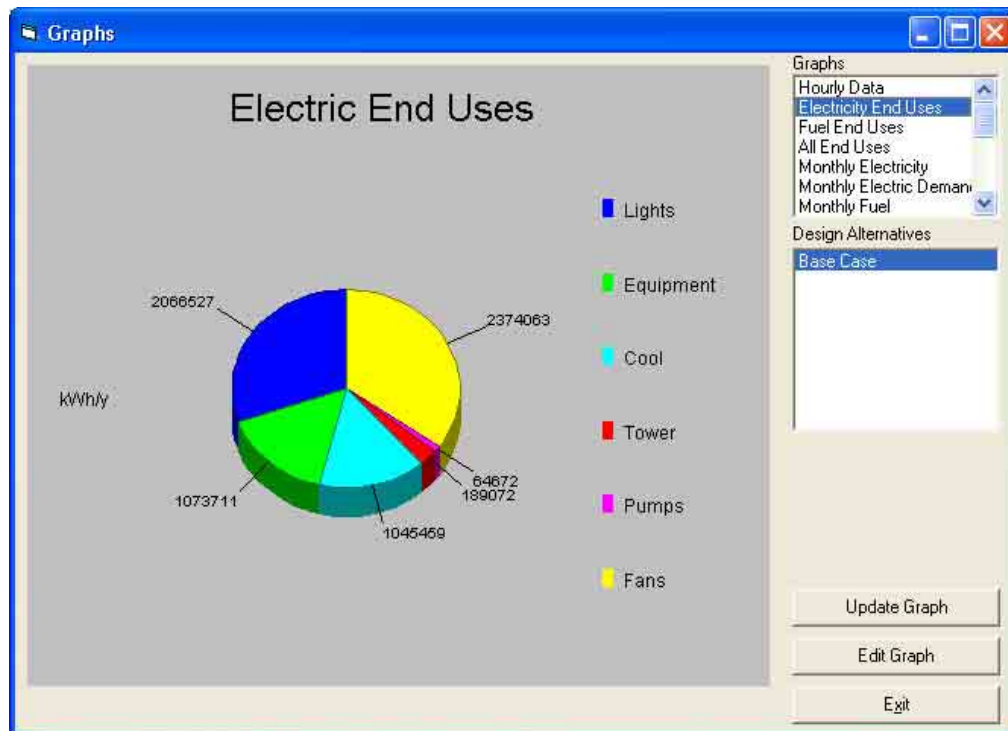

Reports – End-Use

VisualDOE 3.1 - Systems Summary

November 16, 2002

Project Information

Name: Training Exercise
Address: Address
Description: This is a 19-story hotel
Analysis done by: moi @ Eley Associates
Project File: c:\dev\visdoe\training\2002\training files\exercise.gph
Case Name: Base Case
Case Description: Base Case
Number of Systems: 9

Systems Summary

Name	Type	Cond. Area (ft ²)	Supply (CFM)	Min. OA	Cooling Cap (kBtu/h)	Heating Cap (kBtu/h)	Cooling Peak (kBtu/h)	Heating Peak (kBtu/h)	Cooling Energy (MBtu)	Heating Energy (MBtu)
Asm VAV	VAVS	115200	120000	0.307	5465.6	0	2174.1	1092.6	2553	237
1Guest Room	FPFC	7500	3750	0.12	0	0	87.6	63	100	53
Restaurant CAV	RHFS	8000	15000	0.393	685.5	0	611.2	314.2	1111	1216
2Guest Room	FPFC	7500	3750	0.12	0	0	155	67	256	43
3Guest Room	FPFC	39000	19500	0.12	0	0	607.5	168.7	1151	39
4Guest Room	FPFC	10500	5250	0.12	0	0	205.2	75.7	412	19
5Guest Room	FPFC	13500	6750	0.12	0	0	240.4	87	439	32
6Guest Room	FPFC	36000	18000	0.12	0	0	510	159.2	593	57
7Guest Room	FPFC	255000	127500	0.12	0	0	1642.1	0	6326	0

Systems Summary per Conditioned Area

Name	Type	Cond. Area (ft ²)	Supply (CFM/ft ²)	Min. OA	Cooling Cap (Btu/h/ft ²)	Heating Cap (Btu/h/ft ²)	Cooling Peak (Btu/h/ft ²)	Heating Peak (Btu/h/ft ²)	Cooling Energy (kBtu/ft ²)	Heating Energy (kBtu/ft ²)
Asm VAV	VAVS	115200	1.042	0.307	47	0	19	9	22	2
1Guest Room	FPFC	7500	0.5	0.12	0	0	12	8	13	7
Restaurant CAV	RHFS	8000	1.875	0.393	86	0	76	39	139	152
2Guest Room	FPFC	7500	0.5	0.12	0	0	21	9	34	6
3Guest Room	FPFC	39000	0.5	0.12	0	0	16	4	30	1
4Guest Room	FPFC	10500	0.5	0.12	0	0	20	7	39	2
5Guest Room	FPFC	13500	0.5	0.12	0	0	18	6	33	2
6Guest Room	FPFC	36000	0.5	0.12	0	0	14	4	16	2
7Guest Room	FPFC	255000	0.5	0.12	0	0	6	0	25	0

Reports – Systems Summary

VisualDOE 3.1 - Results

November 23, 2002

Energy Cost Summary (\$/y)

Alternative	Total Electric	Total Fuel	Total Utility	Incremental First Cost	Life Cycle Cost*
Total Energy Costs (\$/y)					
As-Designed	\$637,529	\$45,921	\$683,450	\$0	\$5,818,595
EEM2 - Efficient Lighting	\$523,464	\$46,964	\$570,428	\$50,000	\$4,906,375
EEM10 - Cool Roof	\$506,926	\$49,087	\$556,013	\$0	\$4,733,652
Incremental Energy Savings (\$/y) (compared with previous alternative, negative savings represent increases)					
EEM2 - Efficient Lighting	\$114,065	\$-1,043	\$113,022	\$-50,000	\$912,220
EEM10 - Cool Roof	\$16,538	\$-2,123	\$14,415	\$50,000	\$172,723

* 20 year life cycle w/ 10% discount rate.

Results – Life Cycle Cost

Building Design Advisor 3.0

*Decision making through the
integrated use of multiple
simulation tools and
databases*

The **Building Design Advisor (BDA)** is a Windows® program that addresses the needs of building decision-makers from the initial, schematic phases of building design through the detailed specification of building components and systems. The BDA is built around an object-oriented representation of the building and its context, which is mapped onto the corresponding representations of multiple tools and databases. It then acts as a **data manager** and **process controller**, automatically preparing input to simulation tools and integrating their output in ways that support multi-criterion decision-making. BDA 3.0 includes links to **SGE** (a graphical editor for schematic design), **DELIGHT** (a daylighting simulation tool), **ECM** (a simplified electric lighting simulation tool) and the **DOE-2.1E** building energy simulation program.

ECM, an **electric lighting simulation tool**, is integrated through BDA with DOE-2. BDA's Schematic Graphic Editor (**SGE**) allows placement of electric lighting luminaires and specification of reference points for daylight-based electric lighting controls. Moreover, BDA has the capability of **running DOE-2 parametrically** to generate a plot that shows the relationship between effective aperture and energy requirements. There is also the added functionality of working with either **English units or Metric units**.

Current development efforts are focused on the completion of BDA 3.1, which includes computation of operating energy costs. To download a free copy of BDA 3.0, go to

<http://gaia.lbl.gov/BDA/index.html>

The BDA source code is available for licensing; if interested, please contact Dr. Papamichael at K_Papamichael@lbl.gov.

For Beta Testing of BDA 3.1, contact Kosta Papamichael at k_papamichael@lbl.gov.

JOIN THE BLDG-SIM MAILING LIST

BLDG-SIM is a mailing list for users of building energy simulation programs like EnergyPlus, DOE-2, Trace-600, HAP, BLAST, ESP, SERIRES, TRNSYS, TASE, ENERGY-10 and others.

Because building simulation professionals are located worldwide, the BLDG-SIM list is an attempt to foster the development of a community of those users. Users of all levels of expertise are welcome and are encouraged to share their questions and insights about these programs.

The web page for BLDG-SIM is <http://www.gard.com/bldg-sim.htm>

Jason Glazer, P.E., Of GARD Analytics, Inc. is the list administrator (jglazer@gard.com).



You are invited to test **DoeRayMe**, a new DOE-2.1E screening tool application currently being developed by Jason Glazer, P. E., of GARD Analytics, Inc. **DoeRayMe** is a simple and flexible interface that uses a specially developed DOE-2 input file (template) that contains special codes describing the parameters available to

be changed in the user interface. This allows new screening tools to be developed by any DOE-2 user. Please visit the **DoeRayMe** web site at <http://www.gard.com/DoeRayMe>.




DOE-2 Puzzler

Question:

I'm seeing strange values of TCMIN in my hourly output from systems. Why is TCMIN often below 32°F?

MIN-SUPPLY-SCH vs. MIN-AIR-SCH

What's the Difference?



Answer:

I found the cause of the unphysical (less than freezing) TCMIN you were seeing in your DOE-2 runs. In DOE-2 TCMIN is calculated as:

$$\text{TCMIN} = \text{PASTM} - (\text{QCS} / (\text{CONS}(1) * \text{PASTCFM})) \quad (1)$$

where PASTM is last hour's mixed air temperature, QCS is the sensible capacity of the cooling coil this hour, and PASTCFM is last hour's flow rate. Obviously this formula can give quite a low TCMIN if there is a normal amount of capacity. TCMIN is then adjusted for fan heat and duct losses. Finally limits are applied to TCMIN as follows:

$$\text{TCMIN} = \text{AMAX1}(\text{TCMIN}, \text{AMIN1}(\text{PASTM} + \text{DTF}, \text{MIN-SUPPLY-T} + \text{TCR})) \quad (2)$$

where MIN-SUPPLY-T is the user input minimum possible supply temperature. DTF is the fan and duct loss adjustment, TCR is the cooling supply temperature throttling range. So equation (2) overrides the values calculated in equation (1).

You input MIN-SUPPLY-T=55 and the hourly reports show that the mixed air temperature is normal. So what went wrong? You also input MIN-SUPPLY-SCH=LAB-MCR-SCH and LAB-MCR-SCH=SCH

```
THRU DEC 31
(WD) (1,24) (0.50)
$ (WD) (1,7) (0.50)
$ (8,14) (0.50)
$ (15) (1.000)
$ (16,18) (0.50)
$ (19,24) (0.50)
(WEH) (1,24) (0.50) $(-999)
```

MIN-SUPPLY-SCH is a scheduled value for MIN-SUPPLY-T and its hourly values override MIN-SUPPLY-T. You have set the hourly value of MIN-SUPPLY-T to 0.5°F. Undoubtedly, you meant to use MIN-AIR-SCH=LAB-MCR-SCH, thus setting a scheduled value for the minimum cfm ratio. Anyway the upshot is that an unphysical input for either MIN-SUPPLY-T or MIN-SUPPLY-SCH will yield unphysical values for TCMIN. MIN-SUPPLY-T defaults to 55, so a minimal input will be okay. MIN-SUPPLY-SCH is documented on page 3.127 of the DOE-2.1E Supplement, as follows:

MIN-SUPPLY-SCH: This keyword allows you to specify the value of MIN-SUPPLY-T on an hourly basis to simulate the effect of chilled water reset (or other types of capacity control) coil performance. The coil minimum conditions will be based on the value of this schedule rather than the value of MIN-SUPPLY-T. MIN-SUPPLY-T will be used in design calculations for coil and system component sizing only. The values in the schedule are used to calculate the coil surface conditions (temperature and moisture condensation), but are not used to set the supply air controller (if present) except that the supply temperature cannot go below this value (adjusted for fan heat and duct losses). The value specified in this schedule should be coordinated with the COOL-CONTROL method and related schedules, reset schedules or setpoints, as well as coil performance parameters.

DOE-2 Puzzler

Control of Relative Humidity

Question:

I am having big problems controlling relative humidity. I have modeled a school with SZRH (one zone per system) and, although I have lowered MIN-SUPPLY-T down to 50°F, RH exceeds 50% for too much of the time in high occupancy classrooms (Report SS-N). I have also modeled a low occupancy office building with VVS and the RH scatter plot (Report SS-N) shows most of the occupied hours having RH above 50%. Is there a problem with DOE-2.1E or with me? Perhaps cooling coil simulation is outdated; new installations often use 6-row coils.

Answer:

I don't think SZRH will give good humidity control since it is a variable temperature system. When the cooling load is low the supply temperature will rise and do little or no dehumidifying. You can use a constant temperature system, such as VAV, or you can specify a humidity controller. Try using MAX-HUMIDITY=50 in the SYSTEM-CONTROL command then try the same thing with VVS. Also you can always change the coil bypass factor to change the coil performance (smaller CBF means more dehumidification).

Outside Air Intake

Question:

Can outside air intake be linked to occupancy? I want to simulate CO2 sensors controlling OAI.

Answer:

No. You have to do this by hand by using the MIN-AIR-SCH to match the occupancy (given by the occupancy schedule).

Question:

Can outside air intake be scheduled? I want to shut it off during unoccupied periods.

Answer:

Yes. The keyword is MIN-AIR-SCH in the SYSTEM-AIR command. A schedule value of 0 means no outside air flow, a value of 1 means 100% outside air. A value of -999. means ignore the scheduled value and do the normal calculation including possible economizer operation.



Email your "DOE-2 Puzzler" questions to
klellington@lbl.gov


The Building Energy Simulation User News is published bi-monthly and distributed electronically by the Simulation Research Group at Lawrence Berkeley National Laboratory. Direct comments or submissions to Kathy Ellington (KLEllington@lbl.gov). Direct BLAST-related inquiries to the Building Systems Laboratory (support@blast.bso.uiuc.edu).

© 2002 Regents of the University of California, Lawrence Berkeley National Laboratory. This work was supported by the Assistant Secretary for Energy Efficiency and Renewable Energy, Office of the Building Technologies Program, State and Community Programs, Office of Building Systems of the U.S. Dept. of Energy, under Contract No. DE-AC03-76SF00098

DrawBDL 3.0

Joe Huang and Associates is pleased to announce Version 3.0 of the *DrawBDL* program for viewing the building geometry in DOE-2 input and output files. We have completely rewritten *DrawBDL* using C++ to run in a native 32 bit environment such as Windows 95/2000/NT. In addition to having a somewhat different look and feel, Version 3.0 has the following improvements:

1. New user interface with a hierarchical tree showing all building surfaces.
2. No limit on the number of building surfaces, except for the amount of memory available on the computer.
3. For building surfaces, the expanded data window shows not only the input values, but also their locations in the global coordinate system; for spaces, the data window shows the gross and net areas of walls, windows, doors, roofs, and skylights.
4. Displays surfaces input as two-dimensional or three-dimensional polygons (please see DOE-2.1E Documentation Update #2 http://SimulationResearch.lbl.gov/dirsoft/21e_update2.pdf for the syntax to input surfaces as polygons).
5. Changing the sort order of building surfaces used in the display; this allows users to "touch up" the shaded drawings for use in presentations.
6. Output the surface data in *EnergyPlus* *.idf format. This is helpful for *DrawBDL* users who wish to convert their DOE-2 input files into *EnergyPlus* input files. Since *DrawBDL* reads and stores only building surface data, the converted *EnergyPlus* file is a partial file containing only the inputs for building surfaces.

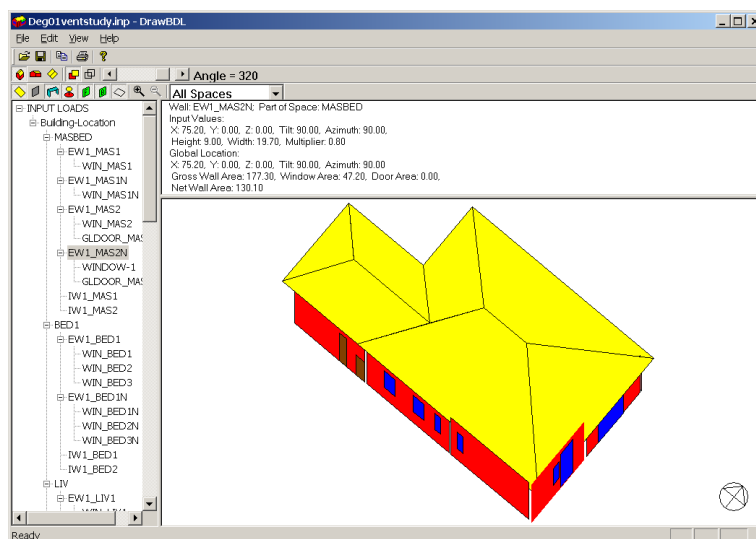

DrawBDL 3.0

DrawBDL 3.0 costs \$125 plus shipping; for more information or to order, please contact

Joe Huang and Associates
31 Sarah Lane Phone 925-247-9180
Moraga CA 94553 email: tmchow@compuserve.com

The minutes from the ASHRAE's Honolulu meeting are now on the TC4.7

web page for downloading. They are in Word and Pdf format.

The home page URL is <http://www.mae.okstate.edu/tc47/index.html>

WINDOW 5.1, THERM 5.1 and Optics 5.1

Updates and Enhancements

WINDOW 5.1

WINDOW 5.1 calculates total window thermal performance indices (i.e. U-values, solar heat gain coefficients, shading coefficients, and visible transmittances) and provides a versatile heat transfer analysis method consistent with the updated rating procedure developed by the National Fenestration Rating Council. The program also has a link to both EnergyPlus and the DOE-2.1E building energy analysis programs. WINDOW 5.1 includes all of the WINDOW 5.0 and 5.02 capabilities, and includes the ability to read the combined Condensation Resistance and U-factor results generated by THERM.

Program Updates

WINDOW 5.1, a significant upgrade to previous versions, offers these new features:

- State of the art Microsoft Windows™ interface
- Updated algorithms for the calculation of total fenestration product U-values and Solar Heat Gain Coefficient consistent with ASHRAE SPC142, ISO15099, and the National Fenestration Rating Council
- A Condensation Resistance Index in accordance with the NFRC 500 Standard
- A surface temperature map
- An integrated database of properties
- Links to other LBNL window analysis software:
 - THERM for calculating 2-D frame and edge effects
 - RESFEN, for calculating the energy effects of windows for US residences
 - Optics 5 for the optical properties of all coated and uncoated glazings, laminates, and applied films

In General

- A New, Copy, Delete, Save and Report buttons to all the Library Detailed view has been added.
- The ability to import and overwrite protected records with protected records from another WINDOW 5.1 database has been added.
- A database "Compacting" feature in the Tools menu has been added; this is useful when records have been deleted.

Optics 5.1

Optics 5.1 allows you to view and modify glazing data in many new and powerful ways. Optics 5.1 is compatible with WINDOW 5.1 and can be downloaded from <http://windows.lbl.gov/materials/optics5/default.htm>.

Optics 5.1 Features, Corrections, Changes

Glazing Layers

- Manipulating layers (changing thickness, substrate, film and/or coating) can be done inside laminates and glazing systems.
- User-manipulated glazing layers will automatically be assigned an NFRC_ID of 30,000 or higher and the user is forced to change the filename of this layer and/or its substrate to denote that the properties have changed. This will prevent entries in the WINDOW 5.1 database from being overwritten automatically when importing NFRC-accepted files.
- It is now possible to create double-coated glazings, i.e., glazings with a coating on each side. These double-coated glazings can be saved to a database but cannot be manipulated any further after the second coating is applied.
- It is now possible to create glazings with a coating on one side and an applied film on the other side by applying a film to a coated glazing. These special glazings can be saved to a user database but cannot be manipulated any further after the film is applied.

Glazing Systems

- Multilayer glazing systems are no longer limited to five layers (glazing slots). A glazing system can consist of any number of layers.
- The user may now change the gap width. The same gap width is used between all layers in the schematic view. Gap width does not affect optical properties.
- Glazing systems are now saved to the user database as type "Glazing system." This type of glazing and the type "Interlayer" cannot be exported to WINDOW 5.1. Saved glazing systems can be re-loaded and edited later.

Continued on the next page

WINDOW 5.1, THERM 5.1 and Optics 5.1 -- Updates and Enhancements

Continued

WINDOW 5.1 Features, Corrections, Changes

Glazing System Library

- Added a tab in the Results section for Angular Data.
- Added a Glazing System Report (similar to that in WINDOW 4.1) that includes both the angular dependence table and the temperature information.
- Added damage-weighted UV Transmittance calculations for both Krochman and ISO methodologies

Glass Library

- Implemented a *checksum* feature, at both glass layer import and also at calculation time, which checks to see that the spectral data in the Glass Library has not been altered from that of the International Glazing Database. If the checksum does not compute correctly, WINDOW will automatically remove the # value.
- Conductivity of the glass layers from the International Glazing Database has been set to 1.0. This will minimally change the U-factor calculations.
- When importing records from the International Glazing Database, the IGDB version number is displayed.
- Reads Optics 5.1-format databases.
- Added ability to change the ID of a record imported from the Optics5 user database.
- Changed what the program prepends in the Source field when importing records:
 - importing from the International Glazing Database prepends "IDGB < db version #>" and
 - importing from an Optics5 user database prepends "IGDB User."

Gas Library

- The gas properties reported in the DOE-2 report are now correct.

Frame Library

- The THERM file paths are now relative to the currently open database (MDB) file.
- Improved the speed of importing THERM files.
- Fixed a problem for Microsoft Windows XP and 2000 operating systems that caused a large increase in memory use when importing THERM files.
- Fixed a crash when going from the List View to the Detail View.

Optics 5.1 Features, Corrections, Changes

Laminates

- The laminate editor is no longer a separate program. Creating new laminates from existing components can be done in Optics 5.1.
- It is now possible to create laminates with embedded coatings, i.e., coatings on a glass layer next to an interlayer. This can only be done when the coating manufacturer has supplied enough information to allow Optics 5.1 to perform such an operation.
- Laminates are no longer limited to six layers; a laminate can consist of any number of layers.
- The program supplies improved feedback when the user tries to create an invalid laminate (e.g., when trying to combine two rigid layers without an interlayer).

Databases

- Optics 5.1 only works with the International Glazing Database (IGDB) version 12.3 and higher.
- The glazings are automatically sorted into groups that show the possible operation that can be done; for example:
 - Embedded coatings are grouped under a tab called 'Embedded coatings.'
 - When applying a new coating to a glazing, Optics 5.1 will only show the new coatings that can be used for this operation.
- It is now possible to switch between multiple user databases.
- A 'Find' feature has been added to quickly find glazings by their filename, NFRC_ID, product name, etc.
- The glazing type "interlayer" has been added.
- Reference laminates that are used to calculate interlayer data, but that have missing or incomplete structure information, are not shown in the database.

Standards - Wavelength Sets

- The default standard is called "W5_NFRC_2003." This standard is to be applied for NFRC rating purposes and supercedes the older standards. All values in the database are calculated with the "W5_NFRC_2003" standard. Other standards that are still supported are: "CRI," "ISO_9050" and "prEN_410." The RADIANCE standard is used internally to export RADIANCE text files.

Continued on the next page

WINDOW 5.1, THERM 5.1 and Optics 5.1 -- Updates and Enhancements

Continued

THERM 5.1

THERM models two-dimensional heat-transfer effects in building components such as windows, walls, foundations, roofs, doors, appliances and other products where thermal bridges are a concern. THERM allows you to evaluate a product's energy efficiency and local temperature patterns, which may relate directly to problems with condensation, moisture damage, and structural integrity.

Updates from THERM 5.0 to THERM 5.1

In General

- Program no longer requires that the simulation results be saved in order to import the CR results into WINDOW 5.1.
- Fixed several problems that had resulted in program crashes.

Frame Cavities

- Added the ability to change emissivities for any boundary segment in a frame cavity.

Boundary Conditions

- Program now picks up the emissivity values for the boundary conditions from the adjacent materials.
- Improvements in boundary condition generation, particularly when existing boundary conditions have been changed or deleted. Program now has three options to pick from when generating boundary conditions to accommodate all the possibilities.

THERM 5.1 may be downloaded from <http://windows.lbl.gov/software/therm/therm.html>. If you download THERM 5.1, and you also use the WINDOW program, you should also download WINDOW 5.1.



Optics 5.1 Features, Corrections, Changes

- The only and default wavelength set that is used is "Optics5." This wavelength set is similar to the one that is required according to the data submission procedures of the International Glazing Database.
- A second wavelength set ("Color 5nm") is only used internally by Optics 5.1 to calculate photopic properties according to certain standards that require this wavelength set.

User interface

- Improved feedback in the form of tooltips.
- Warns when a calculation results in errors or when results are less reliable due to lack of information. Warnings are listed per wavelength and can be exported to a text file for further analysis.
- OLE-drag-and-drop from the database to the glazing slots and to other programs.
- Quick link to the internet to check for the latest version of the International Glazing Database.
- The database grid uses bookmarks to automatically look up the most recent selected glazing in the database grid.

Removed Features

- For the time being, the program is no longer supporting the calculation of angle dependent properties. In a future version of Optics, angle dependent calculations will probably be re-instated in a different form, giving the spectral averaged properties as a function of the angle of incidence.
- Optics is no longer supporting thermal calculations (U-value, SHG-value). These calculations were incorporated by request for a quick comparison. However, other software, such as WINDOW 5.1, may be used to calculate the thermal properties.
- Some older wavelength sets have been removed. Optics still supports the use of various wavelength sets for experienced users; however, these are no longer distributed with the program in order to avoid confusion about the use of these sets.
- The installation package no longer supports Windows 95. Microsoft stopped its official support for Windows 95 and, since some programming components no longer support Windows95, it was decided that we could no longer support installation on a Windows 95 platform. You can still install Optics on a Windows 95 system, which will usually work out fine, but it is not supported officially.



DOE-2



DOE-2.1E (v. 119) 1,000-Zone version for Windows from ESTSC; other vendors of DOE-2 based programs are listed on our website: <http://SimulationResearch.lbl.gov> > DOE-2

Cost is as follows:

- \$ 300 U.S. Government, non-profit Educational
- \$ 575 U.S., Mexico, Canada
- \$ 1268 Japan only
- \$ 1075 All Other Non-U.S.

DOE-2 Documentation on a CD from ESTSC - Cost US\$100

What is included on the CD?

- DOE-2 Reference Manual (Part 1)
- DOE-2 Reference Manual (Part 2)
- DOE-2 Supplement to the Reference Manual (2.1E)
- DOE-2 BDL Summary (2.1E)
- DOE-2 Engineers Manual (2.1A)

Order Software and ESTSC Documentation

Ed Kidd
NCI Information Systems, Inc.
Energy Science and Technology Software Center (ESTSC)
P.O. Box 1020
Oak Ridge, TN 37831

Phone: 865/576-1037
Fax: 865/576-6436
Email: estsc@adonis.osti.gov

Purchase DOE-2 Documentation

DOE-2 Sample Run Book (2.1E) -- The Sample Run book is the only remaining DOE-2 manual not available electronically. It must be purchased separately from NTIS; information is at <http://SimulationResearch.lbl.gov> > DOE-2 > Documentation

Free DOE-2 Documentation (<http://SimulationResearch.lbl.gov> > DOE-2 > Documentation)

- | | |
|---|--|
| <ul style="list-style-type: none">▪ DOE-2 Basics (2.1E)▪ Update Package #1:
DOE-2.1E Basics, the Supplement and BDL Summary▪ Update Package #2: (Version 107, DOE-2.1E)
BDL Summary and Supplement. | <p>DOE-2 Basics and Update Packages 1, 2, 3 and 4 are not included on the ESTSC CD. They consist of scanned pdf files and may be downloaded from our web site. You may also request the same information on a CD by sending email to klellington@lbl.gov.</p> <p>The update files need to be printed and the update pages inserted into the existing DOE-2 manuals.</p> |
|---|--|

DOE-2 listings are continued on the next page

--Continued--

Free DOE-2 Documentation (<http://SimulationResearch.lbl.gov> > DOE-2 > Documentation)

- Update Package #3: Appendix A of the Supplement.
- Update Package #4: (1000-zone DOE-2.1E) BDL Summary.
- DOE-2 Modeling Tips (pdf)

Note that the Update Packages are **not** cumulative and each one contains different information. You have to download all four packages to update the DOE-2 documentation completely.


DOE-2 Modeling Tips is a compilation of all the "how to" articles from the *Building Energy Simulation User News* (through 2001).

DOE-2 Training

Private or group DOE-2 courses for beginning and advanced users:
Contact Marlin Addison at (602) 968-2040, marlin.addison@doe2.com

DOE-2 Help Desk

Email, phone or fax the Simulation Research Group with your questions (klellington@lbl.gov).
Phone: (510) 486-5711, Fax: (510) 486-4089

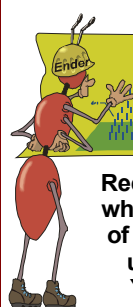

Changes to DOE-2.1E

Recent changes to DOE-2.1E are described. Shown at the left is the version number of DOE-2.1E, which is incremented for each change. Following is a short description of the changes, the initials of the author and date of change. Note that each version of DOE-2.1E includes all changes made up to and including that version number. Therefore, Version -120 includes all prior changes. You can determine which version of the program you are using by checking any of the output reports, where version *nnn* is indicated as DOE-2.1E-*nnn*.



-120 : bdl dkey

Fix number overflow in line number field of the BDL OUTPUT file .

[EE 11/06/2002]

Increase the limit for weighting-factor commands from 128 to 1024. The limit of 128 causes BDL to give error messages when the number of spaces with custom weighting factors is greater than 128. [EE 11/06/2002]



SPARK is an equation-based simulation environment that allows you to build customized models of complex physical processes by connecting calculation objects that represent system components like walls, fans, heat exchangers, chillers, ducts, mixing boxes, controls, etc. It is aimed at the simulation of innovative and/or complex building systems that are beyond the scope of whole-building programs like DOE-2 and EnergyPlus. VisualSPARK adds a graphical user interface to SPARK to simplify use of the program.

Download VisualSPARK 1.0.2 free of charge from

<http://SimulationResearch.lbl.gov> > VisualSPARK

SPARK was developed by the Simulation Research Group of Lawrence Berkeley National Laboratory and by Ayres Sowell Associates, with support from the Assistant Secretary for Energy Efficiency and Renewable Energy, Office of Building Technology Programs of the U.S. Department of Energy, program manager Dru Crawley.

From the Building Energy Simulation User News, Vol. 19, No. 1 (Spring 1998)
Revised, Vol. 23, No. 6 (November/December 2002)

UNDERGROUND SURFACES: HOW TO GET A BETTER UNDERGROUND SURFACE HEAT TRANSFER CALCULATION IN DOE-2.1E

by
Fred Winkelmann

Note: The Spring 1998 issue (Vol. 19, No. 1) of the Building Energy Simulation User News described a simplified method for modeling foundation heat flows in DOE-2. The article contained three tables giving the perimeter conductance per perimeter foot for slab, basement, and crawl space conditions calculated using a two-dimensional finite-difference program*. The basic approach in this simplified procedure was to model the true foundation area as an underground surface[s], and add a fictitious insulating layer to the outside of the surface[s] so that the total foundation conductance equals the perimeter length times the perimeter conductance given in Tables 1, 2, and 3. For basements, the article recommended that the floor be modeled as an UNDERGROUND-FLOOR with zero conductance, and the walls as an UNDERGROUND-WALL with a conductance calculated as just described. It has been brought to our attention that this method presents a problem in some uninsulated basement cases where the required wall conductance may be greater than that of the basement wall, e.g., 4" concrete and 1 ft. of soil, without adding any insulating layer. In such instances the solution is to also model the basement floor as a heat transfer surface and then to add the same insulating layer to both so that the total foundation conductance from both equals the perimeter length times the conductance shown in Table 3.

Joe Huang and Jeff Warner, LBNL, October 2002

* Y.J. Huang, L. Shen, J. Bull, and L. Goldberg, "Whole-House Simulation of Foundation Heat Flows Using the DOE-2.1C Program", ASHRAE Transactions 94(2), 1988.

Underground surfaces in DOE-2.1E are walls or floors that are in contact with the ground. An example is a slab-on-grade or a basement wall. Underground surfaces are entered using the UNDERGROUND-WALL command, or the equivalent command, UNDERGROUND-FLOOR. Check the description of these commands in the *Reference Manual* for information on the keywords for these surfaces.

Heat Transfer

Care needs to be taken in describing the construction of an underground surface in order to get a correct calculation of the heat transfer through the surface and a correct accounting for the thermal mass of the surface, which is important in the weighting factor calculation for the space. In the LOADS program, DOE-2 calculates the heat transfer through the underground surface as

$$Q = UA(T_g - T_i)$$

where U is the conductance of the surface, A is the surface area, T_g is the ground temperature and T_i is the inside air temperature. *If the raw U-value of the surface is used in this expression the heat transfer will be grossly overcalculated.* This is because the heat transfer occurs mainly through the surface's exposed perimeter region (since this region has relatively short heat flow paths to the outside air) rather than uniformly over the whole area of the surface. For this reason, users are asked to specify an effective U-value with the U-EFFECTIVE keyword. This gives

$$Q = [U-EFFECTIVE]*A(T_g - T_i)$$

In general U-EFFECTIVE is much less than the raw U-value.

The following procedure shows how to determine U-EFFECTIVE for different foundation configurations. It also shows how to define an effective construction for an underground surface that properly accounts for its thermal mass when custom weighting factors are specified. The procedure assumes that the monthly ground temperature

is the average outside air temperature delayed by three months, which is similar to how the ground temperatures on the weather file are calculated. To force the program to use the weather file values, do *not* enter ground temperatures using the GROUND-T keyword in the BUILDING-LOCATION command.

Procedure for defining the underground surface construction

1. Choose a value of the perimeter conduction factor, $F2$, from Table 1, 2 or 3 for the configuration that best matches the type of surface (slab floor, basement wall, crawl-space wall), foundation depth and amount and/or location of insulation.
2. Using $F2$, calculate R_{eff} , the *effective resistance* of the underground surface, which is defined by the following equation:

$$R_{eff} = A / (F2 * P_{exp})$$


where A is the area of the surface (ft² or m²) and P_{exp} is the length (ft or m) of the surface's perimeter that is exposed to the outside air. Figures 1 and 2 show values of P_{exp} for example foundation configurations. If P_{exp} is zero**, set R_{eff} to a large value, e.g. $R_{eff} = 1000$.

3. Set $U\text{-EFFECTIVE} = 1/R_{eff}$.

The program will calculate the heat transfer through the underground surface to be

$$Q = [U\text{-EFFECTIVE}] * A (T_g - T_i)$$

4. Define a construction, shown in the figure below, consisting of the following:
 - The underground wall or floor, including carpeting, if present, and inside film resistance (overall resistance = R_{us})
 - A 1-ft (0.3-m) layer of soil (resistance = $R_{soil} = 1.0 \text{ hr-ft}^2\text{-F/Btu}$ [0.18 m²-K/W])
 - A fictitious insulating layer (resistance = R_{fic})

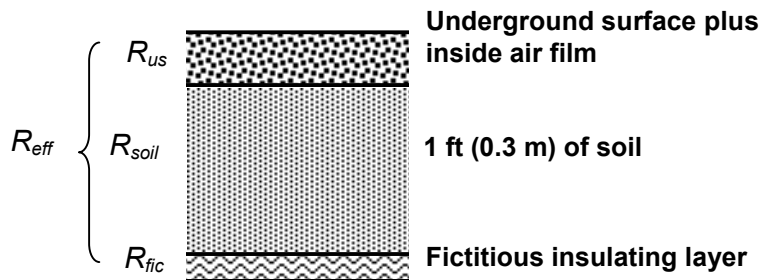

The layer of a soil represents the thermal mass of the ground in contact with the underground surface (a 1-ft [0.3-m] layer is sufficient to account for most of the thermal mass effect). The fictitious insulating layer is required to give the correct effective resistance for the construction, i.e.

$$R_{eff} = R_{us} + R_{soil} + R_{fic}$$

From this we get

$$R_{fic} = R_{eff} - R_{us} - R_{soil}$$

The procedure for defining this construction is shown in the following example.

** The procedure makes the approximation that the heat transfer through an underground surface with no exposed perimeter, such as a basement floor, is zero.

Example: 50' x 100' slab-on-grade.

The slab consists of uncarpeted, 4-in (10-cm) heavy-weight concrete (CC03 in the DOE-2.1E library), with resistance = 0.44 hr-ft²-F/Btu (0.078 m²-K/W). The foundation depth is 4 ft (1.22 m) with R-10 (1.76 m²-K/W) exterior insulation, which gives F2 = 0.50 Btu/hr-F-ft (0.86 W/m-K) from Table 1. We then have:

Slab surface area:	$A = 50 \times 100 = 5000 \text{ ft}^2$
Slab exposed perimeter:	$P_{exp} = (2 \times 50) + (2 \times 100) = 300 \text{ ft}$
Effective slab resistance:	$R_{eff} = A / (F2 \cdot P_{exp}) = 5000 / (0.90 \cdot 300) = 33.3$
Effective slab U-value:	$U\text{-EFFECTIVE} = 1 / R_{eff} = 0.030$
Actual slab resistance:	$R_{us} = 0.44 + R_{film} = 0.44 + 0.77 = 1.21$
Resistance of fictitious layer:	$R_{fic} = R_{eff} - R_{us} - R_{soil} = 33.3 - 1.21 - 1.0 = 31.1$

Here, 0.77 hr-ft²-F/Btu (0.14 m²-K/W) is the average of the air film resistance for heat flow up—0.61 hr-ft²-F/Btu (0.11 m²-K/W)—and heat flow down—0.92 hr-ft²-F/Btu (0.16 m²-K/W). For vertical surfaces, such as basement walls, you can use $R_{film} = 0.68 \text{ hr-ft}^2\text{-F/Btu}$ (0.12 m²-K/W).

The input would look like:

```
$ Slab-on-grade $
MAT-FIC-1 = MATERIAL RESISTANCE = 31.1 .. $ the Rfic value
SOIL-12IN = MATERIAL THICKNESS = 1.0 CONDUCTIVITY = 1.0
                DENSITY = 115 SPECIFIC-HEAT = 0.1 ..

LAY-SLAB-1 = LAYERS MATERIAL = (MAT-FIC-1,SOIL-12IN,CC03)
                INSIDE-FILM-RES = 0.77 ..

CON-SLAB-1 = CONSTRUCTION LAYERS = LAY-SLAB-1 ..

.
.
SLAB-1 = UNDERGROUND-FLOOR HEIGHT = 50
                WIDTH = 100
                TILT = 180
                U-EFFECTIVE = 0.030
                CONSTRUCTION = CON-SLAB-1 ..
```

Caution: If you change the dimensions of the slab later, be sure to recalculate R_{fic} . For example, if the 50x100-ft slab is changed to 50x80-ft exposed perimeter becomes 260-ft, and we get $R_{eff} = 4000 / (0.50 \cdot 260) = 30.8$ (rather than 33.3), $U\text{-EFFECTIVE} = 1 / 30.8 = 0.033$ (rather than 0.030), and $R_{fic} = 30.8 - 1.21 - 1.0 = 28.6$ (rather than 31.1).

Note (1):

For basements (Table 2) and crawl spaces (Table 3) an 8-in (20.3-cm) high section between ground level and the top of the underground wall is included in the F2 calculation and so does not have to be entered as a separate exterior wall. However, for shallow basements (Table 2) the wall section between the top of the underground wall and main level of the building should be entered as a separate exterior wall.

Note (2):

The floor of a crawl space (Table 3) should be entered as an UNDERGROUND-FLOOR consisting of a 1-ft (0.3-m) layer of soil with a fictitious insulation layer underneath it. Because the exposed perimeter of the floor in this case is zero, the heat transfer is zero, so the fictitious insulation layer should have a very high resistance and U-EFFECTIVE should be close to zero. The input would look like:

```
$ Crawl space floor $
MAT-FIC-1 = MATERIAL RESISTANCE = 1000 ..
SOIL-12IN = MATERIAL THICKNESS = 1.0
                CONDUCTIVITY = 1.0
                DENSITY = 115
```


```
SPECIFIC-HEAT = 0.1 ..  
  
LAY-FLOOR-1 = LAYERS MATERIAL = (MAT-FIC-1, SOIL-12IN)  
INSIDE-FILM-RES = 0.77 ..  
  
CON-FLOOR-1 = CONSTRUCTION LAYERS = LAY-FLOOR-1 ..  
.....  
FLOOR-1 = UNDERGROUND-FLOOR HEIGHT = 50  
                                WIDTH = 100  
                                TILT = 180  
                                U-EFFECTIVE = 0.001  
                                CONSTRUCTION = CON-SLAB-1 ..
```

Thermal Mass


Underground surfaces are usually concrete and therefore have high thermal mass. Because of its heat storage capacity, this mass attenuates loads due to heat gains (from lights, solar, people, etc.) and causes a time delay between when the heat gain occurs and when it appears as a load on the HVAC system. In general, the higher the heat capacity and the more closely coupled the mass is to the room air, the larger this delay and attenuation will be.

DOE-2 will account for thermal mass only if (1) the underground surface is entered with a layers-type construction, following the procedure described in the previous section; and (2) custom weighting factors are calculated for the space, i.e., FLOOR-WEIGHT = 0 in the SPACE or SPACE-CONDITIONS command.

Slab-On-Grade

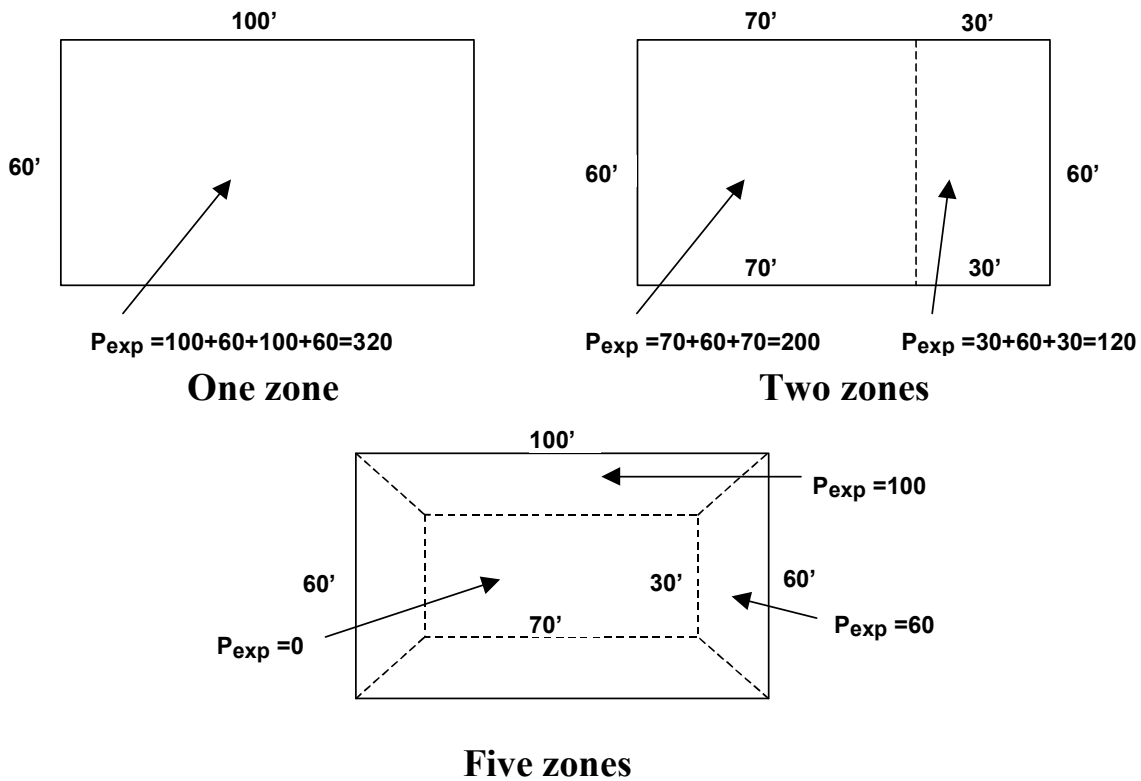

Basement

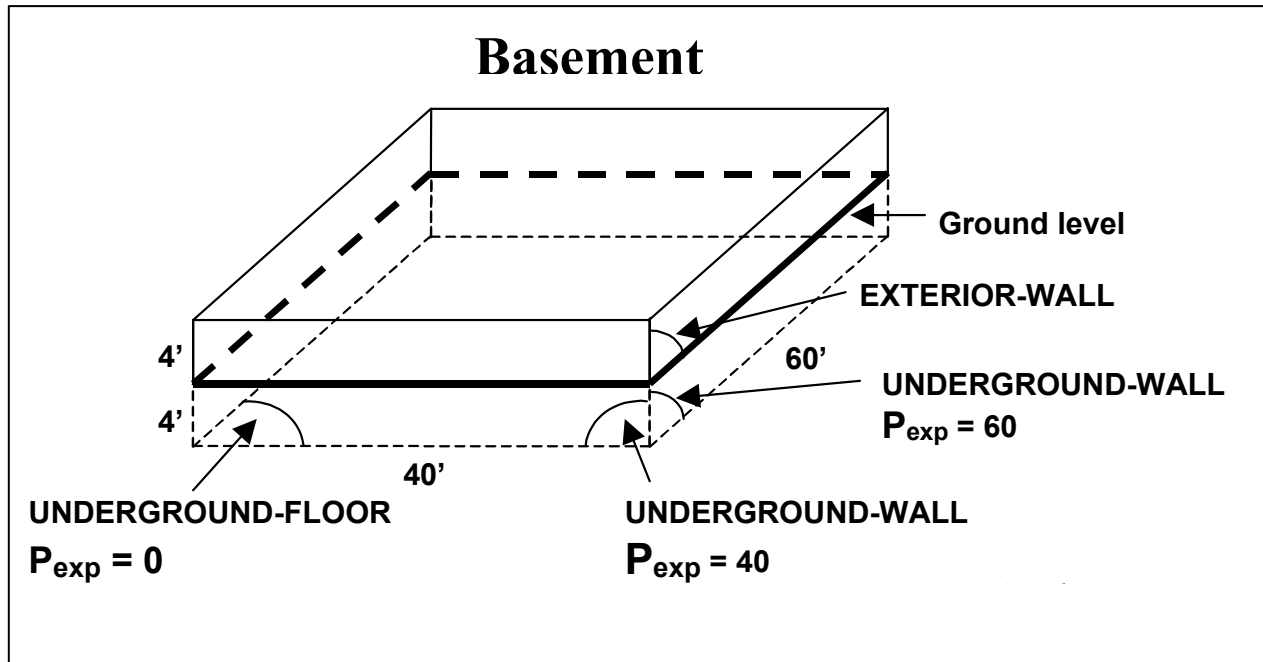

Exposed perimeter calculation for slab-on-grade examples.

Table 1: Perimeter Conduction Factors for Concrete Slab-On-Grade*

Slab-On-Grade			
Foundation depth	Insulation Configuration (see sketch for location of insulation)	PERIM-CONDUCT Btu/hr-F-ft (W/m-K)	
		Uncarpeted	Carpeted
2 ft	Uninsulated	1.10 (1.90)	0.77 (1.33)
	R-5 exterior	0.73 (1.26)	0.54 (0.93)
	R-10 exterior	0.65 (1.12)	0.49 (0.85)
	R-5 interior; R-5 gap	0.75 (1.30)	0.57 (0.98)
	R-10 interior	0.89 (1.54)	0.46 (0.79)
	R-10 interior; R-5 gap	0.70 (1.21)	0.53 (0.92)
	R-10 interior; R-10 gap	0.68 (1.17)	0.52 (0.90)
	R-5 2-ft perimeter; R-5 gap	0.78 (1.35)	0.60 (1.04)
	R-10 2-ft perimeter; R-5 gap	0.73 (1.26)	0.57 (0.98)
	R-10 4-ft perimeter	0.79 (1.36)	0.59 (1.02)
	R-10 15-ft perimeter, R-5 gap	0.39 (0.67)	0.34 (0.59)
	R-5 16-in exterior, R-5 2-ft horizontal	0.65 (1.12)	0.48 (0.83)
	R-5 16-in exterior, R-5 4-ft horizontal	0.58 (1.00)	0.43 (0.74)
	R-10 16-in exterior, R-5 2-ft horizontal	0.56 (0.97)	0.41 (0.71)
	R-10 16-in exterior, R-5 4-ft horizontal	0.47 (0.81)	0.35 (0.60)
4 ft	Uninsulated	1.10 (1.90)	0.77 (1.33)
	R-5 exterior	0.61 (1.05)	0.46 (0.79)
	R-10 exterior	0.50 (0.86)	0.37 (0.64)
	R-15 exterior	0.44 (0.76)	0.33 (0.57)
	R-20 exterior	0.40 (0.69)	0.30 (0.52)
	R-5 interior; R-5 gap	0.63 (1.09)	0.48 (0.83)
	R-10 interior; R-5 gap	0.54 (0.93)	0.42 (0.73)
	R-15 interior; R-5 gap	0.50 (0.86)	0.38 (0.66)
	R-20 interior; R-5 gap	0.47 (0.81)	0.36 (0.62)
	R-5 4-ft perimeter; R-5 gap	0.68 (1.17)	0.54 (0.93)
	R-10 4-ft perimeter; R-5 gap	0.61 (1.05)	0.49 (0.85)
	R-10 4-ft perimeter	0.79 (1.36)	0.59 (1.02)
	R-10 15-ft perimeter, R-5 gap	0.39 (0.67)	0.34 (0.59)
	R-5 16-in exterior, R-5 2-ft horizontal	0.65 (1.12)	0.48 (0.83)
	R-5 16-in exterior, R-5 4-ft horizontal	0.58 (1.00)	0.43 (0.74)
	R-10 16-in exterior, R-5 2-ft horizontal	0.56 (0.97)	0.41 (0.71)
	R-10 16-in exterior, R-5 4-ft horizontal	0.47 (0.81)	0.35 (0.60)

*Source: Y.J.Huang, L.S.Shen, J.C.Bull and L.F.Goldberg, "Whole-House Simulation of Foundation Heat Flows Using the DOE-2.1C Program," ASHRAE Trans. 94 (2), 1988, updated by Y.J.Huang, private communication.

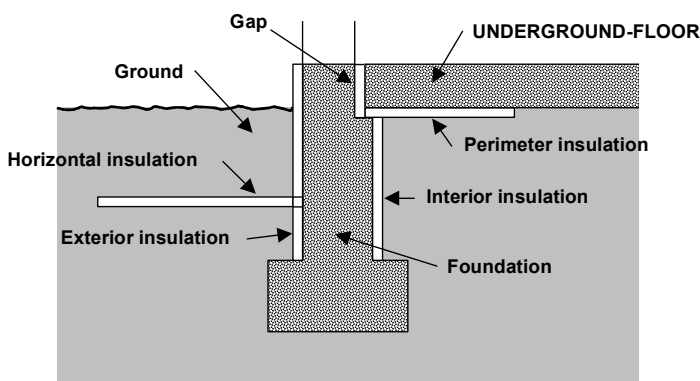


Table 2: Perimeter Conduction Factors for Basement Walls*

Basement Wall		
Underground Wall Height	Construction (see sketch for location of insulation)	PERIM-CONDUCT Btu/hr-F-ft (W/m-K)
8 ft (deep basement)	R-0 (uninsulated), concrete	1.94 (3.35)
	4-ft R-5 exterior, concrete	1.28 (2.21)
	8-ft R-5 exterior, concrete	0.99 (1.71)
	4-ft R-10 exterior, concrete	1.15 (1.99)
	8-ft R-10 exterior, concrete	0.75 (1.30)
	8-ft R-15 exterior, concrete	0.63 (1.09)
	8-ft R-20 exterior, concrete	0.56(0.97)
	8-ft R-10 interior, concrete	0.78 (1.35)
	R-0, wood frame	1.30 (2.25)
	R-11, wood frame	0.88 (1.52)
	R-19, wood frame	0.79 (1.37)
	R-30, wood frame	0.66 (1.14)
4 ft (shallow basement)	R-0 (uninsulated), concrete	1.61 (2.78)
	R-5 exterior, concrete	0.89 (1.54)
	R-10 exterior, concrete	0.73 (1.26)
	R-15 exterior, concrete	0.66 (1.14)
	R-20 exterior, concrete	0.65 (1.12)
	R-10 interior, concrete	0.79 (1.37)
	R-0, wood frame	1.10 (1.90)
	R-11, wood frame	0.80 (1.38)
	R-19, wood frame	0.74 (1.28)

*Source: Y.J.Huang, L.S.Shen, J.C.Bull and L.F.Goldberg, "Whole-House Simulation of Foundation Heat Flows Using the DOE-2.1C Program," ASHRAE Trans. 94 (2), 1988, updated by Y.J. Huang, private communication.


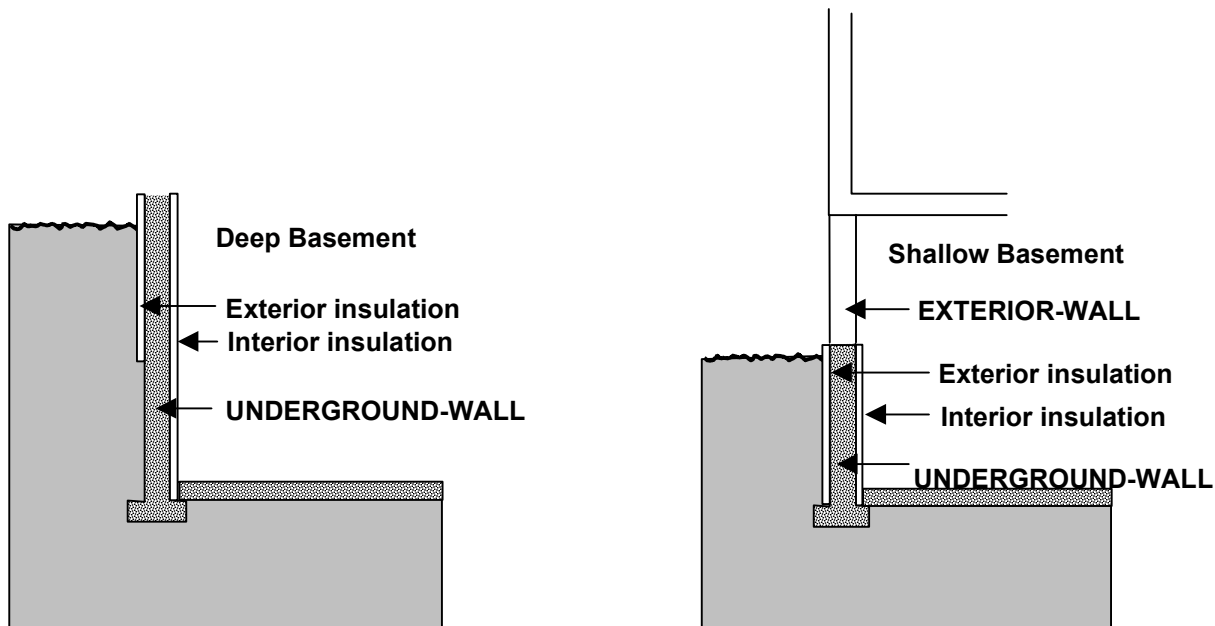


Table 3: Perimeter Conduction Factors for Crawl Space Walls*

Crawl Space Wall		
Wall Height	Construction (see sketch for location of insulation)	PERIM-CONDUCT Btu/hr-F-ft (W/m-K)
2 ft	R-0 (uninsulated), concrete	1.29 (2.23)
	R-5 exterior, concrete	0.93 (1.61)
	R-10 exterior, concrete	0.87 (1.95)
	R-5 interior, concrete	0.97 (1.50)
	R-10 interior, concrete	0.91 (1.57)
	R-5 interior; R-5 4-ft perimeter, concrete	0.73 (1.26)
	R-10 interior; R-10 4-ft perimeter, concrete	0.68 (1.18)
	R-0, wood frame	1.00 (1.73)
	R-11, wood frame	0.88 (1.52)
	R-19, wood frame	0.86 (1.49)
4 ft	R-0 (uninsulated), concrete	1.28 (2.21)
	R-5 exterior, concrete	0.71 (1.23)
	R-10 exterior, concrete	0.59 (1.02)
	R-15 exterior, concrete	0.54 (0.93)
	R-20 exterior, concrete	0.50 (0.86)
	R-5 interior; R-5 4-ft perimeter, concrete	0.64 (1.11)
	R-10 interior; R-10 4-ft perimeter, concrete	0.58 (1.00)
	R-0, wood frame	0.83 (1.44)
	R-11, wood frame	0.59 (1.02)
	R-19, wood frame	0.55 (0.95)

*Source: Y.J.Huang, L.S.Shen, J.C.Bull and L.F.Goldberg, "Whole-House Simulation of Foundation Heat Flows Using the DOE-2.1C Program," ASHRAE Trans. 94 (2), 1988, updated by Y.J. Huang, private communication.

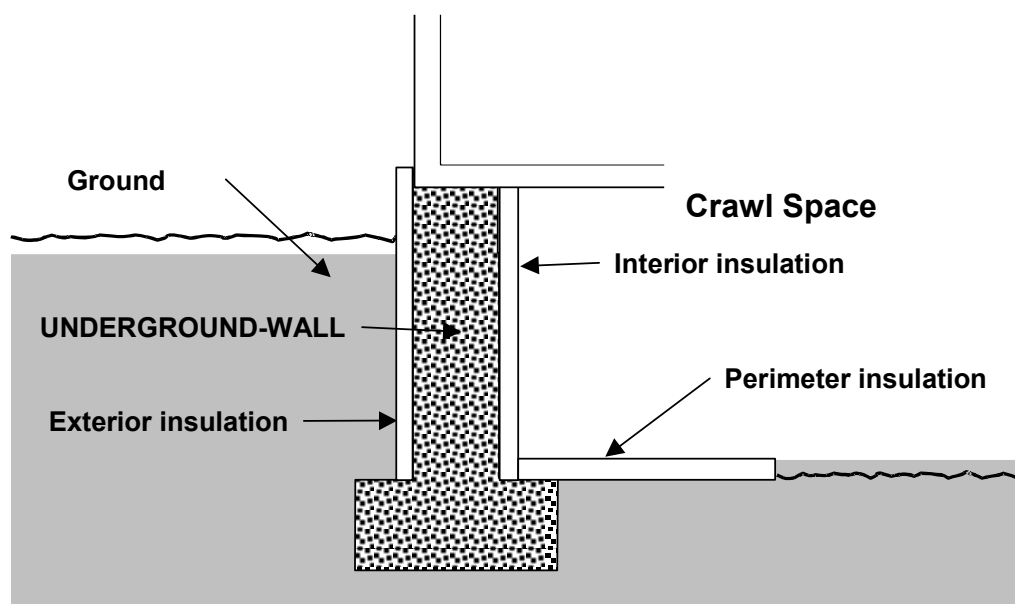

ENERGY-10, VERSION 1.5

ENERGY-10 is a design tool for smaller residential or commercial buildings that are less than 10,000 ft² or buildings that can be treated as 1- or 2-zone increments. It performs whole-building energy analysis for 8760 hours/year, including dynamic thermal and daylighting calculations. ENERGY-10 was specifically designed to facilitate the evaluation of energy-efficient building features in the very early stages of the design process.

Version 1.5 Upgrades

Life Cycle Costs

A whole new capability is included to evaluate life-cycle costs. The year-by-year cash flow of the building is determined and discounted to the present value. The difference between Bldg-1 and Bldg-2 is determined in terms of net present value, NPV (the difference in life-cycle costs), internal rate of return, benefit-to cost ratio, or simple payback.

Up-to-date compiler

The entire program has been ported to 32-bit and (with the exception of the CNE thermal simulation engine) programmed in Visual C++ 6.0, the current Microsoft compiler. One benefit that users will appreciate is that it is no longer necessary to close ENERGY-10 before starting a new project.

More Wall Layers

In previous versions, you were restricted to 6 layers in a wall construction. This has now been expanded by 3, giving you the opportunity to define a 7-layer wall plus two air films.

New Graphs

Graphs are programmed in a new and powerful graphing package (Olectra).

New Reports

A Cost Summary report tabulates the results of the life cycle cost evaluation. An HVAC and EES Cost report details the components of HVAC cost and each of the EES costs. A Peak Loads report identifies the peak loads and corresponding HVAC rated capacities for the AutoSize calculations and also the peak loads and consumptions during the annual simulation showing when the peaks occurred.

Douglas K. Schroeder
1331 H Street N.W., #1000
Washington, DC 20004



Tel: 202.628.7400 ext 210
Fax: 202.383.5043
www.sbicouncil.org

Sustainable Buildings Industry Council (SBIC)

ENERGY-10 User Group at <http://www.sbicouncil.org/forum>

SBIC Bookstore at <http://www.sbicouncil.org/store/resources.php#pubs>

Building Energy Software from Lawrence Berkeley National Laboratory

Free Downloads

BDA 2.0 (Building Design Advisor)

A beta version of 3.0 is available from vpal@lbl.gov

gaia.lbl.gov/BDA

COMIS

(multi-zone air flow and contaminant transport model)

www-epb.lbl.gov/comis

EnergyPlus 1.0.1

(new-generation whole-building energy analysis program, based on BLAST and DOE-2)

www.energyplus.gov

--or--

SimulationResearch.lbl.gov > EnergyPlus

GenOpt[®] 1.1.2 (generic optimization program)

SimulationResearch.lbl.gov > GenOpt

RADIANCE

(analysis and visualization of lighting in design)

radsite.lbl.gov/radiance/

Desktop Radiance (integrates the Radiance Synthetic Imaging System with AutoCAD Release 14)

radsite.lbl.gov/deskrad/

RESEM (Retrofit Energy Savings Estimation Model)

(calculates long-term energy savings directly from actual utility data)

eetd.lbl.gov/btp/resem.htm

SUPERLITE

(calculates illuminance distribution for room geometries)

eetd.lbl.gov/btp/superlite2.html

THERM 2.1a

(models two-dimensional heat-transfer effects in building components where thermal bridges are of concern)

windows.lbl.gov/software/therm/therm.html

VisualSPARK 1.0.1 (Simulation Problem Analysis and Research Kernel) (connect component models to simulate innovative building envelope and HVAC systems)

SimulationResearch.lbl.gov > VisualSPARK

WINDOW 5

(thermal analysis of window products)

windows.lbl.gov/software/window/window.html

Free Software / Request by Fax from 510.486.4089

RESFEN 3.1 (choose energy-efficient, cost-effective windows for a given residential application)

windows.lbl.gov/software/resfen/resfen.html

Web Based

Home Energy Saver (quickly computes home energy use) and

hes.lbl.gov

Home Improvement Tool (simplified Home Energy Saver)

and
hit.lbl.gov

Purchase

ADELINE 2.0

(daylighting performance in complex spaces)

radsite.lbl.gov/adeline/



BLASTnews

www.bso.uiuc.edu

Building Systems Laboratory, 30 Mech Eng Bldg.
University of Illinois, 1206 West Green Street
Urbana, IL 61801
Tel: (217) 333-3977 - Fax: (217) 244-6534
support@blast.bso.uiuc.edu

The **Building Loads Analysis and System Thermodynamics (BLAST)** program predicts energy consumption, energy system performance and cost for new or existing (pre-retrofit) buildings.

BLAST contains three major sub-programs:

- **Space Load Prediction** computes hourly space loads in a building based on weather data and user inputs detailing the building construction and operation.
- **Air Distribution System Simulation** uses the computed space loads, weather data, and user inputs.
- **Central Plant Simulation** computes monthly and annual fuel and electrical power consumption.

Heat Balance Loads Calculator (HBLC)

The BLAST graphical interface (HBLC) is a Windows-based interactive program for producing

BLAST input files. You can download a demo version of HBLC (for MS Windows) from the BLAST web site (User manual included).

HBLC/BLAST Training Courses

Experience with the HBLC and the BLAST family of programs has shown that new users can benefit from a session of structured training with the software. The Building Systems Laboratory offers such training courses on an as needed basis typically at our offices in Urbana, Illinois.

WINLCCID 98

LCCID (Life Cycle Cost in Design) was developed to perform Life Cycle Cost Analyses (LCCA) for the Department of Defense and their contractors.

To order BLAST-related products, contact the Building Systems Laboratory at the address above.

Program Name	Order Number	Price
PC BLAST Includes: BLAST, HBLC, BTEXT, WIFE, CHILLER, Report Writer, Report Writer File Generator, Comfort Report program, Weather File Reporting Program, Control Profile Macros for Lotus or Symphony, and the Design Week Program. The package is on a single CD-ROM and includes soft copies of the BLAST Manual, 65 technical articles and theses related to BLAST, nearly 400 processed weather files with a browsing engine, and complete source code for BLAST, HBLC, etc. Requires an IBM PC 486/Pentium II or compatible running MS Windows 95/98/NT.	3B486E3-0898	\$1500
PC BLAST Package Upgrade from level 295+	4B486E3-0898	\$450
WINLCCID 98: executable version for 386/486/Pentium	3LCC3-0898	\$295
WINLCCID 98: update from WINLCCID 97	4LCC3-0898	\$195

The last four digits of the catalog number indicate the month and year the item was released or published. This will enable you to see if you have the most recent version. All software will be shipped on 3.5" high density floppy disks unless noted otherwise.

This newsletter was prepared as an account of work sponsored by the United States Government (USG). While this document is believed to contain correct information, neither the USG, nor any agency thereof, nor the Regents of the University of California (RUC), nor any of their employees, makes any warranty, express or implied, or assumes any legal responsibility for the accuracy, completeness, or usefulness of any information, apparatus, product or process disclosed, or represents that its use would not infringe privately owned rights. Reference herein to any specific commercial product, process or service by its trade name, trademark, or otherwise, does not necessarily constitute or imply its endorsement, recommendation, or favoring by the USG or any agency thereof, or the RUC. The views and opinions of authors expressed herein do not necessarily state or reflect those of the United States Government or any agency thereof or of the Regents of the University of California

Meetings, Conferences, Symposia

2003

January 25-29 2003

ASHRAE
Winter Meeting



To be held in Chicago, IL
Contact: jyoung@ashrae.org
<http://www.ashrae.org>

February 12-15 2003

Greenprints
2003 Sustainable Communities by Design

To be held in Atlanta, GA
<http://www.southface.org/home/g2k3/g2k3index.htm>



May 20-22 2003

11th National Conference on
Building Commissioning



To be held in Palm Springs, CA
<http://www.peci.org/ncbc>

June 28-July 2 2003

ASHRAE
Annual Meeting




To be held in Kansas City, MO
Contact: jyoung@ashrae.org
<http://www.ashrae.org>

August 11-14 2003

IBPSA
Building Simulation
2003



To be held in Eindhoven, Netherlands
<http://www.ibpsa.org>



August 17-20 2003

Energy 2003

To be held at Lake Buena Vista
(Wyndham resort in Walt Disney World Village), Florida
<http://www.energy2003.ee.doe.gov>

Directory of Software and Services for EnergyPlus

Program Name	Description	Cost
EnergyPlus 1.0.3	Downloadable from www.energyplus.gov <u>Support</u> EnergyPlus-Support@gard.com <u>Support Group</u> groups.yahoo.com/group/EnergyPlus_Support	<i>Free!</i>

Support Tools for EnergyPlus

Program Name	Description	Cost
EnergyPlus Interface Support Tools The Deringer Group, Inc. 1349 Addison Street Berkeley, CA 94702 Tel: (510) 843-9000 Fax: (510) 843-9005 www.deringergroup.com	EnergyPlus Online Simulations – online and embedded in the EcoAdvisor set of online training modules on sustainable buildings. These tools can be used by anyone and require no special knowledge of EnergyPlus. <u>EnergyPlus Interface Support Tools</u> EzPlus-Parm is a standalone Windows tool intended primarily for EnergyPlus parametric analysis. It was designed to simplify the running of multiple parametric EnergyPlus simulations and helps a user organize and edit files. DrawEzPlus is a 3-D geometry rendering tool that displays the 3-D geometry imbedded in an EnergyPlus file.	<i>Free!</i>

U. S. EnergyPlus CONSULTANTS

California				
Tianzhen Hong, PhD, P.E. thong@eley.com	Eley Associates www.eley.com	142 Minna Street	San Francisco, CA 94105	(415) 957-1977 fax: 957-1381
Illinois				
Erik Olsen eolsen@owpp.com	OWP/P Engineers www.owpp.com	111 West Washington St., #2100	Chicago, IL 60602-2714	(312) 960-8313 fax: 837-8313
Jason Glazer jglazer@gard.com	GARD Analytics www.gard.com	1028 Busse Highway	Park Ridge, IL 60068	(847) 698-5686
Minnesota				
Tom McDougall tgm@twgi.com	The Weidt Group www.twgi.com	5800 Baker Road	Minnetonka, MN 55345	((952) 938-1588 fax: 938-1480
Virginia				
John R. Ross III, P.E. mailto:jross3@erols.com	Westwind Corporation www.erols.com	1609 Sereno Court	Vienna, VA 22182-1958	(703) 255-4712 Fax: 255-4712

Directory of Software and Services for DOE-2

ESTSC Versions of DOE-2

Program Name	Description	Cost
DOE-2.1E (Ed Kidd or Walt Kelly) ESTSC P.O. Box 1020 Oak Ridge, TN 37831-1020 Ph: 865-576-2606 / Fx: 576-2865 www.osti.gov/estsc	Source code, executable code and complete current documentation for: DOE-2.1E/Version 117 1000-zone version OS: Windows, SUN UNIX	Support Limited operational support (telephone assistance for installation, media or platform questions). Windows U.S. Govt/Non-Profit/Educ \$ 300 U.S. Public, Mexico, Canada \$ 575 Japan \$1268 Other Foreign \$1075

Commercial Versions of DOE-2

Program Name	Description	Cost
ADM-DOE-2 (Richard Burkhardt) ADM Associates 3239 Ramos Circle Sacramento, CA 95827-2501 Ph: 916-363-8383, Fx: 363-1788 www.adm-energy.com	Use on 386/486 PCs with a math co-processor and 4MB of RAM. The package contains everything needed to run the program: program files, utilities, sample input files, and weather files. More than 300 weather files available. OS: DOS, Windows 95	Input ----- Output ----- Support ----- \$395 + \$15/SH including one set weather data (your choice) and documentation
Compare-IT (Matt Brost) RLW Analytics, Inc. info@rlw.com 1055 Broadway, Suite G Sonoma, CA 95476 Ph: 707-939-8823, Fx: 939-9218 www.rlw.com	Compare-IT allows DOE-2 professionals to add value to their projects by giving clients "what-if" scenarios using DOE-2. The interface is designed for novice energy analysts and the GUI can be customized for each client's particular interests. Based DOE-2.1E. OS: DOS, Windows (98, 95, NT)	Input: Customizable windows GUI dynamically built based on DOE-2 macros. ----- Output Support ----- \$500 consultant \$2000 client Documentation available
DOE-Plus (Steve Byrne) Item Systems byrne@item.com 321 High School Road NE Box 344 Bainbridge Island, WA 98110 Ph: 206-855-9540 / Fx: 855-9541 http://www.item.com/doeplus.htm	Complete support for all DOE-2 commands. Utility programs included: Prep, Demand Analyzer, weather processor. Over 500 worldwide weather files. Imports BDL files created with a text editor or other program. Based on DOE-2.1E. OS: DOS, Windows (3.1, 95, NT)	Input Interactive, graphical, fill-in-the-blanks ----- Output Customizable tables and graphics ----- \$895 with DOE-2 and doc \$495 without DOE-2 Source code not available.

Note: We list third-party DOE-2-related products and services for the convenience of program users, with the understanding that the Simulation Research Group does not have the resources to check the DOE-2 program adaptations and utilities for accuracy or reliability.

Commercial Versions of DOE-2 (continued)

Program Name	Description	Cost
EnergyPro 3.0 (D. Vonderkullen) demian@energysoft.com Gabel Dodd/EnergySoft LLC 100 Galli Drive #1 Novato, CA 94949-5657 Ph: 415-883-5900, Fx: 883-5970 www.energysoft.com	Performs nonresidential load calculations for HVAC equipment sizing. Electronically exports forms to AutoCad for inclusion on blueprints. On-line help. 344 weather files for the U.S. and Canada. OS: DOS, Windows (95, NT). For California Users: Performs Title 24 compliance calculations, includes state-certified HVAC and DHW Equipment directories, Title 24 tailored lighting calculations. Based on ESTSC DOE-2.1E	<u>Input:</u> Graphical <u>Output:</u> Graphs, forms <u>Support:</u> Unlimited support DOE-2 Module: Non-residential \$ 700 ^{1,2} Residential \$ 250 ^{1,2} Program Interface \$ 195 ³ ¹ price reflects cash discount ² includes documentation ³ required
EZDOE (Bill Smith) bsmith @ elitesoft.com Elite Software P.O. Box 1194 Bryan, TX 77806 Ph: 409-846-2340 / Fx: 846-4367 http://www.elitesoft.com/web/hvacr/ elite_ezdoe_info.html	Provides full screen, fill-in-the-blank data entry, dynamic error checking, context-sensitive help, mouse support, graphic reports, a 750-page user manual, and extensive weather data. Full implementation of DOE-2 on DOS-based 386 and higher computers. On-line help. Some weather files. Based on DOE-2.1E. OS: DOS	<u>Input:</u> Fill-in-the-blanks <u>Output:</u> Standard DOE reports plus some custom graphic reports <u>Support:</u> Unlimited phone support \$1295 w/documentation Source code not available.
FTI/DOE2 (Scott Henderson) info @ finite-tech.com Finite Technologies Inc. 3763 Image Drive Anchorage, Alaska 99504 Ph: 907-333-8937, Fx: 333-4482 http://www.finite-tech.com/ FTIDOE2001.htm	Version 3.0 Release -- FTI/DOE is 100% compatible with LBNL version. Source code versions will compile with most F77-compliant compilers. On-line help: 344 weather files for the U.S. and Canada. Based on ESTSC DOE-2.1E. No demo, 30-day trial period OS: DOS, Windows (3.x, 95, NT) AIX, ULTRIX, VMS, Linux, NeXTStep,	<u>Input:</u> Version 2.x: text based Version 3.x: graphical <u>Output:</u> All standard DOE-2 reports Run time and status graphics <u>Support:</u> 90-days free; then cost is \$ 35 each email per incident \$ 55 per hour per incident \$125 per hour for engineering advice. \$ 995.99 US w/documentation \$1066 Int'l w/documentation \$4999.99 Source code
PRC-DOE-2 (Paul Reeves) Paul.Reeves@DOE2.com Partnership for Resource Conservation 140 South 34 th Street Boulder, CO 80303 Ph: 303-499-8611, Fx: 554-1370	Text-based version of DOE-2 includes documentation. Extensive information on new features, including information on new system types, new commands, new options, etc., added to later versions of 2.1E. OS: DOS, Windows (95, NT)	<u>Input:</u> Standard text-based <u>Output:</u> <u>Support:</u> Unlimited support. \$ 495 w/documentation Source code not available.
VisualDOE 3.1 (Eric Kolderup) Charles Eley Associates 142 Minna Street (2 nd floor) San Francisco, CA 94105 Ph: 415-957-1977 - Fax 1381 www.eley.com, support@eley.com	Fast construction of building geometry with pre-defined blocks and drawing interface. Import zone shapes from CADD file (dxf). Point+click to define zone properties and HVAC systems. Dynamic 3-D model views. Online help. LiveUpdate through internet. 400+ US, foreign weather files. OS: Windows 95/98/NT/ME/2000/XP	<u>Input:</u> Graphical <u>Output:</u> Graphical \$800 new commercial license \$400 commercial upgrade from version 2.6 60% discount for educational use \$3000 Site license (up to 8 registration keys) \$8000 corporate license (up to 15 registration keys) <u>Support:</u> 90 days free phone plus 1 year email support.; thereafter \$300/year per licensed user

Support Tools for DOE-2

Program Name	Description	Cost
DOE-2 Parametric Study Tool The Deringer Group, Inc. 1349 Addison Street Berkeley, CA 94702 Ph: (510) 843-9000, Fx: -9005 www.deringergroup.com	DOE2PARM – is an MS Windows-based tool that permits you to run, edit and link all the related input and output files together in the same window.	<i>Free!</i>
DrawBDL Joe Huang & Associates 31 Sarah Lane Moraga CA 94553 Ph: 925-247-9180	DrawBDL , Version 2.1, is a graphic debugging and drawing tool for DOE-2 building geometry . DrawBDL reads your BDL input and makes a rotate-able 3-D drawing of your building with walls, windows, and building shades shown in different colors for easy identification. OS: DOS, Windows (3.1, 95, 98, NT) [Works with 2.1E] email: tmchow@compuserve.com	\$125.00 plus shipping
PRC-TOOLS (Paul Reeves) P R C 140 South 34 th Street Boulder, CO 80303 Ph: 303-499-8611 / Fx: 554-1370	<i>PRC-Tools</i> aid in extracting, analyzing, and formatting DOE-2 output . <i>PRC-Grab</i> automates the process of extracting any number of answers from DOE-2 standard output files. <i>PRC-Hour</i> and <i>PRC-Peak</i> format the hourly output and create Peak-Day and Average-Day load shapes for any number of periods and for any combination of hourly values. OS: Windows (95, 98, NT) [Works with 2.1E]	\$99.00
RIUSKA (Tuomas Laine) Olof Granlund Oy P O Box 59 Helsinki, FIN-00701 Finland (tuomas.laine@granlund.fi) Ph: +358 (9) 351031 / Fx: 35103421	With RIUSKA user can add building envelope materials, internal loads and HVAC-system into the created 3D-model of the building and perform thermal calculations. RIUSKA can be used for space simulations to dimension cooling or heating equipments, or for energy calculations of the whole building. OS: Windows (95, 98, NT) [Works with 2.1E]	Contact Tuomas Laine for pricing.
Visualize-IT (Matt Brost) RLW Analytics, Inc. mattb@rlw.com 1055 Broadway, Suite G Sonoma, CA 95476 Ph: 800-472-6716 Fx: 707-939-8823 www.rlw.com/visualize_it.html	Visualize-IT 2.0 is a Windows application designed to help you explore and summarize short-interval time series data, e.g., measurements taken once every 15 minutes over a period of weeks, months or years. Visualize-IT has been developed specifically for electric and gas load data measuring class profiles, market-segments, individual customer sites or specific end uses. Customized DOE2.1e hourly output importer. Visualize-IT is highly useful and informative for looking at DOE2 output and/or comparing to interval metered data. It is equally useful for other time series measurements such as weather, industrial process control, and water quality. OS: Windows 95, 98 and NT	\$500.00 per set Volume Discounts Available

Special Versions of DOE-2

Program Name	Description	Cost
CBIP cbip.nrcan.gc.ca/cbip.htm Office of Energy Efficiency Natural Resources Canada 580 Booth St., 18th Floor Ottawa ON K1A 0E4, CANADA	Natural Resources Canada's Commercial Building Incentive Program (CBIP) offers a financial incentive for the incorporation of energy efficiency features in new commercial and institutional building designs. The objective of this new incentive is to encourage energy-efficient design practices and to bring about lasting changes in the Canadian building design and construction industry. The program will be offered until March 31, 2004.	Web Based (free)
Cool Tools (Peter Turnbull) Pacific Gas & Electric Company pwt1@pge.com www.hvacexchange.com/cooltools/	The CoolTools™ project objective is to develop, disseminate and promote an integrated set of tools for design and operation of chilled water plants. CoolTools products are Internet based, public domain resources available to building owners, design professionals, and operators involved in both new construction and retrofits.	Web Based (free)
DesiCalc GRI-98/0127 www.desicalc.com	DesiCalc screens desiccant cooling applications. It estimates annual or monthly energy loads, using hour-by-hour simulations, and costs for 11 typical commercial buildings in 236 geographical locations in the US. Includes the latest TMY2 meteorological database [Based on DOE-2.1E] OS: Windows 3.1, 95, 98, NT	\$295 w/doc +8.75% tax in IL +4.5% tax in VA S/H add \$20
Energy Gauge USA (Danny Parker) Florida Solar Energy Center 1679 Clearlake Road Cocoa, FL 32922 energygauge.com	Energy Gauge USA allows the simple calculation and rating of residential building energy use in the US. The simulation calculates a six-zone model of the residence (conditioned zone, attic, crawlspace, basement, garage and sunspace) with the various buffered spaces linked to the interior as appropriate. TMY weather data for the program are available for 239 US locations. [Based on DOE-2.1E] OS: Windows 95, 98, NT	Contact Danny Parker at FSEC for availability.
Home Energy Saver (Residential DOE-2) hes.lbl.gov	Calculation of residential energy consumption using DOE-2.1E. The program performs a full annual simulation for a typical weather year (involving 8760 hourly calculations) from 239 locations around the United States in about 10-20 seconds.	Web Based (free)
PERFORM 2001 California Energy Commission 1516-9 th St., MS-13 Sacramento, CA 95814 Ph: 916-654-5385	Created for the State of California Energy Commission's, Title 24 energy code . Perform 2001 is an interface shell with DOE-2 as the engine. PERFORM 2001 calculates building energy consumption for space heating, space cooling and domestic hot water heating, and compares the energy consumption of the building design against the requirements of the standards. DOS input. Output is only California Title 24 compliant. [Based on DOE-2.1E] Technical support \$100/year from Gabel-Dodd Energy Soft LLC, Call 415-883-5900 for details.	\$250 including PERFORM 2001 program and manual on CD. (VISA/MC) Order #PS-400-04-017 www.energy.ca.gov/reports/ reports_400.html
RESFEN-3.1 Building Technologies, MS 90-3111 Lawrence Berkeley Laboratory Berkeley, CA 94720	RESFEN calculates the energy and cost implications of a building's windows compared to insulated walls . The relative energy and cost impacts of two different windows can also be compared against each other. RESFEN calculates the heating and cooling energy use and associated costs, also the peak heating and cooling demand for specific window products. [Based on DOE-2.1E] OS: Windows 95, 98, NT	Free! Download from windows.lbl.gov/software/ resfen

INTERNATIONAL DOE-2 RESOURCE CENTERS

The people listed here have agreed to be primary contacts for DOE-2 program users in their respective countries. Each resource center has the latest program documentation, all back issues of the User News, and recent LBNL reports pertaining to DOE-2. Users may make arrangements to photocopy the new material for a nominal cost. We hope to establish centers in other countries; please contact us if you want to establish a center in your area.

Australia and Australasia

P. C. Thomas, SOLARCH, University of New South Wales, Sydney 2052, Australia

Tel: +61 2 9385 6373 / Fax: +61 2 9385 6735, email PC.Thomas@unsw.EDU.AU www.fbe.unsw.edu.au/units/solarch

Murray Mason, ACADS BSG, 18 High Street, Glen Iris, VIC. 3146, Australia / Tel: +61 39 885 6586 / Fax: +61 39 885 5974

Brazil

Prof. Roberto Lamberts, Universidade Federal de Santa Catarina, Campus Universitario-Trindade, Cx. Postal 476, 88049-900 Florianopolis SC, BRASIL lamberts@ecv.ufsc.br

/ Tel: +55 48 331 9272/ Fax: +55 48 331 9770

Czech Republic

Faculty of Civil Engineering, Dept. of Environmental and Building Services Engineering, Czech Technical University in Prague, Thakurova 7, 166 29 Praha 6, CZECH

REPUBLIC www.fsv.cvut.cz/ascii/index.htm Tel: +42 2 2435 4327

Egypt

Dr. Ossama A. Abdou, Center for Building Environmental Studies and Testing (C-Best), 15-El-Shibani Street, Almanza, Cairo, Egypt Tel: +20 2 391 1137 or +20 2 417 4583 /

Fax: +20 2 519 4343 / oabdou@hotmail.com

Germany

B. Barath or G. Morgenstern, Ingenieurbüro Barath & Wagner GmnH, Postfach 20 21 41, D-41552 Kaarst, Germany

Tel: +49 2 131 7574 9012 G. Morgenstern / Fax: +49 2 131 7574 9029

Hong Kong, China, Taiwan, Japan

Dr. Sam C. M. HUI, Mechanical Engineering Dept., University of Hong Kong, Pokfulam Road, Hong Kong (SAR), CHINA / cmhui@hku.hk,

<http://arch.hku.hk/research/BEER/DOE-2/DOE-2.htm> Tel: +852 2859 2123 Sam Hui / Fax: +852 2858 5415

India

Jiten Prajapati or Anil K. Anand, Energy Systems Engineering, IIT-Mumbai, Powai, Mumbai 400 076, INDIA

Tel : +91 022 578 2545 x7378

Italy

Marco Rapella, Managing Director Divisione Energie, Openplan SRL, c.so di Porta Nuova 13/15, 20121 Milano, Italy Tel: 39 02 626 94252, fax 36 02 2901 0531,

marco.rapella@openplan.it, www.openplan.it

Korea (Chungnam)

Dr. Jun Tae Kim, Department of Architectural Engineering, Kongju National University, 182 Sinkwan-dong, Kongju, Chungnam 314-701, Republic of Korea /

jtkim@knu.kongju.ac.kr / Tel: +82 416 850 8653 / Fax +82 416 856 9388

Korea (Seoul)

Dr. Jung-Ho Huh, Ph.D., Assistant Professor, Dongdaemoon-Gu Jeonngong-Dong 90, Dept. of Architectural Engineering, The University of Seoul, Seoul 130-743, Korea. --

huhj0715@uoscc.uos.ac.kr, Tel: +02-2210-2616 / Fax: +02-2248-0382

Korea (Taejon)

Dr. Euy-Joon Lee and Jong-Ho Yoon, Passive Solar Research Team, Bldg 2, Room 202, Korea Institute of Energy Research, Daeduk Science Town, 71-2 Jang-Dong,

Yusong-Gu, Taejon 305-343, Republic of Korea. -- Lee: ejlee@kier.re.kr, Yoon: yesru@kier.re.kr

Tel: +82 42 860 3514 / Fax: +82 42 860 3132

INTERNATIONAL DOE-2 RESOURCE CENTERS (continued)

New Zealand

Tan Yune, Architecture Department, The University of Auckland, Private Bag 92019, Auckland, New Zealand tanyune@ccu1.auckland.ac.nz / Tel: +64 9 373 7999 x5647 / Fax: +64 9 373 7410

Portugal, Spain, Italy, and Greece

Antonio Rego Teixeira, INETI, Departamento de Energias Renováveis (DER), Estrada do Paco do Lumiar, 1649-038 Lisboa, Portugal
rego.teixeira@mail.ineti.pt / Tel: +351 21 712 7237 / Fax: +351 21 712 7195

Singapore, Malaysia, Indonesia, Thailand, and the Philippines

WONG Yew Wah (Raymond), Nanyang Technological University, School of Mechanical and Production Engineering, Nanyang Avenue, Singapore 2263, Republic of Singapore, mywwong@ntu.edu.sg / Tel: +65 790 5543 / Fax: +65 791 1859

South Africa

Prof. L. J. Grobler, School of Mechanical and Materials Engineering, University of Potchefstroom, Private Bag X6001, Potchefstroom 2520, South Africa,
mgiljg@puknet.puk.ac.za / Tel: +27 148 299 1328 / Fax: +27 148 299 1320

Switzerland

René Meldem, BG ingenieurs Conseils SA, 61 Avenue de Cour, Case postale, CH-1000 Lausanne, Switzerland
Tel: +41 21 618 1111, Fax: +41 21 618 1122, rene.meldem@bg-21.com

Disclaimer: The Building Energy Simulation User News was prepared as an account of work sponsored by the United States Government (USG). While this document is believed to contain correct information, neither the USG nor any agency thereof, nor the Regents of the University of California (RUC), nor any of their employees, makes any warranty, express or implied, or assumes any legal responsibility for the accuracy, completeness, or usefulness of any information, apparatus, product or process disclosed, or represents that its use would not infringe privately owned rights. Reference herein to any specific commercial product, process or service by its trade name, trademark, or otherwise, does not necessarily constitute or imply its endorsement, recommendation, or favoring by the USG or any agency thereof, or the RUC. The views and opinions of authors expressed herein do not necessarily state or reflect those of the USG or any agency thereof or of the Regents of the University of California

INTERNATIONAL DOE-2 ENERGY CONSULTANTS

Australia

P. C. Thomas, Sustainable Building & Energy Consultants, 6/52 Houston Road, Kingsford NSW 2032, Australia.
Tel/Fax: +61 2 9662 0205, Mobile +61 417 405 478, pc_thomas@iname.com

Paul Bannister, Energy Group, Ltd., Unit 9, 14 Lonsdale Street, P. O. Box 25, Braddon, ACT 2612, Australia, Tel: 61 2 6257 7066, Fax 61 2 6257 7063, paul@xgl.com.au, www.egl.net.com

Belgium

Andre Dewint, S.A. Alpha Pi n.v., Avenue Franklin Roosevelt 74 bte 2, B-1000 Bruxelles, BELGIUM, Tel: +32 2 343 4251 / Fax: +32 2 343 0377, andewint@vub.ac.be

Canada

Curt Hepting, P.Eng. EnerSys Analytics, 2989 Delahaye Drive, Coquitlam, B.C. V3B 6Y9 Canada chepting@enersys.ca, www.enersys.bc.ca/homepage
Tel: (604) 552-0700 / Fax (604) 552-0713

Dejan Radoicic, D. W. Thomson Consultants, Ltd., 1985 West Broadway #200, Vancouver, BC V6J 4Y3, Canada Tel (604) 731-4921 / Fax (604) 738-4420, dwtvan@dwtc.bc.ca, www.dwtc.bc.ca

INTERNATIONAL DOE-2 ENERGY CONSULTANTS (continued)

Australia

Neil A. Caldwell, PE, Ameresco Canada, Inc., 1730 - 401 West Georgia St., Vancouver, BC V6B 5A1 Canada, Tel (604) 684-4984 / Fax (604) 684-4985
ncaldwell@ameresco.com

Dr. Stephane Bilodeau, PE, President, Groupe Enerstat, Inc., 79 Wellington North #202, Sherbrooke (Quebec) J1H 5A9, Canada
sbilodeau@groupeenerstat.com, www.groupeenerstat.com/english/index.htm / Tel: (819) 562-8040 / Fax (819) 562-5578

Gordon Shymko, G.F. Shymko & Associates, Inc., 129 Evergreen Crescent S.W., Calgary, Alberta T2Y 3R2, Canada, gfshymko@home.com, Tel: (403) 254-4776, Fax: (403) 254-4795,

Germany

Jens Grundt and Ludwig Michel, GMW-Ingenieurburo, Die Planer Villa, Bunteweg 10a, 30559 Hannover, Lower Saxony, Germany
Tel: +49 0511 58 59 48 -11/Fax +49 0511 58 59 48 -48 www.gmw-ingenieurbuero.de j.grundt@gmw-ingenieurbuero.de

Italy

Marco Rapella, Managing Director Divisione Energie, Openplan SRL, c.so di Porta Nuova 13/15, 20121 Milano, Italy Tel: 39 02 626 94252, fax 36 02 2901 0531,
marco.rapella@openplan.it, www.openplan.it

Ireland

Paul Overy, Overy + Associates, Mechanical and Electrical Consulting Engineers, 43 Parnell Street, Clonmel, Co Tipperary, Ireland
Tel: +353 (0)52-27667, Fax: +353 (0)52-29238 www.overy-assoc.com

Switzerland

René Meldem, BG ingenieurs Conseils SA, 61 Avenue de Cour, Case postale, CH-1000 Lausanne, Switzerland
Tel: +41 21 618 1111, Fax: +41 21 618 1122, rene.meldem@bg-21.com

Philip Schluchter, Institut für Bauphysik Klein, Urs Graf-Strasse 1, CH-4052 Basel, Switzerland

Gerhard Zweifel, Hochschule Technik + Architektur Luzern, Technikumstrasse 21 Abt. HLK, CH-6048 Horw, Switzerland gzweifel@ztl.ch
Tel: +41 349 3349, Fax: 349 3960

Markus Koschenz, Building Equipment Section 175, EMPA, 129 Überlandstrasse, CH-8600 Dübendorf, Switzerland
Markus.Koschenz@empa.ch, Tel: +41 1823 5511, Fax: 821-6244

United Kingdom

Dr. Peter Simmonds, Ove Arup and Partners, Ltd., 13 Fitzroy Street, London W1P 6BQ, UNITED KINGDOM.
Tel: +44 20-7465-3637 / Fax: 7465-3667, peter.simmonds@arup.com / www.arup.com

U. S. DOE-2 ENERGY CONSULTANTS

Arizona

Dale R. Broughton, P.E. drb6@home.com	Quantum Computer Resources www.qcr-usa.com	20833 North 1 st Street	Phoenix, AZ 85027	(623) 780-3496 fax: 322-0049
Henny van Lambalgen, P.E. henny@questenergy.com	Quest Energy Group, LLC www.questenergy.com	4324 East Pearce Road	Phoenix, AZ 85044	(480) 753-5590 fax 753-1215
Marlin S. Addison marlin.addison@doe2.com	M. S. Addison & Associates	1215 West 12th Place	Tempe, AZ 85281	(480) 968-2040 fax: 968-2053
Chuck Sherman ces@essinc.com	ESSengineering	2141 East Broadway, #211	Tempe, AZ 85282	(480) 784-4500 fax: 784-4800

U. S. DOE-2 ENERGY CONSULTANTS (continued)

California				
Joseph Deringer, Peter Zhang jderinger@deringergroup.com	The Deringer Group, Inc. www.deringergroup.com	1349 Addison Street	Berkeley, CA 94703	(510) 843-9000 fax: 843-9005
M. Gabel, R. Howley office@gabelenergy.com	Gabel Associates, LLC www.gabelenergy.com	1818 Harmon Street	Berkeley, CA 94703	(510) 428-0803 fax: 428-0324
George Marton	1129 Keith Avenue		Berkeley, CA 94708	(510) 841-8083
Leo Rainer lirainer@davisenergy.com	Davis Energy Group, Inc. www.davisenergy.com	123 C Street	Davis, CA 95616	(916) 753-1100
Lisa Heshong Doug Mahone	The Heshong Mahone Group www.h-m-g.com	11626 Fair Oaks Blvd, #302	Fair Oaks, CA 95628	(916) 962-7001 fax: 962-0101
Cliff Gustafson, James Trowbridge, P.E.	Taylor Systems Engineering, Inc. www.tse-inc.net	9801 Fair Oaks Blvd., #100	Fair Oaks, CA 95628	(916) 961-3400 fax: 961-3410
Tom Lunneberg, PE tlunneberg@ctg-net.com	Constructive Tech. Group www.ctg-net.com/main.htm	16 Technology Dr., #109	Irvine, CA 92618	(949) 790-0010
David J. Schwed rma@as.net	Romero Management Associates www.asnet/~rma/index.htm	1805 West Avenue K	Lancaster, CA 93534	(805) 940-0540
Martyn C. Dodd support@energysoft.com	Gabel Dodd/EnergySoft, LLC www.energysoft.com	100 Galli Drive, # 1	Novato, CA 94949	(415) 883-5900 fax: 883-5970
Jim Kelsey PE, Kevin Warren kelsey@kw-engineering.com	kW Engineering www.kw-engineering.com	360-17 th Street #100	Oakland, CA 94612	(510) 834-6420 fax: 834-6373
Patrick Nkwocha, PE UPat@worldnet.att.net	Global Tech Services	3360 Foothill Blvd., #108	Pasadena, CA 91107	(626) 583-8205 fax: 583-8206
John F. Kennedy, PE info@geopraxis.com	GeoPraxis, Inc. www.geopraxis.com	205 Keller Street	Petaluma, CA 94952-3874	(707) 766-7010 fax: 766-7014
Greg Cunningham gwc@essinc.com	ESSengineering	114 Sansome St., #1201	San Francisco, CA 94104	(415) 296-9760 fax: 784-9761
Charles Eley, Eric Kolderup info@eley.com	Eley Associates www.eley.com	142 Minna Street	San Francisco, CA 94105	(415) 957-1977 fax: 957-1381
Chandra Shinde, PE	Envirodesign Group	19613 El Camino Esplanade	Walnut, CA 91789-2138	(909) 598-1980
Colorado				
Fred Porter	Architectural Energy Corp	2540 Frontier Ave, #201	Boulder, CO 80301	(303) 444-4149 fax: 444-4304
Ellen Franconi	Nexant	1401 Walnut Street, #403	Boulder, CO 80302	(303) 440-4343 fax: 440-6644
Susan Reilly denver@enermodal.com	Enermodal Engineering	1554 Emerson Street	Denver, CO 80218	(303) 861-2070 fax: 830-2016
Joel Neymark, PE neymarkj@qwest.net	J. Neymark & Associates	2140 Ellis Street	Golden, CO 80401	(303) 384-3672 fax: 384 9427
Norm Weaver, PE n_weaver@interwvr.com	Interweaver Consulting www.interwvr.com	P.O. Box 775444	Steamboat Springs, CO 80477	(970) 870-1710

U. S. DOE-2 ENERGY CONSULTANTS (continued)

Connecticut				
Adrian Tuluca swa@swinter.com	Steven Winter Associates www.swinter.com	50 Washington Street	Norwalk, CT 06854	(203) 857-0200 fax: 852-0741
Florida				
Philip Wemhoff wemhoffp@buildingsleuth.com	9765 MacArthur Court North		Jacksonville, FL 32246	(904) 645-5342
Dr. Paul Hutchins PE,CEM	Reynolds Smith & Hills, Inc. www.rsandh.com	4651 Salisbury Road	Jacksonville, FL 32256	(904) 279-2277 fax: 279-2491
Georgia				
Lung-Sing Wong, PE lswong@bpe-inc.com	Building Performance Engineers www.bpe-inc.com	3060 Wanda Woods Drive	Atlanta, GA 30340	(770) 270-0100
Illinois				
Gary H. Michaels, PE	G.H. Michaels Associates	1512 Crain Street	Evanston, IL 60202	(847) 869-5859
Prem N. Mehrotra	General Energy Corp.	230 Madison Street	Oak Park, IL 60302	(708) 386-6000
Robert Henninger, PE rhenninger@gard.com	GARD Analytics, Inc. www.gard.com	1028 Busse Highway	Park Ridge, IL 60068-1802	(847) 698-5686
Kansas				
Dr. Brian A. Rock, PE	U. Kansas, A/E Dept, Marvin Hall	barock@ukans.edu	Lawrence, KS 66045-2222	(785) 864-3603
Massachusetts				
C. Kalasinsky PE, T.Chan	R.G. Vanderweil Engrs., Inc. www.vanderweil.com	274 Summer Street	Boston, MA 02458-1113	(617) 423-7423 fax: 423-7401
Mark Mullins	Select Energy Services www.selectenergys.com	24 Prime Parkway	Natick, MA 01760	(508) 653-0456 fax: 653-0266
Michael Andelman, P.E. mike@andelmanlelek.com	Andelman and Lelek Engineering, Inc. www.andelmanlelek.com	1410 Providence Highway	Norwood, MA 02062	(781) 769-8773 fax: ***-****
Minnesota				
Daniel A. Katzenberger, P.E. dan@k-usa.com	Katzenberg USA Inc. http://www.k-usa.com	7540 Edinborough Way, 1303	Edina, Minnesota, MN 55435	(952) 893-7379 fax 952-835-1442
Missouri				
Mike Roberts	Roberts Engineering Co.	11946 Pennsylvania	Kansas City, MO 64145	(816) 942-8121
Bruce A. Leavitt, PE	Wm. Tao & Associates Inc.	2357-59 th Street	St. Louis, MO 63110	(314) 644-1400
Montana				
Michael W Harrison, PE	Harrison Engineering	139 Bluebird Lane	Whitehall, Montana 59759	(406) 287-5370
Nebraska				
Philip M. Schreier, PE FEI-OMA@worldnet.att.net	Farris Engineering www.nebraska.org/4/4/01/00/co.htm	11239 Chicago Circle	Omaha, NE 68154-2634	(402) 330-5900 fax: 330-5902

U. S. DOE-2 ENERGY CONSULTANTS (continued)

New York				
Robert E. Gibeault gibeault@pbworld.com	PB Power, Inc. www.pbworld.com	1873 Western Avenue #201	Albany, NY 12203	(518) 862-0012 fax: 862-1608
J. Fireovid, P.E., K. Yousef, P.E.	SAIC Energy Solutions Div. www.saic.com	421 New Karner Road	Albany, NY 12205	(518) 452-8800 fax: 452-8111
Dave Pruitt, Scott Frank	Jaros, Baum & Bolles www.jbb.com	80 Pine Street	New York, NY 10005	(212) 530-9300
North Carolina				
Gopal Shiddapur, PE gsshidda@duke-energy.com	DukeSolutions (MC: ST05A) duke-energy.com	230 S. Tryon Street, # 400	Charlotte, NC 28202	(704) 373-4439 fax: 373-4872
Oregon				
Carol Gardner	Gardner Energy Management Services	PO Box 12549	Portland, OR 97212-0549	(503) 223-4847 fax: 223-8486
John P. Karasaki, P.E. john_karasaki@pgn.com	Energy Services Group	16280 SW Upper Boones Ferry Rd.	Portland, OR 97224	(503) 603-1629
Pennsylvania				
Kimberly Byk, wba@utcorp.com	Wood, Byk & Associates, Inc.	829 Meadowview Road	Kennett Square, PA 19348	(610) 347-0710 fax: 347-0711
Texas				
Jeff S. Haberl jhaberl@esl.tamu.edu	Energy Systems Laboratory esl.tamu.edu	Texas A&M University	College Station., TX 77843-3123	(409) 845-6065
Tarek Bou-Saada	bousaada@flash.net	4410 Grand Cayman Drive	Sugar Land, TX 77479	(281) 265-9139
Virginia				
Jay Hall jayhall@icfconsulting.com	ICF Consulting	9300 Lee Highway	Fairfax, VA 22031	(410) 263-3162 fax (703) 934-3530
Kurmit C. Rockwell, P.E. CEM krockwell@xenergy.com	XENERGY	4400 Fair Lakes Court	Fairfax, VA 22033-3811	(703) 631-6912 fax: 631-4119
Dave Walker walkeng@swva.net	Walker Engineering www.swva.net/walkeng	P.O. Box 366, 4230 Pulaski Giles Turnpike	Staffordsville, VA 24167	(540) 921-4544 fax: 921-4548
Dr. Hosan F. Abaza	email: habaza@vt.edu	1405 Bayside Avenue #12	Woodbridge, VA 22191	(703) 498-3084 fax: 550-9755
Washington				
Steve Byrne byrne@item.com	ITEM Systems, suite 344 www.halcyon.com/byrne/item.htm	321 High School Road NE	Bainbridge Island, WA 98110	(206) 855-9540
Gregory J. Banken, PE gbanken@qmetrics.com	Q-Metrics, Inc. www.qmetrics.com	P.O. Box 3016	Woodinville, WA 98072-3016	(425) 825-0200 fax: 825-0136

Support Tools for EnergyPlus and DOE-2 from The Deringer Group

EzPlus-Parm

This is a standalone Windows tool intended for EnergyPlus parametric analysis. It was designed to simplify the running of multiple parametric EnergyPlus simulations by helping a user organize and edit all needed files.

Draw EzPlus

A tool that displays the 3-D geometry embedded in an EnergyPlus file. The user can toggle between line and surface (fill) presentation modes, and can select to draw any mix of key building objects – floor, walls, roof, windows, and attached and detached shading.

EnergyPlus Online Simulations

One set of tools is online and embedded in the [EcoAdvisor](#), a set of online training modules for sustainable buildings. These tools can be used by anyone and require no special knowledge of EnergyPlus.

EnergyPlus Interface Support Tools

This is a set of stand-alone Windows-based tools intended to make the text-based use of EnergyPlus faster, easier, and more accurate.

DOE-2 Parametric Study Tool -- DOE2Parm

DOE-2 parametric analysis can be complicated because you need to link, run and edit multiple files that can be located anywhere on your computer. DOE2Parm allows you to run the parametric analysis in the same window. DOE2Parm is an MS Windows-based tool.



Founded in 1980, The Deringer Group (TDG) specializes in sustainable and energy efficient building design projects and studies throughout the world. TDG is developing several support tools for EnergyPlus all of which may be freely downloaded.

• www.deringergroup.com • www.deringergroup.com • www.deringergroup.com • www.deringergroup.com

• www.deringergroup.com • www.deringergroup.com • www.deringergroup.com • www.deringergroup.com

• www.deringergroup.com • www.deringergroup.com • www.deringergroup.com • www.deringergroup.com •