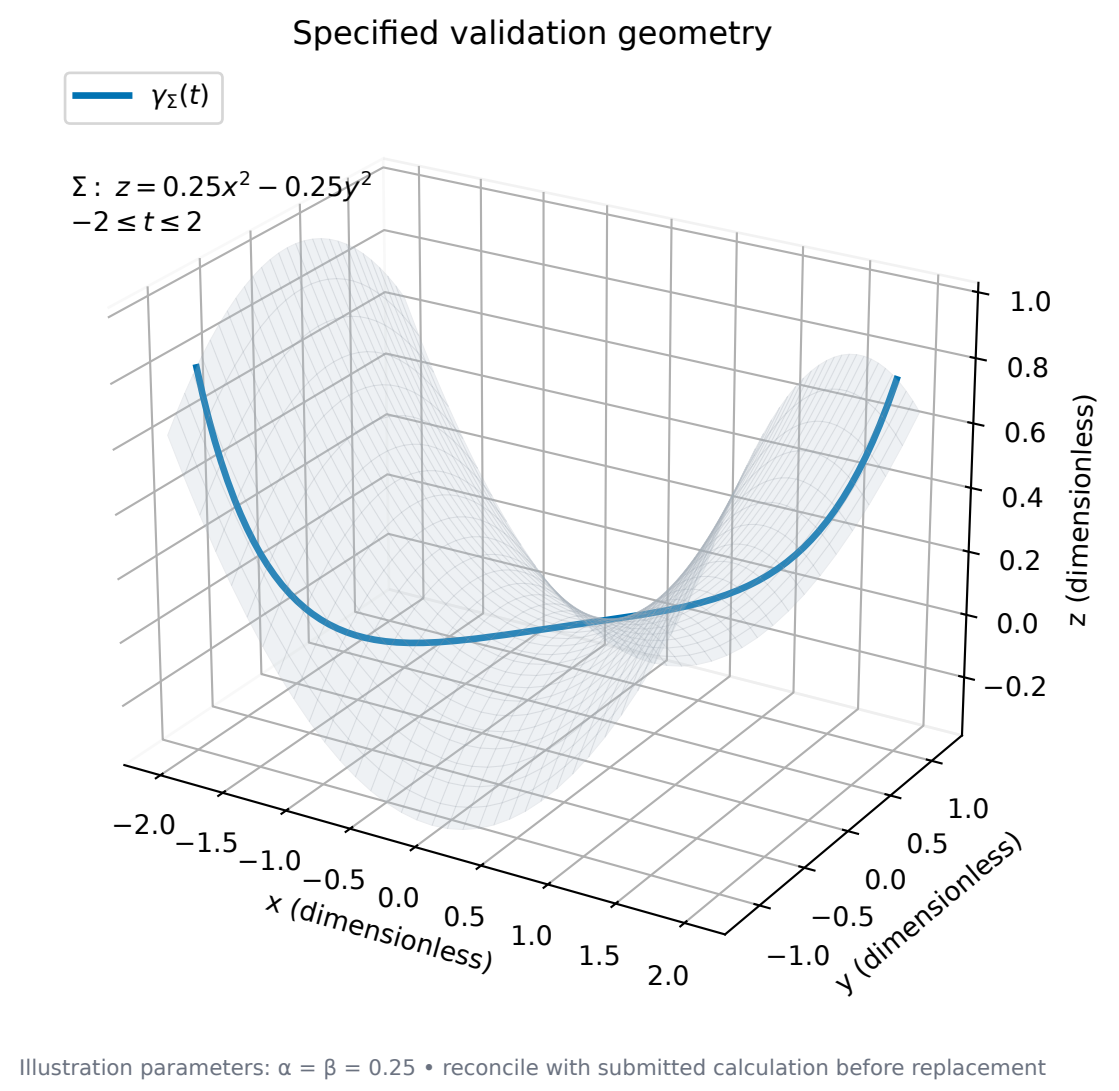

Illustration parameters: α = β = 0.25 • reconcile with submitted calculation before replacement