



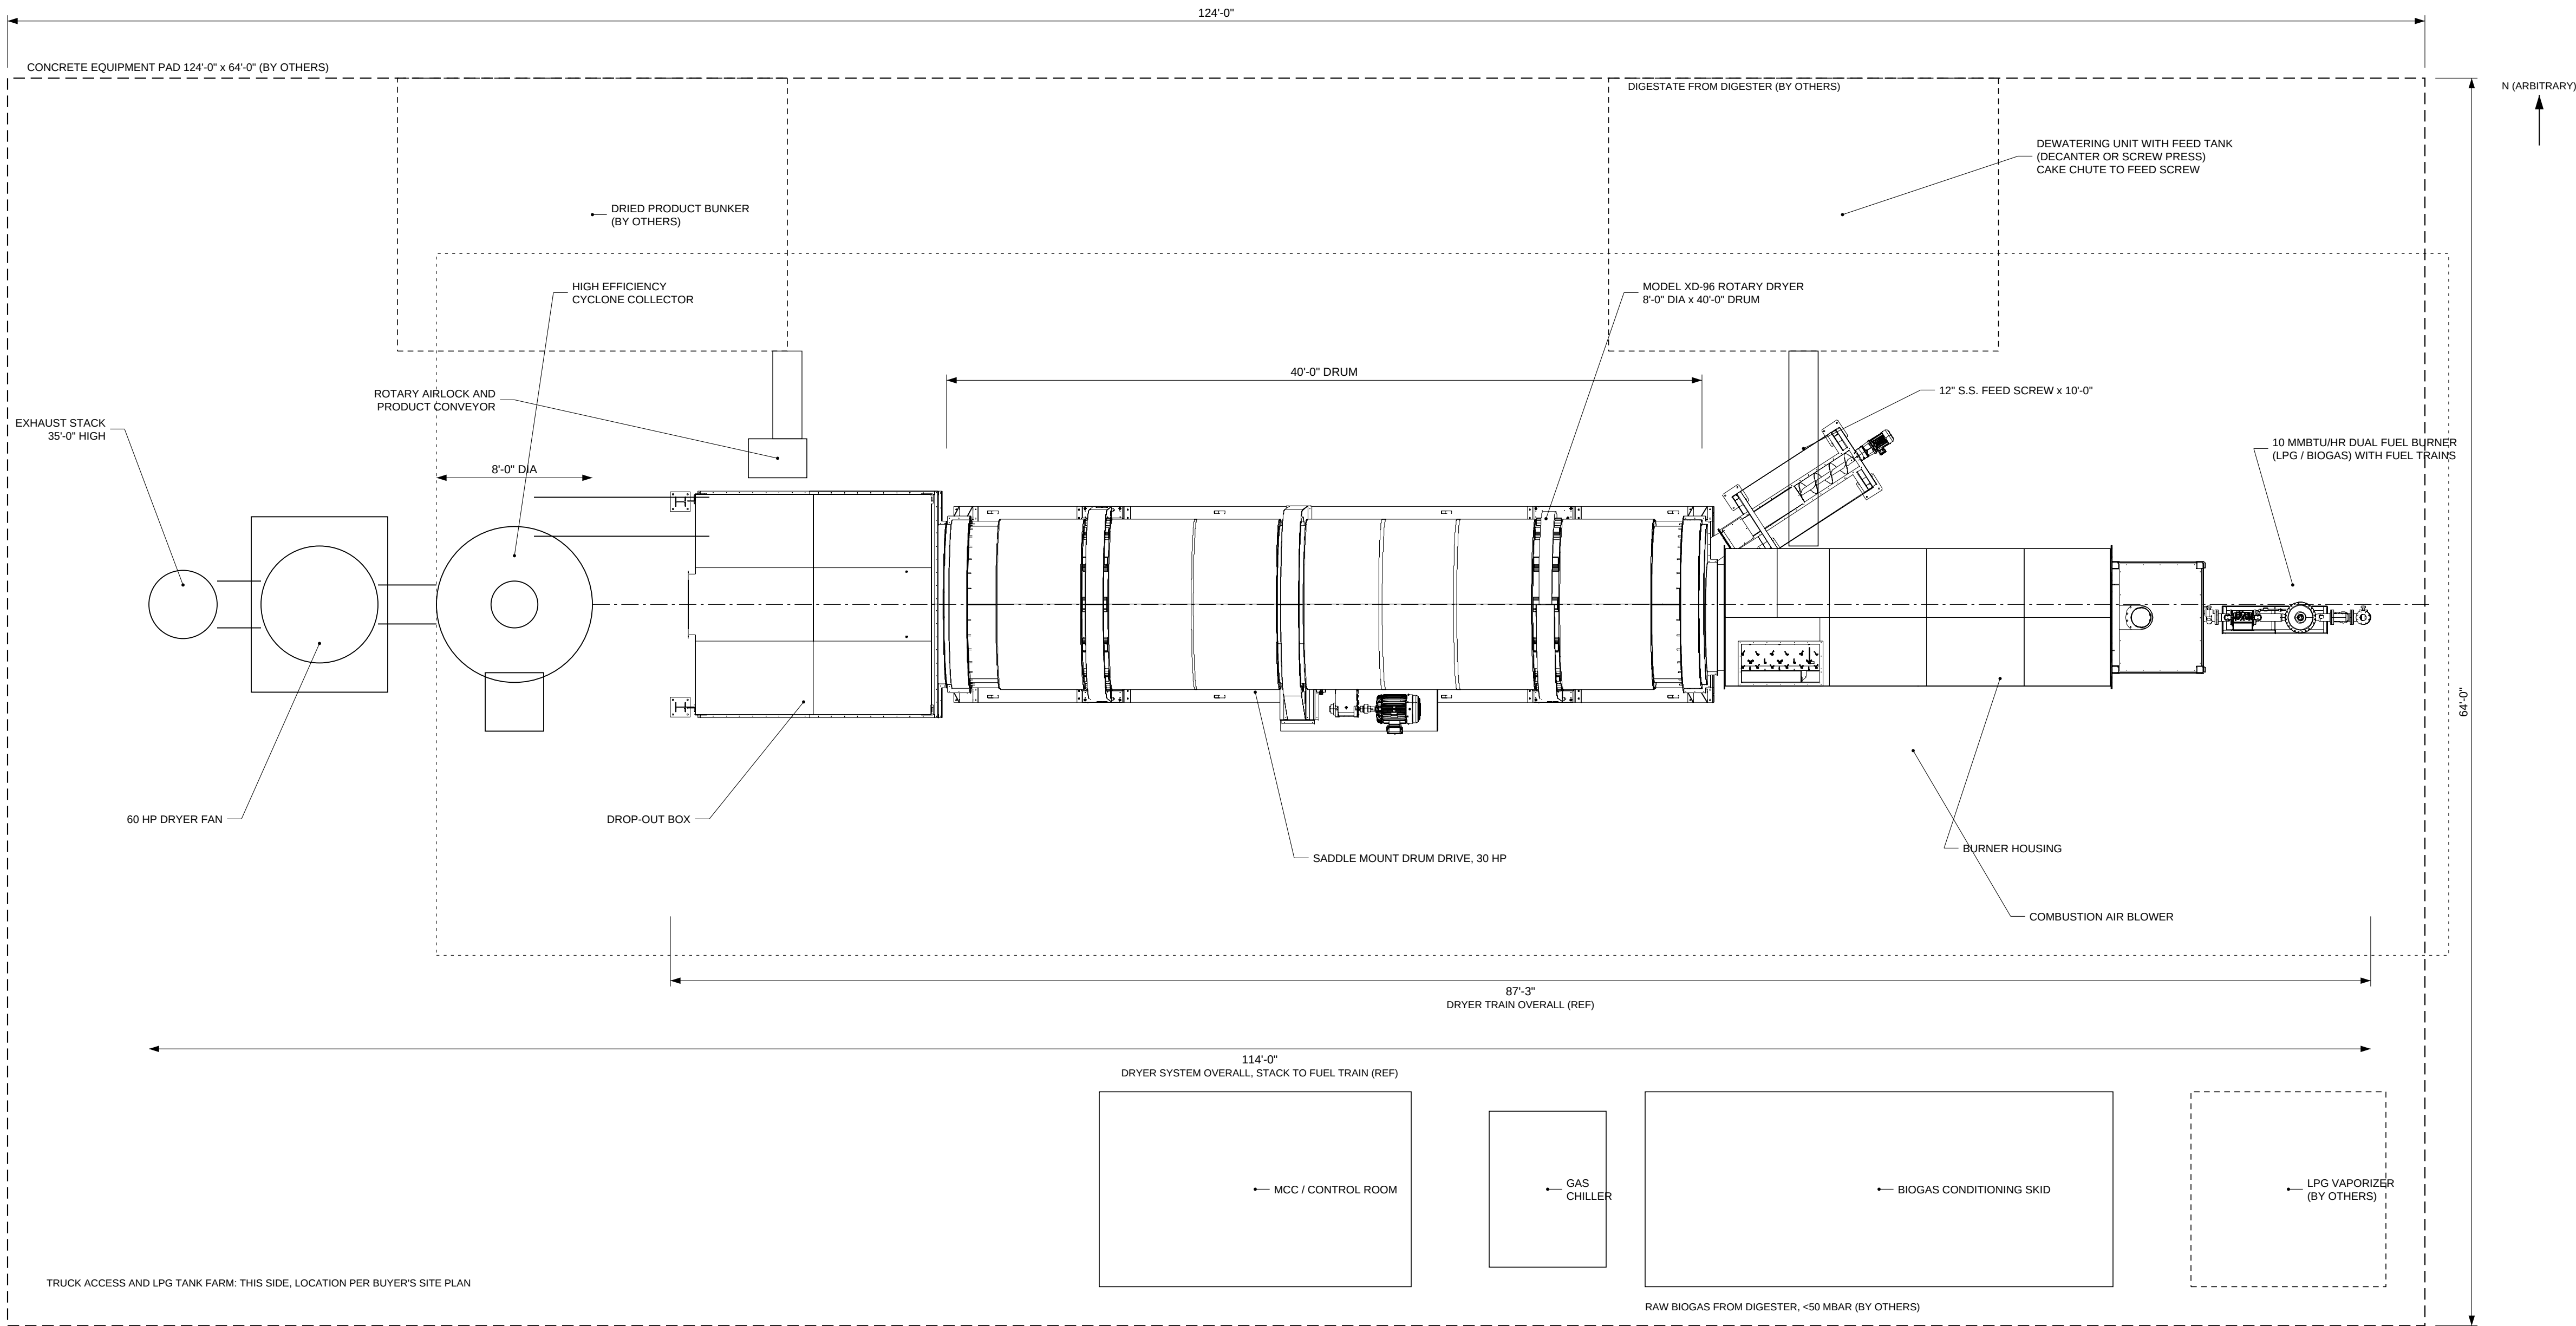

PLAN VIEW

MODEL XD-96 DRYER SYSTEM
Scale 3/16" = 1'-0"

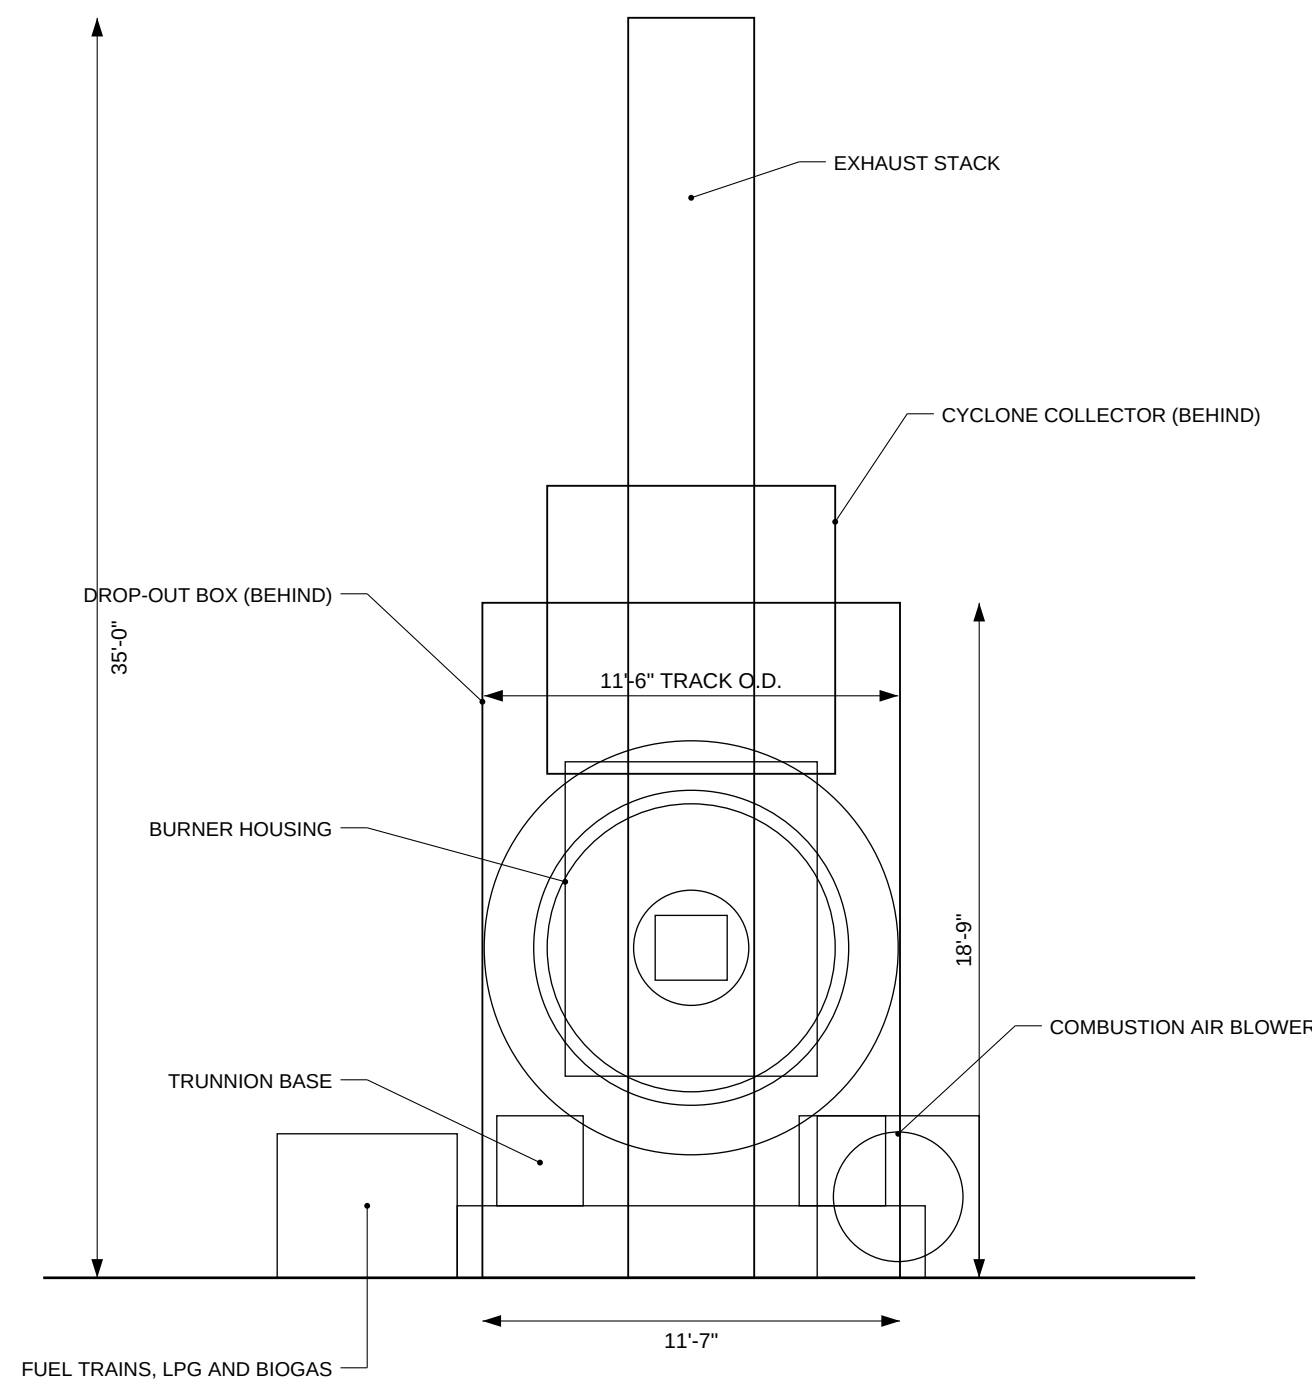

END VIEW

MODEL XD-96 DRYER SYSTEM
Scale 3/16" = 1'-0"

GENERAL NOTES

1. PRELIMINARY ARRANGEMENT FOR SITE PLANNING ONLY. DIMENSIONS OF THE DRYER TRAIN ARE TAKEN FROM THE MCE 8'-0" x 40'-0" DRYER GENERAL ARRANGEMENT. CYCLONE, FAN, DUCTING, FEED, DISCHARGE, DEWATERING AND BIOGAS EQUIPMENT ARE SHOWN SCHEMATICALLY AND WILL BE SIZED IN FINAL ENGINEERING. EQUIPMENT CAN BE ROTATED TO SUIT BUYER'S SITE PLAN.
2. BASIS: 140 MT/DAY DIGESTATE AT 8% TS, DEWATERED TO 22-30% TS AHEAD OF THE DRYER, DRIED TO 15% MOISTURE. 10 MMBTU/HR DUAL-FUEL BURNER, BIOGAS PRIMARY WITH LPG STAND-BY. DRUM MATERIAL CARBON STEEL (316L OPTIONAL).
3. ESTIMATED EQUIPMENT WEIGHTS FOR FOUNDATION DESIGN: DRUM AND SKID 79,900 LB EMPTY PLUS UP TO 19,300 LB OF MATERIAL IN THE DRUM WHEN RUNNING, BURNER ASSEMBLY 18,000 LB, DROP-OUT BOX 9,300 LB, CYCLONE, FAN, DEWATERING AND SKID WEIGHTS TO FOLLOW.
4. UTILITIES: 480V/3PH/60HZ (OR 440V/60HZ), APPROX. 160 HP CONNECTED, 100 KW AVERAGE, BIOGAS FROM DIGESTER AT <50 MBAR TO SKID INLET; SKID DELIVERS 2 PSIG TO THE BURNER TRAIN. LPG VAPOR 5 PSIG AT THE BURNER TRAIN (SUPPLY BY OTHERS). INSTRUMENT AIR 5 SCFM AT 90 PSIG. WASH-DOWN AND POLYMER MAKE-UP WATER 2 GPM AVERAGE, 20 GPM PEAK.
5. CONCRETE EQUIPMENT PAD 124'-0" x 64'-0", ROOF OVER DRYER TRAIN, DEWATERING UNIT AND BIOGAS SKID RECOMMENDED. 10'-0" MAINTENANCE CLEARANCE AROUND THE DRYER TRAIN AND CRANE ACCESS ALONG THE COMBUSTION BLOWER SIDE FOR DRUM AND TRUNNION SERVICE.
6. LPG STORAGE, BIOGAS PIPING FROM THE DIGESTER, DIGESTATE PUMPING, CENTRATE RETURN, PRODUCT BUNKER, ELECTRICAL FEEDER, FOUNDATIONS, ROOFING AND EXHAUST SCRUBBER (IF REQUIRED BY THE AIR PERMIT) ARE BY OTHERS. LPG TANKS MIN. 50'-0" FROM THE DRYER PER LOCAL CODE.
7. DRYER CONTROL PANEL AND MCC TO BE LOCATED IN THE CONTROL ROOM SHOWN OR REMOTELY AS PREFERRED.



THIS DRAWING AND THE DESIGN SHOWN THEREIN IS THE PROPERTY OF MIDWEST CUSTOM ENGINEERING, INC. ANY DUPLICATION OR USE OF THIS PRINT FOR PURPOSES OTHER THAN THAT FOR WHICH IT WAS FURNISHED IS HEREBY PROHIBITED. COPYRIGHT 2026, MIDWEST CUSTOM ENGINEERING, INC. ALL RIGHTS RESERVED.


MCE GENERAL ARRANGEMENT

LETEK DCG / BACHOCO - MODEL XD-96 8'-0" x 40'-0" ROTARY DRYER SYSTEM
PRELIMINARY PLAN AND ELEVATIONS - MERIDA, YUCATAN

DRAWN:	MCE	DATE:	9/18/2026	DRAWING NUMBER:		REV:	
CHECK:		DATE:					
SCALE:	3/16" = 1'-0" [1:64]			SHEET:	1 OF 1		

SD-26-01

P1

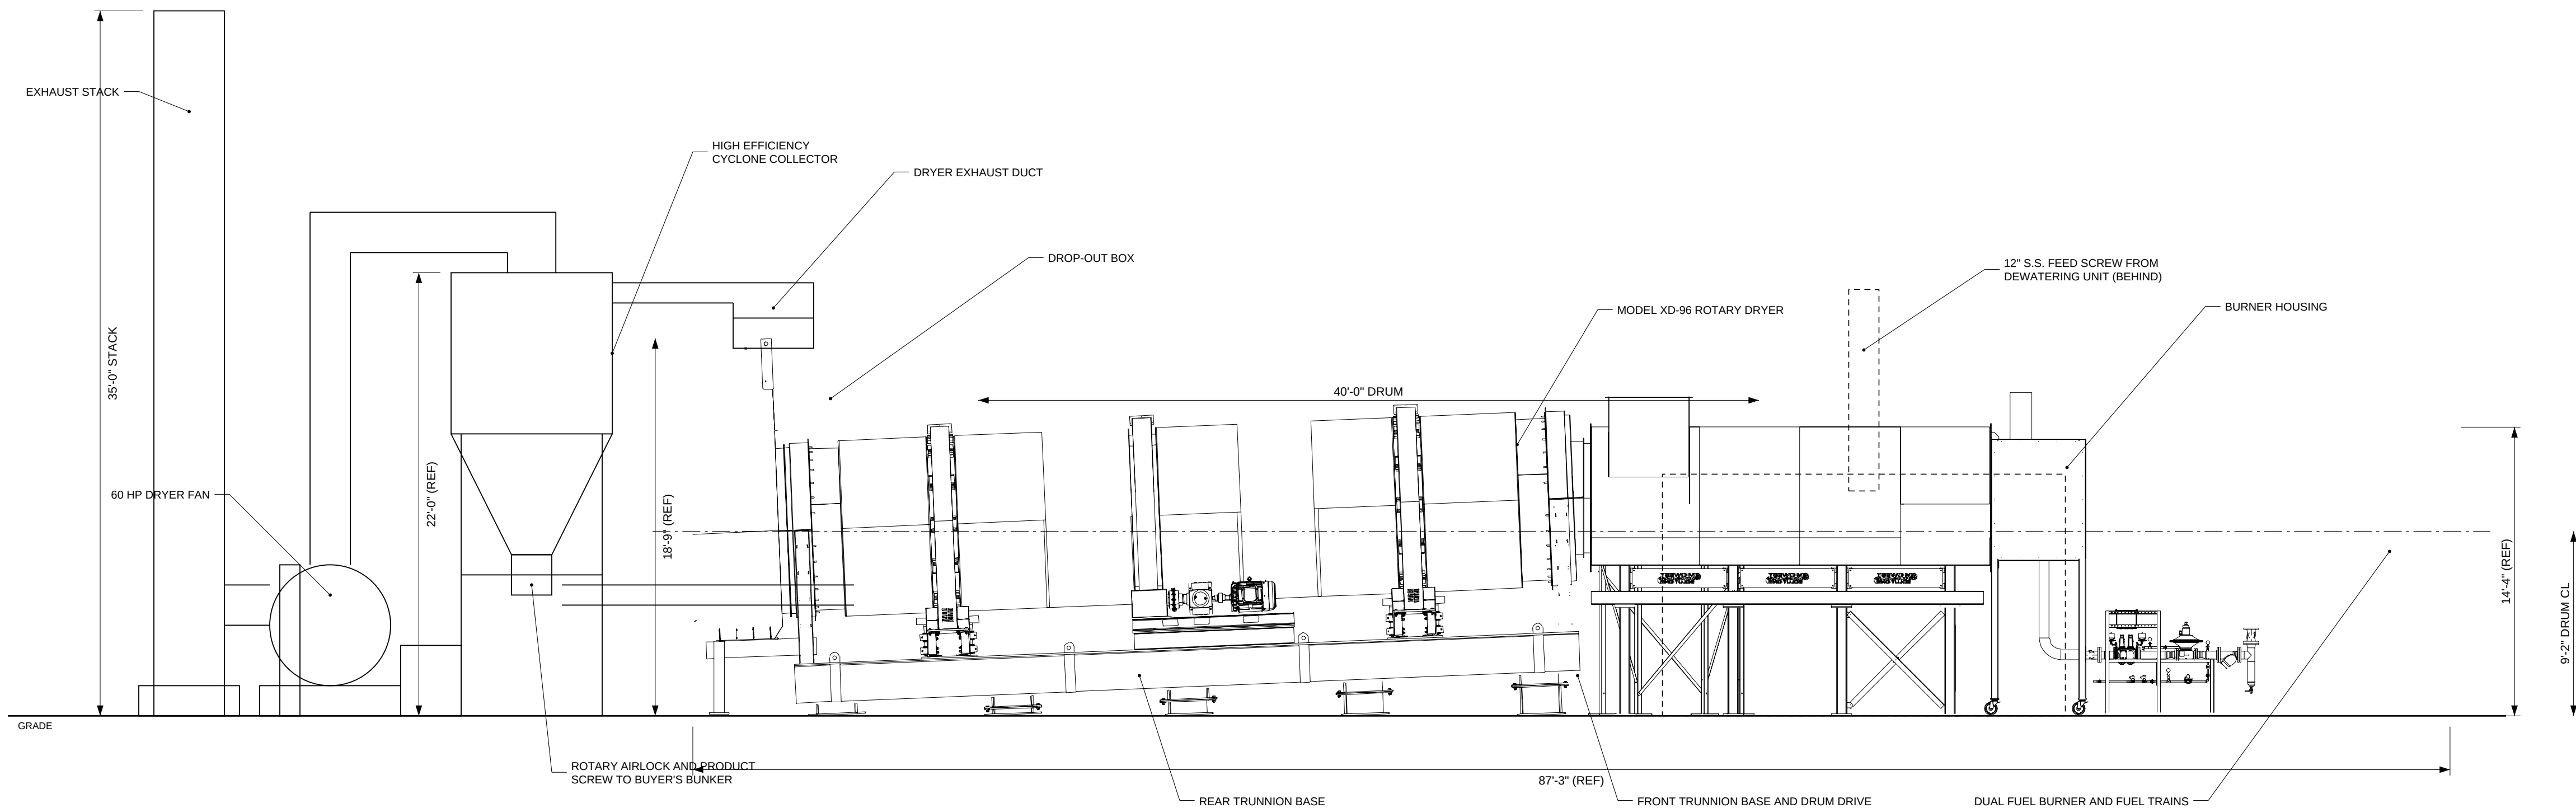

ELEVATION VIEW

MODEL XD-96 DRYER SYSTEM
Scale 3/16" = 1'-0"