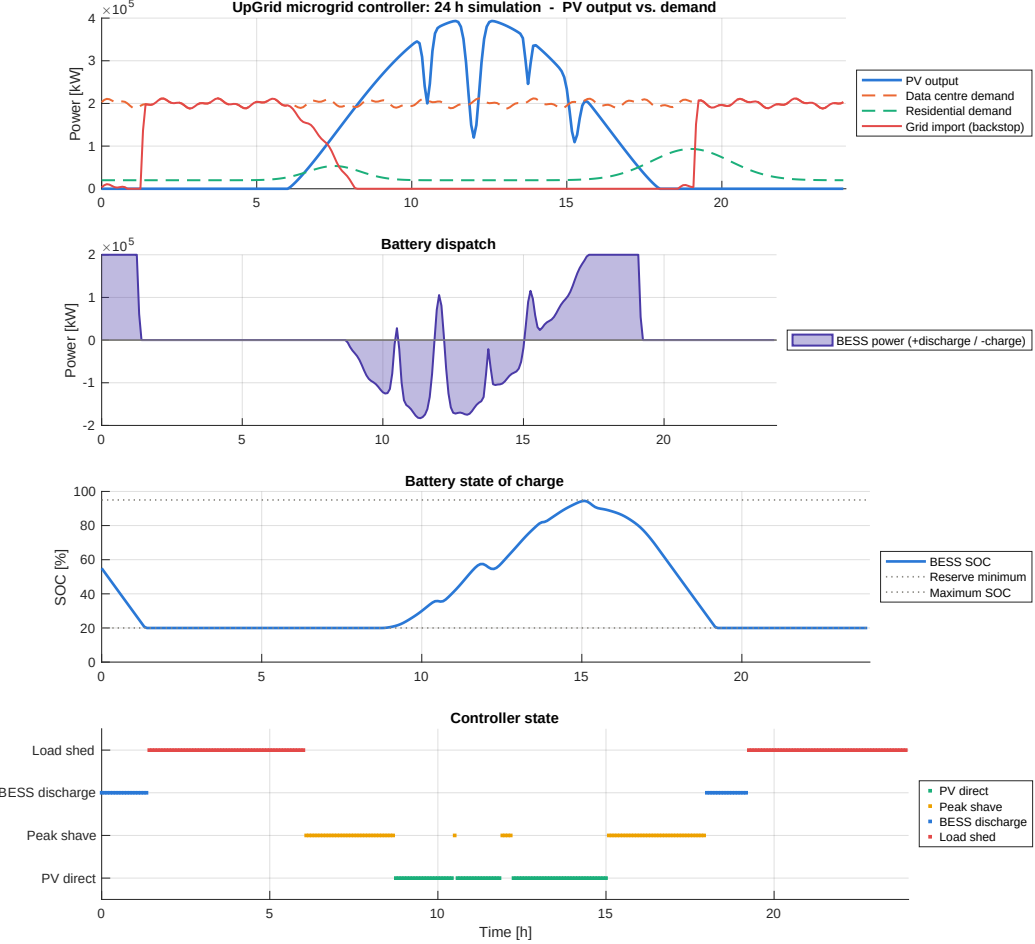
UpGrid microgrid controller: 24 h simulation - PV output vs. demand
×10^5
Power [kW]
PV output
Data centre demand
Residential demand
Grid import (backstop)
Battery dispatch
BESS power (+discharge / -charge)
Battery state of charge
SOC [%]
BESS SOC
Reserve minimum
Maximum SOC
Controller state
Load shed
BESS discharge
Peak shave
PV direct
Time [h]