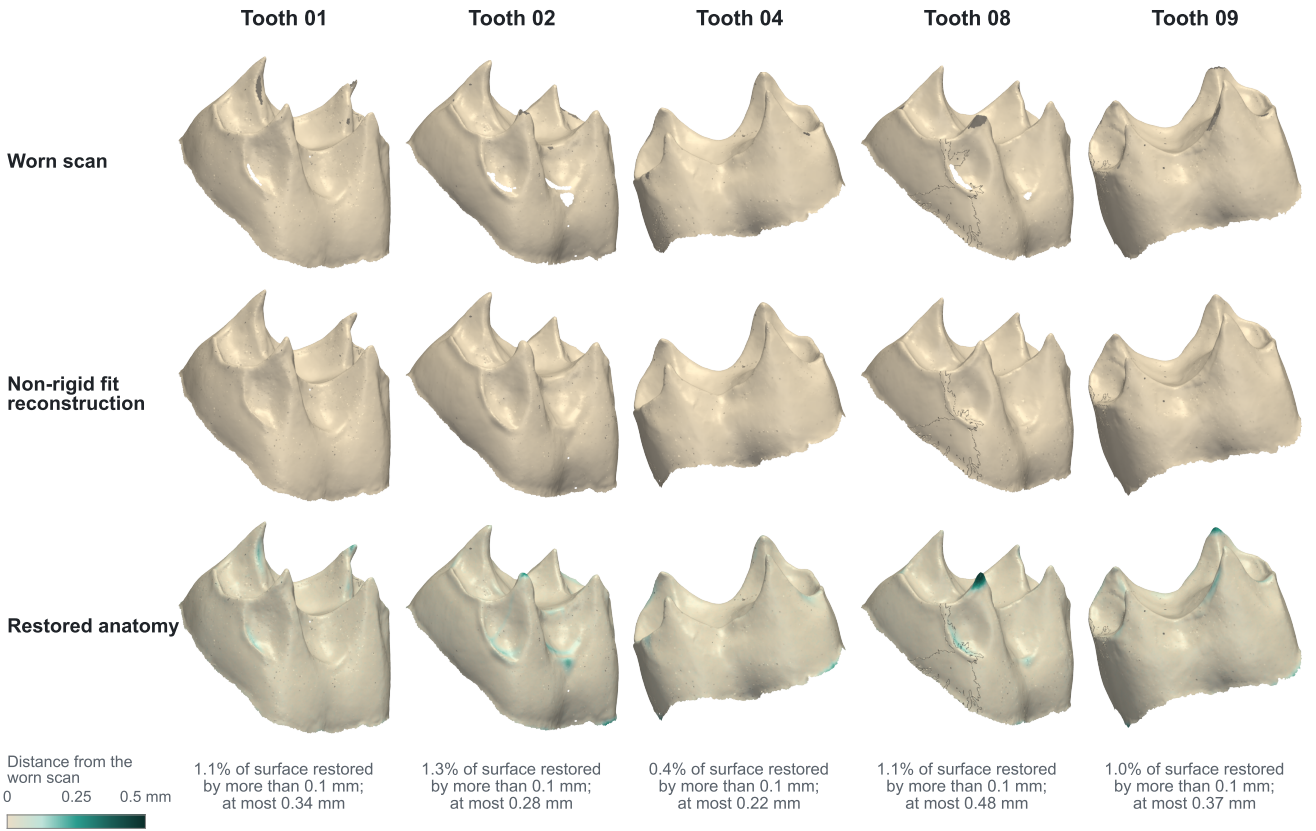

Tooth 01
Tooth 02
Tooth 04
Tooth 08
Tooth 09
Worn scan
Non-rigid fit reconstruction
Restored anatomy
Distance from the worn scan
0
0.25
0.5 mm
1.1% of surface restored by more than 0.1 mm; at most 0.34 mm
1.3% of surface restored by more than 0.1 mm; at most 0.28 mm
0.4% of surface restored by more than 0.1 mm; at most 0.22 mm
1.1% of surface restored by more than 0.1 mm; at most 0.48 mm
1.0% of surface restored by more than 0.1 mm; at most 0.37 mm