




FOOTINGS AND FOUNDATION GENERAL NOTES:

1. ASSUMED SOIL BEARING PRESSURE OF 2000 P.S.F.
 2. ALL CONC. TO BEAR ON FIRM, NATURAL, UNDISTURBED SOIL
 3. CONCRETE COMPREHENSIVE STRENGTH AT 28 DAYS TO BE: WALLS NOT EXPOSED TO WEATHER
- 2500 PSI WALLS EXPOSED TO WEATHER
- 3000 PSI PORCHES, STEPS AND GARAGE SLAB 3500 PSI
4. EXTEND FOOTING BELOW FROST LINE, (30" MIN. INTO NATURAL SOIL FOR 1 STORY AND 2 STORY CONSTRUCTION). FOOTINGS TO BE 10" THICK. ALL FOUNDATION WALLS TO BE 8" WIDE. UNLESS SPEC IS PROVIDED WITHIN 2" BUT NOT CLOSER THAN 1" FROM THE FACE OF THE WALL AWAY FROM THE SOIL. STEEL TO BE 2 - #3'S HORIZONTAL
 5. THE GRADE AWAY FROM THE FOUNDATION WALLS TO FALL A MIN. OF 6" WITHIN THE FIRST 10 FEET
 6. GARAGE: 4" CONC. SLAB W/ 10# - 10# - 6"X6" W.W.M. OVER 4" SAND FILL. SLOPE 1/4" MIN. PER FT. FOR DRAINAGE

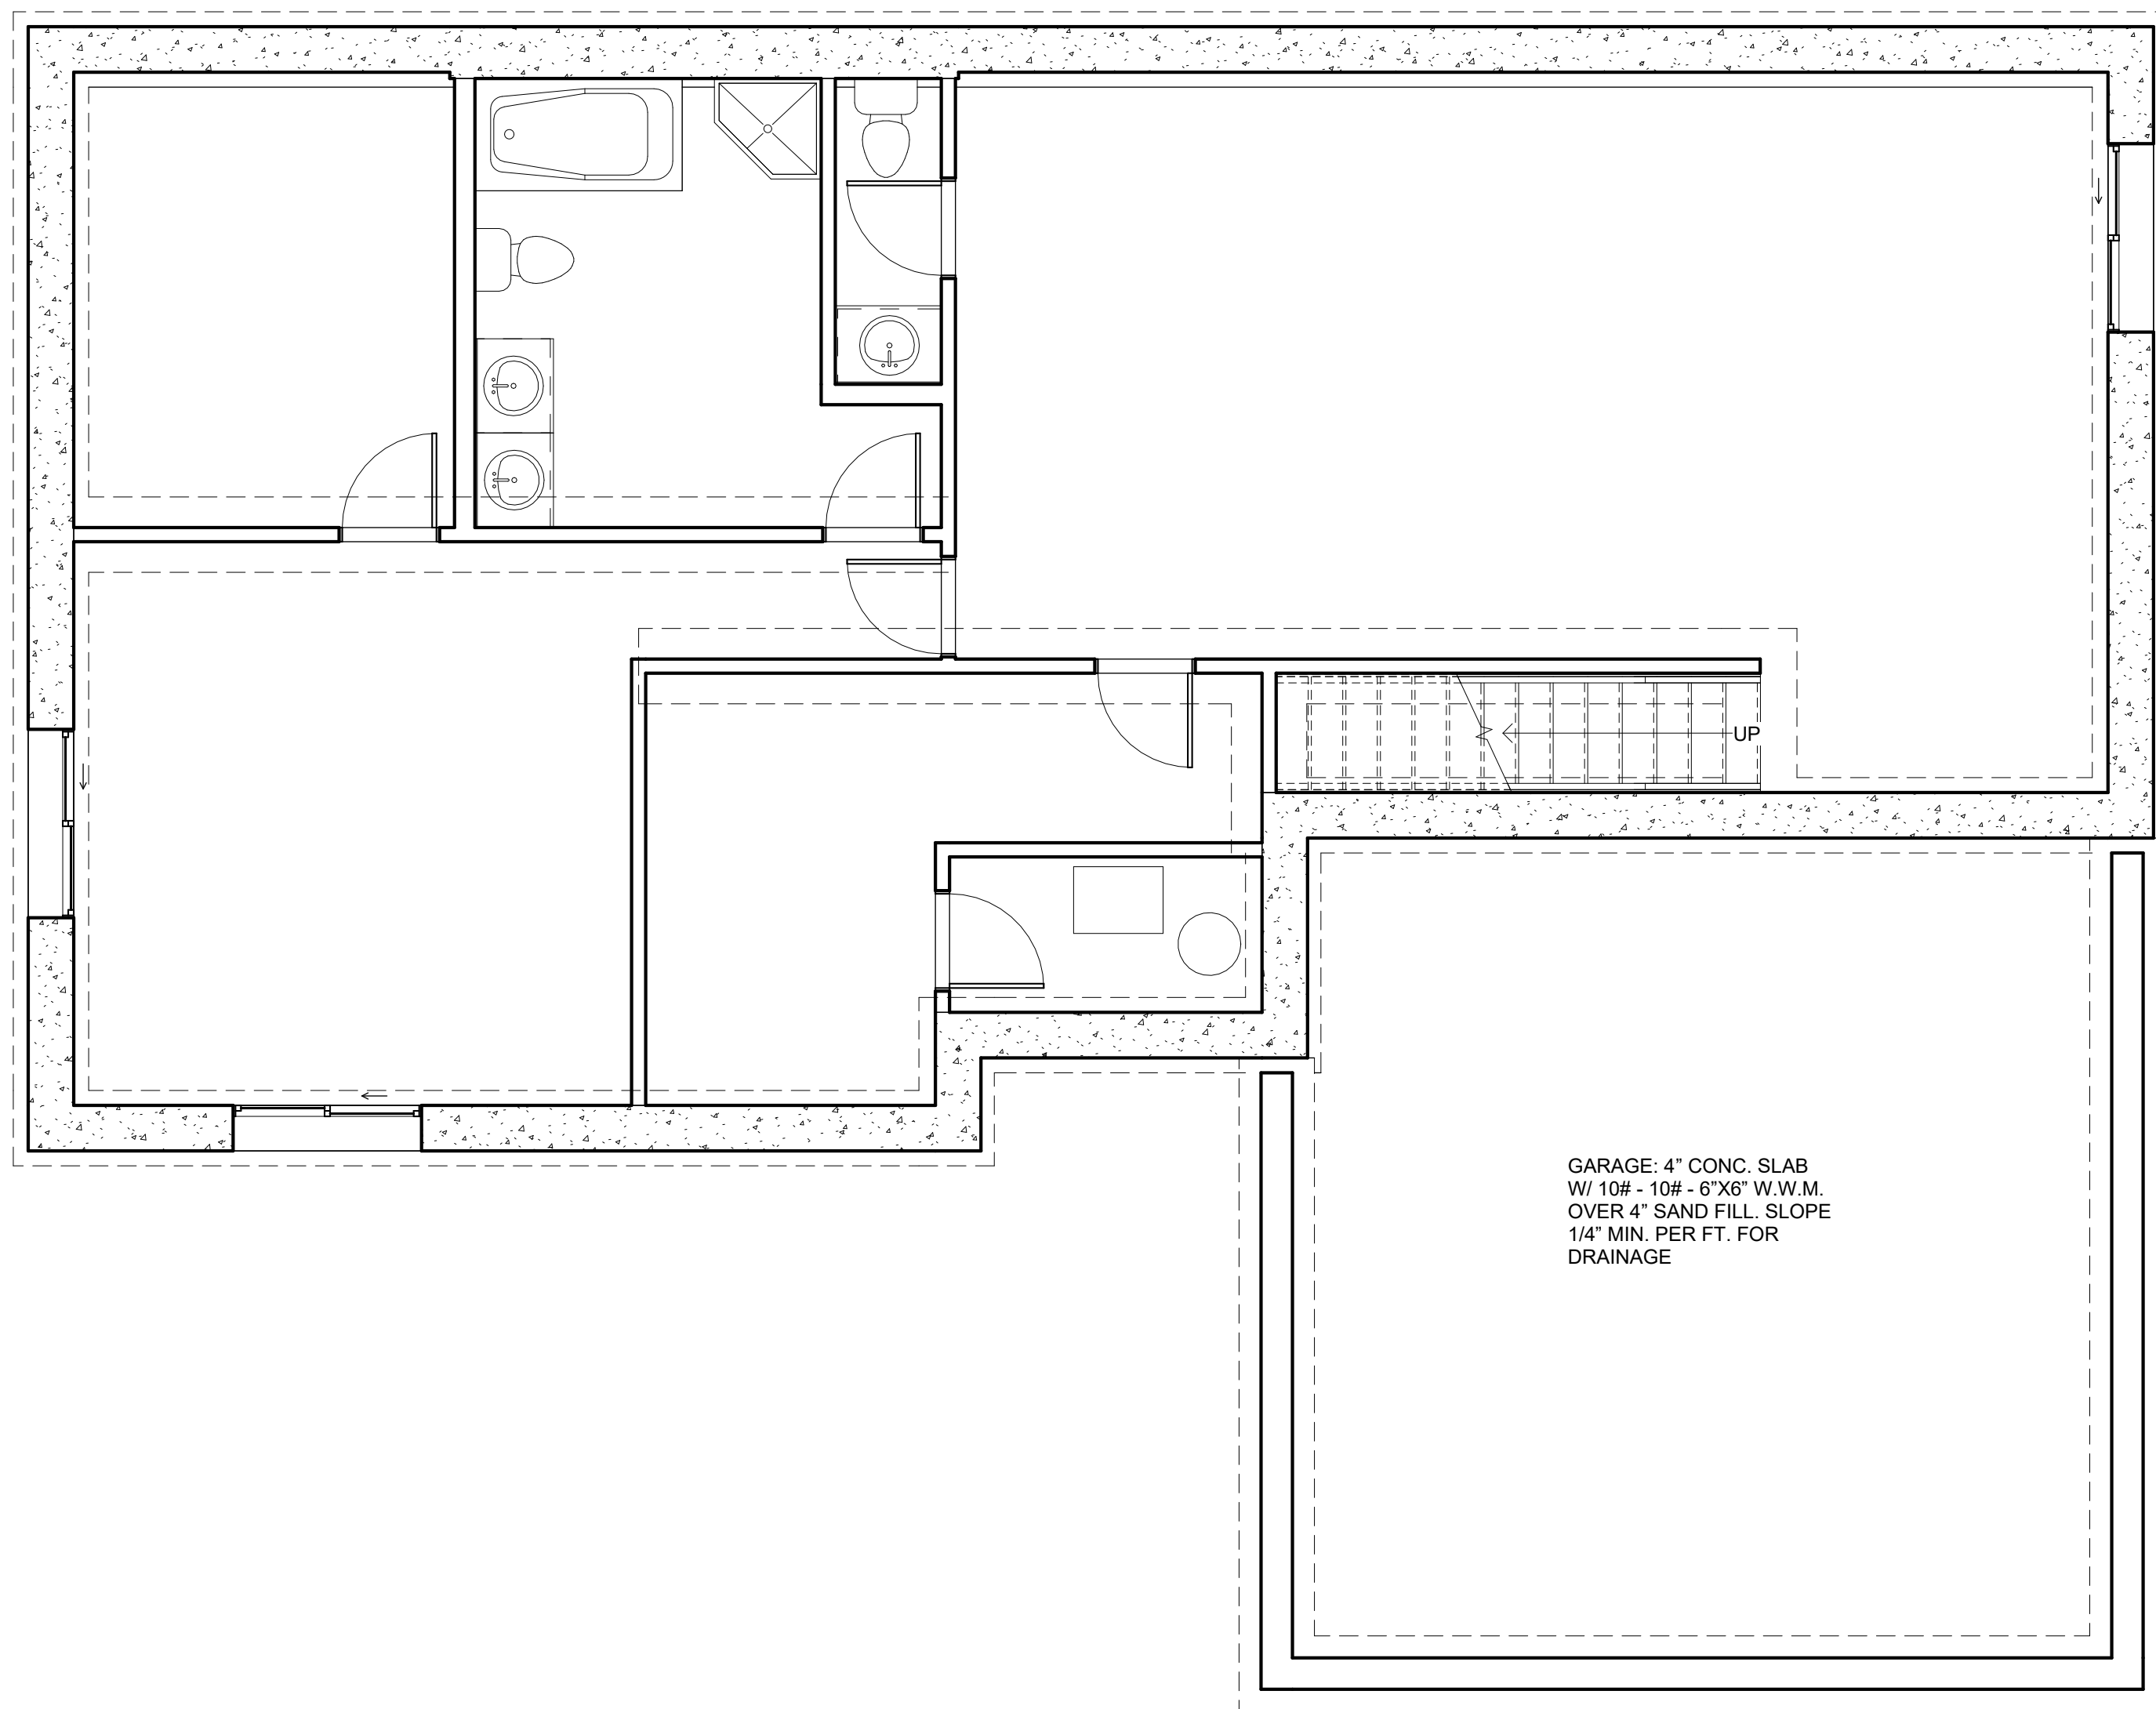

www.autodesk.com/revit

Consultant
Address
Address
Phone
Fax
e-mail

Consultant
Address
Address
Phone
Fax
e-mail

Consultant
Address
Address
Phone
Fax
e-mail

Consultant
Address
Address
Phone
Fax
e-mail

Consultant
Address
Address
Phone
Fax
e-mail

[illegible]

Owner

Project Name

Foundation Plan

Project number	Project Number
Date	Issue Date
Drawn by	Author
Checked by	Checker
S0	
Scale	1/4" = 1'-0"

S0

① T.O. House Footing
1/4" = 1'-0"