



SAMPLE REPORT — reference design, not your parklet

CURBSIDE

Schematic parklet design for Vancouver streets

Sample parklet

Example street, Vancouver
2026-10-03

Preliminary: not for construction

Checks: 19 pass, 0 fail,
0 not confirmed

AI-assisted visualisation — indicative. Rendered with the author’s Replicate account for this sample; your own renders use the key you add in Connections.

ed visualisation – indicative

G-001 WHAT TO DO NEXT

[read this page and the cover](#)

Measure or confirm on site

Nothing: every value the checks read is measured or confirmed.

Failing checks

None.

A check passes only on measured or confirmed values; imported data gives a provisional result, estimates don't count.





V-102 Sidewalk view

Camera: 49.5 mm lens, 20 deg to the deck axis - Nano Banana Pro (2K) - rendered 2026-09-25
Rendered with the author's Replicate account for this sample; your own renders use the key you add in Connections.

AI-assisted visualisation — indicative

Sample - page 4/18



V-103 Corner view

Camera: 49.5 mm lens, 6 deg to the deck axis · Nano Banana Pro (2K) · rendered 2026-09-25
Rendered with the author's Replicate account for this sample; your own renders use the key you add in Connections.



V-104 Aerial view

Camera: isometric, as the axonometric · Nano Banana Pro (2K) · rendered 2026-09-25
Rendered with the author's Replicate account for this sample; your own renders use the key you add in Connections.

Curbside parklet drawing set

Sample parklet

Example street, Vancouver

Lat 49.28270, lon -123.12070 - street bearing 0.0 deg - parklet on the east side

Checks: 19 pass, 0 fail, 0 not confirmed

Preliminary: not for construction




Drawing list

Sheet	Title	Scale
V-000	Cover	NTS
G-001	What to do next	
V-101 to V-104	Renders: Street, Sidewalk, Corner, Aerial	NTS
A-000	Title sheet	NTS
A-101	Site plan	1:250
A-102	Layout plan	1:250
A-103	Deck plan	1:100
A-201	Street section	1:100
A-202	Parklet section	1:50
S-001	Furniture schedule	
G-002	Construction and budget	
C-001	Compliance	
S-002	Site survey	
X-001	Sources	

Revisions

Rev	Date	Description
A	2026-10-03	Preliminary issue for the Parklet Manual pre-application (generated by Curbside v0.17.2)

Legend

	Cut: deck, curb in section (0.70)
	Objects: deck edge, furniture (0.50)
	Edges: curbs, railing (0.35)
	General (0.25)
	Context, dimensions (0.18)
	Fine: hatching, grid (0.13)
	Clearance zone (red: the check fails)
	Required distance, nothing measured: "req."
	Section line A-A, centre line
	Match line, property line
	Hidden, overhead, lane line
	Fire hydrant
	Utility pole
	Signal controller box
	Access chamber / manhole
	Street tree canopy (genus tag)
	Bus stop
	Grid line at a railing post
	Level (datum: top of curb)
	Key: its note in the sheet's notes
	Rule of a clearance zone
	Clearance: measured · rule · check (red: fails)
	Concrete
	Timber deck, along the boards
	Planting
	Earth, subgrade
	Cut building
	Cut steel, thin material
	Accessible route

Abbreviations

CO1 – C19	Parklet Manual checks
CoV	City of Vancouver (open data)
DBH	diameter at breast height
EDM	Engineering Design Manual
max / min	maximum / minimum
NTS	not to scale
OSM	OpenStreetMap
typ.	typical
z	distance along the street from the deck start (m)

Notes

- Dimensions in metres unless noted; drawings at the scale stated on a 17 x 11 in sheet.
- Generated from the design model; imported site data is indicative and must be verified on site.
- Sources, the renders' credits and the model's assumptions: sheet X-001.

A-000 Title sheet


Notes

- 1


Parklet, 19.80 m: layout A-102, deck A-103.
- 2

Section A-A: the street on A-201, the parklet on A-202.
- No street trees in this stretch.
- 3

Buildings from OpenStreetMap, cut at the sheet's extent (78.50 x 55.00 m); name and use where known.
- Site objects from City of Vancouver open data: indicative, confirm on site.

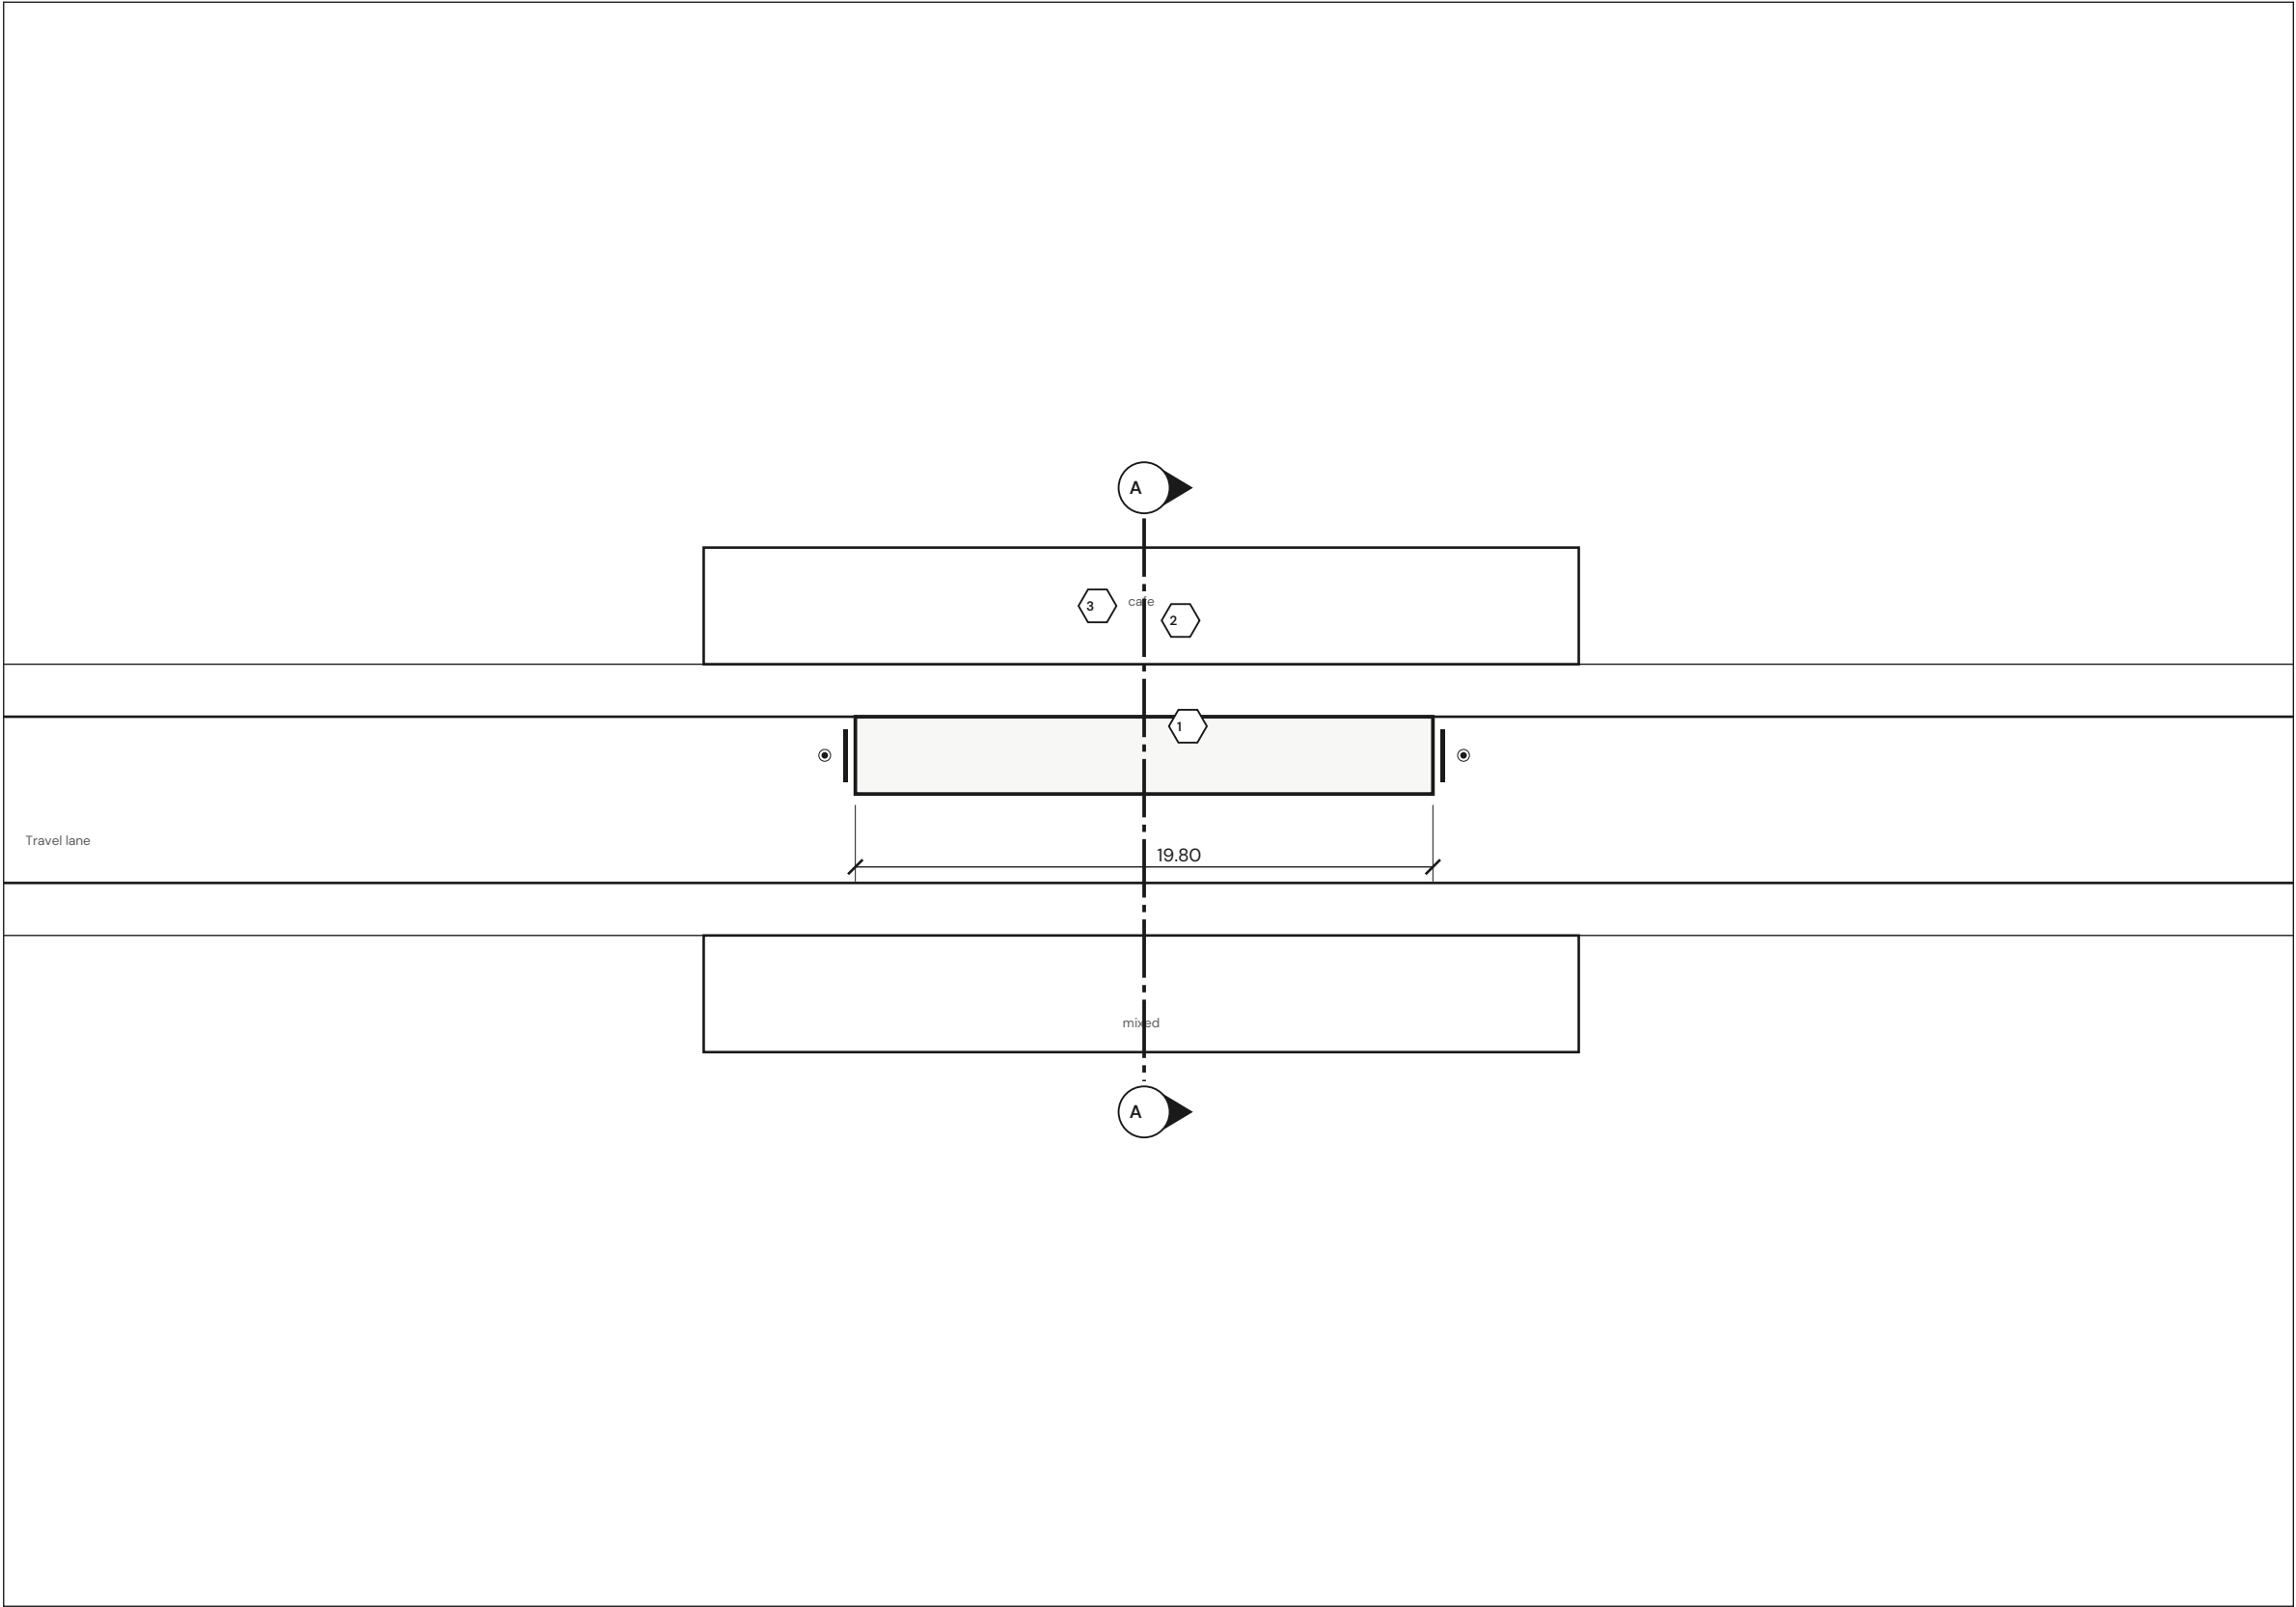

A-101 Site plan

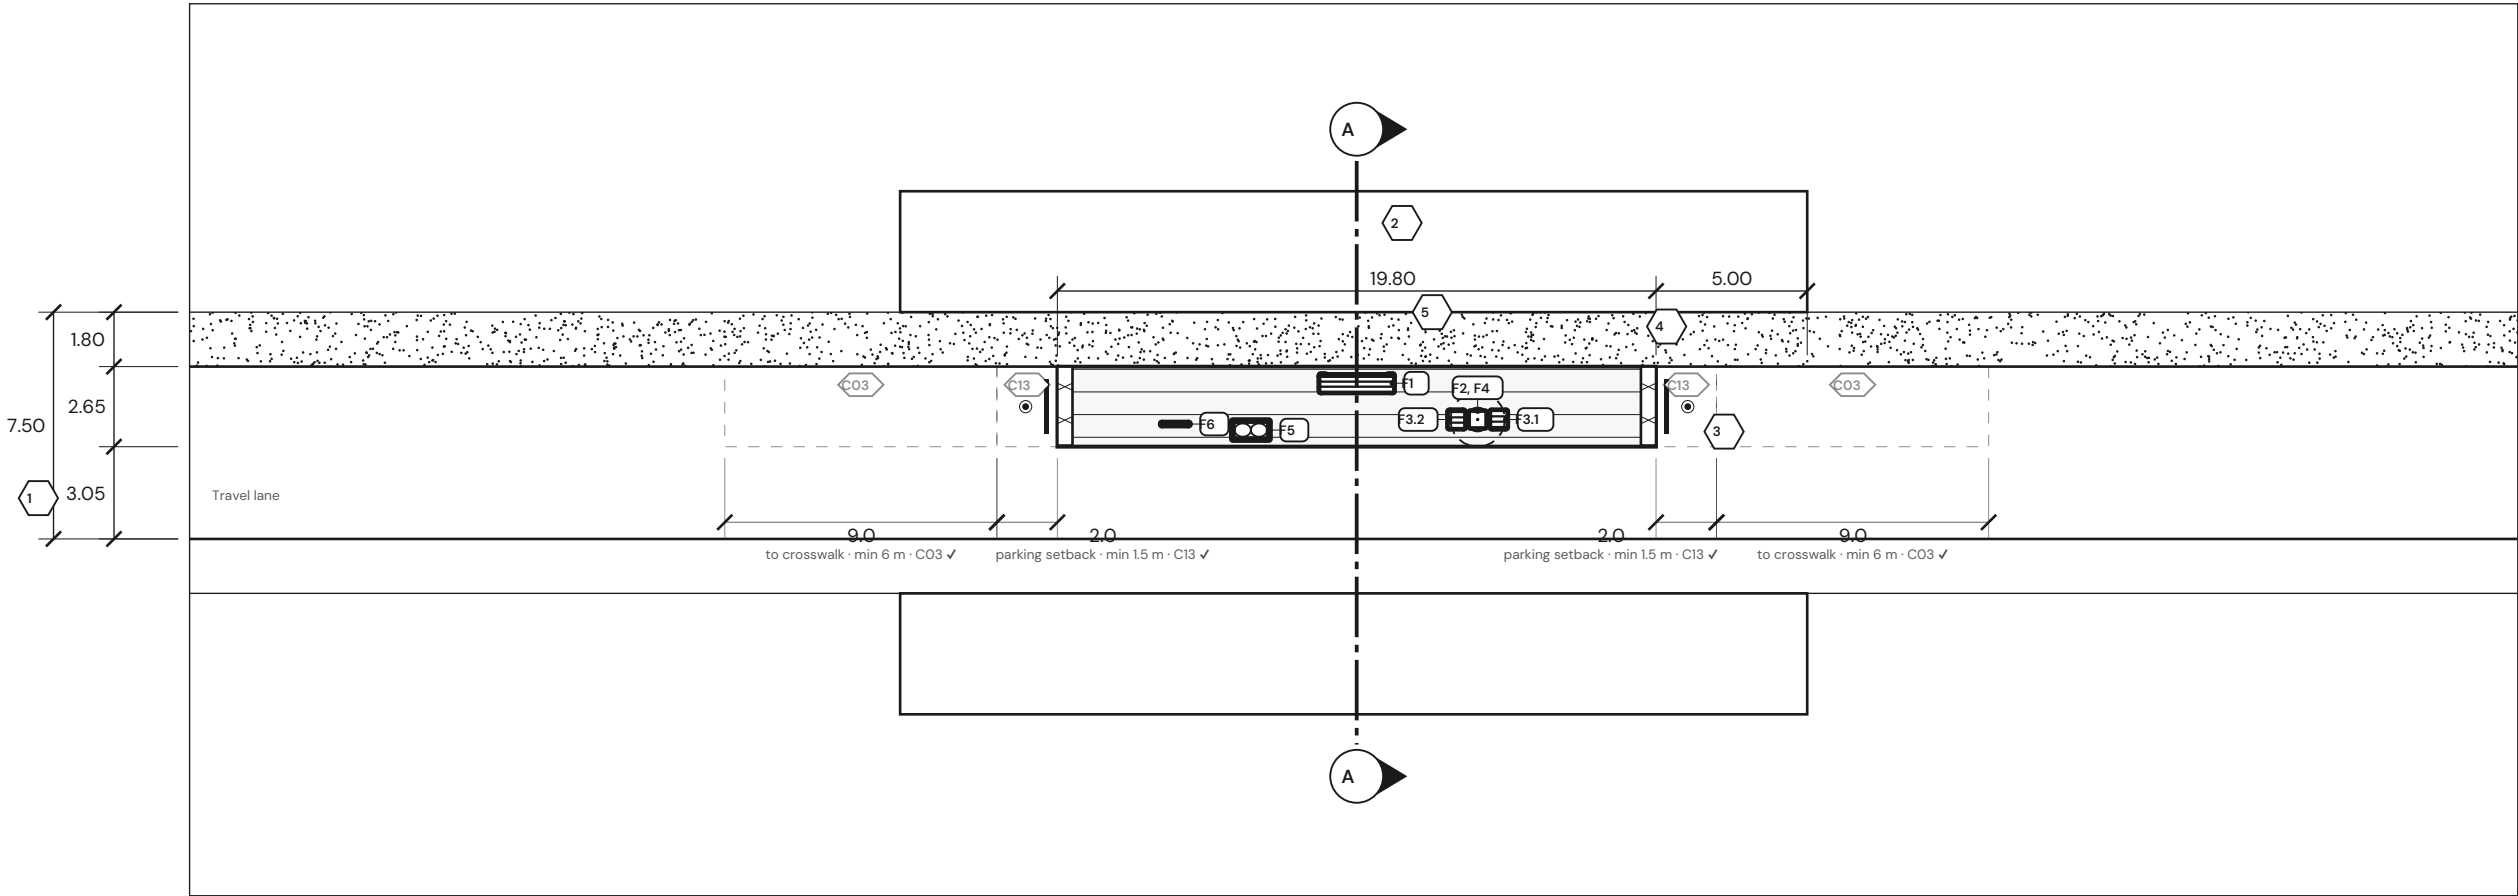

Notes


- 1 Segments from the Section editor, chained with the overall, frontage to far curb.
- 2 The deck located from the host frontage (cafe).
- 3 Clearance zones dashed, with their rule (C03 crosswalk, C05 hydrant, C07 pole, C08 signal, C09 chamber, C13 parking). Each clearance: measured, then rule and check beneath; red: the check fails.
- Furniture tags: schedule S-001.
- 4 Wheel stop and flexible bollard at each end, supplied and installed by the City; location to City (Parklet Manual p. 48, 59).
- 5 Section A-A: the street on A-201, the parklet on A-202; deck plan A-103.




A-102 Layout plan

Notes

- Grid lines 1, 2, 3 ... at the enclosure posts on the traffic side, 1.00 m apart, the first at 0.22 m.
- 1 Enclosure: steel picket in galvanized, 0.90 m high on the traffic side, at the deck edge; planter wall at both ends: in section on A-202.
- 2 Accessible route (C16), hatched: 1.50 m clear from each entry to an accessible seat; dashed circles: 1.50 m turning space where it turns and ends.
- 3 Entry: 1.50 m turning square at the sidewalk edge (C16).
- 4 End enclosure: planter wall, 0.50 m deep, 0.90 m high.
- Furniture tags: schedule S-001.

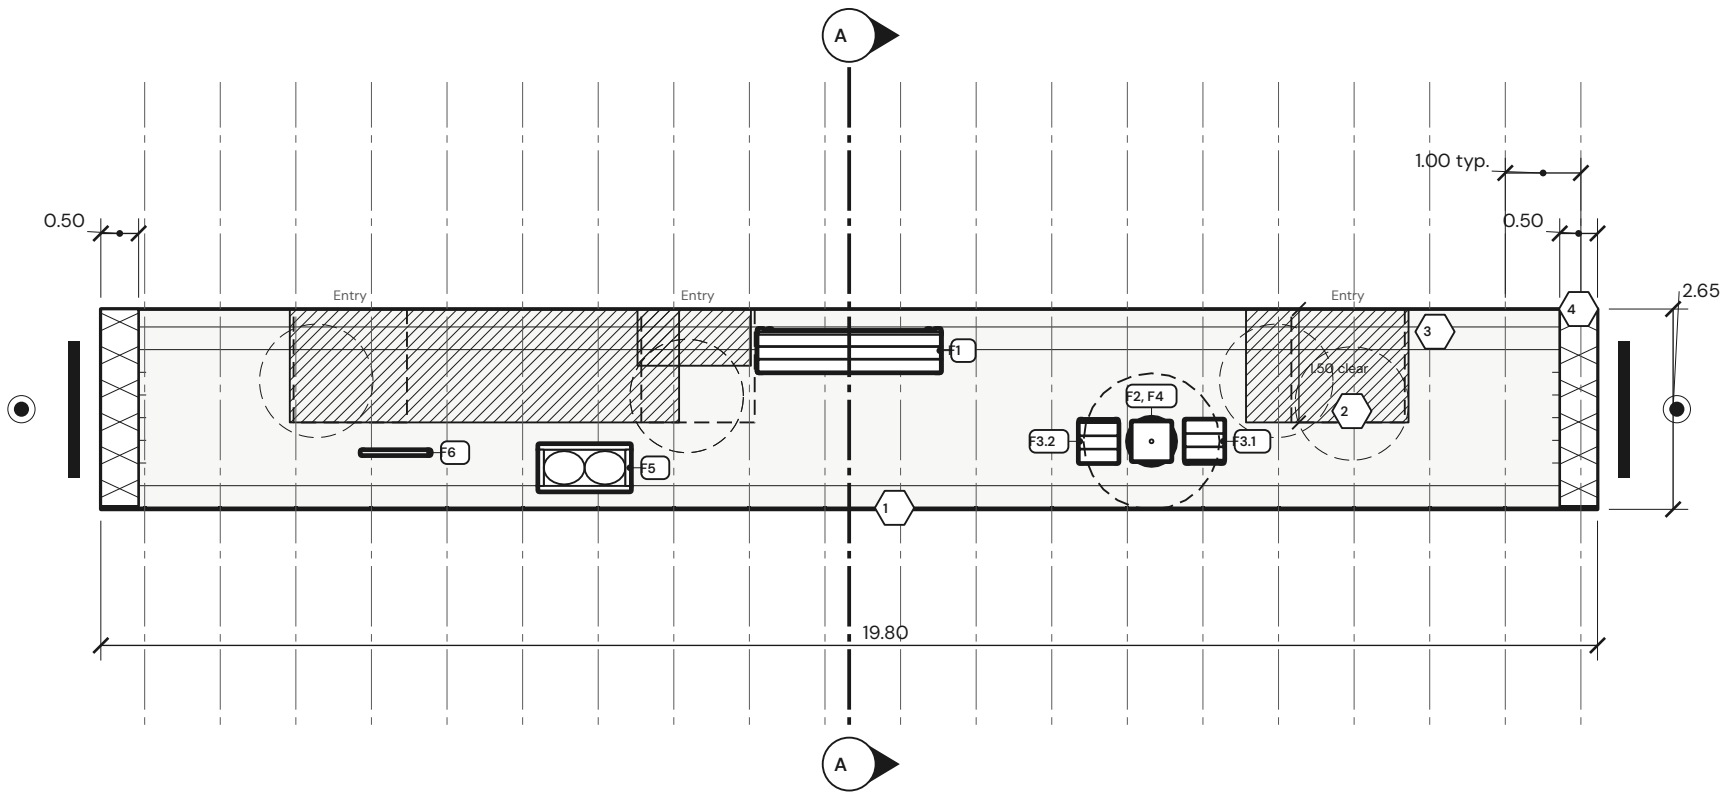

A-103 Deck plan

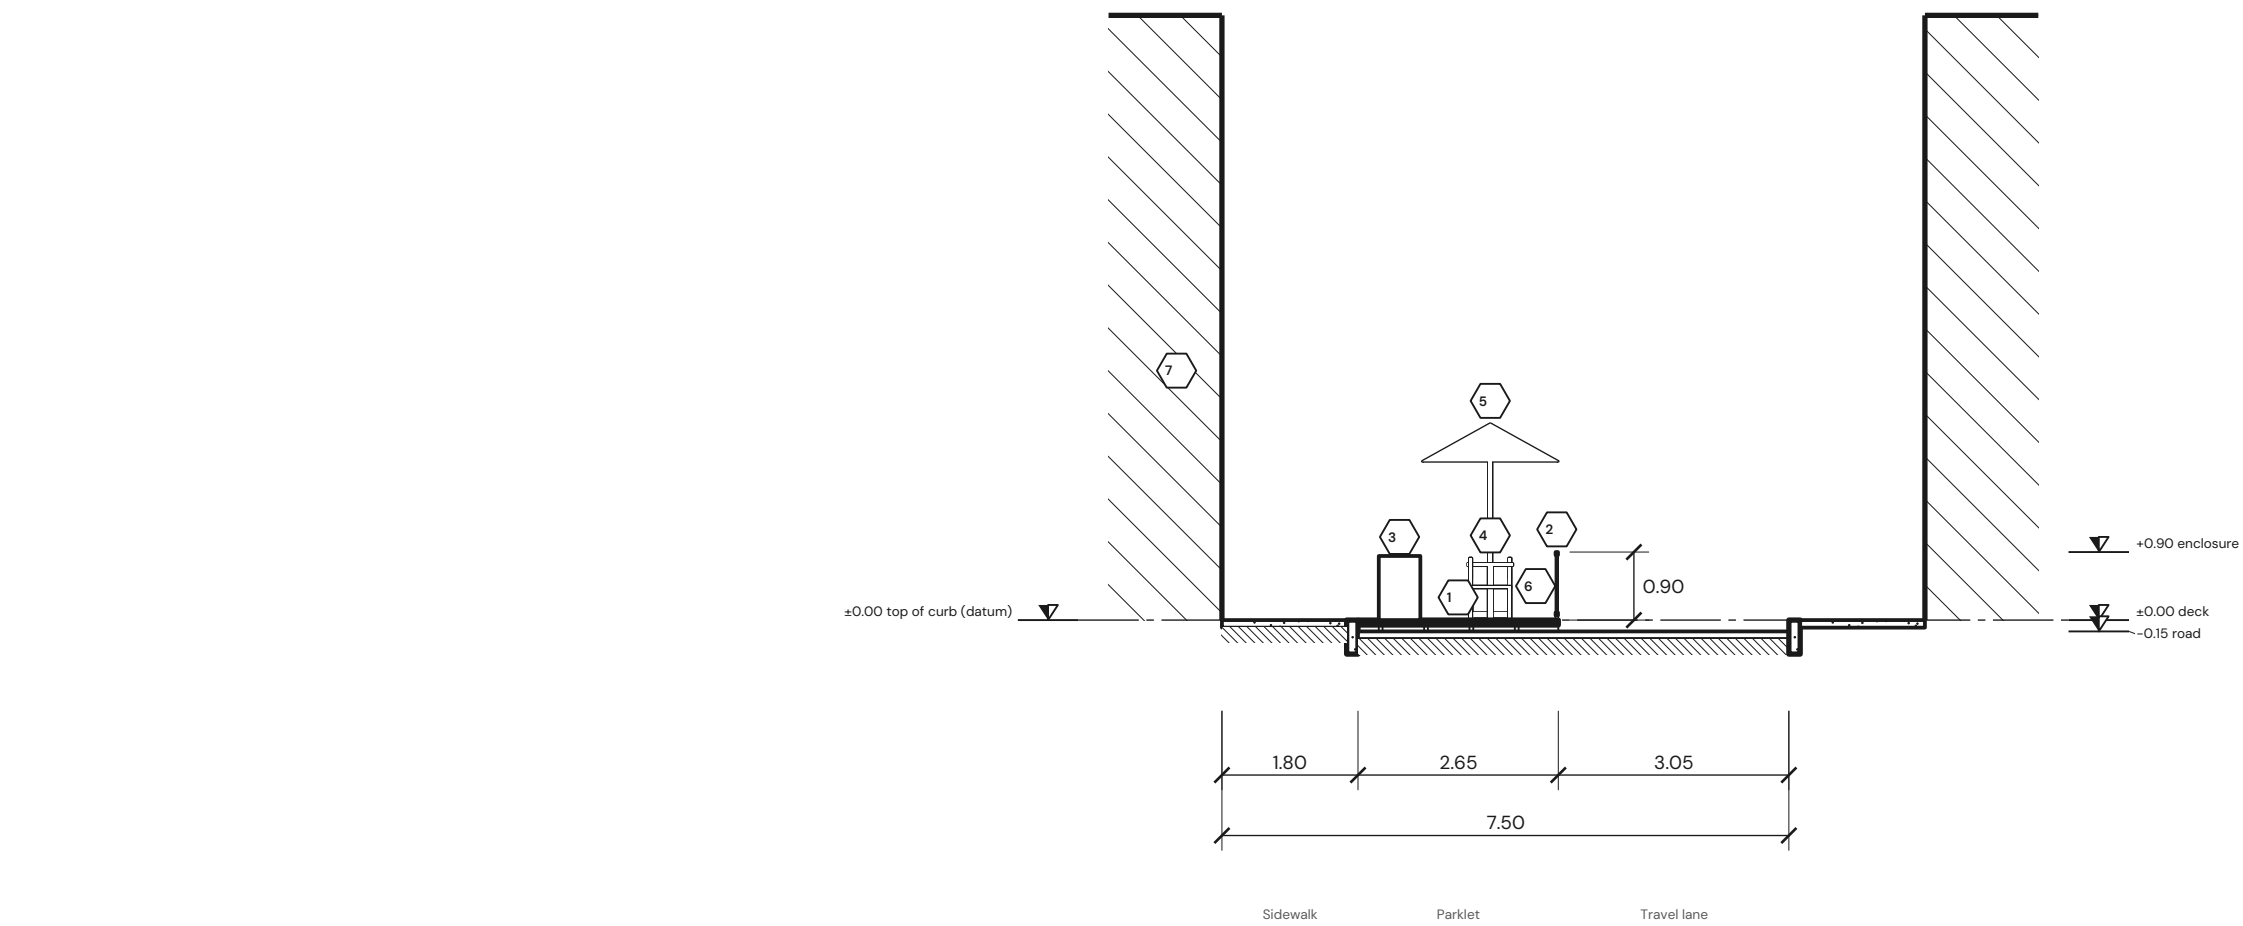

Notes

- Street section A–A at z 9.90 m, looking –z, 6.0 m beyond in elevation; the parklet in detail on A–202.

3

Bench, black stain, 2.40 x 0.55 x 0.80 m, cut.

6

Cafe table, terrazzo, 0.60 x 0.60 x 0.75 m.
- 1

Deck, timber boards 145 mm wide, 65 mm, on indicative supports; top +0.15 m above the road.
- 4

Chair, thermowood, 0.50 x 0.55 x 0.82 m.
- 7


Building at the cut: no address point.
- 2

Enclosure, steel picket, galvanized, 0.90 m above the deck.
- 5

Umbrella, aluminium, 1.80 x 1.80 x 2.60 m.
- Beyond the cut: outlines, the nearer in front. Trees: flat silhouettes by form, behind everything.



A–201 Street section

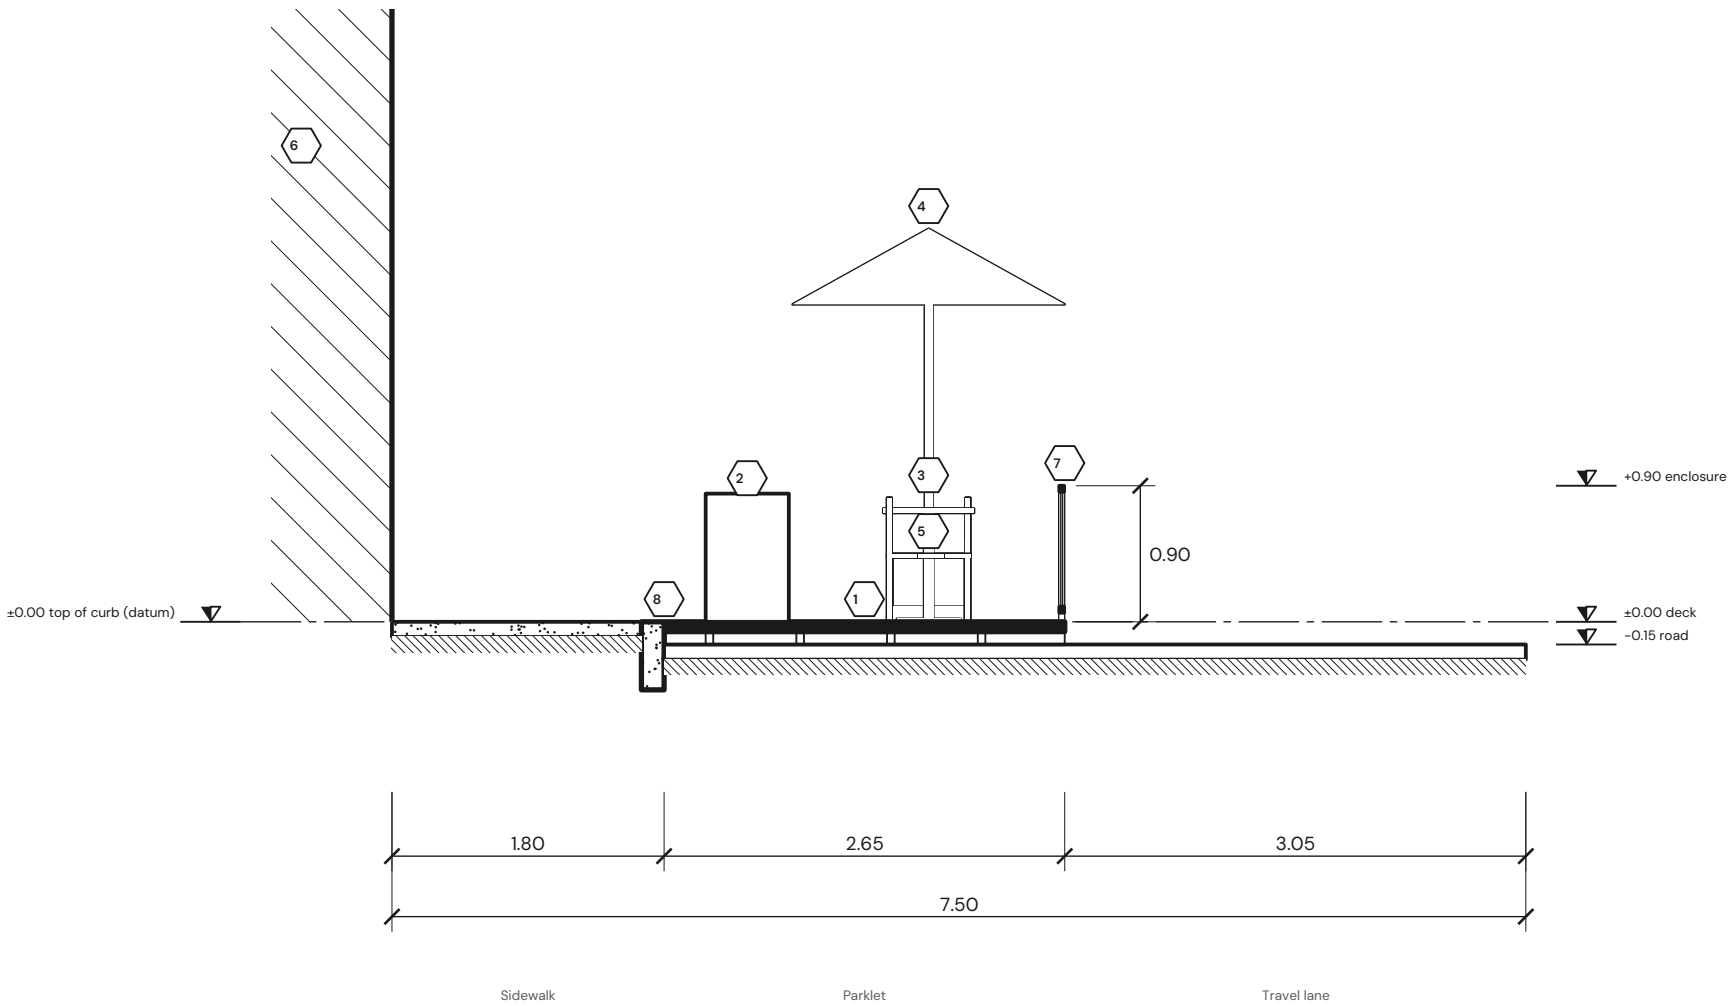

Notes

- Parklet section A-A at z 9.90 m, looking -z, 6.0 m beyond in elevation: the cut and the direction of the street section A-201.
- Beyond the cut: outlines, the nearer in front. Trees: flat silhouettes by form, behind everything.

- 3 Chair, thermowood, 0.50 x 0.55 x 0.82 m.
- 6 Building at the cut: no address point.

- 1 Deck, timber boards 145 mm wide, 65 mm, on indicative supports; top +0.15 m above the road.
- 4 Umbrella, aluminium, 1.80 x 1.80 x 2.60 m.
- 7 Enclosure: steel picket (bar 12 mm, bars at 100 mm, post 40 mm, posts at 1000 mm), 0.90 m above the deck, set 0.00 m in from the traffic-side edge (the buffer); C17.

- 2 Bench, black stain, 2.40 x 0.55 x 0.80 m, cut.
- 5 Cafe table, terrazzo, 0.60 x 0.60 x 0.75 m.
- 8 Deck edge at the sidewalk: gap 12 mm max; a larger gap takes a connector plate 13 mm max (C14, Parklet Manual p. 62).



A-202 Parklet section

S-001 FURNITURE SCHEDULE

Tag	Item	Size l x d x h	Material	Count	Source
F1	Bench 2.4 m, with back	2.40 x 0.55 x 0.80	frame: Black steel; seat: Black stain; back: Black stain	1	generic archetype
F2	Cafe table dia. 0.6 m	0.60 x 0.60 x 0.75	frame: Black steel; top: Terrazzo	1	generic archetype
F3	Chair 0.5 m	0.50 x 0.55 x 0.82	frame: Galvanized; seat: Thermowood	2	generic archetype
F4	Umbrella dia. 1.8 m	1.80 x 1.80 x 2.60	pole: Aluminium; canopy: Fabric, canvas; base: Precast grey	1	generic archetype
F5	Planter 1.2 m	1.20 x 0.60 x 0.60	body: Galvanized	1	generic archetype
F6	Bike rack 0.9 m	0.90 x 0.04 x 0.80	frame: Galvanized	1	generic archetype
Total		6 types		7	

Tags F1, F2 ... mark each piece on the deck plan A-103 and the layout plan A-102. Sizes in metres from each piece's parameters (the numbers the 3D and the plans draw).

Enclosure

Side	Archetype	Height	Run x depth	Materials	See-through
Traffic side	Steel picket	0.90 m	19.80 x 0.040	Galvanized	85 %
Start end	Planter wall	0.90 m	2.61 x 0.500	Corten, Foliage	30 %
Far end	Planter wall	0.90 m	2.61 x 0.500	Corten, Foliage	30 %

Buffer 0.00 m inside the deck's traffic-side edge (unusable: planting or void); usable width 2.61 m of 2.65 m. Heights above the deck; a planter's is the top of its planting (E2, Parklet Manual p. 64). In section on A-202. Buffer 0.00 m: a buffer of at least 0.30 m is recommended from a busy travel lane (Parklet Manual E2, advisory).

Parklet materials

Part	Material	Set by
Deck surface	Light timber (default deck)	default
Deck edge (fascia)	Dark timber (default fascia)	default
Enclosure posts and rails	each enclosure archetype's own	default
Enclosure infill (pickets, slats, cables)	each enclosure archetype's own	default
Planter boxes	each enclosure archetype's own	default
Screens	each enclosure archetype's own	default

G-002 CONSTRUCTION AND BUDGET

City of Vancouver – Parklet Manual 2016, CAD

Estimate from the Parklet Manual's 2016 figures – confirm with the City · Furniture not priced (7 pieces). Rate set: City of Vancouver – Parklet Manual 2016, CAD. Vancouver Parklet Manual, version 1.0 (June 2016): the cost range p. 18, the fees pp. 37 and 40. Figures of 2016: confirm with the City.

Quantities (from the design)

Item	Qty	Unit	How
Deck area	52.47	m²	the applied outline's area (DESIGN_MODEL.parklet.area)
Deck perimeter	44.9	m	the sum of the outline's 4 edges
Joists / sleepers (run)	132.5	m	50 joists across the deck every 0.40 m along 19.80 m, each as long as the deck is wide there
Decking (with waste)	57.72	m²	52.47 m² x (1 + 10 % waste)
Enclosure run (railing types)	19.8	m	the runs of the rail and bench types above
Enclosure posts	20	ea	the posts the 3D view draws, every run
Planters	3	ea	Planter wall (Start end); Planter wall (Far end); Planter 1.2 m
Planter soil	0.84	m³	each planter's inside, length x depth x (height – 0.10 m)
Screens	0	m	the runs of the wall type
Parking spaces taken	4	ea	19.80 m / 6.0 m a space, rounded up (6.0 m is our estimate; the Manual gives none)

Estimate

Item	Qty	Unit	Cost, CAD	Source
Design, construction and installation	4	parking space	\$40,000 – \$60,000	Manual p. 18 (2016): "typically" per parking space, by design, size and material
Application review fee	1	once	\$204	Manual p. 37 (2016)
Program cost recovery fee	1	once	\$1,000	Manual p. 40 (2016)
Site inspection, before and after	1	once	\$200	Manual p. 40 (2016)
Parking meter removal	0	meter	\$0	Manual p. 40 (2016), if applicable
Annual renewal fee (each year after)	1	year	\$500 a year	Manual pp. 19, 40 (2016); yearly, not in the build total
Bench 2.4 m, with back (2.40 x 0.55 x 0.80 m)	1	each	– (not priced)	not priced
Cafe table dia. 0.6 m (0.60 x 0.60 x 0.75 m)	1	each	– (not priced)	not priced
Chair 0.5 m (0.50 x 0.55 x 0.82 m)	2	each	– (not priced)	not priced
Umbrella dia. 1.8 m (1.80 x 1.80 x 2.60 m)	1	each	– (not priced)	not priced
Planter 1.2 m (1.20 x 0.60 x 0.60 m)	1	each	– (not priced)	not priced
Bike rack 0.9 m (0.90 x 0.04 x 0.80 m)	1	each	– (not priced)	not priced
Estimate, build and fees			\$41,404 – \$61,404	7 furniture piece(s) not priced, not counted

City of Vancouver fees: enter from the current fee schedule (<https://vancouver.ca/streets-transportation/parklets.aspx>). Wheel stops, bollards, no-stopping signs and the parklet sign are supplied by the City (Manual p. 48). An estimate to plan a budget, not a quote.

C-001 COMPLIANCE

19 pass · 0 fail · 0 not confirmed

Checks, failures first

Rule	Manual reference	Requirement	Measured value	Result
C01	Parklet Manual p. 20	All-day parking permitted (no rush-hour, bus, taxi, or loading zone)	No restrictions — all-day parking confirmed.	PASS
C02	Parklet Manual p. 20; EDM Table 8-10	Adjacent travel lane ≥ 3.0 m (3.2 m for bus/truck routes)	1 lane × 3.050 m ≥ 3.0 m.	PASS
C03	Parklet Manual p. 20	Minimum 6 m setback from nearest intersection / crosswalk edge	9 m ≥ 6 m minimum. Passes.	PASS
C04	Parklet Manual p. 20	Street running slope ≤ 5%	2% ≤ 5%. Passes.	PASS
C05	Parklet Manual p. 21	Minimum 5 m clearance on either side of any fire hydrant	12 m ≥ 5 m minimum. Passes.; value entered, not drawn	PASS
C06	Parklet Manual p. 62	Minimum 1.5 m setback from adjacent driveways or lanes	8 m ≥ 1.5 m minimum. Passes.; value entered, not drawn	PASS
C07	Parklet Manual p. 21	Minimum 1 m clearance from poles (2.4 m if trolley wires attached)	4 m ≥ 1.0 m (standard pole). Passes.; value entered, not drawn	PASS
C08	Parklet Manual p. 21	Minimum 2 m clearance from traffic signal controller boxes / electrical kiosks	14 m ≥ 2 m minimum. Passes.; value entered, not drawn	PASS
C09	Parklet Manual p. 21	Minimum 1 m clearance from manhole lids, valves, grates, access chambers	5 m ≥ 1 m minimum. Passes.; value entered, not drawn	PASS
C10	Parklet Manual p. 21	Does not block Fire Dept. connections, utility connections, or fire exits	No blockages confirmed. Passes.; value entered, not drawn	PASS
C11	Parklet Manual p. 21	Curb and roadside drainage maintained — street drains not blocked	Drainage confirmed clear and channel designed in. Passes.; value entered, not drawn	PASS
C12	Parklet Manual p. 20	Minimum pedestrian clearances on boulevard / utility strip maintained	Boulevard not used. Criterion not triggered. Passes.	PASS
C13	Parklet Manual p. 62	Minimum 1.5 m setback from adjacent parking spaces	2 m ≥ 1.5 m minimum. Passes.	PASS
C14	Parklet Manual p. 62	Deck flush with the sidewalk (gap at most 12 mm; connector at most 13 mm)	Deck flush with the curb, 12 mm gap (12 mm max). Passes.	PASS
C15	Parklet Manual p. 62	Deck load capacity ≥ 7.2 kPa	7.5 kPa ≥ 7.2 kPa minimum. Passes.	PASS
C16	Parklet Manual p. 60	Accessible route 1.5 m clear from an entry, 1.5 m turning space	3 routes 1.50 m clear or more from the entries to the cafe table, the bench end; 1.50 m turning space at each entry, turn and end. Passes.	PASS
C17	Parklet Manual p. 64	Enclosure 0.75–1.0 m high on the traffic side and both ends	traffic side 0.90 m (steel picket), ends 0.90 / 0.90 m: within 0.75–1.0 m. Passes.	PASS
C18	Parklet Manual p. 65	At least two unobstructed openings of 1.8 m or more to the sidewalk	7 openings of 1.8 m or more to the sidewalk (clear runs 4.45, 0.15, 0.15, 1.85, 8.20 m). Passes.	PASS
C19	Parklet Manual p. 65	Overhead elements at least 2.1 m clear above the deck and within the footprint	umbrella 2.10 m clear: at least 2.1 m and within the footprint. Passes.	PASS

Advisory (no numbered check)

Advisory	Detail
Deck 2.65 m wide – Parklet Manual: typically 2.3–2.5 m; wider to be confirmed by the City	Parklet Manual p. 20 and P2, p. 62: the adjacent lane rule leads to a deck of 2.3–2.5 m; the City confirms the maximum width.

Lane envelope, EDM Table 8-10: travel lane widths (m); this design's route in bold

Route	Lane role	Absolute min.	Preferred	Max.
Standard	rightmost	2.80	3.00	3.40
Standard	other	2.70	3.00	3.20
Standard	single	2.90	3.00	3.50
Bus / truck	rightmost	3.00	3.20	3.50
Bus / truck	other	3.00	3.20	3.20
Bus / truck	single	3.50	3.50	3.60

Route of this design: standard. Rightmost = the lane next to the parklet (or its bike lane / buffer); single = a lone travel lane. Below preferred needs City Engineer approval (note 4); above maximum is an exception only (note 8), never beyond 4.8 m.

C-001 Compliance

C-001 COMPLIANCE (CONT.)

19 pass · 0 fail · 0 not confirmed

Beside the parklet (from the Section): the travel lane. Bike lane: none. The rightmost travel lane (3.05 m) is the first beyond the parklet.

Street changes: existing (as imported) against proposed (the Section)

No imported street is recorded: import the street context to compare the Section with it.

This design (m)

Lane	Direction	Role	Width	Abs. min.	Preferred	Max.	Band	C02 min.	C02
1	one-way	single	3.05	2.90	3.00	3.50	within preferred – maximum	3.00	PASS

C02 (Parklet Manual p. 20): the adjacent travel lane stays at least 3.0 m (3.2 m on bus / truck routes). Widths are the Section's travel-lane segments.

S-002 SITE SURVEY

values to confirm on site

Confirm on site

Measure each item on site and write the value in the last column; enter them in Curbside with the survey template (Site > Survey), or import a survey point file.

Item	Value now	Source	Measured
Sidewalk width, frontage to curb face	1.80 m	estimate	
Curb-to-curb width	5.70 m	estimate	
parklet width	2.65 m	model	
travel lane width	3.05 m	model	
Street slope along the curb (C04)	2 %	entered	
Nearest hydrant to the deck (C05)	12 m	entered	
Nearest driveway to the deck (C06)	8 m	entered	
Nearest pole to the deck (C07)	4 m	entered	
Nearest signal box to the deck (C08)	14 m	entered	
Nearest manhole / valve to the deck (C09)	5 m	entered	
Nearest intersection / crosswalk (C03)	9 m	entered	

X-001

SOURCES

Standards and data	
Source	Used for
City of Vancouver, Parklet Manual, Version 1.0 (June 2016)	criteria C01 – C15 and their pages
Parklet Manual E2, p. 64	C17: the enclosure 0.75 – 1.0 m high on the traffic side and both ends; the 0.30 m buffer advised from a busy travel lane (advisory)
Parklet Manual E3, p. 65	C18: at least two unobstructed openings of 1.8 m or more to the sidewalk
Parklet Manual E5, p. 65	C19: overhead elements at least 2.1 m clear above the deck and within the footprint
Parklet Manual E4, p. 64; G13	a solid edge flagged for the City to confirm (advisory)
City of Vancouver, Engineering Design Manual (2026)	Table 8–10 travel lane widths (8.7.3.1, pp. 275–277); bike lane and buffer widths (8.5.4.5)
City of Vancouver Standard Detail Drawings	W4.1 fire hydrant clearance; WW1 manhole; E5.19C utility pole; E1.3 signal controller base
City of Vancouver street standards placement guidance	street furniture offsets
Parklet Manual G19, p. 60	accessible route 1.5 m clear and a 1.5 m turning area (C16; the 1.1 m route of the BC Building Code, 3.8, noted and not used)
Rate set: City of Vancouver – Parklet Manual 2016, CAD	Vancouver Parklet Manual, version 1.0 (June 2016): the cost range p. 18, the fees pp. 37 and 40. Figures of 2016: confirm with the City. (G-002)
Visualisation 1: Street view	AI-assisted, indicative; Nano Banana Pro (2K), rendered 2026–09–25; 49.5 mm lens, 29 deg to the deck axis. Rendered with the author’s Replicate account for this sample; your own renders use the key you add in Connections.
Visualisation 2: Sidewalk view	AI-assisted, indicative; Nano Banana Pro (2K), rendered 2026–09–25; 49.5 mm lens, 20 deg to the deck axis. Rendered with the author’s Replicate account for this sample; your own renders use the key you add in Connections.
Visualisation 3: Corner view	AI-assisted, indicative; Nano Banana Pro (2K), rendered 2026–09–25; 49.5 mm lens, 6 deg to the deck axis. Rendered with the author’s Replicate account for this sample; your own renders use the key you add in Connections.
Visualisation 4: Aerial view	AI-assisted, indicative; Nano Banana Pro (2K), rendered 2026–09–25; isometric, as the axonometric. Rendered with the author’s Replicate account for this sample; your own renders use the key you add in Connections.
DM Sans (SIL Open Font License 1.1)	the report's typeface, embedded
jsPDF, svg2pdf.js (MIT)	the PDF engine (tools/vendor)

Entered inputs	
Input	Value
Parking restrictions at this location	No restrictions — all-day parking permitted
Is the adjacent lane a bus or truck route?	Standard traffic lane only
Distance to nearest crosswalk / intersecting sidewalk edge	9 m
Street running slope at this block	2 %
Distance to nearest fire hydrant (each side)	12 m
Distance to nearest driveway or lane	8 m
Distance to nearest pole	4 m
Trolley wires on this pole?	No trolley wires
Distance to nearest signal box / electrical kiosk	14 m

Entered inputs (cont.)	
Input	Value
Distance to nearest manhole / valve / grate	5 m
Does the parklet footprint block any FD / utility connection or fire exit?	No — confirmed clear
Are all street drains / catch basins clear of the footprint?	Yes — all drains clear; drainage channel designed in
Does the parklet use the boulevard strip, and if so, are pedestrian clearances maintained?	Boulevard not used — stays within parking lane only
Setback from adjacent parking space / meter (each end)	2 m
Designed load capacity	7.5 kPa

From the design model	
Value	Derived from
Travel lane widths	the Section editor’s travel-lane segments against EDM Table 8–10 (3.05 m)
Deck area	the rectangle footprint, 52.47 m2
Compliance	each check’s own result for the inputs above; an input not entered leaves its check not confirmed
Seats, route, entries	the generator’s metrics of the current layout (access model)
Enclosure, deck levels	DESIGN_MODEL.enclosure (steel picket in galvanized, 0.90 m high on the traffic side, at the deck edge; planter wall at both ends) and PARKLET_LEVELS, the numbers the 3D, the render and these drawings share

Assumptions	
Topic	Assumption
Furniture positions	the model's; not field-measured
Buildings	heights and depths are entered or imported estimates, for context only
Wheel stops and bollards	City-supplied; drawn nominally in the 1.5 m parking setback
C18 openings	a single clear run of w m along the sidewalk edge, between the end enclosures and 1.5 m deep, counts floor(w / 1.8) openings (Parklet Manual E3: at least two of 1.8 m)
End planters (design saved before the enclosure)	End planters raised to 0.90 m planter walls to meet Parklet Manual E2 (0.75–1.0 m)
Host building programme	not entered: the default (cafe, glazed frontage) is used for the renders, the prompts and the Generate bias
Library dimensions	those marked DI are interpreted, not source data
Drawings	schematic, for the pre-application: not construction drawings; no structural or construction feasibility is assessed