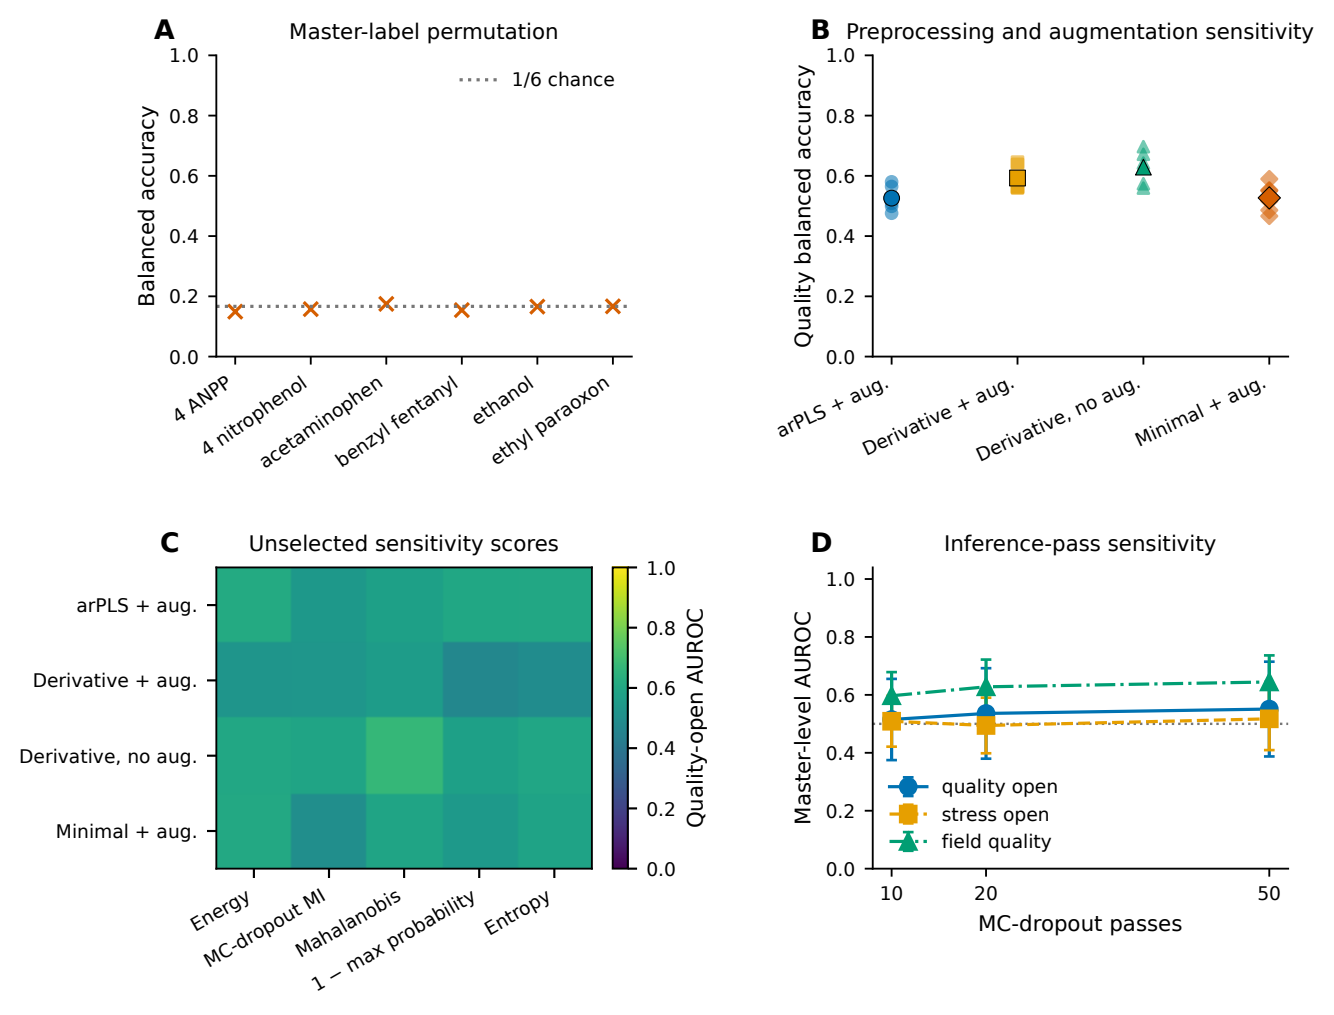
A
Master-label permutation
Balanced accuracy
1.0
0.8
0.6
0.4
0.2
0.0
1/6 chance
4 ANPP
4 nitrophenol
acetaminophen
benzyl fentanyl
ethanol
ethyl paraoxon
B
Preprocessing and augmentation sensitivity
Quality balanced accuracy
arPLS + aug.
Derivative + aug.
Derivative, no aug.
Minimal + aug.
C
Unselected sensitivity scores
arPLS + aug.
Derivative + aug.
Derivative, no aug.
Minimal + aug.
Energy
MC-dropout MI
Mahalanobis
1 − max probability
Entropy
Quality-open AUROC
D
Inference-pass sensitivity
Master-level AUROC
quality open
stress open
field quality
10
20
50
MC-dropout passes