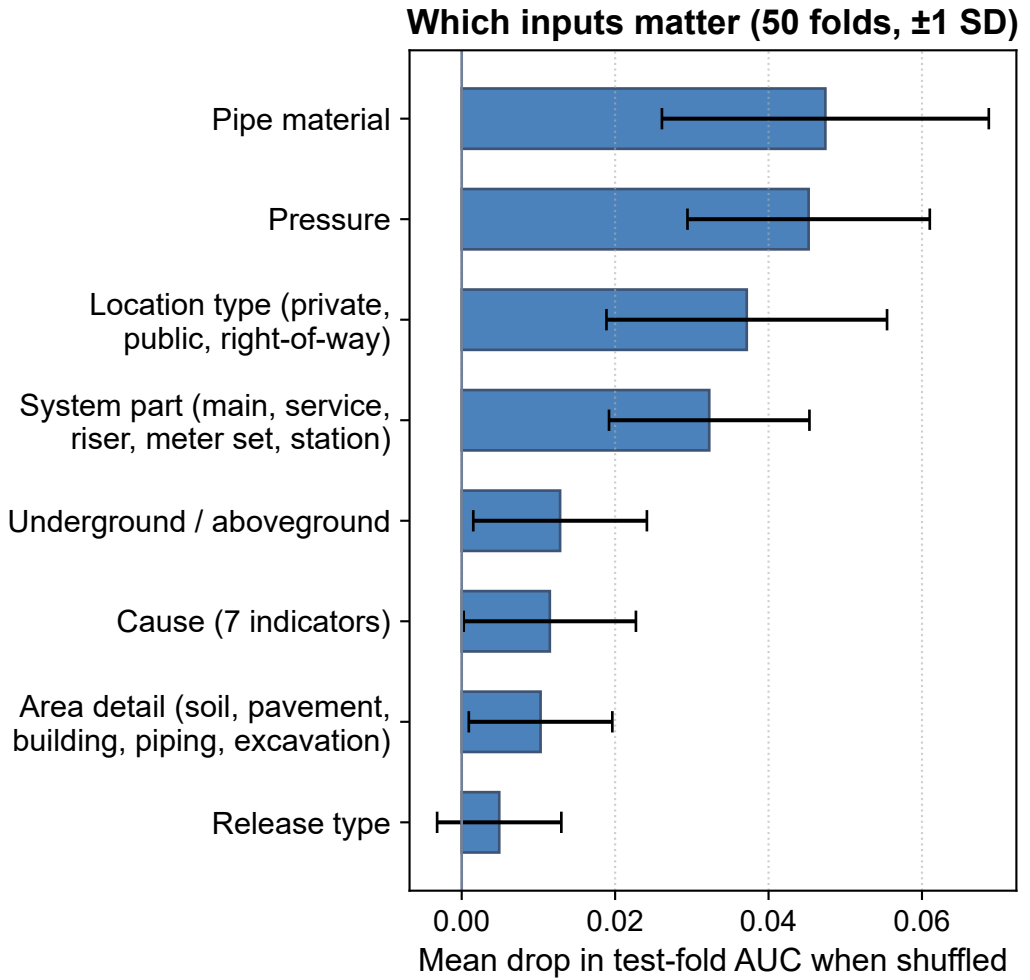
Which inputs matter (50 folds, ±1 SD)
Pipe material
Pressure
Location type (private, public, right-of-way)
System part (main, service, riser, meter set, station)
Underground / aboveground
Cause (7 indicators)
Area detail (soil, pavement, building, piping, excavation)
Release type
0.00
0.02
0.04
0.06
Mean drop in test-fold AUC when shuffled

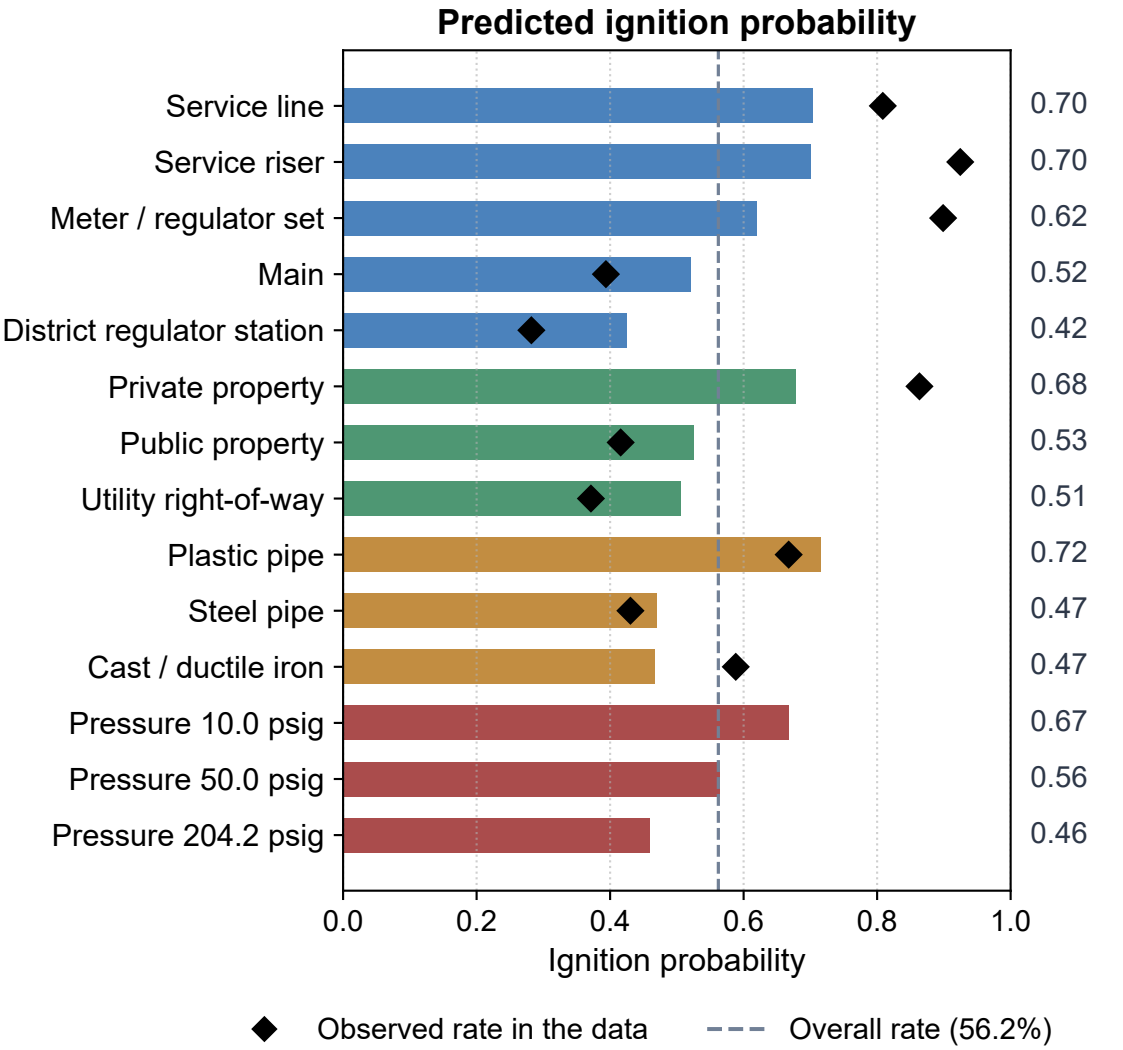
Predicted ignition probability
Service line
Service riser
Meter / regulator set
Main
District regulator station
Private property
Public property
Utility right-of-way
Plastic pipe
Steel pipe
Cast / ductile iron
Pressure 10.0 psig
Pressure 50.0 psig
Pressure 204.2 psig
0.70
0.70
0.62
0.52
0.42
0.68
0.53
0.51
0.72
0.47
0.47
0.67
0.56
0.46
0.0
0.2
0.4
0.6
0.8
1.0
Ignition probability
Observed rate in the data
Overall rate (56.2%)