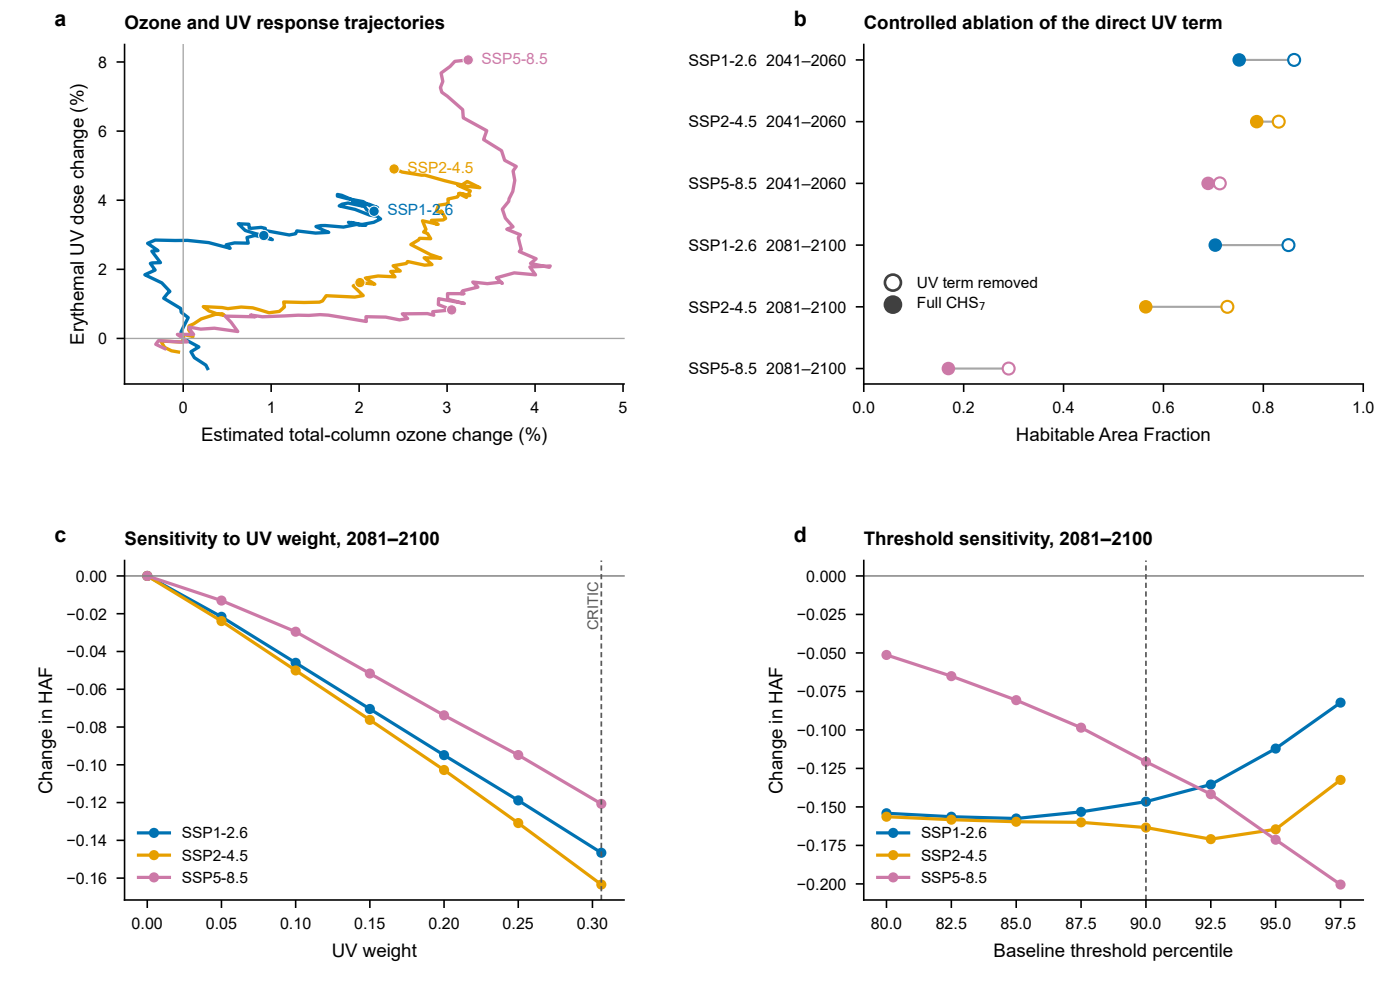

a
Ozone and UV response trajectories
SSP5-8.5
SSP2-4.5
SSP1-2.6
Erythemal UV dose change (%)
Estimated total-column ozone change (%)
b
Controlled ablation of the direct UV term
SSP1-2.6 2041–2060
SSP2-4.5 2041–2060
SSP5-8.5 2041–2060
SSP1-2.6 2081–2100
SSP2-4.5 2081–2100
SSP5-8.5 2081–2100
UV term removed
Full CHS7
Habitable Area Fraction
c
Sensitivity to UV weight, 2081–2100
CRITIC
Change in HAF
SSP1-2.6
SSP2-4.5
SSP5-8.5
UV weight
d
Threshold sensitivity, 2081–2100
Change in HAF
SSP1-2.6
SSP2-4.5
SSP5-8.5
Baseline threshold percentile