


BMA PROJ. NUMBER:		CTI:	SHT. SIZE:	REFER DWG:	CAD FILE NAME:	DRG. ENCL.	DATE:	ENCL.	APP. SP
T&E P&I LOCATION:		SRV OF SUPPLY:	MCC SCALE:	A3 NTS	PD11-28600-E-DRG-00122.dwg	WSP	27.02.24	JGB	
A	B	C	D	E	F	G	H	I	J
K	L	M	N	O	P	Q	R	S	T
U	V	W	X	Y	Z	AA	AB		

NOTES:

1. LOCAL SOIL RESISTANCE SHALL BE CONSIDERED WHEN DESIGNING EARTH GRID
2. NUMBER OF ELECTRODE SHALL BE AS REQUIRED BY EARTH GRID DESIGN.

3. MEN link required to be confirmed on existing site infrastructure. Correct at time of IFC if not currently installed.

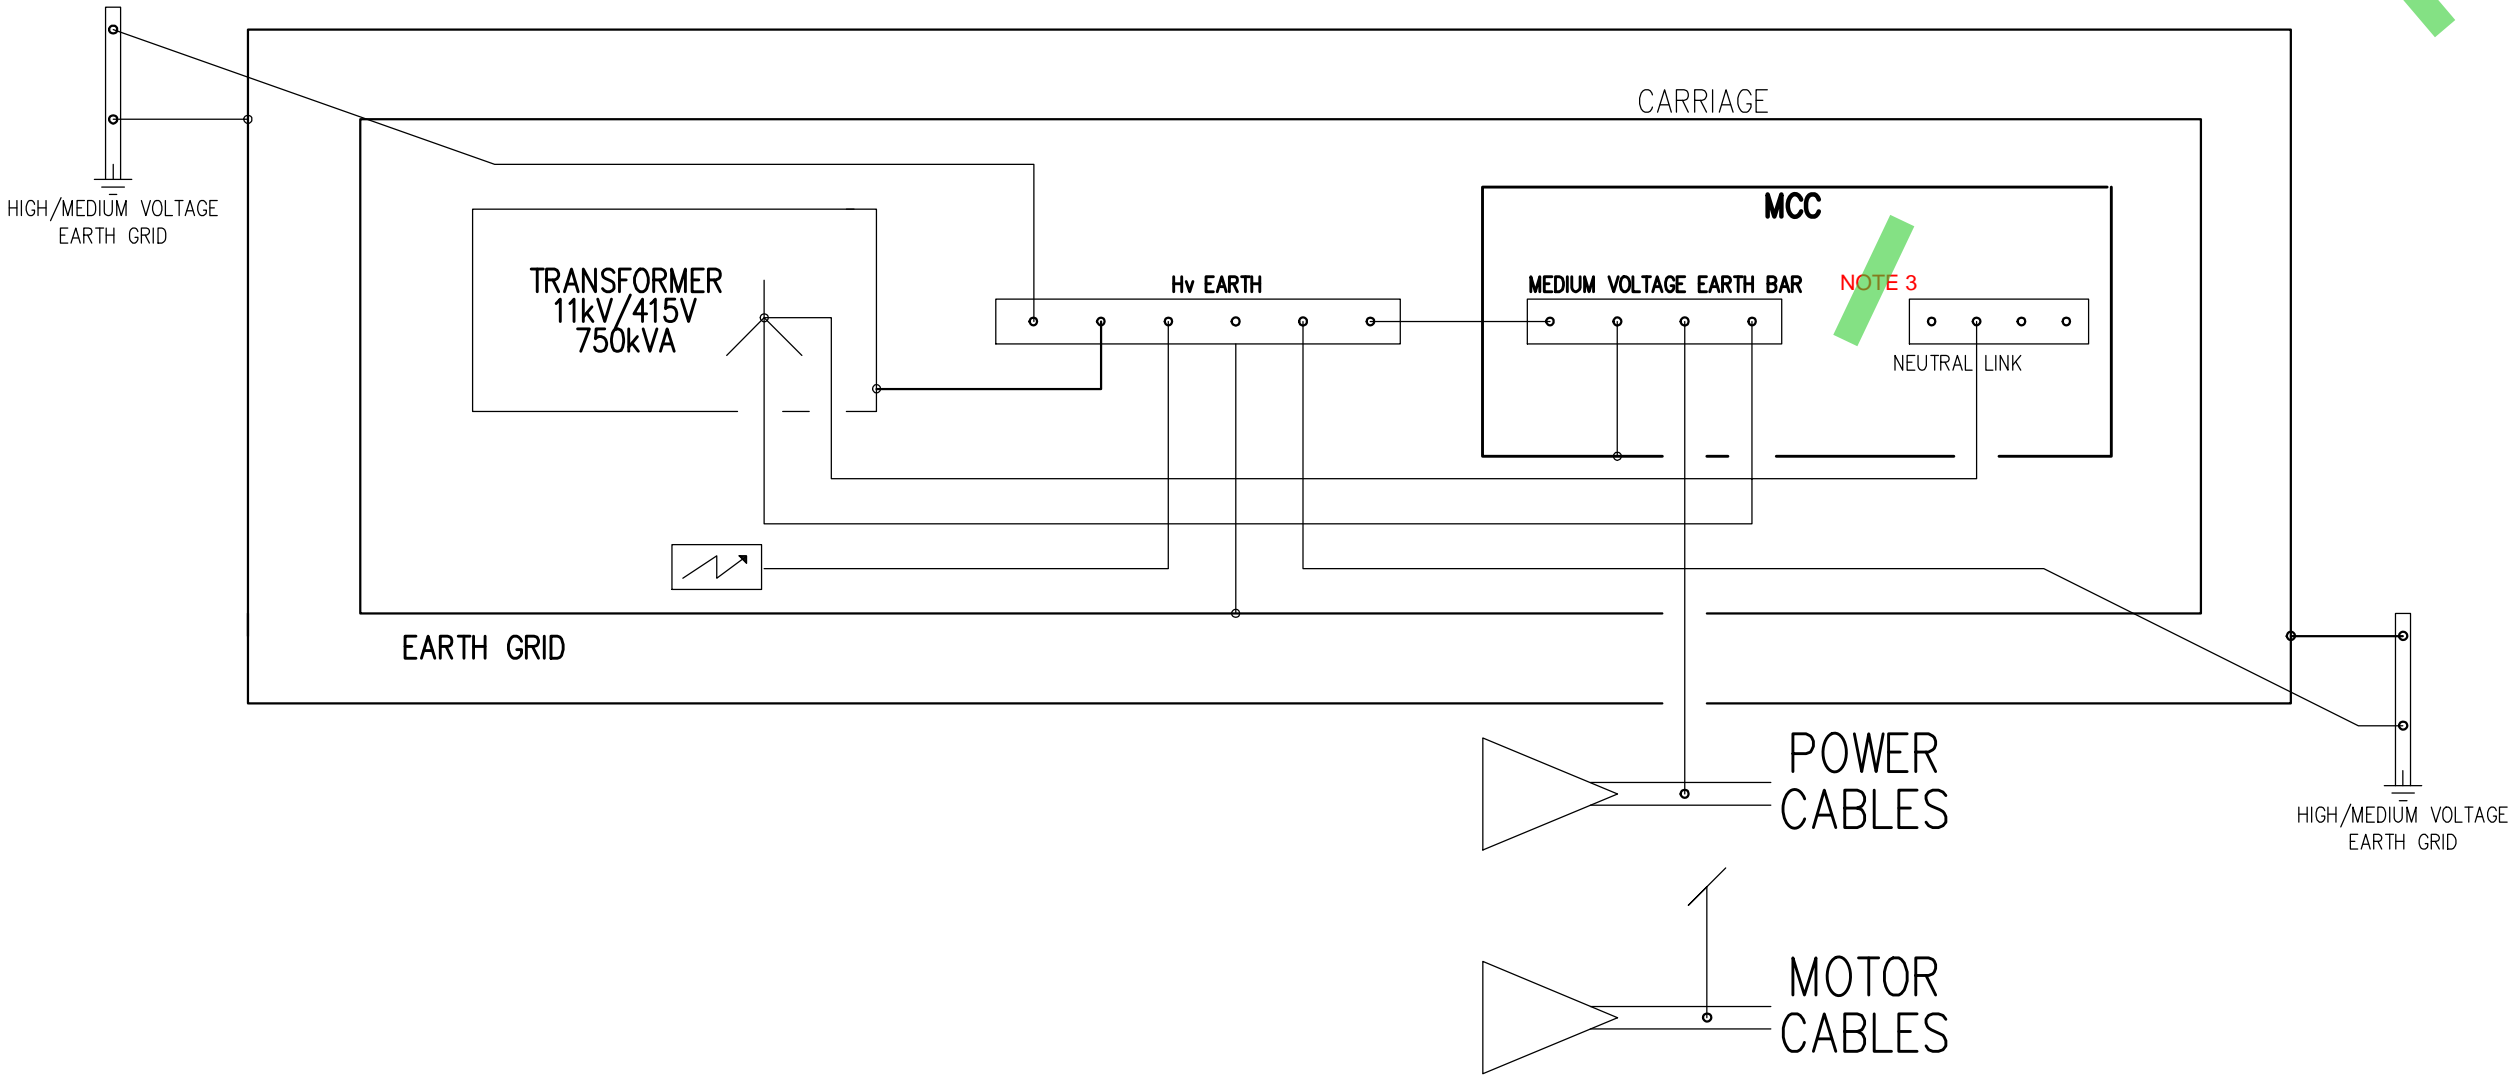

REVISION HISTORY

REV	DESC	DRN	APP	DATE
REV B	ISSUED FOR TENDER	AD	JB	10.02.24
REV A	ISSUED FOR APPROVAL	EC	JB	23.02.24



PEAK DOWNS MINE  
TAILINGS SYSTEM  
TAILINGS BOOSTER PUMP STATION  
MCC23 MAIN EARTHING

DRAWING STATUS	PRELIMINARY	SHT. 1 OF 1
BMA DRAWING NUMBER		
VENDOR DRG #	PD11-28600-E-DRG-00122	