


BMA PROJ. NUMBER:		CTI:	SHEET SIZE:		A3	REFER DWG:		CAD FILE NAME:	PD11-28600-E-DRG-00122.dwg	DRG. DWN. EC	DATE: 27.02.24	ENR. JGB	APP. SP
T&E P&C LOCATION	A	SRC OF SUPPLY:	MCC	SCALE:	NTS	J	K	DRAWING CONTRACTOR	WSP	ENR.	#:	DATE:	DATE:
B	B	C	D	E	F	G	H	I	J	K	L	M	N
C	D	E	F	G	H	I	J	K	L	M	N	O	P
D	E	F	G	H	I	J	K	L	M	N	O	P	Q
E	F	G	H	I	J	K	L	M	N	O	P	Q	R
F	G	H	I	J	K	L	M	N	O	P	Q	R	S
G	H	I	J	K	L	M	N	O	P	Q	R	S	T
H	I	J	K	L	M	N	O	P	Q	R	S	T	U
I	J	K	L	M	N	O	P	Q	R	S	T	U	V
J	K	L	M	N	O	P	Q	R	S	T	U	V	W
K	L	M	N	O	P	Q	R	S	T	U	V	W	X
L	M	N	O	P	Q	R	S	T	U	V	W	X	Y
M	N	O	P	Q	R	S	T	U	V	W	X	Y	Z
N	O	P	Q	R	S	T	U	V	W	X	Y	Z	AA
O	P	Q	R	S	T	U	V	W	X	Y	Z	AA	AB

- NOTES:**
1. LOCAL SOIL RESISTANCE SHALL BE CONSIDERED WHEN DESIGNING EARTH GRID
 2. NUMBER OF ELECTRODE SHALL BE AS REQUIRED BY EARTH GRID DESIGN.
 3. MEN LINK REQUIRED TO BE CONFIRMED ON EXISTING SITE INFRASTRUCTURE. CORRECT AT TIME OF IFC IF NOT CURRENTLY INSTALLED.



REVISION HISTORY				DRAWING STATUS		PRELIMINARY	SHEET 1 OF 1	
REV	DESC	DRAWN	APP	DATE	BMA DRAWING NUMBER		REVISION	
REV B	DESC ISSUED FOR TENDER	DRAWN AD	APP JB	DATE 10.05.24			B	
REV A	DESC ISSUED FOR APPROVAL	DRAWN EC	APP JB	DATE 23.02.24	VENDOR DRG #		PD11-28600-E-DRG-00122	

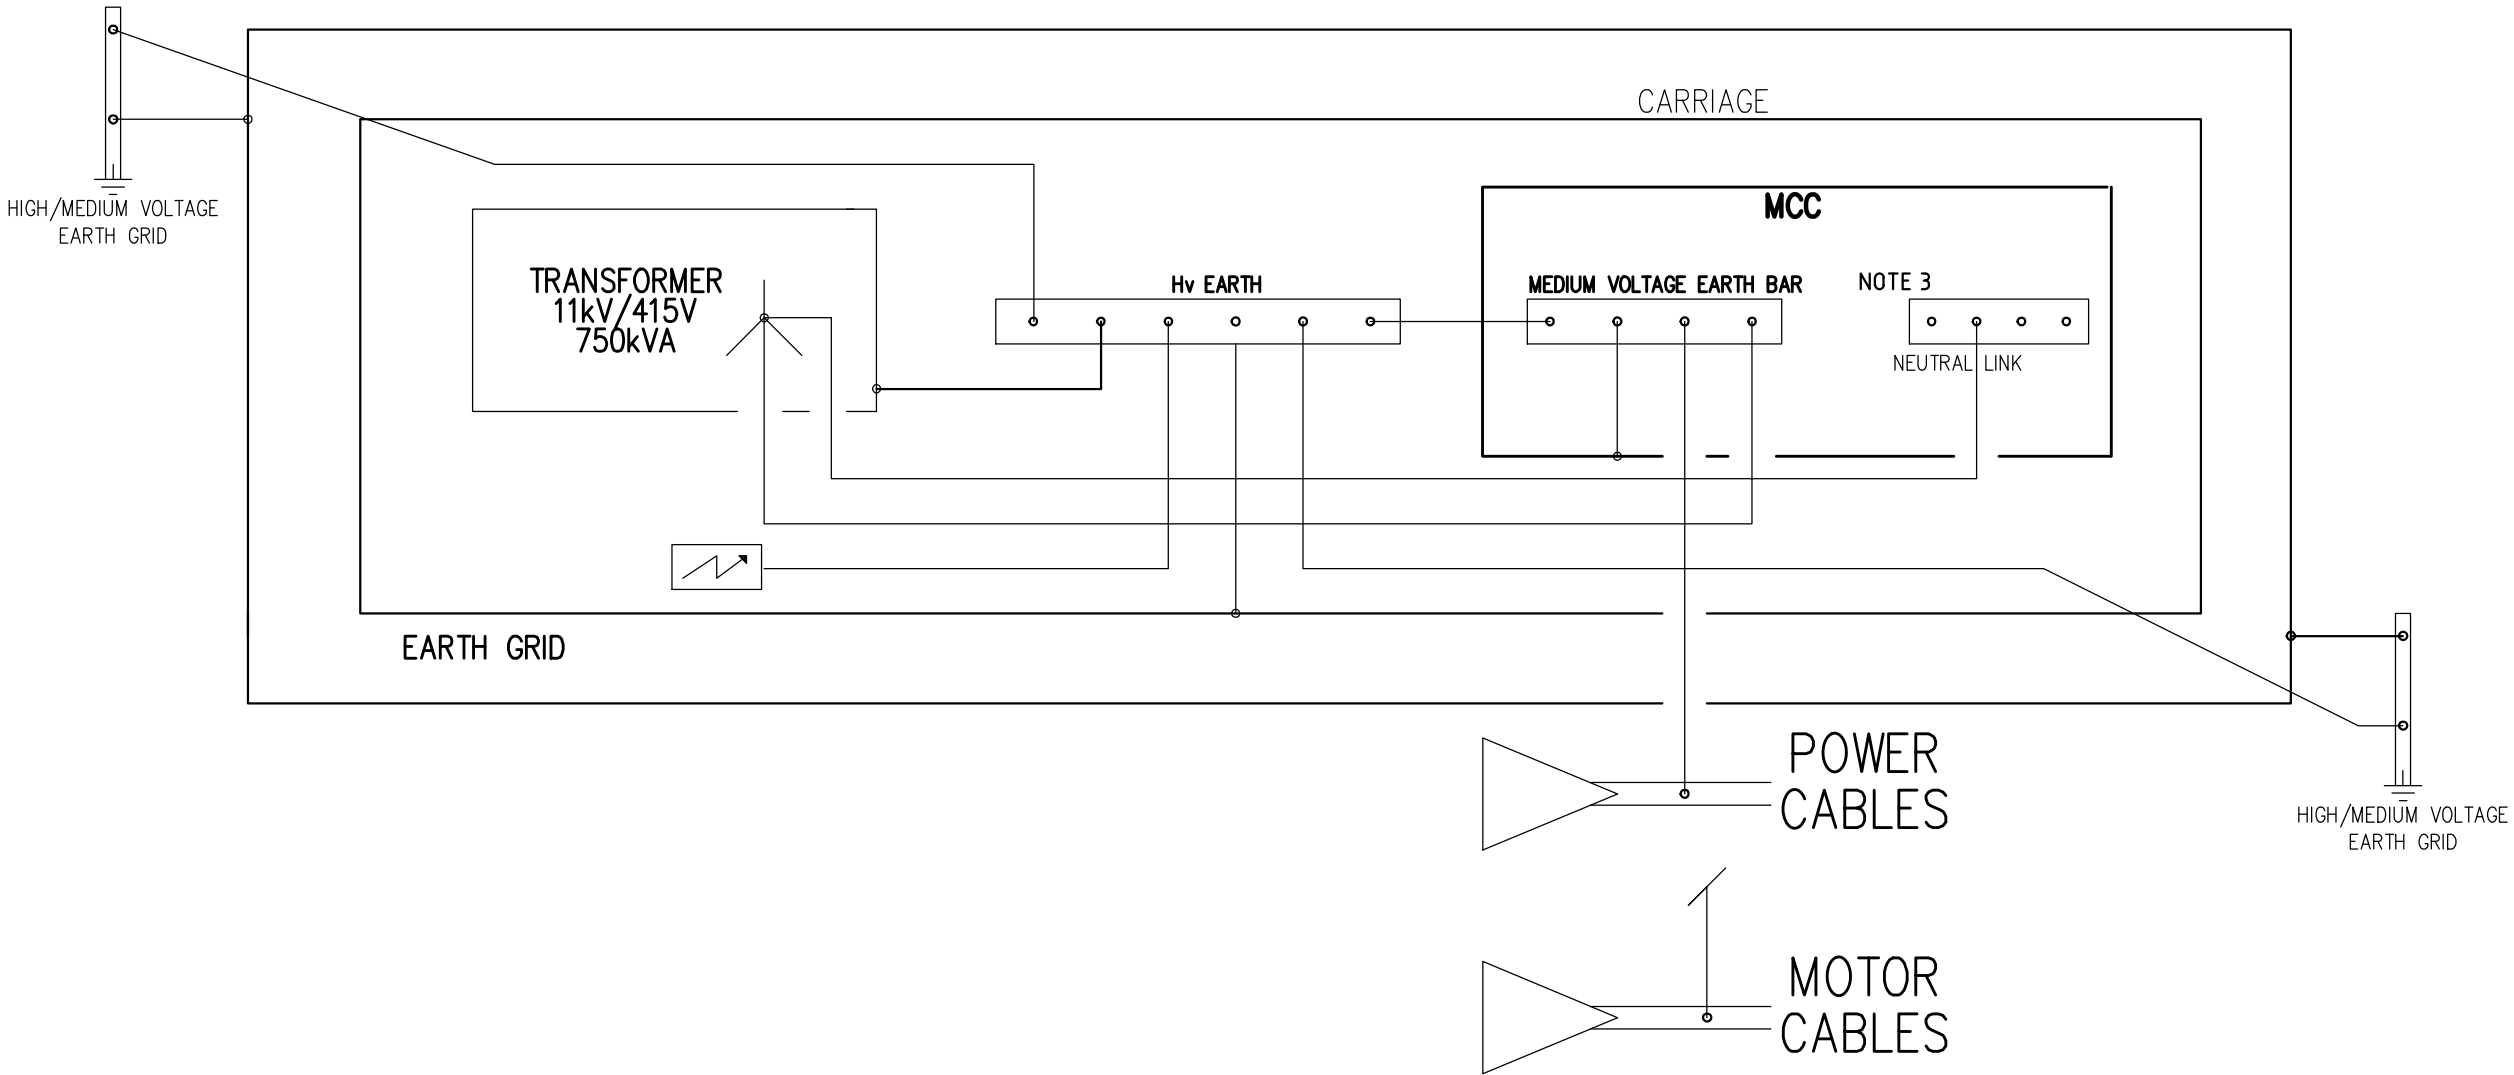

PEAK DOWNS MINE
TAILINGS SYSTEM
MCC23 MAIN EARTHING