


TESTED DETAIL

Combustible Pipe

El 30

Tested to EN 1366-3

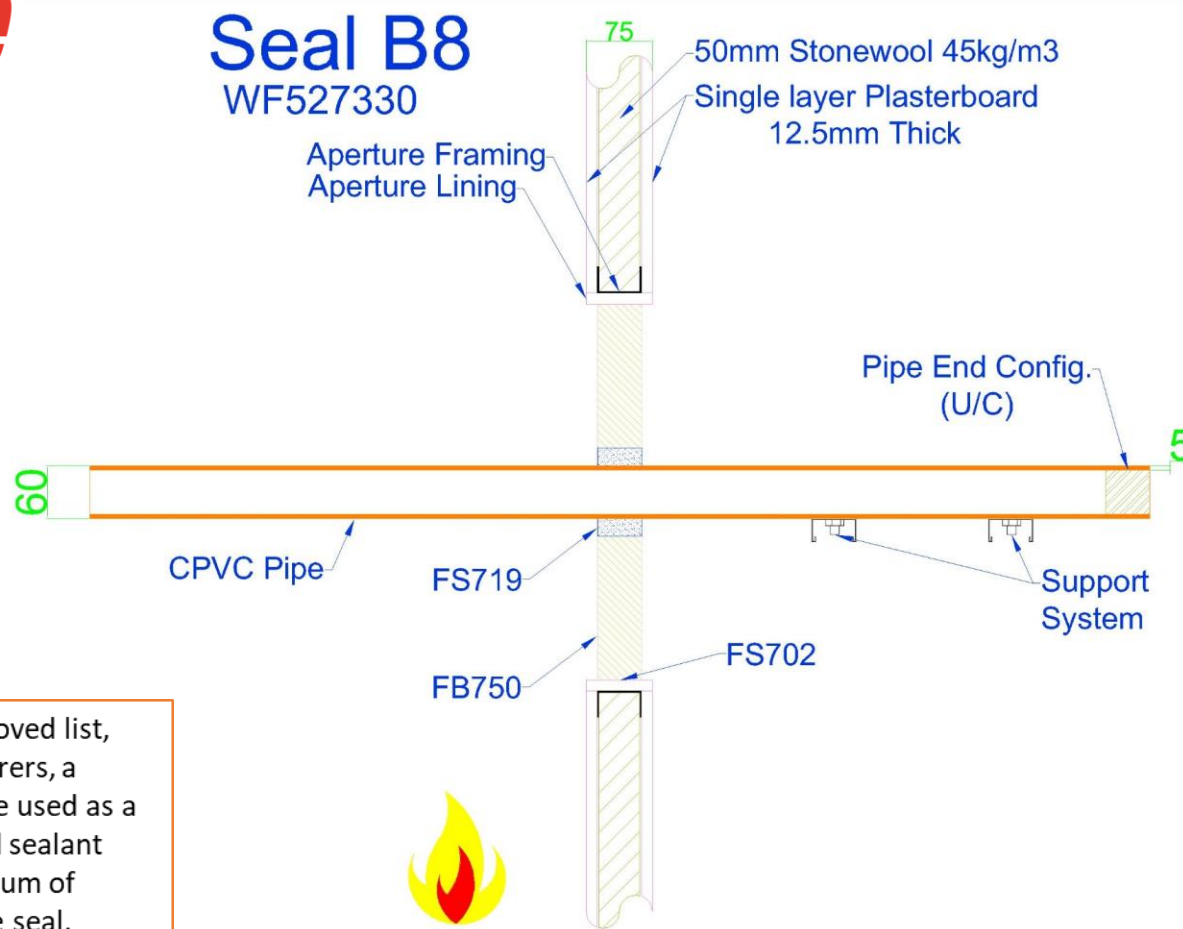

FS719 is on the Lubrizol approved list, for all other CPVC manufacturers, a piece of kitchen foil should be used as a barrier between the pipe and sealant and should protrude a minimum of 50mm from either side of the seal.

Reference number :
FB750-DW75-SI-CP-FS719-997-2D

Flexible Wall 75mm
Single FB750 compressed
Single combustible pipe 60mm

The use of alternative components or any deviation from the tested solution provided above is not permitted. Tremco CPG UK Ltd accept no responsibility for the use of Nullifire products or other Tremco CPG products in any applications or purposes not authorised or recommended by Tremco CPG. Further expert advice should always be sought where such applications are to be considered. This information is provided in good faith and is believed to be correct as of the date of publication based upon tested solutions. The reader must always ensure that they are following the latest published versions. Tremco CPG UK Ltd. assumes no liability, expressed or implied, as to the design, architecture, engineering, or workmanship of any project.