
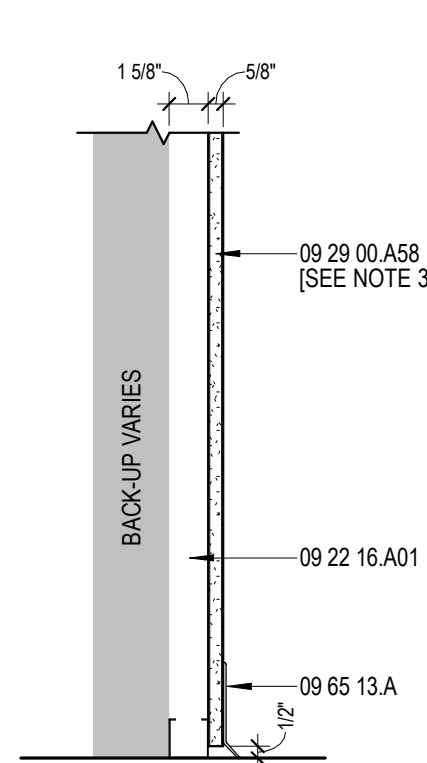


FLOOR SLAB, OR ROOF TRUSS BOTTOM CHORD, U.N.O.

20

WALL CONSTRUCTION VARIES.

TYPICAL HEAD OF WALL CONDITIONS.



D — 8" WALL / 8" WALL
D2 — 8" WALL / 12" WALL
D3 — 12" WALL / 12" WALL
2 HOUR
RATED WALL

F

H

J1 ← 3 5/8" METAL FRAMING
J2 ← 8" CMU STRUCTURE

K

REFERENCED KEYNOTES

03 00 00.0	COMPOSITE SLAB
04 20 00.0A3	CLAY MASONRY VENEER [TYPE 3]
04 20 00.0C1	STANDARD CMU [1/2"]
04 20 00.0C2	STANDARD CMU [3/4"x8"]
04 20 00.0C6	STANDARD CMU [8"x8"]
04 20 00.0C8	STANDARD CMU [12"x8"]
04 20 00.0C9	STANDARD CMU [10"x8"]
04 20 00.0	GROUT FILL
04 20 00.0D4	WEEPS (2" O.C.)
04 20 00.0	JOINT REINFORCEMENT
04 20 00.0	CAVITY DRAINAGE MATERIAL
04 20 00.0	TERMINATION BAR
05 12 00.0	STRUCTURAL STEEL COLUMN - REFER TO STRUCTURAL DWGS.
05 12 00.0	STRUCTURAL STEEL BEAM - REFER TO STRUCTURAL DWGS.
05 12 00.0	STRUCTURAL STEEL ANGLE - REFER TO STRUCTURAL DWGS.
05 12 00.0	STRUCTURAL STEEL BEARING PLATE - REFER TO STRUCTURAL DWGS.
06 16 00.A34	PLYWOOD SHEATHING BOARD [3/4"]
06 16 00.B58	GLASS-MAT GYPSUM WALL SHEATHING [5/8"]
07 21 00.0	MINERAL WOOL BLANKET
07 21 07.0F3	MINERAL WOOL BLANKET [3 1/2"]
07 84 13.A	FIRESTOPPING MATERIAL
07 84 46.A	EXP JOINT ASSEMBLY FIRE RATED [TYPE]
07 92 00.0	SEALANT
07 92 00.8	BACKER ROD
07 95 00.0A1	FLOOR TO FLOOR EXPANSION JOINT COVER
08 41 13.A	ALUMINUM FRAMED STOREFRONT
08 51 13.A	ALUMINUM WINDOW
09 21 16.A	STUDS AND TRACK [1/2"]
09 21 16.A06	STUDS AND TRACK [3/8" @ 16" O.C.]
09 22 16.A	STUDS AND TRACK [1/2"]
09 22 16.A01	STUDS AND TRACK [1/2" @ 16" O.C.]
09 22 16.A03	STUDS AND TRACK [3/8" @ 16" O.C.]
09 29 00.A58	ABUSE RESISTANT GYPSUM BOARD [5/8"]
09 29 00.E58	GYPSUM WALL BOARD [5/8"]
09 55 13.A	ACOUSTICAL PANEL, CEILINGS
09 65 13.A	RESISTANT GAGE
10 12 00.0	DISPLAY CASE

SHEET KEYNOTES

1. LOOKER, SEE INTERIOR DRAWINGS FOR TYPE.
2. PROVIDE BLOCKING AS REQUIRED.
3. STEEL BEANCH, SUPPORT, 1/4" x 1/4" x 1/4" 1/4" STEEL ANGLE @ 32" O.C. MITER ENDS AND SMOOTH ALL SURFACES. PAINT TO MATCH EXTERIOR.
4. 1/4" THICK SOLID LAMINATED HARD MAPLE BENCH. FINISH WITH MOISTURE RESISTANT URETHANE FLOOR COATING. EXPOSE ALL EXPOSED EDGES. BLOCK WITH MAPLE WITH ENDWID AT OPEN ENDS. FINISH TO MATCH BENCH.
5. METAL CLOSURE PANEL, FINISH TO MATCH LOOKER.
6. HARS-B 18" 18" O.C. DOWELED INTO CONCRETE SLAB AND GROUTED SOLID.
7. HIGH-PERFORMANCE THERMAL COATING APPLIED TO STRUCTURAL BEARING PLATE TO PROVIDE THERMAL BREAK BETWEEN EXTERIOR AND INTERIOR CONDITIONS. REFERENCE TO SPECIFICATION 90 06 00 FOR TYPICAL APPLICATION. THERMAL COATING TO BE APPLIED IN ALL CONDITIONS WHERE BEARING PLATE CONNECTS EXTERIOR AND INTERIOR CONSTRUCTION.
8. SELF-ADHERED FLEXIBLE FLASHING. SECURE FLASHING VERTICALLY TO SHEATHING/GUM. THEN RUN FLASHING INTO INTERIOR WALL. FLASHING TO EXTEND 3" ABOVE METAL Drip EDGE. FLASHING SHALL EXTEND 6" MINIMUM ABOVE TOP OF CAVITY DRAINAGE MATERIAL.
9. STAINLESS STEEL Drip EDGE SHALL EXTEND 3" FROM FACE OF MASONRY VENEER AND BE SET IN FULL BED OF SEALANT. EXTEND 1/2" OUT FROM WALL WITH OUTER EDGE BENT DOWN 30 DEGREES AND INFLAT.
10. WALL STRUCTURE VARIES. REFER TO FLOOR PLANS AND WALL SECTIONS.
11. WALL CONSTRUCTION VARIES REFER TO FLOOR PLANS.
12. 1/2" HOLD TIGHT TO COLUMN.
13. ALUMINUM FRAME.
14. CONCEALED TOP LIGHTING. INTERNAL WITH COVER. REFER TO SPECIFICATION FOR ADDITIONAL INFORMATION.
15. TEMPERED GLASS, SLIDING DOWN WITH CAM LOCK. REFER TO SPECIFICATION FOR ADDITIONAL INFORMATION.
16. TEMPERED GLASS, ADJUSTABLE SLIDES. REFER TO SPECIFICATION FOR ADDITIONAL INFORMATION.
17. TACKLED SURFACE.
18. REFER TO STRUCTURAL, SHEET 5-51 FOR LIGHT GAUGE BRACING REQUIREMENTS.
19. AT MONUMENT PARTITIONS, PROVIDE 1/2" SLUTES OF GIBBS WITH 0720-10 MINER WOOD BLANKET INSULATION FOR ACOUSTICAL PERFORMANCE.
20. PROVIDE SHIM WITH POSITIVE DRAINAGE FOR SUPPORT OF THROUGH WALL FLASHING. MAKE UP IT WOOD SHIM AND PROVIDE INSULATION. COORDINATE HEIGHT OF SHIM WITH WINDOW MANUFACTURER TO ENSURE WINDOW FASTENERS DO NOT FUNCTION THROUGH WALL FLASHING.

SALEM CSD NEW K-8
2002 WHINNERY ROAD
SALEM OHIO 44460

A-501



DETAILS