


8/12/2025 11:49:05 AM

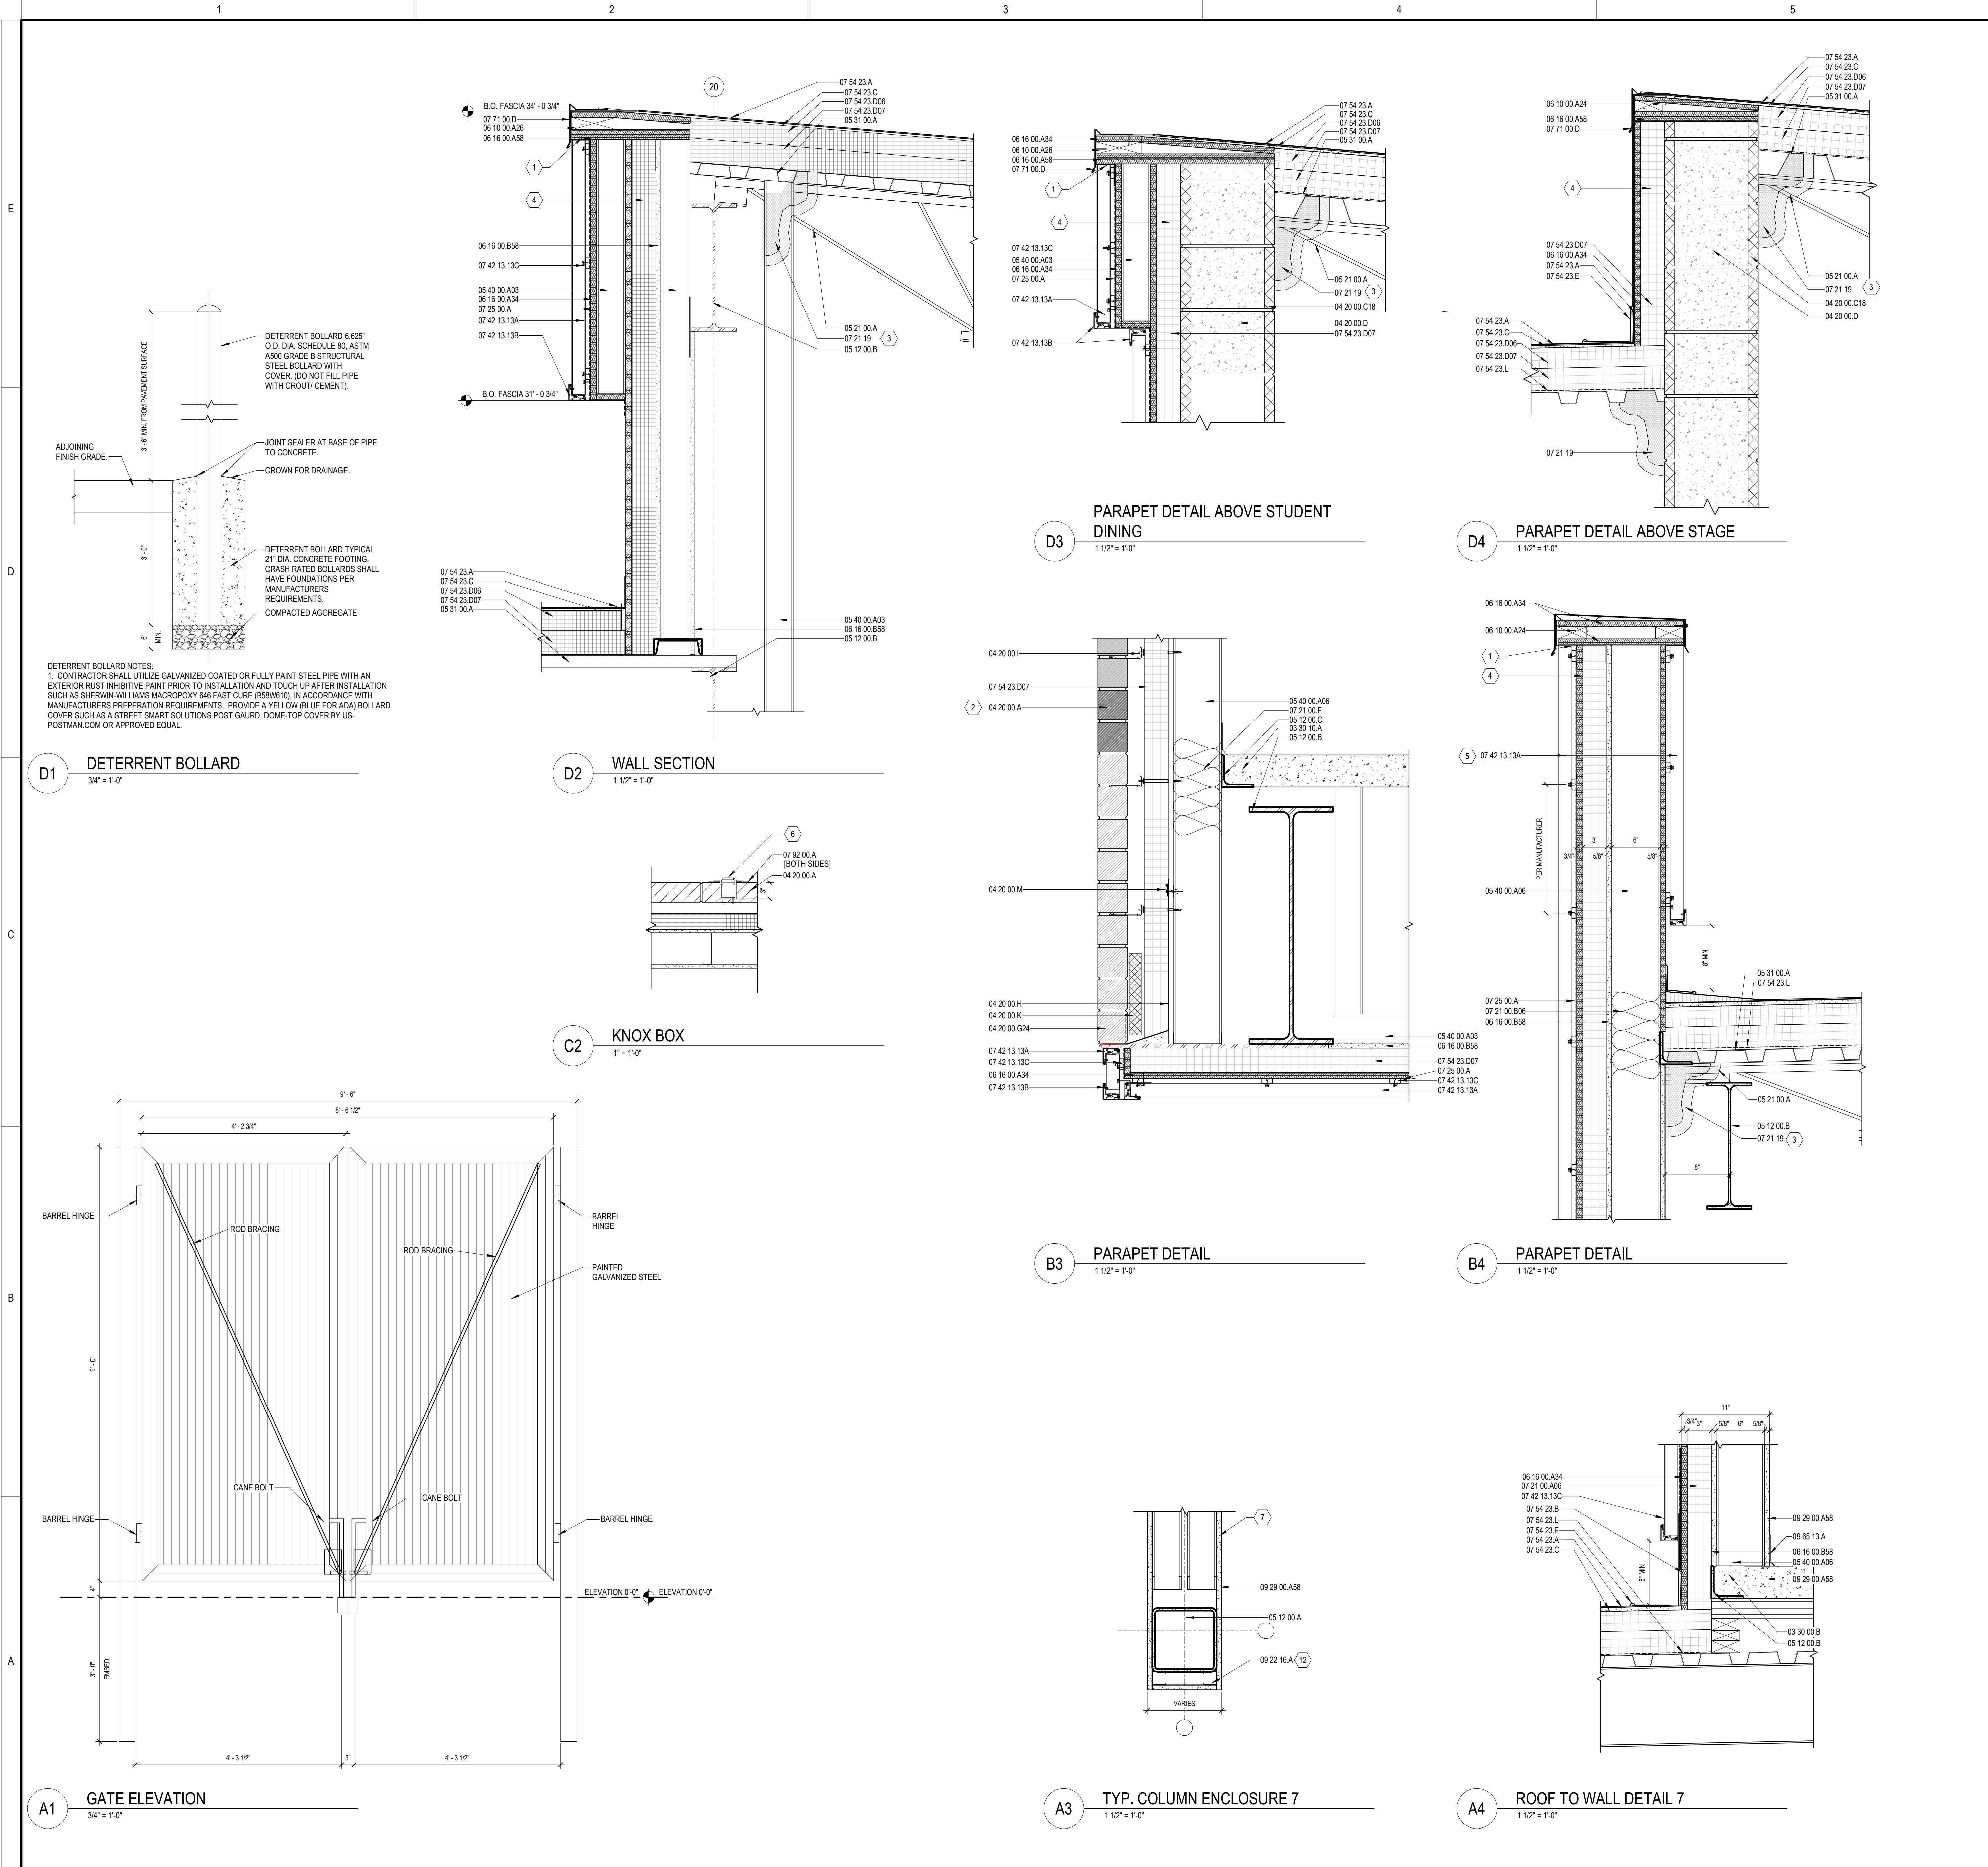

GENERAL SHEET NOTES

- DO NOT SCALE DRAWINGS.
- ALL BLOCKING IN WALLS IS TO BE FIRE RETARDANT TREATED.
- REFER TO EXTERIOR ELEVATIONS FOR BRICK PATTERNS.
- REFER TO EXTERIOR ELEVATIONS FOR FORMED METAL PANEL COLORS AND PATTERNS.
- METAL PANEL CLIPS ARE TO BE DESIGNED AND PROVIDED BY FORMED METAL PANEL MANUFACTURER. EXACT DEPTH OF WALL MAY VARY. NOTIFY ARCHITECT OF LOCATIONS WHERE WALL DEPTH WILL VARY FROM THAT SHOWN IN WALL SECTION.
- PAIN'T ALL UNITS & MISCELLANEOUS EXPOSED STEEL.
- REFER TO A-501 FOR INTERIOR WALL TYPES.
- ALL CHASE WALLS AND COLUMN ENCLOSURES SHALL BE WALL TYPE 'F' UNLESS NOTED OTHERWISE.
- METAL PANEL WALL WIDTH IS SHOWN MEASURED TO PLYWOOD SUBSTRATE. EXACT THICKNESS OF METAL PANEL MAY VARY DUE TO MANUFACTURER REQUIREMENTS AND INDIVIDUAL PANEL VARIATIONS.

REFERENCED KEYNOTES

03 30 00.B	COMPOSITE SLAB
03 30 10.A	CONCRETE SLAB VIBRATION SUPPRESSION
04 20 00.A	CLAY MASONRY VENEER [TYPE]
04 20 00.C18	STANDARD CMU (12x8x16)
04 20 00.D	GROUT FILL
04 20 00.G24	WEEPS [24" O.C.]
04 20 00.H	EMBEDDED FLASHING
04 20 00.I	WALL TIE
04 20 00.K	CAVITY DRAINAGE MATERIAL
04 20 00.M	TERMINATION BAR
05 12 00.A	STRUCTURAL STEEL COLUMN - REFER TO STRUCTURAL DWGS.
05 12 00.B	STRUCTURAL STEEL BEAM - REFER TO STRUCTURAL DWGS.
05 12 00.C	STRUCTURAL STEEL ANGLE - REFER TO STRUCTURAL DWGS.
05 21 00.A	OPEN WEB JOIST - REFER TO STRUCTURAL DWGS.
05 31 00.A	METAL DECK - REFER TO STRUCTURAL DWGS.
05 40 00.A03	STUDS AND TRACK [5/8" @ 16" O.C.]
05 40 00.A06	STUDS AND TRACK [8" @ 16" O.C.]
06 10 00.A24	WOOD BLOCKING [2x4]
06 10 00.A26	WOOD BLOCKING [2x6]
06 16 00.A34	PLYWOOD SHEATHING BOARD [3/4"]
06 16 00.A58	PLYWOOD SHEATHING BOARD [5/8"]
06 16 00.B58	GLASS-MAT GYPSUM WALL SHEATHING [5/8"]
07 21 00.A06	BOARD INSULATION [3"]
07 21 00.B06	BATT INSULATION [R 14]
07 21 00.F	MINERAL WOOL BLANKET
07 21 19	FOAMED-IN-PLACE INSULATION
07 25 00.A	WEATHER BARRIERS
07 42 13.13A	FORMED METAL WALL PANEL
07 42 13.13B	FORMED METAL WALL PANEL TRIM
07 42 13.13C	FORMED METAL WALL PANEL CLIP
07 54 23.A	TPO ROOFING MEMBRANE
07 54 23.B	BASE FLASHING
07 54 23.C	COVERBOARD
07 54 23.D06	INSULATION BOARD [2 1/2"]
07 54 23.D07	INSULATION BOARD [3"]
07 54 23.E	SEALANT
07 54 23.L	VAPOR BARRIER
07 71 00.D	GRAVEL STOP
07 92 00.A	SEALANT
09 22 16.A	STUDS AND TRACK [I-SIZE]
09 29 00.A58	ABUSE RESISTANT GYPSUM BOARD [5/8"]
09 65 13.A	RESILIENT BASE

SHEET KEYNOTES

- WRAP ROOF MEMBRANE UP AND AROUND PLYWOOD SHEATHING TO FACE OF STUD OR CMU WALL. EXTEND MEMBRANE DOWN 1" BEHIND FACE OF INSULATION SYSTEM OR PROVIDE BUILDING WRAP TO CONTINUE VAPOR BARRIER.
- REFER TO BUILDING ELEVATIONS FOR MASONRY VENEER TYPE.
- APPLY CELLULOSIC IN 1" THICKNESS OVER POLYURETHANE SPRAY FOAM INSULATION WHEN SPRAY FOAM INSULATION IS EXPOSED TO INTERIOR OF BUILDING.
- CONTINUOUS INSULATION WALL PANEL SYSTEM. BASIS OF DESIGN: XCI PLY BY HUNTERS PANELS (3/2" SYSTEM W/ 3/4" PLYWOOD), OR OTHER PRODUCT OF EQUAL COMPOSITION BY CARLISLE, RMAX, GAF, OR ATLAS. MINIMUM R-VALUE OF 16.3.
- REFER TO ELEVATIONS FOR METAL PANEL COLOR AND PROFILE.
- RECESSED KNOX BOX.
- WALL CONSTRUCTION VARIES REFER TO FLOOR PLANS.

GPD GROUP®
Glass, Pyle, Schomer, Burns & Dehaven, Inc.
500 South Main Street, Suite 2051
Wrentham, MA 01951
508.572.2100 Fax 508.572.2101
Copyright © Glass, Pyle, Schomer, Burns & Dehaven, Inc. 2025

REV	DATE	DESCRIPTION

ISSUED FOR:

PERMIT	07/07/2025
BID	08/15/2025
CONSTRUCTION	
RECORD	

PROJECT MANAGER	DESIGNER
CB	LMW

SALEM CSD NEW K-8
2002 WHINERY ROAD
SALEM OHIO 44480

DETAILS

JOB NO.
2024270.01

A-504