


Sampling  $\alpha=0.1$ ; 1.96 MC SE

Noise-free procedures under misspecification

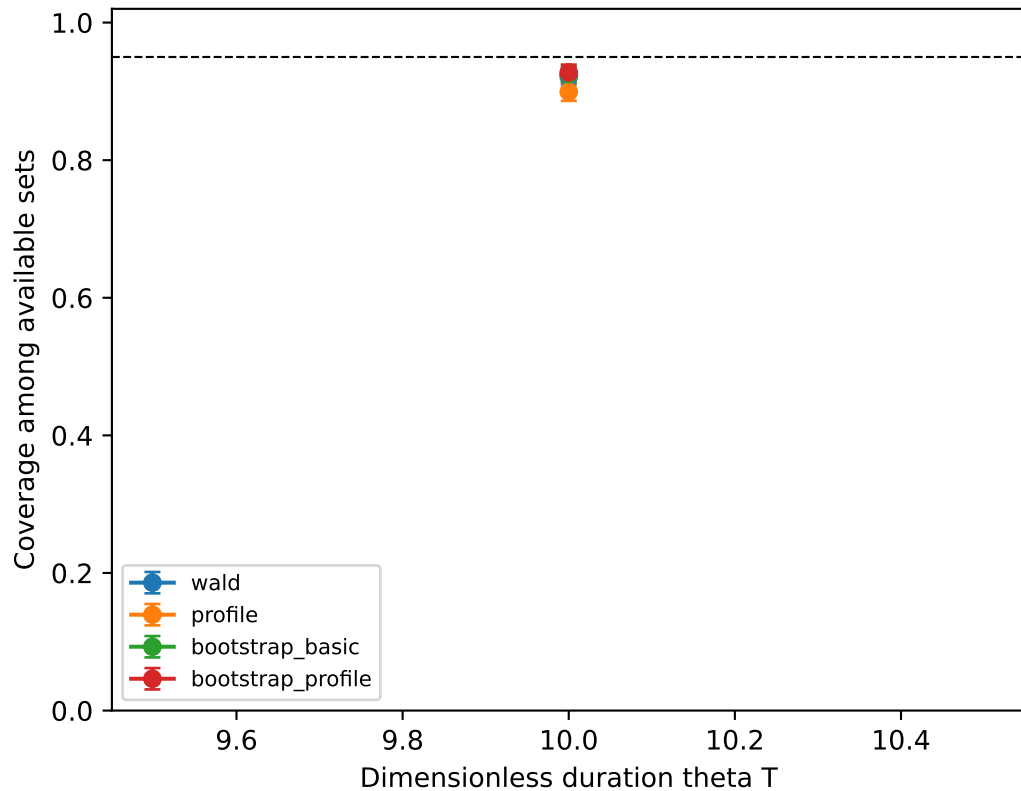