


Sampling $\alpha=0.02$; 1.96 MC SE

Noise-free procedures under misspecification

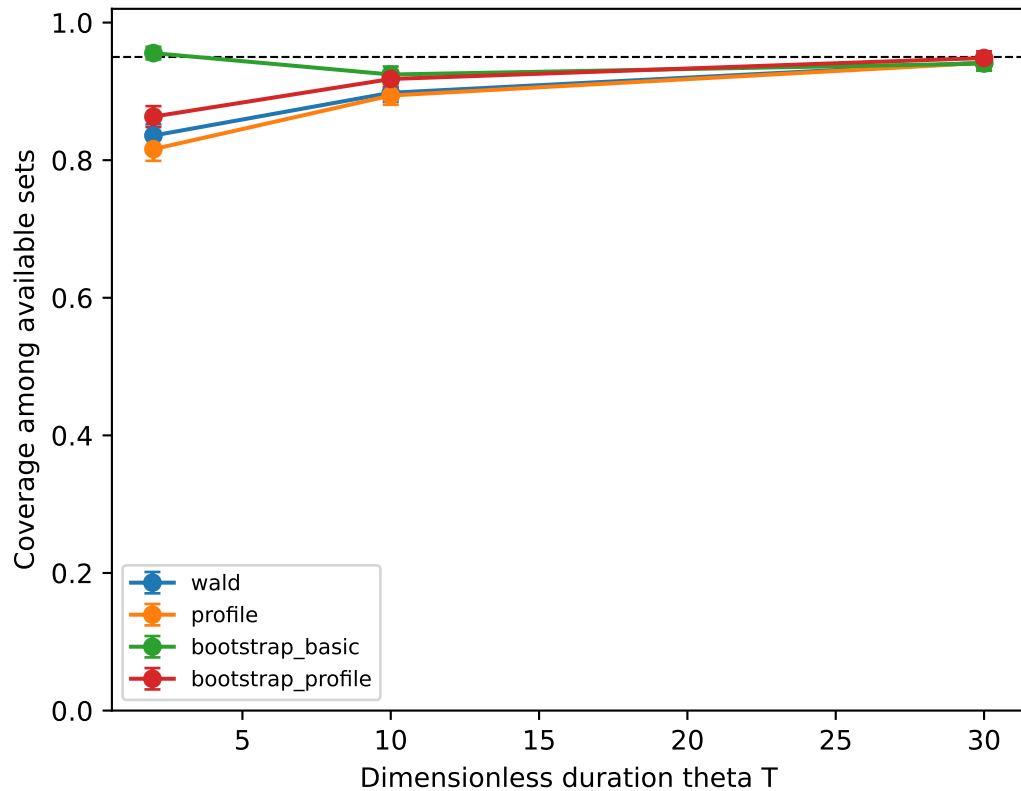