


- DRAWING NOTES:**
1. ALL EQUIPMENT TO BE SUITABLY IP RATED FOR THE ENVIRONMENT THEY ARE BEING INSTALLED.
 2. THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL OTHER DRAWINGS & SPECIFICATIONS.
 3. CONTRACTOR SHALL ALLOW FOR PROVISION OF SAMPLE FITTINGS.
 4. CONTRACTOR TO MAKE FULL TECHNICAL SUBMITTAL BEFORE PROCURING ANY FITTINGS. ANY CHANGES TO EQUIPMENT SPECIFIED AT TENDER MUST BE SIGNED OFF BY OCSC.
 5. THE CONTRACTOR SHALL ALLOW FOR ANY SUSPENSION EQUIPMENT, LAMPS, END CAPS & ANY ASSOCIATED ACCESSORIES.
 6. OCSC RESERVES THE RIGHT TO HAVE ANY UNAPPROVED FITTINGS THAT MAY BE INSTALLED REMOVED BY CONTRACTOR AT NO ADDITIONAL EXPENSE TO THE CONTRACT.
 7. ALL WORK TO BE CARRIED OUT IN ACCORDANCE WITH ETCI REGULATIONS.
 8. EMERGENCY EXIT SIGNAGE SHOWN IS FOR DIAGRAMMATIC PURPOSES ONLY. ALL EXIT SIGNAGE MUST BE AGREED WITH THE ENGINEER ON SITE.
 9. ALL LIGHTING CIRCUITS TO BE WIRED IN 2.5mm² LSF SINGLES UNLESS OTHERWISE STATED.
 10. ALL EXTERNAL LIGHTING CONTROLLED VIA PHOTOCELL TIMECLOCK.

LEGEND OF SYMBOLS:

- B1** - LIGHTING TRACK
- B2** - LED TAPE
- B1a** - 160mm
- B1b** - 1200mm
- B1c** - 900mm
- B1d** - 600mm
- B1f** - 300mm
- D1** - MOISTURE RESISTANT DOWNLIGHT
- D2** - RECESSED DOWNLIGHT
- D3** - BESPOKE SURFACE DOWNLIGHT
- D4** - RECESSED DOWNLIGHT
- D5** - SURFACE DOWNLIGHT
- D6** - SURFACE/ WALL MOUNTED FLOOD LIGHT
- GL/E** - VAPOUR PROOF IP65 LUMINAIRES
- IP65** - 280x180mm EXTERNAL WALL MOUNTED IMPACT RESISTANT LUMINAIRE (IP65 RATED)
- G2** - BESPOKE LUMINAIRE TYPE P3
- L** - LIGHTING CONTROL MODULE
- PM** - PROXIMITY LIGHTING CONTROL SENSOR
- CS** - COMBINED DAYLIGHT & PROXIMITY LIGHTING CONTROL SENSOR
- EM** - NON-MAINTAINED STAND ALONE EMERGENCY LED FITTING
- EM2** - TWIN EMERGENCY SPOTLIGHT
- T** - DENOTES TO 3 HOUR INTEGRAL EMERGENCY CONVERSION PACK
- ES** - EMERGENCY EXIT SIGN
- SW** - ONE WAY LIGHT SWITCH
- TSW** - TWO WAY LIGHT SWITCH
- IS** - INTERMEDIATE LIGHT SWITCH
- - DENOTES LUMINAIRE ON SAME CIRCUIT
- - -** - DENOTES LUMINAIRE ON SAME CIRCUIT BUT SWITCH SEPARATELY
- XX** - SYMBOL
- XX/X** - LUMINAIRE REF
- XX/1** - CONTROL ZONE
- XX/11** - CONTROL CHANNEL
- - LENGTH

Kirby Engineering
MASTER COPY
kirby

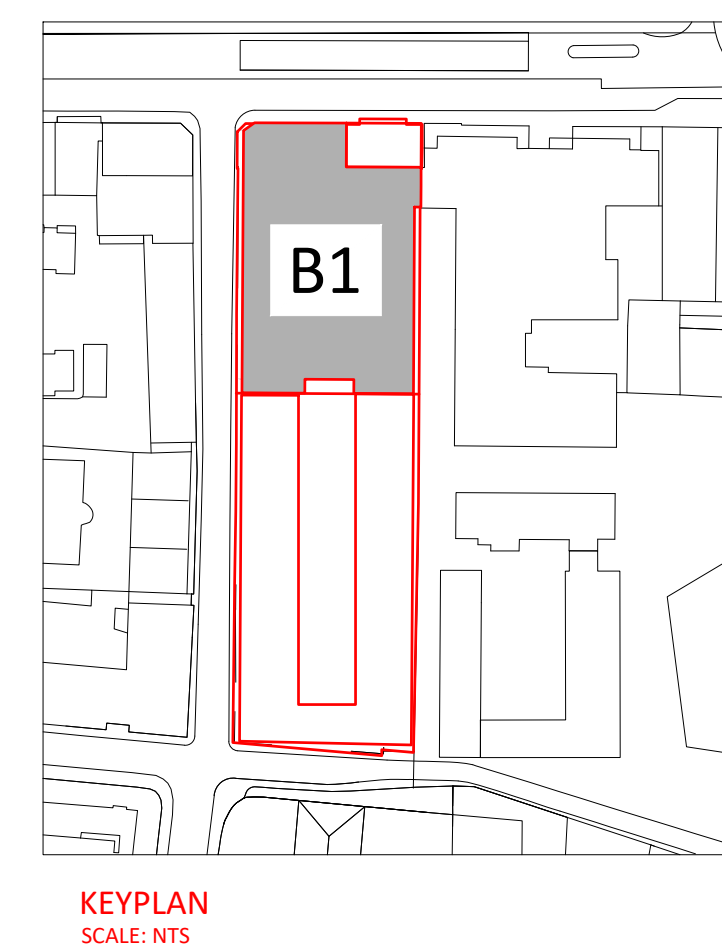


- FOR SETTING OUT REFER TO ARCHITECT'S DRAWINGS.
- THIS DRAWING TO BE READ IN CONJUNCTION WITH ALL OTHER ARCHITECTURAL AND ENGINEERING DRAWINGS AND ALL OTHER RELEVANT DRAWINGS AND SPECIFICATIONS.
- DO NOT SCALE THIS DRAWING. USE FIGURED DIMENSIONS ONLY.
- NO PART OF THIS DOCUMENT MAY BE REPRODUCED OR TRANSMITTED IN ANY FORM OR STORED IN ANY RETRIEVAL SYSTEM OF ANY NATURE WITHOUT THE WRITTEN PERMISSION OF O'CONNOR SUTTON CROININ AS COPYRIGHT HOLDER EXCEPT AS AGREED FOR USE ON THE PROJECT FOR WHICH THE DOCUMENT WAS ORIGINALLY ISSUED.

Rev No. | Date | Revision Note
C01 | 28.08.20 | SUITABLE FOR CONSTRUCTION.

Drm by | Chkd by
F.C. | T.D.

Rev No. | Date | Revision Note

Drm by | Chkd by

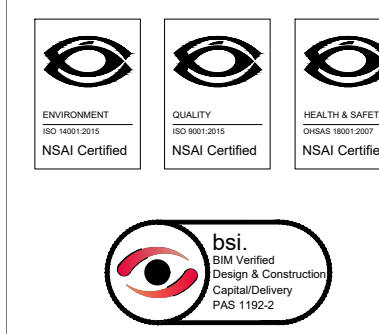

Head Office,
9 Prussia Street,
Dublin 7,
D07 KT57

TEL +353 (0)1 8682000

e: contactus@ocsc.ie

w: www.ocsc.ie

Dublin | London | Belfast | Galway | Cork | Birmingham



Client: Balark Investments Ltd. and Balark Trading GP Ltd.

Project: LIME STREET

Block 1 COMMERCIAL

ELECTRICAL-CAT A

LIGHTING INSTALLATION

FIFTH FLOOR PLAN

Code | Originator | Zone | Level | Type | Role | Number | Status | Revision
CLLS OCSC - B1 - 05 - DR - E - 3007 | A5 | C01

Date: 21.10.19 Scale: 1:100 @ A0 Drn by: C.T. Chkd by: J.D. Aprvd by: E.O.