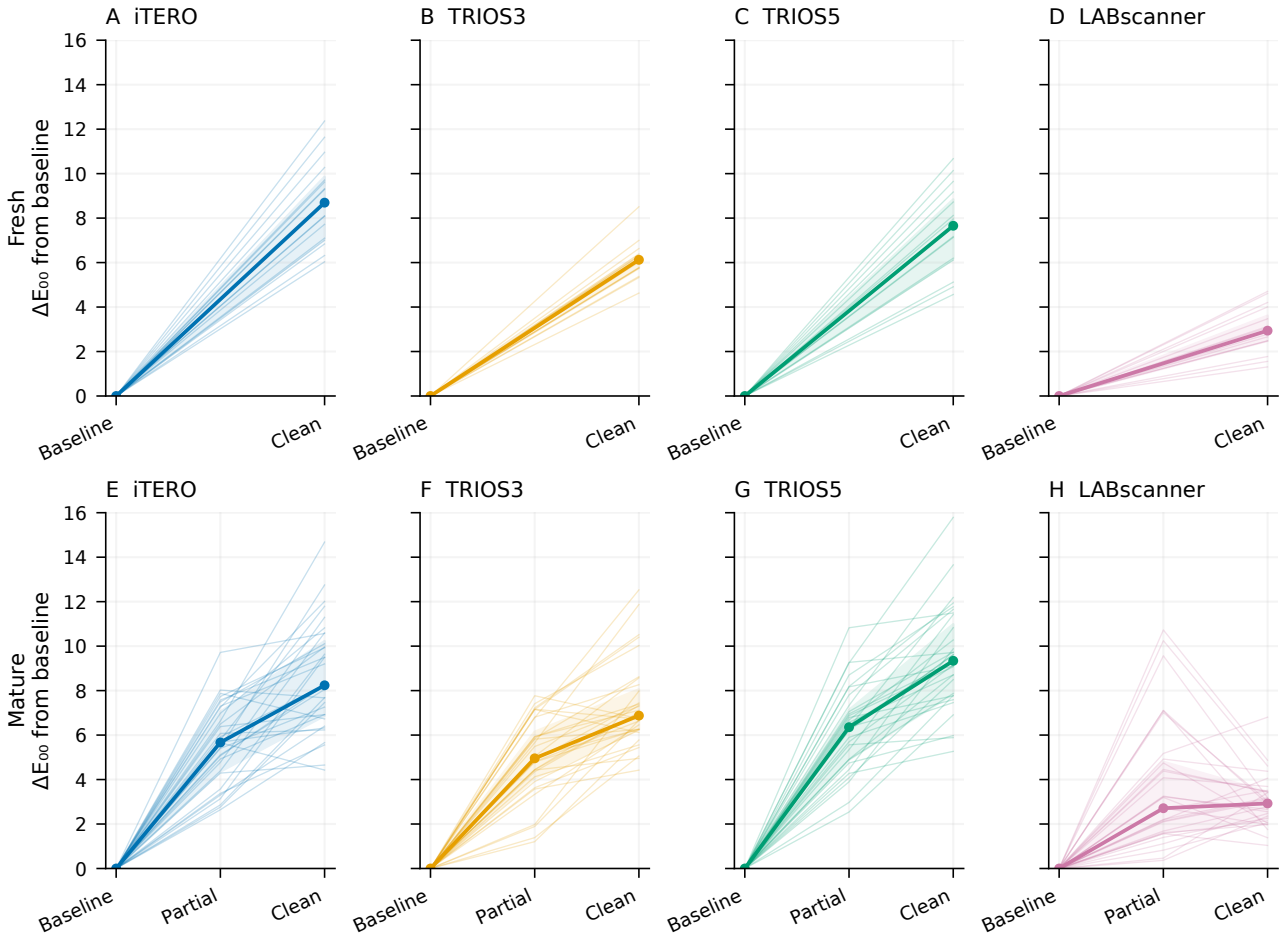
A iTERO
B TRIOS3
C TRIOS5
D LABscanner
E iTERO
F TRIOS3
G TRIOS5
H LABscanner
Fresh
ΔE00 from baseline
Mature
ΔE00 from baseline
0
2
4
6
8
10
12
14
16
Baseline
Partial
Clean