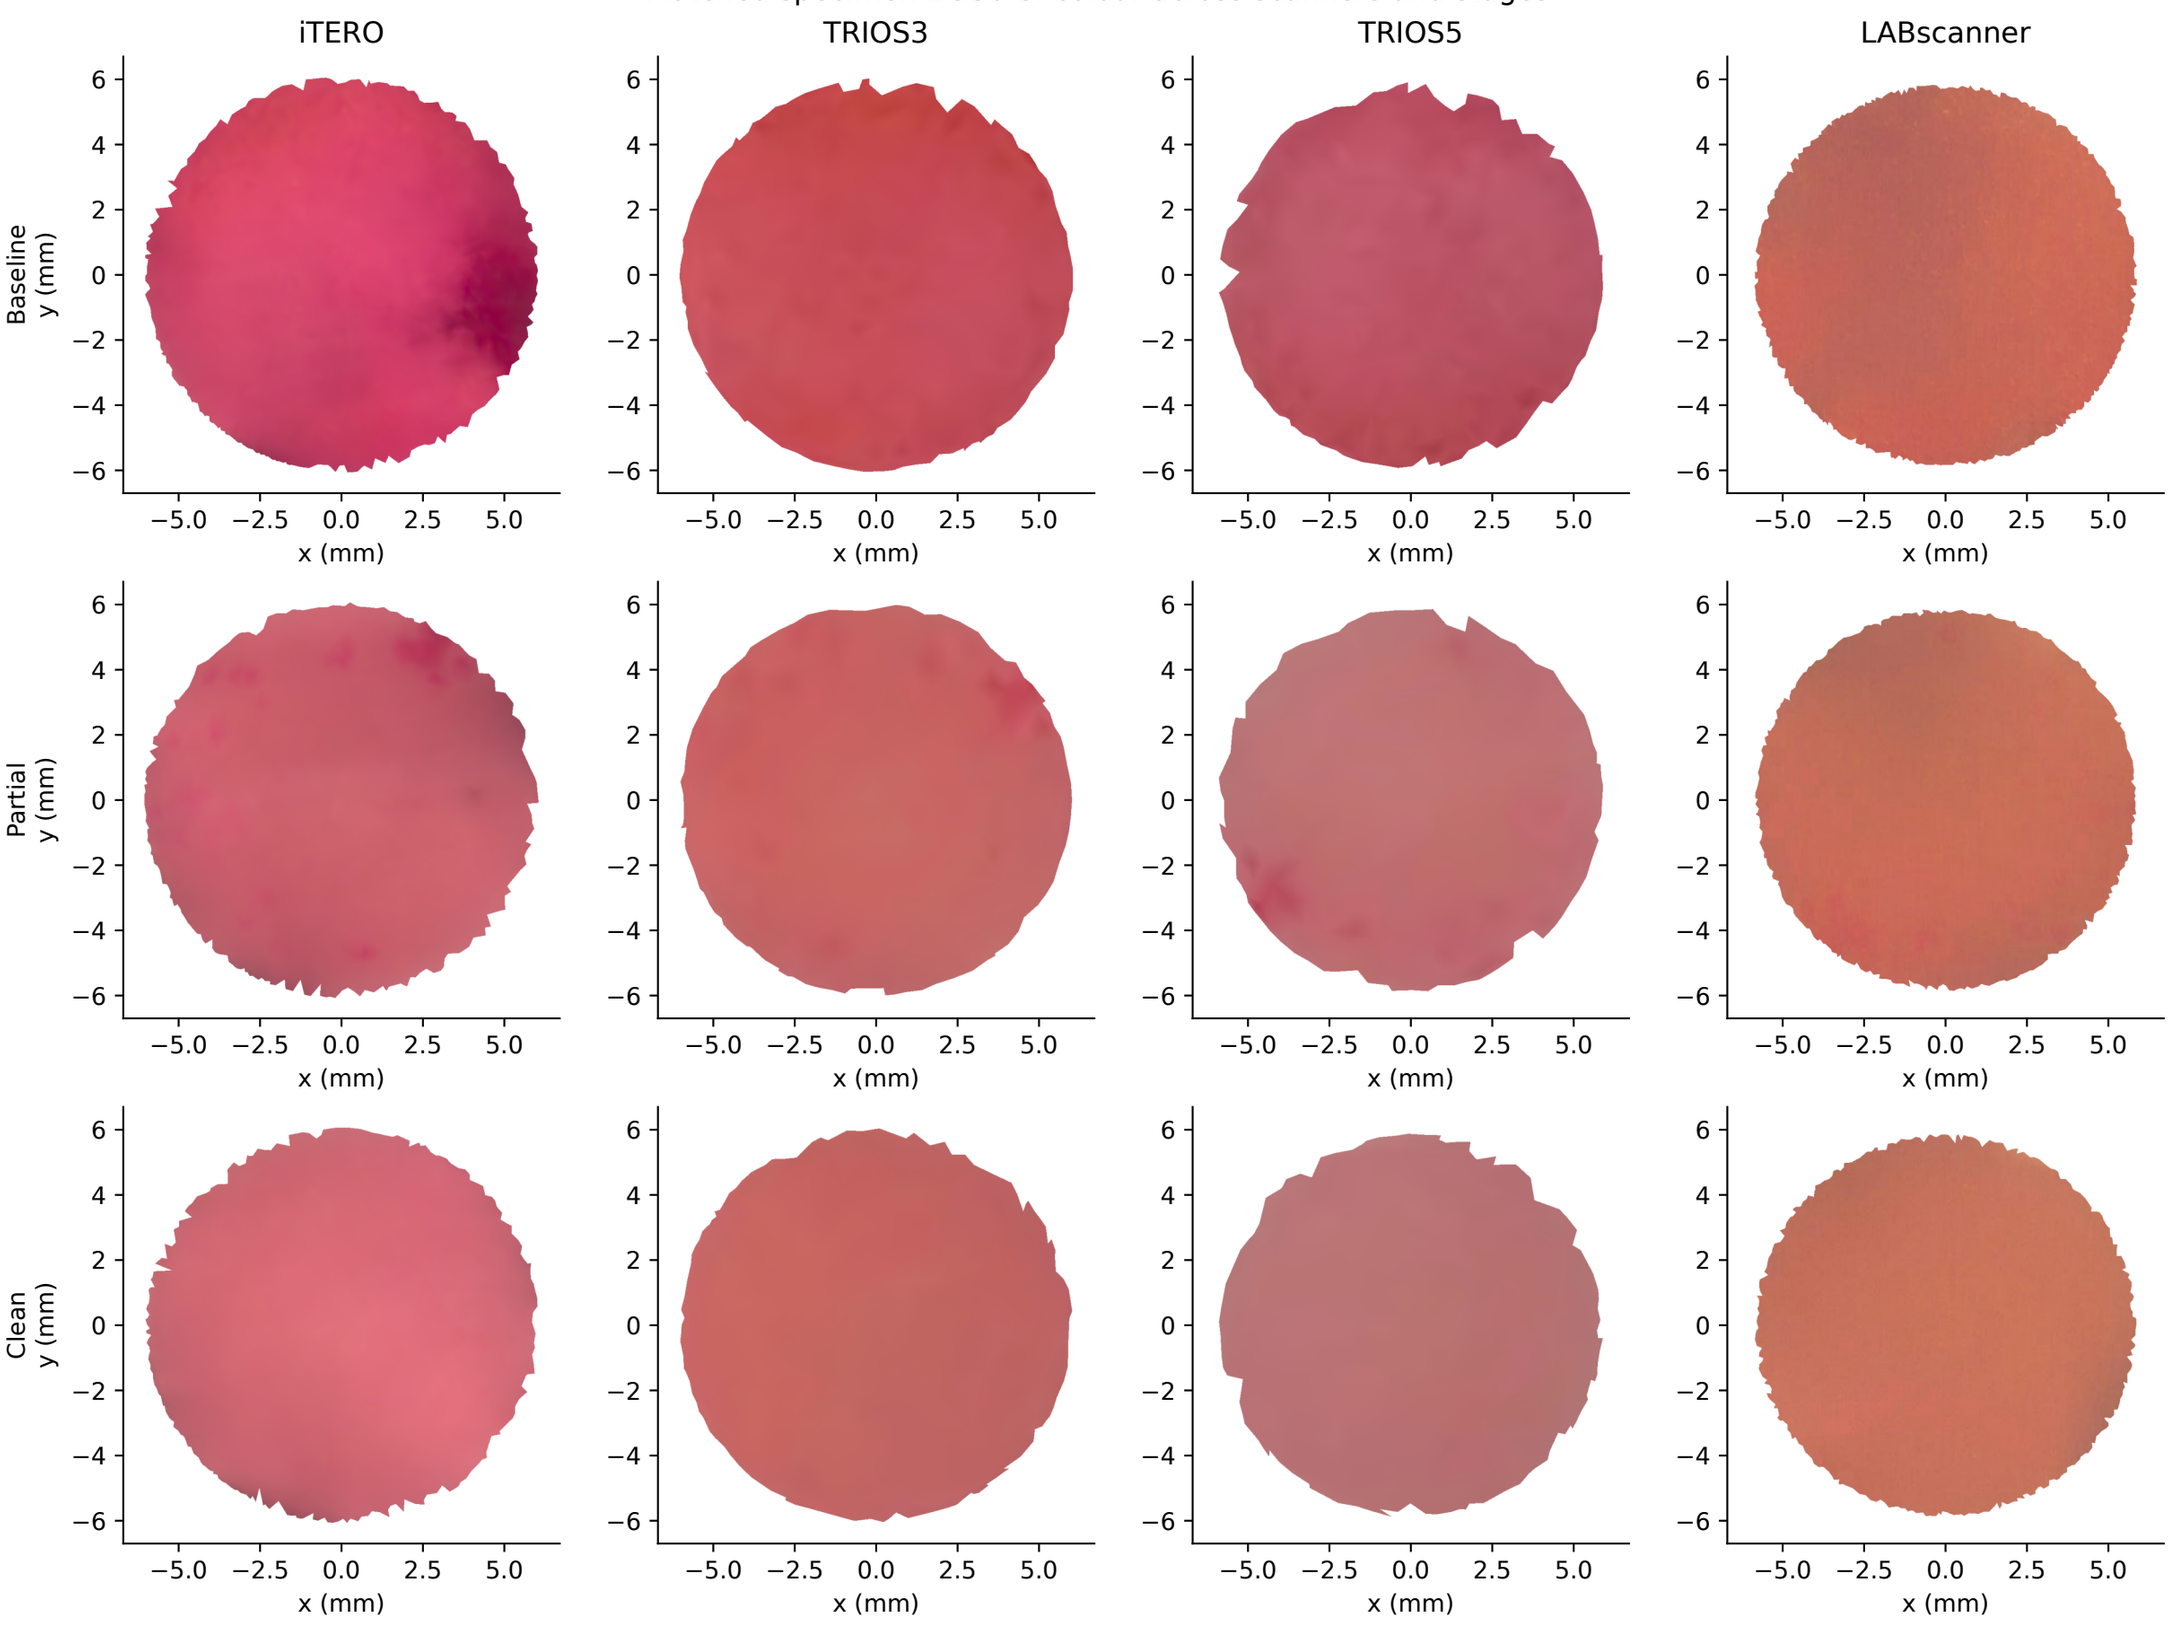

Matched specimen BCG6-8: colour across scanners and stages
iTERO
TRIOS3
TRIOS5
LABscanner
Baseline
Partial
Clean
y (mm)
x (mm)
6
4
2
0
−2
−4
−6
−5.0
−2.5
0.0
2.5
5.0