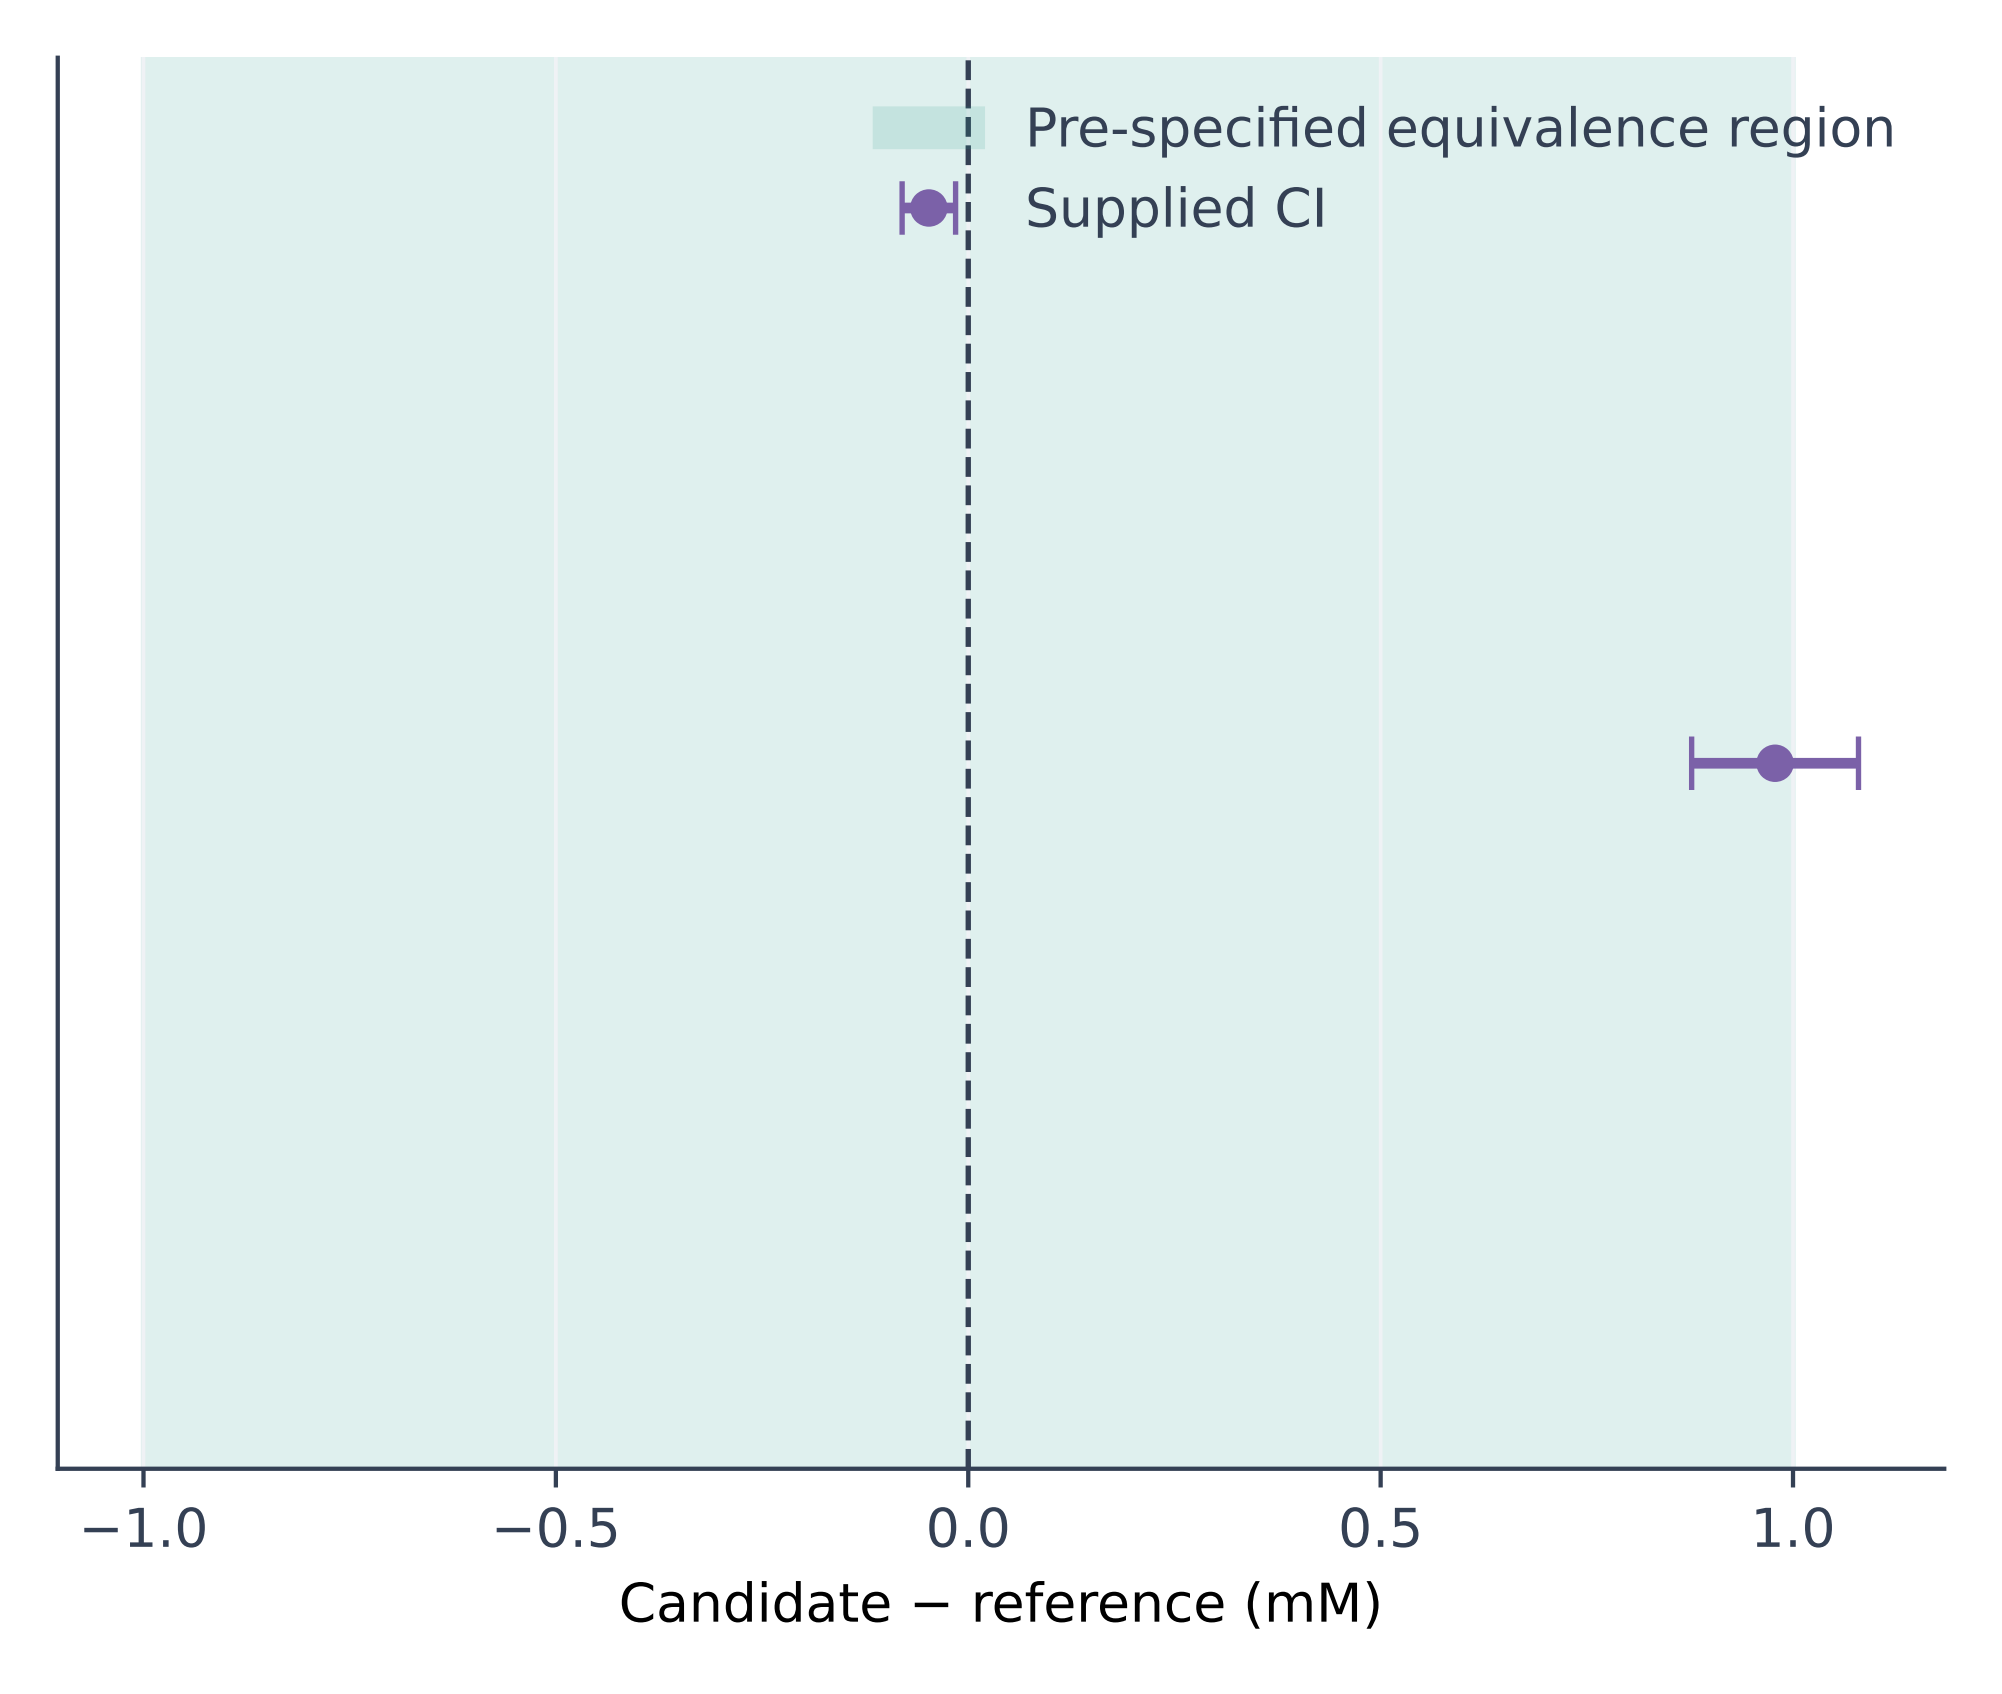
Pre-specified equivalence region
Supplied CI
−1.0
−0.5
0.0
0.5
1.0
Candidate − reference (mM)