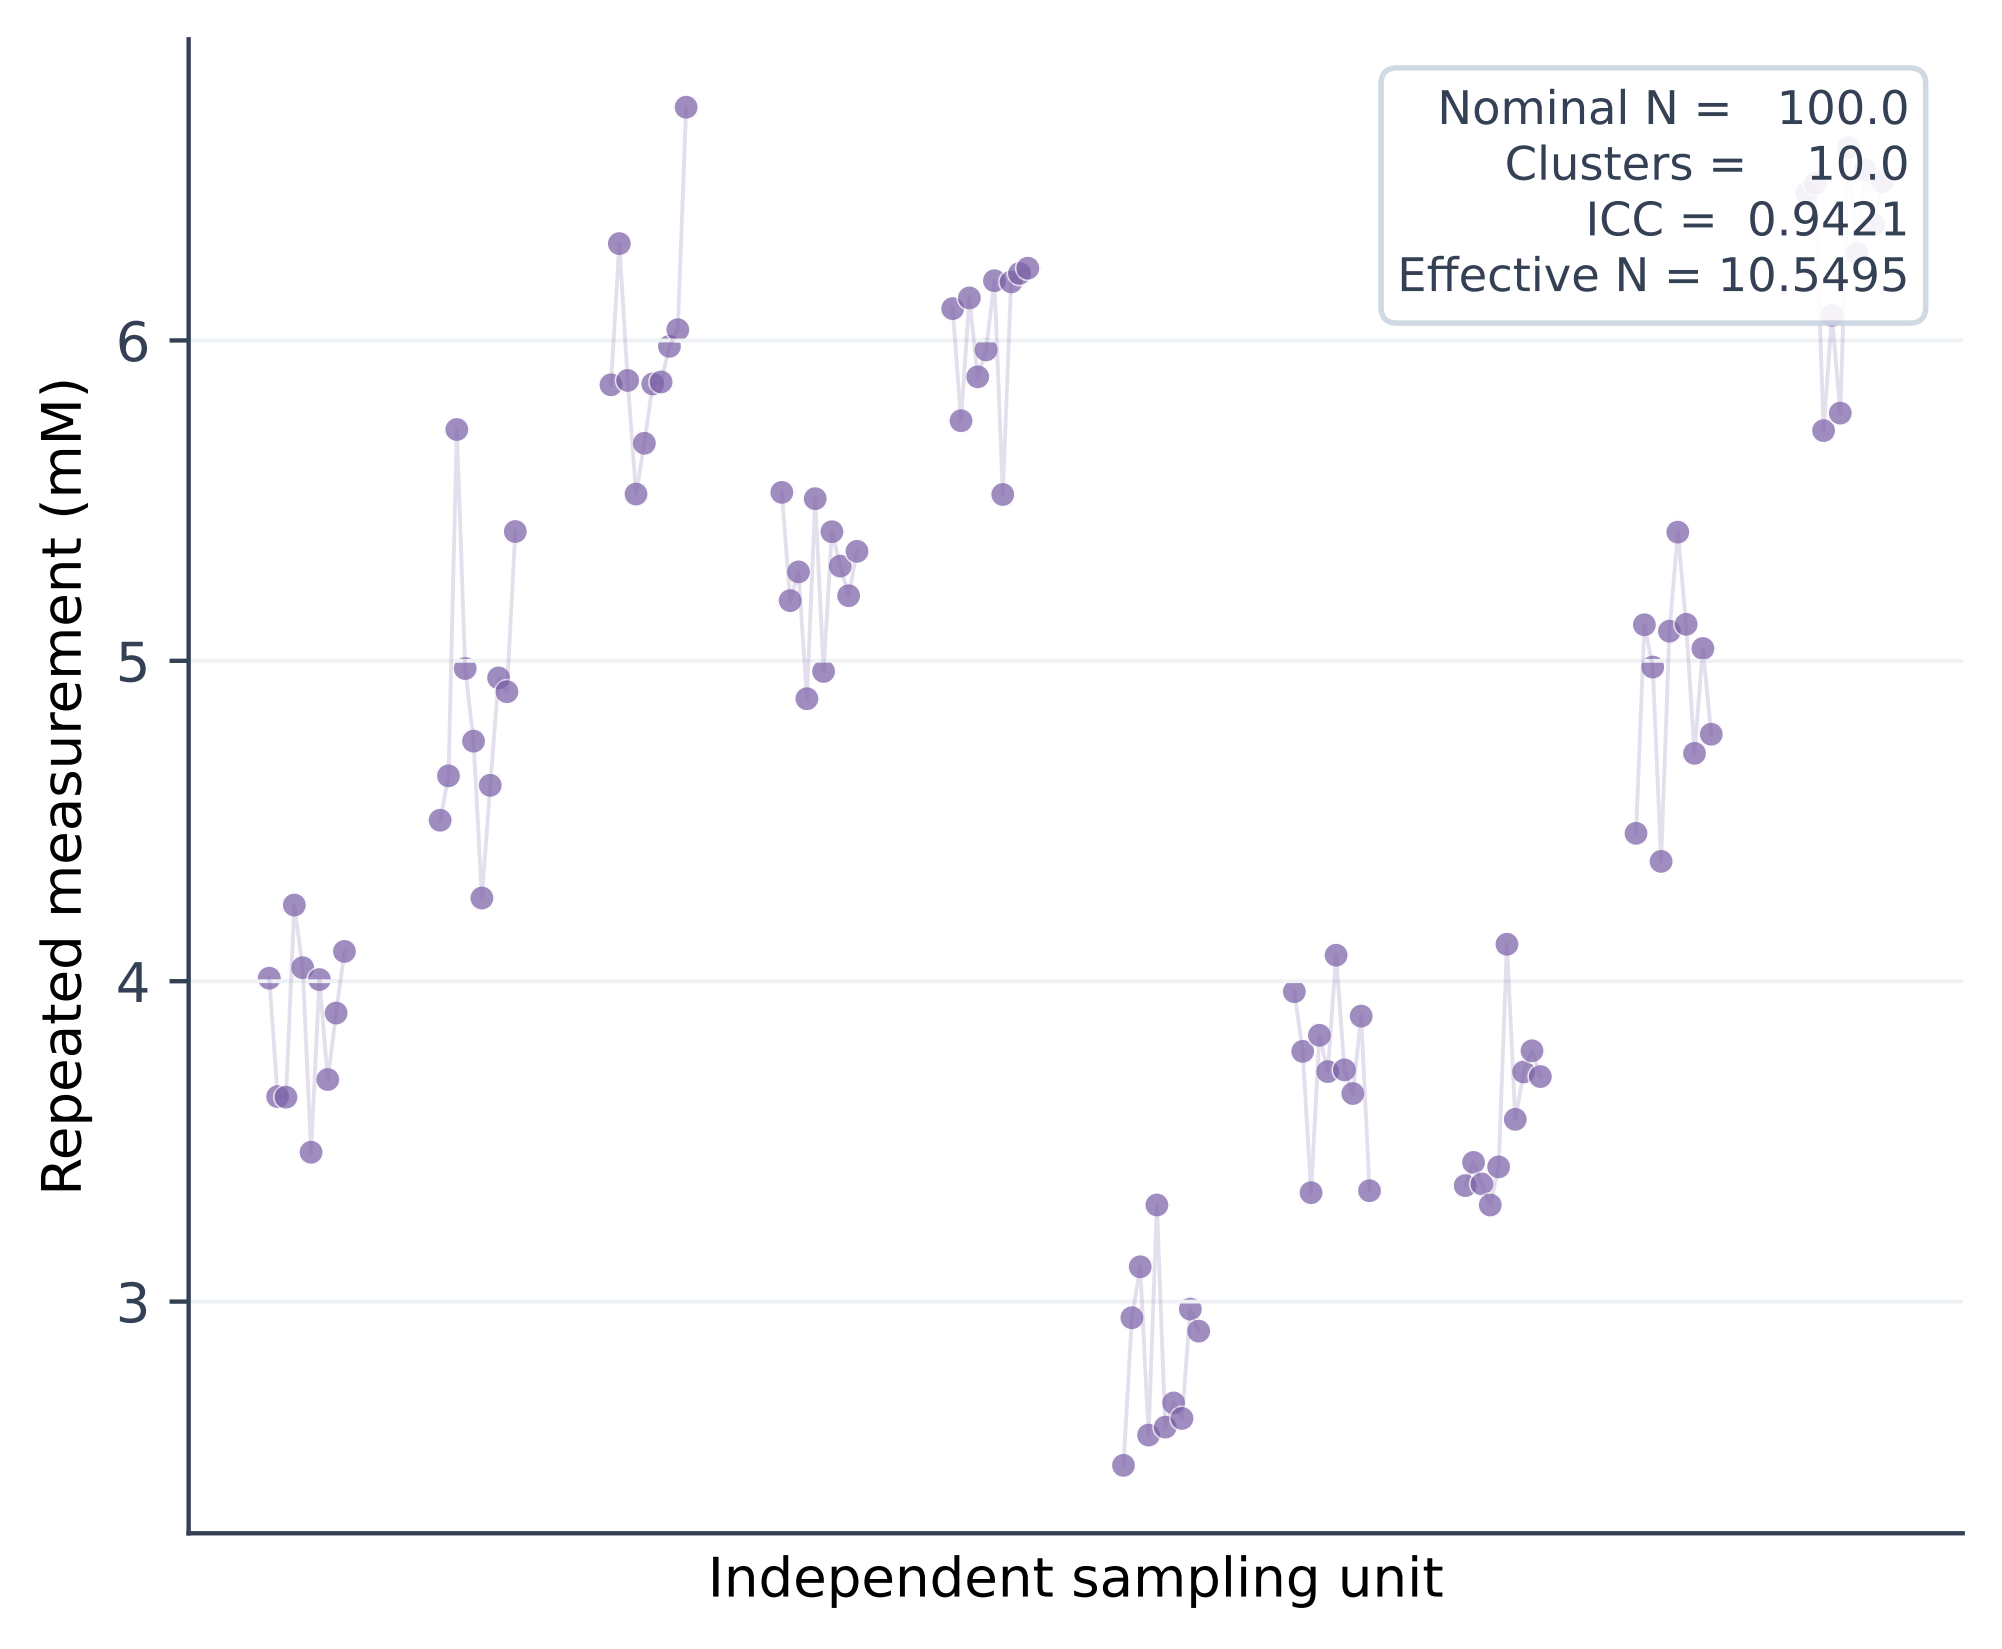
Nominal N = 100.0
Clusters = 10.0
ICC = 0.9421
Effective N = 10.5495
Repeated measurement (mM)
6
5
4
3
Independent sampling unit