



**Verified Carbon
Standard**

SOLITUDE 16 MW SOLAR PV

Document Prepared by AERA Group

On behalf of

Voltas Yellow Ltd

Project Title	Solitude 16 MW solar PV
Version	1.2
Date of Issue	08-September-2020
Prepared By	AERA Group
Contact	28 Cours Albert 1er, 75008 Paris, France Ph +33 1 42 18 02 02 / Fax +33 1 43 25 80 06 contact@aera-group.fr , www.aera-group.fr

CONTENTS

1	PROJECT DETAILS.....	4
1.1	Summary Description of the Project	4
1.2	Sectoral Scope and Project Type	4
1.3	Project Eligibility	4
1.4	Project Design	4
1.5	Project Proponent	5
1.6	Other Entities Involved in the Project	5
1.7	Ownership.....	5
1.8	Project Start Date	5
1.9	Project Crediting Period	5
1.10	Project Scale and Estimated GHG Emission Reductions or Removals	5
1.11	Description of the Project Activity	6
1.12	Project Location	8
1.13	Conditions Prior to Project Initiation	9
1.14	Compliance with Laws, Statutes and Other Regulatory Frameworks	9
1.15	Participation under Other GHG Programs	11
1.16	Other Forms of Credit.....	11
1.17	Additional Information Relevant to the Project	11
2	SAFEGUARDS	13
2.1	No Net Harm	13
2.2	Local Stakeholder Consultation	13
2.3	Environmental Impact	13
2.4	Public Comments	13
2.5	AFOLU-Specific Safeguards	13
3	APPLICATION OF METHODOLOGY.....	13
3.1	Title and Reference of Methodology	14
3.2	Applicability of Methodology	14
3.3	Project Boundary	14
3.4	Baseline Scenario	14
3.5	Additionality	14

3.6	Methodology Deviations	14
4	ESTIMATED GHG EMISSION REDUCTIONS AND REMOVALS.....	14
4.1	Baseline Emissions	14
4.2	Project Emissions	14
4.3	Leakage.....	14
4.4	Estimated Net GHG Emission Reductions and Removals.....	14
5	MONITORING	16
5.1	Data and Parameters Available at Validation	16
5.2	Data and Parameters Monitored.....	16
5.3	Monitoring Plan.....	16
6	ACHIEVED GHG EMISSION REDUCTIONS AND REMOVALS	16
6.1	Data and Parameters Monitored.....	16
6.2	Baseline Emissions	17
6.3	Project Emissions	18
6.4	Leakage.....	18
6.5	Net GHG Emission Reductions and Removals.....	18

1 PROJECT DETAILS

1.1 Summary Description of the Project

Solitude 16 MW solar PV (“the project”) consists of the construction and operation of a greenfield 16.328 MW_{DC} solar photovoltaic power plant in Solitude near the village of Triolet in the north of Mauritius, in the district of Pamplemousses. It involves the setting up of photovoltaic (PV) panels which will capture solar energy and convey such energy to the convertor station in order to produce electricity exported to the national grid. Electricity in Mauritius is mainly generated from coal and heavy fuel oil¹, which is the baseline scenario and can also be considered as the scenario prior to the implementation of the project activity leading to considerable greenhouse gas (GHG) emissions. The project activity undertaken by project promoter Voltas Yellow Ltd will therefore substitute grid electricity by clean and renewable energy and cut down GHG emissions.

The project will generate approximately 28,984 tCO₂e emission reductions per year and 202,889 tCO₂e of emission reductions over the 7 years crediting period.

1.2 Sectoral Scope and Project Type

The sectoral scope is Scope 1 – Energy Industries (renewable sources) – ACM0002: Large-scale Consolidated Methodology: Grid-connected electricity generation from renewable sources, Version 20.0.

The project is a renewable energy type and is not a grouped project.

1.3 Project Eligibility

The project is eligible under the scope of the VCS Program version 4.0 because:

- It results in CO₂ emission reductions, one of the six Kyoto Protocol greenhouse gases
- It consists in grid-connected electricity generation using (large scale) solar power plant in a developing country
- It is completing a gap validation to the VCS Program after it was registered under an approved GHG program²

1.4 Project Design

¹ Cf. Statistics Mauritius: Digest of Water and Energy Statistics – 2017. Port Louis.

² evidence of contracting for a VCS gap validation prior to 9 March 2020 is provided.

The project has been designed to include a single installation of an activity.

Eligibility Criteria

N/A

1.5 Project Proponent

Organization name	Voltas Yellow Ltd
Contact person	Pierre Egot
Title	Managing Director
Address	10 Louis Pasteur Street, Port Louis, Mauritius
Telephone	+262(0)693217391
Email	pegot@greenyellow.fr

1.6 Other Entities Involved in the Project

Organization name	AERA Group
Role in the project	Carbon consultant and trader
Contact person	Alexandre Dunod
Title	Chief Operating Officer
Address	28 Cours Albert 1er, 75008 Paris, France
Telephone	+33 1 42 18 02 02
Email	a.dunod@aera-group.fr

1.7 Ownership

Voltas Yellow Ltd has gained project ownership through a production license and power purchase agreement with Mauritius public utility, CEB, dated December 16th 2016.

1.8 Project Start Date

19-December 2018, as the date of commissioning, synchronization and start of GHG emission reductions.

1.9 Project Crediting Period

The project crediting period started on 19-December 2018 and lasts 7 years, until 18-December 2025.

1.10 Project Scale and Estimated GHG Emission Reductions or Removals

Project Scale

Project	x
Large project	

Year	Estimated GHG emission reductions or removals (tCO ₂ e)
2018 (from December 19 th)	1 053
2019	29 582
2020	29 380
2021	29 179
2022	28 978
2023	28 777
2024	28 576
2025 (until December 18 th)	27 364
Total estimated ERs	202 889
Total number of crediting years	7
Average annual ERs	28 984

1.11 Description of the Project Activity

The proposed project consists of setting-up an amount of 59 376 solar PV modules with an installed capacity of 16.328 MW to produce electricity which is exported to the grid of the Central Electricity Board (CEB). The CEB in consequence will have to produce less electricity from coal or heavy fuel oil, which are non-renewable sources of energy. The energy production strategy implies a substantial reduction in the production of carbon and its release in the atmosphere, thereby reducing the associated greenhouse impact upon the atmosphere.

The project will transfer solar PV technology, methods and skills to Mauritius and demonstrate its applicability and efficiency, thus widening its accessibility. The technology is manufactured by China

Sunergy Co., Ltd. The technology for large scale solar PV power generation is still at starting stage of consideration in the country.

The PV modules installed are new and of make CSUN275-60P from the above-mentioned company. They are of high-efficiency, poly-crystalline silicon solar cells with good temperature coefficient enabling higher output in high temperature regions, which results in module efficiency of up to 16.94%. According to the manufacturer's warranty, the average annual power output degradation of the module shall not exceed 0.68% per year throughout the 25-years linear power output warranty, i.e. implying a life expectancy for at least this duration.³ For the Balance of System components, including inverters, average lifetime is estimated at 10-15 years.⁴

Based on an annual global solar radiation of 2196,1 kWh/m² in the project area⁵ and the specifications of the solar PV system, base year net output is 29.835 GWh (resulting in an average of 29,130 MWh/y over the 7-year crediting period) as provided to banks and/or equity financiers in the financial model, corresponding to a plant load factor of 19.99%. The difference can be attributed to, among others, inverter losses, temperature losses, shadings, cables, weak radiation, and dust.

In the solar photovoltaic power plant, 24 modules are connected per string of 6.6 kW output power and connected to inverters & transformers' shelter boxes (PTR1, PTR2 & PTR4 housing 3 inverters each, while PTR3 only features 2). The solar facility thus consists of 11 Inverter Units, of make INGTEAM, and 4 transformers of 440/22 kV as per below specifications.

Table 1: Characteristics of Solar PV Modules⁶

Manufacturer	China Sunergy Co., Ltd
Model	CSUN275-60P
Quantity	59 376
Peak Power (W)	275 W
Type of cells	Poly-crystalline 156×156mm (6 inch)
Rated voltage (V _{mpp}) (V)	31.3
Rated current (I _{mpp}) (A)	9.27
Efficiency (%)	16.94
Dimensions (mm)	1640×990×35

The figure below provides an overview of the full solar PV system. The engineering, procurement and construction contractor for the project is Green Yellow, a shareholder in VOLTAS ECO-BIOTECH LTD, which owns 100% in Voltas Yellow Ltd. All installed technologies, systems and equipment are new.


³ <http://www.csun-solar.com/products-warranty-insurance.html>

⁴ cf. Mason et al. 2006: Energy Pay-Back and Life Cycle CO₂ Emissions of the BOS in an Optimized 3.5 MW PV Installation in: Progress in Photovoltaics Research and Applications, 14:179-190.

⁵ Reuniwatt forecasts, derived from MeteoSat7 9-y historical data

⁶ as per CSUN275-60P_Solar_Module_4BB5BB_4035_.pdf

Figure 1: Solar PV System - From PV modules to grid connection

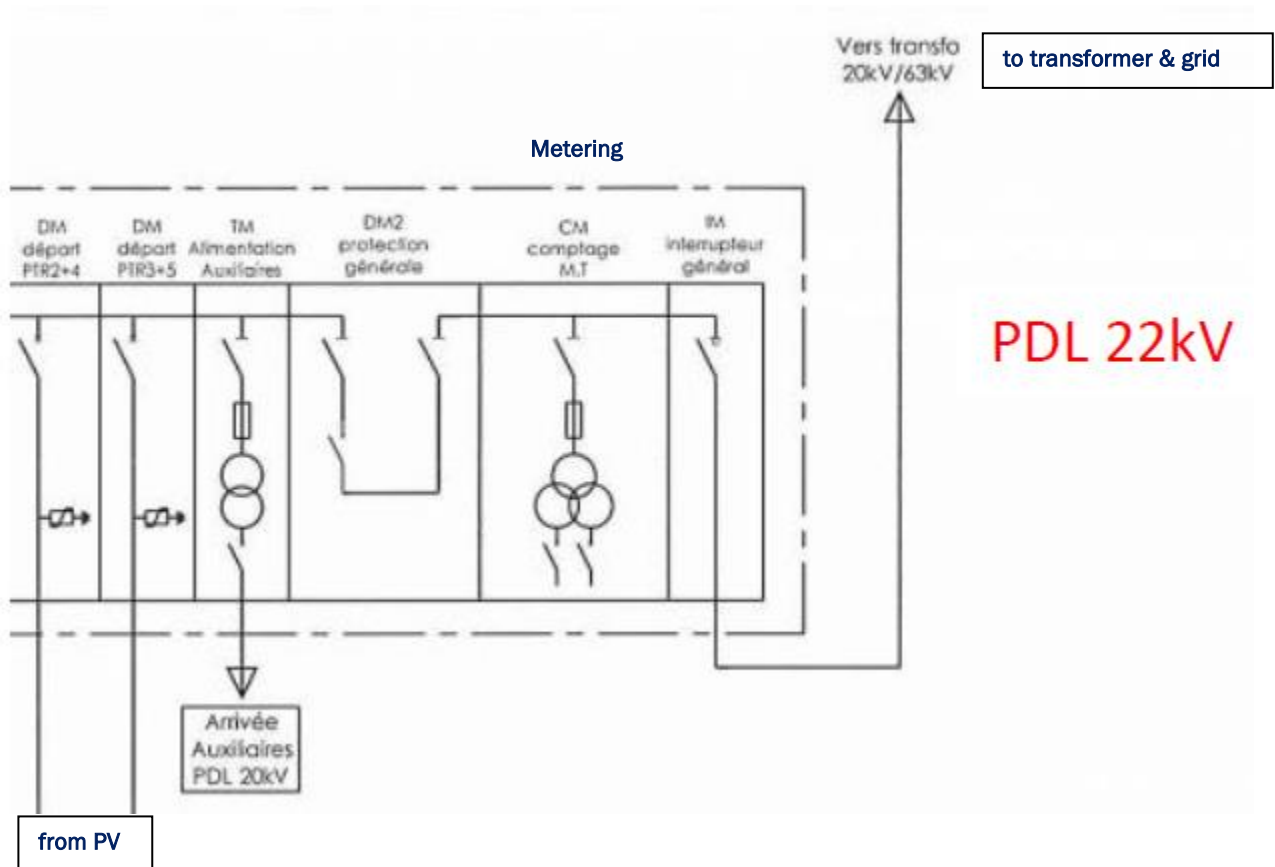

A 5km 22KV line will connect the PV plant to the substation at Riche Terre. The substation (22/66KV) is the delivery and metering point, including protections and control equipment, then conveying electricity to a 14MVA ABB transformer to rise power to 22/66KV.

The monitoring equipment is composed of two class 0.2 meters for import/export, one of which is used for back-up, located at CEB sub-station.

1.12 Project Location


Host Party: Mauritius

Region/State/Province: District of Pamplemousses

City/Town/Community: The site is located in Solitude, which is near the village Triolet.

The project geo-coordinates are: Latitude: 20° 04'44"S; Longitude: 57° 32'30" E

Figure 2: Localisation of project site

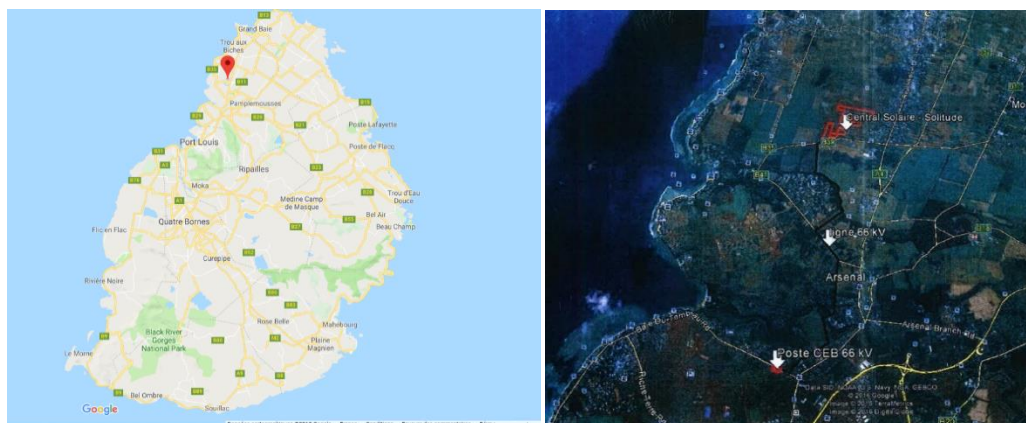

1.13 Conditions Prior to Project Initiation

According to ACM0002 Version 20.0 and since the project activity is the installation of a new grid-connected renewable power plant (Greenfield) the baseline scenario is the following:

“Electricity delivered to the grid by the project activity would have otherwise been generated by the operation of grid-connected power plants and by the addition of new generation sources, as reflected in the combined margin (CM) calculations described in the “Tool to calculate the emission factor for an electricity system.”

Baseline emissions include only CO₂ emissions from electricity generation in fossil fuel fired power plants that are displaced due to the project activity. The methodology assumes that all project electricity generation above baseline levels would have been generated by existing grid-connected power plants and the addition of new grid-connected power plants.

1.14 Compliance with Laws, Statutes and Other Regulatory Frameworks

To date, there are no regulations and policies preventing the implementation of the project activity. The setting up of a solar power plant project to produce electricity in Mauritius is subject to the following laws:

Electricity Act 1939:

The subsequently amended Act deals with the supply of electricity to public and private bodies. By virtue of section 3, this Act applies to any person or bodies for the general supply of electricity.⁷

Section 4 of the Act provides for the application of permits for the supply of electricity in bulk to the CEB. Section 5, 6, 7, 8, 9, deal with the issue of permits and objections by those who are affected.

⁷ For small-scale distributed generation up to 2 MW, a “grid code” has been established by the CEB.

According to Section 4 of the Act, the private operator of a solar farm shall request from the contracting authority a bulk supply permit, under the following premises:

- (1) Undertakers wishing to establish undertakings for the supply of electricity for public and private purposes and for the supply of electricity in bulk shall first apply to the Board for a permit to act as undertaker.
- (2) The application shall contain a description of the proposed area of supply and such other information as the Board may require.

Today, the CEB is practically the single purchaser of electricity in Mauritius. It is allowed to purchase electricity from bulk supply licensees. An Energy Supply and Purchase Agreement (ESPA) has been signed between the project promoter and the CEB on 16 December 2016.

Environment Protection Act (EPA) 2002:

The Act promoted in 2002 and amended in 2008 deals with the protection of environment in Mauritius. It outlines the processes for Environment Impact Assessment (EIA) (part IV)⁸ and Preliminary Environment Report (PER) where and when necessary.

An EIA was required for the solar power plant as a “Power Generating Plant”, and it was conducted in line with the ESPA requirements. An Environmental Impact Assessment license has been obtained on September 5th, 2017 from the Ministry of the Environment and Sustainable Development for the setting-up and operation of the solar PV farm.

Town and Country Planning Act 1990:

This Act regulates the issuance of permits related to any building or erection operations, and the making of access roads, water works, electrical installations, and any road works preliminary or incidental to the erection of buildings. It is under this Act that planning areas are declared, and development permits are granted.

Following the submission of the EIA the project promoter secured a Building and Land Use Permit from Pamplemousses District Council under whose jurisdiction falls the control of immovable property development in the region of Solitude.

The project activity is in line with different existing national strategies and plans:

- Mauritius - Long-Term Energy Strategy 2009-2025: The strategy framework covers all sectors, including electricity generation, transportation, petroleum products, renewable energy and energy efficiency. It aims to achieve by 2025 about 35% self-sufficiency in terms of electricity supply through the use of renewable sources of energy. To achieve this objective, the government has determined grid-connected photovoltaics for electricity generation as one of the viable components that would enter into a renewable energy mix. Accordingly, the “Long

⁸ Procedures for the application of an EIA are defined in section 18 of the Act.

Term Energy Strategy 2009-2025” establishes targets for PV electricity generation at 1% by 2015, and 2% by 2025.⁹

- Maurice Ile Durable (MID) Strategy and Objectives: The MID process involves a participatory approach towards elaborating a national strategy for sustainable development. The original objective of MID has been to create a long-term vision for the country and reduce the country’s dependency on fossil fuels through the promotion of renewable energy, energy saving and energy efficiency. Today, it also encompasses social, economic and environmental issues. The Ministry of Environment and Sustainable Development is currently in the process of having a proper framework in place to translate the MID Vision into a concrete policy, a ten year strategy, and an Action Plan with particular focus on the following five thematic areas: Energy, Environment, Employment, Education and Equity.¹⁰
- Mauritius Vision 2030: The government’s energy policy encourages the use of renewable and clean energy to reduce the island’s dependence on fossil fuels and decrease greenhouse gas emissions. “Our long term target is to increase the use of renewable sources to 35 percent by 2025,” clarified the Vice Prime Minister and Minister of Energy and Public Utilities. A Mauritius Renewable Energy Agency (MARENA) was established for this purpose in March 2016.

1.15 Participation under Other GHG Programs

1.15.1 Projects Registered (or seeking registration) under Other GHG Program(s)

The project is registered under the Clean Development Mechanism¹¹ (Project #10483) on 31 May 2019, although its GHG emission reduction will either be claimed under the VCS programme or the CDM programme, never both.

1.15.2 Projects Rejected by Other GHG Programs

The project has not been rejected by any other GHG program.

1.16 Other Forms of Credit

1.16.1 Emissions Trading Programs and Other Binding Limits

The project does not reduce GHG emissions from activities that are included in an emissions trading program or any other mechanism that includes GHG allowance trading.

1.16.2 Other Forms of Environmental Credit

The project has neither sought nor received another form of GHG-related environmental credits.

⁹ <http://www.sids2014.org/content/documents/68Energy%20Strategy.pdf>

¹⁰ <http://mid.govmu.org/portal/sites/mid/index.html>

¹¹ <https://cdm.unfccc.int/Projects/DB/RWTUV1557984446.68/view>

1.17 Additional Information Relevant to the Project

Leakage Management

As per approved methodology ACM0002 (Version 20.0), no leakage is considered for the proposed project.

Commercially Sensitive Information

There is no information deemed as commercially sensitive for this project activity.

Sustainable Development

The project participants are confident that the proposed project activity will make significant impact on Mauritius sustainable development.

Greenhouse Gas emissions reduction

The project will generate electricity from a renewable and clean energy source, thus avoiding the dispatch of the same amount of electricity produced by fossil-fuelled power plants to Mauritius grid.

Besides, the SO_x emissions from coal-fired power plants would also be reduced.

Development of renewable energy

The project will promote and stimulate the commercialisation of grid-connected renewable energy technologies in Mauritius, in line with the Government's renewable energy policy. Adopted in 2011, the vision of Maurice Ile Durable (MID) targets a 35% share of total energy needs to be fulfilled with renewable energies by 2025.¹²

Energy security

The project will improve energy self-sufficiency of the country which is currently heavily reliant on imported fossil fuels (above 85% according to the governmental Digest of Energy and Water statistics (Ministry of Finance and Economic Empowerment, 2017), alleviating the associated risks of price variations.

Employment opportunities

The project will contribute to the local employment throughout its building and operation phases, creating opportunities for local construction workers (approx. 175 persons) and operation and

¹² <https://sustainabledevelopment.un.org/content/documents/4074durable.pdf>

maintenance technicians (10 to 15). It will also induce indirect employment by increasing the competitiveness of local industry from reducing the country's dependency on fossil fuels.

Therefore, Mauritius Government is supportive of the project because the development of solar PV power is in accordance with the national criteria for sustainable development and national policies relating to energy resources and the environment, which will push forward the use of renewable and clean energy across the country.

Technology transfer

This type of renewable energy project will assist building capacities in the country, through advanced technology transfer from industrialized countries. The project will introduce solar PV technology, methods and skills in Mauritius and demonstrate its applicability and efficiency, thus widening its accessibility. The solar panels are manufactured by China Sunergy Co., Ltd., a leading manufacturer of solar cells and modules and closely affiliated with the renowned China Electric Equipment Group (CEEG).

Further Information

The project participants obtained all necessary clearances; hence no legislative, economic, sectoral, social, environmental, geographic, site-specific risks are anticipated which may have impact on the eligibility of the project activity and the net GHG emission reductions.

2 SAFEGUARDS

2.1 No Net Harm

Not applicable (see registered CDM-PDD)

2.2 Local Stakeholder Consultation

Not applicable (see registered CDM-PDD)

2.3 Environmental Impact

Not applicable (see registered CDM-PDD)

2.4 Public Comments

The project was open for public comment from 08/09/2020 to 08/10/2020. No comment received.

2.5 AFOLU-Specific Safeguards

Not applicable (see registered CDM-PDD)

3 APPLICATION OF METHODOLOGY

3.1 Title and Reference of Methodology

Not applicable (see registered CDM-PDD)

3.2 Applicability of Methodology

Not applicable (see registered CDM-PDD)

3.3 Project Boundary

Not applicable (see registered CDM-PDD)

3.4 Baseline Scenario

Not applicable (see registered CDM-PDD)

3.5 Additionality

Not applicable (see registered CDM-PDD)

3.6 Methodology Deviations

No methodology deviations were applied

4 ESTIMATED GHG EMISSION REDUCTIONS AND REMOVALS

4.1 Baseline Emissions

Not applicable (see registered CDM-PDD)

4.2 Project Emissions

Not applicable (see registered CDM-PDD)

4.3 Leakage

Not applicable (see registered CDM-PDD)

4.4 Estimated Net GHG Emission Reductions and Removals

According to the approved methodology ACM0002 ver.20.0, emission reductions are calculated as follows:

$$ER_y = BE_y - PE_y$$

Where:

ER_y = Emission reductions in year y (t CO₂e)

BE_y = Baseline emissions in year y (t CO₂)

PE_y = Project emissions in year y (t CO₂e)

Table 8: Calculation of emission reductions

	Value/Result	Source/reference
Total installed capacity	16.328 MW	Project documents
Net electricity delivered to the grid ($EG_{PJ,y}$)	29,233 MWh/yr	Project documents (nominal average) [$EG_{PJ,y} = EG_{facility,y}$]
Grid emission factor ($EF_{grid,CM,y}$)	0.9915 tCO ₂ e/MWh	CDM-PDD Section B.6
Baseline emissions (BE_y)	28,984 tCO ₂ e	CDM-PDD Section 3.1 $BE_y = EG_{PJ,y} \cdot EF_{grid,CM,y}$
Project emissions (PE_y)	0 tCO ₂ e	CDM-PDD Section 3.2
Emission reductions (ER_y)	28,984 tCO ₂ e	$ER_y = BE_y - PE_y$

Table 9: Summary of emission reductions

Year	Estimated baseline emissions or removals (tCO ₂ e)	Estimated project emissions or removals (tCO ₂ e)	Estimated leakage emissions (tCO ₂ e)	Estimated net GHG emission reductions or removals (tCO ₂ e)
19/12/2018 - 31/12/2018	1 053	-	-	1 053
01/01/2019 - 31/12/2019	29 582	-	-	29 582
01/01/2020 - 31/12/2020	29 380	-	-	29 380
01/01/2021 - 31/12/2021	29 179	-	-	29 179

01/01/2022 - 31/12/2022	28 978	-	-	28 978
01/01/2023 - 31/12/2023	28 777	-	-	28 777
01/01/2024 - 31/12/2024	28 576	-	-	28 576
01/01/2025 - 18/12/2025	27 364	-	-	27 364
Total	202 889	-	-	202 889

5 MONITORING

5.1 Data and Parameters Available at Validation

Not applicable (see registered CDM-PDD)

5.2 Data and Parameters Monitored

Not applicable (see registered CDM-PDD)

5.3 Monitoring Plan

Not applicable (see registered CDM-PDD)

6 ACHIEVED GHG EMISSION REDUCTIONS AND REMOVALS

6.1 Data and Parameters Monitored

Data / Parameter	EG _{facility,y}			
Data unit	MWh/yr			
Description	Quantity of net electricity generation supplied by the project plant/unit to the grid in year y			
Value applied:	2018	2019	2020	Total
	885	21 251	7 800	29 936

Comments	Electricity outputs will be electronically recorded, stored and invoiced monthly by Voltas Yellow Ltd to CEB, after reconciliation with Voltas Yellow Ltd's meter(s), whose readings are recorded on a record sheet by the Operation and Maintenance Department under the Project Director's authority. Bidirectional electricity meters at CEB substation. The CEB Meters measure the net electrical energy delivered to CEB by Voltas Yellow Ltd (deducing auxiliary consumption) with the following specifications: EDMI Mk6E Genius Accuracy class: 0.2S ($\pm 0.02\%$) Serial # 16538506 & 16538507
----------	--

6.2 Baseline Emissions

The monitoring period for which GHG emission reductions were achieved spans 19/12/2018 to 30/04/2020. Baseline emissions are calculated according to §4.1 methodological approach as the product of (i) the quantity of net electricity generation that is produced and fed into the grid as a result of the implementation of the project activity in year y ($EG_{\text{facility},y}$ = Exports – Imports, in MWh/yr) and (ii) the combined margin CO_2 emission factor for grid connected power generation in year y ($EF_{\text{grid},\text{CM},y}$):

$$BE_y = EG_{PJ,y} \times EF_{\text{grid},\text{CM},y}$$

Where:

BE_y	Baseline emissions in year y (t CO_2 /yr)
$EG_{PJ,y}$	Quantity of net electricity generation that is produced and fed into the grid as a result of the implementation of the project activity in year y (MWh/yr)
$EF_{\text{grid},\text{CM},y}$	Combined margin CO_2 emission factor for grid connected power generation in year y calculated using the latest version of the "Tool to calculate the emission factor for an electricity system" (t CO_2 /MWh)

$EG_{PJ,y} = EG_{\text{facility},y}$ i.e. the quantity of net electricity generation supplied by the project plant to the grid, as monitored and displayed below on a monthly basis.

$EF_{\text{grid},\text{CM},y} = 0.9915$ t CO_2 /MWh, as the Project Proponent have calculated, the DOE validated and the CDM-EB registered.

Year	BE_y	$EF_{\text{grid},\text{CM},y}$	$EG_{\text{facility},y}$	Imports	Exports
	t CO_2	t CO_2 /MWh	MWh	kWh	kWh
December 18	878	0.9915	885	8 542	893 983
January 19	2 149	0.9915	2 167	9 659	2 177 057
February 19	1 837	0.9915	1 853	8 973	1 861 920
March 19	2 147	0.9915	2 165	10 248	2 175 547

April 19	1 268	0.9915	1 279	7 804	1 286 544
May 20	1 287	0.9915	1 298	8 179	1 306 444
June 19	1 434	0.9915	1 446	10 643	1 456 929
July 19	1 269	0.9915	1 280	7 715	1 287 882
August 19	1 456	0.9915	1 469	7 671	1 476 634
September 19	1 843	0.9915	1 859	9 488	1 868 546
October 19	2 080	0.9915	2 098	9 486	2 107 728
November 19	2 057	0.9915	2 074	9 394	2 083 698
December 19	2 242	0.9915	2 261	9 183	2 270 445
January 20	1 864	0.9915	1 880	8 515	1 888 796
February 20	2 234	0.9915	2 253	7 927	2 261 175
March 20	1 730	0.9915	1 745	9 347	1 753 865
April 20	1 905	0.9915	1 922	9 016	1 930 648
TOTAL	29 681		29 936		

6.3 Project Emissions

No project emissions are expected as the project activity only involves renewable electricity generation from the solar power plant. Hence according to ACM0002 guidelines $PE_y = 0$.

6.4 Leakage

As stated in the applicable methodology, no leakage emissions are considered, therefore $LE_y = 0$.

6.5 Net GHG Emission Reductions and Removals

Year	Baseline emissions or removals (tCO ₂ e)	Project emissions or removals (tCO ₂ e)	Leakage emissions (tCO ₂ e)	Net GHG emission reductions or removals (tCO ₂ e)
2018	878	-	-	878
2019	21 070	-	-	21 070
2020	7 733	-	-	7 733
Total	29 681	-	-	29 681

