



BLITTA – TOGO SOLAR POWER PLANT

Document Prepared by ELEMENT 6 – FZCO

ON BEHALF OF CLIMATEPARTNER GmbH



Project title	BLITTA – TOGO SOLAR POWER PLANT
Project ID	3298
Monitoring period	01-January-2023 to 31-December-2023 (including both dates)
Original date of issue	21-June-2024
Most recent date of issue	07-November-2024
Version	4
VCS Standard Version	4.7
Prepared by	Ashwini Sachindran ELEMENT 6 - FZCO

CONTENTS

PROJECT DETAILS.....	4
1.1 Summary Description of the Implementation Status of the Project	4
1.2 Audit History.....	4
1.3 Sectoral Scope and Project Type	5
1.4 Project Proponent	5
1.5 Other Entities Involved in the Project	5
1.6 Project Start Date	6
1.7 Project Crediting Period	6
1.8 Project Location	6
1.9 Title and Reference of Methodology	7
1.10 Double Counting and Participation under Other GHG Programs	7
1.11 Double Claiming, Other Forms of Credit, and Scope 3 Emissions	7
1.12 Sustainable Development Contributions	8
1.13 Commercially Sensitive Information.....	13
2 SAFEGUARDS AND STAKEHOLDER ENGAGEMENT.....	13
2.1 Stakeholder Engagement and Consultation	13
2.2 Risks to Stakeholders and the Environment	16
2.3 Respect for Human Rights and Equity	18
2.4 Ecosystem Health	21
3 IMPLEMENTATION STATUS.....	22
3.1 Implementation Status of the Project Activity	22
3.2 Deviations	23
3.3 Grouped Projects	23
3.4 Baseline Reassessment.....	23
4 DATA AND PARAMETERS	23
4.1 Data and Parameters Available at Validation.....	23
4.2 Data and Parameters Monitored	23
4.3 Monitoring Plan.....	25
5 QUANTIFICATION OF GHG EMISSION REDUCTIONS AND REMOVALS.....	33
5.1 Baseline Emissions.....	33
5.2 Project Emissions	34

5.3	Leakage Emissions	34
5.4	GHG Emission Reductions and Carbon Dioxide Removals	35
APPENDIX 1: COMMERCIAL SENSITIVE INFORMATION		36
APPENDIX 2: SDG CONTRIBUTIONS		37
APPENDIX 3: STAKEHOLDER ENGAGEMENT		42
APPENDIX 4: SINGLE LINE DIAGRAM		42
APPENDIX 5: CALIBRATION		44

PROJECT DETAILS

1.1 Summary Description of the Implementation Status of the Project

The Blitta - Togo solar PV plant is one of the largest in West Africa and the first renewable energy facility in the country^{1,2}. This plant, which is located in Blitta, supplies reliable, clean electricity to the national grid which then supplies to hundreds of thousands of homes and businesses in the country and save more than one million tonnes of CO₂ emissions through its lifetime.

The current capacity of the plant is 70 MW. The commissioning date of Phase 1 with 50 MW was on 12-June-2021 while the commissioning date of Phase 2 with the expansion of 20 MW was on 05-February-2024.

Located within the Blitta-Losso village, part of the Blitta canton, the project benefits from favorable solar radiation conditions, with an average monthly direct normal radiation of 5.14 kWh/m²/day and an annual solar irradiation of 1,876 kWh/m². Positioned at coordinates 8° 21' 52.33"N, 1° 1' 4.42"E, the initiative strongly supports Togo's clean energy strategy, aiming to achieve a 50% renewable electrification share by 2025 and full transition by 2030.

The current monitoring period is from 01-January-2023 to 31-December-2023 (including both dates). The project generated 77,751.00 MWh of electricity for the current monitoring period. The total GHG emission reductions or removals generated in this monitoring period are 44,551 tCO_{2e}. The project activity, which has a lifetime of 25 years, produced an average of 6,481.26 MWh/month of electricity for the given monitoring period.

1.2 Audit History

Audit type	Period	Program	Validation/verification body name	Number of years
Validation	12-April-2023	VCS	LGAI TECHNOLOGICAL CENTER, S.A. (APPLUS+)	N/A
Verification	12-June-2021 to 31-December-2022 (including both dates)	VCS	LGAI TECHNOLOGICAL CENTER, S.A. (APPLUS+)	1.5
Verification	01-January-2023 to 31-December-2023 (including both dates)	VCS	SUSTAINCERT S.A.	1

¹ <https://www.irena.org/newsroom/pressreleases/2021/Jun/Togo-Inaugurates-50MW-Solar-Plant-Financed-Under-IRENA-ADFD-Facility>

² <https://www.mofaic.gov.ae/en/mediahub/news/2021/6/24/24-06-2021-uae-togo>

1.3 Sectoral Scope and Project Type

Sectoral scope ³	Energy industries (renewable -/non-renewable sources)
Project activity type	Renewable energy projects (Large Scale)

1.4 Project Proponent

Organization name	AMEA SOLAR TOGO SAU
Contact person	Basma Bentaher
Title	Senior Director – Project Development
Address	Marina Plaza Offices 3301/3302/3303 Level 33 Dubai Marina PO Box 37669 Dubai United Arab Emirates
Telephone	+971 4 310 7014
Email	Basma.Bentaher@ameapower.com

Organization name	ClimatePartner GmbH
Contact person	Dr. Sascha Lafeld
Title	Head of Carbon Offsets and Green Energy Services
Address	St.-Martin-Str. 59, D-81669 Munich, Germany
Telephone	+49 89 1222 8750
Email	sascha.lafeld@climatepartner.com

1.5 Other Entities Involved in the Project

Organization name	Element 6 – FZCO
Role in the project	Consultant
Contact person	Amer Arafat
Title	Partner
Address	Technohub 1, DTEC, Dubai Silicon Oasis, Dubai, UAE
Telephone	+971 52 938 9590

Email	amer@element6.cc
-------	------------------

1.6 Project Start Date

Project start date	12-June-2021
Justification	The project start date is the date on which the project began generating GHG emission reductions.

1.7 Project Crediting Period

Crediting period	☒ Seven years, twice renewable ☐ Ten years, fixed ☐ Other (state the selected crediting period and justify how it conforms with the VCS Program requirements)
Start and end date of first or fixed crediting period	12-June-2021 to 11-June-2028

1.8 Project Location

The plant is located in Blitta, Togo. The village of Blitta-Losso is part of the canton of Blitta village and is surrounded from north to south and from east to west by the villages of Blitta kotokoli, Boufouli Boko Losso, Doufouli and Oranyi. The coordinates of the project location are 8°21'52.33"N, 1°1'4.42"E. Phase 2 of the project is located at the same site as Phase 1. The image below shows the current location of the entire 70 MW plant.

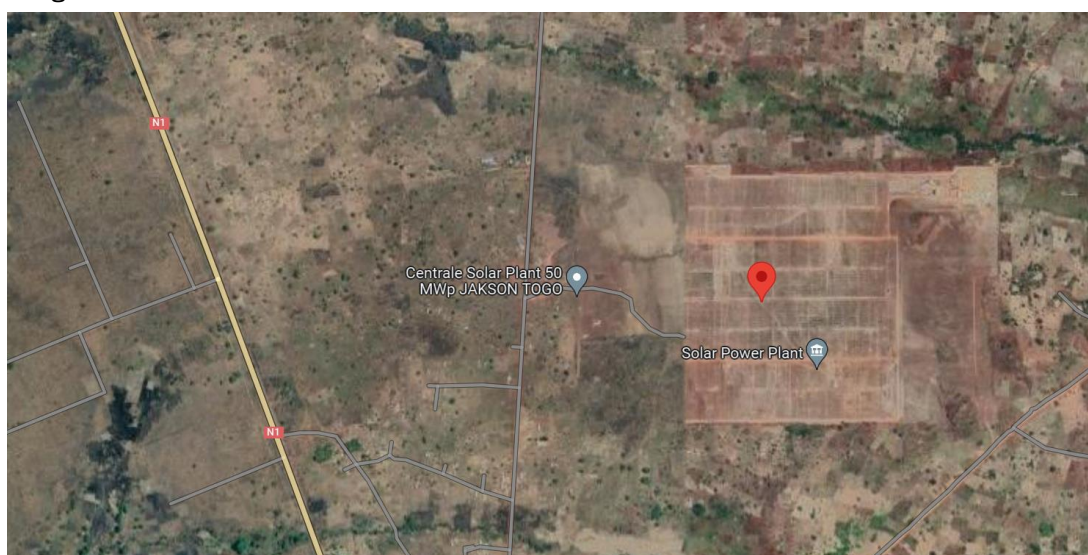


Figure 1 - Site location for the 70MW PV Power Plant

1.9 Title and Reference of Methodology

Type (methodology, tool or module).	Reference ID, if applicable	Title	Version
Methodology	ACM0002	ACM0002: Grid-connected electricity generation from renewable sources	20.0
Tool	TOOL01	TOOL01: Tool for the demonstration and assessment of additionality	7.0.0
Tool	TOOL07	TOOL07: Tool to calculate the emission factor for an electricity system	7.0

1.10 Double Counting and Participation under Other GHG Programs

1.10.1 No Double Issuance

Is the project receiving or seeking credit for reductions and removals from a project activity under another GHG program?

☐ Yes ☒ No

1.10.2 Registration in Other GHG Programs

Was the project registered or seeking registration under any other GHG programs?

☐ Yes ☒ No

1.11 Double Claiming, Other Forms of Credit, and Scope 3 Emissions

1.11.1 No Double Claiming with Emissions Trading Programs or Binding Emission Limits

Are project reductions and removals or project activities also included in an emissions trading program or binding emission limit? See the *VCS Program Definitions* for definitions of emissions trading program and binding emission limit.

☐ Yes ☒ No

1.11.2 No Double Claiming with Other Forms of Environmental Credit

Has the project activity sought, received, or is planning to receive credit from another GHG-related environmental credit system? See the *VCS Program Definitions* for definition of GHG-related environmental credit system.

☐ Yes☒ No

1.11.3 Supply Chain (Scope 3) Emissions

Do the project activities affect the emissions footprint of any product(s) (goods or services) that are part of a supply chain?

☐ Yes☒ No

1.12 Sustainable Development Contributions

AMEA SOLAR TOGO SAU has put in place the following CSR activities across essential sectors during the current monitoring period:

- Maintenance of the clinic in Blitta for curative and preventive service
- Operations and maintenance of primary schools for quality education
- Jobs created for the operation and maintenance of the plant for economic growth
- Provision of electricity and clean energy to the village of Blitta supporting Togo's clean energy strategy, aiming to achieve a 50% renewable electrification share by 2025 and full transition by 2030.
- Reduction of total CO₂ emissions generated.

The evidence of the project's SD contributions is provided in Appendix 2.

Table 1: Sustainable Development Contributions

Row number	SDG Target	SDG Indicator	Net Impact on SDG Indicator	Current Project Contributions	Contributions Over Project Lifetime
1)	3.8	Number of patients visiting the constructed clinic per year	Implemented activities to increase	AMEA SOLAR TOGO SAU built the first clinic in Blitta, and this has improved the standard of living within the village. In the year 2023, the number of patients visiting the amounted to 5,438 medical visits (including 1,201 prenatal consultations). There has also been a total of 219 births (96 boys, 123 girls).	A total of 7,014 patients visited the clinic. Please refer to Appendix 2 for details on patient visits to the clinic.

2)	4.1	Number of students going to primary schools annually	Implemented activities to increase	AMEA SOLAR TOGO SAU has built three (3) primary schools and renovated the four (4) existing primary schools with the necessary equipment and furniture. The number of students going to primary schools annually has increased. EPP BLITTA CENTRAL D (TOMEGBE): 2023: 160 LYCEE BLITTA CARREFOUR: 2023: 309 EPP KOKONADE 2023: 92 EPP KATAKPE 2023: 100 EPP LAMAKAZA B 2023: 217	The number of students attending the primary schools over the project lifetime is 2,787. Please refer to Appendix 2 for details on student admissions to the schools.
----	-----	--	------------------------------------	---	---

3)	7.b	Total clean energy generated from the Blitta Solar Plant. Measured in (MWh/year)	Implemented activities to increase	The project has provided electricity and energy to the village of Blitta which had no access to electricity prior to the plant. The project also feeds energy into the National Grid. It is also the first renewable energy plant in the country. The total clean energy produced in the country has increased since the completion of this project. The project generated 77,751.00 MWh for the current monitoring period.	The project generated 201,606.67 MWh for the project lifetime. The invoices for energy generation for the current monitoring period are attached to this report.
4)	8.1	Number of employees working in the operation and maintenance activities of the plant	Implemented activities to increase	There are currently 13 employees that work in the operations and maintenance of the plant. Seven (7) technicians, one (1) plant manager, one (1) SCADA engineer, one (1) field engineer, one (1) HSE employee, one (1) driver and one (1) housekeeper.	The project created employment for 13 employees that work in the operations and maintenance of the plant. Please refer to the Organization chart in Section 4.3. Based on the above, there will always be 13 people employed in the plant for the entire lifetime of the project.

5)	13.1	Tonnes of greenhouse gas emissions avoided or removed (tCO ₂ e/year)	Implemented activities to increase	The renewable energy plant has prevented the release of 44,551 tCO ₂ e of greenhouse gas emissions for the current monitoring period.	The project prevented the release of 115,520 tCO ₂ e of greenhouse gas emissions into the atmosphere. Please refer to the emission reduction calculation sheet attached with the report for the current monitoring period.
----	------	---	------------------------------------	--	---

1.13 Commercially Sensitive Information

Not applicable, no commercially sensitive information has been excluded from the public version of the monitoring report using Appendix 1.

2 SAFEGUARDS AND STAKEHOLDER ENGAGEMENT

2.1 Stakeholder Engagement and Consultation

2.1.1 Stakeholder Identification

Stakeholder Identification	N/A. The initial stakeholder consultation covered both phases of the 70 MW plant. Since both phases are located in the same area, the stakeholder composition has remained unchanged, and no new stakeholders were identified for the commissioning of phase 2.
Legal or customary tenure/access rights	N/A. There are no legal or customary tenure/access rights to territories and resources, including collective and conflicting rights, held by stakeholders, Indigenous People (IPs), local communities (LCs), and customary rights.
Stakeholder diversity and changes over time	N/A. The stakeholder make-up has not changed since validation, and no new stakeholders were identified at verification.
Expected changes in well-being	The project supplies reliable, clean electricity to the national grid which then supplies to hundreds of thousands of homes and businesses in the country. Additionally, the project achieves many social benefits such as improving social services to targeted social groups and generating job opportunities.
Location of stakeholders	N/A. The stakeholder make-up has not changed since validation, and no new stakeholders were identified at verification.
Location of resources	N/A. The stakeholder make-up has not changed since validation, and no new stakeholders were identified at verification.

2.1.2 Stakeholder Consultation and Ongoing Communication

Ongoing consultation	A grievance mechanism has been put in place for ongoing communication with the stakeholders and the methods to access the grievance mechanism have been disclosed to the local communities. The grievance mechanism is publicized at the site gate, at the Local Community Chief's Offices, and at the Project Company's website.
Date(s) of stakeholder consultation	5-July-2022
Communication of monitored results	The entire process (i.e. how a complaint is received and reviewed, how decisions are made and what possibilities may exist for appeal) is made as transparent as possible by putting it into written form, publicizing it and communicating it to the stakeholders. A grievance mechanism has also been designed based on the appointment of a Community Liaison officer and the methods to access the mechanism have been disclosed to the local communities during the consultations. Communication and awareness raising activities are repeated at regular intervals.
Consultation records	The stakeholder consultation conducted was recorded, and the outcomes of it were included in a local stakeholder consultation report.
Stakeholder input	The entries in the stakeholder engagement log primarily consist of site visits and inspections where no further action was needed, except for one instance where ARSE's technical and legal team conducted an inspection, and the pending points from the visit are still being worked on. These points do not require any design changes to the project. The local stakeholder consultation report includes all questions and feedback received. As the feedback focused on clarification rather than changes, the project design remained unchanged.

2.1.3 Free, Prior, and Informed Consent

Consent	N/A. There are no ongoing or unresolved conflicts over property rights, usage, or resources.
Outcome of FPIC	N/A. The project has not encroached on land, relocated people without consent, and forced physical or economic displacement.

2.1.4 Grievance Redress Procedure

Grievances received	Resolution and outcome
N/A	The methods to access the grievance mechanism have been disclosed to the local communities. The grievance mechanism is publicized at the site gate, at the Local Community Chief's Offices, and at the Project Company's website. All information about grievance procedures and grievance registers kept on site will be in English, but grievances forms can be filled in French. However, since the project-affected communities have no or minimal access to the internet, but the great majority of them have a mobile phone, it's expected that a number of grievances will be received by phone. For such a reason the grievance mechanisms provided a phone number that is made available to the communities. Access to the mechanism is free of cost. No costs nor retribution is associated with lodging a grievance. In addition to the explanation provided verbally, printed materials (e.g., posters) are affixed in prominent areas, providing the key facts about the mechanism and contact information, consisting of a dedicated phone number. Communication and awareness raising activities regarding the Grievance Mechanism are repeated at regular intervals.

2.1.5 Public Comments

Summary of comments received	Actions taken
------------------------------	---------------

N/A

No comments received.

2.2 Risks to Stakeholders and the Environment

2.2.1 Management Experience

A VCS team is designated to be responsible for carrying out the required monitoring tasks for the project activity. Both management people and technical workers are present in the VCS team. All of the team members have passed internal monitoring training.

The management structure consists of 3 levels to guarantee a step-by-step management of the project activity, which casts concrete responsibilities on the appointed person who will be actually in charge of a specific task.

The 3 levels refer to:

1. Solar Plant Manager
2. VCS project manager
3. VCS staff

Before the start of the crediting period, clear roles and responsibilities are assigned to all staff involved in the project activity. A VCS Project Manager is appointed who is responsible for monitoring activities and data management associated with the project activity. All operators involved in the collection of data and records are coordinated by the VCS Manager.

The Monitoring Management and Quality Assurance System is currently being implemented and maintained. In order to qualify local operational staff to carry out required regular tasks professional training is provided, both in class and practical application, to the designated VCS team staff. The regular staff training is provided at least once a year for the duration of the project.

Only trained staff will be members of the VCS team, and only trained VCS staff members will be allowed to perform any tasks related to monitoring activities.

The VCS Manager is permitted to train new staff. By this it will be ensured that operational VCS staff are qualified to carry out the relevant tasks under the Monitoring Management and Quality Assurance System.

AMEA SOLAR TOGO SAU has 3 team members as a part of the Carbon Offsets team. Ignacio Carreras, Sultan Rasoul & Dana Shashaa, that have been involved in projects that generated/continue to generate over 2 million carbon offsets in Egypt, Tunisia, Togo, Djibouti and Burkina Faso. The team has extensive experience in dealing with consultants, VVBs, Local Stakeholders & Authorities, and ESG and CSR teams either internally at AMEA SOLAR TOGO SAU or externally hired for aforementioned projects.

2.2.2 Risk assessment

	Risk identified	Mitigation or preventative measure(s) taken
Natural and human-induced risks to stakeholders' wellbeing	No risk identified	The project does not have a negative impact on stakeholder wellbeing.
Risks to stakeholder participation	No risk identified	It is easily accessible for stakeholders to access the grievance mechanism and methods to access have been disclosed to the local communities. Regular monitoring of the project site and its surroundings ensures immediate intervention in case of incidents. Upon receiving reports, prompt investigations are conducted, and appropriate actions are taken accordingly.
Working conditions	Health and Safety	The organization maintains a robust health and safety program, including regular audits, training initiatives, and grievance mechanisms, ensuring compliance with regulations and promoting a safe and healthy work environment for all employees.
Safety of women and girls	Health and Safety	All women working on site have their own PPE kits. The code of conduct with zero tolerance of any form of discrimination and specifying to address GBVH was made available, while ensuring gender equality (SDG5) as well. Additionally, any grievance with this type of issue will be included within the grievance mechanism.

		Awareness sessions to Women on the GBVH subject were also carried out.
Safety of minority and marginalized groups, including children	No risk identified	There are no marginalized groups, including children working on the site.
Pollutants (air, noise, discharges to water, generation of waste, and release of hazardous materials and chemical pesticides and fertilizers)	No risk identified.	The cleaning of the PV panels is dry cleaning to ensure that dust does not accumulate on the panels reducing its output and at the same time avoids the mixing of water and dust which exacerbates the fouling problem, accordingly the water use in cleaning panels will be minimal. Air pollutants, noise pollutants, and release of hazardous materials and chemical pesticides and fertilizers did not take occur at the project site during the monitoring period. Regular monitoring of project site and surroundings is carried out. Prompt investigation and appropriate action is taken upon receiving any reports. An external consultant has developed a comprehensive waste and wastewater management plan outlining the procedures for effective waste management.

2.3 Respect for Human Rights and Equity

2.3.1 Labor and Work

AMEA SOLAR TOGO SAU is committed to upholding the highest standards of labor practices, adhering strictly to the International Finance Corporation (IFC) and International Labour Organization (ILO) guidelines. In addition to meeting these international standards, AMEA SOLAR TOGO SAU ensures full compliance with all local labor laws in the regions where it operates,

maintaining a strong commitment to ethical employment practices, workers' rights, and safe working conditions globally.

Risks identified ⁴		Mitigation or preventative measure(s) taken
Discrimination	No risk identified	Regular monitoring of workplace behavior and immediate intervention in case of incidents. Prompt investigation and appropriate action taken upon receiving any reports
Sexual harassment	No risk identified	Regular monitoring of workplace behavior and immediate intervention in case of incidents. Prompt investigation and appropriate action taken upon receiving any reports.
Gender equity in labor and work	No risk identified	Regular monitoring of workplace behavior and immediate intervention in case of incidents. Prompt investigation and appropriate action taken upon receiving any reports.
Forced labor	No risk identified	Regular monitoring of workplace behavior and immediate intervention in case of incidents. Prompt investigation and appropriate action taken upon receiving any reports.
Child labor	No risk identified	Regular monitoring of workplace behavior and immediate intervention in case of incidents. Prompt investigation and appropriate action taken upon receiving any reports.
Human trafficking	No risk identified	Regular monitoring of workplace behavior and immediate intervention in case of incidents.

		Prompt investigation and appropriate action taken upon receiving any reports.
--	--	---

2.3.2 Human Rights

Mitigation or preventative measure(s) taken	
Human Rights violation	An Environmental and Social Impact Assessment was conducted which included ensuring that the development process fully respects the human rights of everyone on-site or within the site premises. Additionally, grievance mechanism for reporting and addressing any violations promptly is implemented. There are different management plans prepared such as the ESMS system, implemented during construction along with the employment and procurement management plan, the gender equality and worker grievance mechanism. These are well informed to identify, prevent, track and communicate any Human rights violation.

2.3.3 Indigenous Peoples and Cultural Heritage

Risks identified	Mitigation(s) or preventative measure taken
No risk identified	An Environmental and Social Impact Assessment was conducted which included ensuring that the development process fully respects Indigenous people on-site or within the site premises, as well as cultural considerations.

2.3.4 Property Rights

Risks identified	Mitigation or preventative measure(s) taken
No risk identified	The landowners were appropriately compensated and support the project. As a result of thorough consultations, there have been no identified property rights of

	Indigenous Peoples, Local Communities, or other customary rights holders, nor any legal or customary tenure or access rights to territories, property, or resources, including collective and conflicting rights held by stakeholders.
--	--

2.3.5 Benefit Sharing

N/A, no benefit sharing occurred during the monitoring period.

2.4 Ecosystem Health

Risk identified		Mitigation or preventative measure(s) taken during the monitoring period
Impacts on biodiversity and ecosystems	No risk identified	The project did not have an impact on biodiversity and ecosystems throughout the monitoring period.
Soil degradation and soil erosion	No risk identified	The project did not have an impact on soil degradation or erosion throughout the monitoring period.
Water consumption and stress	No risk identified	The project did not have an impact on water consumption and stress throughout the monitoring period.

2.4.1 Rare, Threatened, and Endangered species

N/A, the project has not adversely impacted rare, threatened, or endangered species during the monitoring period.

Risks identified		Mitigation or preventative measure(s) taken
Habitats for rare, threatened, and endangered species	No risk identified.	No activity was carried out during the monitoring period that will have an adverse impact on habitats for rare, threatened, or endangered species.
Areas for habitat connectivity	No risk identified.	No activity was carried out during the monitoring period that will have an adverse impact on areas needed for habitat connectivity.

2.4.2 Introduction of species

N/A, there was no planting or introduction of species.

2.4.3 Ecosystem conversion

	Risks identified	Mitigation or preventative measure(s) taken
Ecosystem conversion	No risk identified	No ecosystem conversion took place during the monitoring period.

3 IMPLEMENTATION STATUS

3.1 Implementation Status of the Project Activity

The project activity consists of setting up a 70 MW solar PV plant in Blitta-Lasso in Togo, with 50 MW power already installed and an expansion of 20 MW. The commissioning date of Phase 1 was on 12-June-2021 while the commissioning date of Phase 2 was on 05-February-2024.

The technical details for Phase 1 are as follows:

Solar Modules:		
Module Type	JKM390M-72-V	
Maximum Power (Pmax)	390/395/400 Wp	
Module technology	Poly Crystalline	
No. of modules	Module Power	No. of modules
	390 Wp	55,104
	395 Wp	66,528
	400 Wp	5,712
	Total	127,344
Inverters:		
Model	Sungrow SG250HX- 250KTL – H1 String or equivalent	
No. of Inverters	200	
Technical Lifetime of the plant:	25 years	

The project activity is in continuous operation since commissioning and there is no incident reported during the current monitoring period which may impact the operation & capacity design of the project activity. Therefore, no events have happened that may impact the GHG emission reductions or removals and monitoring in this monitoring period.

3.2 Deviations

3.2.1 Methodology Deviations

Not applicable – there were no deviations applied during this monitoring period.

3.2.2 Project Description Deviations

Not applicable – there were no deviations applied during this monitoring period.

3.3 Grouped Projects

Not applicable – this project is not a grouped project.

3.4 Baseline Reassessment

Did the project undergo baseline reassessment during the monitoring period?

☐ Yes ☒ No

4 DATA AND PARAMETERS

4.1 Data and Parameters Available at Validation

Data / Parameter	EF _{grid, CM, y}
Data unit	tCO ₂ /MWh
Description	Combined Margin CO ₂ grid emission factor in the year y
Source of data	Standardized Baseline ASB0034-2021 Version 01.0 ⁵
Value applied	0.573 tCO ₂ /MWh
Justification of choice of data or description of measurement methods and procedures applied	The availability of a Standardized Baseline for the Grid Emission Factor for West African Power Pool Version 01.0
Purpose of data	Calculation of baseline emissions
Comments	This parameter is fixed ex-ante for the entire crediting period

4.2 Data and Parameters Monitored

Data / Parameter	EG _{PJ,y}
Data unit	MWh/yr
Description	Quantity of net electricity generation supplied to the grid during the monitoring period by the solar plant

⁵ https://cdm.unfccc.int/methodologies/standard_base/2015/sb166.html

Source of data	DGR Sheet based on meter readings				
Description of measurement methods and procedures to be applied	Net electricity generation is electronically metered and stored under the Plant Manager’s authority				
Frequency of monitoring/recording	Continuous measurement and monthly recordings				
Value monitored	Year		Actual Value	Corrected Value*	
	2021 (12-June-2021 to 31-December 2021)		42,607.20	42,586.47	
	2022 (1-January-2022 to 31-December 2022)		81,269.20	81,269.20	
	2023 (1-January-2023 to 31-December 2023)		77,775.10	77,751.00	
	Total		201,651.50	201,606.67	
	*Please refer to section ‘5.1 Baseline Emissions’ for detailed explanation on Corrected Values.				
Monitoring equipment	Meter Description		Serial Number	Accuracy Class	Make
	1	Power Trafo.1 Main	56198213	0.2S	Landis+Gyr
	2	Power Trafo.1 Check	56198214	0.2S	Landis+Gyr
	3	Power Trafo.2 Main	56198215	0.2S	Landis+Gyr
	4	Power Trafo.2 Check	56198216	0.2S	Landis+Gyr
	5	Blitta feeder Main	56198203	0.2S	Landis+Gyr
	6	Blitta feeder Check	56198217	0.2S	Landis+Gyr
	7	Auxiliary Trafo. Main	56198221	0.2S	Landis+Gyr

	8	Auxiliary Trafo. Check	56198222	0.2S	Landis+Gyr
QA/QC procedures to be applied	The calibration of the meters is carried out on an annual basis as agreed by all parties and as indicated in the PPA. The calibration is carried out by a 3rd party every year, and copies of the calibration certificates are signed by all parties. For this monitoring period, one calibration certificate is provided that covers this period. Copies of those certificates and the calibration dates are provided in Appendix 5.				
Purpose of the data	Calculation of baseline emissions				
Calculation method	N/A				
Comments	The net energy value generated, as reflected in the invoice, is slightly higher than the net energy value in the DGR sheet. This discrepancy is attributed to the presence of deemed energy as reflected in the invoices. Data will be archived in paper & electronically for a period of 2 years beyond the end of crediting period or of the last issuance of credits for this project activity, whichever occurs later. The major breakdowns of the plant during the current monitoring period, as recorded in the DGR, totaled 416 hours and 53 minutes and resulted in a loss of 969.18 MWh of energy. Electricity demand is typically calculated based on daily solar generation, with additional power sourced from other generation stations in Togo or, when necessary, from Nigeria or Ghana.				

4.3 Monitoring Plan

The proposed Monitoring Plan describes the Management System and Procedures to be developed and implemented by the project proponent for this project in order to ensure consistency with the methodology ACM0002: Grid-connected electricity generation from renewable sources --- Version 20.0, which is applied in the context of the project activity.

The developed monitoring plan contains the following sections:

1. Monitoring parameters
2. Monitoring Points
3. Monitoring equipment
4. Management structure
5. Monitoring guidelines, procedures and documentation

6. Deviation Control Mechanism

7. Regular staff training

All data required for the calculation of emission reductions associated with the project activity is monitored in accordance with the approved methodology ACM0002: Grid-connected electricity generation from renewable sources --- Version 20.0 and will be archived electronically and on paper throughout the crediting period and up to 2 years thereafter.

A Monitoring Management and Quality Assurance System (MMQAS) is developed and implemented to ensure that the results from the project activity are reliable and transparent.

The complete MMQAS, including data and documents from project operation, is open for review to the VVBs contracted for verification.

Monitoring Parameters

The tables under section 4.2 provide information on the required monitoring parameters as per the approved methodology ACM0002: Grid-connected electricity generation from renewable sources --- Version 20.0 and referred tools, required for the ex-post calculation of project emissions associated with the project activity.

Monitoring Points

Please refer to the Single line diagram in Appendix 4.

Monitoring equipment

The physical monitoring system consists of the following meter equipment:

Electricity meter: AMEA SOLAR TOGO SAU to monitor the quantity of net electricity generation supplied to the grid in year y by the solar plant ($EG_{PJ,y}$)

As shown in the calculations of section 4.4 and according to the methodology ACM0002: Grid-connected electricity generation from renewable sources --- Version 20.0, baseline emissions are calculated by multiplying the quantity of net electricity generation supplied to the grid in year y by the solar plant ($EG_{PJ,y}$ with) with the grid emission factor in the year y ($EF_{grid, CM, y}$)

Management structure

A VCS team is designated to be responsible for carrying out the required monitoring tasks for the project activity. Both management people and technical workers are present in the VCS team. All of the team members have passed internal monitoring training.

The management structure consists of 3 levels to guarantee a step-by-step management of the project activity, which casts concrete responsibilities on the appointed person who will be actually in charge of a specific task.

The 3 levels refer to:

1. Solar Plant Manager
2. VCS project manager
3. VCS staff

Before the start of the crediting period, clear roles and responsibilities were assigned to all staff involved in the project activity. A VCS Project Manager was appointed who is responsible for monitoring activities and data management associated with the project activity. All operators involved in the collection of data and records are coordinated by the VCS Manager.

Monitoring guidelines, procedures and documentation

The introduced Monitoring Management and Quality Assurance System is built on written guidelines and procedures provided to the operational VCS team staff and to the local VCS management.

The procedures were developed by the external consultant according to the approved methodology ACM0002: Grid-connected electricity generation from renewable sources --- Version 20.0. All tasks under the monitoring plan are carried out strictly according to the provided guidelines and procedures.


The Monitoring Management and Quality Assurance System is designed to enable VCS staff members to perform the required tasks following the given guidelines and procedures. Providing documentation designed specifically for the required tasks will strongly benefit availability and transparency of data streams and processes which are relevant for the VCS project.

The VCS Project Manager carries out frequent performance and data cross-checking, to ensure that staff are following the Monitoring Management and Quality Assurance System.

All documents filled out and data acquired during the project will be archived separately for backup.


Deviation Control Mechanism

Daily inspection is carried out by the quality team to verify that the activity is performed as per the First Off/SOP (Standard Operating Procedure) or as per the standard. Any deviation observed during inspection is recorded in the DQR (Daily Quality Report) and circulated to all stakeholders on a daily basis. Deviations are classified into observations, NC (Non-conformance) (Minor & Major) and Punch points as shown below:

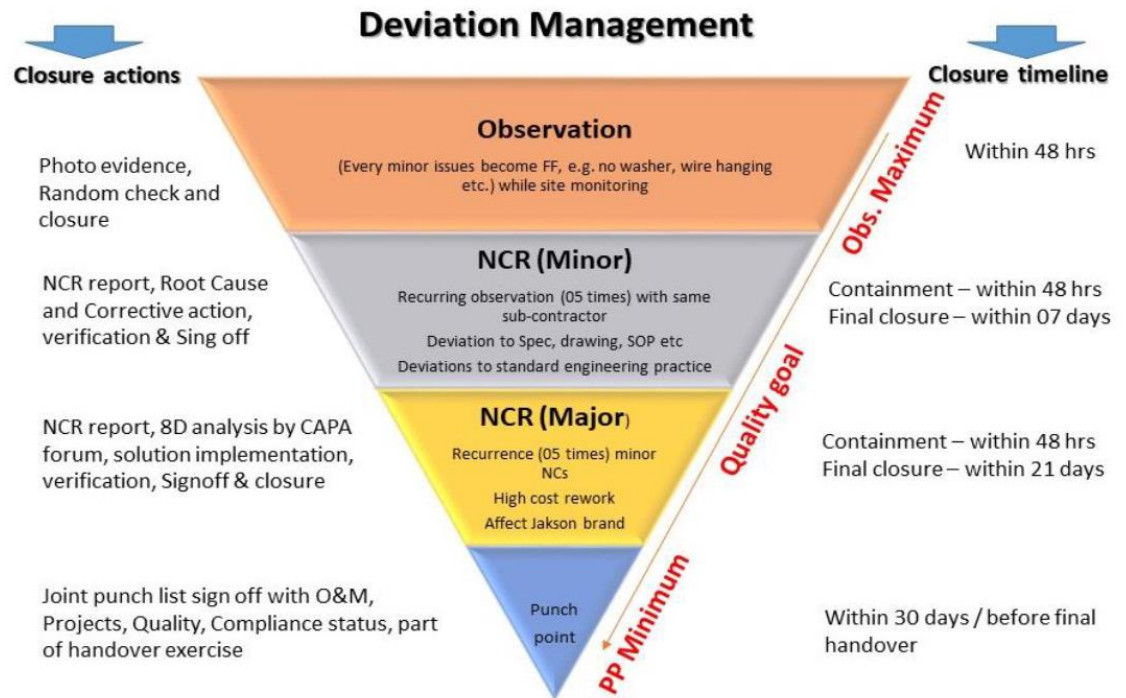

If closure TAT (Turn Around Time) is more than the defined timeline, points are discussed in quality review meetings. Process flow of deviation control mechanism and NC management is shown in the below flowchart:

Deviation Control Mechanism:

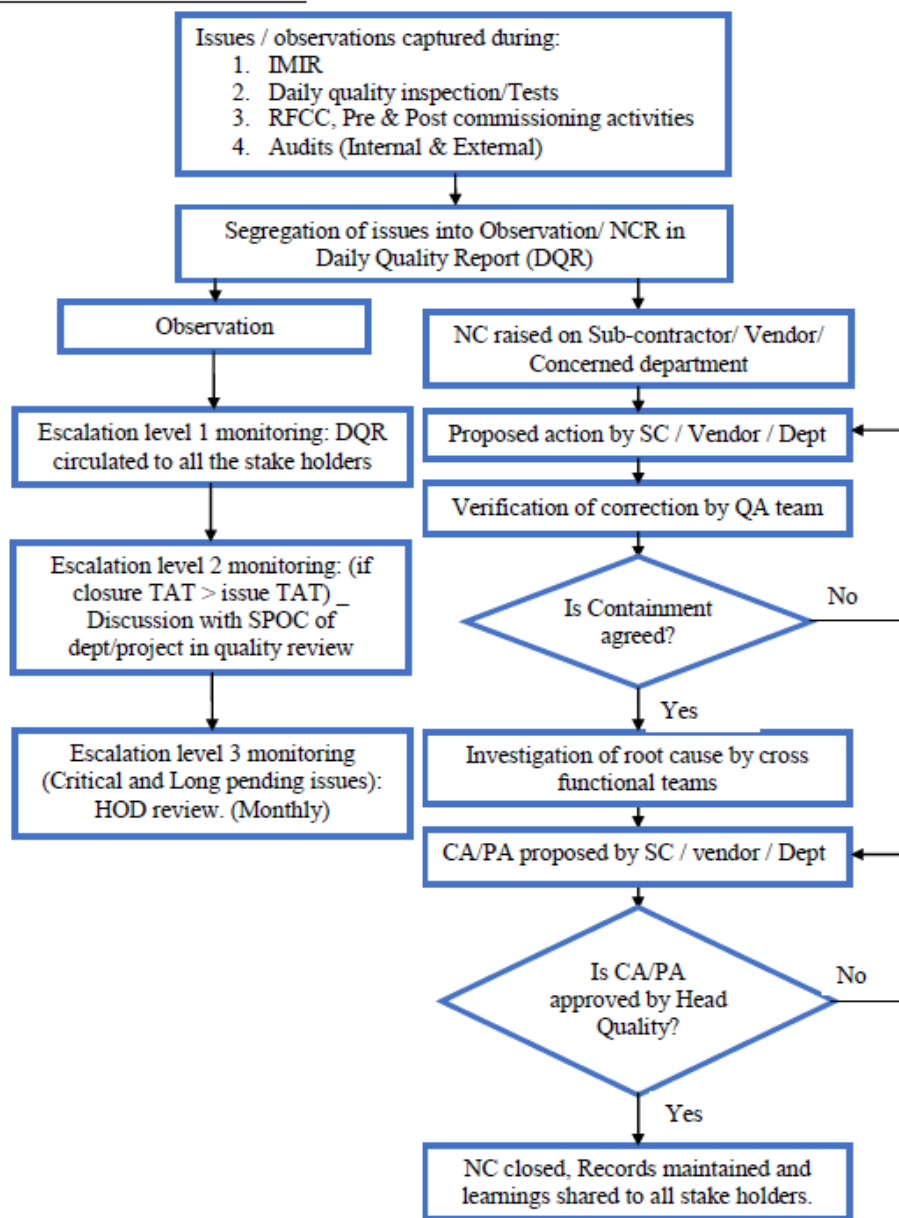

The list of abbreviations is provided below:

Abbreviation	Definition
IMIR	Inward Material Inspection Report
RFCC	Request For Commissioning Clearance
SPOC	Single Point of Contact
CA/PA	Corrective Action/Preventive Action
SC	Sub Contractor
HOD	Head of Department
NCR	Non-Conformance Report

Regular Staff Training

The Monitoring Management and Quality Assurance System is currently being implemented and maintained. In order to qualify local operational staff to carry out required regular tasks professional training is provided, both in class and practical application, to the designated VCS team staff. The regular staff training is provided at least once a year for the duration of the project.

Only trained staff will be members of the VCS team, and only trained VCS staff members will be allowed to perform any tasks related to monitoring activities.

The VCS Manager is permitted to train new staff. By this it will be ensured that operational VCS staff are qualified to carry out the relevant tasks under the Monitoring Management and Quality Assurance System.


This monitoring report has been prepared based on the results of the current monitoring period. An overall QA/QC on the Monitoring Spreadsheet and Monitoring Report is carried out by an external Consultant before the documents are submitted to the selected VVB.

The O&M Organization Chart is shown below:

TOGO, BLITTA



O&M Organization Chart

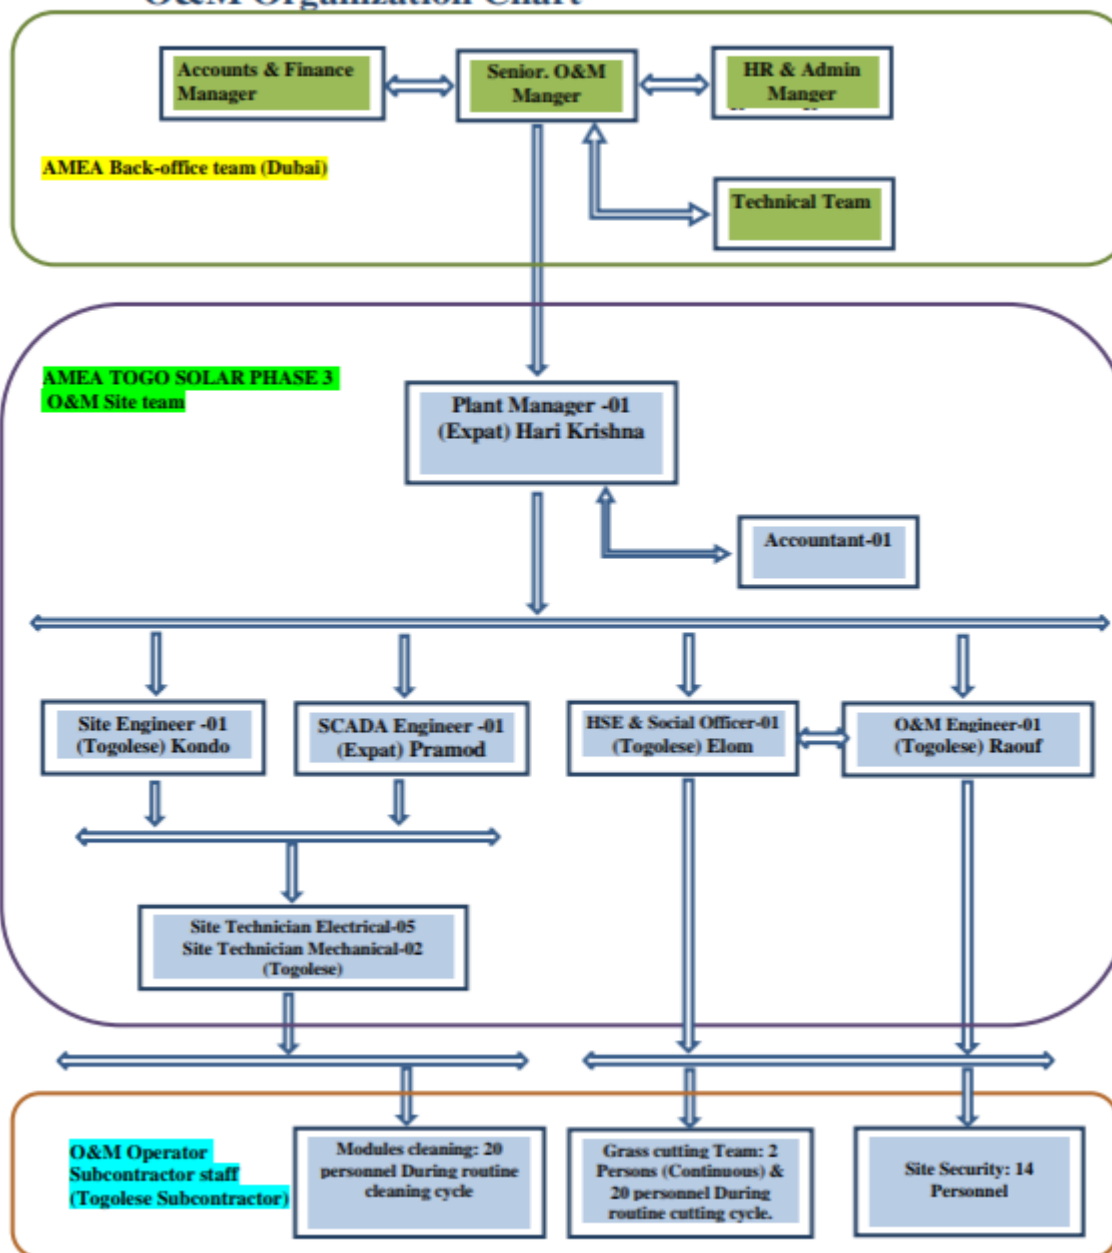

The Plant O&M Manager enforces HSE policies, oversees plant operations, and ensures compliance from subcontractors and vendors. They monitor performance, manage the O&M budget, and use software to analyze technical issues and propose solutions. The manager also supervises personnel, handles subcontract negotiations, maintains stakeholder relationships, and ensures contract

compliance. Additionally, they support financial analysis and assist in developing internal policies and due diligence processes.

The SCADA Engineer is responsible for monitoring daily plant generation to ensure optimal performance and efficiency. They assess system data, including string inverters and MPPT systems, to address any issues and conduct corrective maintenance. The engineer develops preventive maintenance schedules, ensures compliance with health and safety standards, and leads training for the technical team. Additionally, they manage maintenance activities, prepare reports on system performance, and use thermal imaging to identify equipment issues. They also maintain records, analyze plant performance through monthly reports, handle SCADA system failures, and validate real-time data with field equipment.

The Maintenance Engineer manages the operation and maintenance of critical equipment, coordinates with OEMs during failures, and conducts regular inspections. They develop and implement preventive maintenance schedules, perform corrective maintenance, and ensure compliance with safety standards. The engineer also oversees the Permit to Work process, trains technicians, monitors system performance, and reports on maintenance activities, including identifying overheating issues through thermal imaging.

The HSE & Social Officer develops and implements safety policies, conducts safety training, and oversees programs like Lockout-Tagout (LOTO) to prevent equipment accidents. They monitor near-miss incidents, manage hazardous materials and waste, and ensure compliance with safety standards for high-risk activities. Additionally, they maintain an emergency response plan, conduct safety audits, collaborate with other departments, and keep accurate records of HSE activities while administering the Permit to Work (PTW) system for safe operations.

Technicians are responsible for the installation, maintenance, and repair of solar panels and related equipment. Their tasks include performing electrical work, conducting inspections, diagnosing system malfunctions, and executing various types of maintenance. They maintain records of installations and repairs, troubleshoot issues, and ensure optimal performance by managing equipment health. Additionally, they conduct visual inspections, maintain grid failure logs, perform scheduled maintenance, and operate monitoring systems, all while providing hourly forecasting data to relevant authorities.

5 QUANTIFICATION OF GHG EMISSION REDUCTIONS AND REMOVALS

5.1 Baseline Emissions

As per the procedure established in the registered PD,

The baseline emissions are to be calculated as follows:

$BE_y = EG_{PJ,y} \times EF_{grid,CM,y}$ Where:

BE_y = Baseline emissions in year y (tCO₂/yr)

$EG_{PJ,y}$ = Quantity of net electricity generation that is produced and fed into the grid as a result of the implementation of the project activity in year y (MWh/yr)

For this monitoring period, the DGR values are considered for the calculations of the emission reductions as they are the more conservative values.

As the calibration of the meters took place on 25-October-2022 in the previous year and it took place on 26-November-2023 for the year 2023, there is a delay of 33 days (including both dates)

According to the 'CDM validation and verification standard for project activities', 366(a), if the meters' calibration is delayed, then the manufacturer's maximum permissible error must be applied to the metered values for that period, provided the error observed during calibration is below the maximum permissible error. According to 366(b), if the error is beyond the maximum permissible error of the measuring equipment, the error identified in the delayed calibration test must be applied.

The calibration certificates provided in Appendix 5 show that the highest error observed during calibration was 0.297% which is above the maximum permissible error $\pm 0.2\%$ for 0.2S class meters (as shown in calibration certificate). Hence, 0.297% error value was applied to calculate the corrected values.

$EF_{grid,CM,y}$ = Combined margin CO₂ emission factor for grid connected power generation in year y calculated using the latest version of "TOOL07: Tool to calculate the emission factor for an electricity system" (tCO₂/MWh) referring to the Standardized Baseline ASB0034-2021: Grid emission factor for the West African Power Pool, Version 01.0.

Calculation of $EG_{PJ,y}$

In case of Greenfield power plant development, the quantity of net electricity generation that is produced and fed into the grid as a result of the implementation of the project activity in year y , according to the methodology is calculated as follows:

$EG_{PJ,y} = EG_{facility,y}$ Where:

$EG_{PJ,y}$ = Quantity of net electricity generation that is produced and fed into the grid as a result of the implementation of the project activity in year y (MWh/yr)

$EG_{facility,y}$ = Quantity of net electricity generation supplied by the project plant/unit to the grid in year y (MWh/yr)

Calculation of $EF_{grid,CM,y}$

As stated before, the “TOOL07: Tool to calculate the emission factor for an electricity system” allows referring to the Standardized Baseline ASB0034-2021: Grid emission factor for the West African Power Pool, Version 01.0.

The ASB0034-2021 Standardized Baseline states that for wind and solar power generation project activities, the $EF_{grid,CM,y}$ to be used is 0.573 tCO₂/MWh.

The total quantity of net electricity supplied to the grid for the current monitoring period:

$$EG_{PJ,y} = 77,775.10 \text{ MWh}$$

The corrected net electricity supplied to the grid for the current monitoring period (as explained earlier in the section):

$$EG_{PJ,y} = 77,751.00 \text{ MWh}$$

The Grid Emission Factor is:

$$EF_{grid,CM,y} = 0.573 \text{ tCO}_2/\text{MWh}$$

The baseline emissions of the project activity are:

$$BE_y = 77,751.00 \text{ MWh} * 0.573 \text{ tCO}_2/\text{MWh} = 44,551 \text{ tCO}_2\text{e (Round down value)}$$

5.2 Project Emissions

The project activity involves renewable power generation. Therefore, $PE_y = 0$

5.3 Leakage Emissions

No leakage emissions are considered. The emissions potentially arising due to activities such as power plant construction and upstream emissions from fossil fuel use (e.g., extraction, processing, transport etc.) are not calculated.

5.4 GHG Emission Reductions and Carbon Dioxide Removals

As per the applied methodology, emission reductions are calculated as follows:

$$ER_y = BE_y - PE_y$$

Where,

ER_y = Emission Reduction in tCO₂e/year

BE_y = Baseline emission in tCO₂e/year

PE_y = Project emissions in tCO₂e/year

$$ER_y = 44,551 \text{ tCO}_2\text{e} - 0 \text{ tCO}_2\text{e} = 44,551 \text{ tCO}_2\text{e}$$

Vintage period	Baseline emissions (tCO ₂ e)	Project emissions (tCO ₂ e)	Leakage emissions (tCO ₂ e)	Reduction VCU (tCO ₂ e)	Removal VCU (tCO ₂ e)	Total VCUs (tCO ₂ e)
12-June-2021 to 31-December 2021	24,402	0	0	24,402	0	24,402
1-January-2022 to 31-December 2022	46,567	0	0	46,567	0	46,567
1-January-2023 to 31-December 2023	44,551	0	0	44,551	0	44,551
Total	115,520	0	0	115,520	0	115,520

Vintage period	Ex-ante estimated reductions/removals	Achieved reductions/removals	Percent difference	Explanation for the difference
1-January-2023 to 31-December 2023	70,468	44,551	-36.77%	The ex-ante emissions were calculated based on 70 MW. The current monitoring period accounts for 50 MW.
Total	70,468	44,551	-36.77%	

APPENDIX 1: COMMERCIALY SENSITIVE INFORMATION

N/A

APPENDIX 2: SDG CONTRIBUTIONS

AMEA SOLAR TOGO SAU built the first clinic in Blitta, and this has improved the standard of living within the village. The number of patients visiting the newly constructed clinic increased and this contributes towards SDG 3: Good Health and Well-being that aims to focus on key targets that boost the health of a country's overall population. The following shows the number of patients visiting the clinic for consultations in 2023.



**CLINIC BLITTA CARREFOUR
VISITORS OF AMEA MATERNITY**

YEAR	2023						
MONTH	MATERNITY						
	1st PRE NATAL CONSULTATION	2nd PRE NATAL CONSULTATION	3rd PRE NATAL CONSULTATION	4th PRE NATAL CONSULTATION	BIRTHS		
					BOYS	GIRLS	TOTAL
JANUARY	32	33	27	10	7	10	17
FABRUARY	30	34	33	6	7	12	19
MARCH	26	32	34	11	3	11	14
APRIL	27	32	43	17	9	12	21
MAY	27	22	23	17	10	9	19
JUNE	38	31	25	4	5	7	12
JULY	32	32	23	15	8	7	15
AUGUST	26	27	31	15	6	11	17
SEPTEMBER	33	30	27	14	8	16	24
OCTOBER	33	24	18	20	11	14	25
NOVEMBER	32	28	27	19	10	8	18
DECEMBER	24	16	29	12	12	6	18
TOTAL OF YEAR	360	341	340	160	96	123	219




CLINIC BLITTA CARREFOUR
VISITORS OF AMEA PEDIATRY

YEAR	2023
MONTH	MEDICAL CONSULTATION
JANUARY	390
FEBRUARY	389
MARCH	341
APRIL	370
MAY	429
JUNE	602
JULY	600
AUGUST	487
SEPTEMBER	520
OCTOBER	514
NOVEMBER	467
DECEMBER	329
TOTAL OF YEAR	5438

P.O



06/02/24

AMEA SOLAR TOGO SAU built three (3) primary schools and renovated the four (4) existing primary schools with the necessary equipment and furniture. The number of students going to primary schools annually has increased. These activities contribute towards SDG 4: Quality Education that ensures inclusive and equitable quality education and promotes lifelong learning opportunities for all. The following shows the number of students attending each of the schools.

DATA SHEET
EPP KATAKPE

YEAR	2022-2023											
CLASS	CP1-CP2			CE1-CE2			CM1-CM2			MATERNELLE		
GENDER	BOYS	GIRLS	TOTAL	BOYS	GIRLS	TOTAL	BOYS	GIRLS	TOTAL	BOYS	GIRLS	TOTAL
NUMBER	17	9	26	11	12	23	14	8	22	11	12	23

YEAR	2023-2024											
CLASS	CP1-CP2			CE1-CE2			CM1-CM2			MATERNELLE		
GENDER	BOYS	GIRLS	TOTAL	BOYS	GIRLS	TOTAL	BOYS	GIRLS	TOTAL	BOYS	GIRLS	TOTAL
NUMBER	15	20	35	13	14	27	11	10	21	8	8	16

Blitta, le 05 février 2024



DATA SHEET
EPP KOKONADE

YEAR	2022-2023											
CLASS	CP1-CP2			CE1-CE2			CM1-CM2			MATERNELLE		
GENDER	BOYS	GIRLS	TOTAL	BOYS	GIRLS	TOTAL	BOYS	GIRLS	TOTAL	BOYS	GIRLS	TOTAL
NUMBER	14	13	27	16	13	29	9	7	16	9	13	22

YEAR	2023-2024											
CLASS	CP1-CP2			CE1-CE2			CM1-CM2			MATERNELLE		
GENDER	BOYS	GIRLS	TOTAL	BOYS	GIRLS	TOTAL	BOYS	GIRLS	TOTAL	BOYS	GIRLS	TOTAL
NUMBER	13	14	27	17	8	25	10	13	23	7	10	17

Blitta, le 05/02/2024





DATA SHEET

EPP LAMAKAZA B

YEAR	2022-2023								
CLASS	CP1			CE2			CM1		
GENDER	BOYS	GIRLS	TOTAL	BOYS	GIRLS	TOTAL	BOYS	GIRLS	TOTAL
NUMBER	40	40	80	33	31	64	29	30	59

YEAR	2023-2024								
CLASS	CP1			CP2			CE1		
GENDER	BOYS	GIRLS	TOTAL	BOYS	GIRLS	TOTAL	BOYS	GIRLS	TOTAL
NUMBER	43	27	70	39	37	76	33	38	71

Blitta, 05 Février 2024



BATCHASSI N'na



DATA SHEET

EPP TOMEGBE

YEAR	2022-2023											
CLASS	CE1			CE2			CM1			CM2		
GENDER	BOYS	GIRLS	TOTAL	BOYS	GIRLS	TOTAL	BOYS	GIRLS	TOTAL	BOYS	GIRLS	TOTAL
NUMBER	19	25	44	16	27	43	22	19	41	10	20	30

YEAR	2023-2024											
CLASS	CE1			CE2			CM1			CM2		
GENDER	BOYS	GIRLS	TOTAL	BOYS	GIRLS	TOTAL	BOYS	GIRLS	TOTAL	BOYS	GIRLS	TOTAL
NUMBER	22	16	38	18	27	45	15	29	44	15	18	33



Blitta, le 05/02/2024

Hodabalo NABIDA



DATA SHEET

LYCEE BLITTA CARREFOUR

YEAR	2022-2023											
CLASS	5eA			5eB			3eA			3eB		
GENDER	BOYS	GIRLS	TOTAL	BOYS	GIRLS	TOTAL	BOYS	GIRLS	TOTAL	BOYS	GIRLS	TOTAL
NUMBER	46	58	104	47	57	104	43	43	86	45	40	85

YEAR	2023-2024											
CLASS	4eA			4eB			3eA			3eB		
GENDER	BOYS	GIRLS	TOTAL	BOYS	GIRLS	TOTAL	BOYS	GIRLS	TOTAL	BOYS	GIRLS	TOTAL
NUMBER	33	39	72	32	30	62	49	43	92	49	34	83

Fait à Blitta le 02/02/2024



Monsieur

HOUSANTHA Bougoundima

APPENDIX 3: STAKEHOLDER ENGAGEMENT

The stakeholder engagement log for the current monitoring period is shown below:




STAKEHOLDER ENGAGEMENT LOG

PROJECT Blitta Solar Plant
CODE BLIT-QHSE-06M
DATE 30-Sep-24
REVISION 00
PREPARED BY Raouf Dantare

RECORD				EVENT					
#	REFERENCE	DATE	LOGGED BY	EVENT	TOPICS DISCUSSED	PARTIES STAKEHOLDER INVOLVED	MAIN DISCUSSION AND FOLLOW-UP ACTIONS	COMMENTS	DATE OF ACTION
1	BLIT-SEL-031	16-Jan-23	Hervé & Raouf	Annual Control	Inspection of all the site	ARSE	ARSE team came to inspect all the site by referring to the contract between AMEA and Togolese government	No action required.	16-Jan-23
2	BLIT-SEL-032	17-Jan-23	Hervé & Raouf	Annual Control	Annual review of the PR	CEET, AT-ER, ARSE	The national agencies arrived on site to make review of 2022 year production and PR checking by referring to the power purchase agreement	No action required.	17-Jan-23
3	BLIT-SEL-033	20-Jan-23	Hervé & Raouf	Control	Verification of site limits	AT-ER Surveyer	AT-ER sent a surveyer to cross verify the limits installed for the phase 3 and check the ones installed for phase 1&2	No action required.	20-Jan-23
4	BLIT-SEL-034	25-Jan-23	Hervé & Raouf	Visit	Site visit	CEB	CEB team came with a third party company to visit the site in order to install extra camera requested by Togolese Government, this will be done to secure the site against terrorism attacks	No action required.	25-Jan-23
5	BLIT-SEL-035	1-Feb-23	Hervé & Raouf	Visit	Site visit	German Cooperation	A team of German Cooperation came on site to visit and have some explanations on how the plant works	No action required.	1-Feb-23
6	BLIT-SEL-036	23-Feb-23	Hervé & Raouf	Visit	Site visit	European Union	A team of European Union came on site to visit and have some explanations on how the plant works	No action required.	23-Feb-23
7	BLIT-SEL-037	21-Mar-23	Hervé & Raouf & Joel	Visit	Site visit	President of Togo Republic	Ground opening of Phase 3 works	No action required.	21-Mar-23
8	BLIT-SEL-038	19-Apr-23	Hervé & Raouf	Visit	Site visit	Lomé Airport team (SALT)	KYA Energy workers arrived to check the how things are working on site	No action required.	19-Apr-23
9	BLIT-SEL-039	19-Apr-23	Hervé & Raouf	Visit	Site visit	ARSE	Technical and legal team of ARSE came on site to control the pending points	All the points are ongoing	Ongoing
10	BLIT-SEL-040	11-Jul-23	Raouf	Visit	Site visit	President's Advisor	The Togolese President's advisor came on site to visit and have some explanations on how the plant works	No action required.	11-Jul-23
11	BLIT-SEL-041	17-Oct-23	Hervé & Raouf	Visit	o&M Site visit	German ambassador, AT-ER	German ambassador, AT-ER came to visit the solar operation plant	No action required.	17-Oct-23
12	BLIT-SEL-042	19-Oct-23	Hervé & Raouf	Visit	o&M Site visit	BOAD	BOAD came to visit the solar operation plant	No action required.	19-Oct-23

No entries were logged in after 19-October-2023 for the current monitoring period.

APPENDIX 4: SINGLE LINE DIAGRAM

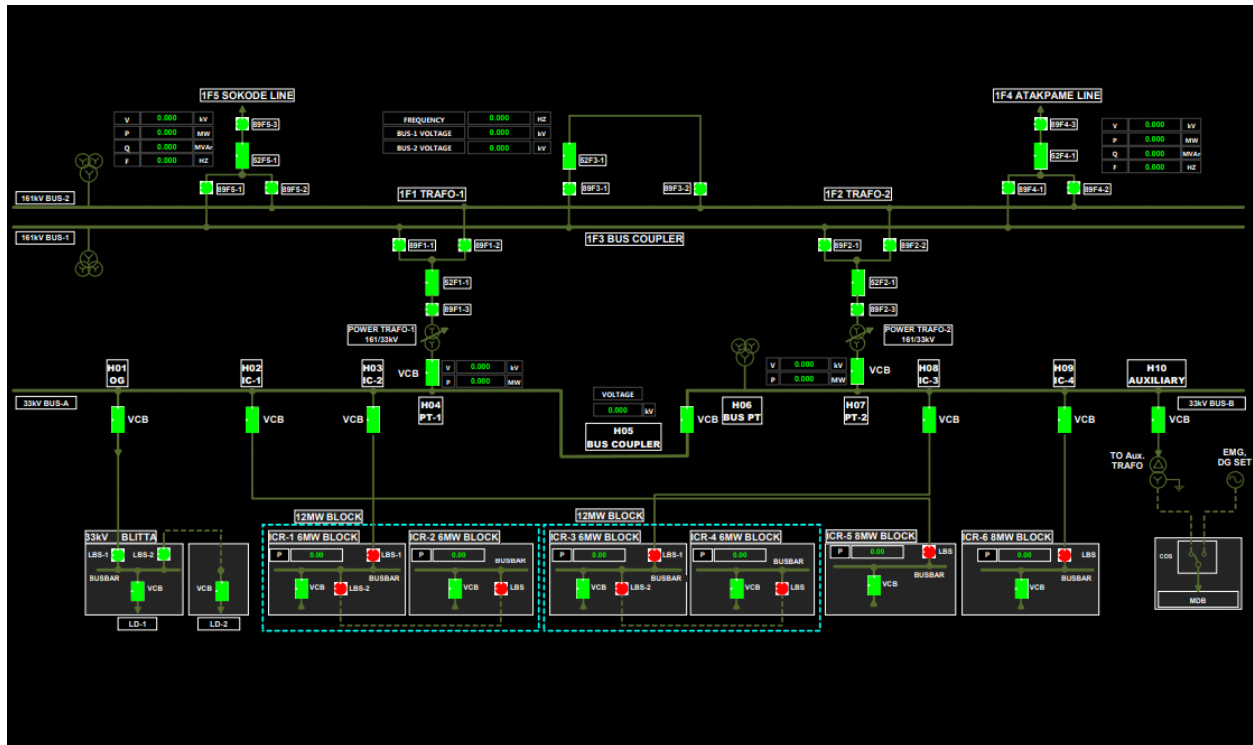

All Energy Meters were installed in Separate Metering Room.

APPENDIX 5: CALIBRATION

The calibration certificates for the following metering equipment for the current monitoring period are provided in this section. All Energy Meters were installed in Separate Metering Room and the next calibration of the energy meters is due on 25-November-2024. The calibration dates are shown below:

Serial Number	Calibration Dates	Calibration Result
56198213	12-October-2020	Completed Successfully
	22-November-2021	Completed Successfully
	25-October-2022	Completed Successfully
	26-November-2023	Completed Successfully
56198214	12-October-2020	Completed Successfully
	22-November-2021	Completed Successfully
	25-October-2022	Completed Successfully
	26-November-2023	Completed Successfully
56198215	12-October-2020	Completed Successfully
	22-November-2021	Completed Successfully
	25-October-2022	Completed Successfully
	26-November-2023	Completed Successfully
56198216	12-October-2020	Completed Successfully
	22-November-2021	Completed Successfully
	25-October-2022	Completed Successfully
	26-November-2023	Completed Successfully
56198203	12-October-2020	Completed Successfully
	22-November-2021	Completed Successfully
	25-October-2022	Completed Successfully
	26-November-2023	Completed Successfully
56198217	12-October-2020	Completed Successfully
	22-November-2021	Completed Successfully
	25-October-2022	Completed Successfully
	26-November-2023	Completed Successfully
56198221	12-October-2020	Completed Successfully
	22-November-2021	Completed Successfully
	25-October-2022	Completed Successfully

	26-November-2023	Completed Successfully
56198222	12-October-2020	Completed Successfully
	22-November-2021	Completed Successfully
	25-October-2022	Completed Successfully
	26-November-2023	Completed Successfully

PROCES VERBAL DES TRAVAUX DE VERIFICATION DE COMPTEURS

L'an deux mil vingt et trois et le dimanche vingt-six novembre, l'équipe de Contrôle Electrique de la CEB, de la CEET et en présence d'un représentant de AMEA/JAKSON a procédé à la vérification des équipements de comptage d'énergie sur les artères 161 kV, 33 kV à la centrale solaire de Blitta.

Etaient présents :

Coté CEB

M. ATTISSO K. Mawuli Technicien contrôle électrique;
TCHAYE Ninkabou Technicien contrôle électrique.

Coté CEET

M. KERIM Makaoui Chef Service Laboratoire Nord.
KEKESSI Etchri Chef Division comptage

Coté AMEA/JAKSON

M. PUSULURI HARI KRISHNA O&M Manager

A la centrale solaire de Blitta où sont installés les compteurs, les travaux suivants ont été exécutés :

1) Vérification de la conformité des compteurs installés

L'authenticité des compteurs a été vérifiée conformément à leurs numéros de série et aux caractéristiques d'origine.

2) Vérification de la présence des scellés

Les scellés étaient intacts

3) Vérification des compteurs

La vérification des compteurs a été faite en charge réelle et sans interruption de comptage, donc pas d'énergie non comptée.

Les résultats trouvés lors de cette vérification sont dans les limites acceptables en rapport avec la classe de précision des compteurs.

(Voir résultats en annexe)

4) Pose des scellés après vérification des compteurs.

Les scellés rompus lors des travaux ont été reposés.

Dans l'ensemble les travaux se sont bien déroulés sans aucun incident.

P.J : 04 fiches de vérification.

Ont signé :

Pour CEB



ATTISSO K. Mawuli

Pour CEET



KERIM Makaoui



PUSULURI HARI KRISHNA

FICHE DE VERIFICATION ET D'ETALONNAGE DES COMPTEURS D'ENERGIE ELECTRIQUE

POSTE: BLITTA

DATE: 26/11/2023

CLIENT: PTR 1

RAPPORT DE VERIFICATION ET D'ETALONNAGE DES COMPTEURS D'ENERGIE ELECTRIQUE

Compteur numérique Bitsa (réactif)		Compteur numérique Bitsa (actif)		Compteur numérique Bitsa (réactif)		Compteur numérique Bitsa (actif)				IDENTIFICATION N COMPTEURS	
LANDYS & GYR Type: ZMD402CT44.0457 S4				LANDYS & GYR Type: ZMD402CT44.0457 S4						TYPES	
N°: 56198214				N°: 56198213						NUMERO DE SERIE	
Riq =50 000 imp/kVARh cl: 0,5		Rip =50 000 imp/kWh cl: 0,25		Riq =50 000 imp/kVARh cl: 0,5		Rip =50 000 imp/kWh cl: 0,25				CONSTANTES à CLASSER	
VEC				VEC						TYPE D'ESSAI	
0.99				0.99						FACTEUR DE PUISSANCE	
59.76		60.01		59.63		59.82		59.13		V _{AN} V _{BN} V _{CN} U _{AB} U _{BC} U _{CA} I _A I _B I _C	
59.30		103.95		103.66		103.84		123.80		0.083	
103.08		103.13		0.071		0.072		0.074		0.066	
30		0.212		0.199%		0.126		0.063%		0.131	
10		0.041		0.032		0.032		0.264%		0.431	
20		0.327		0.329		0.329		0.264%		0.431	
30		0.212		0.199%		0.126		0.063%		0.131	

OBSERVATION: Les erreurs enregistrées sont dans les limites des classes de précision des deux compteurs

Matériel d'étalonnage

Elaboré: CALPORT 300 CL 0,05
Autre charge: MTE
Fabricant: MTE
VEC = VERIFICATION EN CHARGE

Numéros des sceaux posés			
Désig Compt	Main	Check	
Capot compt	CEET 181801	CEET 181803	
Cache borne	CEB 11231	CEB 11232	
BI-M: CEB 11737	BI-C: CEB 11739		
BI-M: CEB 11736	BI-C: CEB 11738		

Représentant CEET	Représentant MATEA	Représentant CEB
KERIM MAKROUI	PUSTULURI HARI KRISHNA	MARUTI K. ATTISSE

FICHE DE VERIFICATION ET D'ETALONNAGE DES COMPTEURS D'ENERGIE ELECTRIQUE

POSTE: BLTTA

DATE: 26/11/2023

CLIENT: PTR 2

RAPPORT DE VERIFICATION ET D'ETALONNAGE DES COMPTEURS D'ENERGIE ELECTRIQUE

IDENTIFICATION COMPTEURS	TYPES	NUMERO DE SERIE	CONSTANTES & CLASSES	TYPE D'ESSAI	FACTEUR DE PUISSANCE	TENSIONS D'ESSAI						COURANTS DE CHARGE			ESSELS MOYENNES EN POURCENTAGE AVANT ET APRES ETALONNAGE					
						V _{AN}	V _{BN}	V _{CN}	U _{AB}	U _{BC}	U _{CA}	I _A	I _B	I _C	2023	2023	2023	2023	2023	2023
Compteur numérique Bites (reactif)	LANDYS & GYR Type: ZMD402CT44.0457 S4	N°: 56198216	Riq =50 000 imp/kVARh cl: 0,5	VEC	0.99	59.95	60.16	59.46	104.22	103.45	103.38	0.148	0.150	0.151	10	-0.006	-0.039%	10	-0.083	-0.079%
Compteur numérique Bites (actif)	LANDYS & GYR Type: ZMD402CT44.0457 S4	N°: 56198215	Rip =50 000 imp/kWh cl: 0,2S	VEC	0.99	59.95	60.16	59.46	104.22	103.45	103.38	0.148	0.150	0.151	20	-0.071	-0.039%	20	-0.077	-0.079%
Compteur numérique Bites (reactif)	LANDYS & GYR Type: ZMD402CT44.0457 S4	N°: 56198216	Riq =50 000 imp/kVARh cl: 0,5	VEC	0.99	59.95	60.16	59.46	104.22	103.45	103.38	0.148	0.150	0.151	30	-0.039	-0.039%	30	-0.078	-0.079%
Compteur numérique Bites (actif)	LANDYS & GYR Type: ZMD402CT44.0457 S4	N°: 56198215	Rip =50 000 imp/kWh cl: 0,2S	VEC	0.99	59.95	60.16	59.46	104.22	103.45	103.38	0.148	0.150	0.151	10	0.173	0.208%	10	0.054	0.083%
Compteur numérique Bites (reactif)	LANDYS & GYR Type: ZMD402CT44.0457 S4	N°: 56198216	Riq =50 000 imp/kVARh cl: 0,5	VEC	0.99	59.95	60.16	59.46	104.22	103.45	103.38	0.148	0.150	0.151	20	0.223	0.208%	20	0.166	0.083%
Compteur numérique Bites (actif)	LANDYS & GYR Type: ZMD402CT44.0457 S4	N°: 56198215	Rip =50 000 imp/kWh cl: 0,2S	VEC	0.99	59.95	60.16	59.46	104.22	103.45	103.38	0.148	0.150	0.151	30	0.229	0.208%	30	0.028	0.083%
Compteur numérique Bites (reactif)	LANDYS & GYR Type: ZMD402CT44.0457 S4	N°: 56198216	Riq =50 000 imp/kVARh cl: 0,5	VEC	0.99	59.95	60.16	59.46	104.22	103.45	103.38	0.148	0.150	0.151	10	-0.085	-0.082%	10	-0.023	0.016%
Compteur numérique Bites (actif)	LANDYS & GYR Type: ZMD402CT44.0457 S4	N°: 56198215	Rip =50 000 imp/kWh cl: 0,2S	VEC	0.99	59.95	60.16	59.46	104.22	103.45	103.38	0.148	0.150	0.151	20	-0.088	-0.082%	20	0.038	0.016%
Compteur numérique Bites (reactif)	LANDYS & GYR Type: ZMD402CT44.0457 S4	N°: 56198216	Riq =50 000 imp/kVARh cl: 0,5	VEC	0.99	59.95	60.16	59.46	104.22	103.45	103.38	0.148	0.150	0.151	30	-0.092	-0.082%	30	0.032	0.016%
Compteur numérique Bites (actif)	LANDYS & GYR Type: ZMD402CT44.0457 S4	N°: 56198215	Rip =50 000 imp/kWh cl: 0,2S	VEC	0.99	59.95	60.16	59.46	104.22	103.45	103.38	0.148	0.150	0.151	10	0.215	0.258%	10	0.113	0.262%
Compteur numérique Bites (reactif)	LANDYS & GYR Type: ZMD402CT44.0457 S4	N°: 56198216	Riq =50 000 imp/kVARh cl: 0,5	VEC	0.99	59.95	60.16	59.46	104.22	103.45	103.38	0.148	0.150	0.151	20	0.263	0.258%	20	0.406	0.262%
Compteur numérique Bites (actif)	LANDYS & GYR Type: ZMD402CT44.0457 S4	N°: 56198215	Rip =50 000 imp/kWh cl: 0,2S	VEC	0.99	59.95	60.16	59.46	104.22	103.45	103.38	0.148	0.150	0.151	30	0.286	0.258%	30	0.267	0.262%

OBSERVATION:

Les erreurs enregistrées sont dans les limites des classes de précision des deux compteurs

Matériel d'étalonnage

Eaton : CALOCT 300 Cl: 0.05
Autre charge : MTE
Fabricant : MTE
VEC = VERIFICATION EN CHARGE

Numéros des étalons posés			
Décl. Compt.	Main	Check	
Capot compt.	CEET 181805	CEET 181807	
Carte borne	CEB 11233	CEB 11234	
BL-M: CEB 11741	BL-C: CEB 11256		
BU-M: CEB 11740	BU-C: CEB 11255		

Représentant CEET		Représentant PTR	
KERIM MAKHOUL	PUSAT HARIRI KASSINA	Mawuli K. ATTISO	

FICHE DE VERIFICATION ET D'ETALONNAGE DES COMPTEURS D'ENERGIE ELECTRIQUE

POSTE: BLUTTA

DATE: 26/11/2023

CLIENT: AUXILIAIRES

RAPPORT DE VERIFICATION ET D'ETALONNAGE DES COMPTEURS D'ENERGIE ELECTRIQUE

RAPPORT DE VERIFICATION ET DE DETAILLAGE DES COMPTEURS D'ENERGIE ELECTRIQUE									
Compteur numérique Bille (réactif)		Compteur numérique Bille (actif)		Compteur numérique Bille (réactif)		Compteur numérique Bille (actif)		IDENTIFICATION COMPTEURS	
LANDYS & GYR Type: ZMD402CT44.0457 S4				LANDYS & GYR Type: ZMD402CT44.0457 S4				TYPES	
N°: 56198222				N°: 56198221				NUMERO DE SERIE	
Riq =50 000 imp/kVARh cl: 0,5		Rip =50 000 imp/kWh cl: 0,25		Riq =50 000 imp/kVARh cl: 0,5		Rip =50 000 imp/kWh cl: 0,25		CONSTANTES & CLASSES	
VEC		VEC		VEC		VEC		TYPE D'ESSAI	
0.90		0.91		0.91		0.91		FACTEUR DE PUISSANCE	
58.94		58.37		58.37		58.37		VAN	
59.20		58.56		58.56		58.56		VBN	
58.41		57.84		57.84		57.84		VCN	
102.57		101.49		101.49		101.49		UAB	
101.59		100.65		100.65		100.65		UBC	
101.62		100.57		100.57		100.57		UCA	
0.010		0.012		0.012		0.012		IA	
0.010		0.013		0.013		0.013		IB	
0.008		0.008		0.008		0.008		IC	
10		10		10		10		TOUTES OU PARTIELLES	
20		20		20		20		ERREUR (%)	
30		30		30		30		MOY. ERREURS	
0.081		-0.054		-0.054		-0.054		TOUTES OU PARTIELLES	
-0.134		-0.392		-0.392		-0.392		ERREUR (%)	
-0.096		-0.189%		-0.189%		-0.189%		MOY. ERREURS	
10		10		10		10		TOUTES OU PARTIELLES	
20		20		20		20		ERREUR (%)	
30		30		30		30		MOY. ERREURS	
0.056%		-0.054%		-0.054%		-0.054%		TOUTES OU PARTIELLES	
0.048		-0.097		-0.097		-0.097		ERREUR (%)	
0.081		-0.268		-0.268		-0.268		MOY. ERREURS	
-0.134		-0.193		-0.193		-0.193		TOUTES OU PARTIELLES	
-0.096		-0.246%		-0.246%		-0.246%		ERREUR (%)	
10		10		10		10		TOUTES OU PARTIELLES	
20		20		20		20		ERREUR (%)	
30		30		30		30		MOY. ERREURS	
0.056%		-0.054%		-0.054%		-0.054%		TOUTES OU PARTIELLES	
0.048		-0.097		-0.097		-0.097		ERREUR (%)	
0.081		-0.268		-0.268		-0.268		MOY. ERREURS	
-0.134		-0.193		-0.193		-0.193		TOUTES OU PARTIELLES	
-0.096		-0.246%		-0.246%		-0.246%		ERREUR (%)	

OBSERVATION:

Matériel d'étalonnage
Echelle :
Autre charge :
Fabricant : MTE
VEC = VERIFICATION EN CHARGE

Numéros des sceaux posés			
Déclat Compt	Mati	Check	
Capot compt	CEB 11091	CEB 11225	
Capot borne	CEB 11220	CEB 11219	
BL-M: CEB 11743	BL-C: CEB 11280		
BL-M: CEB 11742	BL-C: CEB 11259		

Représentant CEET	Représentant AVEA	Représentant CEB
		
KERIM Mahamout	PUSUURI HARIKRISHNA	Mawuli K. ATTISSE
MAKROU ABRIKIM		

FICHE DE VERIFICATION ET D'ETALONNAGE DES COMPTEURS D'ENERGIE ELECTRIQUE

POSTE: BLTTA

DATE: 26/11/2023

CLIENT: DISTRIBUTION

RAPPORT DE VERIFICATION ET D'ETALONNAGE DES COMPTEURS D'ENERGIE ELECTRIQUE

Compteur numérique Bitta (réactif)		Compteur numérique Bitta (actif)		Compteur numérique Bitta (réactif)		Compteur numérique Bitta (actif)		IDENTIFICATION COMPTEUR	
LANDYS & GYR Type: ZMD402CT44.0457 S4				LANDYS & GYR Type: ZMD402CT44.0457 S4				TYPES	
N°: 56198217				N°: 56198203				NUMERO DE SERIE	
Riq =50 000 imp/kVARh cl: 0,5		Rip =50 000 imp/kWh cl: 0,25		Riq =50 000 imp/kVARh cl: 0,5		Rip =50 000 imp/kWh cl: 0,25		CONSTANTES & CLASSES	
VEC				VEC				TYPE D'ESSAI	
0.96				0.93				FACTEUR DE PUISSANCE	
VAN		VBN		VCN		UAB		UBC	
57.84		57.96		57.30		100.48		99.54	
57.84		57.96		57.30		100.48		99.54	
57.33		100.51		99.77		99.58		0.009	
100.51		99.77		99.58		0.009		0.009	
99.77		99.58		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.009		0.010		0.009		0.009		0.010	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	
0.009		0.009		0.010		0.009		0.009	
0.010		0.009		0.009		0.009		0.010	

OBSERVATION: Les erreurs enregistrées sont dans les limites des classes de précision des deux compteurs

Matériel d'étalonnage
Etabli :
Autre charge :
Fabricant : MTE
VEC = VERIFICATION EN CHARGE

Numéros des sceaux posés			
Design Compt	Main	Check	
Capot compt	CEB 11095	CEB 11097	
Carte borne	CEB 11221	CEB 11222	
BI-M: CEB 11745	BI-C: CEB 11264		
BI-M: CEB 11744	BI-C: CEB 11263		

Représentant CEET	Représentant APERA	Représentant CEB
KERIM MAKROU	PUSLURN HARI KUSHINA	Mawili K. ATTISO