




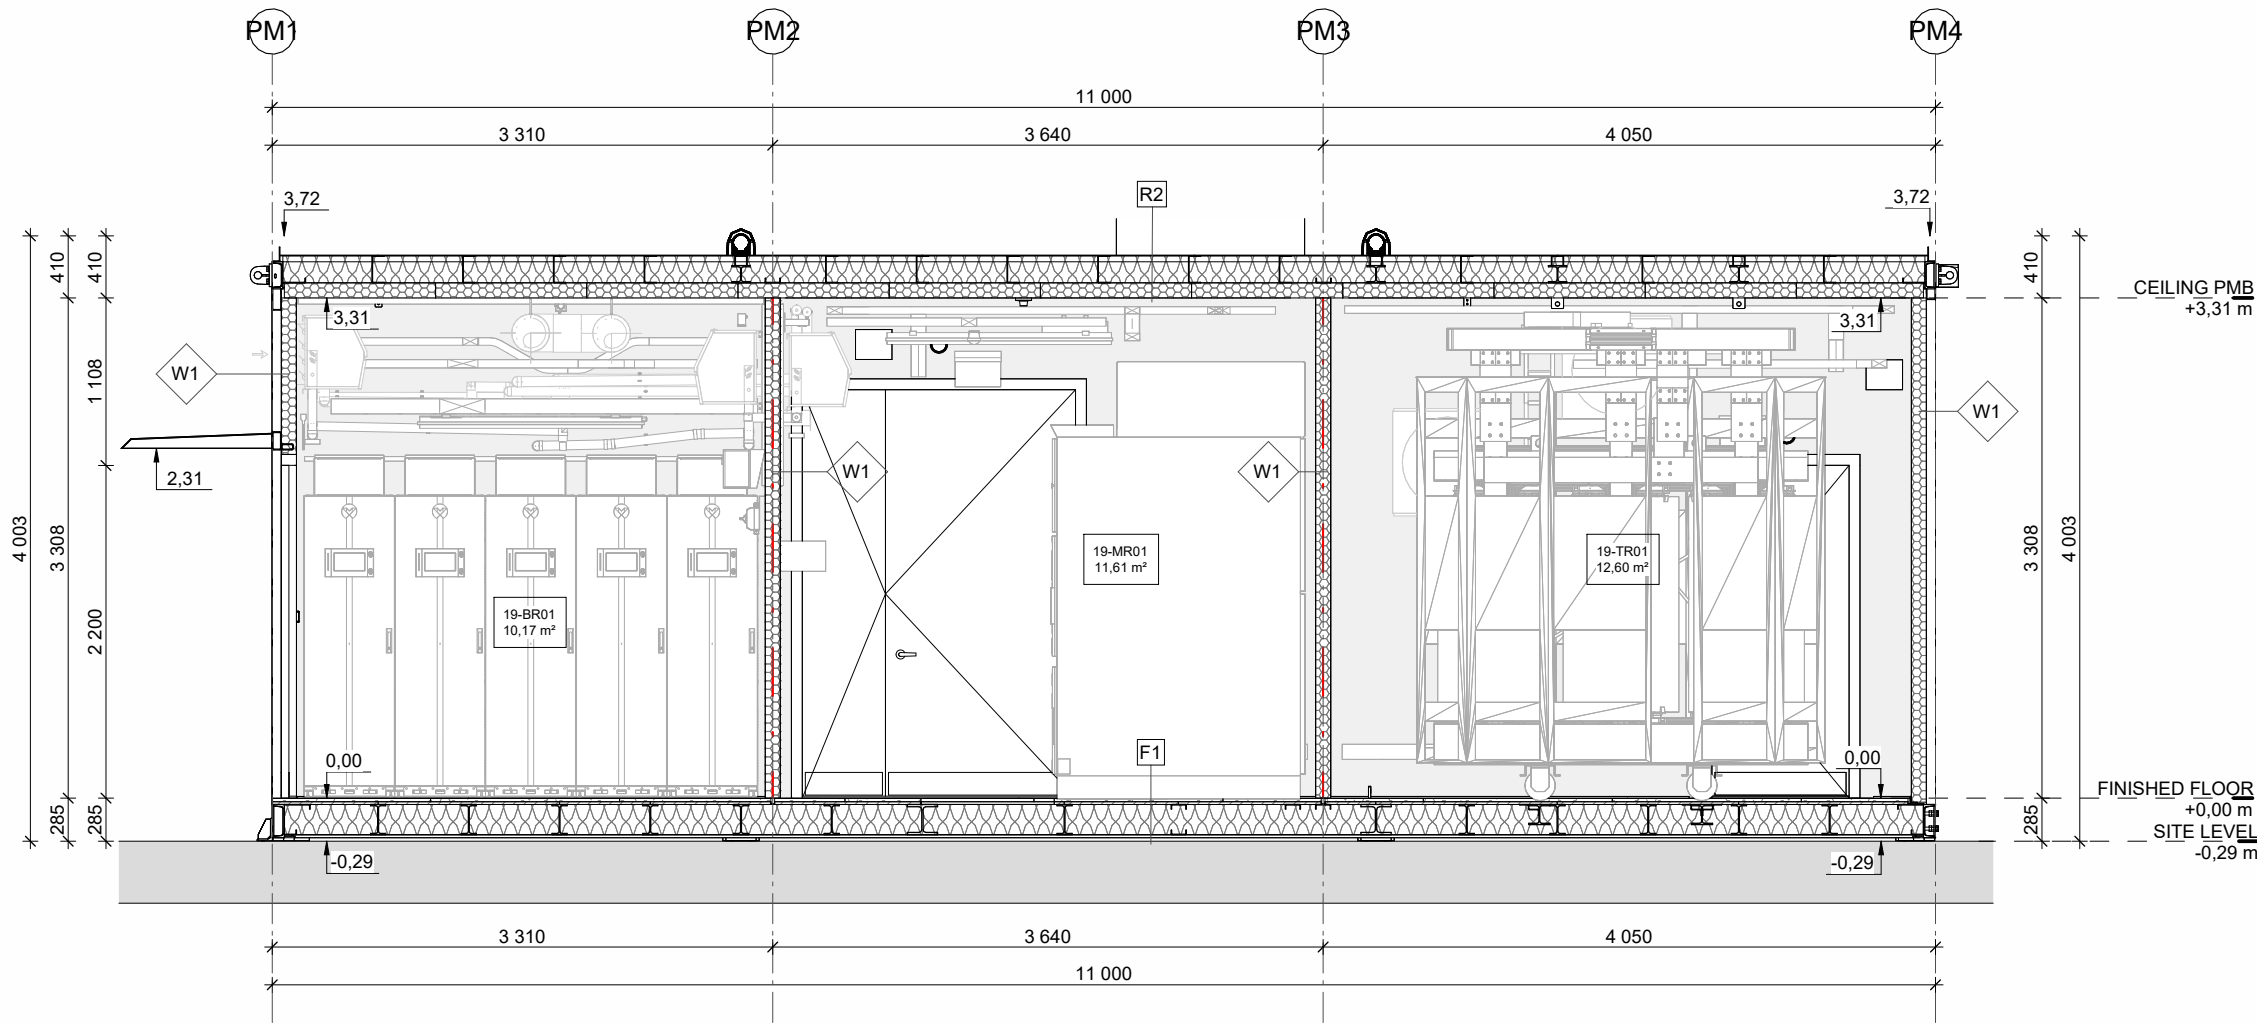


1 POWER MODULE - SECTION A-A
1:50

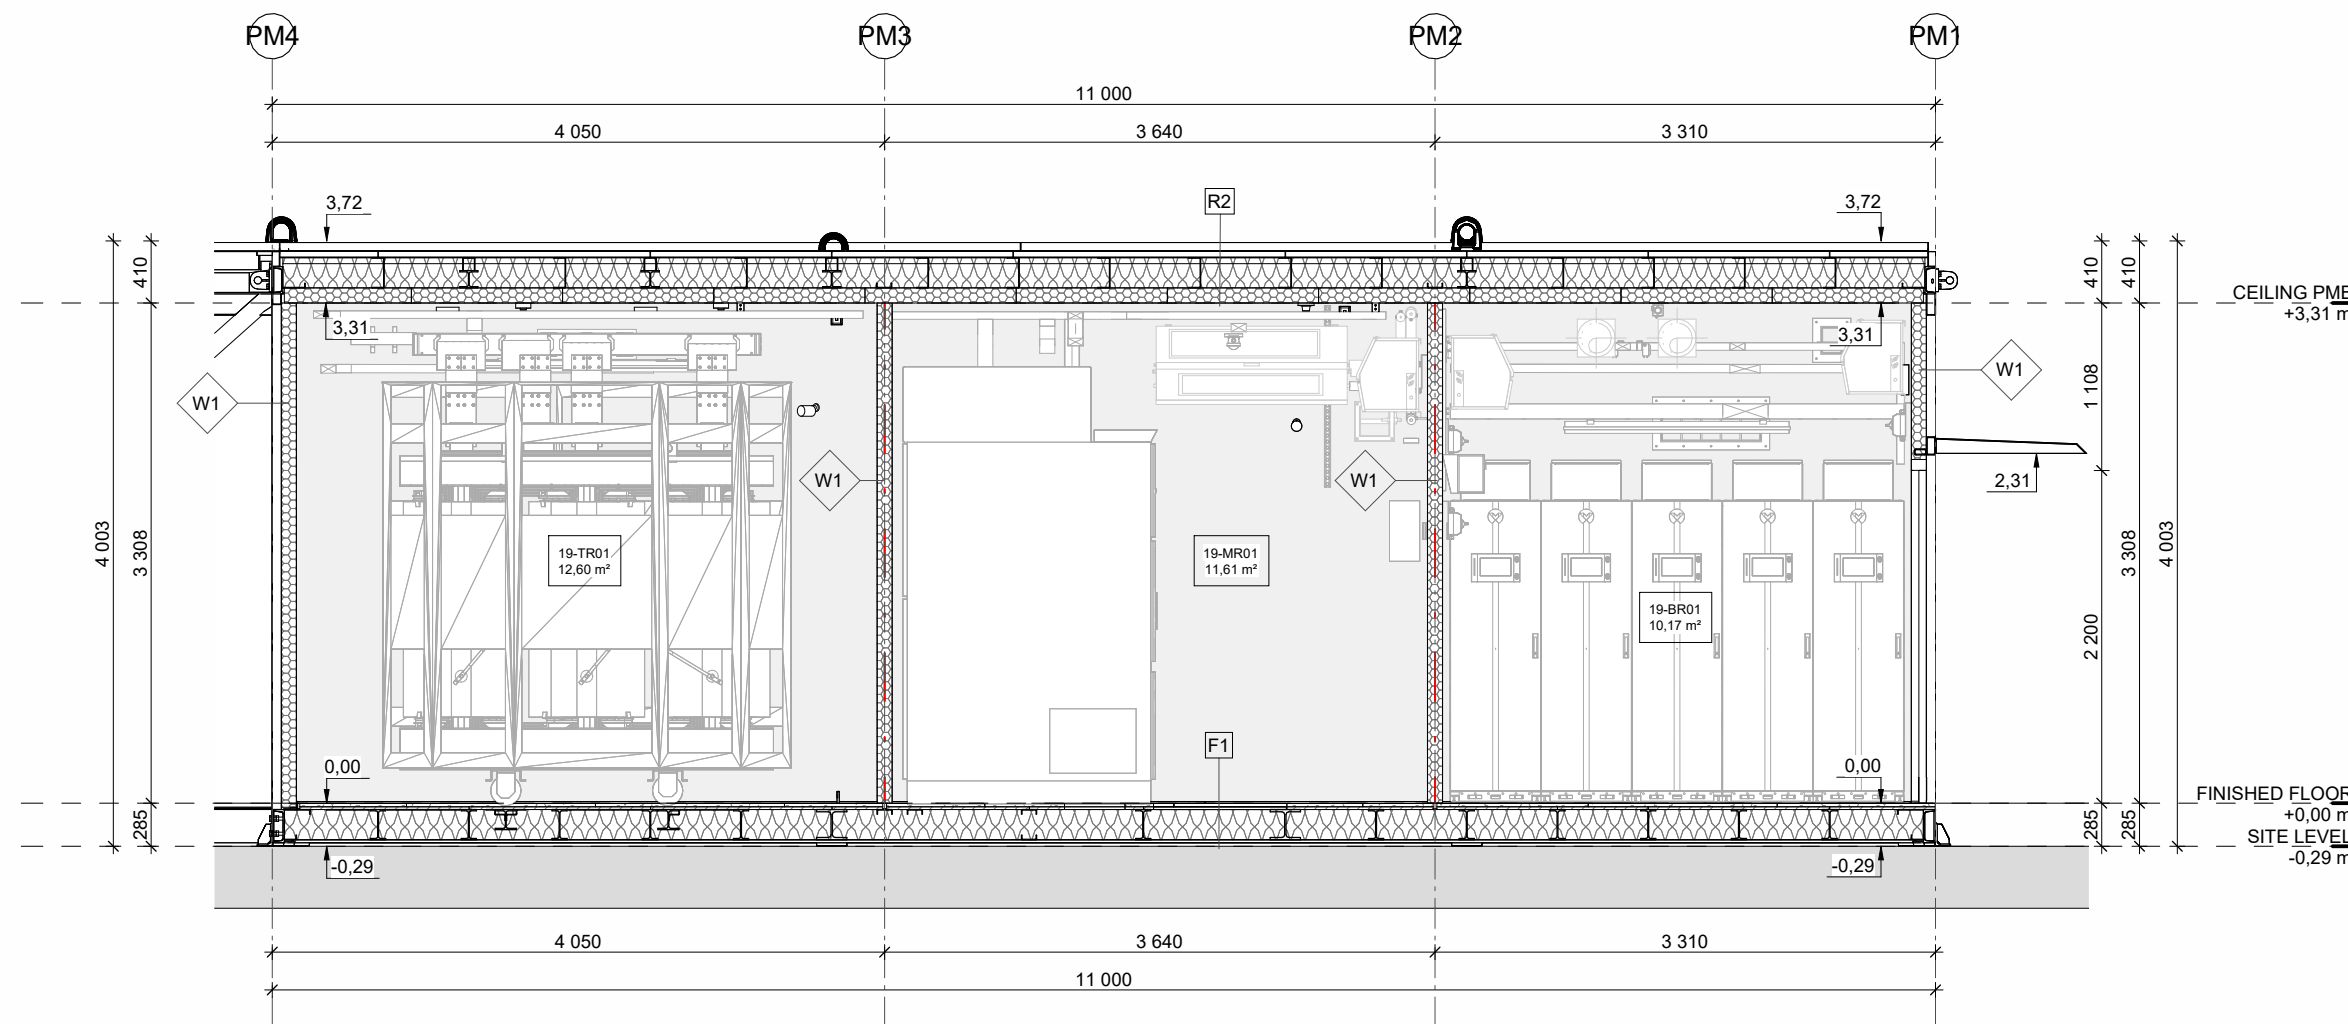


2 POWER MODULE - SECTION B-B
1:50

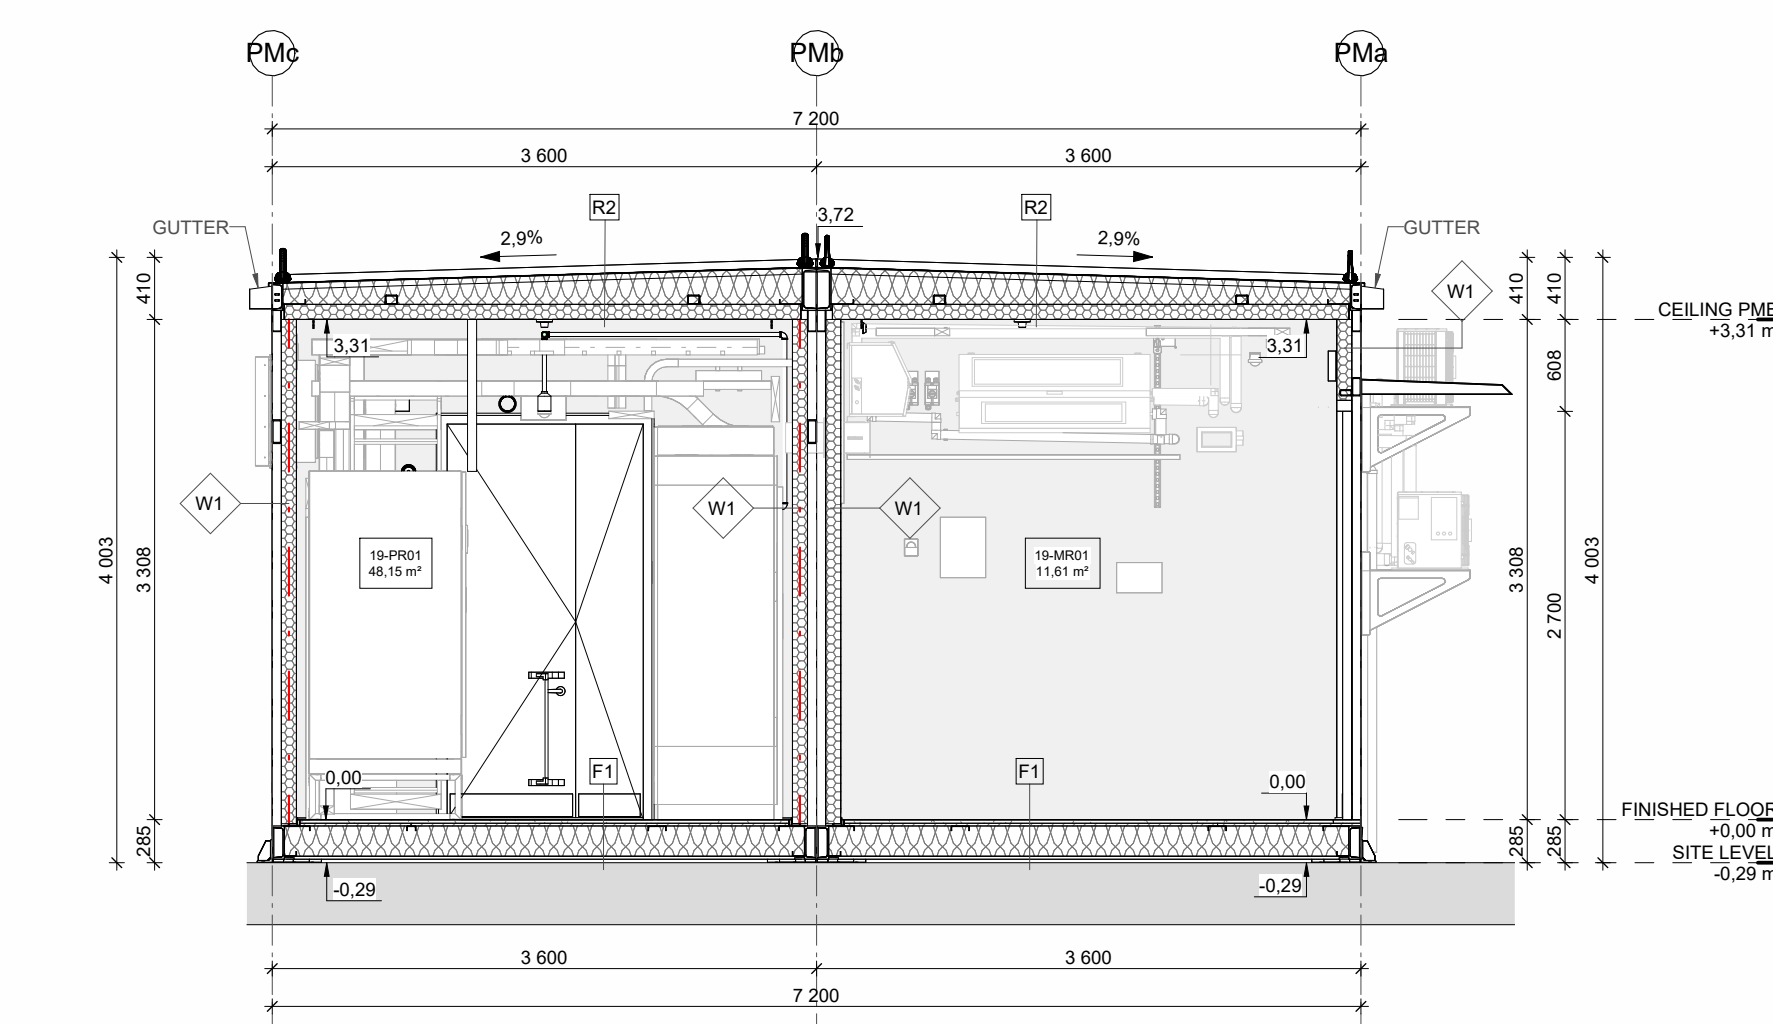


5 POWER MODULE - SECTION 1-1
1:50

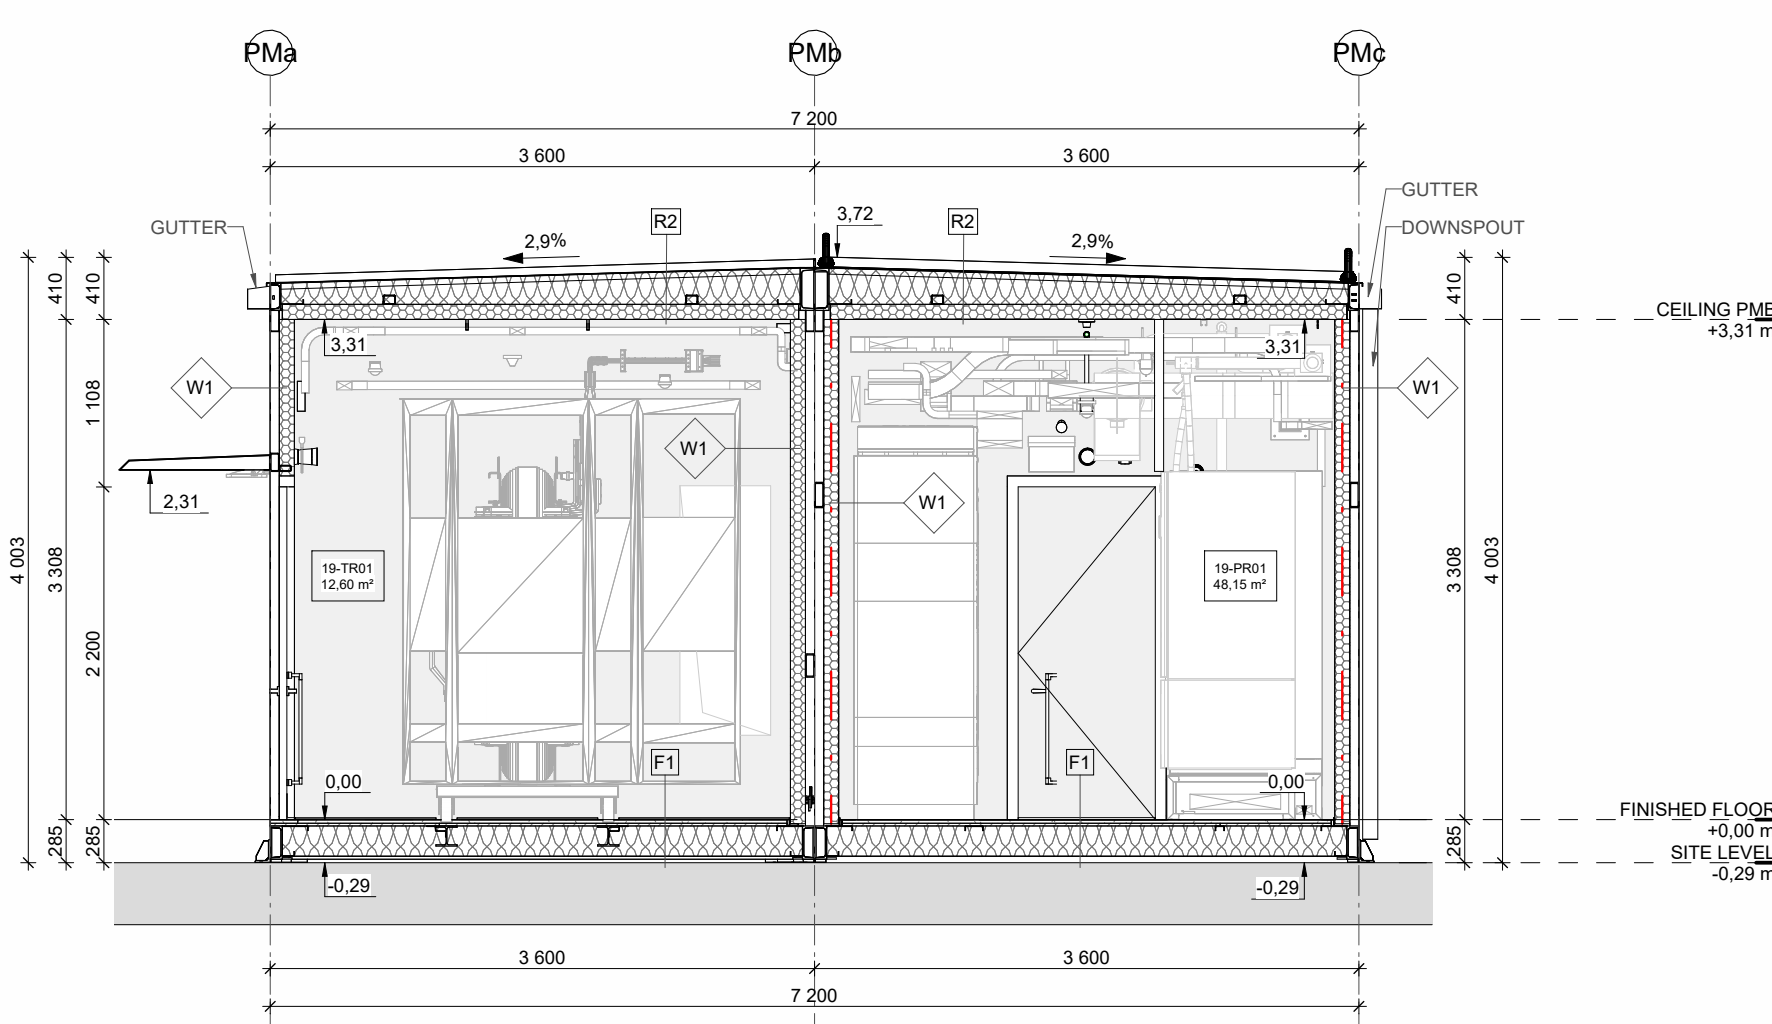


6 POWER MODULE - SECTION 2-2
1:50

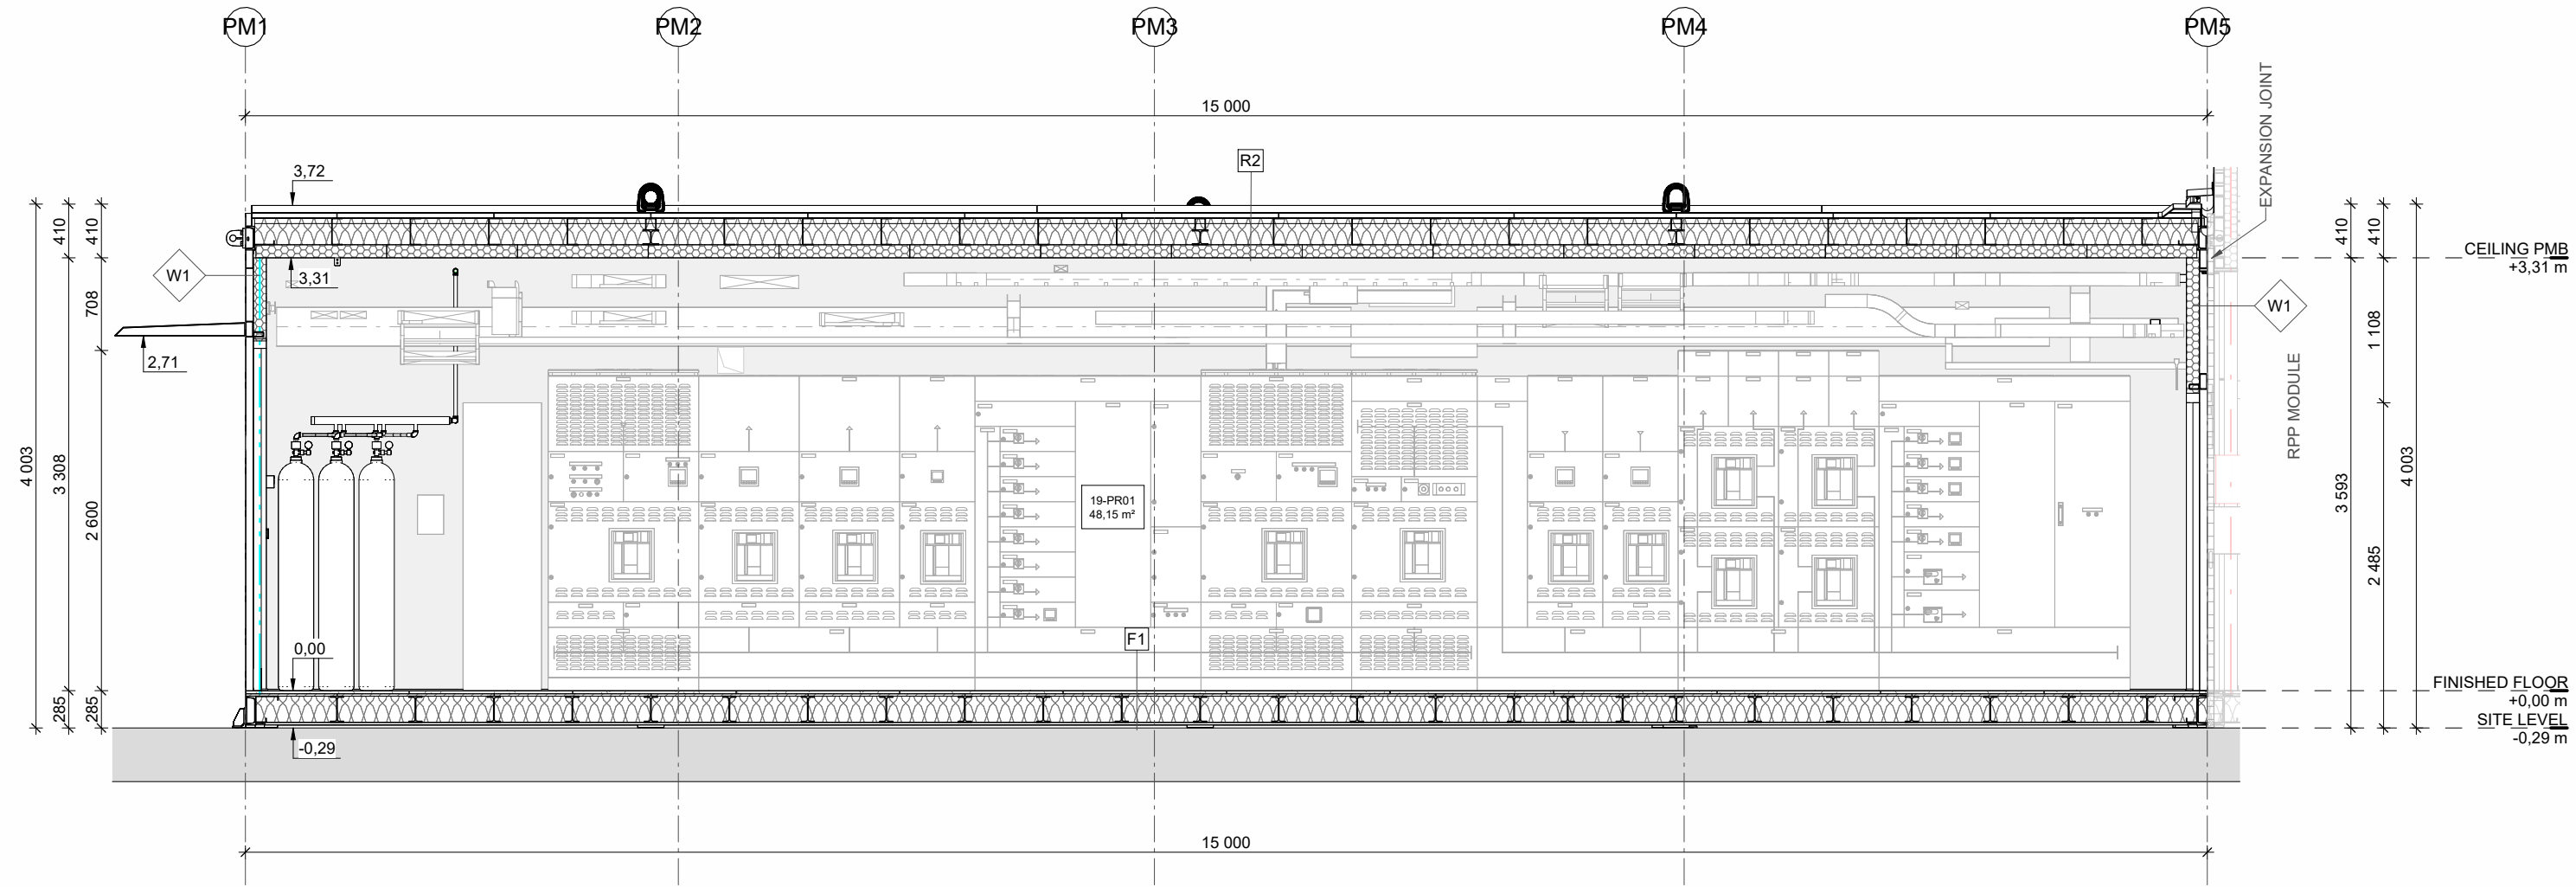

3 POWER MODULE - SECTION C-C
1:50

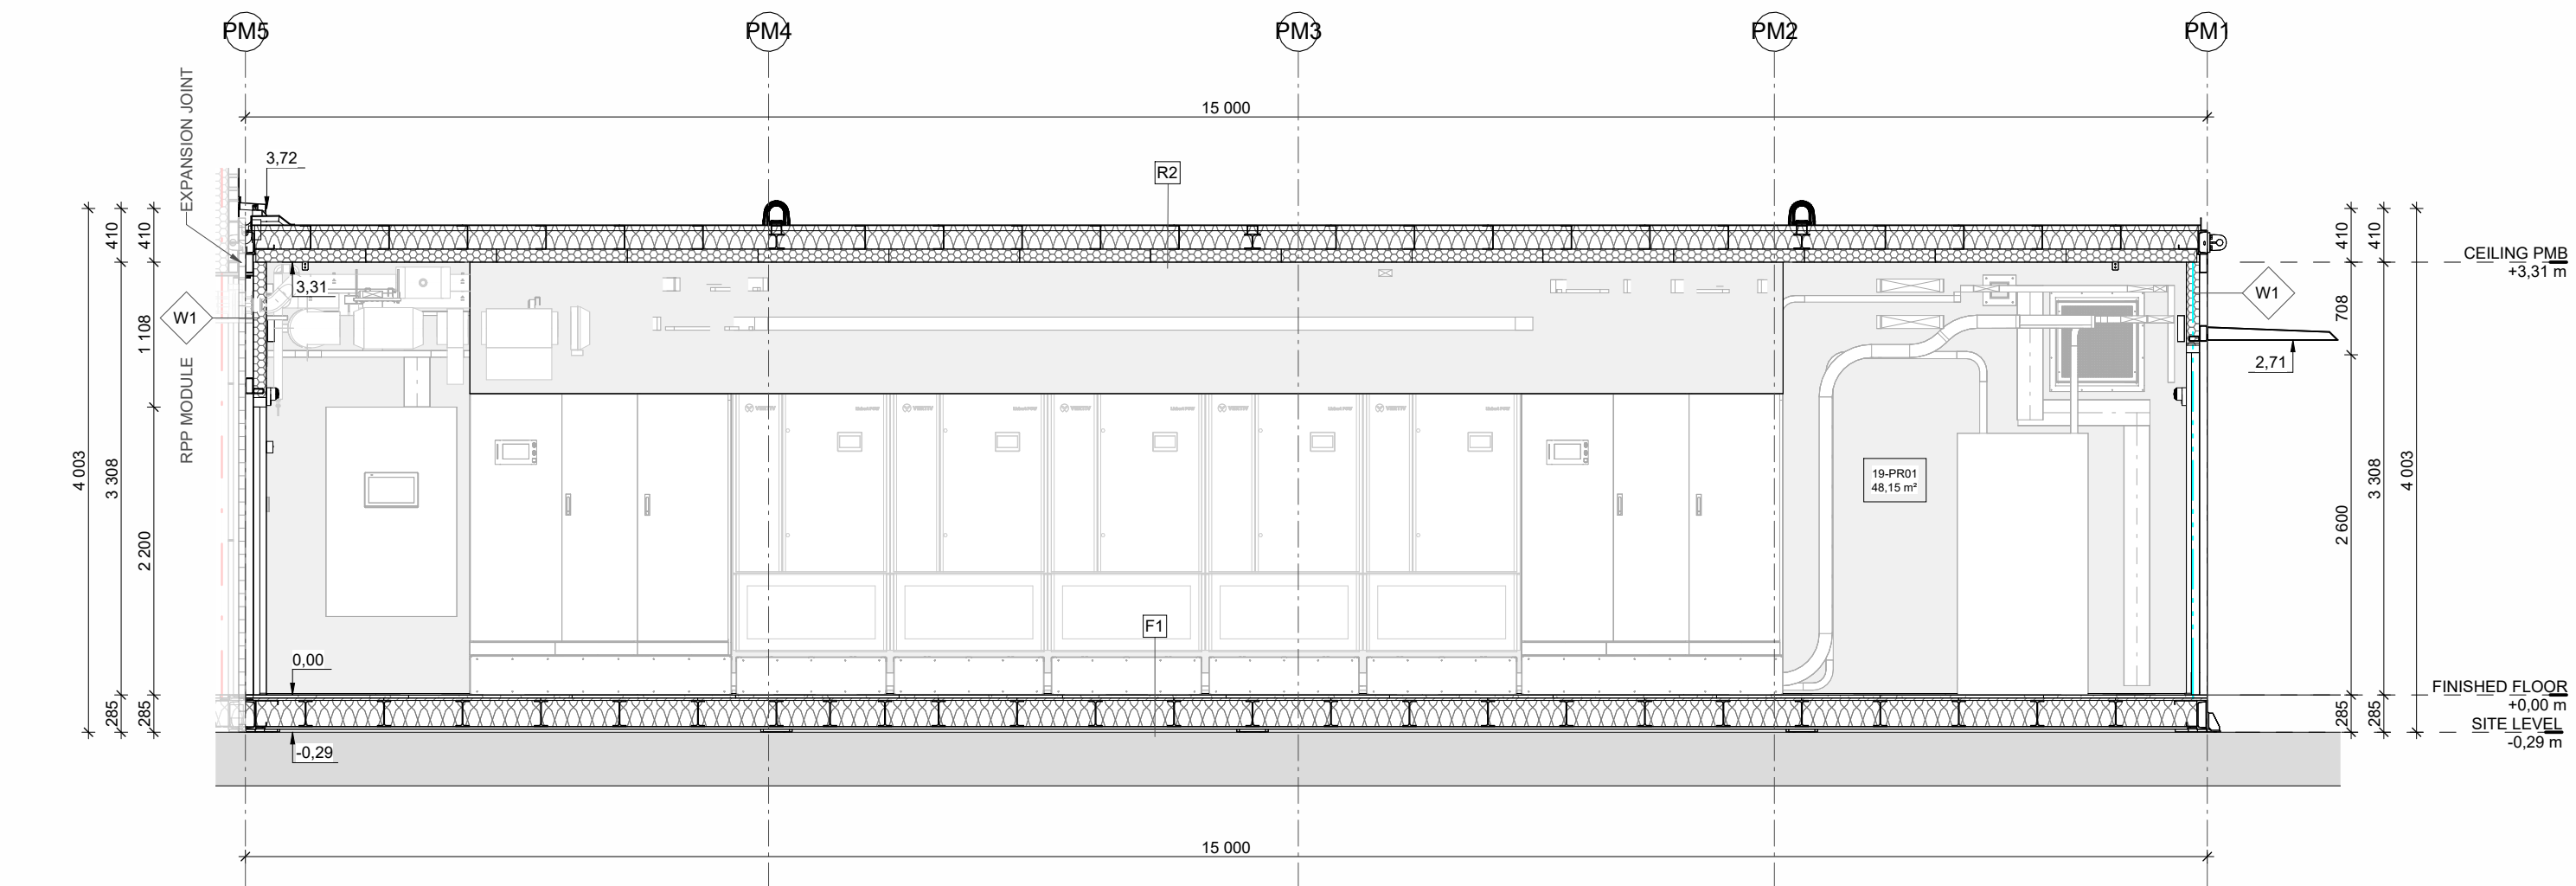


4 POWER MODULE - SECTION D-D
1:50

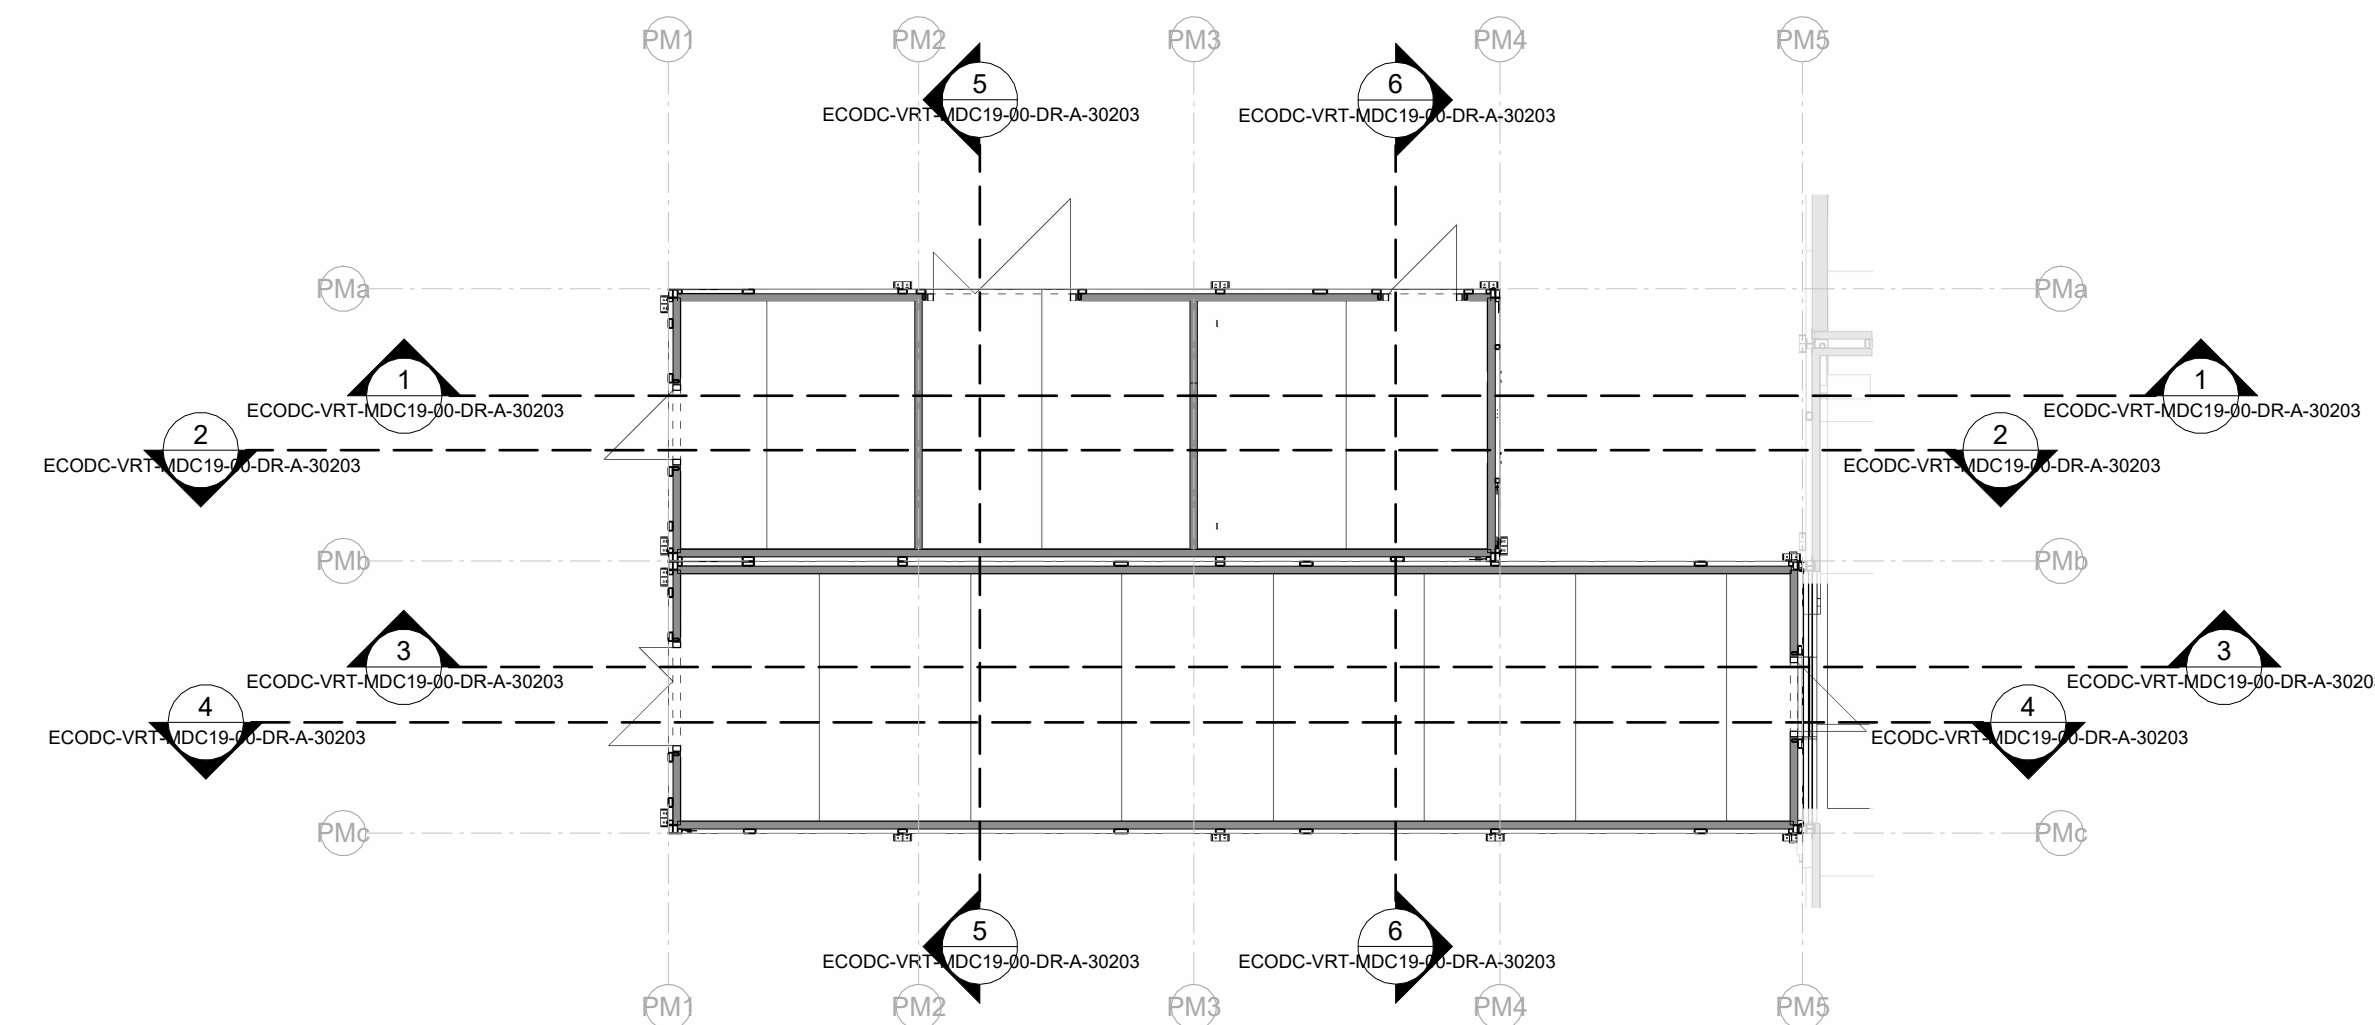

KEY PLAN - POWER MODULE SECTION POSITIONS
1:100

KEYNOTES		
FLOOR SCHEDULE - POWER MODULE		
Type Mark	Description	Fire Rating
F1	Inside to outside: - CERAMIC TILE BOUND 22mm - PL WOOD 18mm - FLOOR STRUCTURE with MINERAL WOOL INFILL 200mm - VAPOUR CONTROL LAYER 0.2mm - STEEL SHEET 0.8mm - UH0.16 WHISK	NA
ROOF SCHEDULE - POWER MODULE		
Type Mark	Description	Fire Rating
R2	Inside to outside: - PREFABRICATED SANDWICH PANEL, TRIMOTERM PERFORM C.F.V. RAL 9006 (EXT.) RAL 9002 (INT.) 100mm - VAPOUR CONTROL LAYER 0.2mm - THERMAL INSULATION (poly isother gap 140.240mm) - STEEL SHEET 0.8mm - UH0.16 WHISK	NA
WALL SCHEDULE - POWER MODULE		
Type Mark	Keynote Description	Fire Rating
W1	- PREFABRICATED SANDWICH PANEL, TRIMOTERM PERFORM C.F.V. RAL 9006 (EXT.) RAL 9002 (INT.) 100mm - UH0.45 WHISK	EI 60 (where indicated)
GENERAL NOTE - ARCHITECTURAL LAYERS ARE LISTED FROM INSIDE TO OUTSIDE - VERTIV RESERVES THE RIGHT TO INSTALL ANY OTHER BRAND OF SANDWICH PANEL, MINERAL WOOL OF EQUAL CHARACTERISTICS AND QUALITY, INSTEAD OF THE PRODUCT SPECIFIED IN THE KEYNOTES, DEPENDING ON THE AVAILABILITY OF THE PRODUCT IN THE MOMENT OF ORDERING - WHERE WALL IS REQUIRED TO PROVIDE FIRE RESISTANCE FROM BOTH SIDES, AND WHERE STRUCTURE LACKS ALTERNATIVE FIRE PROTECTION, INTUMESCENT COATINGS SHALL BE APPLIED TO THE STRUCTURAL ELEMENTS - ALL FACADE PANELS ARE INSTALLED VERTICALLY UNLESS OTHERWISE SPECIFIED - THIS DRAWING SHOWS A SINGLE POWER MODULE AND IS TYPICAL FOR ALL POWER MODULES IN THE PROJECT. EACH MODULE, ALONG WITH ITS CORRESPONDING EQUIPMENT, PENETRATIONS, AND MEP SERVICES, IS IDENTIFIED BY A UNIQUE TAG - BUILDING LAYERS AND STRUCTURE SURFACE COLOUR RAL 9006 EXTERIOR RAL 9002 INTERIOR - ANTICORROSION LEVEL C/M EXTERIOR C/M INTERIOR		
LEGEND - FIRE COMPARTMENT BORDER REIM 60 - FIRE COMPARTMENT BORDER EI 60 - FIRE COMPARTMENT BORDER EI 30 - TRANSPORT COLUMN - OUT OF VERTIV SCOPE - SELF-SUPPORTING CEILING		

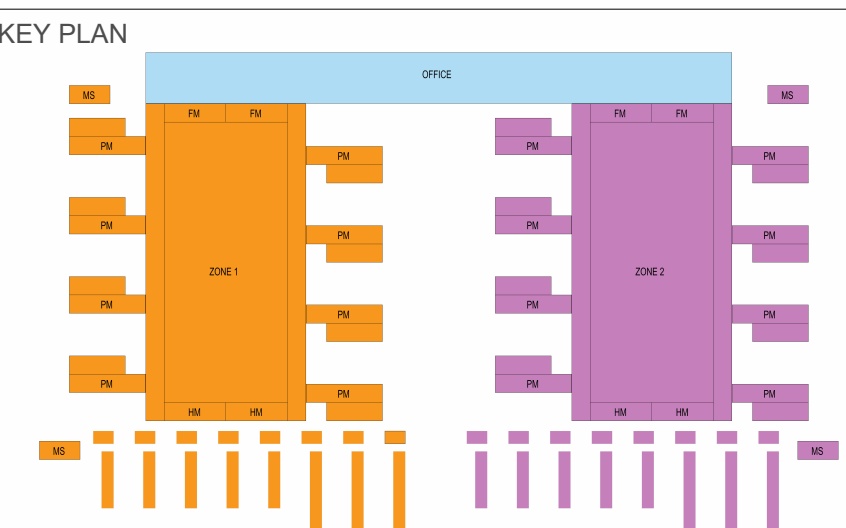

R02 CD SET - FOR INFORMATION 2026-07-24
R01 DD SET - FOR INFORMATION 2026-05-20

REV.	DESCRIPTION	DATE
R02	CD SET - FOR INFORMATION	2026-07-24
R01	DD SET - FOR INFORMATION	2026-05-20



PROJECT NAME
ECO DC MONALISA

DRAWING NAME
**ARCHITECTURAL SECTION VIEWS
- POWER MODULE**

PREPARED (ALSO SUBJECT RESPONSIBLE IF OTHER)
L. MAVREK / K. KOZINA

DOCUMENT RESPONSIBLE / APPROVED
M. PACAK

COO: BIM SYSTEM
AUTODESK REVIT 2025

DOCUMENT NUMBER
ECODC-VRT-MDC19-00-DR-A-30203

SHEET SIZE
A0

DRAWING SCALE
1:50

DATE (YYYYMMDD)
2026-07-24

SHEET 1 OF 1
REVISION
R02