



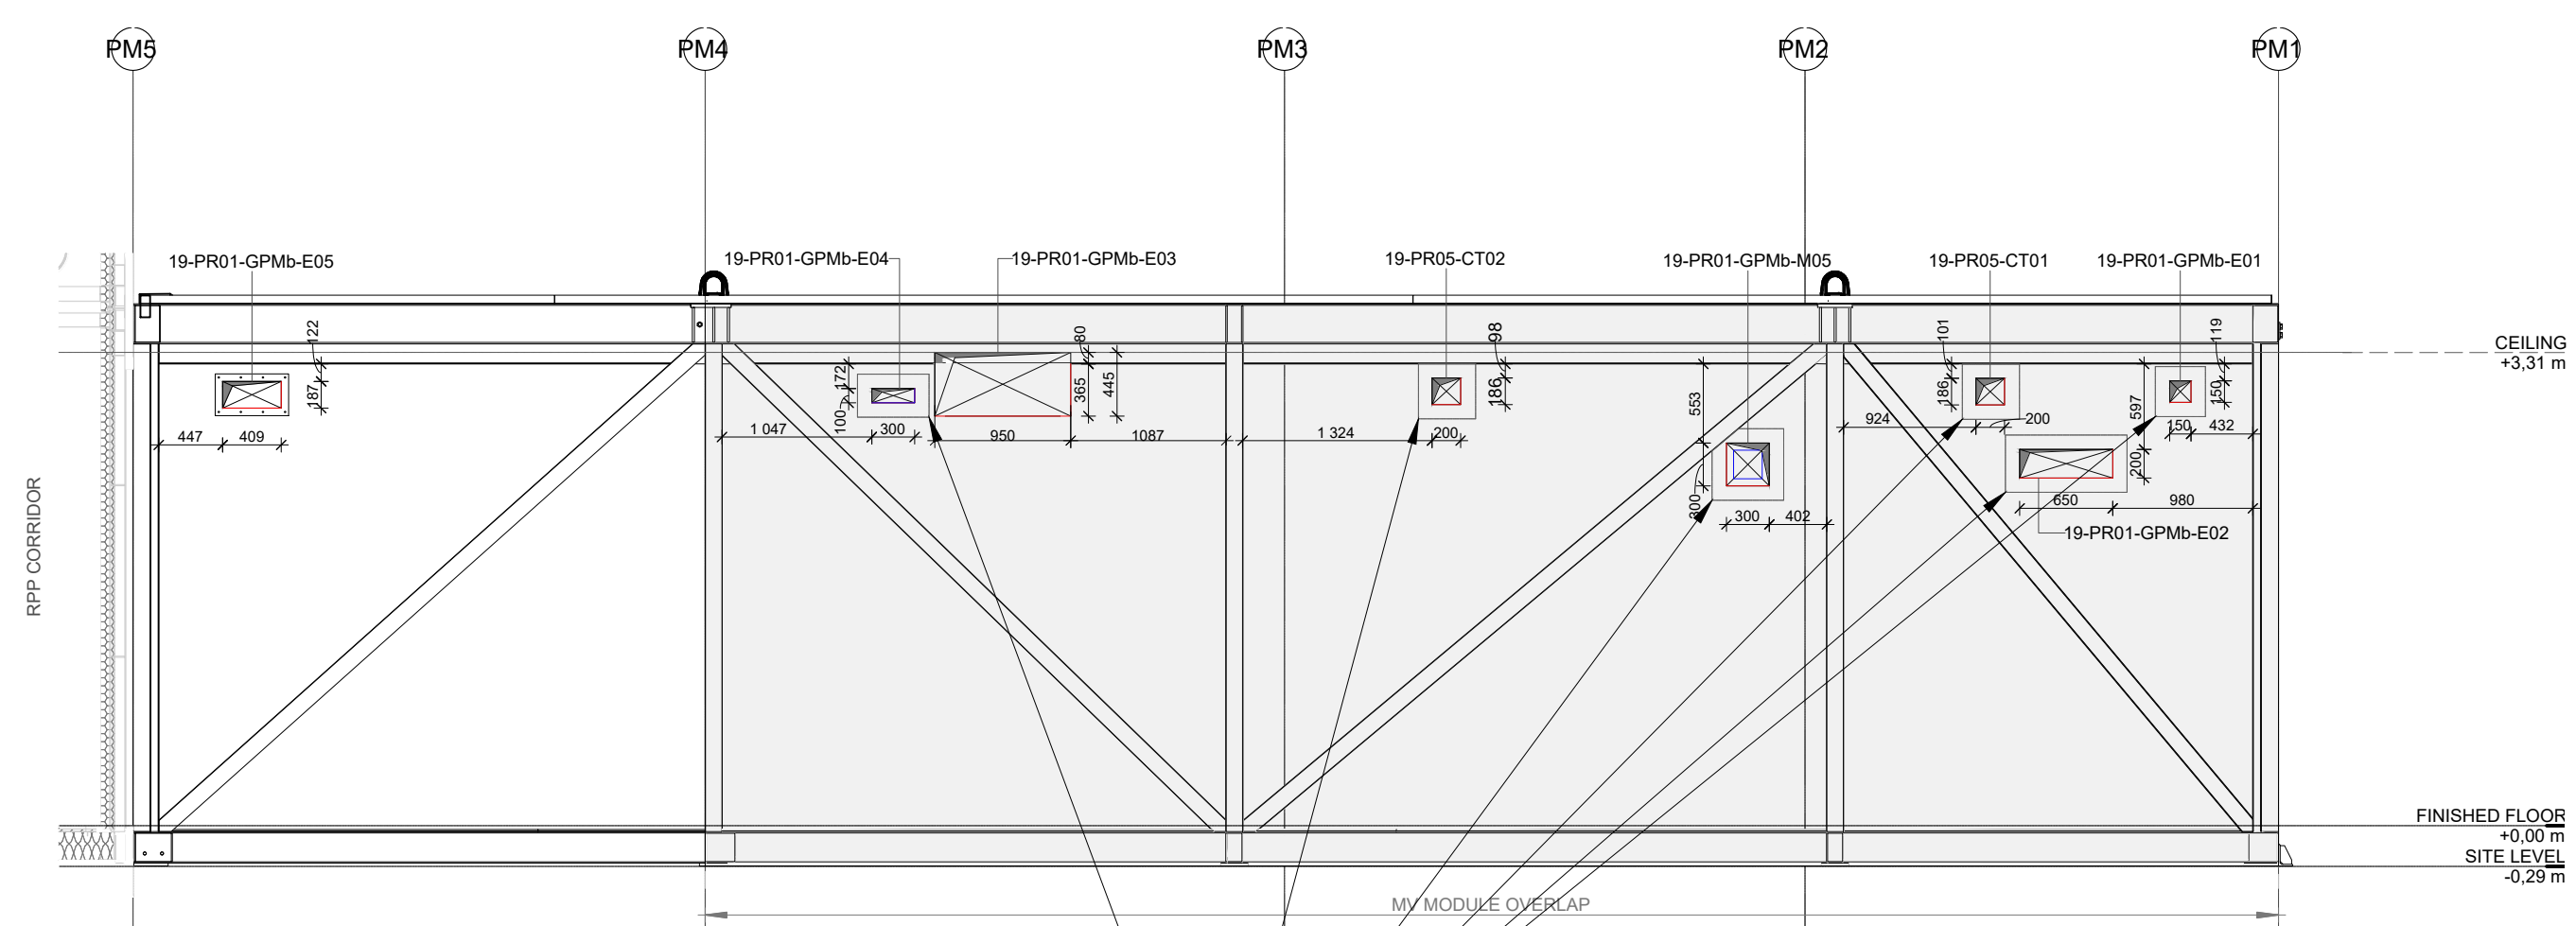


1 PM-ELEVATION NORTH - NEXT TO MV MODULE
1:50


ADD 100 mm WIDE STRIPS OF PANEL 60 mm AROUND OPENING - ON THE EXTERIOR SIDE
TAPE WITH ALU TAPE AND PLACE FLASHING I00000331314 OVER THE PANEL

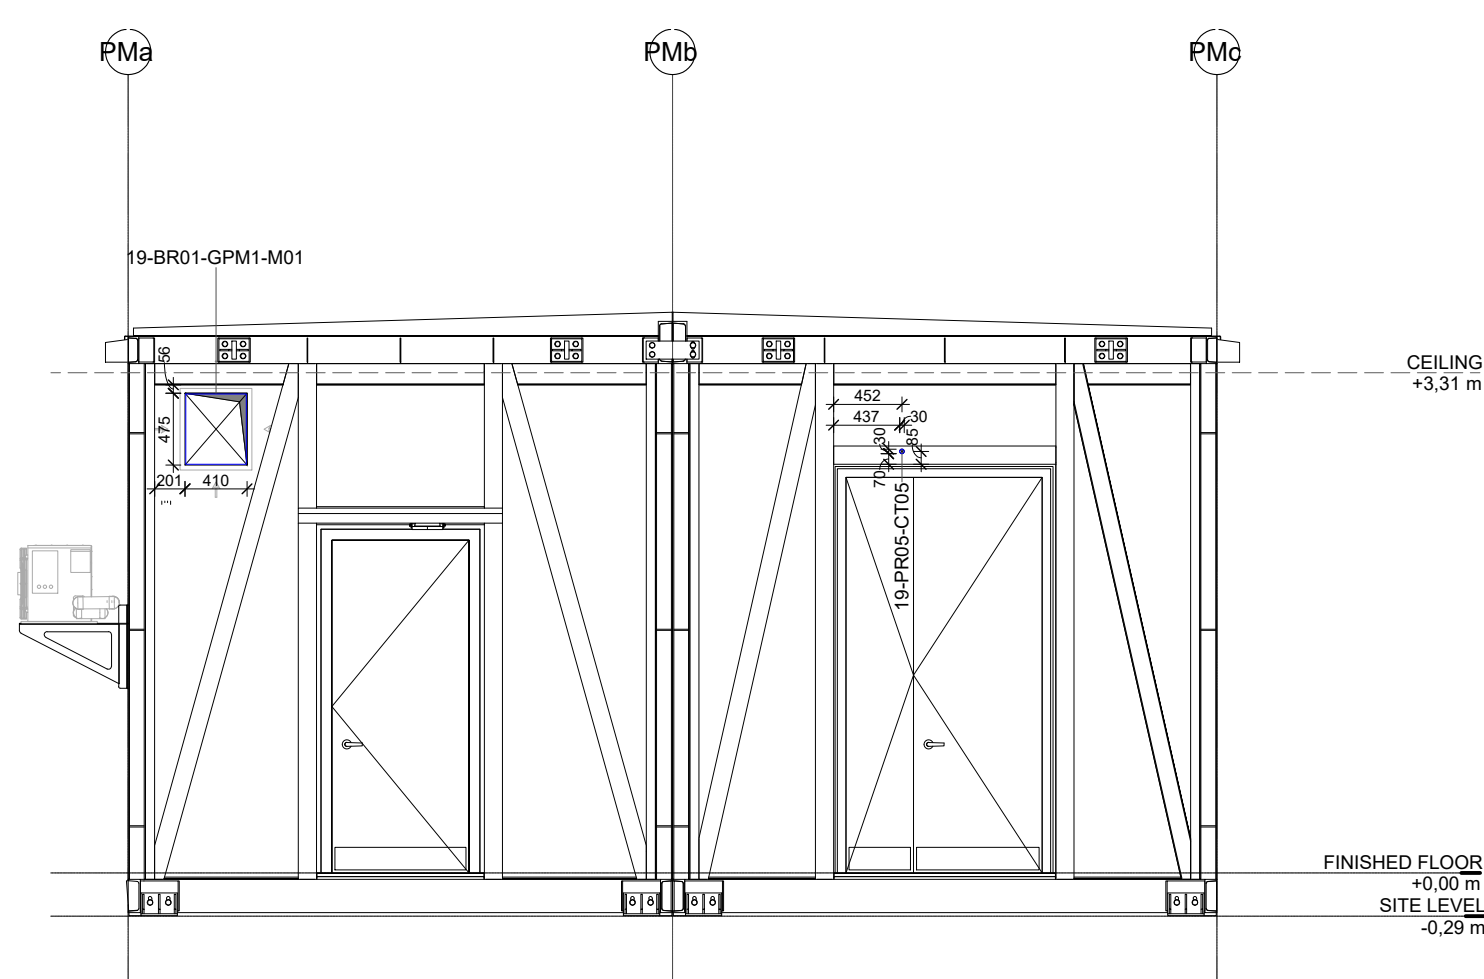


5 PM+MV-ELEVATION EAST
1:50

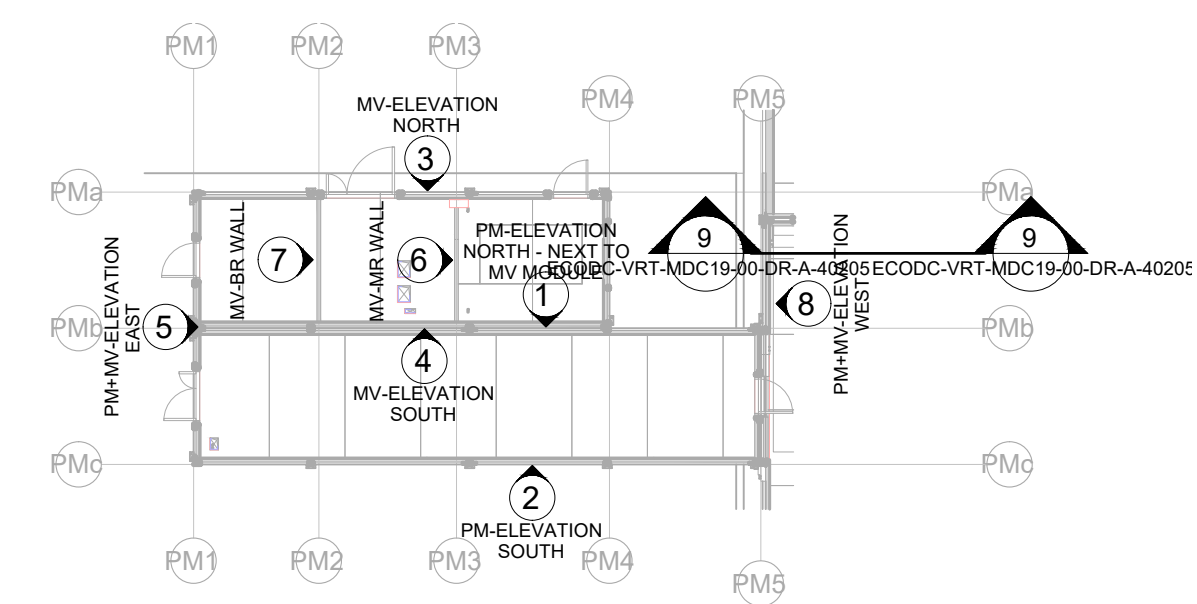

KEYPLAN – POWER MODULE – PEN ELEVATION POSITIONS

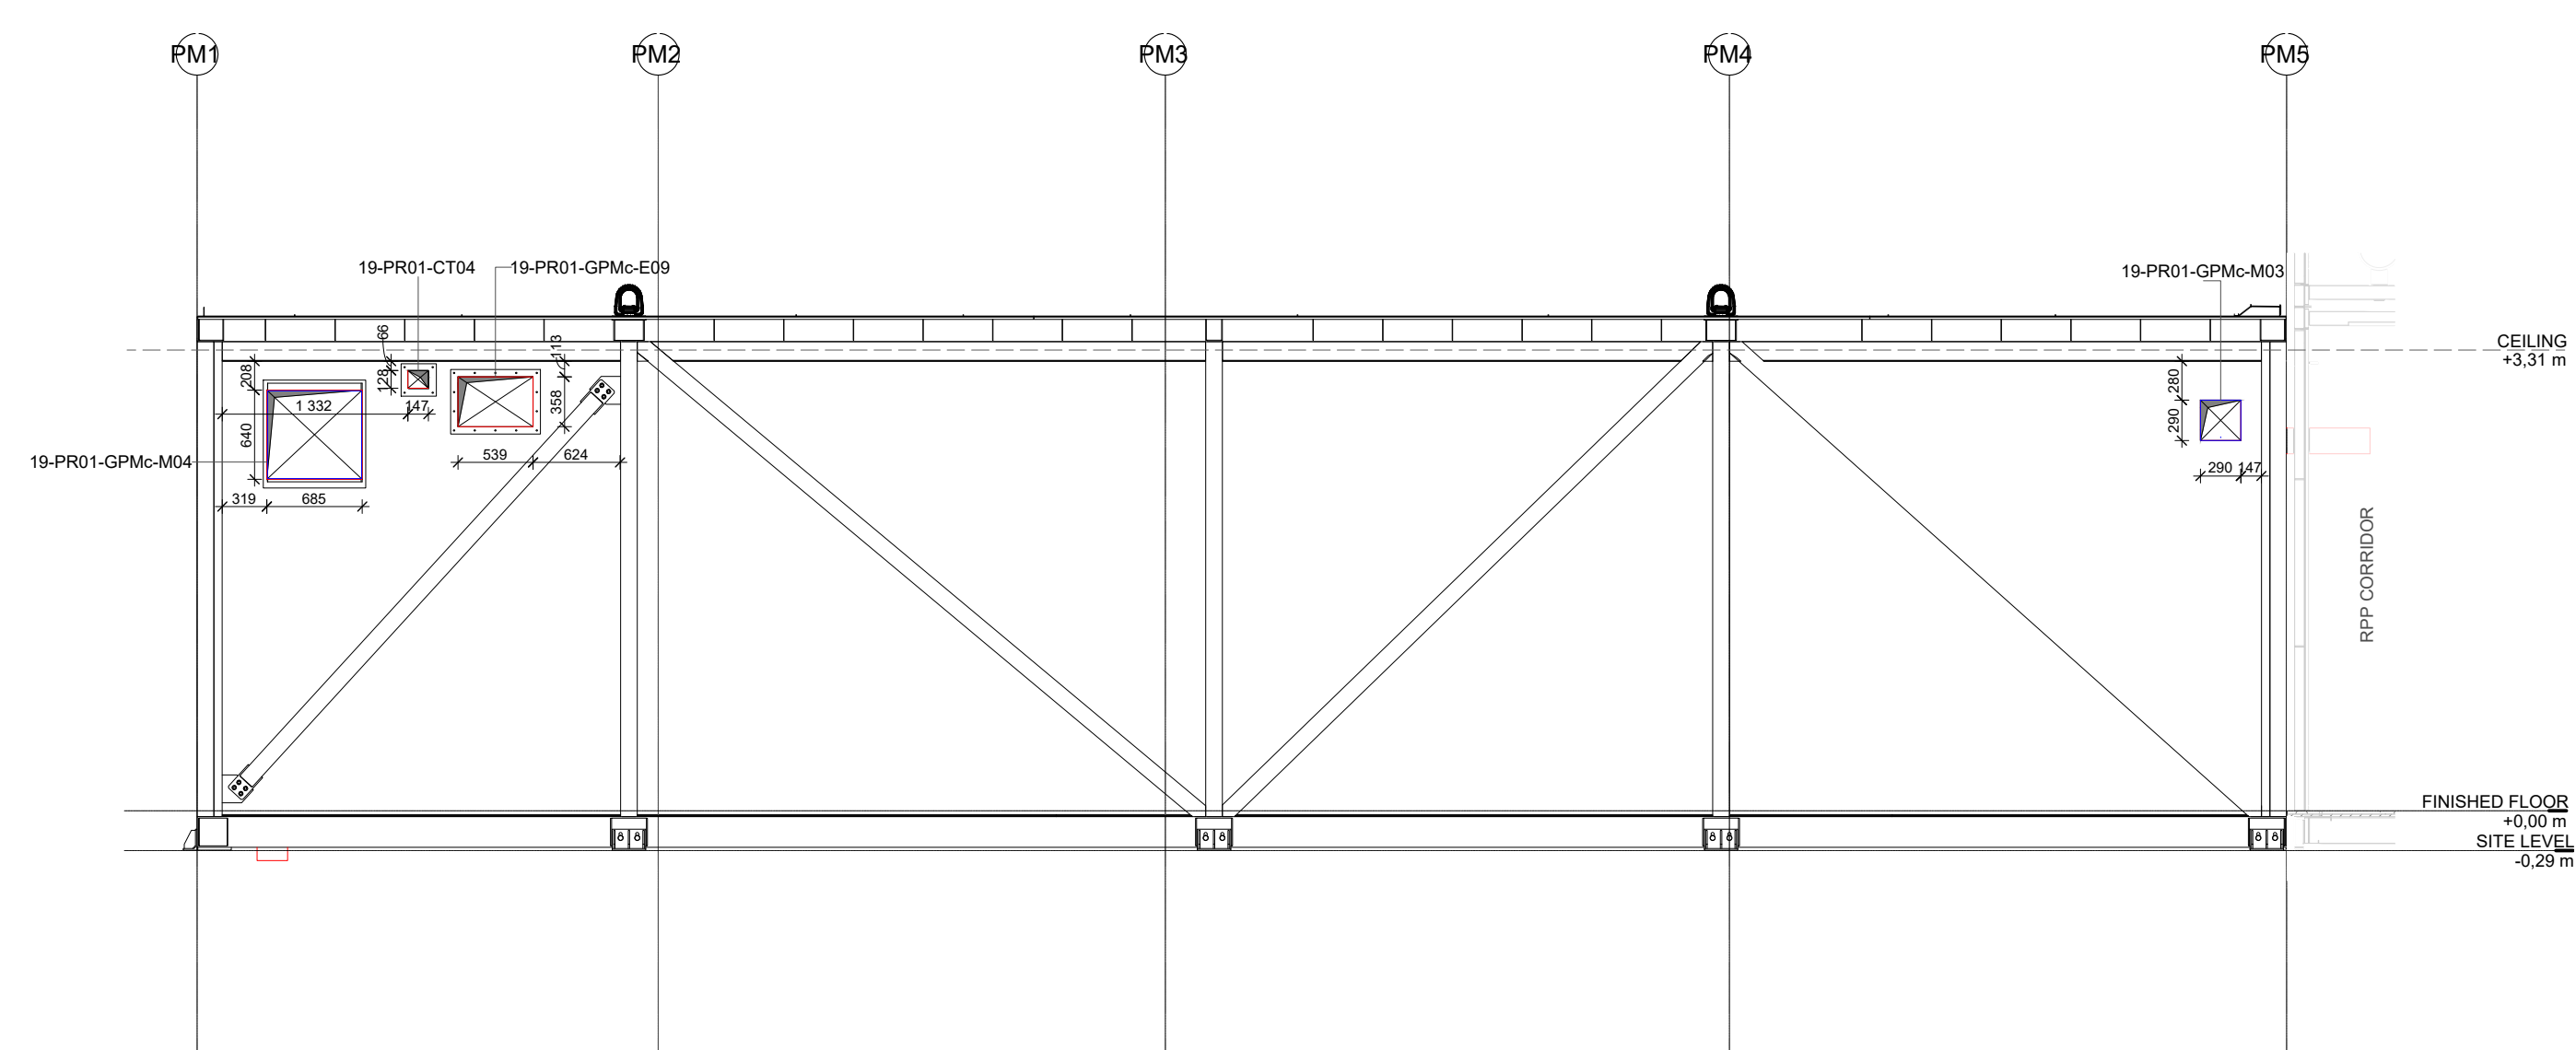

② PM-ELEVATION SOUTH
1 : 50

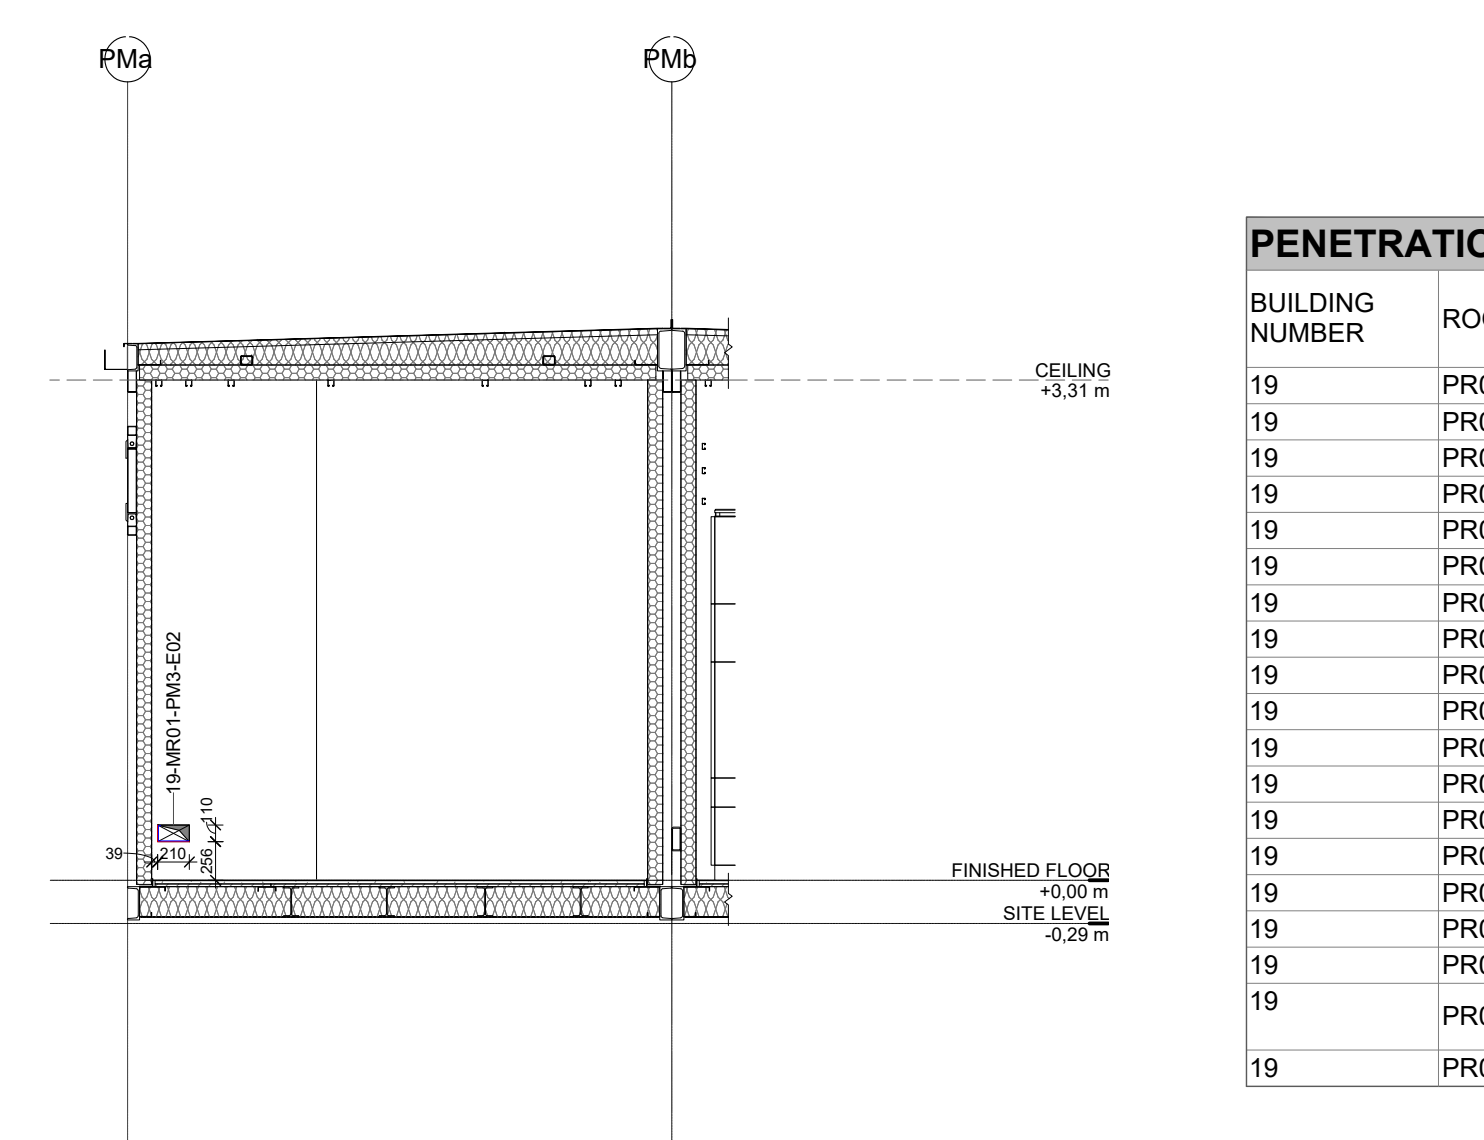


6 MV-MR WALL
1:50

PENETRATION SCHEDULE - POWER MODULE											
BUILDING NUMBER	ROOM NUMBER	GRID	PENETRATION MARK	PENETRATION TYPE	PENETRATION DESCRIPTION	PENETRATION DETAIL TYPE	FINAL OPENING DIAMETER	FINAL OPENING HEIGHT	FINAL OPENING WIDTH	INSIDE FLASHING	OUTSIDE FLASHING
19	PR01	GPMB	CT01	H88	Controls Cables	P04		188	200	000000336622	00000336622
19	PR01	GPMB	CT02	H88	Controls Cables	P04		188	200	000000336622	00000336622
19	PR01	GPMB	CT03	R08x6c GHM 4x1 GALV.	Controls Cables	P01		188	147	000000330010	00000325846
19	PR01	<varies>	CT04	R08x6c GHM 2x1 GALV.	Controls Cables	P01		128	147	000000330010	00000325847
19	PR01	GPMB	CT05	H88	Controls Cables	P04	30	188	200	000000336622	00000336622
19	PR01	GPMB	E01	H88	GPL - Battery Room	P04		150	150	000000336622	00000336622
19	PR01	GPMB	E02	H88	DC Cables	P04		200	650	000000336622	00000336622
19	PR01	GPMB	E03	H88	Busbar	P09		445	803	000000336622	00000336622
19	PR01	GPMB	E04	H88	GPL - Controls - Transformer Room	P04		100	300	000000336622	00000336622
19	PR01	GPMB	E05	R08x6c GH 4x3 GALV.	Chiller	P01		187	409	000000330010	00000325849
19	PR01	GPMB	E06	R08x6c GH 4x2 AISI 316	Q27 - QZ 13 Cables	P01		187	278	000000330010	00000325852
19	PR01	GPMB	E07	R08x6c GH 4x4 AISI 316	RPR (2x - Q1-A-Q1 11)	P01		187	559	000000330010	00000325851
19	PR01	GPMB	E08	R08x6c GH 4x3 AISI 316	RPR (2x)	P01		187	409	000000330010	00000325849
19	PR01	GPMB	E09	R08x6c GH 4+4x4 AISI 316	Generator Cables	P01		358	539	000000330010	00000336059
19	PR01	GPMB	M01	R08x6c RS - SLFRS 125	R08x6c	P02	154			000000331457	00000326153
19	PR01	GPMB	M02	R08x6c RS - SLFRS 125	R08x6c	P02	154			000000331457	00000326153
19	PR01	GPMB	M03	TR0X FRRS-EV	Fire damper	P06	250	290	290	000000331466	000003273252
19	PR01	GPMB	M04	BSV 675x830 EV500 SGHD ASM	Pressure Relief Damper - intrusion protection	P10b		640	685	000000330010	00000336622
19	PR01	GPMB	M05	TR0X FKA2-EV	Fire damper	P08		300	300	000000330010	00000330010


PENETRATION SCHEDULE - BATTERY ROOM											
BUILDING NUMBER	ROOM NUMBER	GRID	PENETRATION MARK	PENETRATION TYPE	PENETRATION DESCRIPTION	PENETRATION DETAIL TYPE	FINAL OPENING DIAMETER	FINAL OPENING HEIGHT	FINAL OPENING WIDTH	INSIDE FLASHING	OUTSIDE FLASHING
10	BR01	PM2	E01	Hill	GPL - RMU Room	P05		110	310	100000330010	100000330104
19	BR01	GP01	M01	Klimaprema	AFZV Weather Louvre	P11		475	410	100000330010	100000330144
19	BR01	GP04	M02	Roxtec GHM 8x1 AISI	Roxtec	P01		305	108	100000330010	100000330182
19	BR01	GP04	M03	Roxtec GHM 8x1 AISI	Roxtec	P01		305	108	100000330010	100000330182
19	BR01	GP04	M04	RS 45 AISI316	Roxtec	P02		620		100000331445	100000332714
19	BR01	GP04	M05	Systemair IGC 200	IGC Weather Louvre		210			100000361264	100000361260

PENETRATION SCHEDULE - MV ROOM											FINAL OPENING DIAMETER	FINAL OPENING HEIGHT	FINAL OPENING WIDTH	INSIDE FLASHING	OUTSIDE FLASHING
BUILDING NUMBER	ROOM NUMBER	GRID	PENETRATION MARK	PENETRATION TYPE	PENETRATION DESCRIPTION	PENETRATION DETAIL TYPE									
19	MR01	GP2M	E01	Opening	Arc Blast Channel	P13			510	1250		/		I00000341413	
19	MR01	GP2M	H01	Hill	MV Cables	P05			110	215		I00000330010			
19	MR01	GP2M	H01	Hill	DX Pipes	P05			209	325		I00000330010			
19	MR01	GP2M2	M02	TROX FKA2-EU	Fire damper	P07			221	325		I00000330010		I00000330010	
19	MR01	GP2M2	M03	Hill	Condensate Pipe	P05			66	424	220	I00000330010		I00000330010	

PENETRATION SCHEDULE - TRANSFORMER ROOM											
BUILDING NUMBER	ROOM NUMBER	GRID	PENETRATION MARK	PENETRATION TYPE	PENETRATION DESCRIPTION	PENETRATION DETAIL TYPE	FINAL OPENING DIAMETER	FINAL OPENING HEIGHT	FINAL OPENING WIDTH	INSIDE FLASHING	OUTSIDE FLASHING
19	TR01	GP4a	M01	Systemair WAK 60 Louvre	Louvre		590	590	590		
19	TR01	GP4a	M02	Systemair WAK 60 Louvre	Louvre		590	590	590		
19	TR01	GP4a	M03	TROX WG-AL Louvre 600x1650	Louvre + intrusion protection	P11b	1685	635	635	00000356487	1px frame

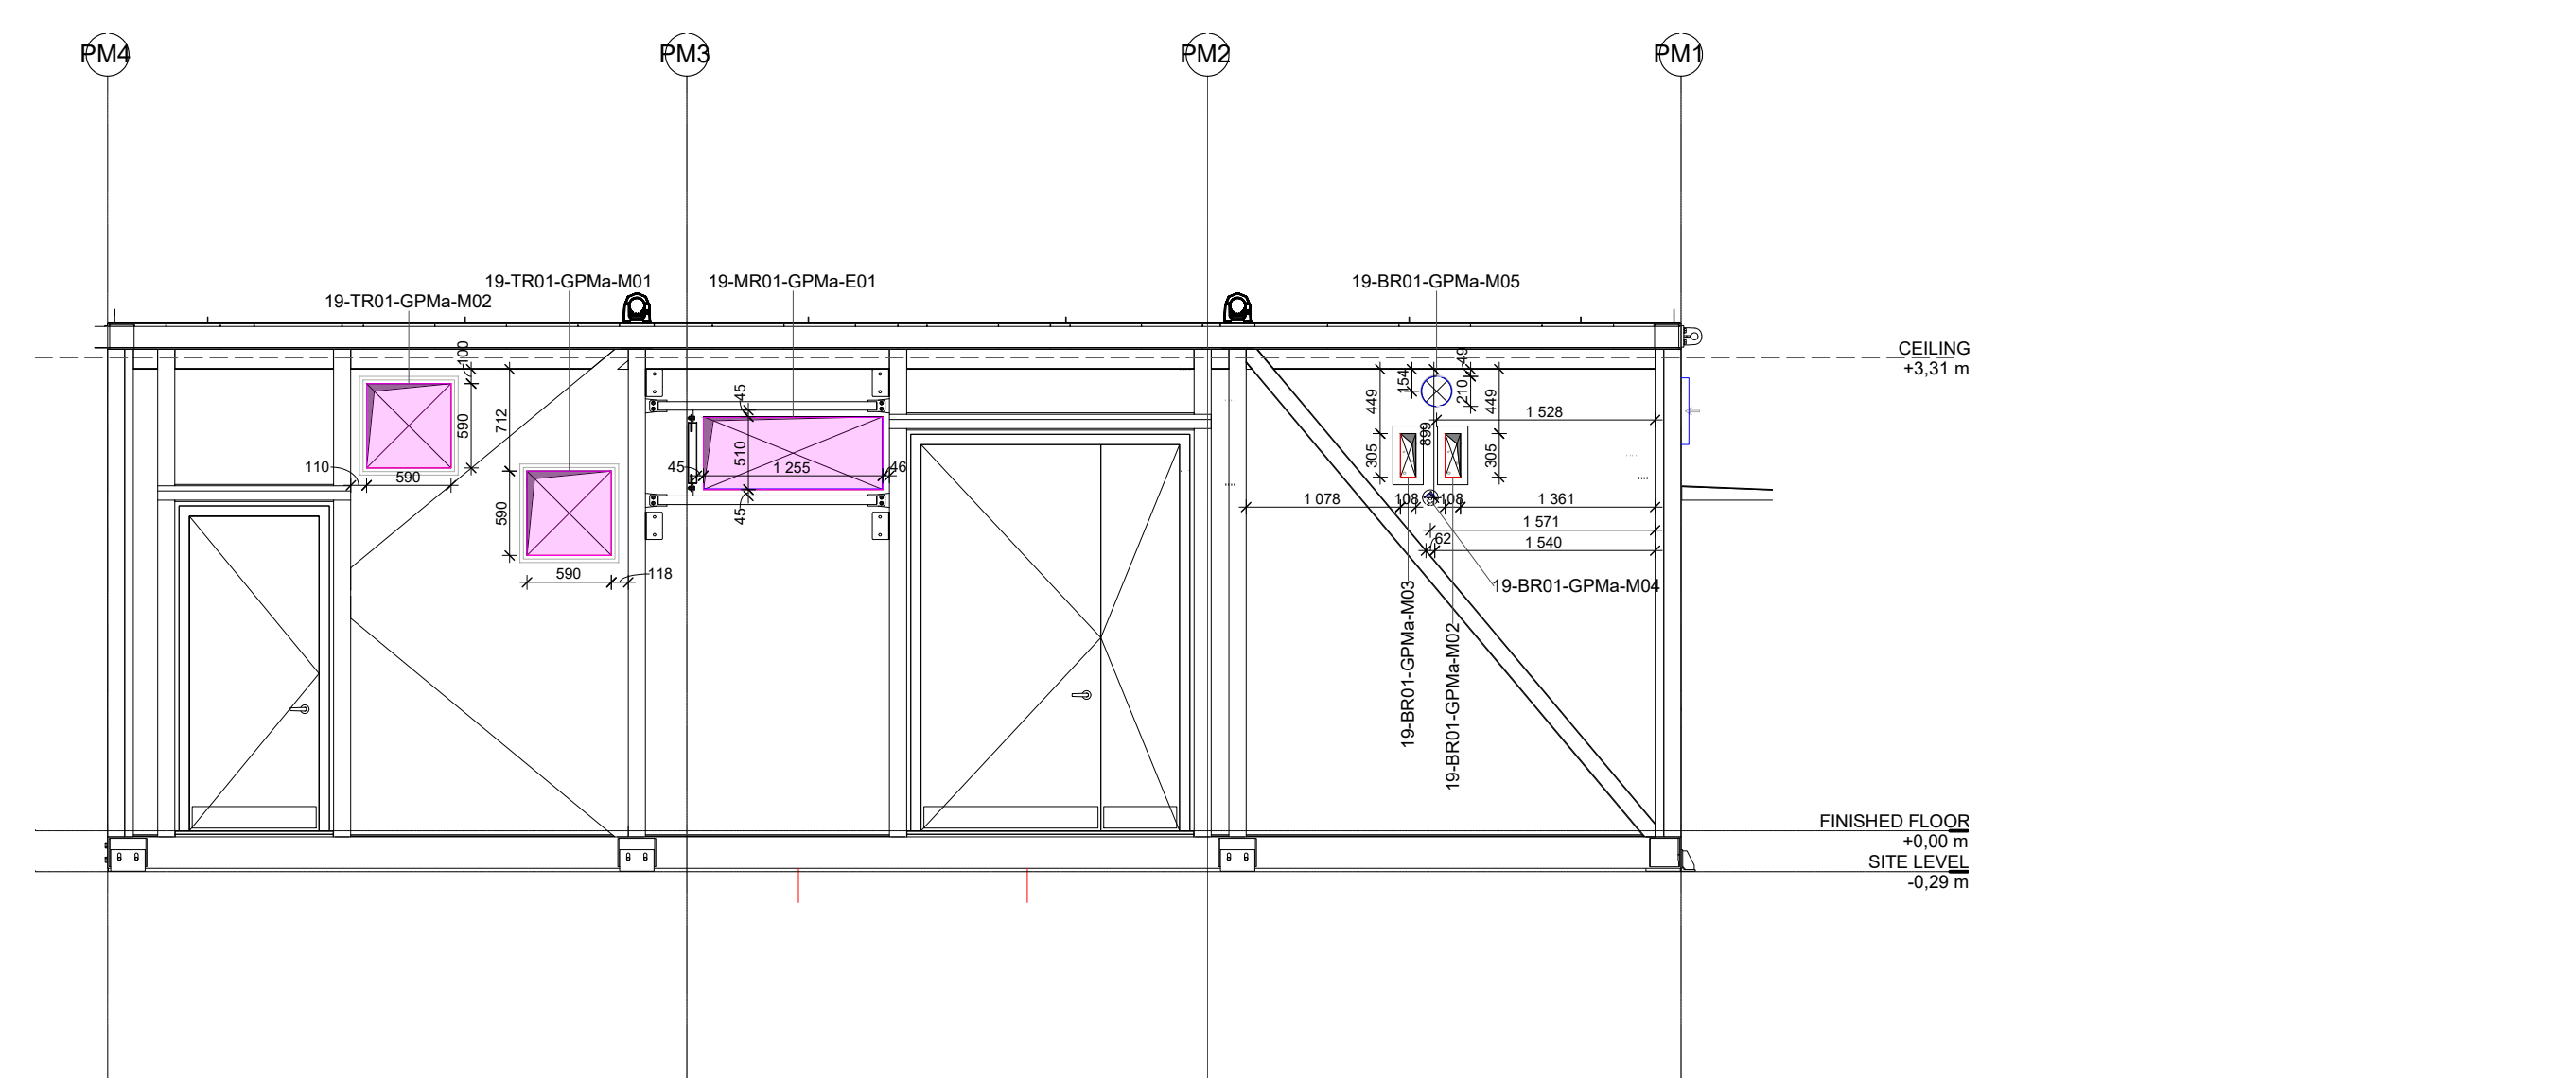


3 MV-ELEVATION NORTH
1:50

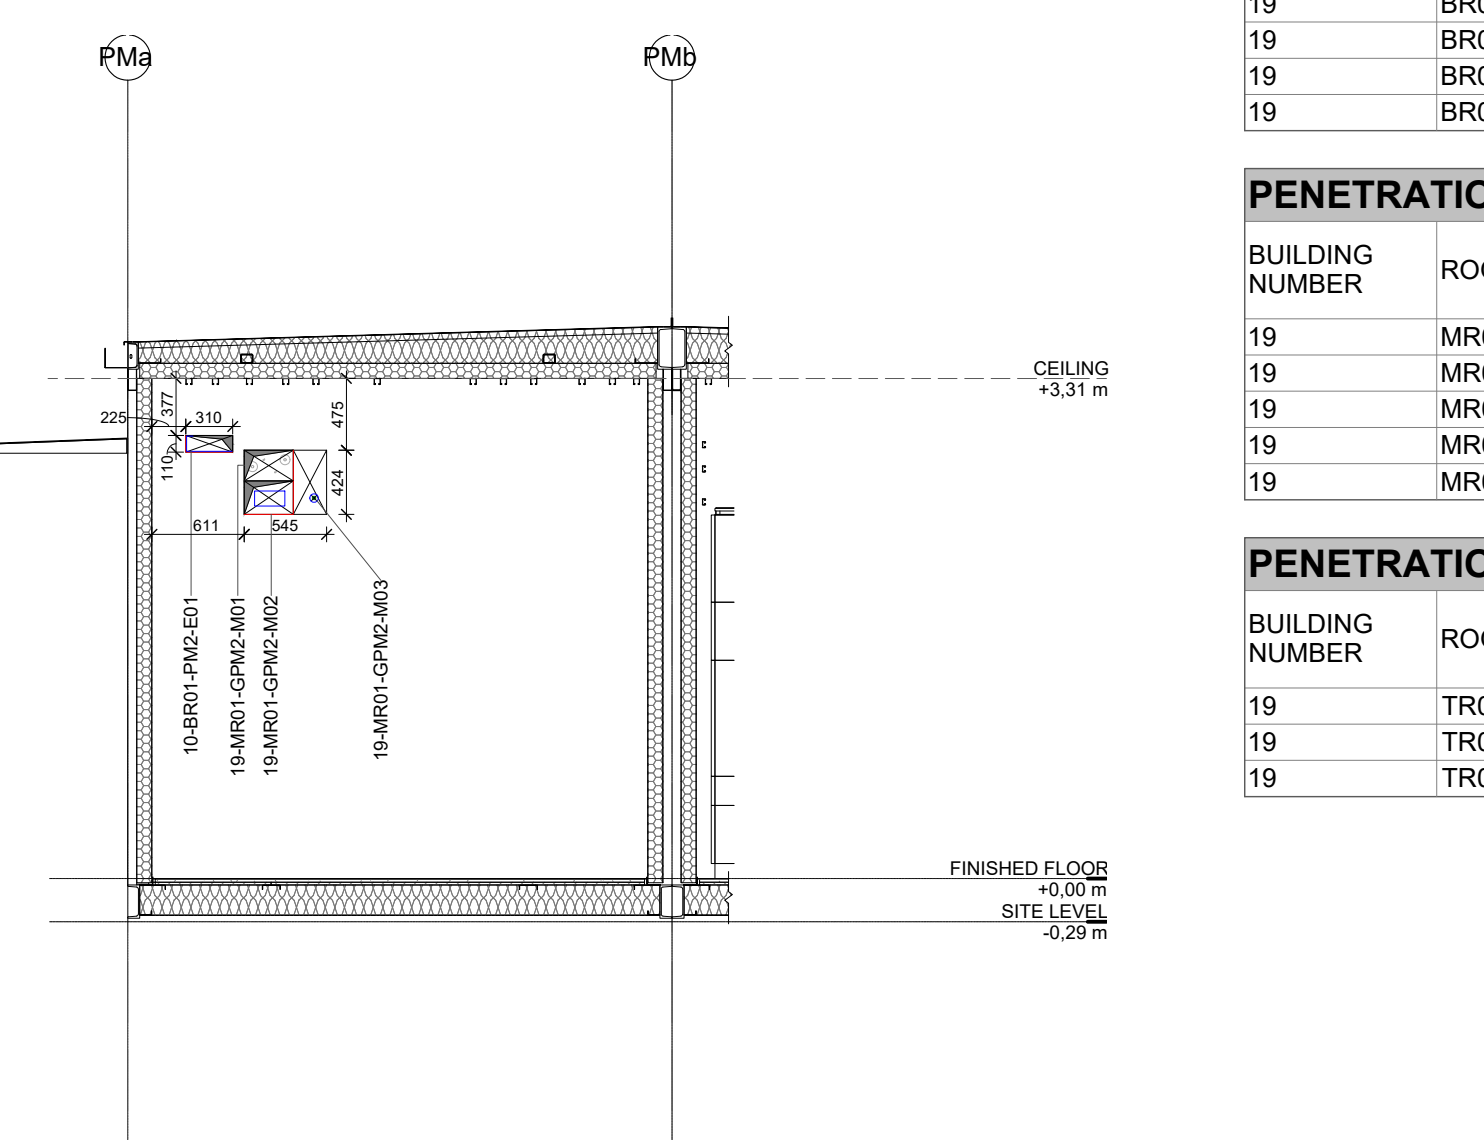

7 MV-BR WALL
1:50


FLOOR PENETRATION FLASHING:
PM:
100000327278 for roxtec
100000327290 for roxtec

MV:
I00000340228 HILTI box
I00000340273 for HILTI
I00000327507 for roxtec
I00000327517 for roxtec

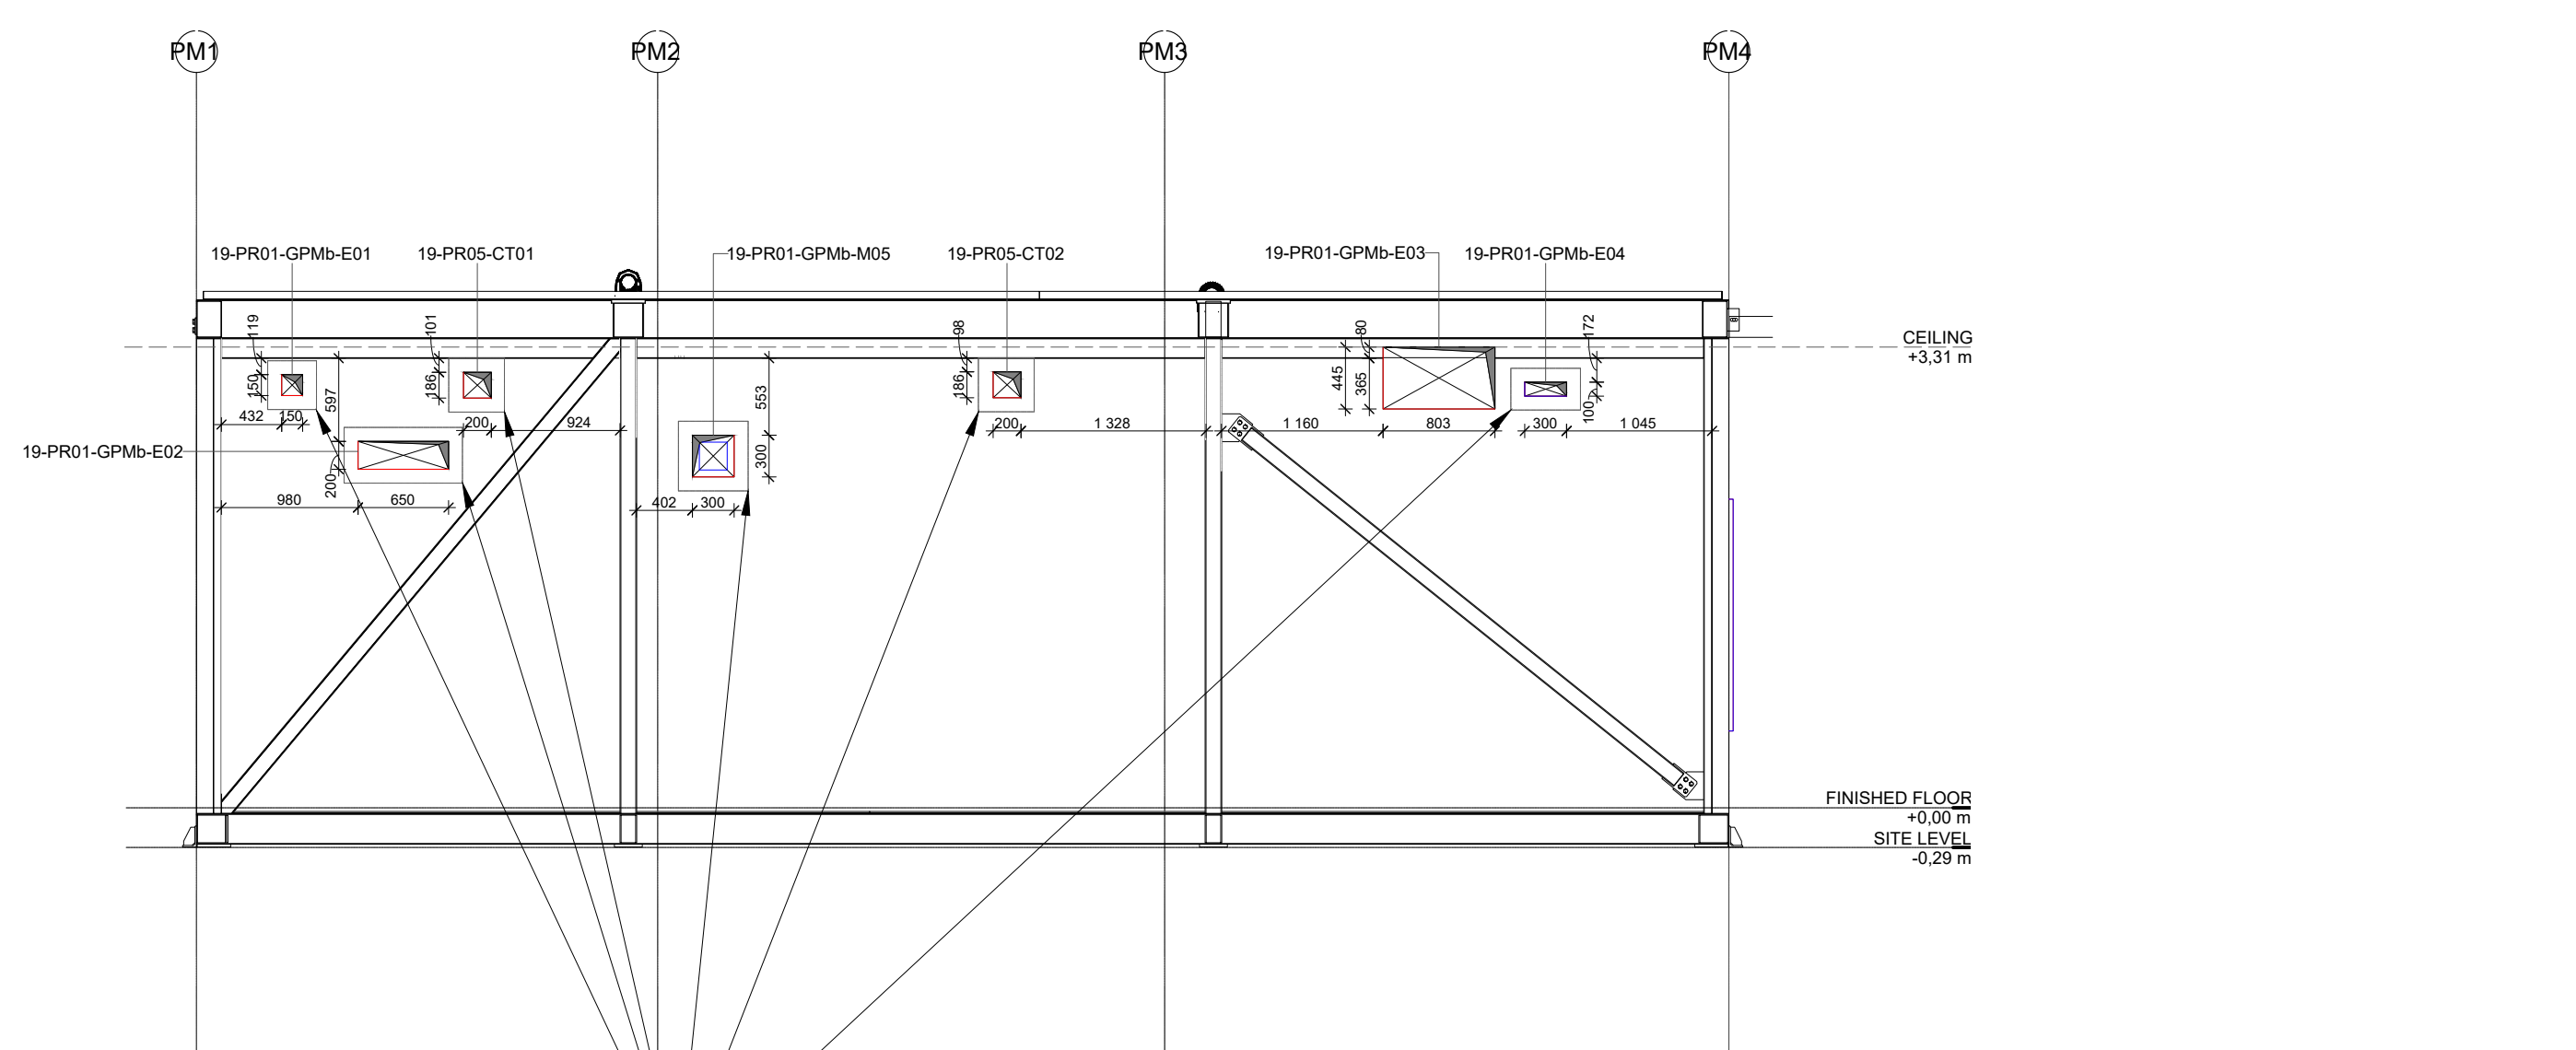


4 MV-ELEVATION SOUTH
1:50

ADD 100 mm WIDE STRIPS OF PANEL 60 mm AROUND OPENING - ON THE EXTERIOR SIDE
TAPE WITH ALU TAPE AND PLACE FLASHING I00000331314 OVER THE PANEL

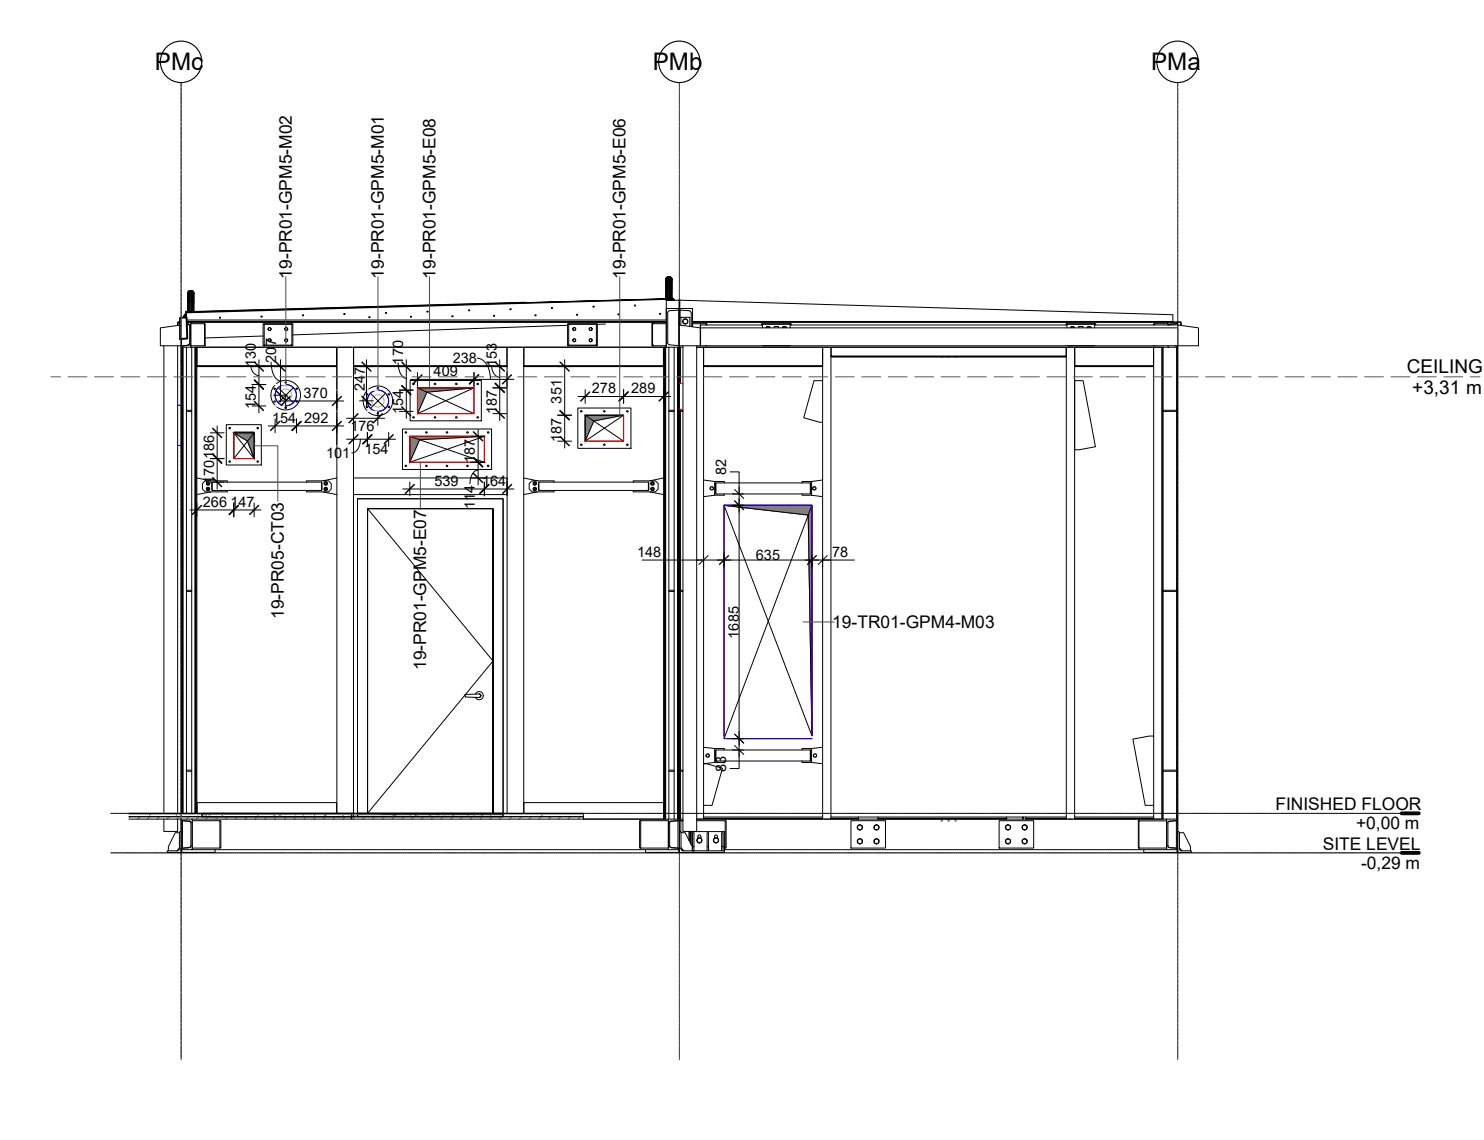

8 PM+MV-ELEVATION WEST
1:50

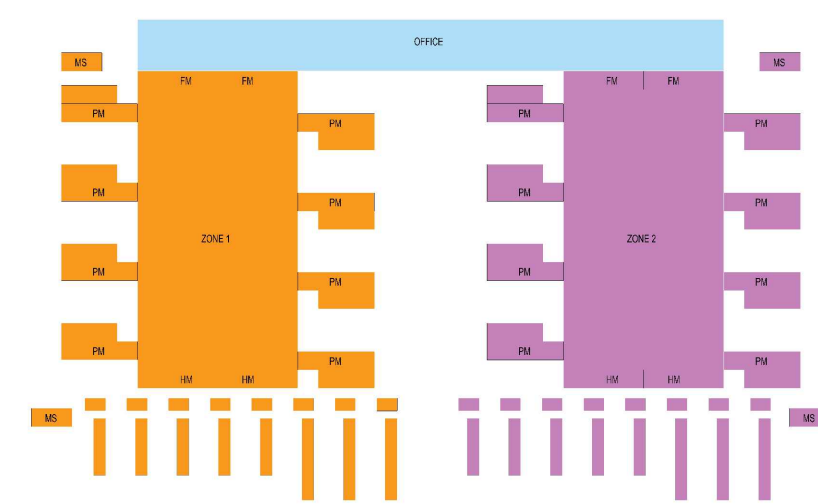

R05	FOR MANUFACTURING	2026-10-06
R04	FOR MANUFACTURING	2026-09-14
R03	FOR MANUFACTURING	2026-08-26
R02	FOR MANUFACTURING	2026-08-19
R01	FOR MANUFACTURING	2026-08-13



PROJECT NAME

ECO DC MONALISA

DRAWING NAME

ARCHITECTURAL BUILDING PENETRATIONS

PREPARED (ALSO SUBJECT RESPONSIBLE IF OTHER)
M. BRATIC

DOCUMENT RESPONSIBLE / APPROVED

CAD / BMSYSTEM AUTODESK REVIT 202

DOCUMENT NUMBER
POWER MODULE - PENETRATION FLAS

LOWER MODULE - PENETRATION PLAS		
20.0 1.000 0.000 0.000 0.000 0.000	20.000 0.000 0.000 0.000 0.000 0.000	20.0 0.000 0.000

SHEET SIZE	DRAWING SCALE	DATE
A0	1:50	202

22	23
----	----

SHEET 1 OF 1

R04

LEGAL DISCLAIMER: THIS DOCUMENT AND THE CONTENTS HEREIN ARE CONFIDENTIAL AND THE SOLE PROPERTY OF VERTIV GROUP CORP. REPRODUCTION, DISTRIBUTION OR UNAUTHORIZED USE OF THIS DOCUMENT OR ANY PARTS WITHIN THIS DOCUMENT ARE FORBIDDEN WITHOUT THE WRITTEN CONSENT OF VERTIV GROUP CORP.