
Secondary diagnostic only: 48 wrong-assigned openings. Distinct from the all-turn clause displays used by judges.

Fresh local probe evaluation — clause units

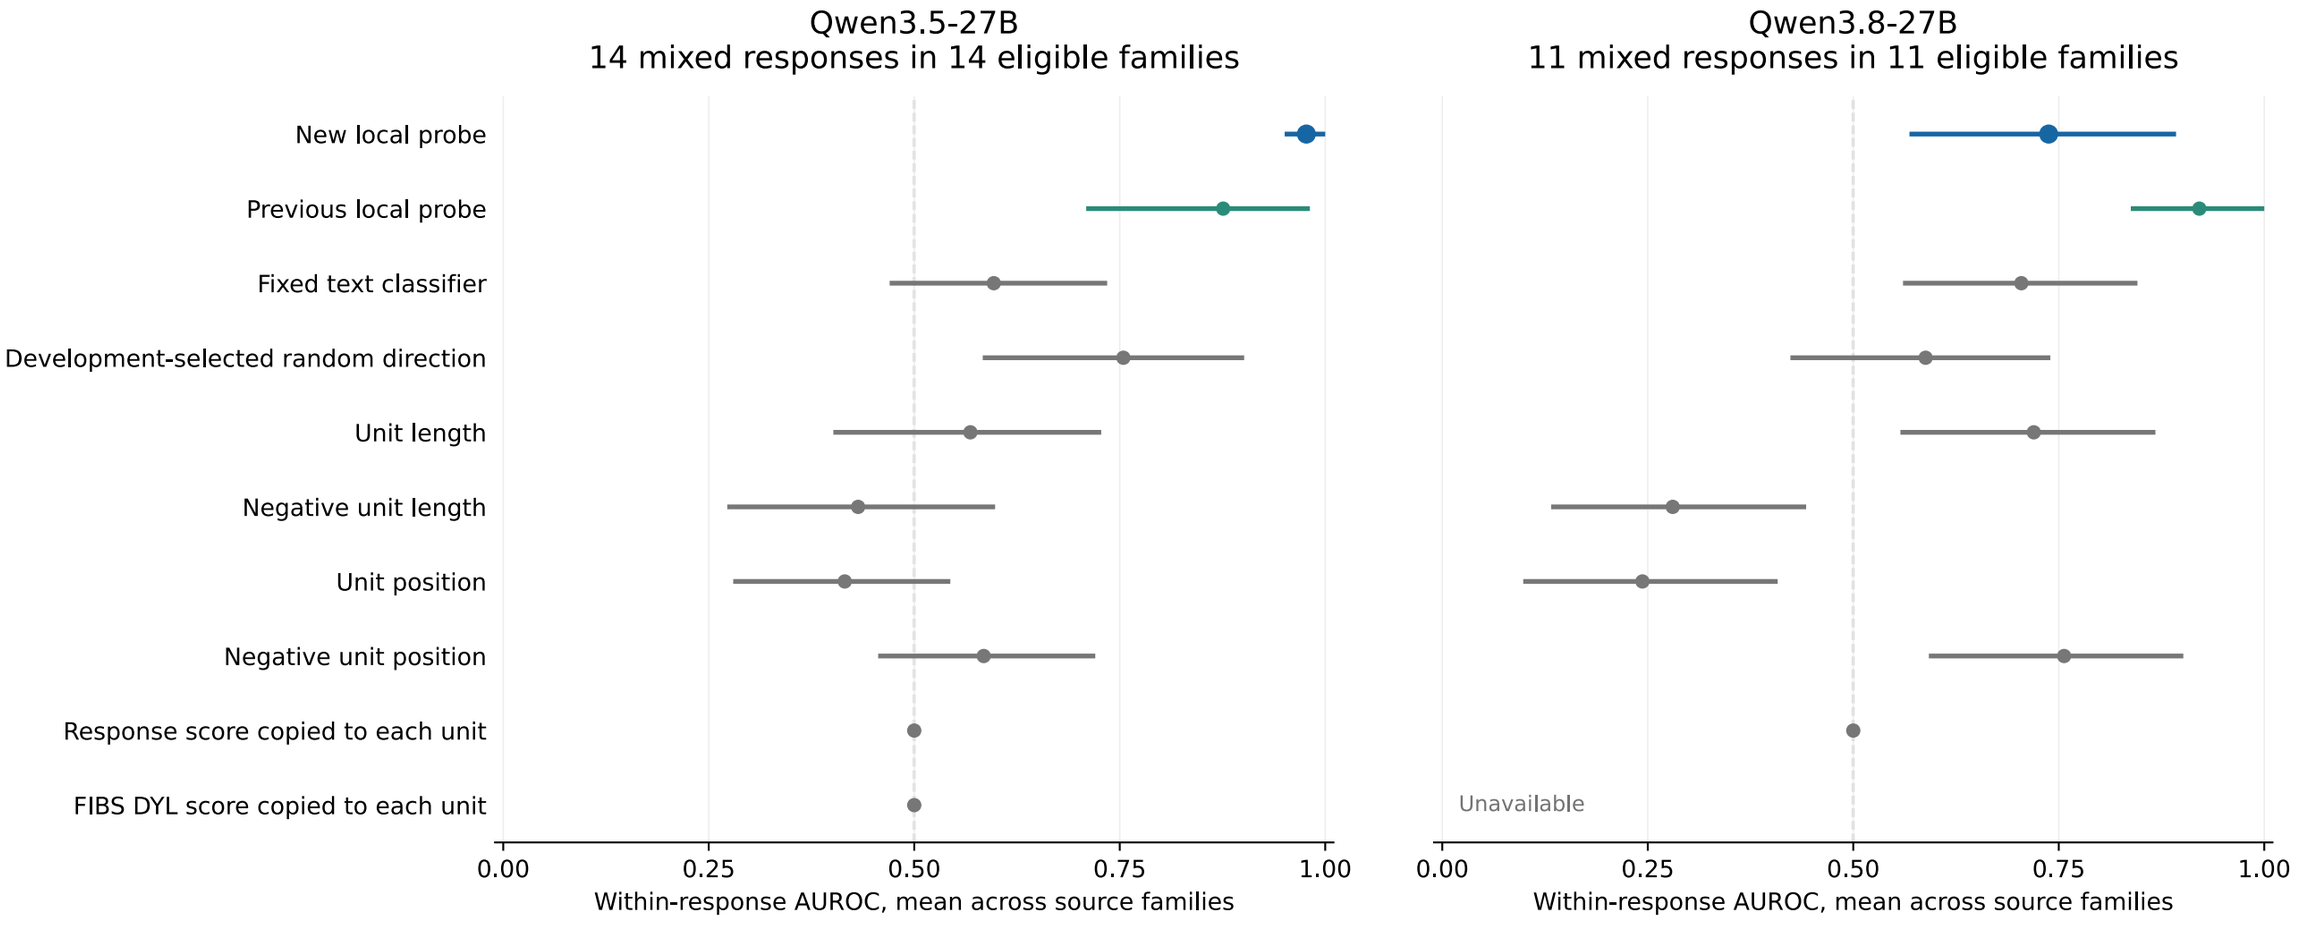

Qwen3.5-27B: 136/391 units with accepted truth labels; 24 complete responses; 24 source families.
Qwen3.8-27B: 142/380 units with accepted truth labels; 24 complete responses; 24 source families.
Intervals resample source families (95%). Only responses containing both accepted supported and contradicted units contribute to local ranking.
Unknown/mixed units stay in coverage counts. Labels are independent model judgments, not human ground truth. All frozen controls are shown.