

SIPIA

Sistema de Monitoreo Sismico Inteligente

Reporte generado: 02/07/2026 22:01

Lecturas	Anomalias	Sismos VIB-01	Sensores activos
50	40	10	5

Resumen Estadistico por Sensor




Sensor	Promedio	Minimo	Maximo	Desv. estandar	N
ACCEL	-0.77	-1.86	0.67	0.78	10
GYRO	-111.95	-241.84	218.42	133.11	10
PRESS	1013.16	1006.21	1021.41	4.21	10
TEMP	24.50	22.67	28.01	1.80	10
VIB-01	3.85	3.85	3.85	0.00	10

Ultimas Lecturas (max. 50)


Sensor	Valor	Unidad	Timestamp
PRESS	1006.21	hPa	2026-07-03T02:01:21
TEMP	22.96	C	2026-07-03T02:01:21
GYRO	-156.04	deg/s	2026-07-03T02:01:21
ACCEL	-1.66	g	2026-07-03T02:01:21
VIB-01	3.85	Richter	2026-07-03T02:01:21
PRESS	1021.41	hPa	2026-07-03T02:01:11
TEMP	24.28	C	2026-07-03T02:01:11
GYRO	-74.57	deg/s	2026-07-03T02:01:11
ACCEL	0.67	g	2026-07-03T02:01:11
VIB-01	3.85	Richter	2026-07-03T02:01:11
PRESS	1014.46	hPa	2026-07-03T02:01:01
TEMP	28.01	C	2026-07-03T02:01:01
GYRO	-34.70	deg/s	2026-07-03T02:01:01
ACCEL	-1.02	g	2026-07-03T02:01:01
VIB-01	3.85	Richter	2026-07-03T02:01:01
PRESS	1013.34	hPa	2026-07-03T02:00:51
TEMP	24.00	C	2026-07-03T02:00:51
GYRO	-22.20	deg/s	2026-07-03T02:00:51

Sensor	Valor	Unidad	Timestamp
ACCEL	-0.74	g	2026-07-03T02:00:51
VIB-01	3.85	Richter	2026-07-03T02:00:51
PRESS	1015.88	hPa	2026-07-03T02:00:41
TEMP	22.67	C	2026-07-03T02:00:41
GYRO	-241.84	deg/s	2026-07-03T02:00:41
ACCEL	0.15	g	2026-07-03T02:00:40
VIB-01	3.85	Richter	2026-07-03T02:00:40
PRESS	1011.30	hPa	2026-07-03T02:00:30
TEMP	22.83	C	2026-07-03T02:00:30
GYRO	-183.72	deg/s	2026-07-03T02:00:30
ACCEL	-1.24	g	2026-07-03T02:00:30
VIB-01	3.85	Richter	2026-07-03T02:00:30
PRESS	1008.41	hPa	2026-07-03T02:00:20
TEMP	25.73	C	2026-07-03T02:00:20
GYRO	218.42	deg/s	2026-07-03T02:00:20
ACCEL	-1.86	g	2026-07-03T02:00:20
VIB-01	3.85	Richter	2026-07-03T02:00:20
PRESS	1013.31	hPa	2026-07-03T02:00:10
TEMP	27.32	C	2026-07-03T02:00:10
GYRO	-224.81	deg/s	2026-07-03T02:00:10
ACCEL	0.07	g	2026-07-03T02:00:10
VIB-01	3.85	Richter	2026-07-03T02:00:10
PRESS	1010.07	hPa	2026-07-03T02:00:00
TEMP	23.98	C	2026-07-03T02:00:00
GYRO	-185.99	deg/s	2026-07-03T02:00:00
ACCEL	-1.24	g	2026-07-03T02:00:00
VIB-01	3.85	Richter	2026-07-03T02:00:00
PRESS	1017.18	hPa	2026-07-03T01:59:49
TEMP	23.21	C	2026-07-03T01:59:49
GYRO	-214.10	deg/s	2026-07-03T01:59:49
ACCEL	-0.78	g	2026-07-03T01:59:49
VIB-01	3.85	Richter	2026-07-03T01:59:49

Graficas del Sistema

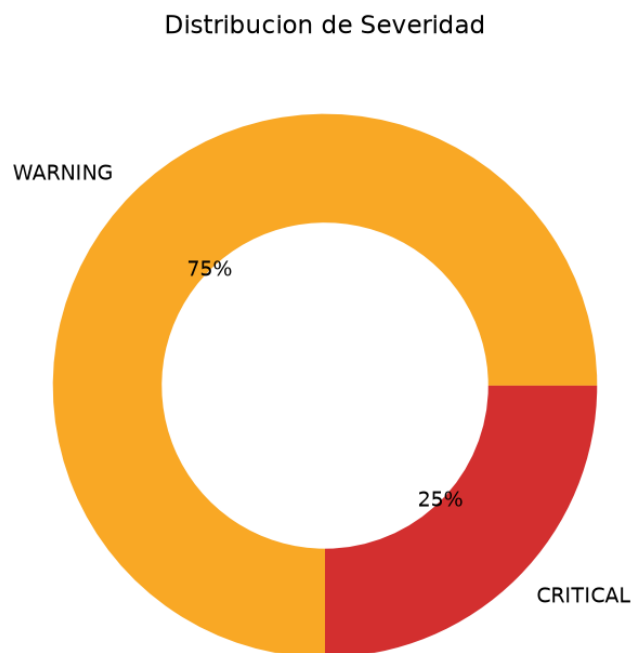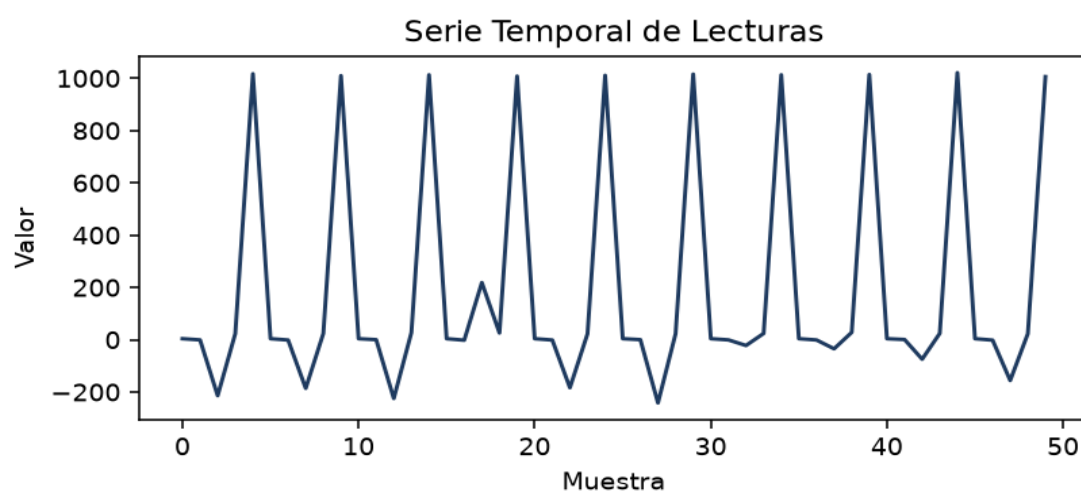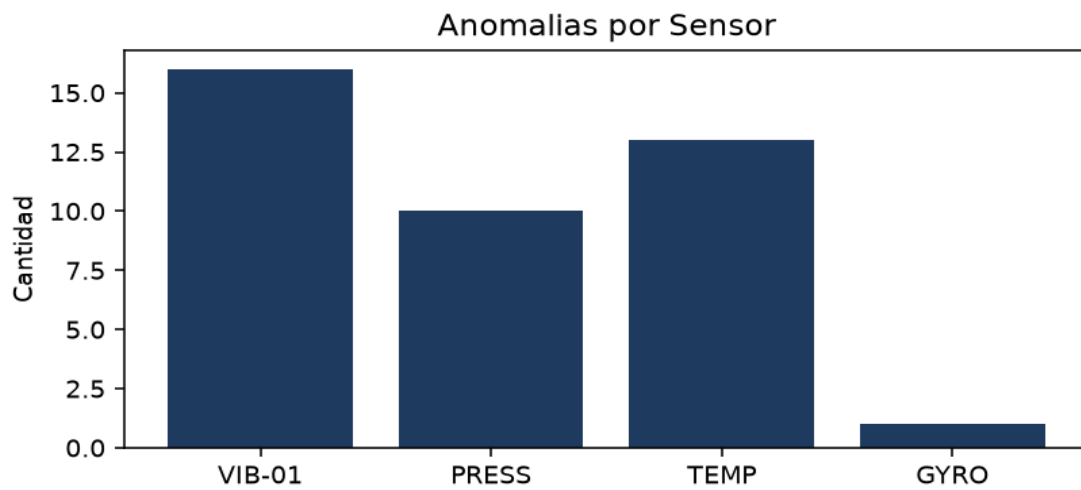

Mapa Mundial de Sismos (USGS)

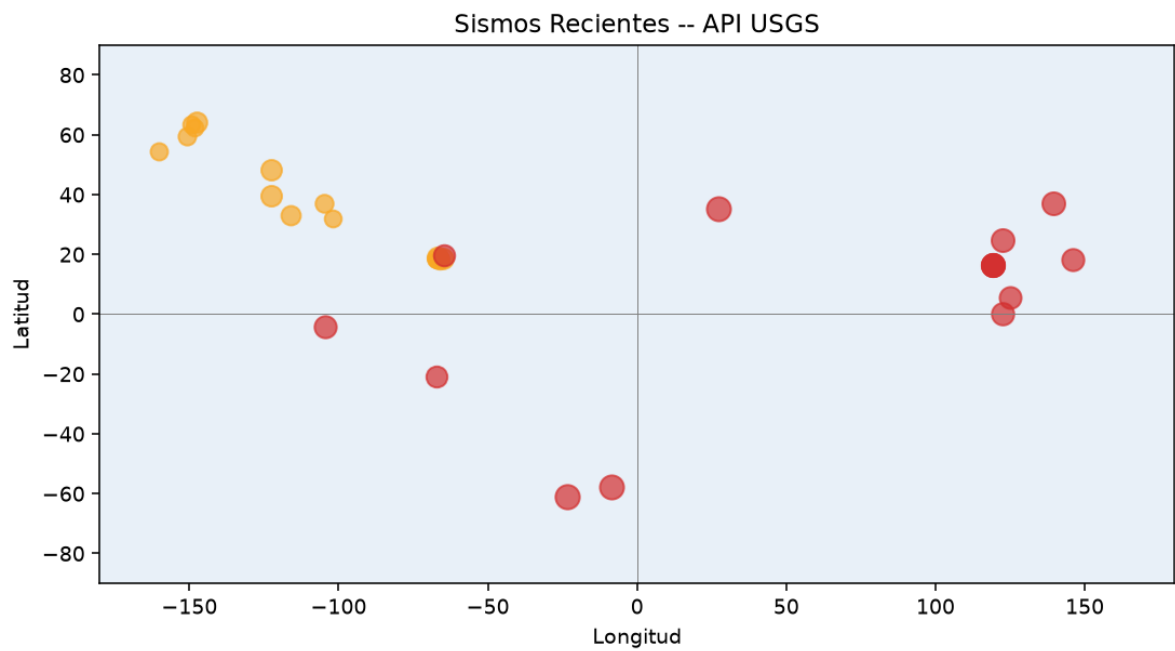

Ultimos Eventos Criticos (max. 40)

Sensor	Severidad	Score	Motivo	Detectado
VIB-01	WARNING	2.71	Z-Score=2.71 fuera de rango normal para	2026-07-03T01:58:16
VIB-01	WARNING	3.00	Z-Score=3.00 fuera de rango normal para	2026-07-03T01:58:06
VIB-01	WARNING	3.39	Z-Score=3.39 fuera de rango normal para	2026-07-03T01:57:56
VIB-01	WARNING	3.96	Z-Score=3.96 fuera de rango normal para	2026-07-03T01:57:45
VIB-01	CRITICAL	4.90	Z-Score=4.90 fuera de rango normal para	2026-07-03T01:57:35
VIB-01	CRITICAL	7.00	Z-Score=7.00 fuera de rango normal para	2026-07-03T01:57:25
VIB-01	CRITICAL	10000.00	Z-Score=10000.00 fuera de rango normal p	2026-07-03T01:57:14
PRESS	WARNING	2.83	Z-Score=2.83 fuera de rango normal para	2026-07-03T01:55:52
TEMP	WARNING	3.25	Z-Score=3.25 fuera de rango normal para	2026-07-03T01:54:02
TEMP	WARNING	-2.77	Z-Score=-2.77 fuera de rango normal para	2026-07-03T01:51:19
PRESS	WARNING	-3.11	Z-Score=-3.11 fuera de rango normal para	2026-07-03T01:45:39
PRESS	WARNING	2.52	Z-Score=2.52 fuera de rango normal para	2026-07-03T01:43:05
VIB-01	WARNING	-2.71	Z-Score=-2.71 fuera de rango normal para	2026-07-03T01:38:09
VIB-01	WARNING	-3.00	Z-Score=-3.00 fuera de rango normal para	2026-07-03T01:37:58
VIB-01	WARNING	-3.39	Z-Score=-3.39 fuera de rango normal para	2026-07-03T01:37:48
VIB-01	WARNING	-3.96	Z-Score=-3.96 fuera de rango normal para	2026-07-03T01:37:36
VIB-01	CRITICAL	-4.90	Z-Score=-4.90 fuera de rango normal para	2026-07-03T01:37:26
VIB-01	CRITICAL	-7.00	Z-Score=-7.00 fuera de rango normal para	2026-07-03T01:37:16
VIB-01	CRITICAL	-400000.00	Z-Score=-400000.00 fuera de rango normal	2026-07-03T01:37:05
TEMP	WARNING	2.65	Z-Score=2.65 fuera de rango normal para	2026-07-03T01:36:22

Sensor	Severidad	Score	Motivo	Detectado
PRESS	WARNING	2.57	Z-Score=2.57 fuera de rango normal para	2026-07-03T01:34:27
TEMP	WARNING	2.97	Z-Score=2.97 fuera de rango normal para	2026-07-03T00:59:52
PRESS	WARNING	2.55	Z-Score=2.55 fuera de rango normal para	2026-07-03T00:58:44
PRESS	WARNING	-2.67	Z-Score=-2.67 fuera de rango normal para	2026-07-03T00:56:05
TEMP	WARNING	-2.52	Z-Score=-2.52 fuera de rango normal para	2026-07-03T00:55:30
PRESS	WARNING	3.50	Z-Score=3.50 fuera de rango normal para	2026-07-03T00:46:47
TEMP	WARNING	3.60	Z-Score=3.60 fuera de rango normal para	2026-07-03T00:44:27
TEMP	WARNING	2.74	Z-Score=2.74 fuera de rango normal para	2026-07-02T23:58:09
TEMP	WARNING	-2.94	Z-Score=-2.94 fuera de rango normal para	2026-07-02T23:57:16
TEMP	WARNING	-2.68	Z-Score=-2.68 fuera de rango normal para	2026-07-02T23:35:51
TEMP	WARNING	2.66	Z-Score=2.66 fuera de rango normal para	2026-07-02T23:32:18
PRESS	WARNING	2.64	Z-Score=2.64 fuera de rango normal para	2026-07-02T23:25:22
PRESS	WARNING	3.74	Z-Score=3.74 fuera de rango normal para	2026-07-02T23:16:10
VIB-01	CRITICAL	-5.94	Z-Score=-5.94 fuera de rango normal para	2026-07-02T22:43:19
TEMP	WARNING	-3.69	Z-Score=-3.69 fuera de rango normal para	2026-07-02T22:41:50
PRESS	WARNING	3.16	Z-Score=3.16 fuera de rango normal para	2026-07-02T22:37:01
TEMP	WARNING	-2.69	Z-Score=-2.69 fuera de rango normal para	2026-07-02T22:36:39
VIB-01	CRITICAL	-2700000.00	Z-Score=-2700000.00 fuera de rango norma	2026-07-02T22:34:08
TEMP	CRITICAL	4.24	Z-Score=4.24 fuera de rango normal para	2026-07-02T22:31:34
GYRO	CRITICAL	-5.18	Z-Score=-5.18 fuera de rango normal para	2026-07-02T22:30:42