

SIPIA

Sistema de Monitoreo Sismico Inteligente

Reporte generado: 02/07/2026 22:03

Lecturas	Anomalias	Sismos VIB-01	Sensores activos
50	40	10	5

Resumen Estadistico por Sensor




Sensor	Promedio	Minimo	Maximo	Desv. estandar	N
ACCEL	-0.01	-1.74	1.95	1.31	10
GYRO	-16.03	-185.28	171.71	95.81	10
PRESS	1011.55	1006.35	1017.09	3.98	10
TEMP	24.10	20.69	25.89	1.40	10
VIB-01	3.85	3.85	3.85	0.00	10

Ultimas Lecturas (max. 50)


Sensor	Valor	Unidad	Timestamp
PRESS	1009.49	hPa	2026-07-03T02:03:27
TEMP	24.02	C	2026-07-03T02:03:27
GYRO	-64.05	deg/s	2026-07-03T02:03:27
ACCEL	-1.19	g	2026-07-03T02:03:27
VIB-01	3.85	Richter	2026-07-03T02:03:27
PRESS	1013.67	hPa	2026-07-03T02:03:16
TEMP	23.20	C	2026-07-03T02:03:16
GYRO	12.20	deg/s	2026-07-03T02:03:16
ACCEL	1.31	g	2026-07-03T02:03:16
VIB-01	3.85	Richter	2026-07-03T02:03:16
PRESS	1016.89	hPa	2026-07-03T02:03:06
TEMP	20.69	C	2026-07-03T02:03:06
GYRO	-185.28	deg/s	2026-07-03T02:03:06
ACCEL	-0.83	g	2026-07-03T02:03:06
VIB-01	3.85	Richter	2026-07-03T02:03:06
PRESS	1017.09	hPa	2026-07-03T02:02:55
TEMP	24.32	C	2026-07-03T02:02:55
GYRO	23.44	deg/s	2026-07-03T02:02:55

Sensor	Valor	Unidad	Timestamp
ACCEL	0.66	g	2026-07-03T02:02:55
VIB-01	3.85	Richter	2026-07-03T02:02:55
PRESS	1007.26	hPa	2026-07-03T02:02:45
TEMP	25.89	C	2026-07-03T02:02:45
GYRO	93.60	deg/s	2026-07-03T02:02:44
ACCEL	-1.74	g	2026-07-03T02:02:44
VIB-01	3.85	Richter	2026-07-03T02:02:44
PRESS	1009.72	hPa	2026-07-03T02:02:34
TEMP	23.72	C	2026-07-03T02:02:34
GYRO	171.71	deg/s	2026-07-03T02:02:34
ACCEL	1.95	g	2026-07-03T02:02:34
VIB-01	3.85	Richter	2026-07-03T02:02:34
PRESS	1012.63	hPa	2026-07-03T02:02:24
TEMP	24.79	C	2026-07-03T02:02:24
GYRO	-102.22	deg/s	2026-07-03T02:02:23
ACCEL	0.28	g	2026-07-03T02:02:23
VIB-01	3.85	Richter	2026-07-03T02:02:23
PRESS	1006.74	hPa	2026-07-03T02:02:13
TEMP	25.75	C	2026-07-03T02:02:13
GYRO	-76.63	deg/s	2026-07-03T02:02:13
ACCEL	-1.61	g	2026-07-03T02:02:13
VIB-01	3.85	Richter	2026-07-03T02:02:13
PRESS	1015.68	hPa	2026-07-03T02:02:03
TEMP	23.87	C	2026-07-03T02:02:03
GYRO	-8.48	deg/s	2026-07-03T02:02:03
ACCEL	-0.62	g	2026-07-03T02:02:03
VIB-01	3.85	Richter	2026-07-03T02:02:03
PRESS	1006.35	hPa	2026-07-03T02:01:53
TEMP	24.73	C	2026-07-03T02:01:53
GYRO	-24.62	deg/s	2026-07-03T02:01:53
ACCEL	1.72	g	2026-07-03T02:01:53
VIB-01	3.85	Richter	2026-07-03T02:01:53

Graficas del Sistema

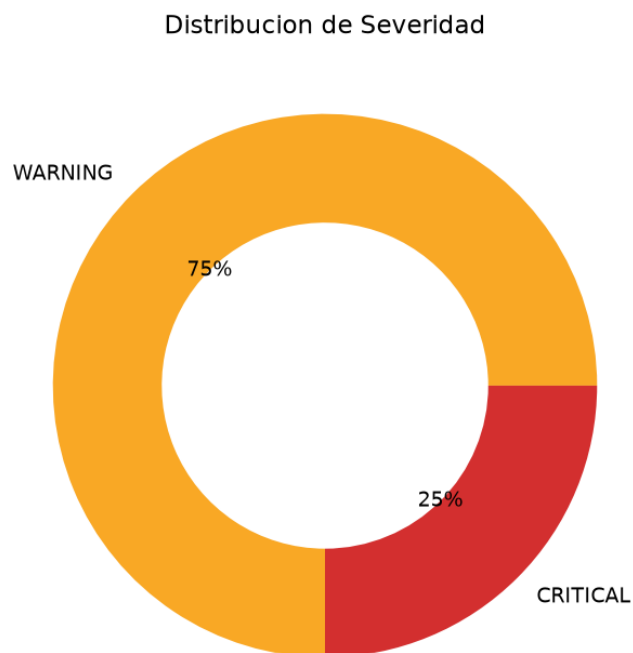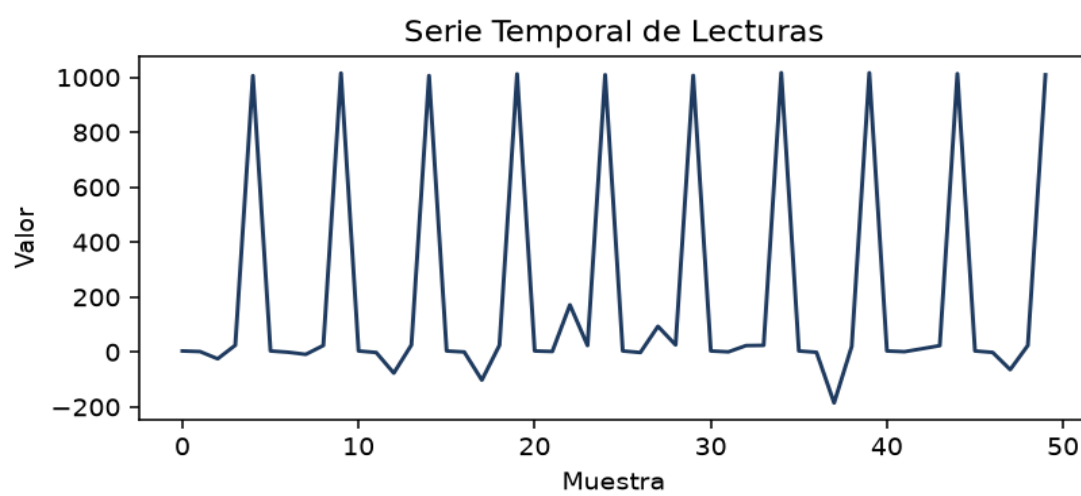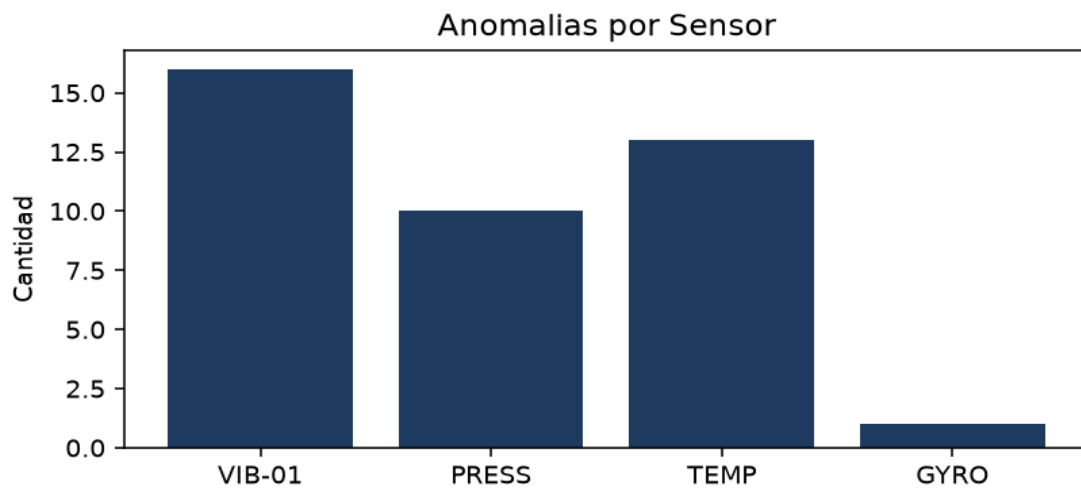

Mapa Mundial de Sismos (USGS)

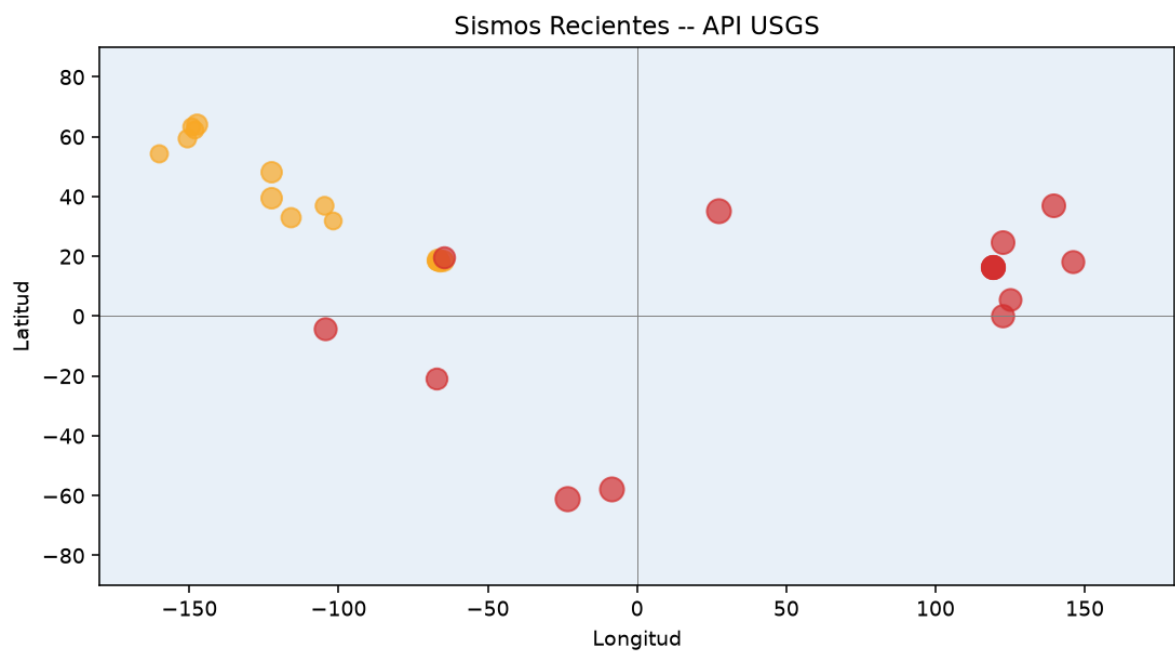

Ultimos Eventos Criticos (max. 40)

Sensor	Severidad	Score	Motivo	Detectado
VIB-01	WARNING	2.71	Z-Score=2.71 fuera de rango normal para	2026-07-03T01:58:16
VIB-01	WARNING	3.00	Z-Score=3.00 fuera de rango normal para	2026-07-03T01:58:06
VIB-01	WARNING	3.39	Z-Score=3.39 fuera de rango normal para	2026-07-03T01:57:56
VIB-01	WARNING	3.96	Z-Score=3.96 fuera de rango normal para	2026-07-03T01:57:45
VIB-01	CRITICAL	4.90	Z-Score=4.90 fuera de rango normal para	2026-07-03T01:57:35
VIB-01	CRITICAL	7.00	Z-Score=7.00 fuera de rango normal para	2026-07-03T01:57:25
VIB-01	CRITICAL	10000.00	Z-Score=10000.00 fuera de rango normal p	2026-07-03T01:57:14
PRESS	WARNING	2.83	Z-Score=2.83 fuera de rango normal para	2026-07-03T01:55:52
TEMP	WARNING	3.25	Z-Score=3.25 fuera de rango normal para	2026-07-03T01:54:02
TEMP	WARNING	-2.77	Z-Score=-2.77 fuera de rango normal para	2026-07-03T01:51:19
PRESS	WARNING	-3.11	Z-Score=-3.11 fuera de rango normal para	2026-07-03T01:45:39
PRESS	WARNING	2.52	Z-Score=2.52 fuera de rango normal para	2026-07-03T01:43:05
VIB-01	WARNING	-2.71	Z-Score=-2.71 fuera de rango normal para	2026-07-03T01:38:09
VIB-01	WARNING	-3.00	Z-Score=-3.00 fuera de rango normal para	2026-07-03T01:37:58
VIB-01	WARNING	-3.39	Z-Score=-3.39 fuera de rango normal para	2026-07-03T01:37:48
VIB-01	WARNING	-3.96	Z-Score=-3.96 fuera de rango normal para	2026-07-03T01:37:36
VIB-01	CRITICAL	-4.90	Z-Score=-4.90 fuera de rango normal para	2026-07-03T01:37:26
VIB-01	CRITICAL	-7.00	Z-Score=-7.00 fuera de rango normal para	2026-07-03T01:37:16
VIB-01	CRITICAL	-400000.00	Z-Score=-400000.00 fuera de rango normal	2026-07-03T01:37:05
TEMP	WARNING	2.65	Z-Score=2.65 fuera de rango normal para	2026-07-03T01:36:22

Sensor	Severidad	Score	Motivo	Detectado
PRESS	WARNING	2.57	Z-Score=2.57 fuera de rango normal para	2026-07-03T01:34:27
TEMP	WARNING	2.97	Z-Score=2.97 fuera de rango normal para	2026-07-03T00:59:52
PRESS	WARNING	2.55	Z-Score=2.55 fuera de rango normal para	2026-07-03T00:58:44
PRESS	WARNING	-2.67	Z-Score=-2.67 fuera de rango normal para	2026-07-03T00:56:05
TEMP	WARNING	-2.52	Z-Score=-2.52 fuera de rango normal para	2026-07-03T00:55:30
PRESS	WARNING	3.50	Z-Score=3.50 fuera de rango normal para	2026-07-03T00:46:47
TEMP	WARNING	3.60	Z-Score=3.60 fuera de rango normal para	2026-07-03T00:44:27
TEMP	WARNING	2.74	Z-Score=2.74 fuera de rango normal para	2026-07-02T23:58:09
TEMP	WARNING	-2.94	Z-Score=-2.94 fuera de rango normal para	2026-07-02T23:57:16
TEMP	WARNING	-2.68	Z-Score=-2.68 fuera de rango normal para	2026-07-02T23:35:51
TEMP	WARNING	2.66	Z-Score=2.66 fuera de rango normal para	2026-07-02T23:32:18
PRESS	WARNING	2.64	Z-Score=2.64 fuera de rango normal para	2026-07-02T23:25:22
PRESS	WARNING	3.74	Z-Score=3.74 fuera de rango normal para	2026-07-02T23:16:10
VIB-01	CRITICAL	-5.94	Z-Score=-5.94 fuera de rango normal para	2026-07-02T22:43:19
TEMP	WARNING	-3.69	Z-Score=-3.69 fuera de rango normal para	2026-07-02T22:41:50
PRESS	WARNING	3.16	Z-Score=3.16 fuera de rango normal para	2026-07-02T22:37:01
TEMP	WARNING	-2.69	Z-Score=-2.69 fuera de rango normal para	2026-07-02T22:36:39
VIB-01	CRITICAL	-2700000.00	Z-Score=-2700000.00 fuera de rango norma	2026-07-02T22:34:08
TEMP	CRITICAL	4.24	Z-Score=4.24 fuera de rango normal para	2026-07-02T22:31:34
GYRO	CRITICAL	-5.18	Z-Score=-5.18 fuera de rango normal para	2026-07-02T22:30:42