

Article

A machine learning model for procurement of secondary reserve capacity in power systems with significant vRES penetrations

João Passagem Santos^{1*}  and Hugo Algarvio^{2*} 

¹ Department of Geographic Engineering, Geophysics and Energy, Faculty of Sciences, University of Lisbon, Campo Grande, 1749-016 Lisbon, Portugal

² LNEG—National Laboratory of Energy and Geology, Est. Paço Lumiar 22, 1649-038 Lisbon, Portugal

* Correspondence: fc55144@alunos.ciencias.ulisboa.pt (J.P.S.), hugo.algarvio@lneg.pt (H.A.)

Abstract: The growing investment in variable renewable energy sources is changing how electricity markets operate. In Europe, players rely on forecasts to participate in day-ahead markets closing between 1 and 37 hours ahead of real-time operation. Usually, transmission system operators use a symmetrical procurement of up and down secondary power reserves based on the expected demand. This work uses machine learning techniques that dynamically computes it using the day-ahead programmed and expected dispatches of variable renewable energy sources, demand, and other technologies. Specifically, the methodology incorporates neural networks, such as Long Short-Term Memory (LSTM) or Convolutional neural network (CNN) models, to improve forecasting accuracy by capturing temporal dependencies and nonlinear patterns in the data. The study uses operational open data from the Spanish operator from 2014 to 2023 for training. Benchmark and test data are from the year 2024. The proposed methodology improves the usage of the up and down secondary reserved power by almost 22% and 11%, respectively.

Keywords: energy markets; forecast; machine learning; neural networks; reserve systems; secondary capacity; variable renewable

1. Introduction

The European Union's energy and climate goals for 2030 and 2050 emphasize the transition to a carbon-neutral energy system, driven by the large-scale integration of variable Renewable Energy Systems (vRES), such as wind and solar photovoltaic (PV) technologies [1–3]. While vRES are critical for achieving sustainability targets, such as Sustainable Development Goals (SDG) 7 (Affordable and Clean Energy) and SDG 13 (Climate Action), their stochastic and intermittent nature poses significant challenges to power system operations, particularly in balancing energy supply and demand efficiently [4,5].

The increasing penetration of vRES introduces greater uncertainty into energy markets, particularly in Day-Ahead (DA) forecasts, which are essential for the allocation of the automatic Frequency Restoration Reserve (aFRR), also known as secondary reserves [6, 7]. They are critical to guarantee the stable operation of power systems by maintaining frequency oscillations between technical constraints. Fast response power plants with high ramping down and up capability, as pumped-hydro storage, are the main providers of secondary reserves [8]. These reserves, procured to address real-time imbalances between generation and consumption, often suffer from inefficient allocation methodologies. DA predictions frequently diverge from real-time conditions, leading to both over-allocation and under-allocation of reserves. This inefficiency not only results in higher operational costs but also compromises the optimal utilization of resources, thereby undermining the economic and energy efficiency of the system [9,10].

This paper focuses on enhancing the accuracy of DA forecasts for secondary reserve allocation, addressing the inefficiencies caused by vRES uncertainty [11,12]. By leveraging

Citation: Passagem Santos, J.; Algarvio, H. A machine learning model for procurement of secondary reserve capacity in power systems with significant vRES penetrations. *Journal Not Specified* **2024**, *1*, 0. <https://doi.org/>

Received:

Revised:

Accepted:

Published:

Copyright: © 2025 by the authors. Submitted to *Journal Not Specified* for possible open access publication under the terms and conditions of the Creative Commons Attribution (CC BY) license (<https://creativecommons.org/licenses/by/4.0/>).

machine learning techniques, this work develops predictive models that incorporate historical data on vRES generation, demand patterns, and system behavior [13,14]. The objective is to dynamically adjust reserve allocations, ensuring that grid stability is maintained while minimizing excess reserve procurement [9,15].

The work presented on this paper analyzes the benefits of using of machine learning techniques for an independent, up and down, capacity procurement of secondary reserves. Publicly available operational data from the Spanish Transmission System Operators (TSO) was utilized, ensuring the replicability of the analysis. Typically, TSOs rely on bilateral agreements to acquire additional reserves, which can drive up costs. Analyzing the under-utilization of secondary reserves and the frequent need for extraordinary reserves in Portugal and Spain highlights the inefficiencies in current methods for determining reserve requirements [9,10,15,16].

The remainder of this paper is structured as follows. Section 2 presents a literature review on dynamic reserves and machine learning. Section 3 provides an overview of wholesale energy markets and reserve systems, highlighting existing inefficiencies. Section 4 outlines the proposed methodology for dynamic reserve allocation using machine learning techniques. Section 5 presents a case study and evaluates the performance of the developed models. Finally, Section 6 summarizes the findings and discusses the implications for future energy systems.

2. Literature Review

The increasing integration of vRES in power systems has created significant challenges for electricity markets and ancillary services. Traditionally, TSOs rely on symmetric allocation of upward and downward reserves based on deterministic forecasts of demand. However, with vRES like wind and solar introducing substantial variability and unpredictability, these conventional methods have proven inefficient in addressing the real-time balancing needs of modern power systems.

The European Network of Transmission System Operators for Electricity (ENTSO-E) framework [17] outlines standardized methodologies for reserve sizing, which are Frequency Containment Reserve (FCR), aFRR, and manual Frequency Restoration Reserve (mFRR), that often fail to adapt dynamically to changing system conditions. In Portugal, for example, the secondary reserve allocation formula used by the TSO employs a fixed ratio applied to expected demand, resulting in excessive allocation and energy waste [2,10]. Similar inefficiencies are observed in the Spanish market, where reserve procurement lacks symmetry and adaptability to vRES production [9,18]. Indeed, after the European gas crisis, the Spanish TSO changed the allocation of reserve capacity in the middle of 2022 to a more conservative, practically symmetrical procurement. The procurement of secondary capacity increased to a similar level across the day and is typical of peak procurement. The procurement of secondary down capacity significantly increased values close to up capacity. Since the middle of 2022, the procurement of secondary capacity has been less dynamic and volatile throughout the day, decreasing the usage percentage of secondary capacity [9,18].

Numerous studies highlight the limitations of static reserve procurement methods under high vRES penetration. The majority of the literature focuses on using historical data to compute the procurement of secondary reserves [12,19,20]. Operational methodologies are needed to be used by TSOs. Dynamic procurement of secondary reserves has been proposed to address these inefficiencies, with an improvement of 13% and 8% for up and down secondary capacities by 2022 [15]. By incorporating real-time or near real-time forecasts of demand and renewable generation, dynamic methodologies aim to optimize reserve allocation, reducing operational costs and resource wastage. Furthermore, five different mechanisms for procuring secondary power in Spain were analyzed for the Spanish power system by 2030, with renewable penetrations higher than 70% [9]. The dynamic procurement methodology proposed in this study enables cost reductions for Spanish secondary power by 27% when using block bids and 34% when using flexible bids. These results highlight the increasing importance of dynamic reserve procurements

with the rising uncertainty of higher penetrations of vRES. Machine learning techniques have emerged as a powerful tool to support this transition. Studies such as [13] and [14] demonstrate the potential of predictive models to estimate reserve needs with greater accuracy, leading to significant reductions in over-procurement. De Vos *et al.* proposed a machine learning approach to estimate imbalance uncertainty, to adjust the size of Belgium's operating reserves from an annual to a daily basis, resulting in a 5% reduction [13]. Kruse, Schäfer, and Witthaut introduced an ex-post machine learning method to determine the appropriate size for secondary reserves. They identified key variables that most accurately estimate errors, essential for detecting when secondary control is activated. Additionally, to enhance the efficiency of cross-border capacity allocation in balancing service exchanges, legislation recommended coupling balancing mechanisms, as demonstrated in the Nordpool market [10,21].

Cardo-Miota *et al.* identified the benefit of using machine learning techniques to predict the prices of aFRR in Spain [18]. The literature also underscores the importance of enhancing forecast accuracy for vRES generation and consumption patterns. Traditional statistical models, including ARMA and ARIMA, have been widely used for time series forecasting. However, recent advancements in machine learning, such as LSTM networks and CNN, have shown superior performance in capturing the nonlinear and temporal characteristics of renewable energy data [22,23]. These models can adapt to complex patterns and improve prediction accuracy, enabling more efficient management of reserves.

So, most studies use machine learning techniques to improve the market outcomes of their participants. Moreover, on the subject of the presented article, most studies use historical data analysis to define the size of the secondary capacity. This study presents an operational open-source methodology that can be tested and adapted by TSOs. Against this background, while the literature presents rich forecasting approaches to accurately predict vRES production using machine learning techniques, TSOs still use deterministic conservative methodologies to procure secondary capacity. Indeed, vRES and demand-side players are the main sources of real-time deviations, and forecast methodologies are being improved to reduce the penalties they pay for imbalances. So, TSOs shall also consider the stochastic nature of those imbalances while predicting the secondary energy needs. In summary, has been identified in the literature three key areas of focus: the inefficiency of static reserve allocation methods, the potential of machine learning to improve forecasting accuracy, and the need for market design adaptations to support dynamic reserve procurement. This paper builds upon these insights by applying machine learning techniques to optimize secondary reserve allocation, addressing forecast uncertainty and market inefficiencies.

3. Electricity Markets and Ancillary Services

The operation of modern electricity systems relies heavily on well-structured markets to ensure the balance between generation and consumption. These markets encompass wholesale electricity markets, where energy is traded, and ancillary services markets, which guarantee the system's stability and reliability. The integration of vRES has added complexity to these operations, requiring more dynamic approaches to market design and reserve allocation.

3.1. Wholesale Electricity Markets

Wholesale electricity markets facilitate the trading of electricity between generators, suppliers, and other market participants. These markets are typically divided into three main categories: day-ahead markets (DAM), intraday markets (IDM), and real-time balancing markets. In the DAM, participants submit bids for energy delivery 12 to 37 hours before real-time operation. The market-clearing process determines the energy schedules and market prices based on supply and demand equilibrium [11]. While the DAM provides a foundation for energy trading, IDM allow participants to make adjustments closer to real-time, responding to unforeseen changes in demand or vRES generation.

Balancing markets, on the other hand, operate in near real-time to address deviations between scheduled and actual energy delivery. TSOs procure balancing services to ensure system equilibrium, activating reserves as needed. This process is particularly critical in systems with high vRES penetration, where forecasting errors can cause significant imbalances [8,24].

3.2. Ancillary Services and Reserve Requirements

Ancillary services are essential for maintaining grid stability and ensuring a reliable power supply. They include services such as frequency control, voltage regulation, and operating reserves. Among these, frequency control reserves play a crucial role in balancing supply and demand in real-time. These reserves are divided into three main categories [24] as presented in Figure 1:

- FCR: Activated automatically within seconds to stabilize frequency deviations.
- aFRR: Restore frequency to nominal levels and release FCR for subsequent use.
- mFRR: Address longer-term imbalances through manual activation.

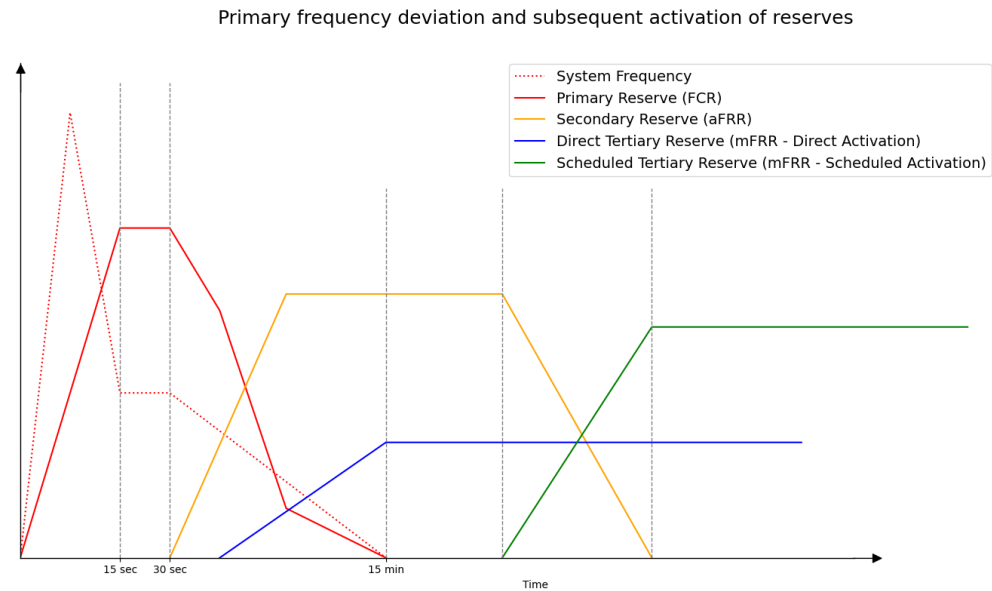


Figure 1. Ancillary Services Response Scheme. Adapted from [17]

3.3. Iberian Reserve Markets

Iberian Market of Electricity (MIBEL) is the Iberian example of energy market integration across countries. Acting as a bond between Portuguese and Spanish electricity markets, *Operador do Mercado Ibérico de Energia Português, Sociedade Gestora do Mercado Regulamentado, S.A.* (OMIP) and *Operador del Mercado Ibérico de Energía - Pólo Español, S.A* (OMIE). This joint market consists of bilateral, derivatives, and spot markets. Even though there is a joint market, each country's TSO, Red Eléctrica de España (REE) for Spain and *Redes Energéticas Nacionais* (REN) for Portugal, manages its own ancillary services independently.

3.3.1. Static Reserve Procurement

In Europe, the ENTSO-E provides guidelines for the procurement and activation of these reserves. Traditionally, TSOs acquire reserves symmetrically (equal upward and downward capacities), based on deterministic demand forecasts. However, this approach often leads to inefficiencies in systems with high vRES variability. For secondary reserve ENTSO-E proposes:

$$R = \sqrt{a \times L_{max} + b^2} - b \quad (1)$$

where:

- R : Secondary Control Reserve.
- a and b : empiric coefficients, $a=10\text{MW}$ and $b=150\text{MW}$.
- L_{max} : maximum anticipated consumer load.

The Spanish and Portuguese markets provide examples of differing reserve procurement methods. In Portugal, the TSO employs a fixed ratio formula for secondary reserve sizing. Creating a symmetrical distribution for upward and downward bands, respectively $\frac{2}{3}$ and $\frac{1}{3}$ of the reserve band.

The given formula is based on ENTSO-E equation (1), adding an hourly ratio ρ :

$$R = \rho \times \sqrt{a \times L_{max} + b^2} - b \quad (2)$$

The hourly ratio ρ varies between 20% (1.2) and 60% (1.6), upscaling the the ENTSO-E suggestion for up regulation. Conversely, the Spanish market lacks a standardized reserve procurement formula, relying instead on a more flexible procurement mechanism [19]. Where the upward and downward bands distribution is not directly symmetric. These differences highlight the need for market design improvements to better accommodate the variability of vRES.

4. Dynamic Procurement of Secondary Power

This study proposes a dynamic procurement based on machine learning techniques, trained with historical hourly data with custom made model architectures

4.1. Methodology Implementation

The methodology applied was a "brute force" choosing of better model, which can lead to better fine tuning results than a more complex architecture as shown in [25].

With multiple model related variables in study presented in Table 1:

Table 1. Training and Architecture Variables.

| Variables | Options |
|-----------------------|--|
| Architecture | CNN LSTM FCNN UNET Transformer |
| Advance Loss function | Mirror Weights N/A |
| Loss function | MAE MSE MSLE |
| Activation | linear ReLU GELU |
| Weights | Temporal Distance to mean No Weights |

For that we will study different architectures already proven to work in energy forecast [26], or in forecast in general [27], such as Fully Connected Neural Network (FCNN), LSTM, CNN. Testing also architectures proven to work in other fields, such as UNET [28] from image segmentation, or Transformers [29], the current machine learning state of art architecture. Although for Transformer, processing limitation won't allow for a deep study of potential the given problem.

As for the loss function used, we shall test it with the three most common regression loss function: Mean Absolute Error (MAE), Mean Squared Error (MSE), Mean Squared

Logarithmic Error (MSLE), which are means of the given error, in absolute terms, the square of the errors, and the logarithmic square, respectively. The last two functions give more importance to larger errors.

But since the problem we are trying to solve is not only of finding the smallest error, but to make sure there is less negative and positive error than the benchmark we create a custom loss function to encapsulate the final loss calculation, the Mirror Weights.

This function acts as a weight distributor for the negative and positive errors, in such a way that the a ratio defines which size gives more meaning to the final loss calculation. This was created since the error in missing energy is on a 10^5 dimension, and on surplus 10^6 .

In a default loss function trying to lower the absolute error, this difference means most work would be to lower surplus errors even at the expenses of raising the missing error. The created function allows for more behaviors, and some of them were studied, but the one with better results was defaulting surplus results weight 1, and making the weights of missing values its own error, multiplied by a ratio. Insights on given different ratio outcomes can be seen in Figure 2:

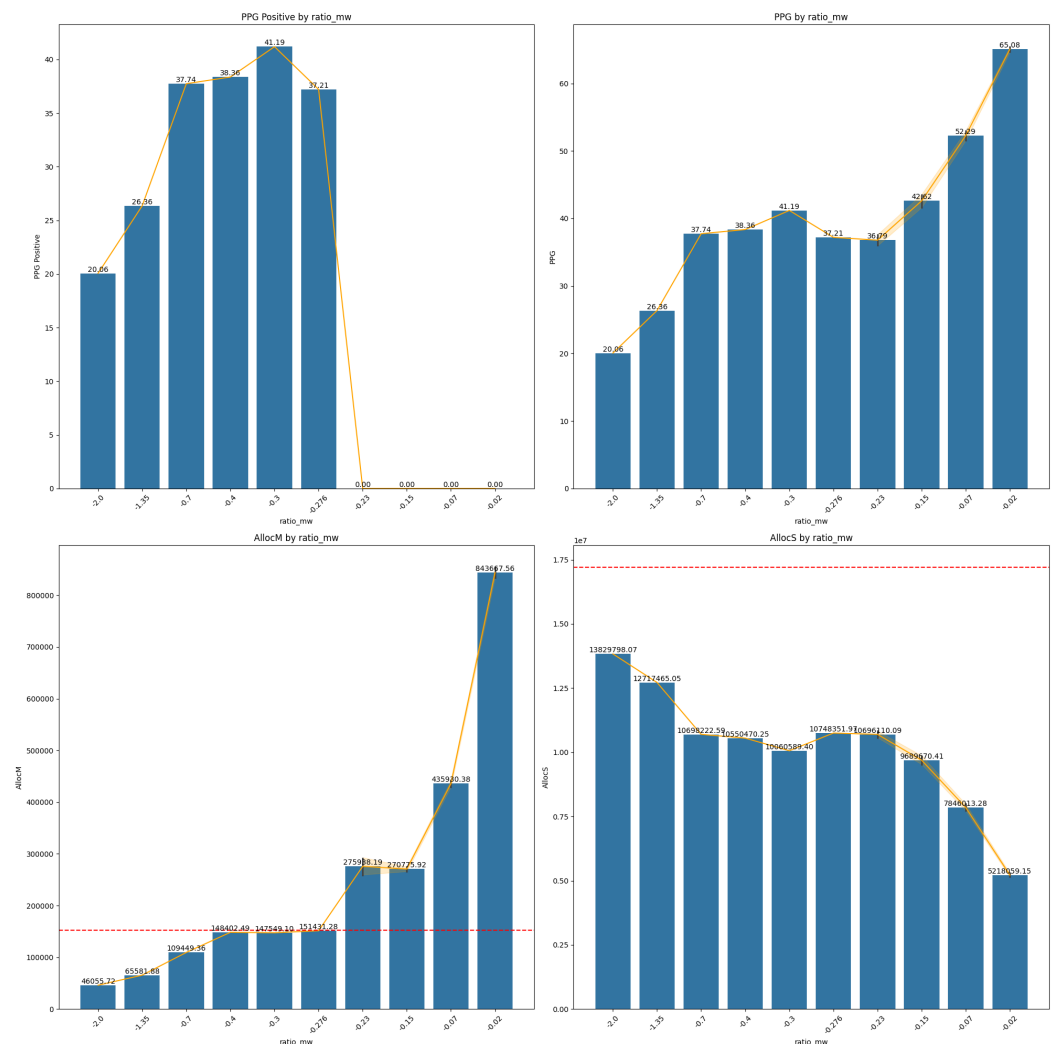


Figure 2. Mirror Weights Ratio Influence on Metrics

Were the red dotted line shows the benchmark values, and our goal is to have both below the benchmark line.

As for activation research suggested it could provide significant impact on the outcome [25,29]. The test were done using the most common activations for regression problems,

where we separated activations inside the model structure (on each deep layer), and the final layer. These are: linear leaves inputs unchanged, Rectified Linear Unit (ReLU) outputs the input if positive and zero otherwise, while Gaussian Error Linear Unit (GELU) smooth this behavior by applying a Gaussian-based probabilistic transformation.

And the last model variable in test were the weights, these given directly to the model training, not in a custom loss function. These weights are multiplied with the Mirror Weights.

Temporal weights give weight one to the oldest sample and add one per time sample, making older data less relevant, in an attempt to be more aware of latest trends. The distance to mean purpose is to give more weight values further away from the mean, this would serve as a way to alleviate mean related generalization and catch spike inducing patterns.

Where each of the model variables in study is a layer of training, giving the best model within that scope we would go to the next variable with the given best option so far. Going back and forward as to not loose best possible choices.

Figure 3 shows this scheme. For each layer training the set of models with the given variable in study, advancing to the next layer with the best option choosen before. And trying again the same variables in the most dinamic experiments.

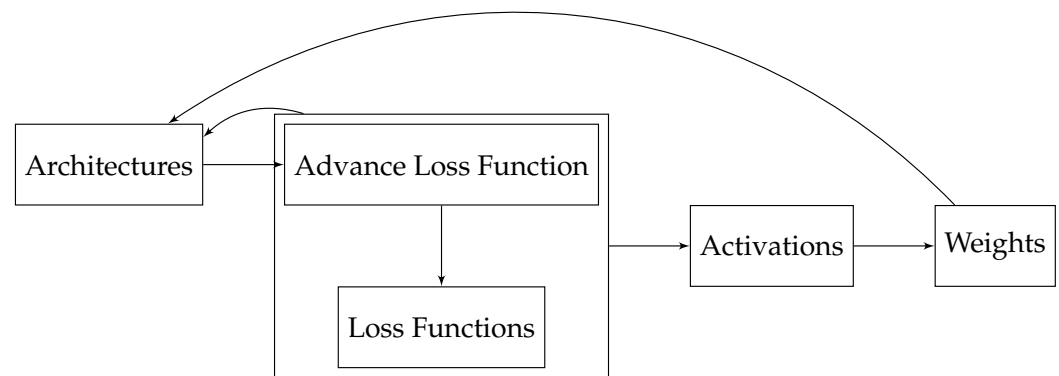


Figure 3. Model Choice Method Scheme.

For the purpose of controlling and processing this experiment three python packages were created.

- Alquimodelia: A keras based model builder package, to create the necessary models with each different arch and variable.
- Alquitable: A keras based workshop package, to create custom callbacks, loss functions, data generators.
- MuadDib: A machine learning framework that uses Alquimodelia to test and choose best models on given conditions automatically.

The experiments were done using keras>=3, a high-level deep learning library that simplifies the implementation of neural networks, with a torch backend on a CPU laptop.

4.2. Metrics

With distinct weights, the metrics, are used to choose best model on each iteration, and they can be divided into two groups:

1. Model metrics, where we just use the usual regression metrics adding a metric for how much did the model missed in allocating for the validation period.
2. Comparative metrics, where we assert percentage gains over the current allocation method.

4.2.1. Model Metrics

$$RMSE = \sqrt{\frac{1}{n} \sum_{i=1}^n (t_i - p_i)^2} \quad (3)$$

where t is the observed value, p is the forecast and n is the number of samples.

$$SAE = \sum_{i=1}^n |t_i - p_i| \quad (4)$$

SAE can be divide into the following metrics, where we obtain the error, within the time period, of allocated energy not enough for the needs, and too much energy allocated, separately.

The missing allocation (AllocM) is computed as follows:

$$AllocM = \sum_{i=1}^n |t_i - p_i|, \text{ if } p_i < t_i \quad (5)$$

The surplus allocation (AllocS) is computed as follows:

$$AllocS = \sum_{i=1}^n |t_i - p_i|, \text{ if } p_i > t_i \quad (6)$$

These metrics are needed to get a better error than the benchmark, but also to have less wasted AllocM, and less occurrences of AllocS.

4.2.2. Model/benchmark comparative metrics

Performance Percentage Gain (PPG) is the percentage of how much better is the model over the benchmark, it is computed as follows:

$$PPG = \frac{SAE_{benchmark} - SAE_{model}}{SAE_{benchmark}} \times 100 \quad (7)$$

The following metrics are the same but for only missing allocation and surplus allocation.

Performance Percentage Gain Missing (PPGM) computes the performance of the missing allocation as follows:

$$PPGM = \frac{AllocM_{benchmark} - AllocM_{model}}{AllocM_{benchmark}} \times 100 \quad (8)$$

PPGM computes the performance of the surplus allocation as follows:

$$PPGS = \frac{AllocS_{benchmark} - AllocS_{model}}{AllocS_{benchmark}} \times 100 \quad (9)$$

The PPGLPositive metric is showing how much better is the model over the benchmark, but only if PPGM and PPGS are positive.

$$PPGLPositive = \begin{cases} PPG & , \text{ if } PPGM \& PPGS \geq 0 \\ 0 & , \text{ if } PPGM \parallel PPGS < 0 \end{cases} \quad (10)$$

5. Case-Study

To evaluate the applicability of machine learning techniques for secondary reserve allocation, the study was conducted using the Spanish electricity market historical data from 2014 to 2024.

5.1. Data Sources and Preprocessing

The case study utilizes publicly available operational and historical data from the Spanish TSO, REE (please check the Data Availability Statement). The dataset includes the key variables presented in Table 2.

The data spans multiple years to account for seasonal variability and long-term trends in vRES generation and demand. Data preprocessing only handled missing values using interpolation methods, with IterativeImputer [30,31], as presented in Figure 4.

To choose the temporal space of the models, temporal auto-correlations were checked in Table 3.

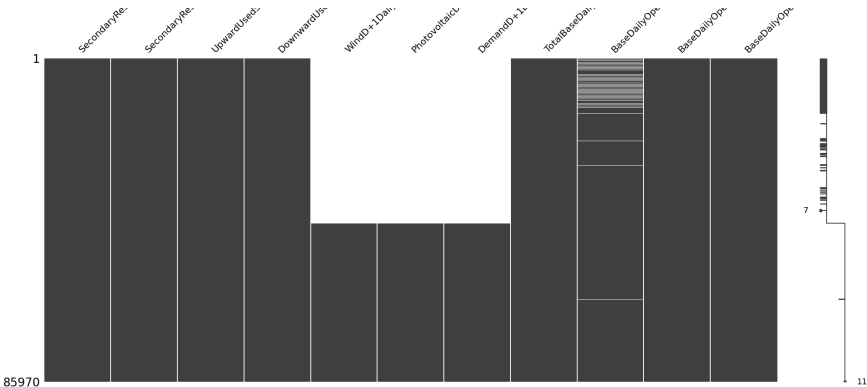


Figure 4. Missing Data per Attribute Time-Wise.

Table 2. ESIOS data used on the study.

| ESIOS Code | ESIOS Name | Variable | Units |
|------------|---|-----------------------------|-------|
| 632 | Secondary Reserve Allocation AUpward | Up Allocated | MW |
| 633 | Secondary Reserve Allocation ADownward | Down Allocated | MW |
| 680 | Secondary Reserve Upward Used Energy | Up Used | MWh |
| 681 | Secondary Reserve Downward Used Energy | Down Used | MWh |
| 1777 | Wind D+1 Daily Forecast | DA Wind | MWh |
| 1779 | Photovoltaic D+1 Daily Forecast | DA PV | MWh |
| 1775 | Demand D+1 Daily Forecast | DA Demand | MWh |
| 10258 | Total Base Daily Operating Schedule PBF Generation | DA Schedule Generation | MWh |
| 14 | Base Daily Operating Schedule PBF Solar PV | DA Schedule PV Generation | MWh |
| 10073 | Base Daily Operating Schedule PBF Wind | DA Schedule Wind Generation | MWh |
| 10186 | Base Daily Operating Shedule PBF Total Balance Interconnections | DA Scheduled Tie Lines | MWh |

Table 3. Temporal Self Correlation.

| Hour | 1 | 2 | 24 | 23 | 25 | 168 | 144 | 192 | 48 |
|------|------|------|------|------|------|------|------|------|------|
| Up | 0.44 | 0.24 | 0.22 | 0.19 | 0.19 | 0.17 | 0.16 | 0.16 | 0.16 |
| Down | 0.43 | 0.22 | 0.25 | 0.20 | 0.19 | 0.21 | 0.19 | 0.20 | 0.19 |

From Table 3 can be verified small correlations between variables.

The goal is to forecast DA values 24 hours ahead. The input for that forecast considers that temporal correlations present 168 hours after each day as the next correlation, which represents a week, i.e., is used the data of a week to forecast the next day. Variables has been added to account for each time range: day, day of year, month, day of week.

So, models will receive data in (Batch Size, 168, 18) shape for input, and (Batch Size, 24, 1) shape for output.

5.1.1. Training Data

For training the full dataset from 2014 to 2023, the data used has the following summary presented in Table 4.

Table 4. Training Data Summary.

| | Mean | Standard deviation | Min | Max |
|-----------------------------|----------|--------------------|----------|----------|
| Down Used | 168.18 | 199.23 | 0.00 | 1721.40 |
| Up Allocated | 665.98 | 150.88 | 399.00 | 958.00 |
| Down Allocated | 554.50 | 131.06 | 312.00 | 956.00 |
| Up Used | 160.82 | 193.09 | 0.00 | 1654.80 |
| DA Wind | 5881.14 | 3480.52 | 66.13 | 20879.30 |
| DA PV | 1676.31 | 2745.51 | 0.00 | 14925.30 |
| DA Demand | 27933.38 | 4488.71 | 14170.00 | 41799.66 |
| DA Schedule Generation | 27250.40 | 4608.74 | 13470.50 | 42707.60 |
| DA Schedule PV Generation | 1737.79 | 2850.91 | 0.00 | 16358.90 |
| DA Schedule Wind Generation | 6588.28 | 3637.80 | 308.60 | 21619.60 |
| DA Scheduled Tie Lines | 266.26 | 2169.01 | -7817.00 | 6858.50 |

Can be verified a significant standard deviations between the used energy for up and down regulation. Furthermore, even the allocated up and down capacities significantly differ according to the time period. The correlation of each variable with used secondary reserve energy presented in Figure 5.

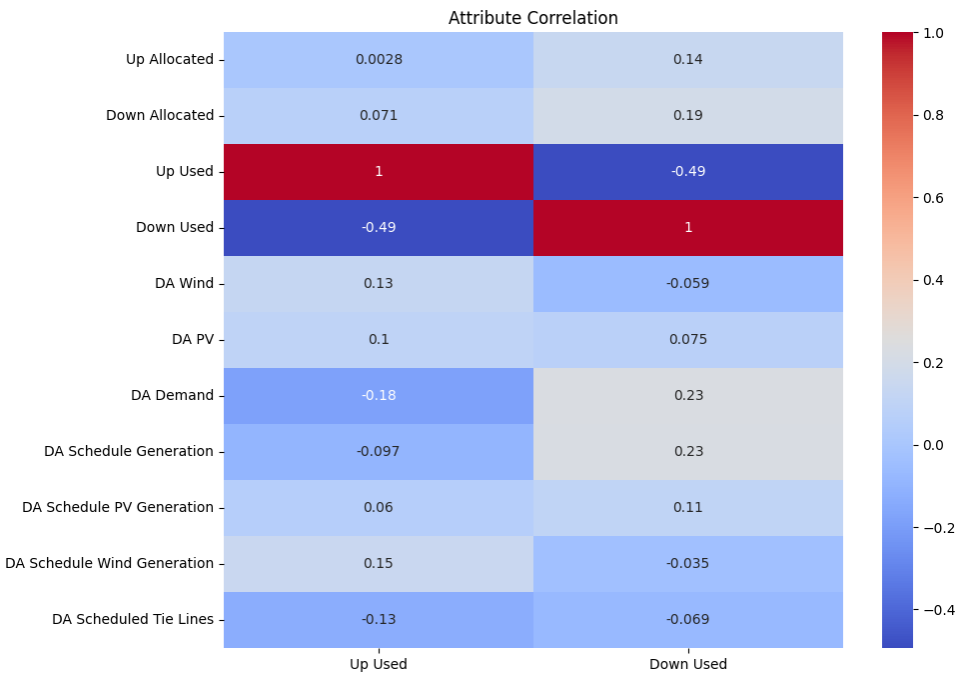


Figure 5. Attribute Correlation to Variables to forecast

In Figure 5 is possible to verify that the correlation between allocated capacities and used energy is close to zero.

The goal of this work is to reduce the difference between allocated capacities and used energy to efficiently use the available resources.

5.1.2. Validation Data

As for validation it was chosen the year 2024, with summary presented in Table 5.

Table 5. Validation Data Summary.

| | Mean | Standard deviation | Min | Max |
|-----------------------------|----------|--------------------|----------|----------|
| Down Used | 176.54 | 199.61 | 0.00 | 2012.00 |
| Up Used | 273.29 | 238.75 | 0.00 | 1852.80 |
| Up Allocated | 921.49 | 191.72 | 719.00 | 1694.00 |
| Down Allocated | 921.84 | 191.03 | 720.00 | 1708.00 |
| DA Wind | 6882.86 | 3963.88 | 452.80 | 19182.00 |
| DA PV | 4922.12 | 6136.32 | 0.00 | 19526.50 |
| DA Demand | 26430.59 | 4003.09 | 17500.30 | 38047.00 |
| DA Schedule Generation | 27790.16 | 5317.65 | 14489.30 | 41348.40 |
| DA Schedule PV Generation | 5442.92 | 6571.48 | 1.30 | 21273.90 |
| DA Schedule Wind Generation | 7774.31 | 4066.82 | 545.00 | 21195.10 |
| DA Scheduled Tie Lines | -1130.23 | 2477.49 | -7814.20 | 5884.80 |

Using the non comparative metrics the results are presented in Table 6.

310

Table 6. Metric Results for Validation Data.

| | RMSE | SAE | AllocM | AllocS |
|----------------------|--------|------------|----------|------------|
| Up Allocation (MW) | 726.26 | 5787490.59 | 41080.10 | 5746410.49 |
| Down Allocation (MW) | 794.53 | 6585513.97 | 15017.90 | 6570496.07 |

Table 6 presents the main problems of the actual capacity allocation methodology, resulting with high: i) errors (RMSE and SAE) with used energy, ii) missing energy (AllocM), and iii) extra energy (AllocS).

311


312

313

The correlation between allocated energy in the current method to the used energy can be seen in Figure 6.

314

315

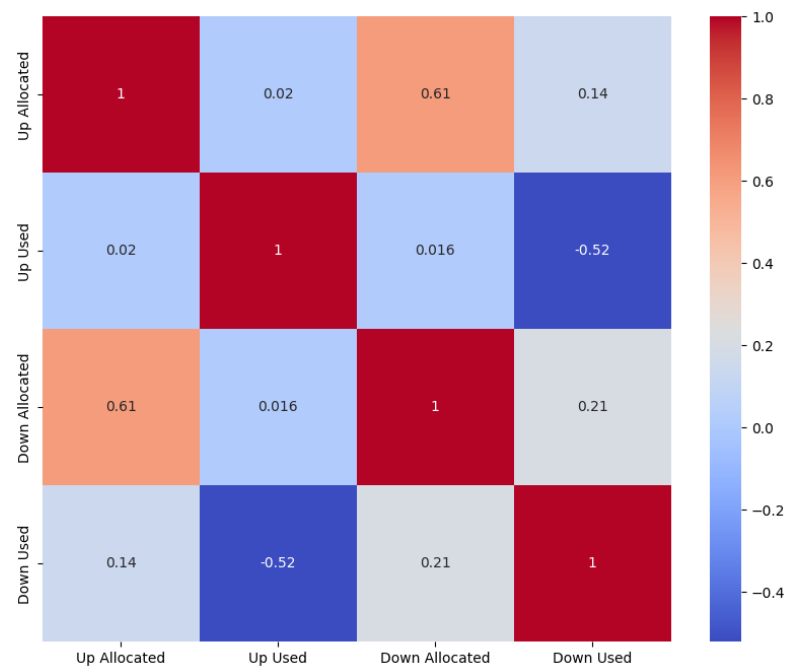**Figure 6.** Attribute Correlation Benchmark

In Figure 6 can be verified a high correlation between up and down allocated capacities, identifying the practically symmetrical used allocation. Furthermore, the correlation of allocated capacities with used energy is small, which can be solved by using dynamic allocation as presented in the next section.

5.2. Results

The best results, only based on PPG Positive, for each architecture are presented in Tables 7 and 8, where Vanilla means it is only one layer deep, and Stacked means two layers deep:

Table 7. Metric Results for Up and Down Forecast.

| Architecture | | RMSE | SAE $\times 10^6$ | AllocM $\times 10^5$ | AllocS $\times 10^6$ |
|-----------------|----------------|--------|----------------------|-------------------------|-------------------------|
| Up Allocation | StackedFCNN200 | 558.73 | 4.45 | 0.41 | 4.41 |
| | StackedCNN200 | 241.95 | 1.52 | 10.68 | 0.45 |
| | UNET200 | 242.62 | 1.55 | 10.75 | 0.48 |
| | VanillaCNN200 | 233.11 | 1.63 | 6.42 | 0.99 |
| | Transformer | 267.64 | 8.28 | 6.37 | 7.65 |
| Down Allocation | StackedFCNN200 | 674.12 | 5.64 | 0.14 | 5.62 |
| | StackedCNN200 | 196.73 | 1.20 | 7.24 | 0.47 |
| | UNET200 | 187.44 | 1.11 | 6.78 | 0.43 |
| | VanillaCNN200 | 664.59 | 5.41 | 0.21 | 5.39 |
| | Transformer | 351.15 | 10.69 | 4.59 | 10.23 |

Table 8. Comparative Metric Results for Up and Down Forecast.

| | Architecture | PPG % | PPG M % | PPG S % | PPG Positive % |
|-----------------|----------------|----------|------------|-------------|-------------------|
| Up Allocation | StackedFCNN200 | 22.67 | 1.02 | 22.83 | 22.67 |
| | StackedCNN200 | 73.69 | -2500.21 | 92.18 | 0.00 |
| | UNET200 | 73.14 | -2516.72 | 91.74 | 0.00 |
| | VanillaCNN200 | 71.72 | -1463.78 | 82.75 | 0.00 |
| | Transformer | 52.27 | -317.32 | 55.55 | 0.00 |
| Down Allocation | StackedFCNN200 | 14.08 | 6.01 | 14.10 14.08 | |
| | StackedCNN200 | 81.81 | -4721.00 | 92.84 | 0.00 |
| | UNET200 | 83.09 | -4413.30 | 93.41 | 0.00 |
| | VanillaCNN200 | 17.48 | -40.50 | 17.61 | 0.00 |
| | Transformer | 5.63 | 2.18 | 5.15 | 5.63 |

To choose the best model there was some analysis on PPG and the individuals Performance Percentage Gain Surplus (PPGS) and PPGM. So that the final results would not just be the one best across the validation time, but also meanwise in the same time.

Regarding all variables in Table 1, the chosen model can be described as presented in Table 9.

Table 9. Best Model Variable Description

| | Architecture | Advance Loss function ratio | Loss function | Activation | Weights |
|--------------------|--------------|--------------------------------------|------------------|------------|---------|
| Up Allocation | StackedFCNN | 0.23 | MSE | ReLU | Mean |
| Down Allocation | StackedFCNN | 0.002 | MSE | ReLU | Mean |

Within the validation time, best model results can be summarized by Tables 10 and 11.

Table 10. Model Metric Results for Predictions.

| | RMSE | SAE | AllocM | AllocS |
|-------------------------|--------|------------|----------|------------|
| Up Allocation (MW) | 570.21 | 4506080.04 | 40569.85 | 4465510.18 |
| Down Allocation (MW) | 694.80 | 5811536.58 | 13619.08 | 5797917.50 |

Table 11. Model/Benchmark Comparative Metrics Results for predictions.

| | PPG | PPG M | PPG S |
|---------------------|-------|-------|-------|
| Up Allocation (%) | 21.77 | 1.24 | 21.92 |
| Down Allocation (%) | 11.39 | 9.31 | 11.39 |

When comparing Table 6 with Table 10 can be verified a significant improvement in all outputs, supported by the metrics presented in Table 11. Indeed, by using the best machine learning methodology, in Table 11 is possible to verify a reduction of 21.92% and 11.39% in the extra up and down allocated capacity (PPG S) concerning the benchmark, respectively. Furthermore, the missing allocated up and down capacity (PPG M) also reduced by 1.24% and 9.31% concerning the benchmark, respectively.

Table 12 presents the overall description and comparison of the presented model with the benchmark.

Table 12. Model Results and (Allocated) Values within 2024.

| | Mean | Standard deviation | Min | Max |
|---------------------------------|----------------------|--------------------|---------------------|----------------------|
| Down Allocation (MW) | (921.84) 836.85 | (191.03) 182.04 | (720.00) 247.82 | (1708.00) 1469.62 |
| Up Allocation (MW) | (921.49) 778.42 | (191.72) 228.85 | (719.00) -29.47 | (1694.00) 1458.01 |
| Hourly Capacity (MW) | (1843.32) 1615.27 | (382.35) 346.50 | (1439.00) 393.85 | (3399.00) 2594.85 |
| Extraordinary Down Energy (MWh) | (168.74) 149.66 | (175.69) 179.96 | (0.90) 2.66 | (1214.00) 1358.81 |
| Extraordinary Up Energy (MWh) | (179.39) 141.85 | (163.94) 153.57 | (1.00) 1.83 | (1054.80) 1420.22 |

The proposed model presents an overall improvement of ~22% in upward allocation and ~11% in downward allocation, comparing to current allocation methods.

Where the hourly means differences between benchmark and validation results are presented in Table 13.

Table 13. Mean Δ% between Model and Benchmark

| | Δ% |
|---------------------------|--------|
| Down Allocation | -9.22 |
| Up Allocation | -15.53 |
| Hourly Capacity | -12.37 |
| Extraordinary Down Energy | -11.31 |
| Extraordinary Up Energy | -20.92 |

Average hourly improvements are of ~16% and ~9% respectively, which also is an improvement on state of the art [15] with 13% and 8%. The current study can free in average ~12% of hourly resources, lowering the need to allocate down and up capacity to the secondary reserve in ~21% and ~11%, respectively.

Can also be checked that the correlation between used and allocated is bigger than in the current method, achieving 36% in both upward energy and downward energy.

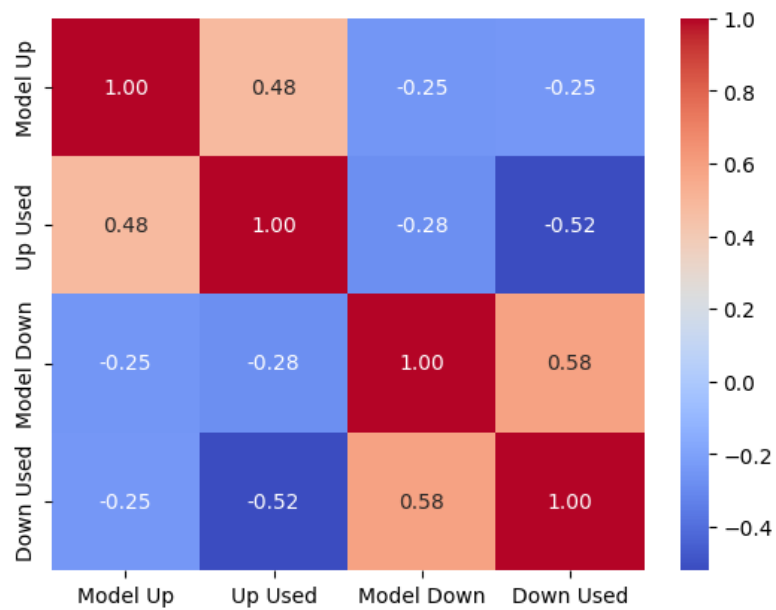


Figure 7. Correlations between Used and Allocated Energy

6. Conclusions

The results of the case study validate the effectiveness of machine learning techniques in improving the accuracy of reserve forecasts and optimizing reserve allocation. By dynamically adjusting upward and downward reserves based on real-time forecasts, the proposed methodology addresses the inefficiencies of static procurement methods. The observed cost savings and improved reserve utilization demonstrate the practical benefits of this approach for systems with high renewable penetration.

Additionally, the case study highlights the potential for asymmetrical dynamic reserve procurement to better reflect system needs, particularly during periods of extreme renewable generation variability. The integration of weather forecasts into the predictive models further enhances their reliability, ensuring that reserve procurement decisions are informed by real-time conditions.

Using the StackedFCNN architecture the average hourly improvements are of ~16% and ~9%, respectively. By using this leaning architecture the average hourly secondary allocated capacity can be reduced by ~12%, lowering the hourly need to allocate down and up capacities in ~11% and ~21%, respectively.

In conclusion, the case study illustrates that dynamic reserve procurement, supported by machine learning techniques, can significantly improve the efficiency and cost-effectiveness of balancing services in modern electricity systems. These findings provide a strong foundation for further research and potential implementation in other balancing markets with similar challenges.

For future work, a daily operational machine learning methodology will be developed, considering daily training data updates to better correlate reserved capacity with real-time reserve needs.

Author Contributions: Conceptualization, J.S and H.A.; Methodology, J.S and H.A.; Software, J.S.; Validation, H.A.; Formal analysis, J.S and H.A.; Investigation, J.S and H.A.; Resources, J.S and H.A.; Data curation, J.S and H.A.; Writing—original draft, J.S.; Writing—review & editing, H.A.; Visualization, J.S.; Supervision, H.A.; Project administration, H.A.; Funding acquisition, H.A. All authors have read and agreed to the published version of the manuscript.

Funding: This work received funding from the EU Horizon 2020 research and innovation program under the project TradeRES (grant agreement no. 864276).

Supplementary Materials: All methodologies are provided to allow the replicability of this work and testing them on other markets. IterativeImputer data preprocessing methodology is at <https://scikit-learn.org/stable/modules/generated/sklearn.impute.IterativeImputer.html>. Alquimodelia model can be obtained at <https://github.com/alquimodelia>. Mirror Weights ratio methodology is at https://github.com/alquimodelia/alquitable/blob/main/alquitable/advanced_losses.py#L33. Alquitable workshop package is at <https://github.com/alquimodelia/alquitable>. MuadDib machine learning framework can be obtained at <https://github.com/alquimodelia/MuadDib>.

Data Availability Statement: The data used to dynamically forecast secondary reserve needs and validate the proposed model is available at <https://www.esios.ree.es/es>.

Conflicts of Interest: The authors declare no conflicts of interest.

Abbreviations

| | |
|---------|---|
| aFRR | automatic Frequency Restoration Reserve |
| AllocM | missing allocation |
| AllocS | surplus allocation |
| CNN | Convolutional neural network |
| DA | Day-Ahead |
| DAM | day-ahead markets |
| ENTSO-E | European Network of Transmission System Operators for Electricity |
| ESIOS | <i>Sistema de Información del Operador del Sistema</i> |
| FCNN | Fully Connected Neural Network |
| FCR | Frequency Containment Reserve |
| GELU | Gaussian Error Linear Unit |
| IDM | intraday markets |
| LSTM | Long Short-Term Memory |
| MAE | Mean Absolute Error |
| mFRR | manual Frequency Restoration Reserve |
| MIBEL | <i>Iberian Market of Electricity</i> |
| MSE | Mean Squared Error |
| MSLE | Mean Squared Logarithmic Error |
| OMIE | <i>Operador del Mercado Ibérico de Energía - Pólo Espanhol, S.A</i> |
| OMIP | <i>Operador do Mercado Ibérico de Energia Português</i> |
| PPG | Performance Percentage Gain |
| PPGM | Performance Percentage Gain Missing |
| PV | solar photovoltaic |
| REE | <i>Red Eléctrica de España</i> |
| ReLU | Rectified Linear Unit |
| REN | <i>Redes Energéticas Nacionais</i> |
| SDG | Sustainable Development Goals |
| TSO | Transmission System Operators |
| vRES | variable Renewable Energy Systems |

Indices

| | |
|-----|-------------------|
| i | hour |
| n | number of samples |

Parameters

| | |
|--------|----------------------|
| ρ | hourly ratio |
| a, b | empiric coefficients |

Variables

| | |
|-----------|---------------------------|
| L_{max} | Maximum consumption |
| p_i | secondary energy forecast |
| R | Secondary Control Reserve |
| t_i | secondary energy observed |

References

1. Franc-Dabrowska, J.; Madra-Sawicka, M.; Milewska, A. Energy Sector Risk and Cost of Capital Assessment—Companies and Investors Perspective. *Energies* 2021, Vol. 14, Page 1613 2021, 14, 1613. <https://doi.org/10.3390/EN14061613>.
2. Perissi, I.; Jones, A. Investigating European Union Decarbonization Strategies: Evaluating the Pathway to Carbon Neutrality by 2050. *Sustainability (Switzerland)* 2022, 14, 4728. <https://doi.org/10.3390/SU14084728/S1>.
3. Dobrowolski, Z.; Drozdowski, G.; Panait, M.; Apostu, S.A. The Weighted Average Cost of Capital and Its Universality in Crisis Times: Evidence from the Energy Sector. *Energies* 2022, Vol. 15, Page 6655 2022, 15, 6655. <https://doi.org/10.3390/EN15186655>.
4. Ocker, F.; Ehrhart, K.M. The “German Paradox” in the balancing power markets. *Renewable and Sustainable Energy Reviews* 2017, 67, 892–898. <https://doi.org/10.1016/J.RSER.2016.09.040>.
5. Frade, P.M.; Pereira, J.P.; Santana, J.J.; Catalão, J.P. Wind balancing costs in a power system with high wind penetration - Evidence from Portugal. *Energy Policy* 2019, 132, 702–713. <https://doi.org/10.1016/J.ENPOL.2019.06.006>.
6. Algarvio, H.; Lopes, F.; Couto, A.; Estanqueiro, A.; Santana, J. Variable Renewable Energy and Market Design: New Products and a Real-World Study. *Energies* 2019, Vol. 12, Page 4576 2019, 12, 4576. <https://doi.org/10.3390/EN12234576>.
7. Skytte, K.; Bobo, L. Increasing the value of wind: From passive to active actors in multiple power markets. *Wiley Interdisciplinary Reviews: Energy and Environment* 2019, 8. <https://doi.org/10.1002/WENE.328>.
8. Algarvio, H.; Lopes, F.; Santana, J. Strategic Operation of Hydroelectric Power Plants in Energy Markets: A Model and a Study on the Hydro-Wind Balance. *Fluids* 2020, Vol. 5, Page 209 2020, 5, 209. <https://doi.org/10.3390/FLUIDS5040209>.
9. Algarvio, H.; Couto, A.; Riquelme-Santos, M.; Algarvio, H.; Couto, A.; Estanqueiro, A. RES.Trade: An Open-Access Simulator to Assess the Impact of Different Designs on Balancing Electricity Markets. *Energies* 2024, Vol. 17, Page 6212 2024, 17, 6212. <https://doi.org/10.3390/EN17246212>.
10. Frade, P.M.; Osório, G.J.; Santana, J.J.; Catalão, J.P. Regional coordination in ancillary services: An innovative study for secondary control in the Iberian electrical system. *International Journal of Electrical Power & Energy Systems* 2019, 109, 513–525. <https://doi.org/10.1016/J.IJEPES.2019.02.027>.
11. Algarvio, H.; Lopes, F.; Couto, A.; Santana, J.; Estanqueiro, A. Effects of regulating the European Internal Market on the integration of variable renewable energy. *Wiley Interdisciplinary Reviews: Energy and Environment* 2019, 8. <https://doi.org/10.1002/WENE.346>.
12. Knorr, K.; Dreher, A.; Böttger, D. Common dimensioning of frequency restoration reserve capacities for European load-frequency control blocks: An advanced dynamic probabilistic approach. *Electric Power Systems Research* 2019, 170, 358–363. <https://doi.org/10.1016/J.EPSR.2019.01.037>.
13. Vos, K.D.; Stevens, N.; Devolder, O.; Papavasiliou, A.; Hebb, B.; Matthys-Donnadieu, J. Dynamic dimensioning approach for operating reserves: Proof of concept in Belgium. *Energy Policy* 2019, 124, 272–285. <https://doi.org/10.1016/J.ENPOL.2018.09.031>.
14. Kruse, J.; Schäfer, B.; Witthaut, D. Secondary control activation analysed and predicted with explainable AI. *Electric Power Systems Research* 2022, 212. <https://doi.org/10.1016/J.EPSR.2022.108489>.
15. Algarvio, H.; Couto, A.; Estanqueiro, A. A Methodology for Dynamic Procurement of Secondary Reserve Capacity in Power Systems with Significant vRES Penetrations. *International Conference on the European Energy Market, EEM* 2024. <https://doi.org/10.1109/EEM60825.2024.10608904>.
16. Martín-Martínez, S.; Lorenzo-Bonache, A.; Honrubia-Escribano, A.; Cañas-Carretón, M.; Gómez-Lázaro, E. Contribution of wind energy to balancing markets: The case of Spain. *Wiley Interdisciplinary Reviews: Energy and Environment* 2018, 7. <https://doi.org/10.1002/WENE.300>.
17. Handbook, U.O. Policy 1: Load-frequency control and performance. *Final policy* 2009, 2.
18. Cardo-Miota, J.; Pérez, E.; Beltran, H. Deep learning-based forecasting of the automatic Frequency Reserve Restoration band price in the Iberian electricity market. *Sustainable Energy, Grids and Networks* 2023, 35, 101110. <https://doi.org/10.1016/J.SEGAN.2023.101110>.
19. Frade, P.M.; Shafie-khah, M.; Santana, J.J.; Catalão, J.P. Cooperation in ancillary services: Portuguese strategic perspective on replacement reserves. *Energy Strategy Reviews* 2019, 23, 142–151. <https://doi.org/10.1016/J.ESR.2018.12.011>.
20. Papavasiliou, A. An overview of probabilistic dimensioning of frequency restoration reserves with a focus on the greek electricity market. *Energies* 2021, 14. <https://doi.org/10.3390/EN14185719>.
21. Khodadadi, A.; Herre, L.; Shinde, P.; Eriksson, R.; Soder, L.; Amelin, M. Nordic Balancing Markets: Overview of Market Rules. *International Conference on the European Energy Market, EEM* 2020, 2020-September. <https://doi.org/10.1109/EEM49802.2020.9221992>.
22. Couto, A.; Estanqueiro, A. Assessment of wind and solar PV local complementarity for the hybridization of the wind power plants installed in Portugal. *Journal of Cleaner Production* 2021, 319, 128728. <https://doi.org/10.1016/J.JCLEPRO.2021.128728>.
23. Benti, N.E.; Chaka, M.D.; Semie, A.G. Forecasting Renewable Energy Generation with Machine Learning and Deep Learning: Current Advances and Future Prospects. *Sustainability (Switzerland)* 2023, 15. <https://doi.org/10.3390/SU15097087>.
24. Algarvio, H.; Lopes, F.; Couto, A.; Estanqueiro, A. Participation of wind power producers in day-ahead and balancing markets: An overview and a simulation-based study. *Wiley Interdisciplinary Reviews: Energy and Environment* 2019, 8. <https://doi.org/10.1002/WENE.343>.
25. Liu, Z.; Mao, H.; Wu, C.Y.; Feichtenhofer, C.; Darrell, T.; Xie, S. A ConvNet for the 2020s. *Proceedings of the IEEE Computer Society Conference on Computer Vision and Pattern Recognition* 2022, 2022-June, 11966–11976. <https://doi.org/10.1109/CVPR52688.2022.01167>.

26. de C. Costa, R.L. Convolutional-LSTM networks and generalization in forecasting of household photovoltaic generation. *Engineering Applications of Artificial Intelligence* **2022**, *116*, 105458. <https://doi.org/10.1016/J.ENGAPPAI.2022.105458>. 451
27. Hewamalage, H.; Bergmeir, C.; Bandara, K. Recurrent Neural Networks for Time Series Forecasting: Current status and future directions. *International Journal of Forecasting* **2021**, *37*, 388–427. <https://doi.org/10.1016/j.ijforecast.2020.06.008>. 452
28. Shelhamer, E.; Long, J.; Darrell, T. Fully Convolutional Networks for Semantic Segmentation. *IEEE Transactions on Pattern Analysis and Machine Intelligence* **2014**, *39*, 640–651. <https://doi.org/10.1109/TPAMI.2016.2572683>. 453
29. Vaswani, A.; Shazeer, N.; Parmar, N.; Uszkoreit, J.; Jones, L.; Gomez, A.N.; Łukasz Kaiser; Polosukhin, I. Attention Is All You Need. *Advances in Neural Information Processing Systems* **2017**, 2017-December, 5999–6009. 454
30. van Buuren, S.; Groothuis-Oudshoorn, K. mice: Multivariate Imputation by Chained Equations in R. *Journal of Statistical Software* **2011**, *45*, 1–67. <https://doi.org/10.18637/JSS.V045.I03>. 455
31. Buck, S.F. A Method of Estimation of Missing Values in Multivariate Data Suitable for use with an Electronic Computer. *Journal of the Royal Statistical Society. Series B (Methodological)* **1960**, *22*, 302–306. 456

Disclaimer/Publisher's Note: The statements, opinions and data contained in all publications are solely those of the individual author(s) and contributor(s) and not of MDPI and/or the editor(s). MDPI and/or the editor(s) disclaim responsibility for any injury to people or property resulting from any ideas, methods, instructions or products referred to in the content. 457
458
459
460
461
462
463
464
465