



JP2 ARCHITECTS
2811 Dillon Street
Baltimore, MD 21224
t 410.646.8300
www.JP2architects.com

CONSULTANTS

Mechanical, Electrical, Plumbing, Fire Protection:
CFR Engineering
20251 Century Blvd.
Germantown, MD 20874
t 877.871.4229
w www.cfrengineering.com

SEAL / SIGNATURE



PROFESSIONAL CERTIFICATION: I HEREBY CERTIFY THAT THESE DOCUMENTS WERE PREPARED OR SUPERVISED BY ME, AND THAT I AM A DULY LICENSED PROFESSIONAL ARCHITECT UNDER THE LAWS OF THE STATE OF MARYLAND. LICENSE NO. 10086 EXPIRATION DATE 08/01/2027

PROJECT

GATEWAY PLAZA
TENANT 121
121 TOWNE CENTER BLVD
SANFORD, FL 32771

CONSTRUCTION DOCUMENTS

CLIENT / OWNER

GG REIF | Gateway LLC
3904 Boston St.
Baltimore, MD 21224
t 410.559.2500
f 410.518.2032
www.ggcommercial.com

REVISION DRAWING LOG

No.	Date	Title

PROJECT NUMBER: 25-137
COPYRIGHT © 2025 JP2 ARCHITECTS

DRAWING TITLE

**GENERAL NOTES,
SYMBOLS, AND
ABBREVIATIONS -
ELECTRICAL**

DRAWING NUMBER

E001

Issue Date 01/07/2026

ELECTRICAL GENERAL NOTES

GENERAL CONDITIONS

- THE CONTRACTOR SHALL COMPLY WITH ALL THE LAWS, ORDINANCES, RULES AND REGULATIONS OF ALL LOCAL AND STATE GOVERNMENTAL AUTHORITIES, THE RULES OF THE NATIONAL FIRE PROTECTION ASSOCIATION AS INTERPRETED BY THE ENFORCING AUTHORITY HAVING JURISDICTION AND OF THE PUBLIC UTILITIES HAVING CONNECTION WITH ANY OF THE SYSTEMS HEREIN SPECIFIED.
 - ADA - AMERICANS WITH DISABILITIES ACT ACCESSIBILITY GUIDELINES
 - IESNA - ILLUMINATING ENGINEERS SOCIETY OF NORTH AMERICA
 - IBC - INTERNATIONAL BUILDING CODE - 2021
 - IEEC - INTERNATIONAL ENERGY CODE CONSERVATION CODE - 2021
 - IMC - INTERNATIONAL MECHANICAL CODE - 2021
 - IPC - INTERNATIONAL PLUMBING CODE - 2021
 - NEMA - NATIONAL ELECTRICAL MANUFACTURERS ASSOCIATION
 - NESC - NATIONAL ELECTRIC SAFETY CODE - 2023
 - NFPA 70 - NATIONAL ELECTRICAL CODE (NEC) - 2023
 - NFPA 72 - NATIONAL FIRE ALARM AND SIGNALING CODE - 2022
 - NFPA 101 - LIFE SAFETY CODE - 2021
 - NFPA 110 - STANDARD FOR EMERGENCY AND STANDBY POWER SYSTEMS - 2022
 - UL - UNDERWRITERS LABORATORIES
- THE CONTRACTOR SHALL SECURE AND PAY FOR ALL PERMITS AND INSPECTIONS REQUIRED BY ANY OF THE FOREGOING AUTHORITIES, AND PAY FOR ALL OTHER COSTS IN CONNECTION WITH THE WORK. ALL CERTIFICATES SHALL BE IN DUPLICATE AND SHALL BE DELIVERED TO THE OWNER.
- THE SITE, LOCATION AND ROUTING OF SYSTEMS INDICATED TO HAVE NEW CONNECTIONS MADE TO THEM ARE SHOWN AS ACCURATELY AS FIELD CONDITIONS WOULD PERMIT. ALL EXISTING CONDITIONS SHALL BE EXAMINED AND THEIR EXACT LOCATIONS VERIFIED. THE CONTRACTOR SHALL REPORT TO THE ARCHITECT, ENGINEER AND OWNER BEFORE SUBMITTING A BID, ANY CONDITIONS WHICH MIGHT MAKE INSTALLATION OF REQUIRED EQUIPMENT A PROBLEM. NO CONSIDERATION OR ALLOWANCE WILL BE GRANTED FOR FAILURE TO INVESTIGATE CONDITIONS OR MISUNDERSTANDINGS OF THE CONTRACTUAL REQUIREMENTS.
- THE CONTRACTOR SHALL REMOVE ALL EQUIPMENT NOT INDICATED TO BE REUSED TO A DESIGNATED LOCATION AT THE PROJECT SITE. AFTER THE EQUIPMENT HAS BEEN ASSEMBLED FOR THE OWNER'S INSPECTION AND POSSIBLE RETENTION, ALL EQUIPMENT NOT TO BE RETAINED BY THE OWNER SHALL BE REMOVED FROM THE SITE BY THE CONTRACTOR. ALL BUILDING SYSTEMS SHALL REMAIN IN SERVICE UNLESS INDICATED OTHERWISE. ALL OUTAGES OR INTERRUPTIONS SHALL BE KEPT TO MINIMUM DURATION. NOTIFY THE OWNER 48 HOURS IN ADVANCE OF ANY OUTAGE OR INTERRUPTION.
- THE CONTRACTOR SHALL INSTALL AND CONNECT ALL EQUIPMENT AND MATERIALS IN ACCORDANCE WITH THE BEST ENGINEERING PRACTICE AND, UNLESS OTHERWISE SHOWN OR SPECIFIED, FOLLOW THE MANUFACTURER'S INSTRUCTIONS AND RECOMMENDATIONS AND FURNISH AND INSTALL ALL REQUIRED AUXILIARY ITEMS COMPLETE.
- DRAWINGS SHALL BE CONSIDERED DIAGRAMMATIC AND FOR BIDDING PURPOSES ONLY. WHILE THE DRAWINGS ARE GENERALLY TO SCALE AND ARE AS ACCURATE AS THE SCALE WILL PERMIT, ALL IMPORTANT DIMENSIONS SHALL BE DETERMINED IN THE FIELD.
- COORDINATE WITH ALL TRADES TO AVOID INTERFERENCE AMONG MECHANICAL, ELECTRICAL, ARCHITECTURAL AND STRUCTURAL ITEMS. PROVIDE ALL NECESSARY OFFSETS AND FITTINGS IN CIRCUITRY AND OTHER ITEMS REQUIRED TO INSTALL THE WORK WITHOUT INTERFERENCES.
- THE CONTRACTOR SHALL TEST ALL EQUIPMENT INSTALLED UNDER THIS CONTRACT AND DEMONSTRATE TO THE OWNER ITS PROPER OPERATIONS. ALL NEW EQUIPMENT SHALL BE MOUNTED VIBRATION FREE.
- ALL EQUIPMENT AND WORKMANSHIP SHALL BE GUARANTEED IN FULL FROM ALL DEFECTS FOR ONE (1) YEAR FROM THE DATE OF FINAL ACCEPTANCE OF THIS WORK.
- ALL EQUIPMENT INSTALLED SHALL BE NEW AND SHALL CONFORM IN ALL RESPECTS TO THE LATEST APPROVED STANDARDS OF IEEE, ANSI, NEMA AND UNDERWRITERS LABORATORIES, INC., (UNLESS INDICATED OTHERWISE). SUBSTITUTIONS SHALL ONLY BE ACCOMPLISHED AT THE DISCRETION OF THE ENGINEER. SHOP DRAWINGS ARE TO BE SUBMITTED AND APPROVED BEFORE THE EQUIPMENT IS ORDERED.
- THE CONTRACTOR SHALL REPAIR ALL WALL, CEILING, FLOOR, OR ROOF OPENINGS WHICH ARE CREATED BY DEMOLITION OR PENETRATION. THE REPAIRS SHALL BE WITH MATERIALS AND FINISHES TO MATCH EXISTING. ALL FIRE RATED PENETRATIONS SHALL BE SEALED WITH SUITABLE MATERIALS TO PRESERVE FIRE RATED INTEGRITY.
- DEFINITIONS
 - "PROVIDE" UNDER THIS CONTRACT IS DEFINED AS FURNISH AND INSTALL.
 - "CONCEALED" UNDER THIS CONTRACT IS DEFINED AS HIDDEN BY ARCHITECTURAL WALLS AND CEILING.
 - "EXPOSED" UNDER THIS CONTRACT IS DEFINED AS VISIBLE TO THE UNPAID EYE.
 - "INDICATED" UNDER THIS CONTRACT IS DEFINED AS SHOWN IN THE CONTRACT DOCUMENTS.
- UPON COMPLETION OF THE WORK, THE CONTRACTOR SHALL THOROUGHLY CLEAN THE CONTRACT AREA AND ALL OTHER AREAS USED FOR STORAGE, STAGING, ETC.
- THE CONTRACTOR SHALL NOTIFY THE OWNER WHEN THE PROJECT IS APPROXIMATELY 75% COMPLETED IN ORDER TO SCHEDULE A PRE-FINAL REVIEW OF CONSTRUCTION. NO WORK SHALL BE CONCEALED BY PLUMBS, WALLS, ETC. FINAL REVIEW SHALL BE SCHEDULED AT 100% COMPLETION. ALL PUNCH LIST ITEMS MUST BE ACCOMPLISHED PRIOR TO FINAL ACCEPTANCE.
- THE CONTRACTOR SHALL PREPARE A COMPREHENSIVE METHOD OF PROCEDURE AND SUBMIT IT TO THE OWNER WITH SHOP DRAWINGS FOR REVIEW. THE SUBMITTAL SHALL INCLUDE METHODS OF PROCEDURE FOR ALL POTENTIAL EMERGENCY SITUATIONS AND SHALL INCLUDE A LIST OF PERSONS REPRESENTING THE OWNER AND THE CONTRACTOR ALONG WITH DAYTIME AND EMERGENCY PHONE NUMBERS WHO SHALL BE CONTACTED IN THE EVENT OF AN EMERGENCY. THIS LIST SHALL BE DISTRIBUTED TO THE OWNER'S REPRESENTATIVE AND THE CONTRACTORS SUPERINTENDENT OR FOREMAN AT THE SITE. EMERGENCY SITUATIONS SHALL INCLUDE BUT NOT BE LIMITED TO POWER OUTAGES, CHILLED AND CONDENSER WATER SYSTEM RUPTURES, AUTOMATIC TEMPERATURE CONTROL, OUTAGES AND OWNERS EQUIPMENT DAMAGE. THE COMPREHENSIVE METHOD OF PROCEDURE SHALL BE APPROVED BY THE OWNER PRIOR TO COMMENCEMENT OF ANY WORK.
- THE USE OF POWDER DRIVEN FASTENERS OR IMPACT TOOLS SHALL NOT BE PERMITTED.
- PROVIDE TEMPORARY SERVICE FOR LIGHTING AND POWER EQUIPMENT (DRILLS, SAW, ETC.). VERIFY TEMPORARY REQUIREMENTS WITH GENERAL CONTRACTOR. TEMPORARY LIGHTING AND POWER SHALL MEET OSHA REQUIREMENTS AND LOCAL CODE. TEMPORARY POWER SHALL BE 120 VOLTS.
- UNLESS SPECIFICALLY NOTED ON THE DEMOLITION PLANS, REMOVE ALL LIGHTING, SWITCHES, RECEPTACLES AND CLOCK OUTLETS AND ASSOCIATED CIRCUITRY INDICATED. CIRCUITRY TO BE REMOVED SHALL BE ALL CONDUCTORS AND ANY EXPOSED RACEWAYS INCLUDING WIREMOLD AND ALL RACEWAY THAT BECOMES EXPOSED UPON REMOVAL OF WALLS AND CEILING. NOT ALL DEVICES TO BE REMOVED ARE SHOWN ON PLANS.
- UNLESS SPECIFICALLY NOTED ON THE PLANS, ALL CIRCUITRY, EQUIPMENT, DEVICES, ETC., NOT NOTED AS EXISTING TO REMAIN OR TO BE RELOCATED, SHALL BE NEW. THE CONTRACTOR MAY REUSE ALL EXISTING CIRCUITRY AS FIELD CONDITIONS PERMIT. REMOVE ALL DEVICES AND CIRCUITRY NOT BEING REUSED. CIRCUITRY TO BE REMOVED SHALL BE REMOVED BACK TO THE SOURCE AND ALL HOLES SHALL BE REPAIRED TO CONFORM TO FINISHED SURFACE. ALL CIRCUITS THAT ARE TO REMAIN IN SERVICE UPON COMPLETION OF THIS PROJECT MUST BE COORDINATED WITH THE OWNER'S REPRESENTATIVE.
- PROTECT ADJACENT MATERIALS INDICATED TO REMAIN. INSTALL AND MAINTAIN DUST AND NOISE BARRIERS TO KEEP DIRT, DUST, AND NOISE FROM BEING TRANSMITTED TO ADJACENT AREAS. REMOVE PROTECTION AND BARRIERS AFTER DEMOLITION OPERATIONS ARE COMPLETE.
- LOCATE, IDENTIFY AND PROTECT ELECTRICAL SERVICES PASSING THROUGH DEMOLITION AREA AND SERVING OTHER AREAS OUTSIDE THE DEMOLITION LIMITS. MAINTAIN SERVICES TO AREAS OUTSIDE DEMOLITION LIMITS. WHEN SERVICES MUST BE INTERRUPTED, INSTALL TEMPORARY SERVICES FOR AFFECTED AREAS.
- FINAL TESTING: AT THE TIME OF FINAL INSPECTION AND TESTS, ALL CONNECTIONS AT PANELBOARDS, DEVICES AND EQUIPMENT AND ALL SPLICES MUST BE COMPLETED. EACH BRANCH CIRCUIT AND ITS RESPECTIVE CONNECTED EQUIPMENT MUST TEST FREE OF SHORT CIRCUITS. UPON COMPLETION OF THE WORK, CLEAN AND POLISH ALL EXPOSED SURFACES IN ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS.

ELECTRICAL SCOPE OF WORK NARRATIVE

EXISTING SPACE IS BEING IS CURRENTLY ONE (1) TENANT SPACE THAT IS BEING TURNED INTO TWO (2) NEW TENANT SPACES WITH A DEMISING WALL. BOTH NEW TENANT SPACES WILL BE TREATED AS A COLD DARK SHELL. ELECTRICAL SCOPE OF WORK IS TO PROVIDE SEPARATE WATER METERS AND SANITARY SERVICES TO EACH TENANT.

ELECTRICAL ABBREVIATIONS

A	AMPS	FAAP	FIRE ALARM ANNUNCIATOR PANEL	NTS	NOT TO SCALE
AIC	AMPS INTERRUPTING CAPACITY	FACP	FIRE ALARM CONTROL PANEL	PBO	PROVIDED BY OTHERS
AFF	ABOVE FINISHED FLOOR	FLA	FULL LOAD AMPS	PH	PHASE
ATS	AUTOMATIC TRANSFER SWITCH	G	GROUND	(R)	EQUIPMENT TO BE RELOCATED
AWG	AMERICAN WIRE GAUGE	GF1	GROUND FAULT INTERRUPTER	T	TRANSFORMER
C	CONDUIT	HOA	HANDS OFF AUTOMATIC	TYP	TYPICAL
CB	CIRCUIT BREAKERS	HP	HORSEPOWER	TELE	TELEPHONE
CKT	CIRCUIT	KVA	KILOVOLT AMPERE	SW	SWITCH
CLG	CEILING	KW	KILOWATTS	UCON	UNLESS OTHERWISE NOTED
CT	CURRENT TRANSFORMER	LTO	LIGHTING	UPS	UNINTERRUPTIBLE POWER SUPPLY
(E)	EXISTING TO REMAIN	MCB	MAIN CIRCUIT BREAKER	V	VOLTS
ELEC	ELECTRIC	MDP	MAIN DISTRIBUTION PANEL	VA	VOLT-AMPS
EM	EMERGENCY	MIN	MINIMUM	W	WATTS
(ER)	RELOCATED EQUIPMENT	MLO	MAIN LUGS ONLY	WP	WEATHERPROOF
FA	FIRE ALARM	(N)	NEW	(X)	REMOVE
		NEC	NATIONAL ELECTRICAL CODE	XFMR	TRANSFORMER

ELECTRICAL SYMBOLS

NOTE: ALL SYMBOLS LISTED MAY NOT APPEAR ON THE DRAWINGS

PLAN SYMBOLS

	PLAN REFERENCE NOTE SYMBOL
	EXISTING TO BE REMOVED
	EXISTING TO REMAIN
	NEW WORK
	MECHANICAL EQUIPMENT, REFERENCE MECHANICAL DRAWINGS
	END OF DEMOLITION
	POINT OF CONNECTION TO EXISTING

WIRING DEVICES

	DUPLEX RECEPTACLE - NEMA 5-20R	1'-6" UON
	TOGGLE SWITCH	4'-0" UON
	3-WAY TOGGLE SWITCH	4'-0" UON
	4-WAY TOGGLE SWITCH	4'-0" UON

EQUIPMENT

	PANELBOARD, DISTRIBUTION
	PANELBOARD, BRANCH
	MOTOR CONNECTION
	NON-FUSED SAFETY DISCONNECT SWITCH - NUMERAL DENOTES SWITCH SIZE - 3 POLE, UON
	FUSED SAFETY DISCONNECT SWITCH - UPPER NUMERAL DENOTES SWITCH SIZE, LOWER NUMERAL DENOTES FUSE SIZE - 3 POLE, UON
	TRANSFORMER
	HOMERUN TO PANELBOARD, NUMERALS AND LETTERS ADJACENT TO ARROW HEAD(S) INDICATE ASSIGNED PANEL AND CIRCUITS NUMBER(S); SEE PANEL SCHEDULES FOR CIRCUIT WIRE AND CONDUIT SIZES/QUANTITIES
	UTILITY CT METER CABINET

ONE-LINE DIAGRAM


	PANEL, SWITCHBOARD, OR BUSDUCT - SEE ONE-LINE DIAGRAM FOR EXACT SPECIFICATION
	EQUIPMENT ENCLOSURE - SEE ONE-LINE DIAGRAM FOR EXACT SPECIFICATION
	ELECTRICAL CONDUIT - SEE ONE-LINE DIAGRAM FOR EXACT SPECIFICATION
	CIRCUIT BREAKER
	FUSED DISCONNECT SAFETY SWITCH, 3 POLE UON
	TRANSFORMER
	UTILITY METER

FIRE ALARM

	FIRE ALARM MANUAL PULL STATION
	FIRE ALARM AUDIO-VISUAL DEVICE, CANDELA RATING AND SPEAKER WATTAGE AS INDICATED. WATTAGE RANGES FROM 0.25W TO 2.0W. WALL MOUNTED UON. "C" INDICATES SUSPENDED FROM CEILING. INCLUDES SEPARATE AMBER FOR WEATHER ALERTS AND SPEAKER FOR MASS NOTIFICATION
	FIRE ALARM SMOKE DETECTOR, PROVIDE COMPATIBLE WITH FIRE ALARM SYSTEM AS INDICATED. CEILING MOUNTED UON
	FIRE ALARM ANNUNCIATOR PANEL
	FIRE ALARM CONTROL PANEL

1 FIRE ALARM PARTIAL RISER DIAGRAM - TENANT SPACE 121


SCALE: NO SCALE

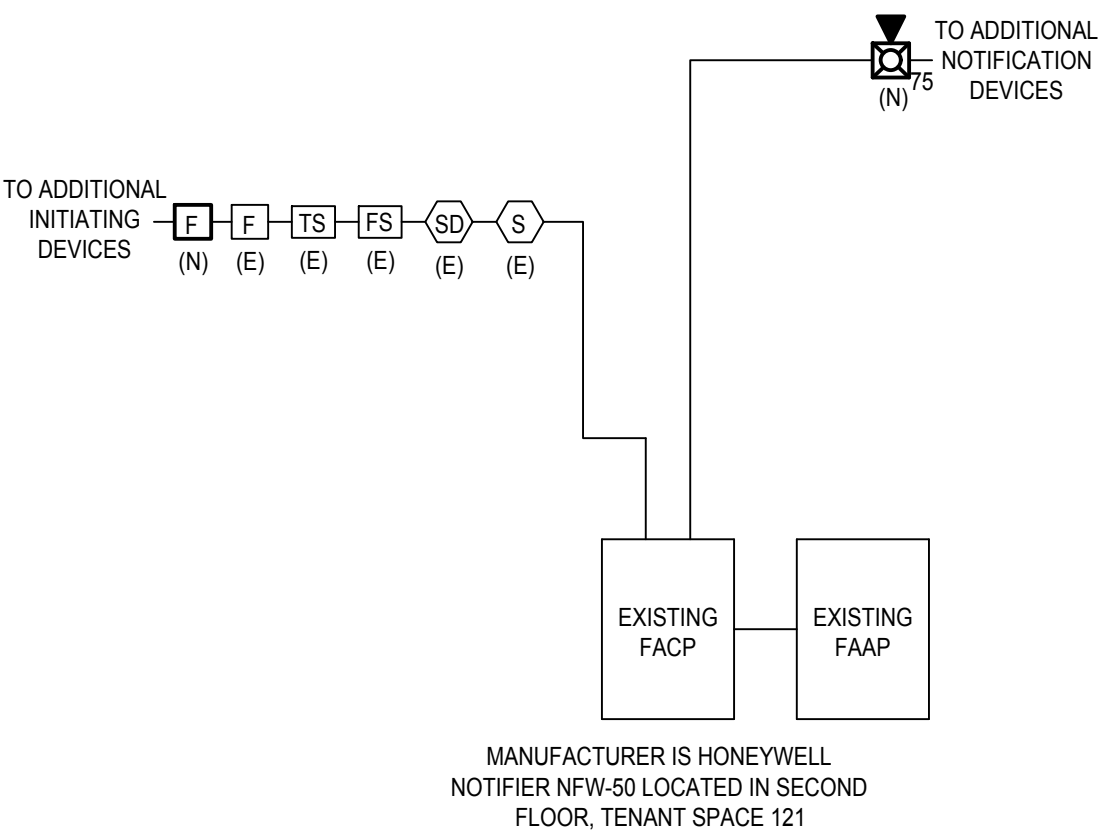


- PRIOR TO THE START OF ANY WORK THE CONTRACTOR SHALL PERFORM A TEST PER NFPA 72 AND VERIFY THE EXISTING FIRE ALARM SYSTEM IS IN GOOD WORKING CONDITION. THE RESULTS OF THIS TEST SHALL BE SUBMITTED TO THE OWNER, ARCHITECT, AND ENGINEER FOR RECORD. ANY REPAIRS REQUIRED TO MAKE THE FIRE ALARM SYSTEM OPERATIONAL SHALL BE PROVIDED TO THE OWNER UNDER A SEPARATE LINE ITEM PRICE FOR APPROVAL. COMMENCEMENT OF ANY REPAIR WORK WITHOUT AUTHORIZATION BY OWNER WILL BE DONE AT THE CONTRACTOR'S EXPENSE.
- THIS PROJECT INVOLVES THE INSTALLATION OF NEW FIRE ALARM DEVICES TO EXTEND THE SERVICE OF THE EXISTING BASE BUILDING FIRE ALARM SYSTEM TO PROTECT THE AREA OF WORK INDICATED. THE EXTENSION OF SYSTEM WILL EMPLOY THE FOLLOWING CIRCUIT PERFORMANCE IN ACCORDANCE OF NFPA 72: CLASS A FOR SIGNALING LINE CIRCUITS, INITIATING DEVICE CIRCUITS, AND NOTIFICATION APPLIANCE CIRCUITS. PROVIDE CLASS X FOR PANEL-TO-PANEL COMMUNICATIONS.
- NEW INITIATING DEVICES SHALL BE INSTALLED AND CONNECTED ON EXISTING INITIATING DEVICE CIRCUITS SERVED BY THE EXISTING FIRE ALARM CONTROL PANEL AS PER MANUFACTURERS REQUIREMENTS. THE CONTRACTOR SHALL PROVIDE ADDITIONAL NOTIFICATION CIRCUITS TO ACCOMMODATE THE ADA APPROVED AUDIBLE AND VISUAL SIGNALING DEVICES IN QUANTITIES AND TYPES AS INDICATED.
- ALL INTERCONNECTIONS TO THE EXISTING FIRE ALARM SYSTEM SHALL BE CONNECTED SO AS TO PROVIDE U.L. REQUIRED SUPERVISION OF ALL WIRING. ADDITIONALLY, SHOULD THE NEW EQUIPMENT BECOME INOPERATIVE FOR ANY REASON, THE EXISTING FIRE ALARM SYSTEM SHALL ENTER TROUBLE MODE.
- THE CONTRACTOR SHALL PROVIDE ALL DEVICES, WIRING, EXPANDER PANELS, ETC., AS REQUIRED FOR A COMPLETE, CODE COMPLIANT AND OPERATIONAL FIRE ALARM SYSTEM.
- THIS RISER DIAGRAM IS TYPICAL ONLY. REFER TO FLOOR PLANS FOR EXACT QUANTITY AND LOCATIONS OF DEVICES.
- ALL FIRE ALARM SYSTEM WIRING SHALL BE INSTALLED IN EMT.
- CONTRACTOR SHALL SUBMIT SHOP DRAWINGS AND PLAN DRAWINGS TO AHJ FOR APPROVAL.
- ALL DEVICES SHALL BE COMPATIBLE WITH THE EXISTING FACP. VISUAL DEVICES SHALL HAVE SELECTABLE 15, 30, 75 AND 110CD RATINGS. ALL FIRE ALARM STROBES SHALL SYNCHRONIZE. PROVIDE SYNCHRONIZATION MODULES AS REQUIRED.
- TEST AND RE-CERTIFY SYSTEM PER NFPA 72. ALL WORK SHALL COMPLY WITH THE LOCAL FIRE ALARM CODES.
- CONTRACTOR SHALL UPDATE EXISTING FAC/EXPANDER CALCULATIONS FOR BATTERY AND LINE VOLTAGE DROPS.

2 FIRE ALARM PARTIAL RISER DIAGRAM - TENANT SPACE 151

SCALE: NO SCALE

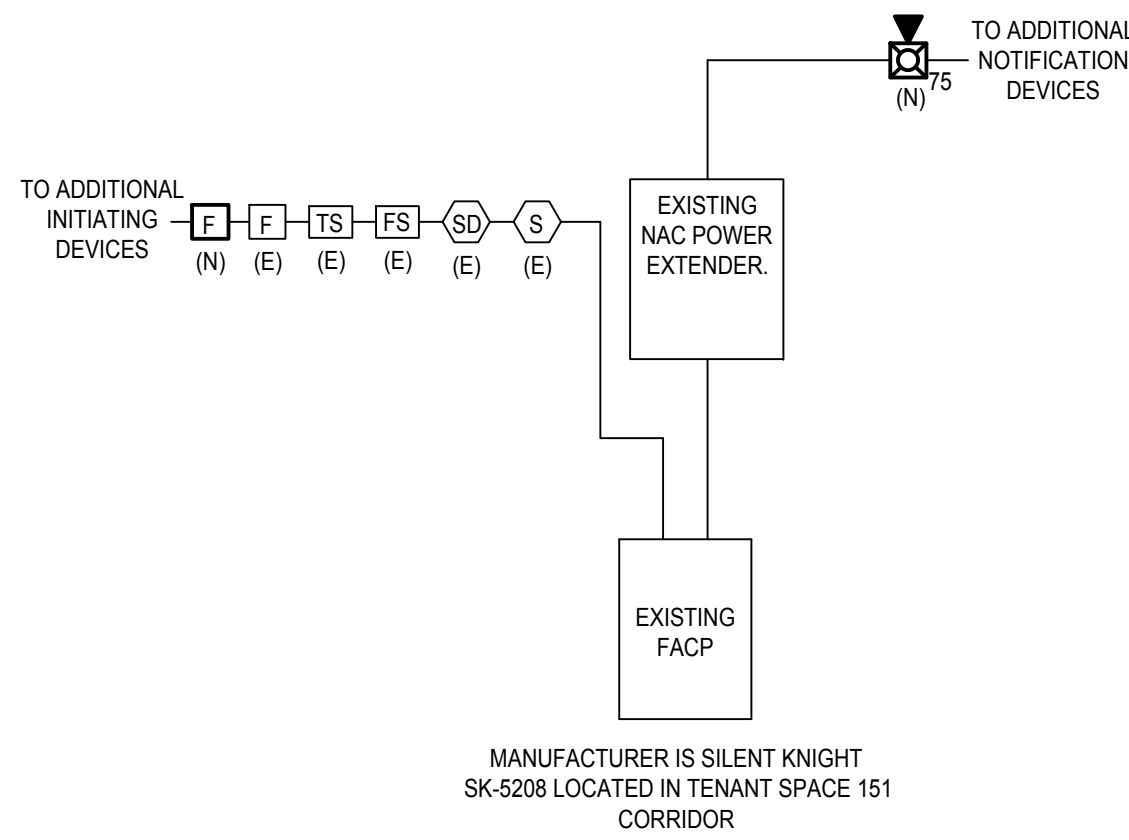

- PRIOR TO THE START OF ANY WORK THE CONTRACTOR SHALL PERFORM A TEST PER NFPA 72 AND VERIFY THE EXISTING FIRE ALARM SYSTEM IS IN GOOD WORKING CONDITION. THE RESULTS OF THIS TEST SHALL BE SUBMITTED TO THE OWNER, ARCHITECT, AND ENGINEER FOR RECORD. ANY REPAIRS REQUIRED TO MAKE THE FIRE ALARM SYSTEM OPERATIONAL SHALL BE PROVIDED TO THE OWNER UNDER A SEPARATE LINE ITEM PRICE FOR APPROVAL. COMMENCEMENT OF ANY REPAIR WORK WITHOUT AUTHORIZATION BY OWNER WILL BE DONE AT THE CONTRACTOR'S EXPENSE.
- THIS PROJECT INVOLVES THE INSTALLATION OF NEW FIRE ALARM DEVICES TO EXTEND THE SERVICE OF THE EXISTING BASE BUILDING FIRE ALARM SYSTEM TO PROTECT THE AREA OF WORK INDICATED. THE EXTENSION OF SYSTEM WILL EMPLOY THE FOLLOWING CIRCUIT PERFORMANCE IN ACCORDANCE OF NFPA 72: CLASS A FOR SIGNALING LINE CIRCUITS, INITIATING DEVICE CIRCUITS, AND NOTIFICATION APPLIANCE CIRCUITS. PROVIDE CLASS X FOR PANEL-TO-PANEL COMMUNICATIONS.
- NEW INITIATING DEVICES SHALL BE INSTALLED AND CONNECTED ON EXISTING INITIATING DEVICE CIRCUITS SERVED BY THE EXISTING FIRE ALARM CONTROL PANEL AS PER MANUFACTURERS REQUIREMENTS. THE CONTRACTOR SHALL PROVIDE ADDITIONAL NOTIFICATION CIRCUITS TO ACCOMMODATE THE ADA APPROVED AUDIBLE AND VISUAL SIGNALING DEVICES IN QUANTITIES AND TYPES AS INDICATED.
- ALL INTERCONNECTIONS TO THE EXISTING FIRE ALARM SYSTEM SHALL BE CONNECTED SO AS TO PROVIDE U.L. REQUIRED SUPERVISION OF ALL WIRING. ADDITIONALLY, SHOULD THE NEW EQUIPMENT BECOME INOPERATIVE FOR ANY REASON, THE EXISTING FIRE ALARM SYSTEM SHALL ENTER TROUBLE MODE.
- THE CONTRACTOR SHALL PROVIDE ALL DEVICES, WIRING, EXPANDER PANELS, ETC., AS REQUIRED FOR A COMPLETE, CODE COMPLIANT AND OPERATIONAL FIRE ALARM SYSTEM.
- THIS RISER DIAGRAM IS TYPICAL ONLY. REFER TO FLOOR PLANS FOR EXACT QUANTITY AND LOCATIONS OF DEVICES.
- ALL FIRE ALARM SYSTEM WIRING SHALL BE INSTALLED IN EMT.
- CONTRACTOR SHALL SUBMIT SHOP DRAWINGS AND PLAN DRAWINGS TO AHJ FOR APPROVAL.
- ALL DEVICES SHALL BE COMPATIBLE WITH THE EXISTING FACP. VISUAL DEVICES SHALL HAVE SELECTABLE 15, 30, 75 AND 110CD RATINGS. ALL FIRE ALARM STROBES SHALL SYNCHRONIZE. PROVIDE SYNCHRONIZATION MODULES AS REQUIRED.
- TEST AND RE-CERTIFY SYSTEM PER NFPA 72. ALL WORK SHALL COMPLY WITH THE LOCAL FIRE ALARM CODES.
- CONTRACTOR SHALL UPDATE EXISTING FAC/EXPANDER CALCULATIONS FOR BATTERY AND LINE VOLTAGE DROPS.

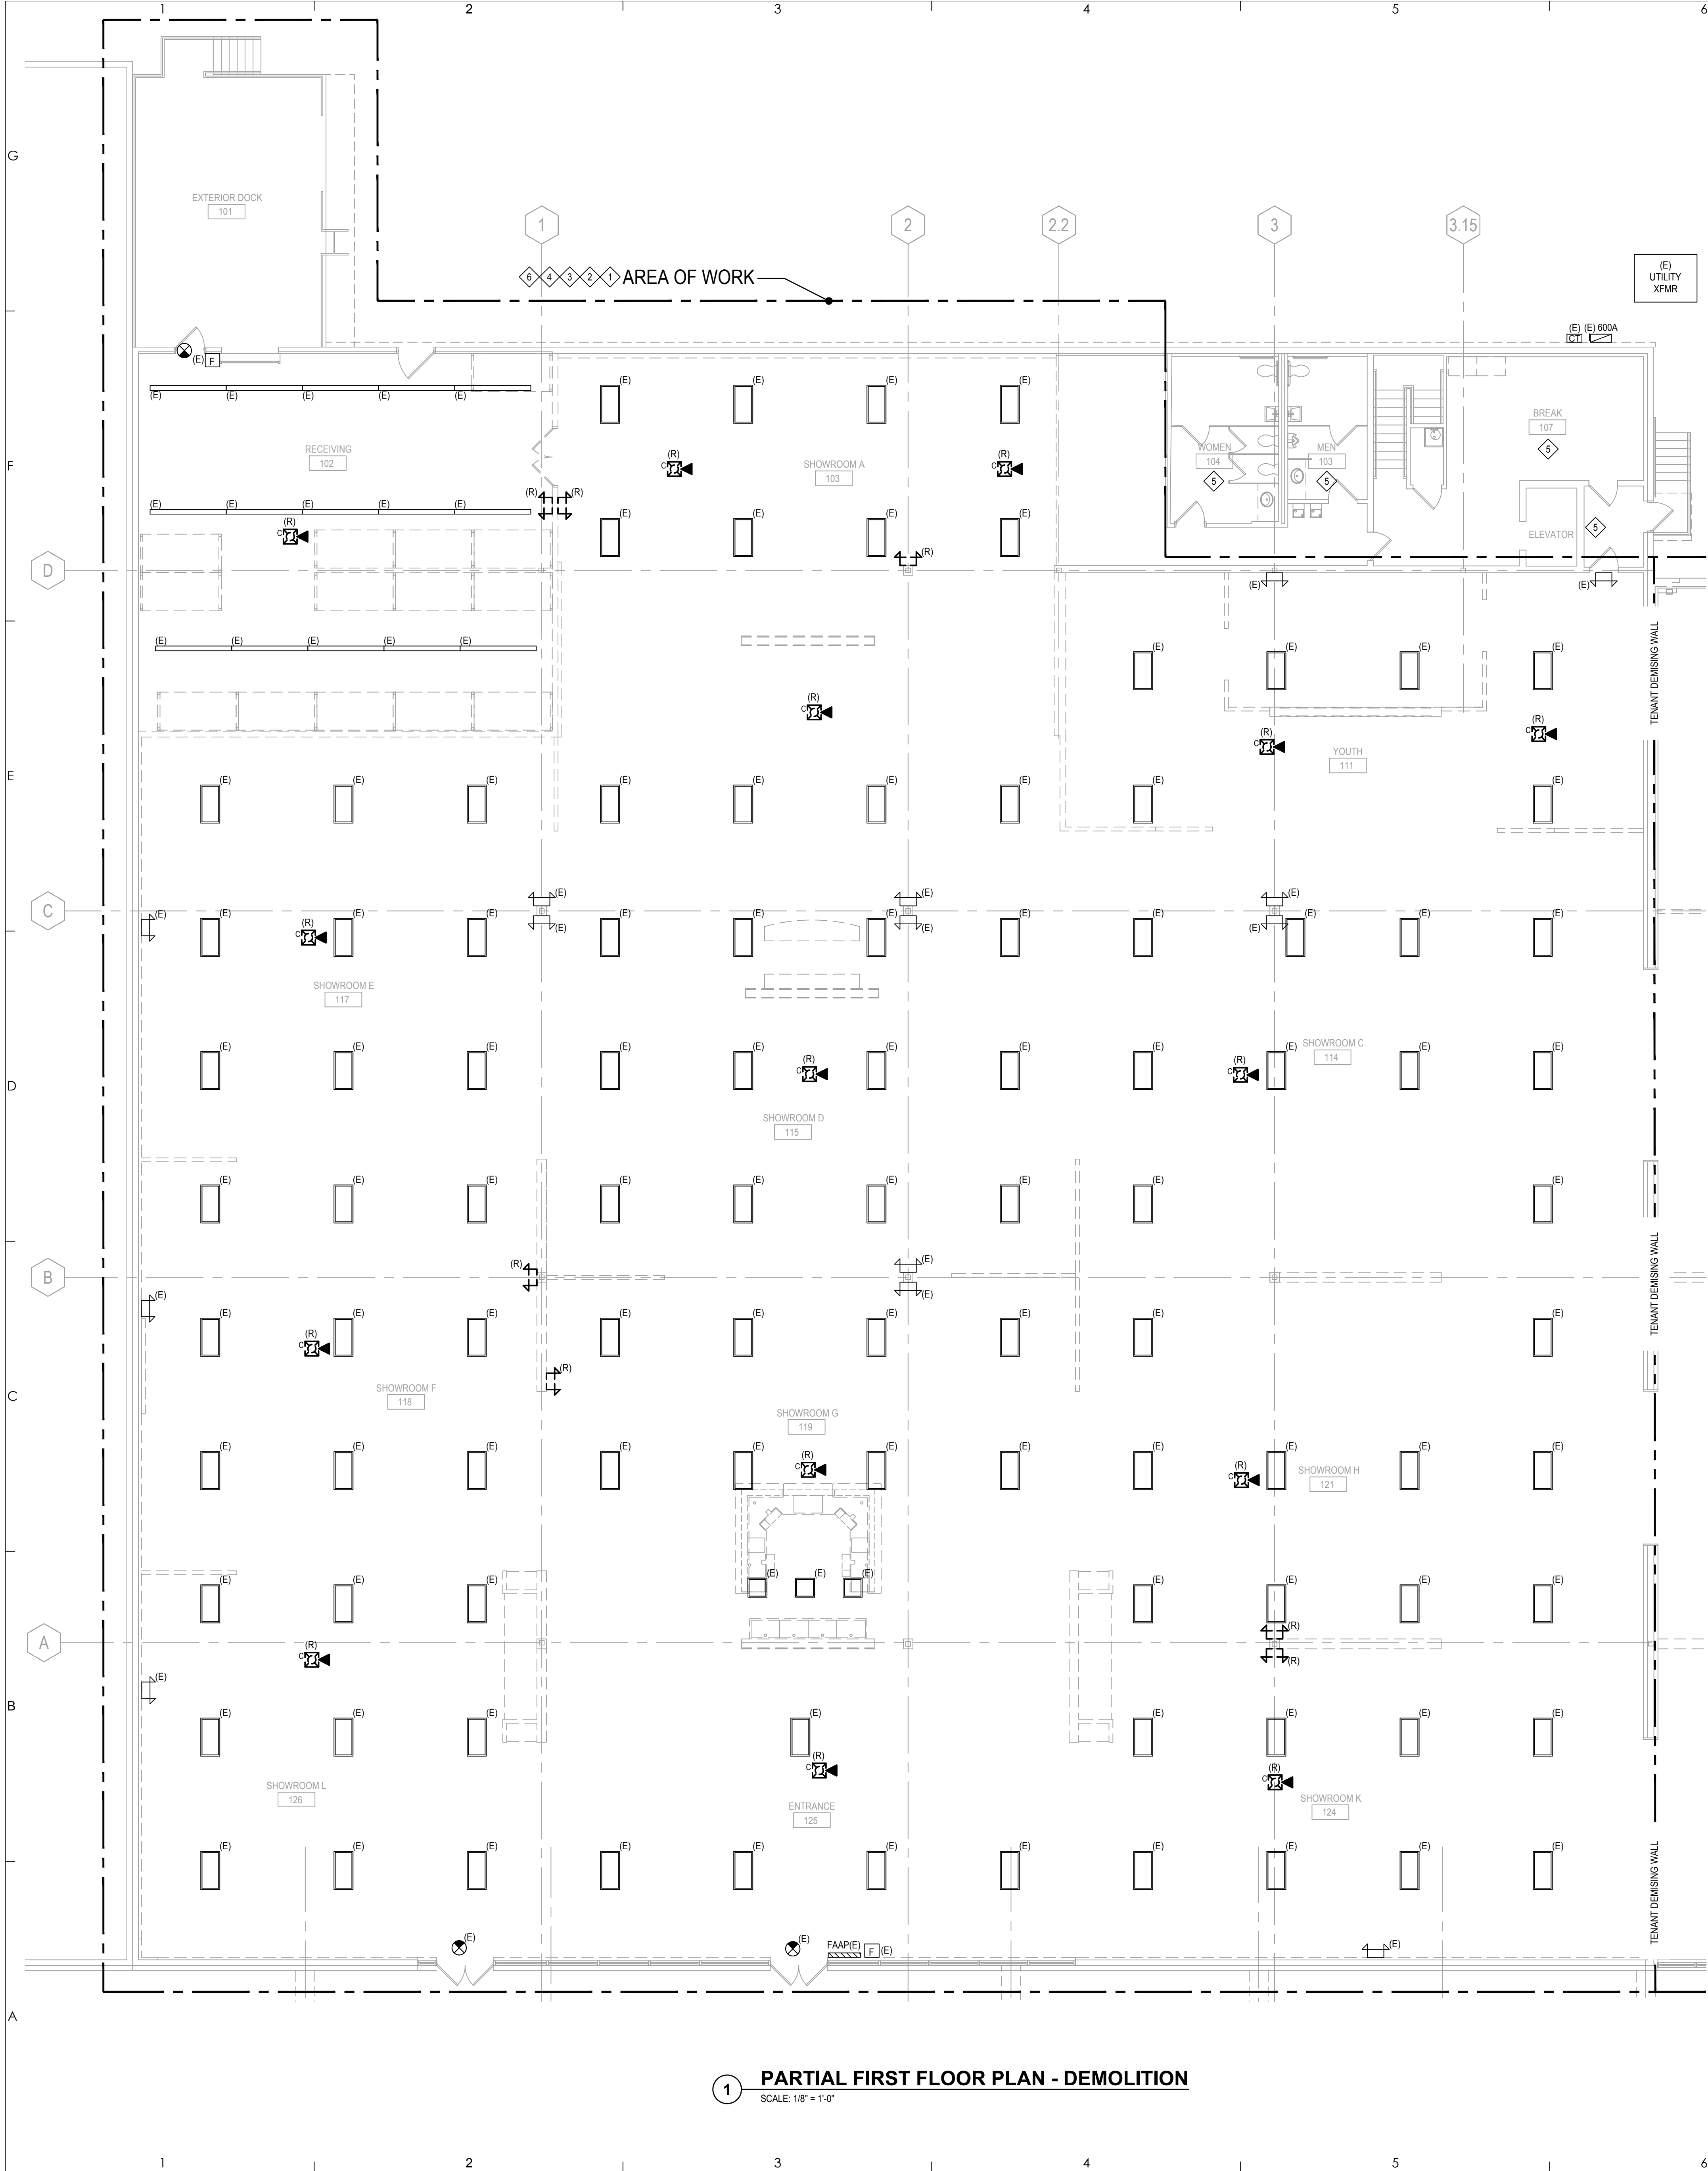


1 PARTIAL FIRST FLOOR PLAN - DEMOLITION
SCALE: 1/8" = 1'-0"

GENERAL NOTES


- EXISTING CONDITIONS SHOWN ON THIS DRAWING HAVE BEEN OBTAINED FROM RECORD DRAWINGS WHEN AVAILABLE AND GENERAL FIELD SURVEY AND MAY NOT INDICATE ACTUAL EXISTING CONDITIONS IN DETAIL AND DIMENSION. THE CONTRACTOR IS RESPONSIBLE FOR VERIFYING EXACT EXISTING CONDITIONS PRIOR TO THE FABRICATION OR ORDER OF EQUIPMENT OR PERFORMANCE OF ANY WORK. THE CONTRACTOR SHALL NOTIFY THE ARCHITECT OR ENGINEER IN WRITING IF EXISTING CONDITIONS ARE DISCOVERED THAT PREVENT THE EXECUTION OF WORK. THE CONTRACTOR SHALL NOT PROCEED WITH WORK UNTIL DIRECTION IS PROVIDED.
- ELECTRICAL DRAWINGS ARE DIAGRAMMATIC AND SHOW INTENT OF DEMOLITION WORK TO BE DONE. THE CONTRACTOR SHALL PROVIDE ALL MATERIALS, EQUIPMENT AND LABOR REQUIRED FOR A COMPLETE DEMOLITION.
- UNLESS SPECIFICALLY INDICATED OTHERWISE, REMOVE ALL EXISTING ELECTRICAL EQUIPMENT, LIGHTING FIXTURES, DEVICES, FEEDERS AND BRANCH CIRCUITRY WHERE EQUIPMENT IS INDICATED TO BE REMOVED. REMOVE WIRING AND CONDUIT/CABLE BACK TO NEXT REMAINING ACTIVE OUTLET OR BACK TO SOURCE.
- ANY SHUTDOWN OF POWER SERVICES SHALL BE COMPLETED AT TIMES OUTSIDE OF NORMAL WORKING HOURS AS APPROVED BY THE OWNER. PROVIDE A MINIMUM OF 15 BUSINESS DAYS ADVANCED NOTICE PRIOR TO ANY SHUTDOWN.
- EXISTING EQUIPMENT INDICATED TO REMAIN ARE TO REMAIN ACTIVE THROUGHOUT CONSTRUCTION. PROVIDE TEMPORARY FEEDERS IF REQUIRED TO MAINTAIN SERVICE.
- PROVIDE TEMPORARY SERVICE AS DIRECTED FOR LIGHTING AND POWER EQUIPMENT (DRILLS, SAWS, ETC.). VERIFY TEMPORARY REQUIREMENTS WITH GENERAL CONTRACTOR. TEMPORARY LIGHTING AND POWER SHALL MEET OSHA REQUIREMENTS AND LOCAL CODES.
- LOCATE, IDENTIFY AND PROTECT ELECTRICAL SERVICES PASSING THROUGH DEMOLITION AREA AND SERVING OTHER AREAS OUTSIDE DEMOLITION LIMITS. MAINTAIN SERVICES TO AREAS OUTSIDE DEMOLITION LIMITS. WHEN SERVICES MUST BE INTERRUPTED, INSTALL TEMPORARY SERVICES FOR AFFECTED AREAS.
- ADVANCE NOTICE SHALL BE GIVEN TO OWNER BEFORE COMMENCEMENT OF WORK ON ANY ELECTRICAL CIRCUITRY, WHETHER OR NOT AN OUTAGE IS REQUIRED.
- PROTECT ADJACENT MATERIALS INDICATED TO REMAIN. INSTALL AND MAINTAIN DUST AND NOISE BARRIERS TO KEEP DIRT, DUST AND NOISE FROM BEING TRANSMITTED TO ADJACENT AREAS. REMOVE PROTECTION AND BARRIERS AFTER DEMOLITION OPERATIONS ARE COMPLETE.
- REMOVE ALL DATA/COMMUNICATIONS AND CATV WIRING AND DEVICES WHERE INDICATED.
- REMOVE ALL ELECTRICAL DEVICES, WIRING, AND CONDUIT FEEDING HVAC EQUIPMENT INDICATED TO BE REMOVED BACK TO SOURCE.
- EXISTING LIGHT FIXTURES TO BE REUSED AND RELOCATED SHALL BE CLEANED, RE-LAMPED, AND REPAIRED AS NECESSARY.

PLAN NOTES

- DISCONNECT AND REMOVE ALL RECEPTACLES WITHIN THE AREA OF WORK. REMOVE CONDUIT AND CONDUCTORS BACK TO SOURCE.
- DISCONNECT AND REMOVE THE FOLLOWING EXISTING LIGHTING FIXTURES WITHIN THE AREA OF WORK. REMOVE CONDUIT AND CONDUCTORS BACK TO SOURCE OR NEXT ACTIVE FIXTURE/DEVICE:
 - DRYWALL CANTILEVER LIGHTING FIXTURES IN SHOWROOMS
 - TRACK LIGHTING
 - SPECIALTY LIGHTING FIXTURES
 - LIGHTING CONTROLS ON WALLS TO BE DEMOLISHED
- DISCONNECT AND SALVAGE EXISTING FIRE ALARM AUDIOVISUAL DEVICES WITHIN AREA OF WORK. SALVAGE CONDUIT AND CONDUCTORS FOR RECONNECTION UNDER NEW WORK.
- LIGHTING FIXTURES AND CONTROLS NOTED EXISTING SHALL REMAIN.
- ROOM IS NOT IN SCOPE. EXISTING POWER, LIGHTING, COMMUNICATIONS, AND FIRE ALARM EQUIPMENT AND DEVICES SHALL BE MAINTAINED.
- DISCONNECT AND SALVAGE EMERGENCY WALL PACKS ON WALLS TO BE DEMOLISHED. SALVAGE CONDUIT AND CONDUCTORS FOR RECONNECTION UNDER NEW WORK.

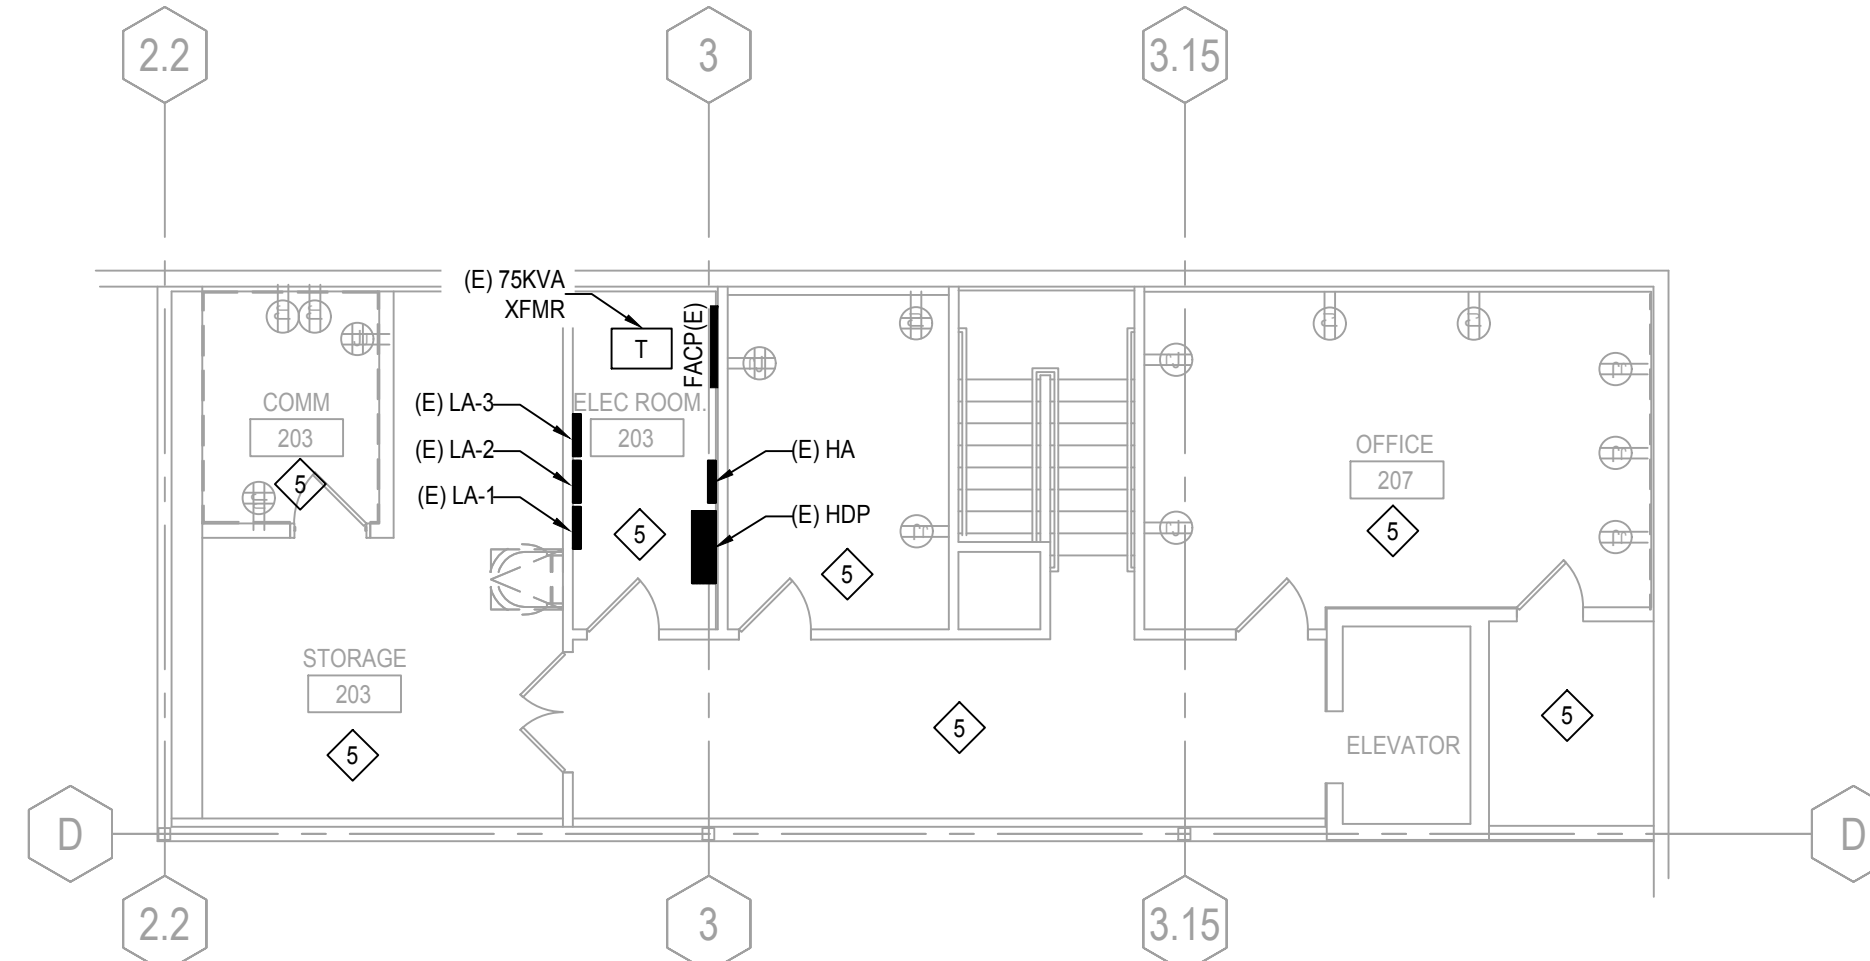

2 PARTIAL SECOND FLOOR PLAN - EXISTING - POWER
SCALE: 1/8" = 1'-0"



8 4 0 8 16
SCALE: 1/8" = 1'-0"
9




JP2 ARCHITECTS
2811 Dillon Street
Baltimore, MD 21224
t 410.646.8300
www.JP2architects.com

CONSULTANTS

Mechanical, Electrical, Plumbing, Fire Protection:
CFR Engineering
20251 Century Blvd.
Germantown, MD 20874
t 877.871.4229
w www.cfrengineering.com

SEAL / SIGNATURE

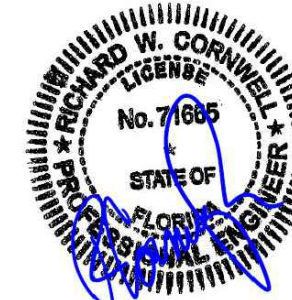

PROFESSIONAL CERTIFICATION: I HEREBY CERTIFY THAT THESE DOCUMENTS WERE PREPARED OR APPROVED BY ME AND THAT I AM A DULY LICENSED PROFESSIONAL ARCHITECT UNDER THE LAWS OF THE STATE OF MARYLAND. LICENSE NO. 7188 EXPIRATION DATE 03/2027

PROJECT

GATEWAY PLAZA
TENANT 121
121 TOWNE CENTER BLVD
SANFORD, FL 32771

CONSTRUCTION DOCUMENTS

CLIENT / OWNER

GG REIF I Gateway LLC
3904 Boston St.
Baltimore, MD 21224
t 410.559.2500
f 410.518.2032
www.ggcommercial.com

REVISION DRAWING LOG

No.	Date	Title

PROJECT NUMBER:

25-137

COPYRIGHT © 2025 JP2 ARCHITECTS


DRAWING TITLE

PARTIAL FLOOR PLAN -
DEMOLITION - ELECTRICAL

DRAWING NUMBER

ED101

Issue Date 01/07/2026

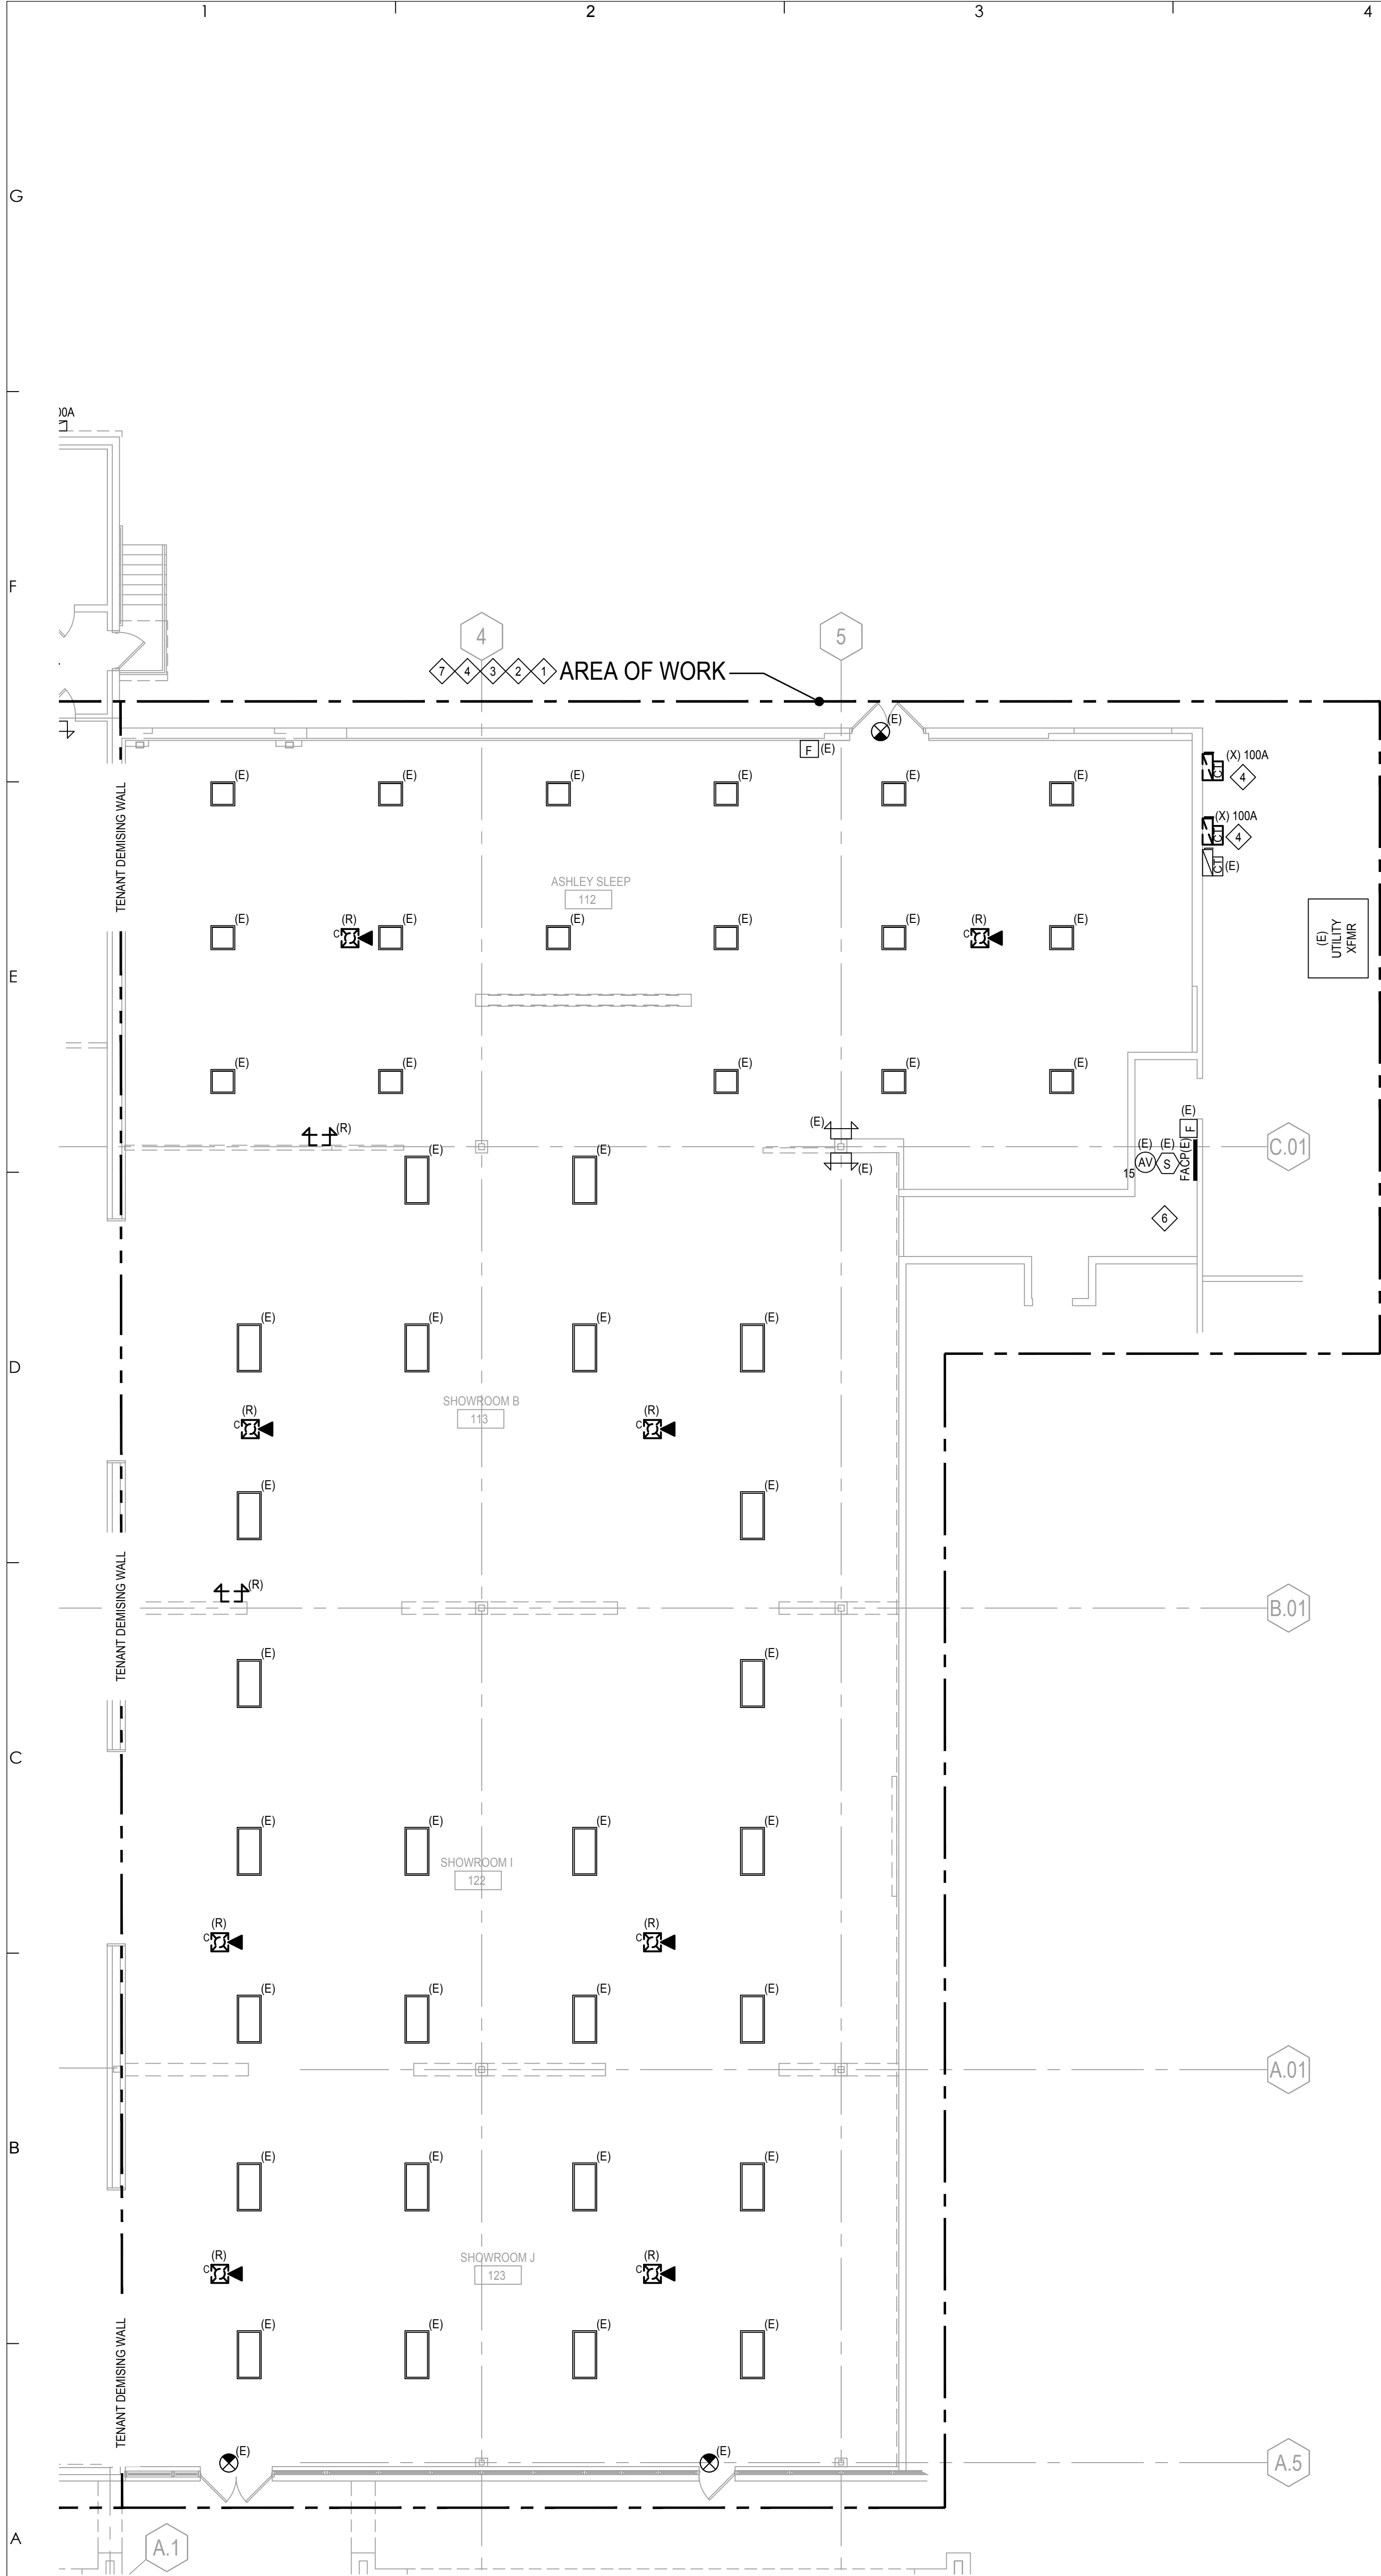

1 PARTIAL FIRST FLOOR PLAN - DEMOLITION
SCALE: 1/8" = 1'-0"

GENERAL NOTES

- EXISTING CONDITIONS SHOWN ON THIS DRAWING HAVE BEEN OBTAINED FROM RECORD DRAWINGS WHEN AVAILABLE AND GENERAL FIELD SURVEY AND MAY NOT INDICATE ACTUAL EXISTING CONDITIONS IN DETAIL AND DIMENSION. THE CONTRACTOR IS RESPONSIBLE FOR VERIFYING EXACT EXISTING CONDITIONS PRIOR TO THE FABRICATION OR ORDER OF EQUIPMENT OR PERFORMANCE OF ANY WORK. THE CONTRACTOR SHALL NOTIFY THE ARCHITECT OR ENGINEER IN WRITING IF EXISTING CONDITIONS ARE DISCOVERED THAT PREVENT THE EXECUTION OF WORK. THE CONTRACTOR SHALL NOT PROCEED WITH WORK UNTIL DIRECTION IS PROVIDED.
- ELECTRICAL DRAWINGS ARE DIAGRAMMATIC AND SHOW INTENT OF DEMOLITION WORK TO BE DONE. THE CONTRACTOR SHALL PROVIDE ALL MATERIALS, EQUIPMENT AND LABOR REQUIRED FOR A COMPLETE DEMOLITION.
- UNLESS SPECIFICALLY INDICATED OTHERWISE, REMOVE ALL EXISTING ELECTRICAL EQUIPMENT, LIGHTING FIXTURES, DEVICES, FEEDERS AND BRANCH CIRCUITRY WHERE EQUIPMENT IS INDICATED TO BE REMOVED. REMOVE WIRING AND CONDUIT/CABLE BACK TO NEXT REMAINING ACTIVE OUTLET OR BACK TO SOURCE.
- ANY SHUTDOWN OF POWER SERVICES SHALL BE COMPLETED AT TIMES OUTSIDE OF NORMAL WORKING HOURS AS APPROVED BY THE OWNER. PROVIDE A MINIMUM OF 15 BUSINESS DAYS ADVANCED NOTICE PRIOR TO ANY SHUTDOWN.
- EXISTING EQUIPMENT INDICATED TO REMAIN ARE TO REMAIN ACTIVE THROUGHOUT CONSTRUCTION. PROVIDE TEMPORARY FEEDERS IF REQUIRED TO MAINTAIN SERVICE.
- PROVIDE TEMPORARY SERVICE AS DIRECTED FOR LIGHTING AND POWER EQUIPMENT (DRILLS, SAWS, ETC.). VERIFY TEMPORARY REQUIREMENTS WITH GENERAL CONTRACTOR. TEMPORARY LIGHTING AND POWER SHALL MEET OSHA REQUIREMENTS AND LOCAL CODES.
- LOCATE, IDENTIFY AND PROTECT ELECTRICAL SERVICES PASSING THROUGH DEMOLITION AREA AND SERVING OTHER AREAS OUTSIDE DEMOLITION LIMITS. MAINTAIN SERVICES TO AREAS OUTSIDE DEMOLITION LIMITS. WHEN SERVICES MUST BE INTERRUPTED, INSTALL TEMPORARY SERVICES FOR AFFECTED AREAS.
- ADVANCE NOTICE SHALL BE GIVEN TO OWNER BEFORE COMMENCEMENT OF WORK ON ANY ELECTRICAL CIRCUITRY, WHETHER OR NOT AN OUTAGE IS REQUIRED.
- PROTECT ADJACENT MATERIALS INDICATED TO REMAIN. INSTALL AND MAINTAIN DUST AND NOISE BARRIERS TO KEEP DIRT, DUST AND NOISE FROM BEING TRANSMITTED TO ADJACENT AREAS. REMOVE PROTECTION AND BARRIERS AFTER DEMOLITION OPERATIONS ARE COMPLETE.
- REMOVE ALL DATA/COMMUNICATIONS AND CATV WIRING AND DEVICES WHERE INDICATED.
- REMOVE ALL ELECTRICAL DEVICES, WIRING, AND CONDUIT FEEDING HVAC EQUIPMENT INDICATED TO BE REMOVED BACK TO SOURCE.
- EXISTING LIGHT FIXTURES TO BE REUSED AND RELOCATED SHALL BE CLEANED, RE-LAMPED, AND REPAIRED AS NECESSARY.

PLAN NOTES

- DISCONNECT AND REMOVE ALL RECEPTACLES AND DATA DROPS WITHIN THE AREA OF WORK. REMOVE CONDUIT AND CONDUCTORS BACK TO SOURCE.
- DISCONNECT AND REMOVE THE FOLLOWING EXISTING LIGHTING FIXTURES WITHIN THE AREA OF WORK. REMOVE CONDUIT AND CONDUCTORS BACK TO SOURCE OR NEXT ACTIVE FIXTURE/DEVICE:
 - 2.a. DRYWALL CANTILEVER LIGHTING FIXTURES IN SHOWROOMS
 - 2.b. TRACK LIGHTING
 - 2.c. SPECIALTY LIGHTING FIXTURES
 - 2.d. LIGHTING CONTROLS ON WALLS TO BE DEMOLISHED
- DISCONNECT AND REMOVE EXISTING FIRE ALARM AUDIOVISUAL DEVICES WITHIN AREA OF WORK. SALVAGE CONDUIT AND CONDUCTORS FOR RECONNECTION UNDER NEW WORK.
- DISCONNECT AND RECONFIGURE CIRCUITRY TO EXISTING 2X2 AND 2X4 HIGH-BAY LIGHTING FIXTURES AS REQUIRED TO SUPPORT NEW WORK IN TENANT SHELL SPACE. LIGHTING FIXTURES SHALL BE RE-CIRCUITED TO NEW 480/277V PANEL AND SWITCHES UNDER NEW WORK.
- DISCONNECT AND REMOVE EXISTING SERVICE DISCONNECT AND CT/METER CABINET ABOVE SERVICE TROUGH. REMOVE CONDUIT AND CONDUCTORS BACK TO SOURCE.
- ROOM IS NOT IN SCOPE. EXISTING POWER, LIGHTING, COMMUNICATIONS, AND FIRE ALARM EQUIPMENT AND DEVICES SHALL BE MAINTAINED.
- DISCONNECT AND SALVAGE EMERGENCY WALL PACKS ON WALLS TO BE DEMOLISHED. SALVAGE CONDUIT AND CONDUCTORS FOR RECONNECTION UNDER NEW WORK.



JP2 ARCHITECTS
2811 Dillon Street
Baltimore, MD 21224
t 410.646.8300
www.JP2architects.com

CONSULTANTS
Mechanical, Electrical, Plumbing, Fire Protection:
CFR Engineering
20251 Century Blvd.
Cermantown, MD 20874
t 877.871.4229
w www.cfrengineering.com

SEAL / SIGNATURE

PROFESSIONAL CERTIFICATION: I HEREBY CERTIFY THAT THESE DOCUMENTS WERE PREPARED OR APPROVED BY ME AND THAT I AM A DULY LICENSED PROFESSIONAL ARCHITECT UNDER THE LAWS OF THE STATE OF MARYLAND. LICENSE NO. 71686 EXPIRATION DATE 07/2025
PROJECT

GATEWAY PLAZA
TENANT 121
121 TOWNE CENTER BLVD
SANFORD, FL 32771

CONSTRUCTION DOCUMENTS

CLIENT / OWNER
GG REIF | Gateway LLC
3904 Boston St.
Baltimore, MD 21224
t 410.559.2500
f 410.518.2032
www.ggcommercial.com

REVISION DRAWING LOG

No.	Date	Title


PROJECT NUMBER: 25-137
COPYRIGHT © 2025 JP2 ARCHITECTS

DRAWING TITLE

PARTIAL FLOOR PLAN -
DEMOLITION - ELECTRICAL


DRAWING NUMBER

ED102
Issue Date 01/07/2026

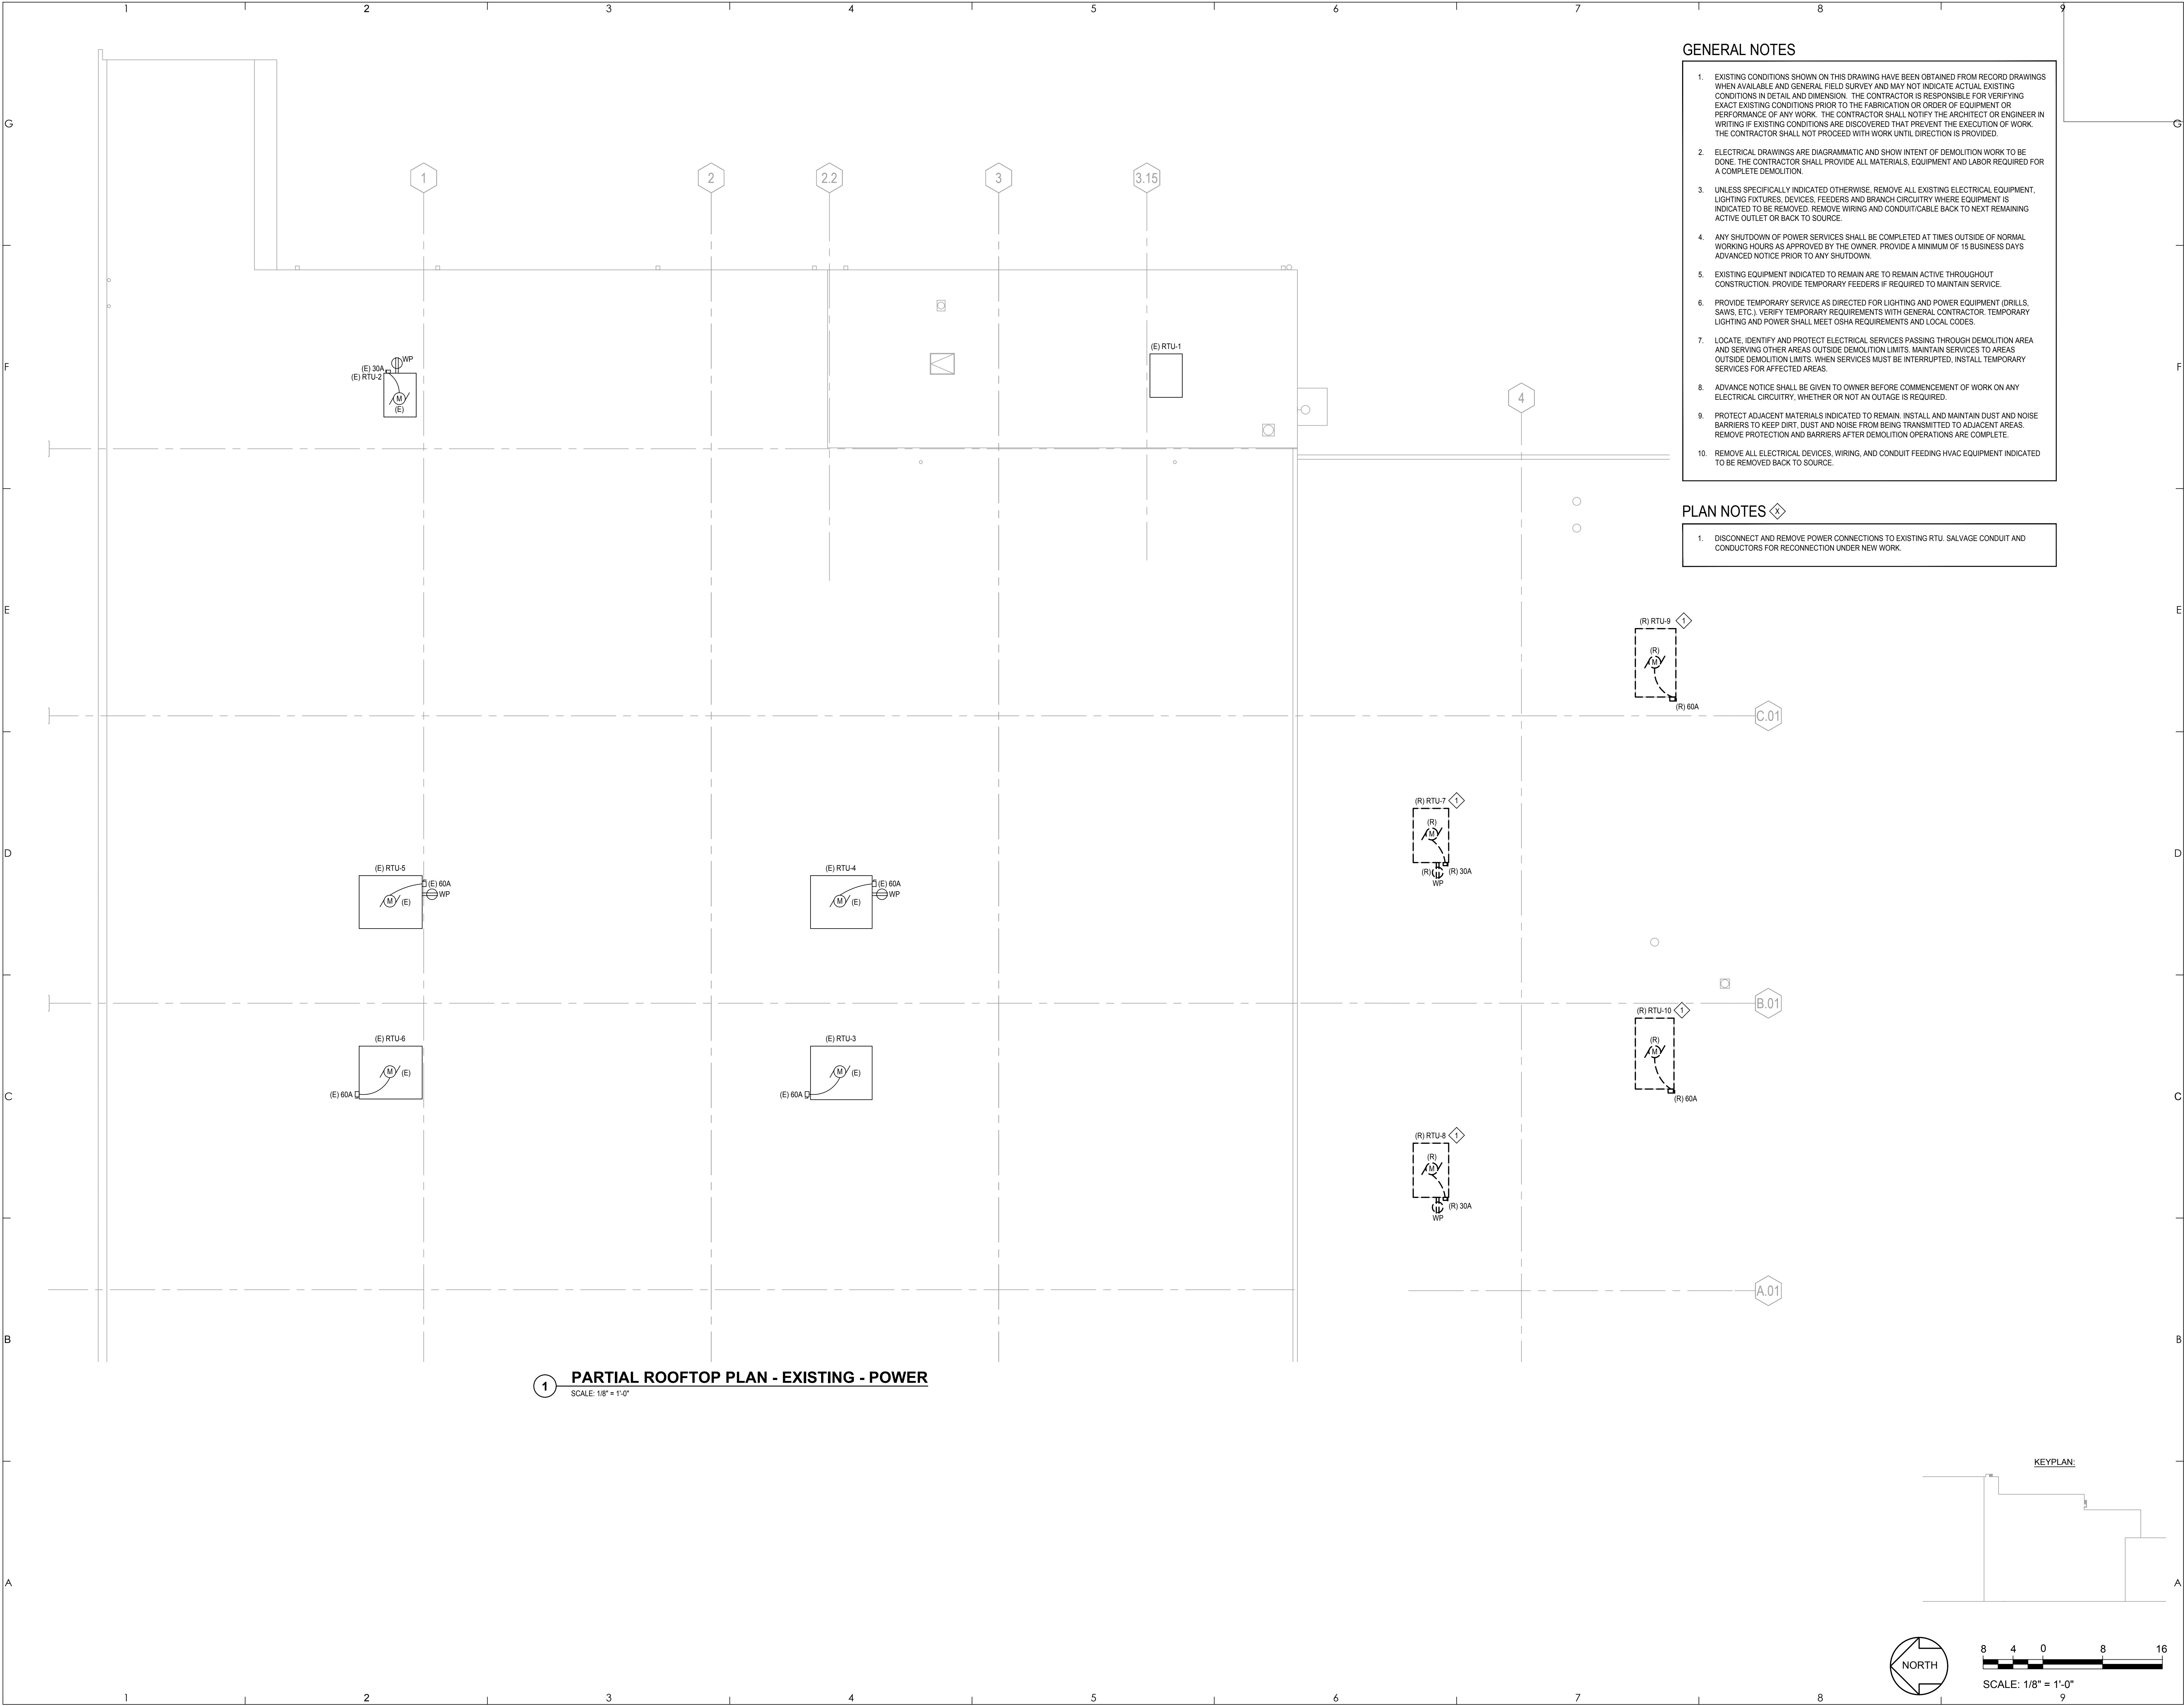

- GENERAL NOTES**
- EXISTING CONDITIONS SHOWN ON THIS DRAWING HAVE BEEN OBTAINED FROM RECORD DRAWINGS WHEN AVAILABLE AND GENERAL FIELD SURVEY AND MAY NOT INDICATE ACTUAL EXISTING CONDITIONS IN DETAIL AND DIMENSION. THE CONTRACTOR IS RESPONSIBLE FOR VERIFYING EXACT EXISTING CONDITIONS PRIOR TO THE FABRICATION OR ORDER OF EQUIPMENT OR PERFORMANCE OF ANY WORK. THE CONTRACTOR SHALL NOTIFY THE ARCHITECT OR ENGINEER IN WRITING IF EXISTING CONDITIONS ARE DISCOVERED THAT PREVENT THE EXECUTION OF WORK. THE CONTRACTOR SHALL NOT PROCEED WITH WORK UNTIL DIRECTION IS PROVIDED.
 - ELECTRICAL DRAWINGS ARE DIAGRAMMATIC AND SHOW INTENT OF DEMOLITION WORK TO BE DONE. THE CONTRACTOR SHALL PROVIDE ALL MATERIALS, EQUIPMENT AND LABOR REQUIRED FOR A COMPLETE DEMOLITION.
 - UNLESS SPECIFICALLY INDICATED OTHERWISE, REMOVE ALL EXISTING ELECTRICAL EQUIPMENT, LIGHTING FIXTURES, DEVICES, FEEDERS AND BRANCH CIRCUITRY WHERE EQUIPMENT IS INDICATED TO BE REMOVED. REMOVE WIRING AND CONDUIT/CABLE BACK TO NEXT REMAINING ACTIVE OUTLET OR BACK TO SOURCE.
 - ANY SHUTDOWN OF POWER SERVICES SHALL BE COMPLETED AT TIMES OUTSIDE OF NORMAL WORKING HOURS AS APPROVED BY THE OWNER. PROVIDE A MINIMUM OF 15 BUSINESS DAYS ADVANCED NOTICE PRIOR TO ANY SHUTDOWN.
 - EXISTING EQUIPMENT INDICATED TO REMAIN ARE TO REMAIN ACTIVE THROUGHOUT CONSTRUCTION. PROVIDE TEMPORARY FEEDERS IF REQUIRED TO MAINTAIN SERVICE.
 - PROVIDE TEMPORARY SERVICE AS DIRECTED FOR LIGHTING AND POWER EQUIPMENT (DRILLS, SAWS, ETC.). VERIFY TEMPORARY REQUIREMENTS WITH GENERAL CONTRACTOR. TEMPORARY LIGHTING AND POWER SHALL MEET OSHA REQUIREMENTS AND LOCAL CODES.
 - LOCATE, IDENTIFY AND PROTECT ELECTRICAL SERVICES PASSING THROUGH DEMOLITION AREA AND SERVING OTHER AREAS OUTSIDE DEMOLITION LIMITS. MAINTAIN SERVICES TO AREAS OUTSIDE DEMOLITION LIMITS. WHEN SERVICES MUST BE INTERRUPTED, INSTALL TEMPORARY SERVICES FOR AFFECTED AREAS.
 - ADVANCE NOTICE SHALL BE GIVEN TO OWNER BEFORE COMMENCEMENT OF WORK ON ANY ELECTRICAL CIRCUITRY, WHETHER OR NOT AN OUTAGE IS REQUIRED.
 - PROTECT ADJACENT MATERIALS INDICATED TO REMAIN. INSTALL AND MAINTAIN DUST AND NOISE BARRIERS TO KEEP DIRT, DUST AND NOISE FROM BEING TRANSMITTED TO ADJACENT AREAS. REMOVE PROTECTION AND BARRIERS AFTER DEMOLITION OPERATIONS ARE COMPLETE.
 - REMOVE ALL ELECTRICAL DEVICES, WIRING, AND CONDUIT FEEDING HVAC EQUIPMENT INDICATED TO BE REMOVED BACK TO SOURCE.

- PLAN NOTES**
- DISCONNECT AND REMOVE POWER CONNECTIONS TO EXISTING RTU. SALVAGE CONDUIT AND CONDUCTORS FOR RECONNECTION UNDER NEW WORK.



JP2 ARCHITECTS
2811 Dillon Street
Baltimore, MD 21224
t 410.646.8300
www.JP2architects.com

CONSULTANTS
Mechanical, Electrical, Plumbing, Fire Protection:
CFR Engineering
20251 Century Blvd.
Germantown, MD 20874
t 877.871.4229
www.cfrengineering.com

SEAL / SIGNATURE

PROFESSIONAL CERTIFICATION: I HEREBY CERTIFY THAT THESE DOCUMENTS WERE PREPARED OR APPROVED BY ME, AND THAT I AM A duly LICENSED PROFESSIONAL ARCHITECT UNDER THE LAWS OF THE STATE OF MARYLAND. LICENSE NO. 1386, EXPIRATION DATE 08/01/2025

PROJECT

GATEWAY PLAZA
TENANT 121
121 TOWNE CENTER BLVD
SANFORD, FL 32771

CONSTRUCTION
DOCUMENTS

CLIENT / OWNER
GG REIF I Gateway LLC
3904 Boston St.
Baltimore, MD 21224
t 410.559.2500
f 410.518.2032
www.ggcommercial.com

REVISION DRAWING LOG		
No.	Date	Title


PROJECT NUMBER: 25-137
COPYRIGHT © 2025 JP2 ARCHITECTS

DRAWING TITLE

PARTIAL ROOFTOP PLAN
- DEMOLITION - POWER

DRAWING NUMBER

ED103
Issue Date 01/07/2026

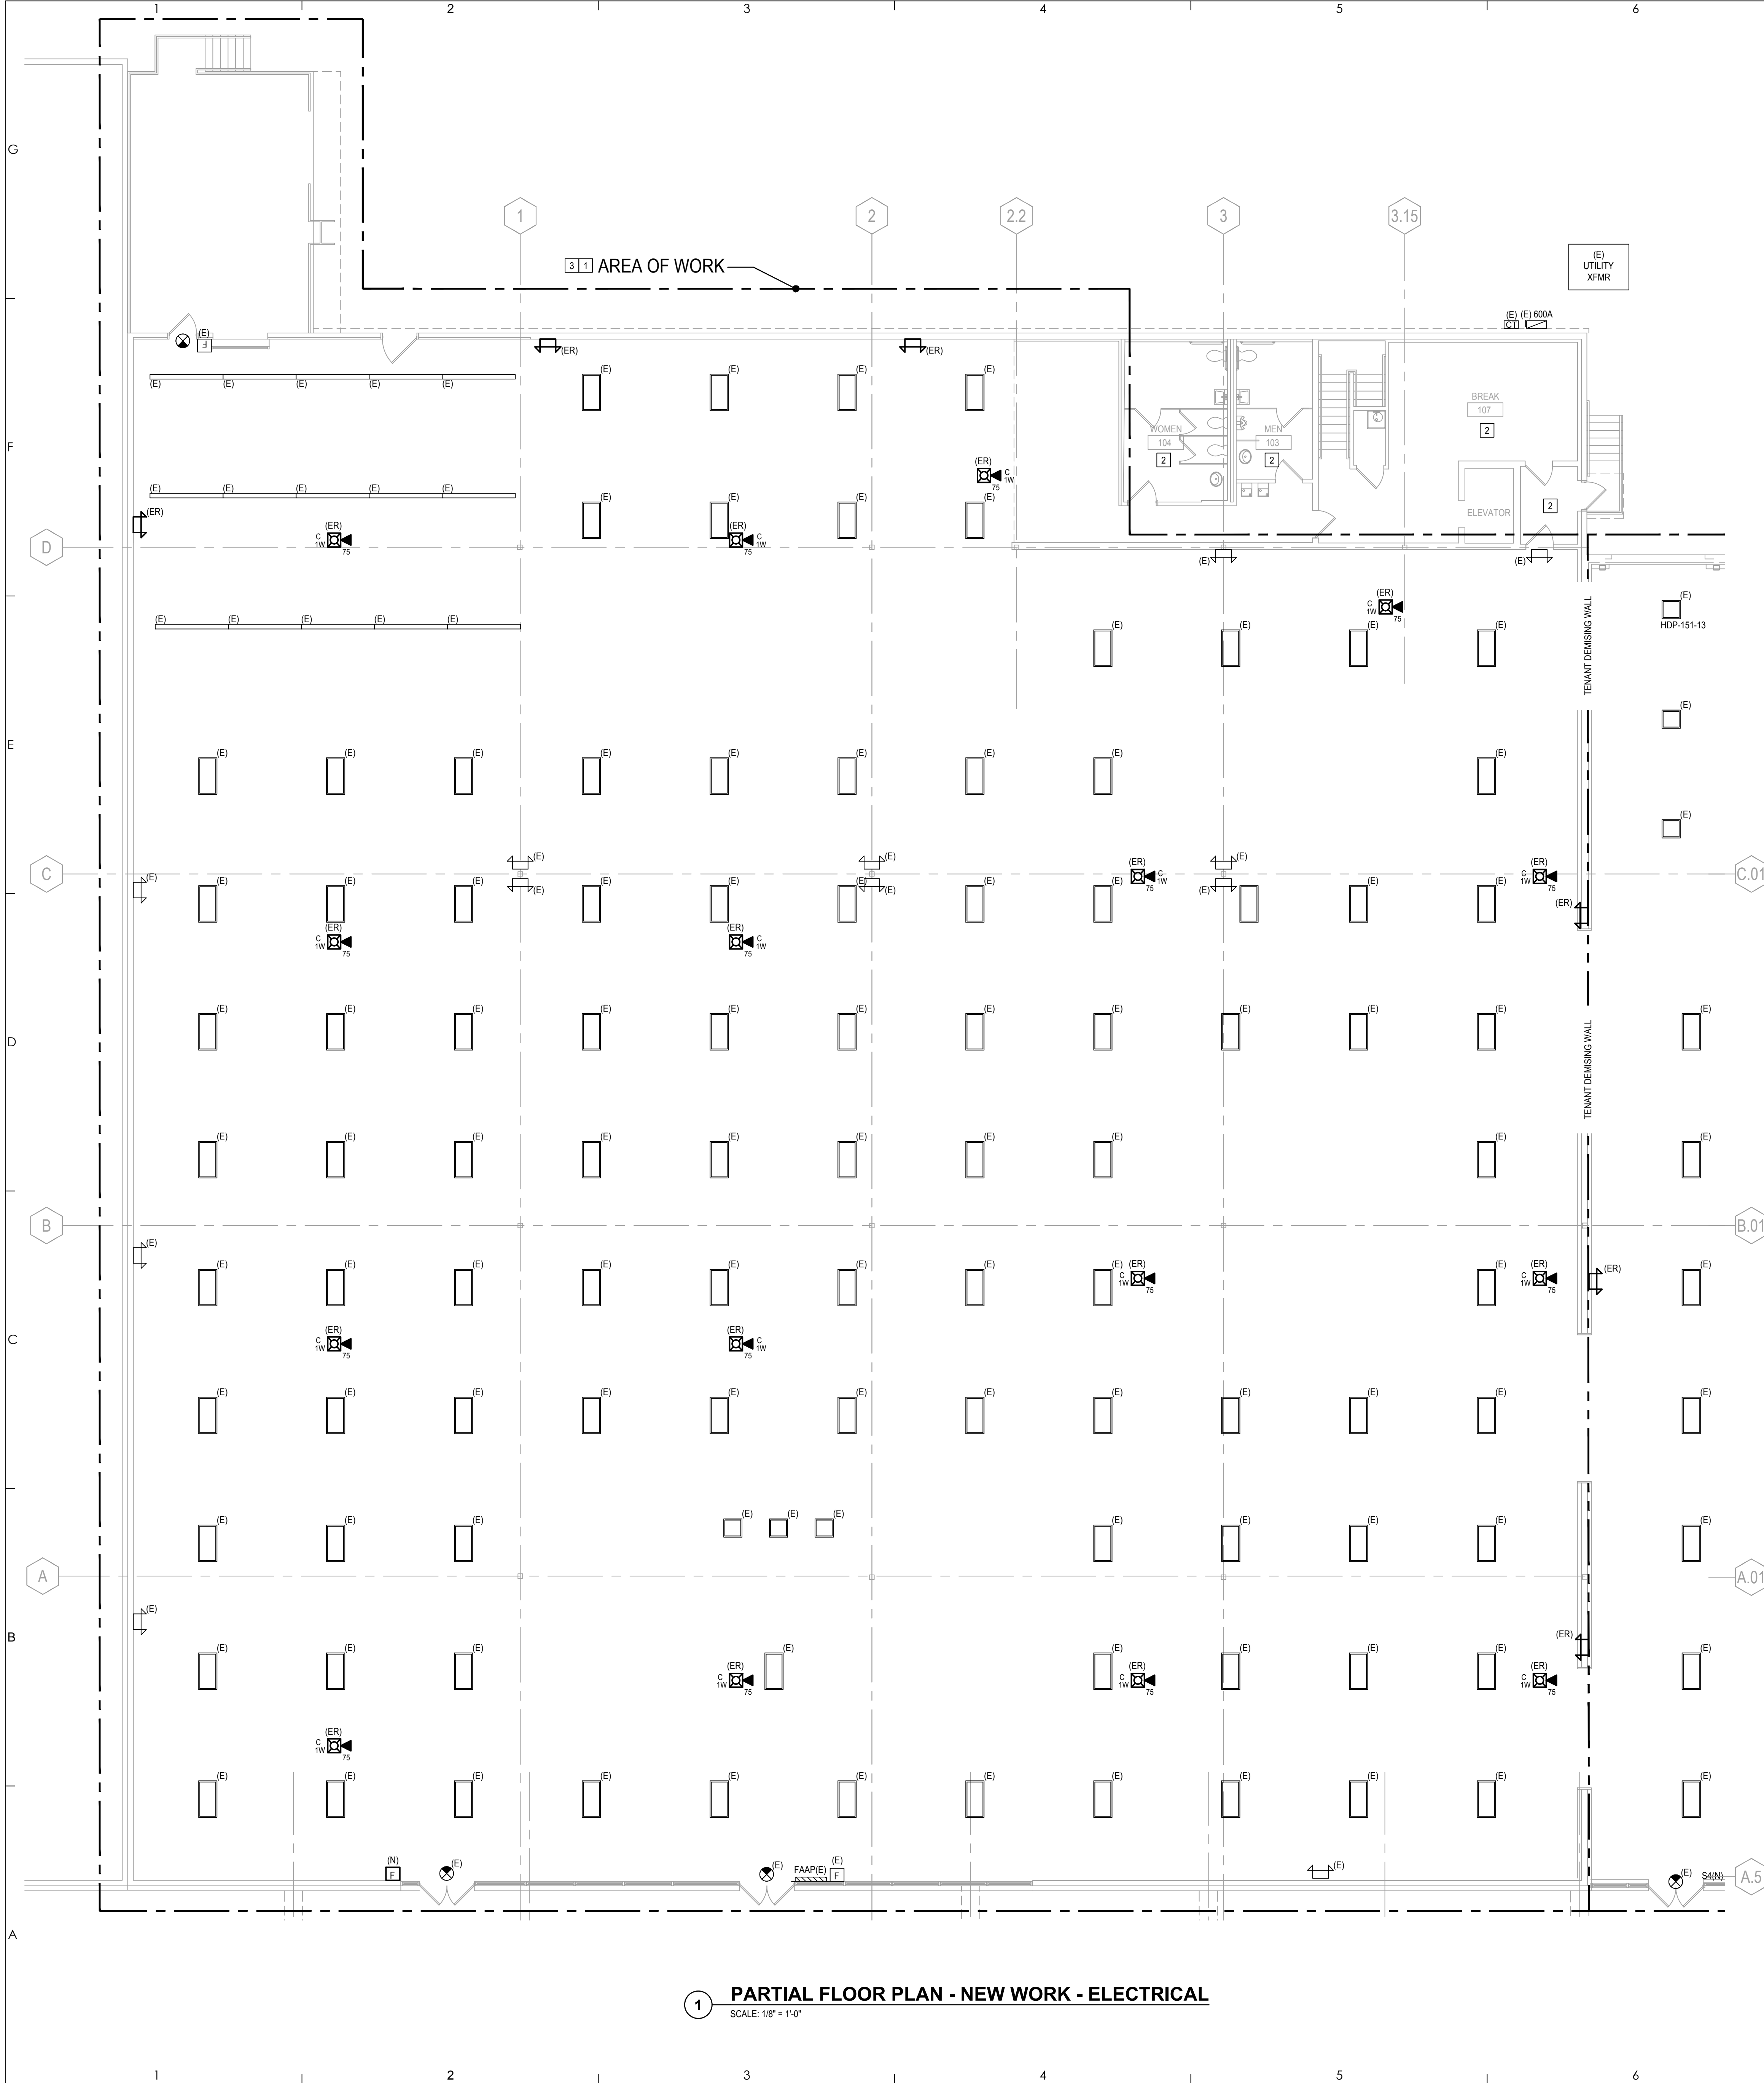


1 PARTIAL FLOOR PLAN - NEW WORK - ELECTRICAL
SCALE: 1/8" = 1'-0"

GENERAL NOTES


- EXISTING CONDITIONS SHOWN ON THIS DRAWING HAVE BEEN OBTAINED FROM RECORD DRAWINGS WHEN AVAILABLE AND GENERAL FIELD SURVEY AND MAY NOT INDICATE ACTUAL EXISTING CONDITIONS IN DETAIL AND DIMENSION. THE CONTRACTOR IS RESPONSIBLE FOR VERIFYING EXACT EXISTING CONDITIONS PRIOR TO THE FABRICATION OR ORDER OF EQUIPMENT OR PERFORMANCE OF ANY WORK. THE CONTRACTOR SHALL NOTIFY THE ARCHITECT OR ENGINEER IN WRITING IF EXISTING CONDITIONS ARE DISCOVERED THAT PREVENT THE EXECUTION OF WORK. THE CONTRACTOR SHALL NOT PROCEED WITH WORK UNTIL DIRECTION IS PROVIDED.
- ALL EQUIPMENT SHOWN SHALL BE NEW UNLESS NOTED OTHERWISE.
- REFERENCE SHEET E601 FOR PANEL SCHEDULES AND ONE LINE DIAGRAM.
- NEW FA DEVICES SHALL BE CONNECTED TO EXISTING FA/CP IN ELEC ROOM 203. REFERENCE SHEET E102 FOR LOCATION OF FA/CP.

PLAN NOTES 1

- RECONFIGURE EXISTING LIGHTING CIRCUIT AS NECESSARY FOR SEPARATION OF TENANT SPACES. LIGHTING CIRCUIT(S) AND CONTROL(S) IN TENANT 121 AREA SHALL REMAIN.
- ROOM IS NOT IN SCOPE. EXISTING POWER, LIGHTING, COMMUNICATIONS, AND FIRE ALARM EQUIPMENT AND DEVICES SHALL BE MAINTAINED.
- CONNECT SALVAGED EMERGENCY WALL PACKS TO CIRCUIT(S) SALVAGED DURING DEMOLITION.

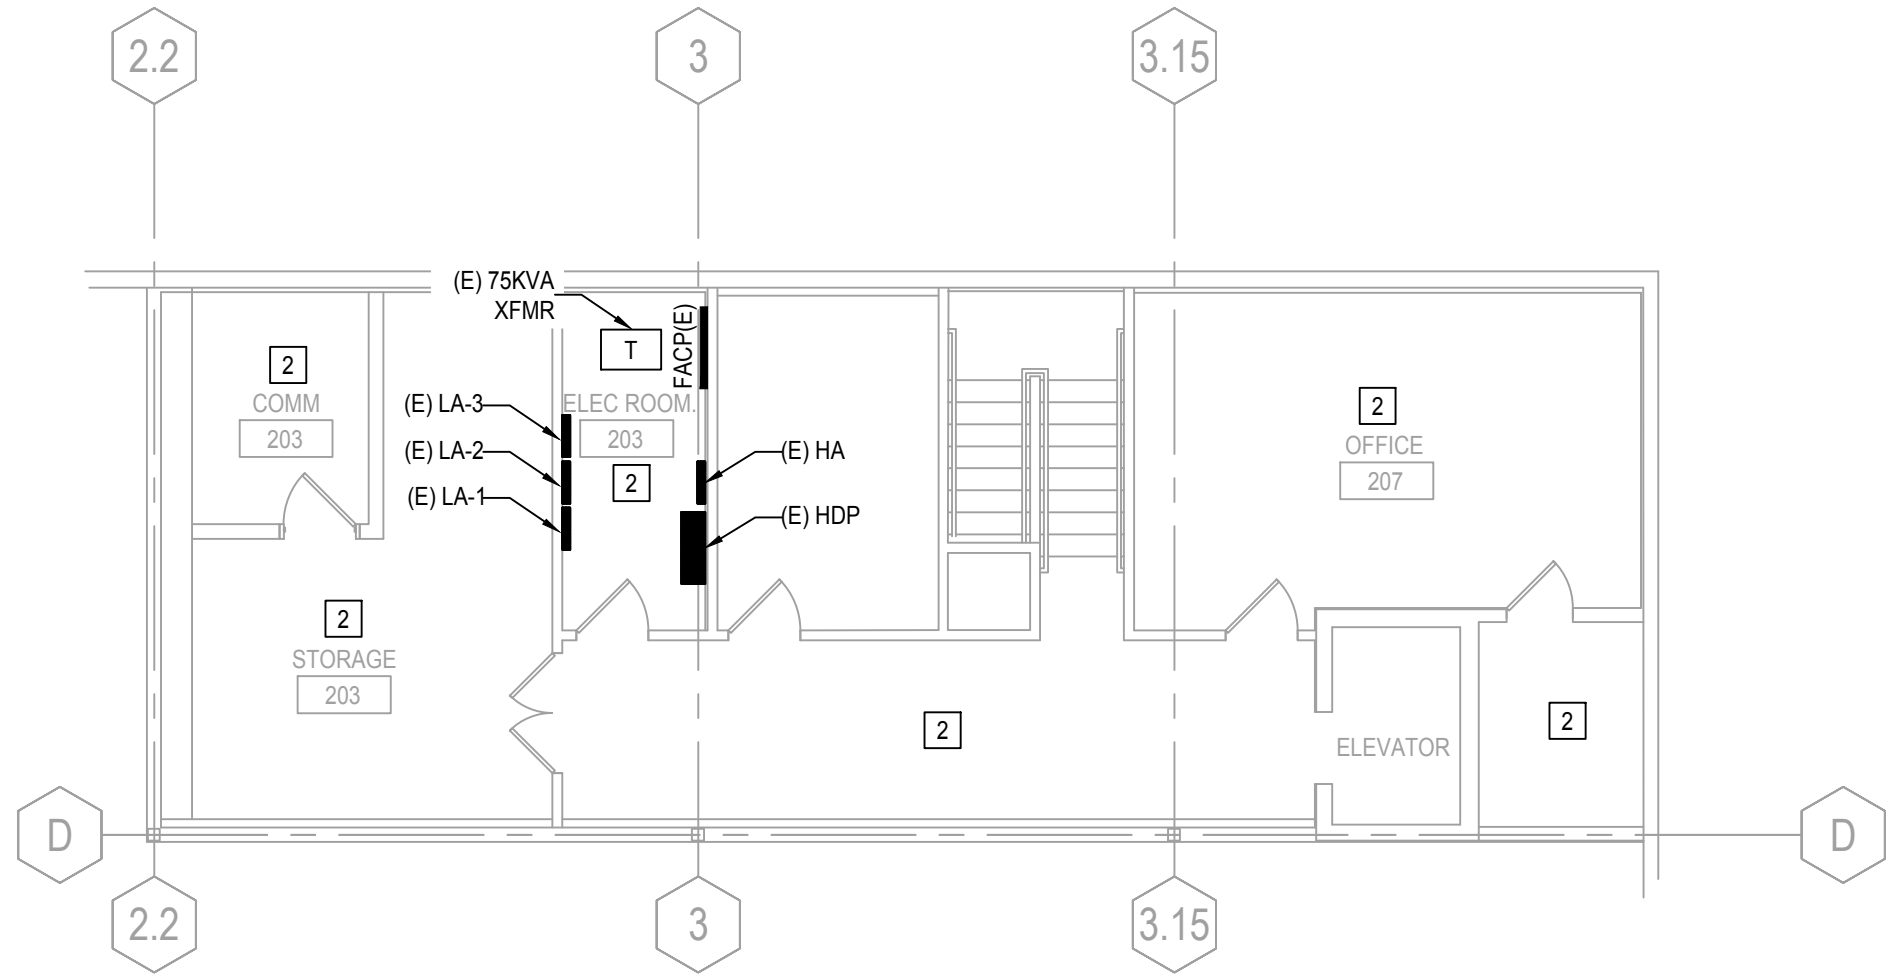

2 PARTIAL SECOND FLOOR PLAN - EXISTING - POWER
SCALE: 1/8" = 1'-0"

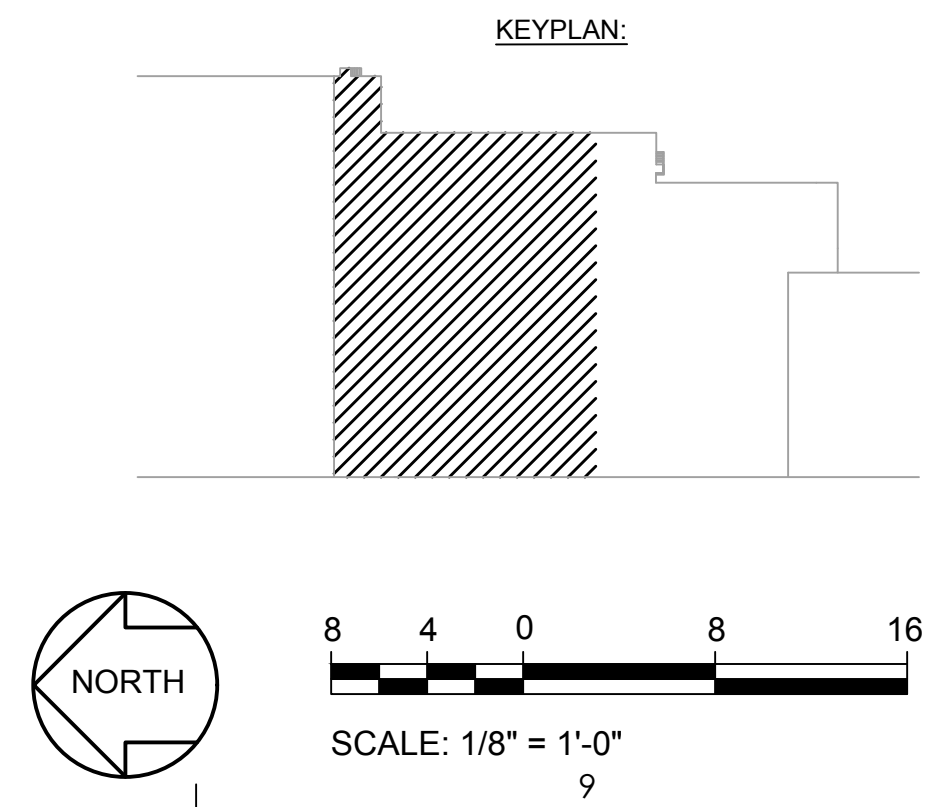

JP2

JP2 ARCHITECTS
2811 Dillon Street
Baltimore, MD 21224
410.646.8300
www.JP2architects.com

CONSULTANTS

Mechanical, Electrical, Plumbing, Fire Protection:
CFR Engineering
20251 Century Blvd.
Germantown, MD 20874
877.871.4229
www.cfrengineering.com

SEAL / SIGNATURE

PROFESSIONAL CERTIFICATION - I HEREBY CERTIFY THAT THESE DOCUMENTS WERE PREPARED OR APPROVED BY ME AND THAT I AM A VALIDLY LICENSED PROFESSIONAL ARCHITECT UNDER THE LAWS OF THE STATE OF MARYLAND. LICENSE NO. 71089 EXPIRATION DATE 03/31/2027

PROJECT

GATEWAY PLAZA
TENANT 121
121 TOWNE CENTER BLVD
SANFORD, FL 32771

CONSTRUCTION
DOCUMENTS

CLIENT / OWNER

GG REIF I Gateway LLC
3904 Boston St.
Baltimore, MD 21224
410.559.2500
410.518.2032
www.ggcommercial.com

REVISION DRAWING LOG

No.	Date	Title

PROJECT NUMBER: 25-137

COPYRIGHT © 2025 JP2 ARCHITECTS


DRAWING TITLE

PARTIAL FLOOR PLAN -
NEW WORK - ELECTRICAL

DRAWING NUMBER

E101

Issue Date 01/07/2026

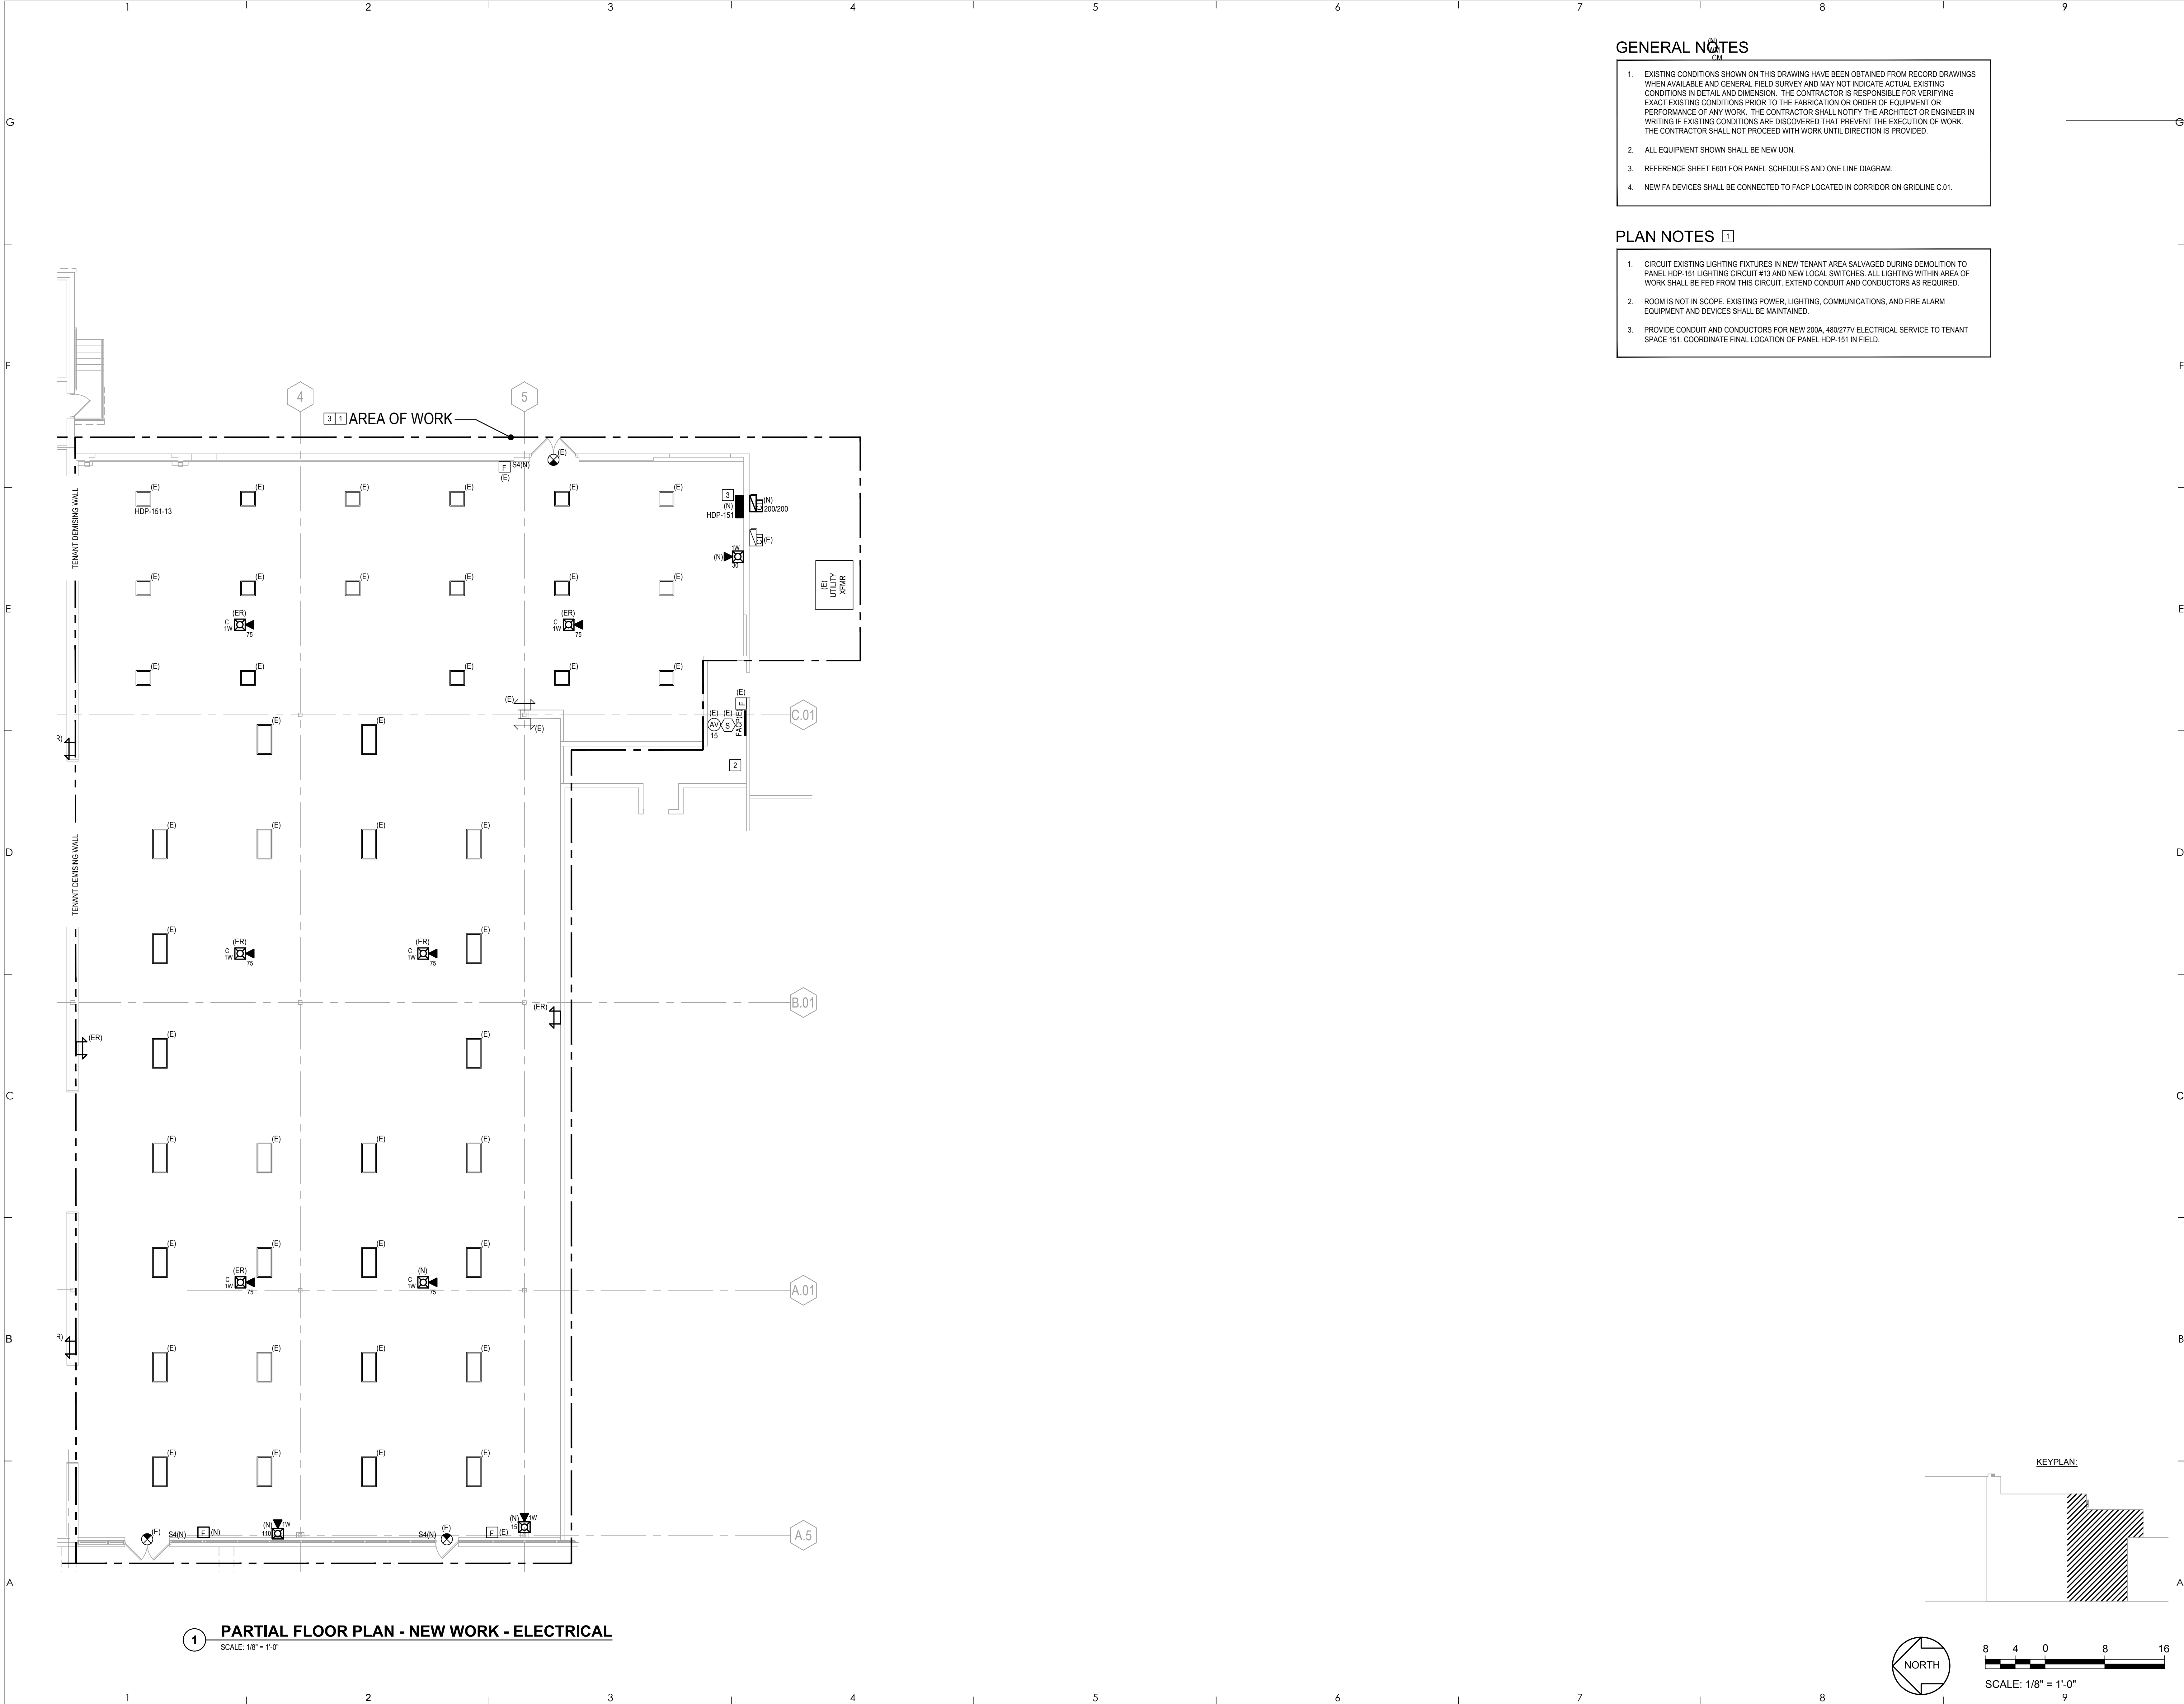


GENERAL NOTES

- EXISTING CONDITIONS SHOWN ON THIS DRAWING HAVE BEEN OBTAINED FROM RECORD DRAWINGS WHEN AVAILABLE AND GENERAL FIELD SURVEY AND MAY NOT INDICATE ACTUAL EXISTING CONDITIONS IN DETAIL AND DIMENSION. THE CONTRACTOR IS RESPONSIBLE FOR VERIFYING EXACT EXISTING CONDITIONS PRIOR TO THE FABRICATION OR ORDER OF EQUIPMENT OR PERFORMANCE OF ANY WORK. THE CONTRACTOR SHALL NOTIFY THE ARCHITECT OR ENGINEER IN WRITING IF EXISTING CONDITIONS ARE DISCOVERED THAT PREVENT THE EXECUTION OF WORK. THE CONTRACTOR SHALL NOT PROCEED WITH WORK UNTIL DIRECTION IS PROVIDED.
- ALL EQUIPMENT SHOWN SHALL BE NEW UNO.
- REFERENCE SHEET E601 FOR PANEL, SCHEDULES AND ONE LINE DIAGRAM.
- NEW FA DEVICES SHALL BE CONNECTED TO FACP LOCATED IN CORRIDOR ON GRIDLINE C.01.

PLAN NOTES

- CIRCUIT EXISTING LIGHTING FIXTURES IN NEW TENANT AREA SALVAGED DURING DEMOLITION TO PANEL HDP-151 LIGHTING CIRCUIT #13 AND NEW LOCAL SWITCHES. ALL LIGHTING WITHIN AREA OF WORK SHALL BE FED FROM THIS CIRCUIT. EXTEND CONDUIT AND CONDUCTORS AS REQUIRED.
- ROOM IS NOT IN SCOPE. EXISTING POWER, LIGHTING, COMMUNICATIONS, AND FIRE ALARM EQUIPMENT AND DEVICES SHALL BE MAINTAINED.
- PROVIDE CONDUIT AND CONDUCTORS FOR NEW 200A, 480/277V ELECTRICAL SERVICE TO TENANT SPACE 151. COORDINATE FINAL LOCATION OF PANEL HDP-151 IN FIELD.

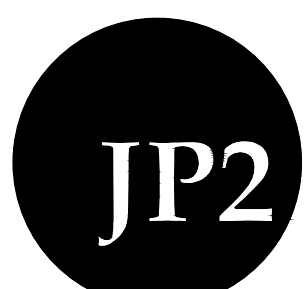

JP2 ARCHITECTS
2811 Dillon Street
Baltimore, MD 21224
t 410.646.8300
www.JP2architects.com

CONSULTANTS

Mechanical, Electrical, Plumbing, Fire Protection:
CFR Engineering
20251 Century Blvd.
Cermantown, MD 20874
t 877.871.4229
w www.cfrengineering.com

SEAL / SIGNATURE



PROFESSIONAL CERTIFICATION I HEREBY CERTIFY THAT THESE DOCUMENTS WERE PREPARED OR APPROVED BY ME AND THAT I AM A DULY LICENSED PROFESSIONAL ARCHITECT UNDER THE LAWS OF THE STATE OF MARYLAND. LICENSE NO. 71686 EXPIRATION DATE 08/30/27

PROJECT

**GATEWAY PLAZA
TENANT 121
121 TOWNE CENTER BLVD
SANFORD, FL 32771**

CONSTRUCTION
DOCUMENTS

CLIENT / OWNER

GG REIF I Gateway LLC
3904 Boston St.
Baltimore, MD 21224
t 410.559.2500
f 410.518.2032
www.ggcommercial.com

REVISION DRAWING LOG

No.	Date	Title

PROJECT NUMBER: 25-137
COPYRIGHT © 2025 JP2 ARCHITECTS


DRAWING TITLE

**PARTIAL FLOOR PLAN -
NEW WORK - ELECTRICAL**


DRAWING NUMBER

E102

Issue Date 01/07/2026

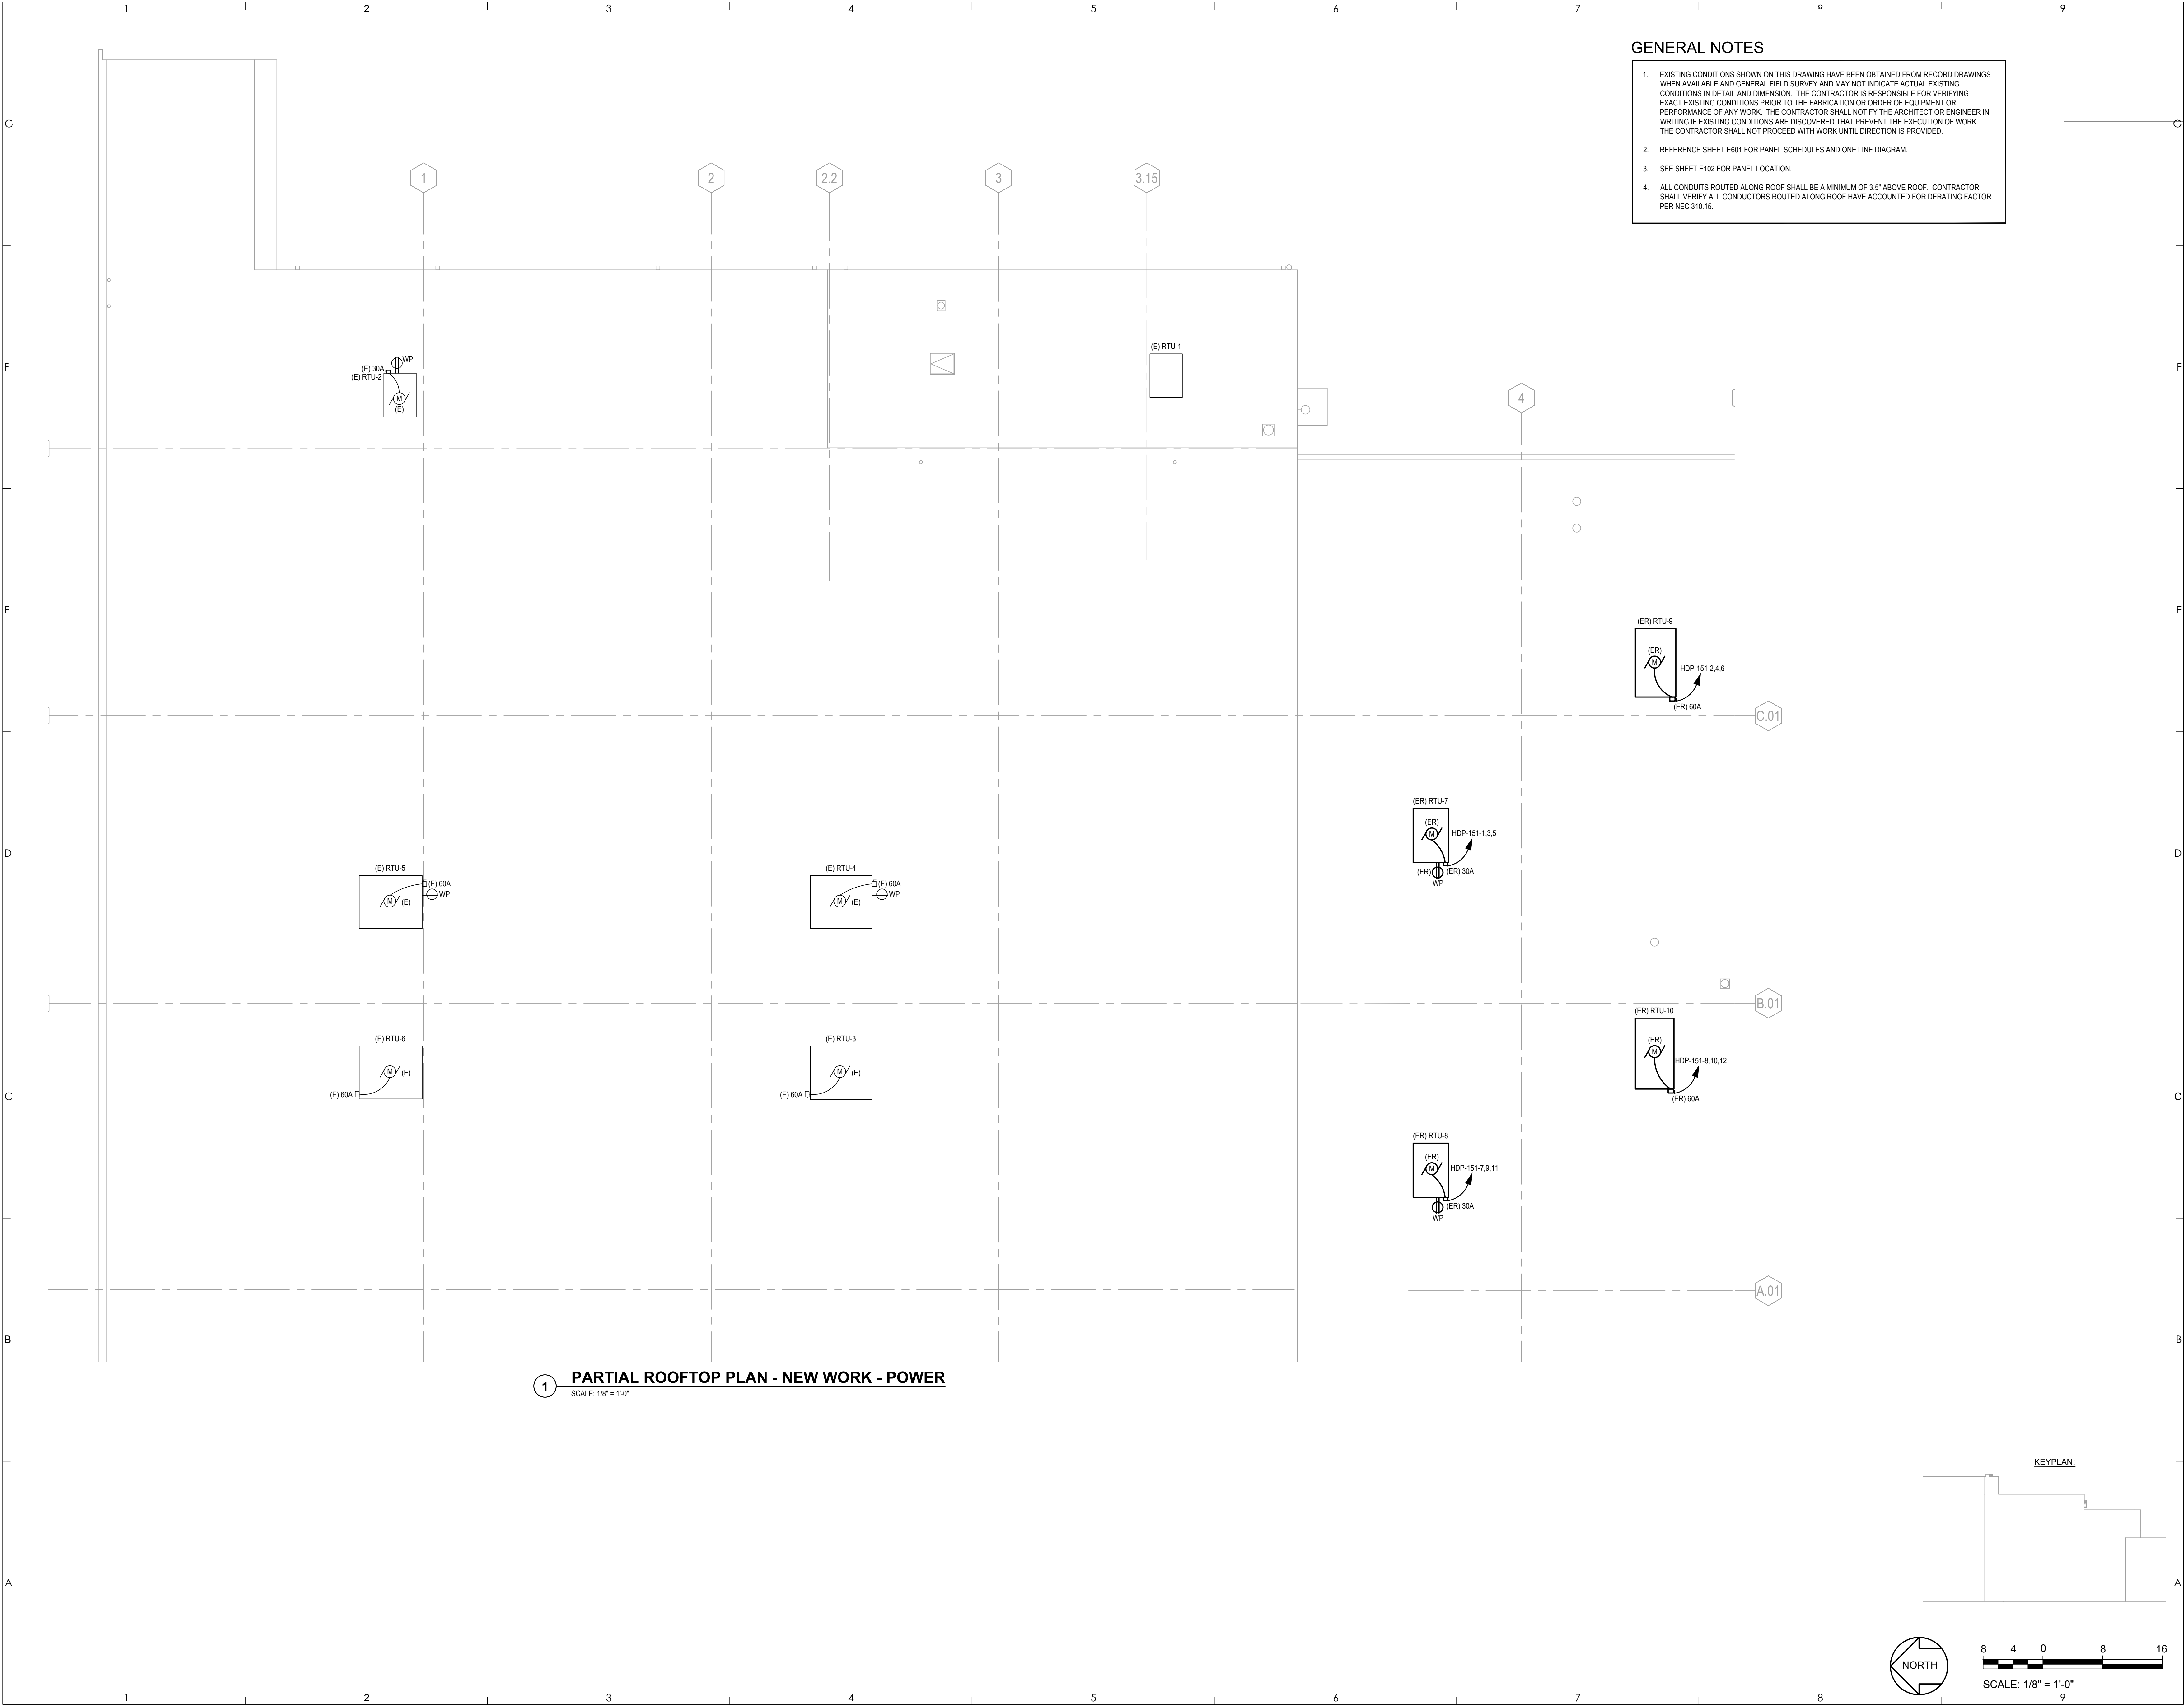

- GENERAL NOTES**
- EXISTING CONDITIONS SHOWN ON THIS DRAWING HAVE BEEN OBTAINED FROM RECORD DRAWINGS WHEN AVAILABLE AND GENERAL FIELD SURVEY AND MAY NOT INDICATE ACTUAL EXISTING CONDITIONS IN DETAIL AND DIMENSION. THE CONTRACTOR IS RESPONSIBLE FOR VERIFYING EXACT EXISTING CONDITIONS PRIOR TO THE FABRICATION OR ORDER OF EQUIPMENT OR PERFORMANCE OF ANY WORK. THE CONTRACTOR SHALL NOTIFY THE ARCHITECT OR ENGINEER IN WRITING IF EXISTING CONDITIONS ARE DISCOVERED THAT PREVENT THE EXECUTION OF WORK. THE CONTRACTOR SHALL NOT PROCEED WITH WORK UNTIL DIRECTION IS PROVIDED.
 - REFERENCE SHEET E801 FOR PANEL SCHEDULES AND ONE LINE DIAGRAM.
 - SEE SHEET E102 FOR PANEL LOCATION.
 - ALL CONDUITS ROUTED ALONG ROOF SHALL BE A MINIMUM OF 3.5' ABOVE ROOF. CONTRACTOR SHALL VERIFY ALL CONDUCTORS ROUTED ALONG ROOF HAVE ACCOUNTED FOR DERATING FACTOR PER NEC 310.15.

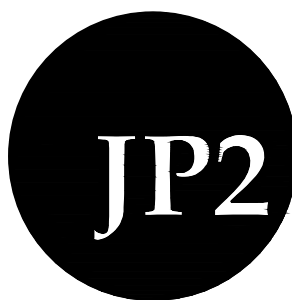

JP2 ARCHITECTS
2811 Dillon Street
Baltimore, MD 21224
t 410.646.8300
www.JP2architects.com

CONSULTANTS
Mechanical, Electrical, Plumbing, Fire Protection:
CFR Engineering
20251 Century Blvd.
Germantown, MD 20874
t 877.871.4229
w www.cfrengineering.com

Structural, Inc.
Structural, Inc.
200 Main Street
Anywhere, MN 00000
t 000.000.0000
f 000.000.0000

Other:
Other, Inc.
200 Main Street
Anywhere, MN 00000
t 000.000.0000
f 000.000.0000

Other:
Other, Inc.
200 Main Street
Anywhere, MN 00000
t 000.000.0000
f 000.000.0000

SEAL / SIGNATURE



PROFESSIONAL CERTIFICATION: I HEREBY CERTIFY THAT THESE DOCUMENTS WERE PREPARED OR APPROVED BY ME, AND THAT I AM A DULY LICENSED PROFESSIONAL ARCHITECT UNDER THE LAWS OF THE STATE OF MARYLAND, LICENSE NO. 71085, EXPIRATION DATE 01/07/2026.

PROJECT

**GATEWAY PLAZA
TENANT 121
121 TOWNE CENTER BLVD
SANFORD, FL 32771**

**CONSTRUCTION
DOCUMENTS**

CLIENT / OWNER

GG REIF I Gateway LLC
3904 Boston St.
Baltimore, MD 21224
t 410.559.2500
f 410.518.2032
www.ggcommercial.com

REVISION DRAWING LOG

No.	Date	Title

PROJECT NUMBER: 25-137
COPYRIGHT © 2025 JP2 ARCHITECTS


DRAWING TITLE

**PARTIAL ROOFTOP PLAN
- NEW WORK - POWER**

DRAWING NUMBER

E103

Issue Date 01/07/2026

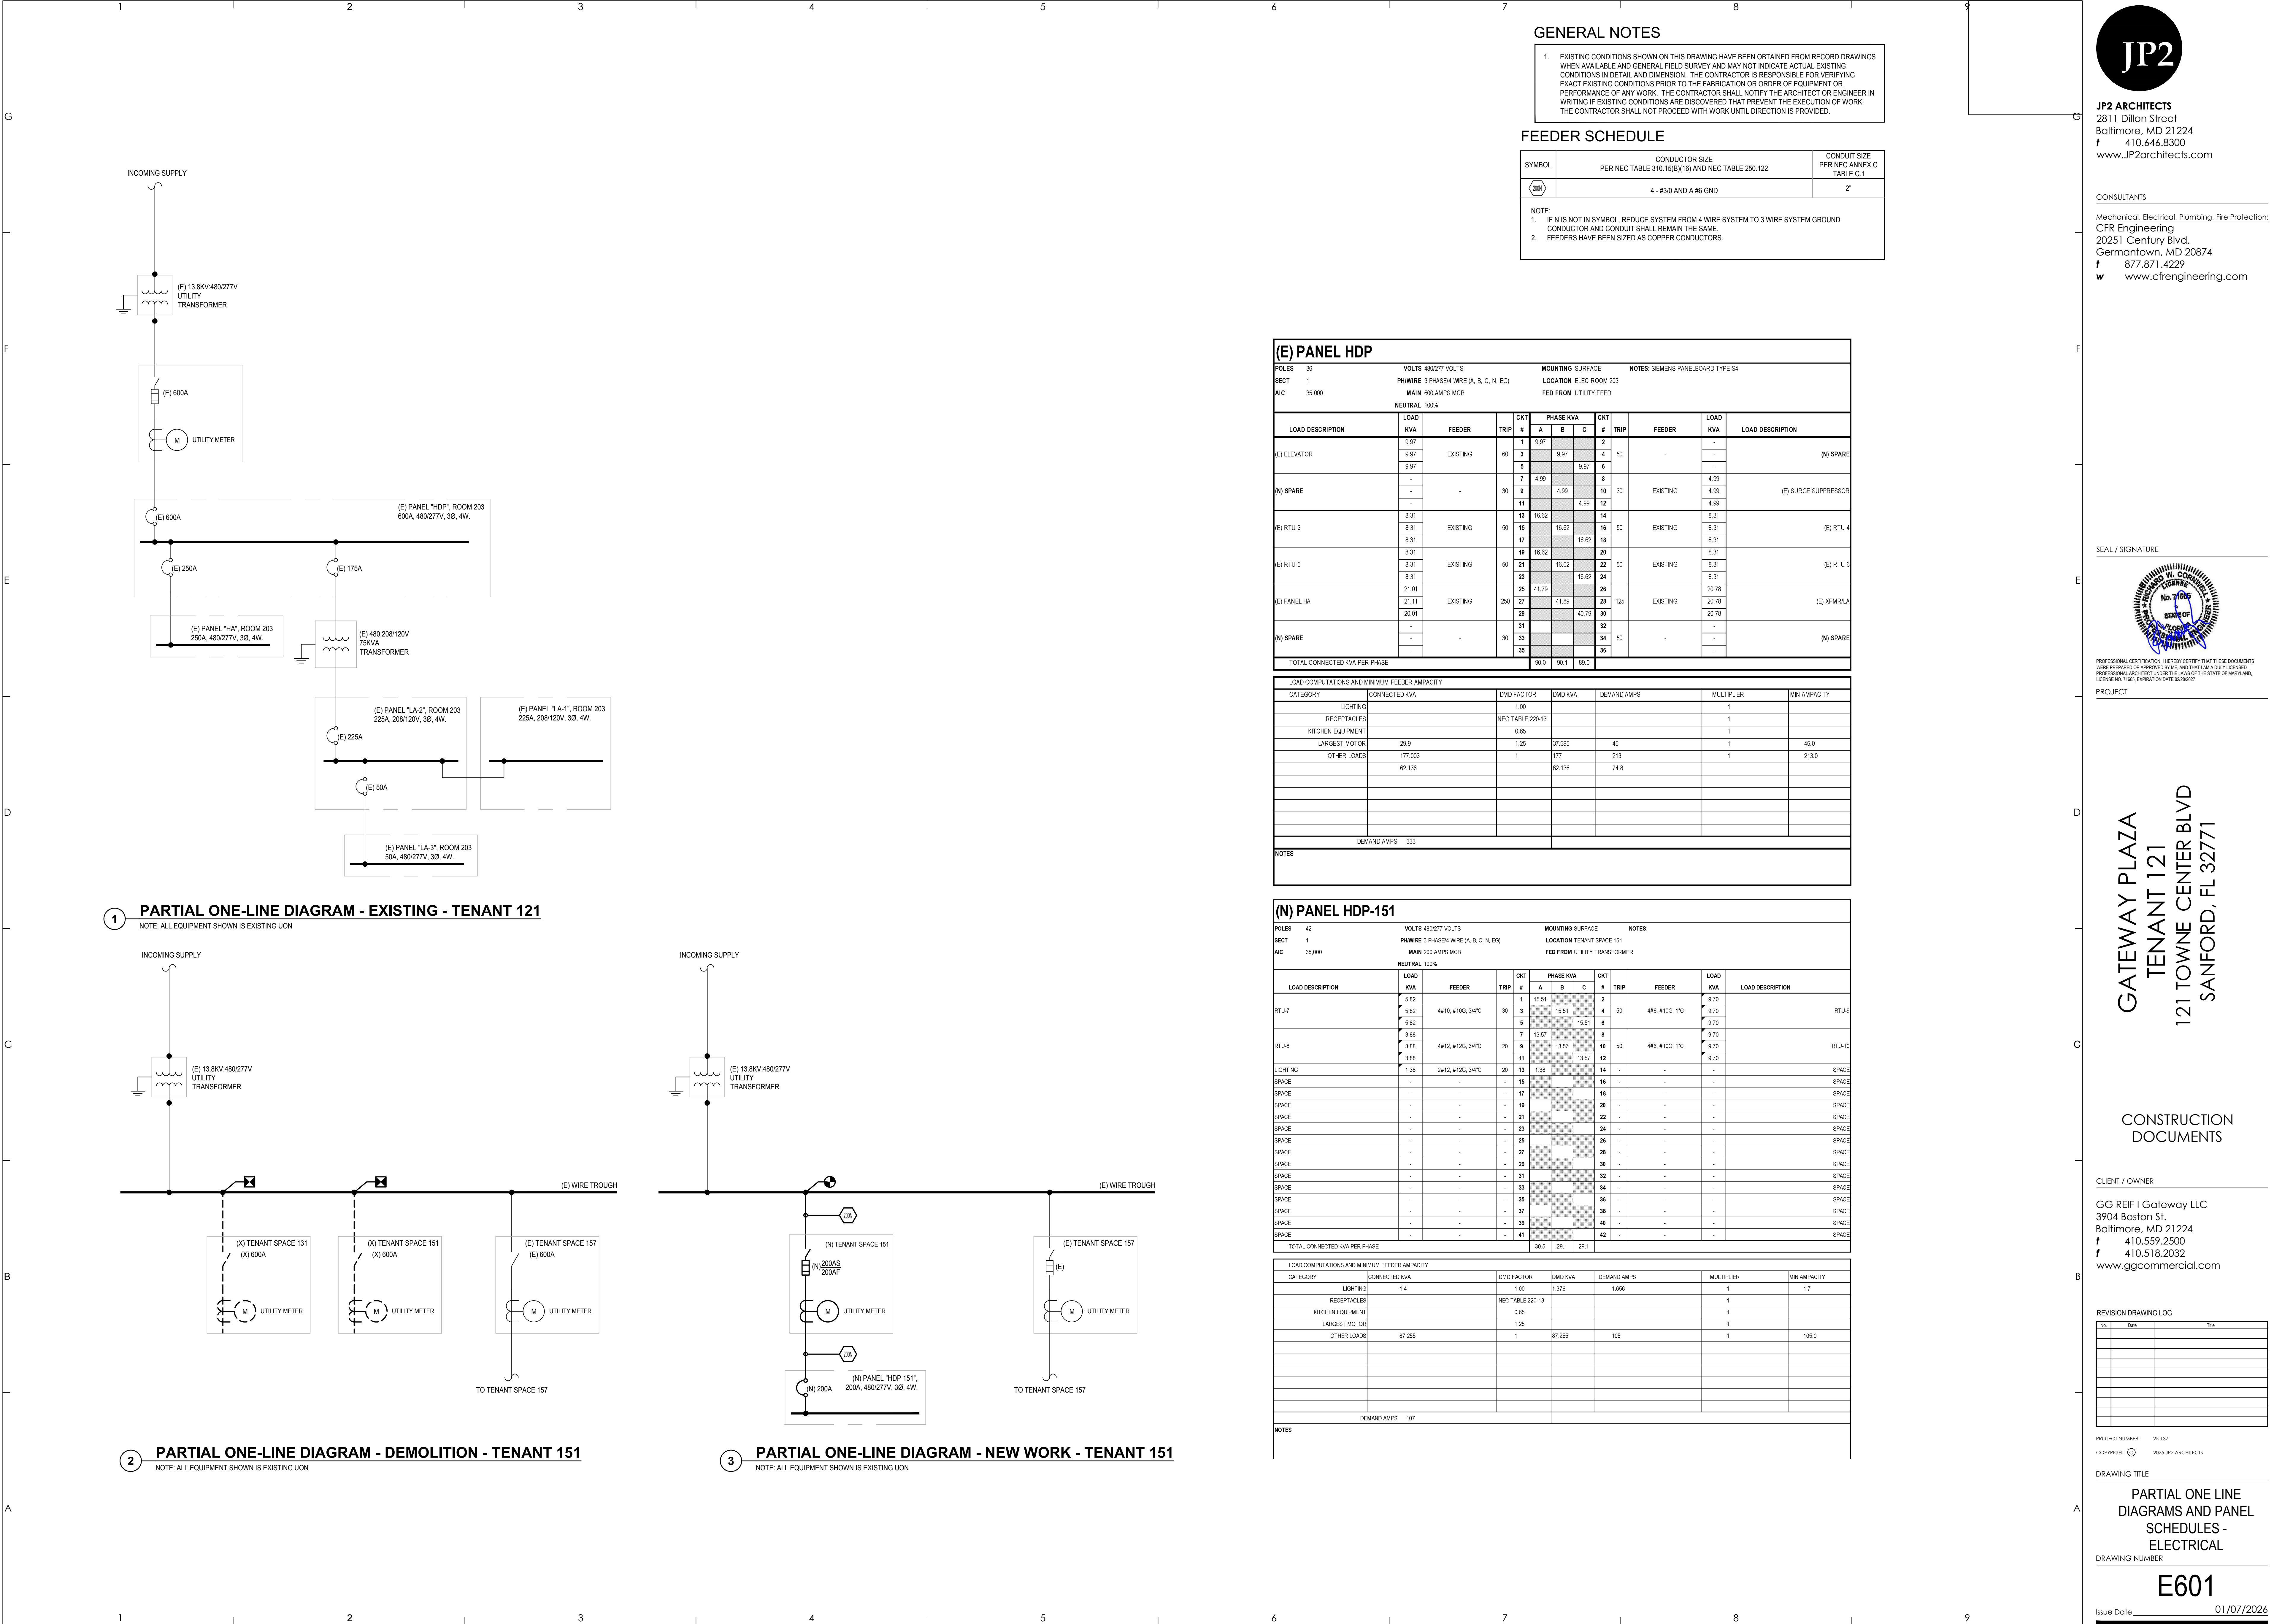

GENERAL NOTES


1. EXISTING CONDITIONS SHOWN ON THIS DRAWING HAVE BEEN OBTAINED FROM RECORD DRAWINGS WHEN AVAILABLE AND GENERAL FIELD SURVEY AND MAY NOT INDICATE ACTUAL EXISTING CONDITIONS IN DETAIL AND DIMENSION. THE CONTRACTOR IS RESPONSIBLE FOR VERIFYING EXACT EXISTING CONDITIONS PRIOR TO THE FABRICATION OR ORDER OF EQUIPMENT OR PERFORMANCE OF ANY WORK. THE CONTRACTOR SHALL NOTIFY THE ARCHITECT OR ENGINEER IN WRITING IF EXISTING CONDITIONS ARE DISCOVERED THAT PREVENT THE EXECUTION OF WORK. THE CONTRACTOR SHALL NOT PROCEED WITH WORK UNTIL DIRECTION IS PROVIDED.

FEEDER SCHEDULE

SYMBOL	CONDUCTOR SIZE	CONDUIT SIZE
	PER NEC TABLE 310.15(B)(16) AND NEC TABLE 250.122	PER NEC ANNEX C TABLE C.1
	4 - #3/0 AND A #6 GND	2"
NOTE: 1. IF N IS NOT IN SYMBOL, REDUCE SYSTEM FROM 4 WIRE SYSTEM TO 3 WIRE SYSTEM GROUND CONDUCTOR AND CONDUIT SHALL REMAIN THE SAME. 2. FEEDERS HAVE BEEN SIZED AS COPPER CONDUCTORS.		

(E) PANEL HDP													
POLES 38 SECT 1 AIC 35,000			VOLTS 480/277 VOLTS PH WIRE 3 PHASE 4 WIRE (A, B, C, N, EG) MAIN 600 AMPS MCB NEUTRAL 100%				MOUNTING SURFACE LOCATION ELEC ROOM 203 FED FROM UTILITY FEED				NOTES: SEMENS PANELBOARD TYPE S4		
LOAD DESCRIPTION	KVA	FEEDER	TRIP	CKT #	PHASE KVA			CKT #	TRIP	FEEDER	LOAD KVA	LOAD DESCRIPTION	
					A	B	C						
(E) ELEVATOR	9.97	EXISTING	60	1	9.97			2		-	-	(N) SPARE	
	9.97			3		9.97		4		-	-		
	9.97			5			9.97	6		-	-		
	-			7	4.99			8		4.99	-		
(N) SPARE	-		30	9	4.99			10	30	EXISTING	4.99	(E) SURGE SUPPRESSOR	
	-			11			4.99	12		4.99	-		
(E) RTU 3	8.31	EXISTING	50	13	16.62			14		8.31	-	(E) RTU 4	
	8.31			15		16.62		16	50	EXISTING	8.31		
	8.31			17			16.62	18		8.31	-		
(E) RTU 5	8.31	EXISTING	50	19	16.62			20		8.31	-	(E) RTU 6	
	8.31			21		16.62		22	50	EXISTING	8.31		
	8.31			23			16.62	24		8.31	-		
(E) PANEL HA	21.01	EXISTING	250	25	41.79			26		20.78	-	(E) XFMR/LA	
	21.11			27		41.89		28	125	EXISTING	20.78		
	20.01			29			40.78	30		20.78	-		
	-			31				32		-	-		
(N) SPARE	-		30	33				34	50	-	-	(N) SPARE	
	-			35				36		-	-		
TOTAL CONNECTED KVA PER PHASE					90.0	90.1	88.9						
LOAD COMPUTATIONS AND MINIMUM FEEDER AMPACITY													
CATEGORY	CONNECTED KVA	DMD FACTOR	DMD KVA	DEMAND AMPS		MULTIPLIER		MIN AMPACITY					
LIGHTING		1.00				1							
RECEPTACLES		NEC TABLE 220-13				1							
KITCHEN EQUIPMENT		0.65				1							
LARGEST MOTOR	29.9	1.25	37.365	45		1		45.0					
OTHER LOADS	177.003	1	177	213		1		213.0					
	62.136		62.136	74.8									
DEMAND AMPS 333													
NOTES													

(N) PANEL HDP-151												
POLES 42 SECT 1 AIC 35,000			VOLTS 480/277 VOLTS PH WIRE 3 PHASE 4 WIRE (A, B, C, N, EG) MAIN 200 AMPS MCB NEUTRAL 100%			MOUNTING SURFACE LOCATION TENANT SPACE 151 FED FROM UTILITY TRANSFORMER			NOTES:			
LOAD DESCRIPTION	KVA	FEEDER	TRIP	#	PHASE KVA			#	TRIP	FEEDER	KVA	LOAD DESCRIPTION
					A	B	C					
RTU-7	5.82	#10, #100, 34°C	30	1	15.51			2		#6, #100, 1°C	9.70	RTU-9
	5.82				15.51		4	50	9.70			
	5.82					15.51		6	9.70			
RTU-8	3.88	#12, #120, 34°C	20	7	13.57			8		#6, #100, 1°C	9.70	RTU-10
	3.88				13.57		10	50	9.70			
	3.88					13.57		12	9.70			
LIGHTING	1.38	2#12, #120, 34°C	20	13	1.38			14	-	-	-	SPACE
SPACE	-	-	-	15				16	-	-	-	SPACE
SPACE	-	-	-	17				18	-	-	-	SPACE
SPACE	-	-	-	19				20	-	-	-	SPACE
SPACE	-	-	-	21				22	-	-	-	SPACE
SPACE	-	-	-	23				24	-	-	-	SPACE
SPACE	-	-	-	25				26	-	-	-	SPACE
SPACE	-	-	-	27				28	-	-	-	SPACE
SPACE	-	-	-	29				30	-	-	-	SPACE
SPACE	-	-	-	31				32	-	-	-	SPACE
SPACE	-	-	-	33				34	-	-	-	SPACE
SPACE	-	-	-	35				36	-	-	-	SPACE
SPACE	-	-	-	37				38	-	-	-	SPACE
SPACE	-	-	-	39				40	-	-	-	SPACE
SPACE	-	-	-	41				42	-	-	-	SPACE
TOTAL CONNECTED KVA PER PHASE					30.5	29.1	29.1					
LOAD COMPUTATIONS AND MINIMUM FEEDER AMPACITY												
CATEGORY	CONNECTED KVA	DMD FACTOR	DMD KVA	DEMAND AMPS		MULTIPLIER		MIN AMPACITY				
LIGHTING	1.4	1.00	1.378	1.656		1		1.7				
RECEPTACLES		NEC TABLE 220-13				1						
KITCHEN EQUIPMENT		0.65				1						
LARGEST MOTOR		1.25				1						
OTHER LOADS	87.255	1	87.255	105		1		105.0				
DEMAND AMPS 107												
NOTES												

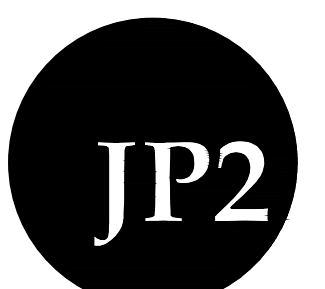

JP2 ARCHITECTS
2811 Dillon Street
Baltimore, MD 21224
t 410.646.8300
www.JP2architects.com

CONSULTANTS

Mechanical, Electrical, Plumbing, Fire Protection:
CFR Engineering
20251 Century Blvd.
Germantown, MD 20874
t 877.871.4229
w www.cfrengineering.com

SEAL / SIGNATURE



PROFESSIONAL CERTIFICATION: I HEREBY CERTIFY THAT THESE DOCUMENTS WERE PREPARED OR APPROVED BY ME, AND THAT I AM A duly LICENSED PROFESSIONAL ARCHITECT UNDER THE LAWS OF THE STATE OF MARYLAND. LICENSE NO. 71085 EXPIRATION DATE 08/01/2027

PROJECT

GATEWAY PLAZA
TENANT 121
121 TOWNE CENTER BLVD
SANFORD, FL 32771

CONSTRUCTION DOCUMENTS

CLIENT / OWNER

GG REIF I Gateway LLC
3904 Boston St.
Baltimore, MD 21224
t 410.559.2500
f 410.518.2032
www.ggcommercial.com

REVISION DRAWING LOG

No.	Date	Title

PROJECT NUMBER: 25-137

COPYRIGHT © 2025 JP2 ARCHITECTS

DRAWING TITLE

PARTIAL ONE LINE
DIAGRAMS AND PANEL
SCHEDULES -
ELECTRICAL

DRAWING NUMBER

E601

Issue Date 01/07/2026