

WIDEN STRIP FOUNDATION FOR STEEL POST
900mm WIDE X450mm (SHOWN ON PLAN) MASS CONCRETE PAD FOUNDATION AT TRENCH FILL LEVEL - DEPTH TO BE MIN 1300mm BELOW CURRENT GROUND LEVEL
OK TO REDUCE WITH SCAPE OF GROUND BY THE SAME PROPORTION

WIDEN STRIP FOUNDATION FOR STEEL POST
900mm WIDE X850mm (SHOWN ON PLAN) MASS CONCRETE PAD FOUNDATION AT TRENCH FILL LEVEL - DEPTH TO BE MIN 1300mm BELOW CURRENT GROUND LEVEL
OK TO REDUCE WITH SCAPE OF GROUND BY THE SAME PROPORTION

NLBS = WHERE DASHED WALLS SHOWN ALLOW FOR 2KN/M LINE LOAD FOR STUD WALLS

ALL BEAM & BLOCK FLOOR

150MM PRESTRESSED BEAM & BLOCK SUSPENDED FLOOR;
100MM INFILL BLOCKS @ ~450MM CENTRES; MIN 100MM END BEARING; VENTILATED VOID BELOW; 50-65MM SCREED; TRIM OPENINGS TO MANUFACTURER'S DETAILS.

ALL EXTERNAL FOUNDATIONS

600mm WIDE MASS CONCRETE TRENCH FILL FOUNDATIONS
DEPTH TO BE MIN 1300mm BELOW CURRENT GROUND LEVEL
OK TO REDUCE WITH SCAPE OF GROUND BY THE SAME PROPORTION

WIDEN STRIP FOUNDATION FOR STEEL POST

450mm WIDE X450mm SQUARE (SHOWN ON PLAN) MASS CONCRETE PAD FOUNDATION AT TRENCH FILL LEVEL - IN ADDITION TO 600mm WIDE FOUNDATION - DEPTH TO BE MIN 1300mm BELOW CURRENT GROUND LEVEL
OK TO REDUCE WITH SCAPE OF GROUND BY THE SAME PROPORTION

ALL INTERNAL FOUNDATIONS

450mm WIDE MASS CONCRETE TRENCH FILL FOUNDATIONS
DEPTH TO BE MIN 1300mm BELOW CURRENT GROUND LEVEL
OK TO REDUCE WITH SCAPE OF GROUND BY THE SAME PROPORTION

WIDEN STRIP FOUNDATION FOR STEEL POST

450mm WIDE X850mm (SHOWN ON PLAN) MASS CONCRETE PAD FOUNDATION AT TRENCH FILL LEVEL - IN ADDITION TO 600mm WIDE FOUNDATION - DEPTH TO BE MIN 1300mm BELOW CURRENT GROUND LEVEL
OK TO REDUCE WITH SCAPE OF GROUND BY THE SAME PROPORTION

ALL INTERNAL SLEEPER WALLS

INTERNAL SLEEPER WALLS IN 100MM SOLID DENSE CONCRETE BLOCKWORK (MIN 7.3N) BUILT OFF TRENCHFILL FOUNDATIONS; BLOCKS LAID FLAT; PROVIDE MIN 100MM BEARING TO PRESTRESSED FLOOR BEAMS.


WIDEN STRIP FOUNDATION FOR STEEL POST

450mm WIDE X700mm (SHOWN ON PLAN) MASS CONCRETE PAD FOUNDATION AT TRENCH FILL LEVEL - IN ADDITION TO 600mm WIDE FOUNDATION - DEPTH TO BE MIN 1300mm BELOW CURRENT GROUND LEVEL
OK TO REDUCE WITH SCAPE OF GROUND BY THE SAME PROPORTION


WIDEN STRIP FOUNDATION FOR STEEL POST

900mm WIDE X700mm (SHOWN ON PLAN) MASS CONCRETE PAD FOUNDATION AT TRENCH FILL LEVEL - DEPTH TO BE MIN 1300mm BELOW CURRENT GROUND LEVEL
OK TO REDUCE WITH SCAPE OF GROUND BY THE SAME PROPORTION


WIDEN STRIP FOUNDATION FOR STEEL POST
900mm WIDE X450mm (SHOWN ON PLAN) MASS CONCRETE PAD FOUNDATION AT TRENCH FILL LEVEL - DEPTH TO BE MIN 1300mm BELOW CURRENT GROUND LEVEL
OK TO REDUCE WITH SCAPE OF GROUND BY THE SAME PROPORTION

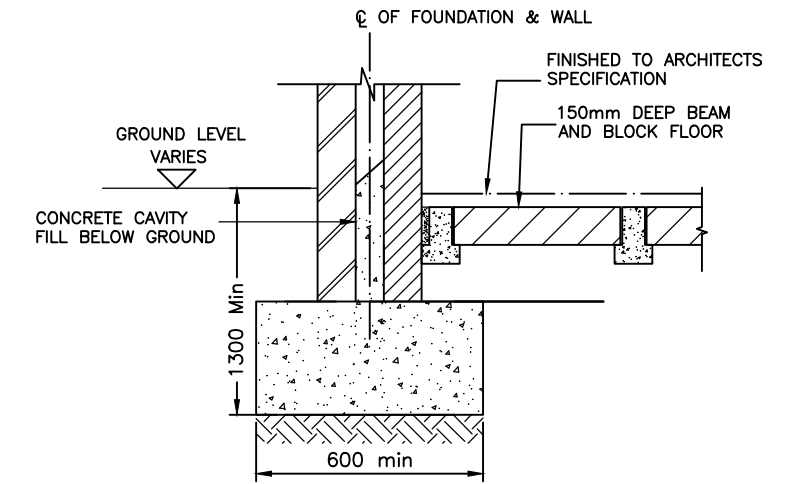

01,02 BEAM&BLOCK DETAIL 1
SCALE 1:20

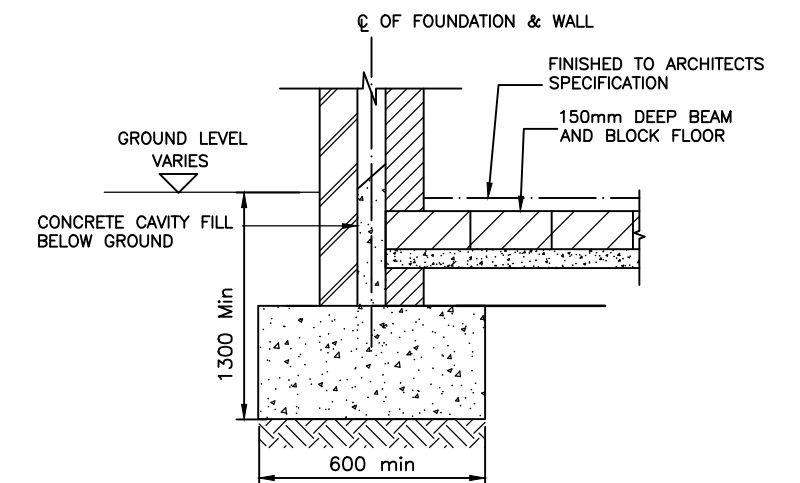

01,03 BEAM&BLOCK DETAIL 2
SCALE 1:20

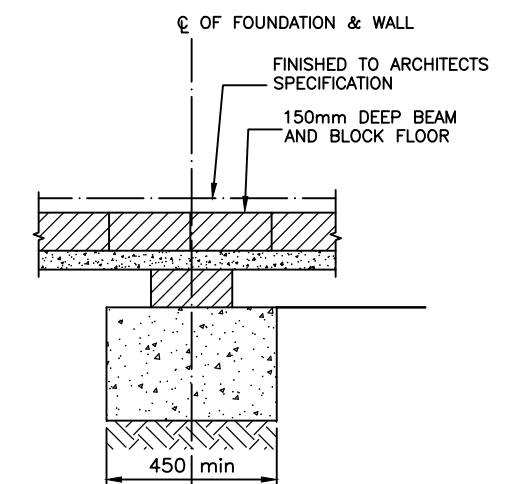

01,04 BEAM&BLOCK DETAIL 3
SCALE 1:20

01,01 FOUNDATION PLAN

SCALE 1:50

TEMPORARY WORKS TO MAIN CONTRACTORS METHOD STATEMENT
DO NOT DIRECTLY SCALE FROM THIS DRAWING.
USE SITE DIMENSIONS FOR SETTING OUT AND ARCHITECTS DRAWINGS

NOTE DRAWINGS AND CALCULATIONS ARE ONLY TO COVER PART A OF THE BUILDING REGULATIONS - ELLIS STRUCTURES HAVE NOT BEEN APPOINTED AS THE PRINCIPAL DESIGNER
CONTACT OTHERS FOR THIS ROLE

NLBS = WHERE DASHED WALLS SHOWN ALLOW FOR 2KN/M LINE LOAD FOR STUD WALLS

ALL WORK MUST COMPLY WITH THE CONSTRUCTION (DESIGN AND MANAGEMENT) REGULATIONS 2015 (CDM 2015)

