


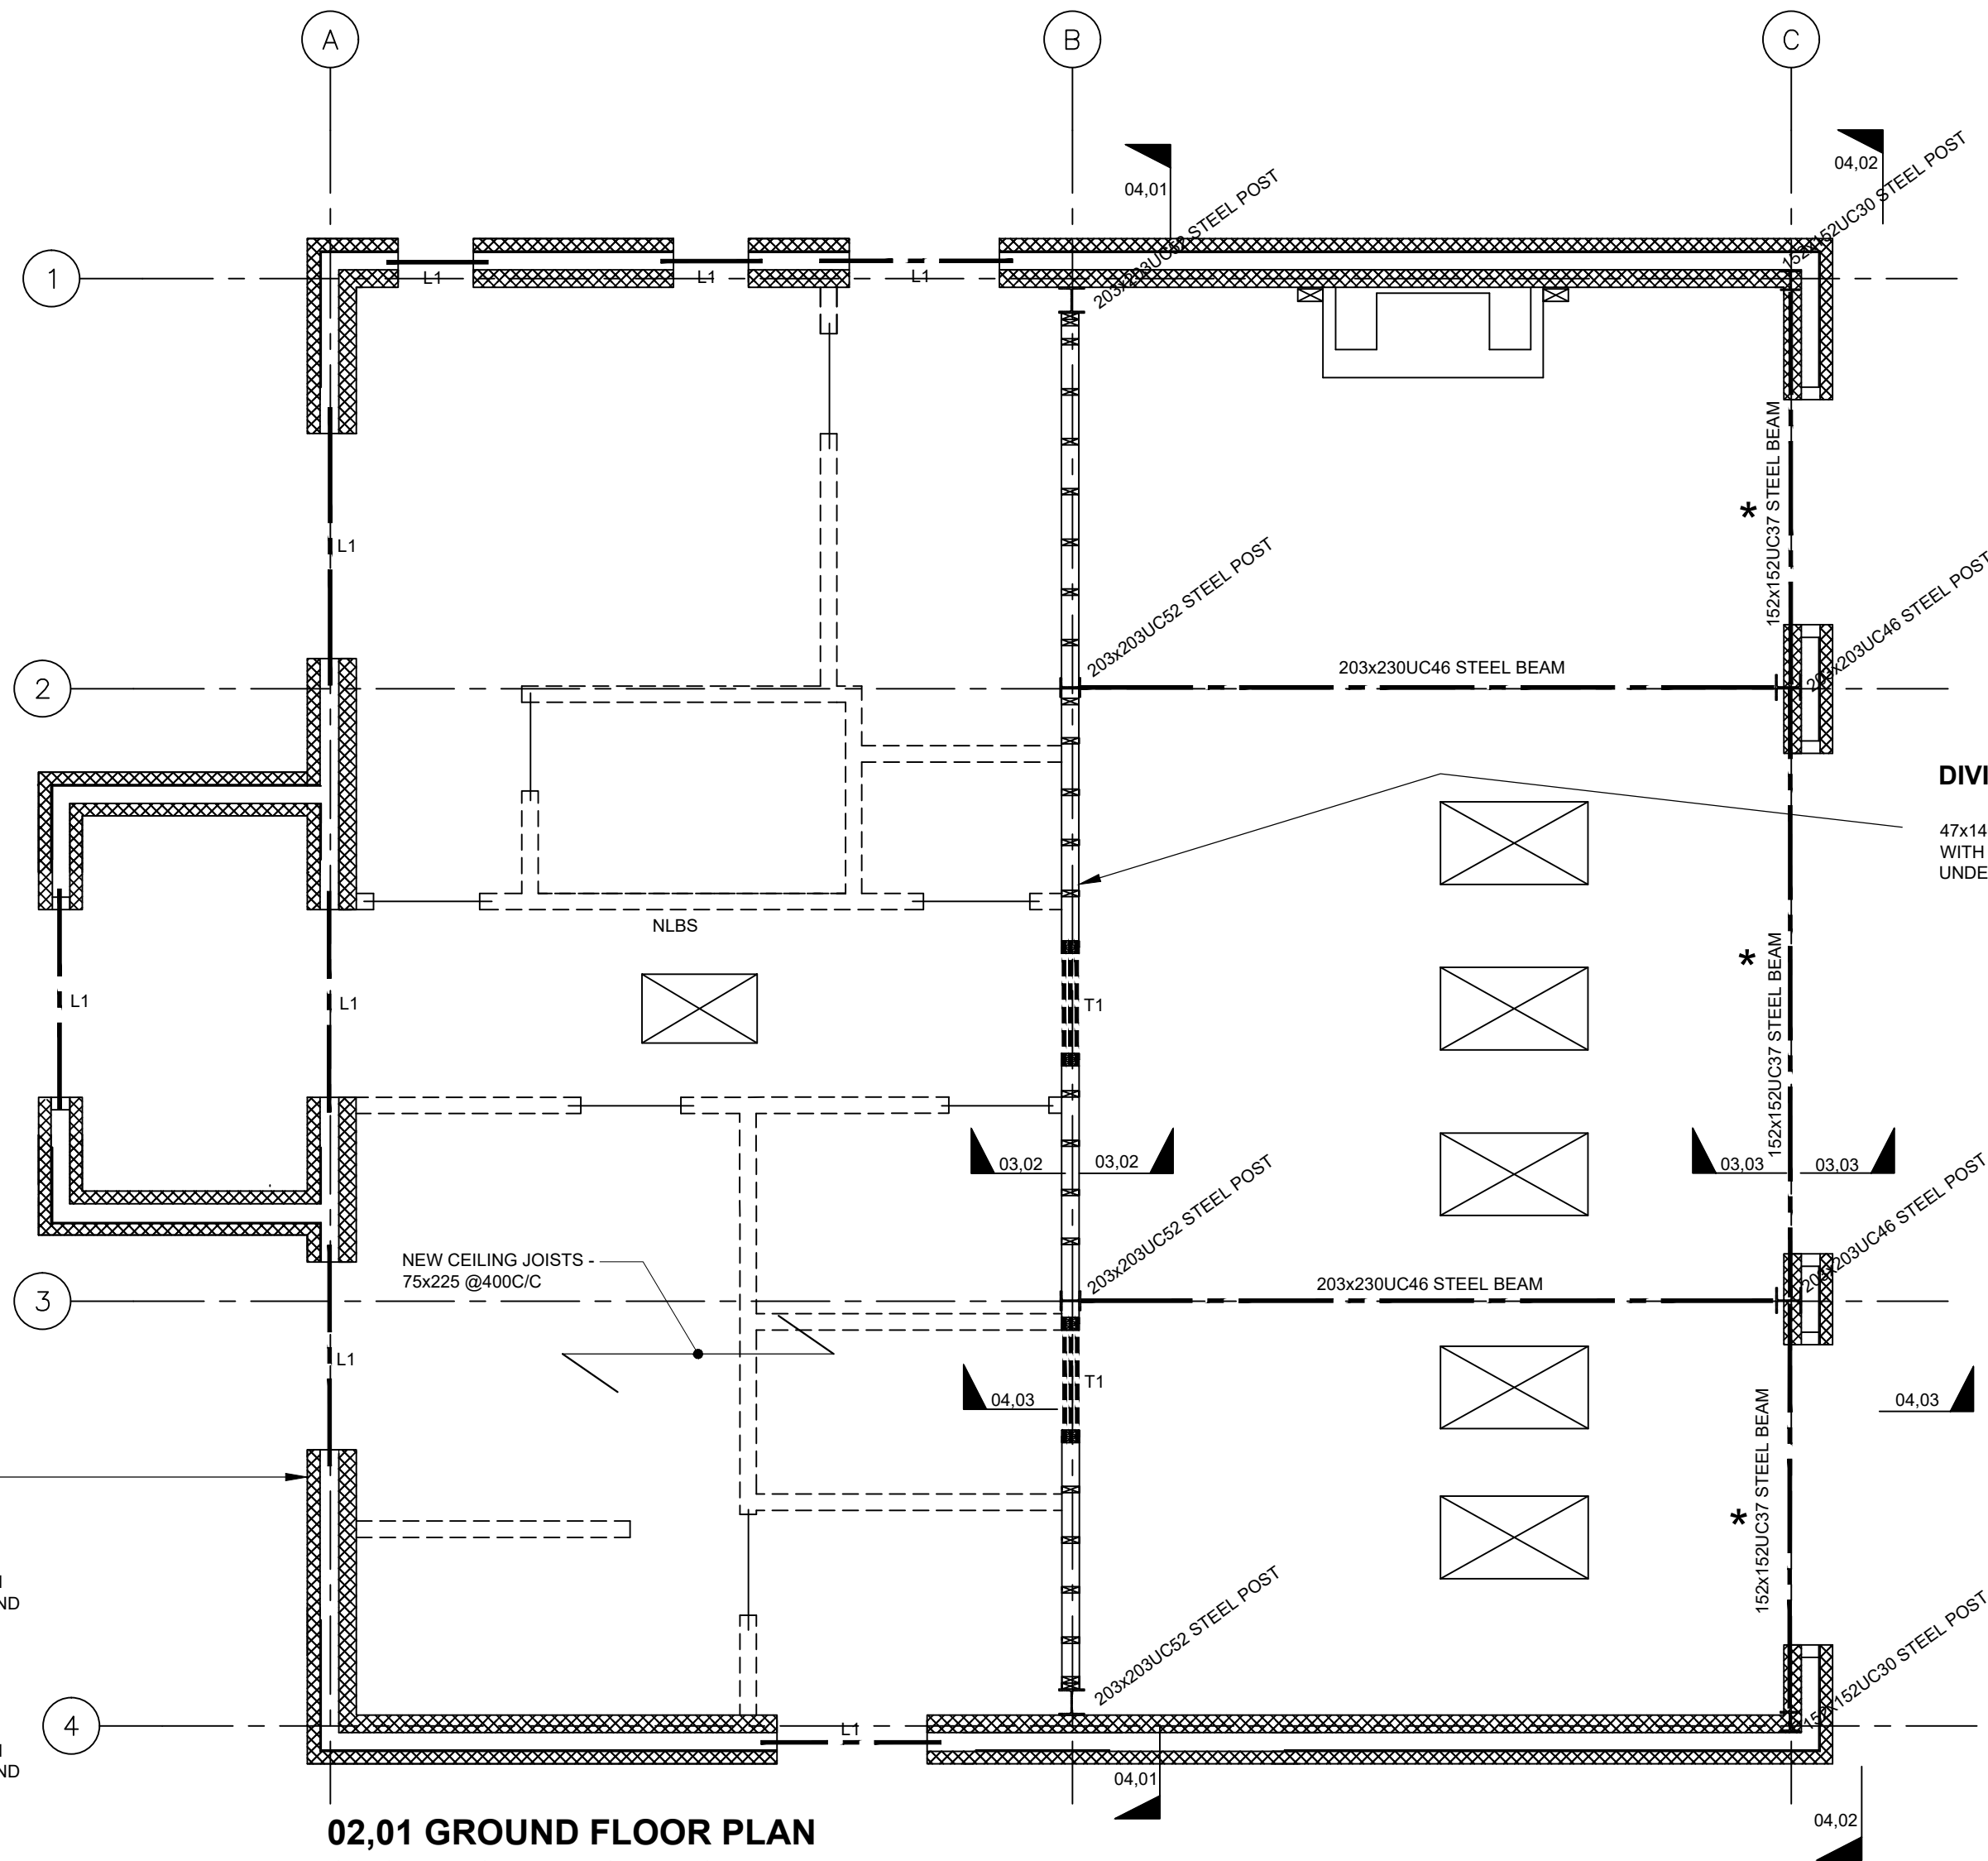

**WALL TYPE
(EXTERNAL LOAD
BEARING WALL)**

INNER LEAF
140mm 7.3N CONCRETE BLOCKS IN
CLASS (III) MORTAR ABOVE DPC AND
CLASS (I) MORTAR BELOW

**CAVITY WIDTH TO ARCHITECTS
DETAILS**

OUTER LEAF
100mm 7.3N CONCRETE BLOCKS IN
CLASS (III) MORTAR ABOVE DPC AND
CLASS (I) MORTAR BELOW

**02,01 GROUND FLOOR PLAN
SHOWING NEW STRUCTURE
ABOVE**

SCALE 1:50

TEMPORARY WORKS TO
MAIN CONTRACTORS
METHOD STATEMENT

DO NOT DIRECTLY SCALE
FROM THIS DRAWING.
USE SITE DIMENSIONS
FOR SETTING OUT AND
ARCHITECTS DRAWINGS

HOT DIP GALV BEAMS**

ALL WORK MUST COMPLY WITH THE
CONSTRUCTION (DESIGN AND MANAGEMENT)
REGULATIONS 2015 (CDM 2015)

NOTE DRAWINGS AND CALCULATIONS
ARE ONLY TO COVER PART A OF THE BUILDING
REGULATIONS - ELLIS STRUCTURES HAVE NOT
BEEN APPOINTED AS THE PRINCIPAL DESIGNER
CONTACT OTHERS FOR THIS ROLE

**OPEN BACK CAVITY
LINTELS**

L1 = CG150/125 BY CATNIC OR SIMILAR
(MIN 150mm END BEARING)

TIMBER MEMBERS

NLBS = WHERE DASHED WALLS
SHOWN BUILD NEW 47x97C24 TIMBER
NON LOAD BEARING STUD WALLS
@400C/C - FOR ALL OPENINGS MAX
SPAN 900mm APPLY 2No 47x97 C24
TIMBERS BOLTED WITH TIMBER LOK
SCREW BOLTS @ 300C/C FOR LINTEL

T1 = 3No NEW 47x195 C24 TIMBERS
BOLTED WITH TIMBER LOK SCREW
BOLTS @300C/C

