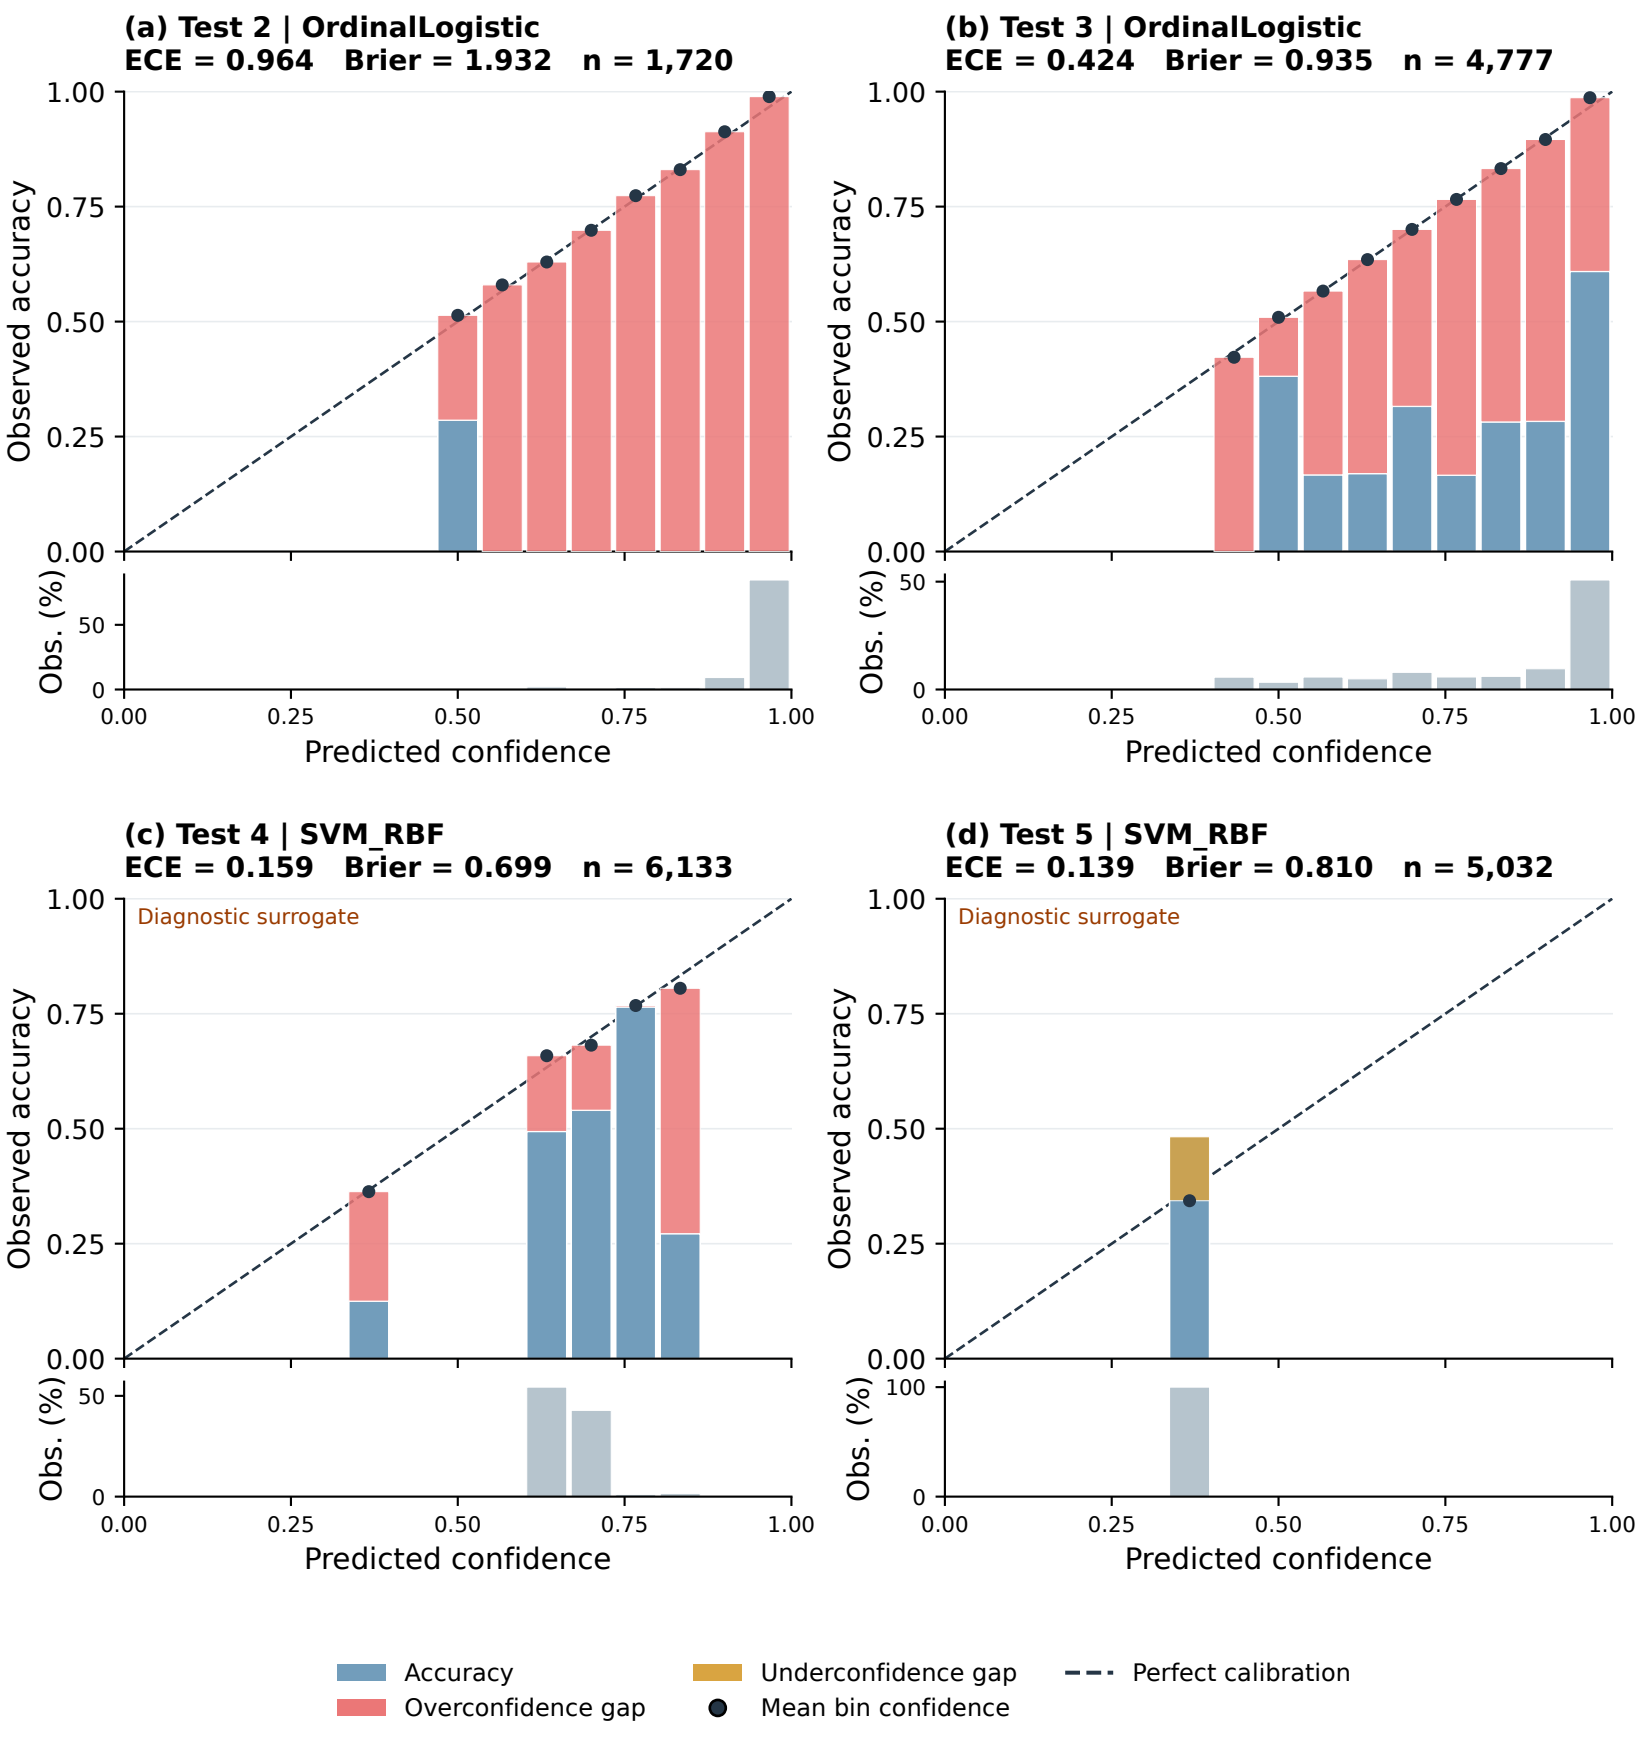
TPH + Spectral | Before calibration
(a) Test 2 | OrdinalLogistic
ECE = 0.964 Brier = 1.932 n = 1,720
(b) Test 3 | OrdinalLogistic
ECE = 0.424 Brier = 0.935 n = 4,777
(c) Test 4 | SVM_RBF
ECE = 0.159 Brier = 0.699 n = 6,133
Diagnostic surrogate
(d) Test 5 | SVM_RBF
ECE = 0.139 Brier = 0.810 n = 5,032
Diagnostic surrogate
Observed accuracy
Obs. (%)
Predicted confidence
Accuracy
Overconfidence gap
Underconfidence gap
Mean bin confidence
Perfect calibration