Chapter 23 HEAT EXCHANGERS

Types of Heat Exchangers

23-1C Heat exchangers are classified according to the flow type as parallel flow, counter flow, and cross-flow arrangement. In parallel flow, both the hot and cold fluids enter the heat exchanger at the same end and move in the same direction. In counter-flow, the hot and cold fluids enter the heat exchanger at opposite ends and flow in opposite direction. In cross-flow, the hot and cold fluid streams move perpendicular to each other.


23-2C In terms of construction type, heat exchangers are classified as compact, shell and tube and regenerative heat exchangers. Compact heat exchangers are specifically designed to obtain large heat transfer surface areas per unit volume. The large surface area in compact heat exchangers is obtained by attaching closely spaced thin plate or corrugated fins to the walls separating the two fluids. Shell and tube heat exchangers contain a large number of tubes packed in a shell with their axes parallel to that of the shell. Regenerative heat exchangers involve the alternate passage of the hot and cold fluid streams through the same flow area. In compact heat exchangers, the two fluids usually move perpendicular to each other.

23-3C A heat exchanger is classified as being compact if $\beta > 700 \text{ m}^2/\text{m}^3$ or $(200 \text{ ft}^2/\text{ft}^3)$ where β is the ratio of the heat transfer surface area to its volume which is called the area density. The area density for double-pipe heat exchanger can not be in the order of 700. Therefore, it can not be classified as a compact heat exchanger.


23-4C In counter-flow heat exchangers, the hot and the cold fluids move parallel to each other but both enter the heat exchanger at opposite ends and flow in opposite direction. In cross-flow heat exchangers, the two fluids usually move perpendicular to each other. The cross-flow is said to be unmixed when the plate fins force the fluid to flow through a particular interfin spacing and prevent it from moving in the transverse direction. When the fluid is free to move in the transverse direction, the cross-flow is said to be mixed.

23-5C In the shell and tube exchangers, baffles are commonly placed in the shell to force the shell side fluid to flow across the shell to enhance heat transfer and to maintain uniform spacing between the tubes. Baffles disrupt the flow of fluid, and an increased pumping power will be needed to maintain flow. On the other hand, baffles eliminate dead spots and increase heat transfer rate.

23-6C Using six-tube passes in a shell and tube heat exchanger increases the heat transfer surface area, and the rate of heat transfer increases. But it also increases the manufacturing costs.



23-7C Using so many tubes increases the heat transfer surface area which in turn increases the rate of heat transfer.



23-8C Regenerative heat exchanger involves the alternate passage of the hot and cold fluid streams through the same flow area. The static type regenerative heat exchanger is basically a porous mass which has a large heat storage capacity, such as a ceramic wire mash. Hot and cold fluids flow through this porous mass alternately. Heat is transferred from the hot fluid to the matrix of the regenerator during the flow of the hot fluid and from the matrix to the cold fluid. Thus the matrix serves as a temporary heat storage medium. The dynamic type regenerator involves a rotating drum and continuous flow of the hot and cold fluid through different portions of the drum so that any portion of the drum passes periodically through the hot stream, storing heat and then through the cold stream, rejecting this stored heat. Again the drum serves as the medium to transport the heat from the hot to the cold fluid stream.

The Overall Heat Transfer Coefficient

23-9C Heat is first transferred from the hot fluid to the wall by convection, through the wall by conduction and from the wall to the cold fluid again by convection.

23-10C When the wall thickness of the tube is small and the thermal conductivity of the tube material is high, which is usually the case, the thermal resistance of the tube is negligible.

23-11C The heat transfer surface areas are $A_j = \pi D_1 L$ and $A_o = \pi D_2 L$. When the thickness of inner tube is small, it is reasonable to assume $A_j \cong A_o \cong A_s$.

23-12C No, it is not reasonable to say $h_i \approx h_0 \approx h$

23-13C When the wall thickness of the tube is small and the thermal conductivity of the tube material is high, the thermal resistance of the tube is negligible and the inner and the outer surfaces of the tube are almost identical ($A_i \cong A_o \cong A_s$). Then the overall heat transfer coefficient of a heat exchanger can be determined to from $U = (1/k_1 + 1/k_0)^{-1}$

23-14C None.

23-15C When one of the convection coefficients is much smaller than the other $h_j \ll h_o$, and $A_j \approx A_0 \approx A_s$. Then we have $(1/h_j >> 1/h_o)$ and thus $U_j = U_0 = U \cong h_j$.

23-16C The most common type of fouling is the precipitation of solid deposits in a fluid on the heat transfer surfaces. Another form of fouling is corrosion and other chemical fouling. Heat exchangers may also be fouled by the growth of algae in warm fluids. This type of fouling is called the biological fouling. Fouling represents additional resistance to heat transfer and causes the rate of heat transfer in a heat exchanger to decrease, and the pressure drop to increase.

23-17C The effect of fouling on a heat transfer is represented by a fouling factor R_i . Its effect on the heat transfer coefficient is accounted for by introducing a thermal resistance R_i/A_s . The fouling increases with increasing temperature and decreasing velocity.

23-18 The heat transfer coefficients and the fouling factors on tube and shell side of a heat exchanger are given. The thermal resistance and the overall heat transfer coefficients based on the inner and outer areas are to be determined.

Assumptions 1 The heat transfer coefficients and the fouling factors are constant and uniform.

Analysis (a) The total thermal resistance of the heat exchanger per unit length is

$$R = \frac{1}{h_{i}A_{i}} + \frac{R_{fi}}{A_{i}} + \frac{\ln(D_{o}/D_{i})}{2\pi kL} + \frac{R_{fo}}{A_{o}} + \frac{1}{h_{o}A_{o}}$$


$$R = \frac{1}{(700 \text{ W/m}^{2}.^{\circ}\text{C})[\pi(0.012 \text{ m})(1 \text{ m})]} + \frac{(0.0005 \text{ m}^{2}.^{\circ}\text{C/W})}{[\pi(0.012 \text{ m})(1 \text{ m})]} + \frac{\ln(1.6/1.2)}{2\pi(380 \text{ W/m}.^{\circ}\text{C})(1 \text{ m})} + \frac{(0.0002 \text{ m}^{2}.^{\circ}\text{C/W})}{[\pi(0.016 \text{ m})(1 \text{ m})]} + \frac{1}{(700 \text{ W/m}^{2}.^{\circ}\text{C})[\pi(0.016 \text{ m})(1 \text{ m})]} = 0.0837^{\circ}\text{C/W}$$

(D) The overall heat transfer coefficient based on the inner and the outer surface areas of the tube per length are

$$R = \frac{1}{UA} = \frac{1}{U_{i}A_{i}} = \frac{1}{U_{o}A_{o}}$$

$$U_{i} = \frac{1}{RA_{i}} = \frac{1}{(0.0837 \text{ °C/W})[\pi(0.012 \text{ m})(1 \text{ m})]} = 317 \text{ W/m}^{2}.\text{°C}$$

$$U_{o} = \frac{1}{RA_{o}} = \frac{1}{(0.0837 \text{ °C/W})[\pi(0.016 \text{ m})(1 \text{ m})]} = 238 \text{ W/m}^{2}.\text{°C}$$



23-19

"GIVEN"

k=380 "[W/m-C], parameter to be varied"

D_i=0.012 "[m]"

D_o=0.016 "[m]"

D_2=0.03 "[m]"

h_i=700 "[W/m^2-C], parameter to be varied"

h_o=1400 "[W/m^2-C], parameter to be varied"

R_f_i=0.0005 "[m^2-C/W]"

R_f_o=0.0002 "[m^2-C/W]"

"ANALYSIS"

 $R = 1/(h_i^*A_i) + R_f_i/A_i + \ln(D_o/D_i)/(2^*p_i^*k^*L) + R_f_o/A_o + 1/(h_o^*A_o)$

L=1 "[m], a unit length of the heat exchanger is considered"

A_i=pi*D_i*L


A_o=pi*D_o*L

1 5777/ 61	D ICAN
k [W/m-C]	R [C/W]
10	0.07392
30.53	0.07085
51.05	0.07024
71.58	0.06999
92.11	0.06984
112.6	0.06975
133.2	0.06969
153.7	0.06964
174.2	0.06961
194.7	0.06958
215.3	0.06956
235.8	0.06954
256.3	0.06952
276.8	0.06951
297.4	0.0695
317.9	0.06949
338.4	0.06948
358.9	0.06947
379.5	0.06947
400	0.06946


Chap 23 *Heat Exchangers*

h _i [W/m ² -C]	R [C/W]
500	0.08462
550	0.0798
600	0.07578
650	0.07238
700	0.06947
750	0.06694
800	0.06473
850	0.06278
900	0.06105
950	0.05949
1000	0.0581
1050	0.05684
1100	0.05569
1150	0.05464
1200	0.05368
1250	0.05279
1300	0.05198
1350	0.05122
1400	0.05052
1450	0.04987
1500	0.04926

$h_o [W/m^2-C]$	R [C/W]
1000	0.07515
1050	0.0742
1100	0.07334
1150	0.07256
1200	0.07183
1250	0.07117
1300	0.07056
1350	0.06999
1400	0.06947
1450	0.06898
1500	0.06852
1550	0.06809
1600	0.06769
1650	0.06731
1700	0.06696
1750	0.06662
1800	0.06631
1850	0.06601
1900	0.06573
1950	0.06546
2000	0.0652

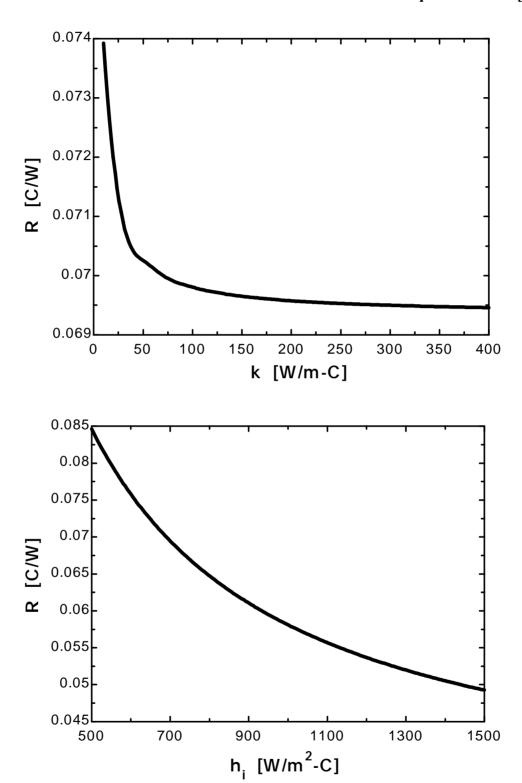



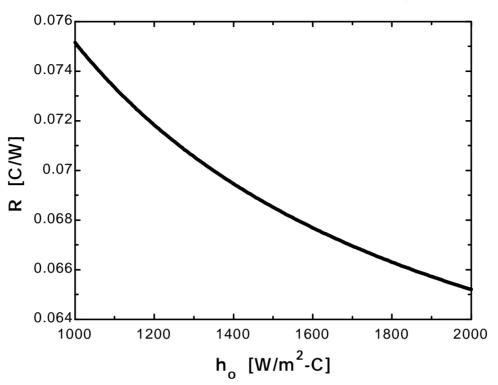

23-20 Water flows through the tubes in a boiler. The overall heat transfer coefficient of this boiler based on the inner surface area is to be determined.

Assumptions 1 Water flow is fully developed. **2** Properties of the water are constant.

Properties The properties of water at 110°C are (Table A-15)

$$v = \mu / \rho = 0.268 \times 10^{-6} \text{ m}^2/\text{s}$$

 $\ell = 0.682 \text{ W/m}^2 \text{.K}$
 $\ell = 1.58$

Analysis The Reynolds number is

Re =
$$\frac{V_m D_h}{v}$$
 = $\frac{(3.5 \text{ m/s})(0.01 \text{ m})}{0.268 \times 10^{-6} \text{ m}^2/\text{s}}$ = 130,600

which is greater than 4000. Therefore, the flow is turbulent. Assuming fully developed flow,

$$Nu = \frac{hD_h}{h} = 0.023 \text{Re}^{0.8} \text{Pr}^{0.4} = 0.023(130,600)^{0.8} (1.58)^{0.4} = 342$$

and
$$h = \frac{k}{D_h} Mu = \frac{0.682 \text{ W/m.}^{\circ}\text{C}}{0.01 \text{ m}} (342) = 23,324 \text{ W/m}^{2}.^{\circ}\text{C}$$

The total resistance of this heat exchanger is then determined from


$$R = R_{total} = R_{j} + R_{wall} + R_{o} = \frac{1}{h_{j}A_{j}} + \frac{\ln(D_{o}/D_{j})}{2\pi kL} + \frac{1}{h_{o}A_{o}}$$

$$= \frac{1}{(23,324 \text{ W/m}^{2}.^{\circ}\text{C})[\pi(0.01 \text{ m})(5 \text{ m})]} + \frac{\ln(1.4/1)}{[2\pi(14.2 \text{ W/m}.^{\circ}\text{C})(5 \text{ m})]}$$

$$+ \frac{1}{(8400 \text{ W/m}^{2}.^{\circ}\text{C})[\pi(0.014 \text{ m})(5 \text{ m})]}$$

$$= 0.00157^{\circ}\text{C/W}$$

and
$$R = \frac{1}{U_j A_j} \longrightarrow U_j = \frac{1}{RA_j} = \frac{1}{(0.00157^{\circ}\text{C/W})[\pi(0.01\,\text{m})(5\,\text{m})]} = 4055\,\text{W/m}^2.^{\circ}\text{C}$$



23-21 Water is flowing through the tubes in a boiler. The overall heat transfer coefficient of this boiler based on the inner surface area is to be determined.

Assumptions 1 Water flow is fully developed. **2** Properties of water are constant. **3** The heat transfer coefficient and the fouling factor are constant and uniform.

Properties The properties of water at 110°C are (Table A-15)

$$v = \mu / \rho = 0.268 \times 10^{-6} \text{ m}^2/\text{s}$$

 $\ell = 0.682 \text{ W/m}^2.\text{K}$
 $\text{Pr} = 1.58$

Analysis The Reynolds number is

Re =
$$\frac{V_m D_h}{v}$$
 = $\frac{(3.5 \text{ m/s})(0.01 \text{ m})}{0.268 \times 10^{-6} \text{ m}^2/\text{s}}$ = 130,600

which is greater than 4000. Therefore, the flow is turbulent. Assuming fully developed flow,

Outer surface
$$D_{a} A_{b} h_{a} U_{0}, R_{l0}$$
Inner surface
$$D_{b} A_{b} h_{b} U_{l}, R_{ll}$$

$$N_{\text{W}} = \frac{hD_{h}}{h} = 0.023 \text{Re}^{0.8} \text{Pr}^{0.4} = 0.023(130,600)^{0.8} (1.58)^{0.4} = 342$$

$$h = \frac{k}{D_h} Nu = \frac{0.682 \text{ W/m.}^{\circ}\text{C}}{0.01 \text{ m}} (342) = 23,324 \text{ W/m}^{2}.^{\circ}\text{C}$$

The thermal resistance of heat exchanger with a fouling factor of $R_{f,j} = 0.0005 \text{ m}^2.$ °C/W is determined from

$$R = \frac{1}{h_{i}A_{i}} + \frac{R_{f,i}}{A_{i}} + \frac{\ln(D_{o}/D_{i})}{2\pi kL} + \frac{1}{h_{o}A_{o}}$$

$$R = \frac{1}{(23,324 \text{ W/m}^{2}.^{\circ}\text{C})[\pi(0.01 \text{ m})(5 \text{ m})]} + \frac{0.0005 \text{ m}^{2}.^{\circ}\text{C/W}}{[\pi(0.01 \text{ m})(5 \text{ m})]} + \frac{\ln(1.4/1)}{2\pi(14.2 \text{ W/m}.^{\circ}\text{C})(5 \text{ m})} + \frac{1}{(8400 \text{ W/m}^{2}.^{\circ}\text{C})[\pi(0.014 \text{ m})(5 \text{ m})]} = 0.00476^{\circ}\text{C/W}$$

Then,

$$R = \frac{1}{U_i A_i} \longrightarrow U_i = \frac{1}{RA_i} = \frac{1}{(0.00476^{\circ}\text{C/W})[\pi(0.01\,\text{m})(5\,\text{m})]} = 1337\,\text{W/m}^2.^{\circ}\text{C}$$

23-22

```
"GIVEN"
```

T_w=107 "[C]"
Vel=3.5 "[m/s]"
L=5 "[m]"
k_pipe=14.2 "[W/m-C]"
D_i=0.010 "[m]"
D_0=0.014 "[m]"
h_0=8400 "[W/m^2-C]"

"R_f_i=0.0005 [m^2-C/W], parameter to be varied"

"PROPERTIES"

k=conductivity(Water, T=T_w, P=300) Pr=Prandtl(Water, T=T_w, P=300) rho=density(Water, T=T_w, P=300) mu=viscosity(Water, T=T_w, P=300) nu=mu/rho

"ANALYSIS"

Re=(Vel*D_i)/nu

"Re is calculated to be greater than 4000. Therefore, the flow is turbulent."

Nusselt=0.023*Re^0.8*Pr^0.4


h_i=k/D_i*Nusselt A_i=pi*D_i*L

A_o=pi*D_o*L

 $R=1/(h_i*A_i)+R_f_i/A_i+In(D_o/D_i)/(2*pi*k_pipe*L)+1/(h_o*A_o)$

 $U_i = 1/(R^*A_i)$

$R_{f,i}$ [m ² -C/W]	U _i [W/m ² -C]
0.0001	2883
0.00015	2520
0.0002	2238
0.00025	2013
0.0003	1829
0.00035	1675
0.0004	1546
0.00045	1435
0.0005	1339
0.00055	1255
0.0006	1181
0.00065	1115
0.0007	1056
0.00075	1003
0.0008	955.2

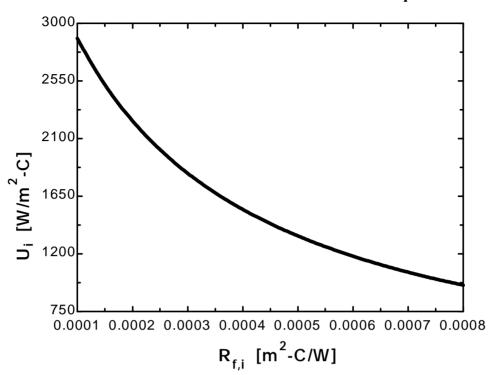

23-23 Refrigerant-134a is cooled by water in a double-pipe heat exchanger. The overall heat transfer coefficient is to be determined.

Assumptions 1 The thermal resistance of the inner tube is negligible since the tube material is highly conductive and its thickness is negligible. **2** Both the water and refrigerant-134a flow are fully developed. **3** Properties of the water and refrigerant-134a are constant.


Properties The properties of water at 20°C are (Table A-15)

$$\rho = 998 \text{ kg/m}^3$$

 $v = \mu / \rho = 1.004 \times 10^{-6} \text{ m}^2/\text{s}$
 $\ell = 0.598 \text{ W/m.}^{\circ}\text{C}$
 $\text{Pr} = 7.01$

Analysis The hydraulic diameter for annular space is

$$D_h = D_o - D_i = 0.025 - 0.01 = 0.015 \text{ m}$$



The average velocity of water in the tube and the Reynolds number are

$$V_{m} = \frac{\hbar \mathbf{w}}{\rho A_{c}} = \frac{\hbar \mathbf{w}}{\rho \left(\pi \frac{D_{o}^{2} - D_{j}^{2}}{4}\right)} = \frac{0.3 \,\text{kg/s}}{(998 \,\text{kg/m}^{3}) \left(\pi \frac{(0.025 \,\text{m})^{2} - (0.01 \,\text{m})^{2}}{4}\right)} = 0.729 \,\text{m/s}$$

Re =
$$\frac{V_{m}D_{h}}{v}$$
 = $\frac{(0.729 \text{ m/s})(0.015 \text{ m})}{1.004 \times 10^{-6} \text{ m}^{2}/\text{s}}$ = 10,890

which is greater than 4000. Therefore flow is turbulent. Assuming fully developed flow,

$$Nu = \frac{hD_h}{h} = 0.023 \text{Re}^{0.8} \text{Pr}^{0.4} = 0.023(10,890)^{0.8}(7.01)^{0.4} = 85.0$$

and

$$h_o = \frac{k}{D_h} Nu = \frac{0.598 \text{ W/m.}^{\circ}\text{C}}{0.015 \text{ m}} (85.0) = 3390 \text{ W/m}^2.^{\circ}\text{C}$$

Then the overall heat transfer coefficient becomes

$$U = \frac{1}{h_i} + \frac{1}{h_o} = \frac{1}{5000 \text{ W/m}^2 \cdot \text{°C}} + \frac{1}{3390 \text{ W/m}^2 \cdot \text{°C}} = 2020 \text{ W/m}^2 \cdot \text{°C}$$

23-24 Refrigerant-134a is cooled by water in a double-pipe heat exchanger. The overall heat transfer coefficient is to be determined.

Assumptions 1 The thermal resistance of the inner tube is negligible since the tube material is highly conductive and its thickness is negligible. **2** Both the water and refrigerant-134a flows are fully developed. **3** Properties of the water and refrigerant-134a are constant. **4** The limestone layer can be treated as a plain layer since its thickness is very small relative to its diameter.


Properties The properties of water at 20°C are (Table A-15)

$$\rho = 998 \text{ kg/m}^3$$
 $v = \mu / \rho = 1.004 \times 10^{-6} \text{ m}^2/\text{s}$
 $\ell = 0.598 \text{ W/m.}^{\circ}\text{C}$
Pr = 7.01

Analysis The hydraulic diameter for annular space is

$$D_h = D_o - D_i = 0.025 - 0.01 = 0.015 \text{ m}$$

The average velocity of water in the tube and the Reynolds number are



which is greater than 4000. Therefore flow is turbulent. Assuming fully developed flow,


$$Nu = \frac{hD_h}{h} = 0.023 \,\text{Re}^{0.8} \,\text{Pr}^{0.4} = 0.023(10,890)^{0.8}(7.01)^{0.4} = 85.0$$

and

$$h_o = \frac{k}{D_h} N_W = \frac{0.598 \text{ W/m.}^{\circ}\text{C}}{0.015 \text{ m}} (85.0) = 3390 \text{ W/m}^{2}.^{\circ}\text{C}$$

Disregarding the curvature effects, the overall heat transfer coefficient is determined to be

$$U = \frac{1}{\frac{1}{h_i} + \left(\frac{L}{h}\right)_{\text{limeston}} + \frac{1}{h_o}} = \frac{1}{5000 \text{ W/m}^2 \cdot \text{°C}} + \frac{0.002 \text{ m}}{1.3 \text{ W/m} \cdot \text{°C}} + \frac{1}{3390 \text{ W/m}^2 \cdot \text{°C}} = 493 \text{ W/m}^2 \cdot \text{°C}$$



23-25

```
"GIVEN"
```

D_i=0.010 "[m]"
D_o=0.025 "[m]"
T_w=20 "[C]"
h_i=5000 "[W/m^2-C]"
m_dot=0.3 "[kg/s]"
"I_limestone=2 [mm]_parame

"L_limestone=2 [mm], parameter to be varied"

k_limestone=1.3 "[W/m-C]"

"PROPERTIES"

k=conductivity(Water, T=T_w, P=100) Pr=Prandtl(Water, T=T_w, P=100) rho=density(Water, T=T_w, P=100) mu=viscosity(Water, T=T_w, P=100) nu=mu/rho

"ANALYSIS"

 $\begin{array}{l} D_h=D_o-D_i\\ Vel=m_dot/(rho^*A_c)\\ A_c=pi^*(D_o^2-D_i^2)/4\\ Re=(Vel^*D_h)/nu \end{array}$


"Re is calculated to be greater than 4000. Therefore, the flow is turbulent."

Nusselt=0.023*Re^0.8*Pr^0.4

h_o=k/D_h*Nusselt

U=1/(1/h_i+(L_limestone*Convert(mm, m))/k_limestone+1/h_o)

L _{limestone} [mm]	U [W/m ² -C]
1	791.4
1.1	746
1.2	705.5
1.3	669.2
1.4	636.4
1.5	606.7
1.6	579.7
1.7	554.9
1.8	532.2
1.9	511.3
2	491.9
2.1	474
2.2	457.3
2.3	441.8
2.4	427.3
2.5	413.7
2.6	400.9
2.7	388.9
2.8	377.6
2.9	367
3	356.9

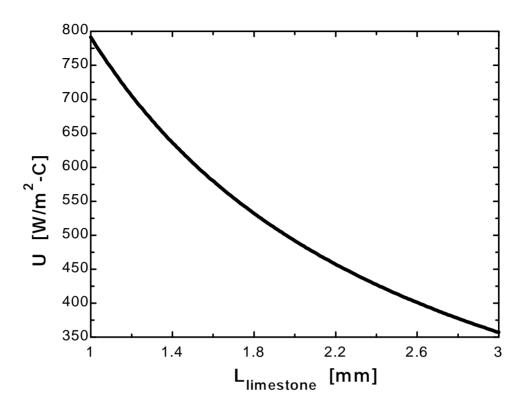

23-26E Water is cooled by air in a cross-flow heat exchanger. The overall heat transfer coefficient is to be determined

Assumptions 1 The thermal resistance of the inner tube is negligible since the tube material is highly conductive and its thickness is negligible. **2** Both the water and air flow are fully developed. **3** Properties of the water and air are constant.

Properties The properties of water at 140°F are (Table A-15E)

$$R = 0.378 \text{ Btu/h.ft.}^{\circ}\text{F}$$


 $v = 5.11 \times 10^{-6} \text{ ft}^{2} / \text{s}$
 $\text{Pr} = 2.98$

The properties of air at 80°F are (Table A-22E)

$$k = 0.0150 \text{ Btu / h. ft.}^{\circ} \text{ F}$$

 $v = 0.17 \times 10^{-3} \text{ ft}^{2} / \text{ s}$
 $v = 0.72$

Analysis The overall heat transfer coefficient can be determined from



$$\frac{1}{U} = \frac{1}{h_i} + \frac{1}{h_o}$$

The Reynolds number of water is

Re =
$$\frac{V_m D_h}{v}$$
 = $\frac{(8 \text{ ft/s})[0.75/12 \text{ ft}]}{5.11 \times 10^{-6} \text{ ft}^2/\text{s}}$ = 97,850

which is greater than 4000. Therefore the flow of water is turbulent. Assuming the flow to be fully developed, the Nusselt number is determined from

$$Nu = \frac{hD_h}{h} = 0.023 \,\text{Re}^{0.8} \,\text{Pr}^{0.4} = 0.023(97,850)^{0.8} (2.98)^{0.4} = 350$$

and

$$h_f = \frac{k}{D_h} N_{tt} = \frac{0.378 \text{ Btu/h.ft.}^{\circ}\text{F}}{0.75/12 \text{ ft}} (350) = 2117 \text{ Btu/h.ft}^{2}.^{\circ}\text{F}$$

The Reynolds number of air is

Re =
$$\frac{V_{\infty}D}{v}$$
 = $\frac{(12 \text{ ft/s})[3/(4 \times 12) \text{ ft}]}{0.17 \times 10^{-3} \text{ ft}^2/\text{s}}$ = 4412

The flow of air is across the cylinder. The proper relation for Nusselt number in this case is

$$Mu = \frac{hD}{h} = 0.3 + \frac{0.62 \operatorname{Re}^{0.5} \operatorname{Pr}^{1/3}}{\left[1 + \left(0.4 / \operatorname{Pr}\right)^{2/3}\right]^{1/4}} \left[1 + \left(\frac{\operatorname{Re}}{282,000}\right)^{5/8}\right]^{4/5}$$
$$= 0.3 + \frac{0.62(4412)^{0.5} (0.729)^{1/3}}{\left[1 + \left(0.4 / 0.729\right)^{2/3}\right]^{1/4}} \left[1 + \left(\frac{4412}{282,000}\right)^{5/8}\right]^{4/5} = 34.8$$

and

$$h_o = \frac{k}{D} N u = \frac{0.01481 \text{Btu/h.ft.} ^\circ \text{F}}{0.75/12 \text{ ft}} (34.8) = 8.25 \text{ Btu/h.ft} ^2. ^\circ \text{F}$$

Then the overall heat transfer coefficient becomes

$$U = \frac{1}{\frac{1}{h_i} + \frac{1}{h_o}} = \frac{1}{\frac{1}{2117 \text{ Btu/h.ft}^2.°F}} + \frac{1}{8.25 \text{ Btu/h.ft}^2.°F} = 8.22 \text{ Btu/h.ft}^2.°F$$

Analysis of Heat Exchangers

23-27C The heat exchangers usually operate for long periods of time with no change in their operating conditions, and then they can be modeled as steady-flow devices. As such, the mass flow rate of each fluid remains constant and the fluid properties such as temperature and velocity at any inlet and outlet remain constant. The kinetic and potential energy changes are negligible. The specific heat of a fluid can be treated as constant in a specified temperature range. Axial heat conduction along the tube is negligible. Finally, the outer surface of the heat exchanger is assumed to be perfectly insulated so that there is no heat loss to the surrounding medium and any heat transfer thus occurs is between the two fluids only.

23-28C That relation is valid under steady operating conditions, constant specific heats, and negligible heat loss from the heat exchanger.

23-29C The product of the mass flow rate and the specific heat of a fluid is called the heat capacity rate and is expressed as $C = \Re C_p$. When the heat capacity rates of the cold and hot fluids are equal, the temperature change is the same for the two fluids in a heat exchanger. That is, the temperature rise of the cold fluid is equal to the temperature drop of the hot fluid. A heat capacity of infinity for a fluid in a heat exchanger is experienced during a phase-change process in a condenser or boiler.

23-30C The mass flow rate of the cooling water can be determined from $\mathcal{E} = (\mathcal{E}_{\mathcal{A}} \mathcal{L})_{\text{cooling water}}$. The rate of condensation of the steam is determined from $\mathcal{E} = (\mathcal{E}_{\mathcal{A}} \mathcal{L})_{\text{steam}}$, and the total thermal resistance of the condenser is determined from $\mathcal{R} = \mathcal{E}_{\mathcal{A}} / \Delta \mathcal{I}$.

23-31C When the heat capacity rates of the cold and hot fluids are identical, the temperature rise of the cold fluid will be equal to the temperature drop of the hot fluid.

The Log Mean Temperature Difference Method

23-32C ΔT_{lm} is called the log mean temperature difference, and is expressed as

$$\Delta T_{lm} = \frac{\Delta T_1 - \Delta T_2}{\ln(\Delta T_1 / \Delta T_2)}$$

where

$$\Delta T_1 = T_{h.in} - T_{c.in}$$
 $\Delta T_2 = T_{h.out} - T_{c.out}$ for parallel-flow heat exchangers and

$$\Delta T = T_{h,in} - T_{c,out}$$
 $\Delta T_2 = T_{h,out} - T_{c,in}$ for counter-flow heat exchangers

23-33C The temperature difference between the two fluids decreases from ΔZ_1 at the inlet to ΔZ_2 at the outlet, and arithmetic mean temperature difference is defined as $\Delta Z_{m} = \frac{\Delta Z_1 + \Delta Z_2}{2}$. The logarithmic mean

temperature difference ΔZ_{lm} is obtained by tracing the actual temperature profile of the fluids along the heat exchanger, and is an exact representation of the average temperature difference between the hot and cold fluids. It truly reflects the exponential decay of the local temperature difference. The logarithmic mean temperature difference is always less than the arithmetic mean temperature.

23-34C ΔZ_{lm} cannot be greater than both ΔZ_1 and ΔZ_2 because ΔZ_{ln} is always less than or equal to ΔZ_m (arithmetic mean) which can not be greater than both ΔZ_1 and ΔZ_2 .

23-35C No, it cannot. When ΔZ_1 is less than ΔZ_2 the ratio of them must be less than one and the natural logarithms of the numbers which are less than 1 are negative. But the numerator is also negative in this case. When ΔZ_1 is greater than ΔZ_2 , we obtain positive numbers at the both numerator and denominator.

23-36C In the parallel-flow heat exchangers the hot and cold fluids enter the heat exchanger at the same end, and the temperature of the hot fluid decreases and the temperature of the cold fluid increases along the heat exchanger. But the temperature of the cold fluid can never exceed that of the hot fluid. In case of the counterflow heat exchangers the hot and cold fluids enter the heat exchanger from the opposite ends and the outlet temperature of the cold fluid may exceed the outlet temperature of the hot fluid.

23-37C The ΔI_{lm} will be greatest for double-pipe counter-flow heat exchangers.

23-38C The factor *F* is called as correction factor which depends on the geometry of the heat exchanger and the inlet and the outlet temperatures of the hot and cold fluid streams. It represents how closely a heat exchanger approximates a counter-flow heat exchanger in terms of its logarithmic mean temperature difference. *F* cannot be greater than unity.

23-39C In this case it is not practical to use the LMTD method because it requires tedious iterations. Instead, the effectiveness-NTU method should be used.

23-40C First heat transfer rate is determined from $\mathcal{P} = \mathcal{P}_{D}[T_{in} - T_{out}]$, ΔT_{ln} from $\Delta T_{lm} = \frac{\Delta T_1 - \Delta T_2}{\ln(\Delta T_1 / \Delta T_2)}$, correction factor from the figures, and finally the surface area of the heat exchanger from $\mathcal{P} = UAFDT_{lm,cf}$

23-41 Steam is condensed by cooling water in the condenser of a power plant. The mass flow rate of the cooling water and the rate of condensation are to be determined.

Assumptions 1 Steady operating conditions exist. **2** The heat exchanger is well-insulated so that heat loss to the surroundings is negligible and thus heat transfer from the hot fluid is equal to the heat transfer to the cold fluid. **3** Changes in the kinetic and potential energies of fluid streams are negligible. **4** There is no fouling. **5** Fluid properties are constant.

Properties The heat of vaporization of water at 50°C is given to be $I_{fg} = 2305$ kJ/kg and specific heat of cold water at the average temperature of 22.5°C is given to be $C_p = 4180$ J/kg.°C.

Analysis The temperature differences between the steam and the cooling water at the two ends of the condenser are

$$\Delta T_1 = T_{h,in} - T_{c,out} = 50^{\circ} \text{ C} - 27^{\circ} \text{ C} = 23^{\circ} \text{ C}$$

 $\Delta T_2 = T_{h,out} - T_{c,in} = 50^{\circ} \text{ C} - 18^{\circ} \text{ C} = 32^{\circ} \text{ C}$


and

$$\Delta T_{lm} = \frac{\Delta T_1 - \Delta T_2}{\ln(\Delta T_1 / \Delta T_2)} = \frac{23 - 32}{\ln(23 / 32)} = 27.3^{\circ} \text{ C}$$

Then the heat transfer rate in the condenser becomes

$$\mathcal{E} = UA_s \Delta T_{lm} = (2400 \,\text{W/m}^2.^{\circ}\text{C})(58 \,\text{m}^2)(27.3^{\circ}\text{C}) = 3800 \,\text{kW}$$

The mass flow rate of the cooling water and the rate of condensation of steam are determined from



$$\mathcal{E} = [\mathcal{E}_{D}(T_{out} - T_{in})]_{\text{cooling water}}$$

$$\mathcal{E}_{\text{cooling water}} = \frac{\mathcal{E}_{D}(T_{out} - T_{in})}{C_{D}(T_{out} - T_{in})} = \frac{3800 \text{ kJ/s}}{(4.18 \text{ kJ/kg.}^{\circ}\text{C})(27^{\circ}\text{C} - 18^{\circ}\text{C})} = 101 \text{kg/s}$$

$$\mathcal{E} = (\mathcal{E}_{D} h_{fg})_{\text{steam}} \longrightarrow \mathcal{E}_{\text{steam}} = \frac{\mathcal{E}_{D}}{h_{fg}} = \frac{3800 \text{ kJ/s}}{2305 \text{ kJ/kg}} = 1.65 \text{ kg/s}$$

23-42 Water is heated in a double-pipe parallel-flow heat exchanger by geothermal water. The required length of tube is to be determined.

Assumptions 1 Steady operating conditions exist. **2** The heat exchanger is well-insulated so that heat loss to the surroundings is negligible and thus heat transfer from the hot fluid is equal to the heat transfer to the cold fluid. **3** Changes in the kinetic and potential energies of fluid streams are negligible. **4** There is no fouling. **5** Fluid properties are constant.

Properties The specific heats of water and geothermal fluid are given to be 4.18 and 4.31 kJ/kg.°C, respectively.

Analysis The rate of heat transfer in the heat exchanger is

$$\mathcal{E} = [\mathcal{E}_{p}(T_{out} - T_{ip})]_{\text{water}} = (0.2 \text{ kg/s})(4.18 \text{ kJ/kg.}^{\circ}\text{C})(60^{\circ}\text{C} - 25^{\circ}\text{C}) = 29.26 \text{ kW}$$

Then the outlet temperature of the geothermal water is determined from

$$\mathcal{E} = [\mathcal{E}_{DC_p}(T_{in} - T_{out})]_{\text{geot.water}} \longrightarrow T_{out} = T_{in} - \mathcal{E}_{DC_p} = 140^{\circ}\text{C} - \frac{29.26 \text{ kW}}{(0.3 \text{ kg/s})(4.31 \text{ kJ/kg.}^{\circ}\text{C})} = 117.4^{\circ}\text{C}$$

The logarithmic mean temperature difference is

$$\Delta T_1 = T_{h,in} - T_{c,in} = 140^{\circ} \text{C} - 25^{\circ} \text{C} = 115^{\circ} \text{C}$$

 $\Delta T_2 = T_{h,out} - T_{c,out} = 117.4^{\circ} \text{C} - 60^{\circ} \text{C} = 57.4^{\circ} \text{C}$


and

$$\Delta T_{lm} = \frac{\Delta T_1 - \Delta T_2}{\ln(\Delta T_1 / \Delta T_2)} = \frac{115 - 57.4}{\ln(115 / 57.4)} = 82.9^{\circ} \text{C}$$

The surface area of the heat exchanger is determined from

Then the length of the tube required becomes

$$A_s = \pi DL \longrightarrow L = \frac{A_s}{\pi D} = \frac{0.642 \text{ m}^2}{\pi (0.008 \text{ m})} = 25.5 \text{ m}$$



23-43

"GIVEN"


 $T_w_{in} = 25 \ "[C]" \\ T_w_{out} = 60 \ "[C]" \\ m_{dot_w} = 0.2 \ "[kg/s]" \\ C_p_w = 4.18 \ "[kJ/kg-C]" \\ T_geo_{in} = 140 \ "C], parameter to be varied" \\ m_{dot_geo} = 0.3 \ "[kg/s], parameter to be varied" \\ C_p_{geo} = 4.31 \ "[kJ/kg-C]" \\ D = 0.008 \ "[m]" \\ U = 0.55 \ "[kW/m^2-C]"$

"ANALYSIS"

T _{geo,in} [C]	L [m]
100	53.73
105	46.81
110	41.62
115	37.56
120	34.27
125	31.54
130	29.24
135	27.26
140	25.54
145	24.04
150	22.7
155	21.51
160	20.45
165	19.48
170	18.61
175	17.81
180	17.08
185	16.4
190	15.78
195	15.21
200	14.67

Chap 23 *Heat Exchangers*

m _{geo} [kg/s]	L [m]
0.1	46.31
0.125	35.52
0.15	31.57
0.175	29.44
0.2	28.1
0.225	27.16
0.25	26.48
0.275	25.96
0.3	25.54
0.325	25.21
0.35	24.93
0.375	24.69
0.4	24.49
0.425	24.32
0.45	24.17
0.475	24.04
0.5	23.92

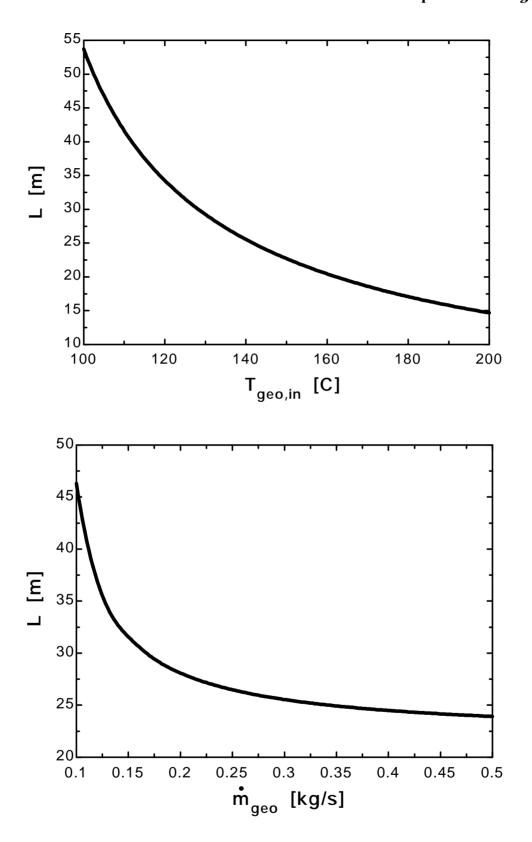

120°F

175°F

Hot Water

140°F

Glycerin

65°F

23-44E Glycerin is heated by hot water in a 1-shell pass and 8-tube passes heat exchanger. The rate of heat transfer for the cases of fouling and no fouling are to be determined.

Assumptions 1 Steady operating conditions exist. **2** The heat exchanger is well-insulated so that heat loss to the surroundings is negligible and thus heat transfer from the hot fluid is equal to the heat transfer to the cold fluid. **3** Changes in the kinetic and potential energies of fluid streams are negligible. **4** Heat transfer coefficients and fouling factors are constant and uniform. **5** The thermal resistance of the inner tube is negligible since the tube is thin-walled and highly conductive.

Properties The specific heats of glycerin and water are given to be 0.60 and 1.0 Btu/lbm.°F, respectively.

Analysis (a) The tubes are thin walled and thus we assume the inner surface area of the tube to be equal to the outer surface area. Then the heat transfer surface area of this heat exchanger becomes

$$A_s = m\pi DL = 8\pi (0.5/12 \text{ ft})(500 \text{ ft}) = 523.6 \text{ ft}^2$$

The temperature differences at the two ends of the heat exchanger are

and
$$\Delta T_1 = T_{h,in} - T_{c,out} = 175^{\circ} F - 140^{\circ} F = 35^{\circ} F$$

$$\Delta T_2 = T_{h,out} - T_{c,in} = 120^{\circ} F - 65^{\circ} F = 55^{\circ} F$$

$$\Delta T_{lm,CF} = \frac{\Delta T_1 - \Delta T_2}{\ln(\Delta T_1 / \Delta T_2)} = \frac{35 - 55}{\ln(35 / 55)} = 44.25^{\circ} F$$


The correction factor is

$$P = \frac{t_2 - t_1}{T_1 - t_1} = \frac{120 - 175}{65 - 175} = 0.5$$

$$R = \frac{T_1 - T_2}{t_2 - t_1} = \frac{65 - 140}{120 - 175} = 1.36$$

$$F = 0.70$$

In case of no fouling, the overall heat transfer coefficient is determined from



Then the rate of heat transfer becomes

$$\partial \!\!\!/ = UA_s F\Delta T_{lm,CF} = (3.7 \text{ Btu/h.ft}^2.\text{°F})(523.6 \text{ ft}^2)(0.70)(44.25\text{°F}) = 60,000 \text{ Btu/h}$$

(1) The thermal resistance of the heat exchanger with a fouling factor is

$$R = \frac{1}{h_{i}A_{i}} + \frac{R_{fi}}{A_{i}} + \frac{1}{h_{o}A_{o}}$$

$$= \frac{1}{(50 \text{ Btu/h.ft}^{2}.^{\circ}\text{F})(523.6 \text{ ft}^{2})} + \frac{0.002 \text{ h.ft}^{2}.^{\circ}\text{F/Btu}}{523.6 \text{ ft}^{2}} + \frac{1}{(4 \text{ Btu/h.ft}^{2}.^{\circ}\text{F})(523.6 \text{ ft}^{2})}$$

$$= 0.0005195 \text{ h.}^{\circ}\text{F/Btu}$$

The overall heat transfer coefficient in this case is

$$R = \frac{1}{UA_s} \longrightarrow U = \frac{1}{RA_s} = \frac{1}{(0.0005195 \text{ h.}^{\circ}\text{F/Btu})(523.6 \text{ ft}^2)} = 3.68 \text{ Btu/h.ft}^2.^{\circ}\text{F}$$

Then rate of heat transfer becomes

$$\mathcal{E} = UA_s F \Delta T_{lm,CF} = (3.68 \text{ Btu/h.ft}^2.\text{°F})(523.6 \text{ ft}^2)(0.70)(44.25\text{°F}) = 59,680 \text{ Btu/h}$$

23-45 During an experiment, the inlet and exit temperatures of water and oil and the mass flow rate of water are measured. The overall heat transfer coefficient based on the inner surface area is to be determined.

Assumptions 1 Steady operating conditions exist. **2** The heat exchanger is well-insulated so that heat loss to the surroundings is negligible and thus heat transfer from the hot fluid is equal to the heat transfer to the cold

fluid. 3 Changes in the kinetic and potential energies of fluid streams are negligible. 4 Fluid properties are constant

Properties The specific heats of water and oil are given to be 4180 and 2150 J/kg.°C, respectively.

Analysis The rate of heat transfer from the oil to the water is

$$\mathcal{D} = [\mathcal{D}_{n}C_{n}(T_{out} - T_{in})]_{\text{water}} = (5 \text{ kg/s})(4.18 \text{ kJ/kg.}^{\circ}\text{C})(55^{\circ}\text{C} - 20^{\circ}\text{C}) = 731.5 \text{ kW}$$

The heat transfer area on the tube side is

$$A_i = I \pi D_i L = 24 \pi (0.012 \text{ m})(2 \text{ m}) = 1.8 \text{ m}^2$$

The logarithmic mean temperature difference for counterflow arrangement and the correction factor F are


$$\Delta T_{1} = T_{h,in} - T_{c,out} = 120^{\circ} \text{C} - 55^{\circ} \text{C} = 65^{\circ} \text{C}$$

$$\Delta T_{2} = T_{h,out} - T_{c,in} = 45^{\circ} \text{C} - 20^{\circ} \text{C} = 25^{\circ} \text{C}$$

$$\Delta T_{lm,CF} = \frac{\Delta T_{1} - \Delta T_{2}}{\ln(\Delta T_{1} / \Delta T_{2})} = \frac{65 - 25}{\ln(65 / 25)} = 41.9^{\circ} \text{C}$$

$$P = \frac{C_{2} - C_{1}}{T_{1} - C_{1}} = \frac{55 - 20}{120 - 20} = 0.35$$

$$R = \frac{T_{1} - T_{2}}{C_{2} - C_{1}} = \frac{120 - 45}{55 - 20} = 2.14$$



Then the overall heat transfer coefficient becomes

$$\mathcal{E} = U_{j} A_{j} F \Delta T_{lm,CF} \longrightarrow U_{j} = \underbrace{\mathcal{E}}_{A_{j} F \Delta} T_{lm,CF} = \underbrace{731.5 \text{ kW}}_{(1.8 \text{ m}^{2})(0.70)(41.9^{\circ}\text{C})} = 13.9 \text{ kW/m}^{2}.^{\circ}\text{C}$$

23-46 Ethylene glycol is cooled by water in a double-pipe counter-flow heat exchanger. The rate of heat transfer, the mass flow rate of water, and the heat transfer surface area on the inner side of the tubes are to be determined.


Assumptions 1 Steady operating conditions exist. **2** The heat exchanger is well-insulated so that heat loss to the surroundings is negligible and thus heat transfer from the hot fluid is equal to the heat transfer to the cold fluid. **3** Changes in the kinetic and potential energies of fluid streams are negligible. **4** There is no fouling. **5** Fluid properties are constant.

Properties The specific heats of water and ethylene glycol are given to be 4.18 and 2.56 kJ/kg.°C, respectively.

Analysis(a) The rate of heat transfer is

$$\mathcal{E} = [\mathbf{A} C_p (T_{in} - T_{out})]_{\text{glycol}}$$
= (3.5 kg/s)(2.56 kJ/kg.°C)(80°C - 40°C)
= **358.4 kW**

(1) The rate of heat transfer from water must be equal to the rate of heat transfer to the glycol. Then,



$$\mathcal{B} = [\mathcal{B}_{\alpha}C_{p}(T_{out} - T_{in})]_{\text{water}} \longrightarrow \mathcal{B}_{\text{water}} = \underbrace{\frac{\mathcal{B}_{\alpha}}{C_{p}(T_{out} - T_{in})}}_{358.4 \text{ kJ/s}} = \underbrace{\frac{358.4 \text{ kJ/s}}{(4.18 \text{ kJ/kg.}^{\circ}\text{C})(55^{\circ}\text{C} - 20^{\circ}\text{C})}}_{= 2.45 \text{ kg/s}} = 2.45 \text{ kg/s}$$

(c) The temperature differences at the two ends of the heat exchanger are

$$\Delta T_1 = T_{h,in} - T_{c,out} = 80^{\circ} \,\mathrm{C} - 55^{\circ} \,\mathrm{C} = 25^{\circ} \,\mathrm{C}$$

 $\Delta T_2 = T_{h,out} - T_{c,in} = 40^{\circ} \,\mathrm{C} - 20^{\circ} \,\mathrm{C} = 20^{\circ} \,\mathrm{C}$

and

$$\Delta T_{lm} = \frac{\Delta T_1 - \Delta T_2}{\ln(\Delta T_1 / \Delta T_2)} = \frac{25 - 20}{\ln(25 / 20)} = 22.4^{\circ} \text{C}$$

Then the heat transfer surface area becomes

$$b = U_j A_j \Delta T_{lm} \longrightarrow A_j = 0$$

$$U_j \Delta T_{lm} = 0$$

$$(0.25 \text{ kW/m}^2 \cdot \text{°C})(22.4 \text{°C}) = 64.0 \text{ m}^2$$

23-47 Water is heated by steam in a double-pipe counter-flow heat exchanger. The required length of the tubes is to be determined.

Assumptions 1 Steady operating conditions exist. **2** The heat exchanger is well-insulated so that heat loss to the surroundings is negligible and thus heat transfer from the hot fluid is equal to the heat transfer to the cold fluid. **3** Changes in the kinetic and potential energies of fluid streams are negligible. **4** There is no fouling. **5** Fluid properties are constant.

Properties The specific heat of water is given to be 4.18 kJ/kg.°C. The heat of condensation of steam at 120°C is given to be 2203 kJ/kg.

Analysis The rate of heat transfer is


$$\mathcal{E} = [\mathcal{E}_{D}C_{p}(T_{out} - T_{in})]_{\text{water}}$$
= $(3 \text{ kg/s})(4.18 \text{ kJ/kg.}^{\circ}\text{C})(80^{\circ}\text{C} - 17^{\circ}\text{C})$
= 790.02 kW

The logarithmic mean temperature difference is

$$\Delta I_1 = I_{h,in} - I_{c,out} = 120^{\circ} \,\text{C} - 80^{\circ} \,\text{C} = 40^{\circ} \,\text{C}$$

 $\Delta I_2 = I_{h,in} - I_{c,in} = 120^{\circ} \,\text{C} - 17^{\circ} \,\text{C} = 103^{\circ} \,\text{C}$

$$\Delta T_{lm} = \frac{\Delta T_1 - \Delta T_2}{\ln(\Delta T_1 / \Delta T_2)} = \frac{40 - 103}{\ln(40 / 103)} = 66.6^{\circ} \text{C}$$



The heat transfer surface area is

$$\mathcal{E} = U_i A_i \Delta T_{lm} \longrightarrow A_i = \underbrace{\mathcal{E}}_{U_i \Delta T_{lm}} = \underbrace{790.02 \text{ kW}}_{(15 \text{ kW/m}^2.^{\circ}\text{C})(66.6^{\circ}\text{C})} = 7.9 \text{ m}^2$$

Then the length of tube required becomes

$$A_j = \pi D_j L \longrightarrow L = \frac{A_j}{\pi D_j} = \frac{7.9 \text{ m}^2}{\pi (0.025 \text{ m})} = 100.6 \text{ m}$$

23-48 Oil is cooled by water in a thin-walled double-pipe counter-flow heat exchanger. The overall heat transfer coefficient of the heat exchanger is to be determined.


Assumptions 1 Steady operating conditions exist. 2 The heat exchanger is well-insulated so that heat loss to the surroundings is negligible and thus heat transfer from the hot fluid is equal to the heat transfer to the cold fluid. 3 Changes in the kinetic and potential energies of fluid streams are negligible. 4 There is no fouling. 5 Fluid properties are constant. 6 The thermal resistance of the inner tube is negligible since the tube is thinwalled and highly conductive.

Properties The specific heats of water and oil are given to be 4.18 and 2.20 kJ/kg.°C, respectively.

Analysis The rate of heat transfer from the water to the oil is

$$\mathcal{E} = [\mathcal{E}_p(T_{in} - T_{out})]_{oil}$$
= $(2 \text{ kg/s})(2.2 \text{ kJ/kg.}^\circ\text{C})(150^\circ\text{C} - 40^\circ\text{C})$
= 484 kW

The outlet temperature of the water is determined from



$$\mathcal{E} = [\mathbf{k} C_p (T_{out} - T_{in})]_{\text{water}} \longrightarrow T_{out} = T_{in} + \frac{\mathcal{E}}{\mathbf{k} B C_p}$$

$$= 22^{\circ} \text{C} + \frac{484 \text{ kW}}{(1.5 \text{ kg/s})(4.18 \text{ kJ/kg.°C})} = 99.2^{\circ} \text{C}$$

The logarithmic mean temperature difference is

$$\Delta T_1 = T_{h,in} - T_{c,out} = 150^{\circ} \text{C} - 99.2^{\circ} \text{C} = 50.8^{\circ} \text{C}$$

$$\Delta T_2 = T_{h,out} - T_{c,in} = 40^{\circ} \text{C} - 22^{\circ} \text{C} = 18^{\circ} \text{C}$$

$$\Delta T_{hm} = \frac{\Delta T_1 - \Delta T_2}{\ln(\Delta T_1 / \Delta T_2)} = \frac{50.8 - 18}{\ln(50.8 / 18)} = 31.6^{\circ} \text{C}$$

Then the overall heat transfer coefficient becomes

$$U = A_s \Delta T_{lm} = \frac{484 \text{ kW}}{\pi (0.025 \text{ m})(6 \text{ m})(31.6^{\circ}\text{C})} = 32.5 \text{ kW/m}^2.^{\circ}\text{C}$$

23-49

"GIVEN"

 $\label{eq:total_continuous_cont$


"ANALYSIS"


 $\begin{array}{lll} Q_dot=m_dot_oil^*C_p_oil^*(T_oil_in-T_oil_out) \\ Q_dot=m_dot_w^*C_p_w^*(T_w_out-T_w_in) \\ DELTAT_1=T_oil_in-T_w_out \\ DELTAT_2=T_oil_out-T_w_in \\ DELTAT_Im=(DELTAT_1-DELTAT_2)/In(DELTAT_1/DELTAT_2) \\ Q_dot=U^*A^*DELTAT_Im \\ A=pi^*D^*L \end{array}$

T _{oil,out} [C]	U [kW/m ² -C]
30	53.22
32.5	45.94
35	40.43
37.5	36.07
40	32.49
42.5	29.48
45	26.9
47.5	24.67
50	22.7
52.5	20.96
55	19.4
57.5	18
60	16.73
62.5	15.57
65	14.51
67.5	13.53
70	12.63

Chap 23 *Heat Exchangers*

T _{w,in} [C]	U [kW/m ² -C]
5	20.7
6	21.15
7	21.61
8	22.09
9	22.6
10	23.13
11	23.69
12	24.28
13	24.9
14	25.55
15	26.24
16	26.97
17	27.75
18	28.58
19	29.46
20	30.4
21	31.4
22	32.49
23	33.65
24	34.92
25	36 29

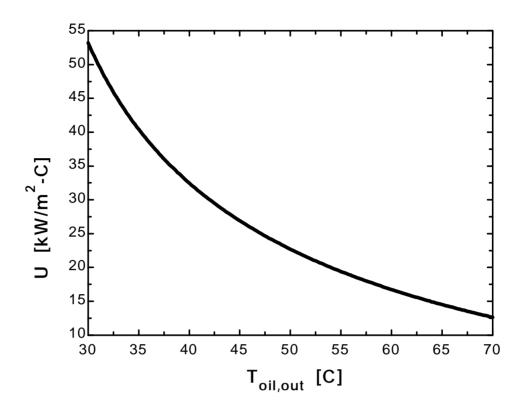

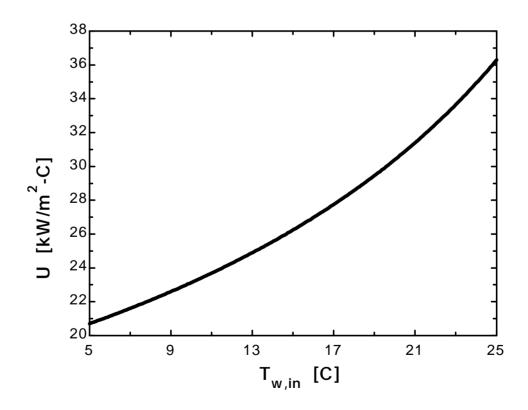

Chap 23 Heat Exchangers

23-50 The inlet and outlet temperatures of the cold and hot fluids in a double-pipe heat exchanger are given. It is to be determined whether this is a parallel-flow or counter-flow heat exchanger.

Analysis In parallel-flow heat exchangers, the temperature of the cold water can never exceed that of the hot fluid. In this case $I_{cold out} = 50$ °C which is greater than $I_{hot out} = 45$ °C. Therefore this must be a counter-flow heat exchanger.


23-51 Cold water is heated by hot water in a double-pipe counter-flow heat exchanger. The rate of heat transfer and the heat transfer surface area of the heat exchanger are to be determined.

Assumptions 1 Steady operating conditions exist. 2 The heat exchanger is well-insulated so that heat loss to the surroundings is negligible and thus heat transfer from the hot fluid is equal to the heat transfer to the cold fluid. 3 Changes in the kinetic and potential energies of fluid streams are negligible. 4 There is no fouling. 5 Fluid properties are constant. 6 The thermal resistance of the inner tube is negligible since the tube is thinwalled and highly conductive.

Properties The specific heats of cold and hot water are given to be 4.18 and 4.19 kJ/kg.°C, respectively.

Analysis The rate of heat transfer in this heat exchanger is

$$\mathcal{E} = [\mathcal{E}_{p}(T_{out} - T_{in})]_{\text{cold water}}$$
= (0.25 kg/s)(4.18 kJ/kg.°C)(45°C - 15°C)
= 31.35 kW



The outlet temperature of the hot water is determined from

$$\mathcal{E} = [\mathcal{E}_{D}C_{p}(T_{in} - T_{out})]_{\text{hot water}} \longrightarrow T_{out} = T_{in} - \frac{\mathcal{E}_{D}}{\mathcal{E}_{D}} = 100^{\circ}\text{C} - \frac{31.35 \text{ kW}}{(3 \text{ kg/s})(4.19 \text{ kJ/kg.}^{\circ}\text{C})} = 97.5^{\circ}\text{C}$$

The temperature differences at the two ends of the heat exchanger are

$$\Delta T_1 = T_{h.in} - T_{c.out} = 100^{\circ} \text{C} - 45^{\circ} \text{C} = 55^{\circ} \text{C}$$

 $\Delta T_2 = T_{h.out} - T_{c.in} = 97.5^{\circ} \text{C} - 15^{\circ} \text{C} = 82.5^{\circ} \text{C}$

and

$$\Delta T_{lm} = \frac{\Delta T_1 - \Delta T_2}{\ln(\Delta T_1 / \Delta T_2)} = \frac{55 - 82.5}{\ln(55 / 82.5)} = 67.8^{\circ} \text{ C}$$

Then the surface area of this heat exchanger becomes

$$\mathcal{E} = UA_s \Delta T_{lm} \longrightarrow A_s = \underbrace{\mathcal{E}}_{U\Delta T_{lm}} = \underbrace{31.35 \,\text{kW}}_{(1.210 \,\text{kW/m}^2.^{\circ}\text{C})(67.8^{\circ}\text{C})} = 0.382 \,\text{m}^2$$

23-52 Engine oil is heated by condensing steam in a condenser. The rate of heat transfer and the length of the tube required are to be determined.

Assumptions 1 Steady operating conditions exist. 2 The heat exchanger is well-insulated so that heat loss to the surroundings is negligible and thus heat transfer from the hot fluid is equal to the heat transfer to the cold fluid. 3 Changes in the kinetic and potential energies of fluid streams are negligible. 4 There is no fouling. 5 Fluid properties are constant. 6 The thermal resistance of the inner tube is negligible since the tube is thinwalled and highly conductive.

Properties The specific heat of engine oil is given to be 2.1 kJ/kg.°C. The heat of condensation of steam at 130°C is given to be 2174 kJ/kg.

Analysis The rate of heat transfer in this heat exchanger is

$$\mathcal{P} = [\mathcal{M}C_p(T_{out} - T_{in})]_{oil} = (0.3 \text{ kg/s})(2.1 \text{ kJ/kg.}^\circ\text{C})(60^\circ\text{C} - 20^\circ\text{C}) = 25.2 \text{ kW}$$

The temperature differences at the two ends of the heat exchanger are

$$\Delta T_1 = T_{h,in} - T_{c,out} = 130^{\circ} \text{C} - 60^{\circ} \text{C} = 70^{\circ} \text{C}$$

 $\Delta T_2 = T_{h,out} - T_{c,in} = 130^{\circ} \text{C} - 20^{\circ} \text{C} = 110^{\circ} \text{C}$

and


$$\Delta T_{lm} = \frac{\Delta T_1 - \Delta T_2}{\ln(\Delta T_1 / \Delta T_2)} = \frac{70 - 110}{\ln(70 / 110)} = 88.5^{\circ} \text{ C}$$

The surface area is

$$A_s = \frac{25.2 \text{ kW}}{U\Delta T_{lm}} = \frac{25.2 \text{ kW}}{(0.65 \text{ kW/m}^2.^{\circ}\text{C})(88.5^{\circ}\text{C})} = 0.44 \text{ m}^2$$

Then the length of the tube required becomes

$$A_s = \pi DL \longrightarrow L = \frac{A_s}{\pi D} = \frac{0.44 \text{ m}^2}{\pi (0.02 \text{ m})} = 7.0 \text{ m}$$



23-53E Water is heated by geothermal water in a double-pipe counter-flow heat exchanger. The mass flow rate of each fluid and the total thermal resistance of the heat exchanger are to be determined.

Assumptions 1 Steady operating conditions exist. **2** The heat exchanger is well-insulated so that heat loss to the surroundings is negligible and thus heat transfer from the hot fluid is equal to the heat transfer to the cold fluid. **3** Changes in the kinetic and potential energies of fluid streams are negligible. **4** There is no fouling. **5** Fluid properties are constant.

Properties The specific heats of water and geothermal fluid are given to be 1.0 and 1.03 Btu/lbm.°F, respectively.

Analysis The mass flow rate of each fluid are determined from

$$\mathcal{B} = [\mathcal{B}_{W}C_{p}(T_{out} - T_{in})]_{\text{water}}$$

$$\mathcal{B}_{\text{water}} = \frac{\mathcal{B}_{W}}{C_{p}(T_{out} - T_{in})} = \frac{30 \text{ Btu/s}}{(1.0 \text{ Btu/lbm.°F})(200°\text{F} - 140°\text{F})} = \textbf{0.5 lbm/s}$$

$$\mathcal{B}_{W} = [\mathcal{B}_{W}C_{p}(T_{out} - T_{in})]_{\text{geo. water}}$$

$$\mathcal{B}_{W} = \frac{30 \text{ Btu/s}}{C_{p}(T_{out} - T_{in})} = \frac{30 \text{ Btu/s}}{(1.03 \text{ Btu/lbm.°F})(310°\text{F} - 180°\text{F})} = \textbf{0.224 lbm/s}$$

The temperature differences at the two ends of the heat exchanger are

$$\Delta T_{1} = T_{h,in} - T_{c,out} = 310^{\circ} \text{F} - 200^{\circ} \text{F} = 110^{\circ} \text{F}$$

$$\Delta T_{2} = T_{h,out} - T_{c,in} = 180^{\circ} \text{F} - 140^{\circ} \text{F} = 40^{\circ} \text{F}$$
and
$$\Delta T_{lm} = \frac{\Delta I_{1} - \Delta I_{2}}{\ln(\Delta T_{1} / \Delta T_{2})} = \frac{110 - 40}{\ln(110 / 40)} = 69.20^{\circ} \text{F}$$
Then
$$\mathcal{E} = UA_{s} \Delta T_{lm} \longrightarrow UA_{s} = \frac{\mathcal{E}}{\Delta T_{lm}} = \frac{30 \text{ Btu/s}}{69.20^{\circ} \text{F}} = 0.4335 \text{ Btu/s}.^{\circ} \text{F}$$

$$U = \frac{1}{RA_{s}} \longrightarrow R = \frac{1}{UA_{s}} = \frac{1}{0.4336 \text{ Btu/s}} = 2.31 \text{ s.}^{\circ} \text{F/Btu}$$

23-54 Glycerin is heated by ethylene glycol in a thin-walled double-pipe parallel-flow heat exchanger. The rate of heat transfer, the outlet temperature of the glycerin, and the mass flow rate of the ethylene glycol are to be determined.


Assumptions 1 Steady operating conditions exist. **2** The heat exchanger is well-insulated so that heat loss to the surroundings is negligible and thus heat transfer from the hot fluid is equal to the heat transfer to the cold fluid. **3** Changes in the kinetic and potential energies of fluid streams are negligible. **4** There is no fouling. **5** Fluid properties are constant. **6** The thermal resistance of the inner tube is negligible since the tube is thinwalled and highly conductive.

Properties The specific heats of glycerin and ethylene glycol are given to be 2.4 and 2.5 kJ/kg.°C, respectively.

Analysis (a) The temperature differences at the two ends are

$$\Delta T_{1} = T_{h,in} - T_{c,in} = 60^{\circ} \text{C} - 20^{\circ} \text{C} = 40^{\circ} \text{C}$$

$$\Delta T_{2} = T_{h,out} - T_{c,out} = T_{h,out} - (T_{h,out} - 15^{\circ} \text{C}) = 15^{\circ} \text{C}$$
and
$$\Delta T_{lm} = \frac{\Delta T_{1} - \Delta T_{2}}{\ln(\Delta T_{1} / \Delta T_{2})} = \frac{40 - 15}{\ln(40 / 15)} = 255^{\circ} \text{C}$$



Then the rate of heat transfer becomes

$$\mathcal{E} = UA_s \Delta T_{hp} = (240 \text{ W/m}^2. ^{\circ}\text{C})(3.2 \text{ m}^2)(25.5 ^{\circ}\text{C}) = 19,584 \text{ W} = 19.58 \text{ kW}$$

(b) The outlet temperature of the glycerin is determined from

$$\mathcal{E} = [\mathcal{E}_{D} C_{p} (T_{out} - T_{in})]_{\text{glycerin}} \longrightarrow T_{out} = T_{in} + \mathcal{E}_{D} = 20^{\circ}\text{C} + \frac{19.584 \text{ kW}}{(0.3 \text{ kg/s})(2.4 \text{ kJ/kg.}^{\circ}\text{C})} = 47.2^{\circ}\text{C}$$

(c) Then the mass flow rate of ethylene glycol becomes

$$\mathcal{B} = [\mathcal{B}_{D}(T_{in} - T_{out})]_{\text{ethylene glycol}}$$

$$\mathcal{B}_{\text{ethylene glycol}} = \frac{\mathcal{B}_{D}(T_{in} - T_{out})}{C_{p}(T_{in} - T_{out})} = \frac{19.584 \text{ kJ/s}}{(2.5 \text{ kJ/kg.}^{\circ}\text{C})[(47.2 + 15)^{\circ}\text{C} - 60^{\circ}\text{C}]} = 3.56 \text{ kg/s}$$

23-55 Air is preheated by hot exhaust gases in a cross-flow heat exchanger. The rate of heat transfer and the outlet temperature of the air are to be determined.

Assumptions 1 Steady operating conditions exist. **2** The heat exchanger is well-insulated so that heat loss to the surroundings is negligible and thus heat transfer from the hot fluid is equal to the heat transfer to the cold fluid. **3** Changes in the kinetic and potential energies of fluid streams are negligible. **4** There is no fouling. **5** Fluid properties are constant.

Properties The specific heats of air and combustion gases are given to be 1005 and 1100 J/kg.°C, respectively.


Analysis The rate of heat transfer is

$$\mathcal{E} = [\mathbf{M}C_p(T_{in} - T_{out})]_{gas.}$$
= (1.1 kg/s)(1.1 kJ/kg.°C)(180°C - 95°C)
= **103 kW**

The mass flow rate of air is

$$R = \frac{P k}{RT} = \frac{(95 \text{ kPa})(0.8 \text{ m}^3/\text{s})}{(0.287 \text{ kPa}.\text{m}^3/\text{kg}.\text{K}) \times 293 \text{ K}} = 0.904 \text{ kg/s}$$

Then the outlet temperature of the air becomes



$$\mathcal{E} = \mathcal{E}_{C_p}(T_{C_cout} - T_{C_cin})$$

$$T_{C_cout} = T_{C_cin} + \mathcal{E}_{D_c} = 20^{\circ}\text{C} + \frac{103 \times 10^3 \text{ W}}{(0.904 \text{ kg/s})(1005 \text{ J/kg.}^{\circ}\text{C})} = 133^{\circ}\text{C}$$

23-56 Water is heated by hot oil in a 2-shell passes and 12-tube passes heat exchanger. The heat transfer surface area on the tube side is to be determined.

Assumptions 1 Steady operating conditions exist. **2** The heat exchanger is well-insulated so that heat loss to the surroundings is negligible and thus heat transfer from the hot fluid is equal to the heat transfer to the cold fluid. **3** Changes in the kinetic and potential energies of fluid streams are negligible. **4** There is no fouling. **5** Fluid properties are constant.

Properties The specific heats of water and oil are given to be 4.18 and 2.3 kJ/kg.°C, respectively.

Analysis The rate of heat transfer in this heat exchanger is

$$\mathcal{P} = [\mathbf{A} C_p (T_{out} - T_{in})]_{water} = (4.5 \text{ kg/s})(4.18 \text{ kJ/kg.}^{\circ}\text{C})(70^{\circ}\text{C} - 20^{\circ}\text{C}) = 940.5 \text{ kW}$$

The outlet temperature of the hot water is determined from

$$\mathcal{E} = [\mathcal{E}_{DC} (T_{in} - T_{out})]_{oil} \longrightarrow T_{out} = T_{in} - \frac{\mathcal{E}_{DC}}{\mathcal{E}_{DC}} = 170^{\circ} \text{C} - \frac{940.5 \text{ kW}}{(10 \text{ kg/s})(2.3 \text{ kJ/kg.}^{\circ}\text{C})} = 129^{\circ} \text{C}$$

The logarithmic mean temperature difference for counterflow arrangement and the correction factor F are

$$\Delta T_{1} = T_{h,in} - T_{c,out} = 170^{\circ}\text{C} - 70^{\circ}\text{C} = 100^{\circ}\text{C}$$

$$\Delta T_{2} = T_{h,out} - T_{c,in} = 129^{\circ}\text{C} - 20^{\circ}\text{C} = 109^{\circ}\text{C}$$

$$\Delta T_{lm,CF} = \frac{\Delta T_{1} - \Delta T_{2}}{\ln(\Delta T_{1} / \Delta T_{2})} = \frac{100 - 109}{\ln(100 / 109)} = 105^{\circ}\text{C}$$

$$P = \frac{t_{2} - t_{1}}{T_{1} - t_{1}} = \frac{129 - 170}{20 - 170} = 0.27$$

$$R = \frac{T_{1} - T_{2}}{t_{2} - t_{1}} = \frac{20 - 70}{129 - 170} = 1.2$$

$$F = 1.0$$

$$Vater$$

$$20^{\circ}\text{C}$$

$$4.5 \text{ kg/s}$$

$$(12 \text{ tube passes})$$

$$\& = UA_s F \Delta T_{lm,CF} \longrightarrow A_s = UF \Delta T_{lm,CF} = 940.5 \text{ kW} = 15 \text{ m}^2$$

23-57 Water is heated by hot oil in a 2-shell passes and 12-tube passes heat exchanger. The heat transfer surface area on the tube side is to be determined.

Assumptions 1 Steady operating conditions exist. **2** The heat exchanger is well-insulated so that heat loss to the surroundings is negligible and thus heat transfer from the hot fluid is equal to the heat transfer to the cold fluid. **3** Changes in the kinetic and potential energies of fluid streams are negligible. **4** There is no fouling. **5** Fluid properties are constant.

Properties The specific heats of water and oil are given to be 4.18 and 2.3 kJ/kg.°C, respectively.

Analysis The rate of heat transfer in this heat exchanger is

$$\mathcal{E} = [\mathcal{E}_p (T_{out} - T_{in})]_{\text{water}} = (2 \text{ kg/s})(4.18 \text{ kJ/kg.}^{\circ}\text{C})(70^{\circ}\text{C} - 20^{\circ}\text{C}) = 418 \text{ kW}$$

The outlet temperature of the oil is determined from

$$\mathcal{E} = [\mathcal{E}_{D}C_{p}(T_{in} - T_{out})]_{oil} \longrightarrow T_{out} = T_{in} - \mathcal{E}_{D} = 170^{\circ}\text{C} - \frac{418 \,\text{kW}}{(10 \,\text{kg/s})(2.3 \,\text{kJ/kg.}^{\circ}\text{C})} = 151.8^{\circ}\text{C}$$

The logarithmic mean temperature difference for counterflow arrangement and the correction factor F are

$$\Delta T_{1} = T_{h,in} - T_{c,out} = 170^{\circ} \text{C} - 70^{\circ} \text{C} = 100^{\circ} \text{C}$$

$$\Delta T_{2} = T_{h,out} - T_{c,in} = 151.8^{\circ} \text{C} - 20^{\circ} \text{C} = 131.8^{\circ} \text{C}$$

$$\Delta T_{lm,CF} = \frac{\Delta T_{1} - \Delta T_{2}}{\ln(\Delta T_{1} / \Delta T_{2})} = \frac{100 - 131.8}{\ln(100 / 131.8)} = 115.2^{\circ} \text{C}$$

$$P = \frac{I_{2} - I_{1}}{T_{1} - I_{1}} = \frac{151.8 - 170}{20 - 170} = 0.12$$

$$R = \frac{T_{1} - T_{2}}{I_{2} - I_{1}} = \frac{20 - 70}{151.8 - 170} = 2.7$$

$$F = 1.0$$

$$(12 \text{ tube passes})$$

$$\mathcal{E} = U_{j} A_{j} F \Delta T_{lm,CF} \longrightarrow A_{j} = \underbrace{U_{j} F \Delta T_{lm,CF}}_{U_{j} F \Delta T_{lm,CF}} = \underbrace{418 \,\text{kW}}_{(0.6 \,\text{kW/m}^{2}.^{\circ}\text{C})(1.0)(115.2^{\circ}\text{C})} = 6.05 \,\text{m}^{2}$$

23-58 Ethyl alcohol is heated by water in a 2-shell passes and 8-tube passes heat exchanger. The heat transfer surface area of the heat exchanger is to be determined.

Assumptions 1 Steady operating conditions exist. **2** The heat exchanger is well-insulated so that heat loss to the surroundings is negligible and thus heat transfer from the hot fluid is equal to the heat transfer to the cold fluid. **3** Changes in the kinetic and potential energies of fluid streams are negligible. **4** There is no fouling. **5** Fluid properties are constant.

Properties The specific heats of water and ethyl alcohol are given to be 4.19 and 2.67 kJ/kg.°C, respectively.

Analysis The rate of heat transfer in this heat exchanger is

$$\mathcal{P} = [\mathcal{M}C_p(T_{out} - T_{in})]_{\text{ethyl alcohol}} = (2.1 \text{kg/s})(2.67 \text{kJ/kg.}^{\circ}\text{C})(70^{\circ}\text{C} - 25^{\circ}\text{C}) = 252.3 \text{kW}$$

The logarithmic mean temperature difference for counterflow arrangement and the correction factor F are


$$\Delta T_{1} = T_{h,in} - T_{c,out} = 95^{\circ} \text{C} - 70^{\circ} \text{C} = 25^{\circ} \text{C}$$

$$\Delta T_{2} = T_{h,out} - T_{c,in} = 45^{\circ} \text{C} - 25^{\circ} \text{C} = 20^{\circ} \text{C}$$

$$\Delta T_{lm,CF} = \frac{\Delta T_{1} - \Delta T_{2}}{\ln(\Delta T_{1} / \Delta T_{2})} = \frac{25 - 20}{\ln(25 / 20)} = 22.4^{\circ} \text{C}$$

$$P = \frac{C_{2} - C_{1}}{T_{1} - C_{1}} = \frac{45 - 95}{25 - 95} = 0.7$$

$$R = \frac{T_{1} - T_{2}}{C_{2} - C_{1}} = \frac{25 - 70}{45 - 95} = 0.9$$



$$\mathcal{E} = U_j A_j F \Delta T_{lm,CF} \longrightarrow A_j = \underbrace{U_j F \Delta T_{lm,CF}}_{U_j F \Delta T_{lm,CF}} = \underbrace{252.3 \,\text{kW}}_{(0.950 \,\text{kW/m}^2.^\circ\text{C})(0.77)(22.4^\circ\text{C})} = 15.4 \,\text{m}^2$$

23-59 Water is heated by ethylene glycol in a 2-shell passes and 12-tube passes heat exchanger. The rate of heat transfer and the heat transfer surface area on the tube side are to be determined.

Assumptions 1 Steady operating conditions exist. **2** The heat exchanger is well-insulated so that heat loss to the surroundings is negligible and thus heat transfer from the hot fluid is equal to the heat transfer to the cold fluid. **3** Changes in the kinetic and potential energies of fluid streams are negligible. **4** There is no fouling. **5** Fluid properties are constant.

Properties The specific heats of water and ethylene glycol are given to be 4.18 and 2.68 kJ/kg.°C, respectively.

Analysis The rate of heat transfer in this heat exchanger is:

$$\mathcal{D} = [\mathcal{D}_{n}(T_{out} - T_{in})]_{\text{water}} = (0.8 \text{ kg/s})(4.18 \text{ kJ/kg.}^{\circ}\text{C})(70^{\circ}\text{C} - 22^{\circ}\text{C}) = 160.5 \text{ kW}$$

The logarithmic mean temperature difference for counterflow arrangement and the correction factor F are

$$\Delta T_{1} = T_{h,in} - T_{c,out} = 110^{\circ} \text{C} - 70^{\circ} \text{C} = 40^{\circ} \text{C}$$


$$\Delta T_{2} = T_{h,out} - T_{c,in} = 60^{\circ} \text{C} - 22^{\circ} \text{C} = 38^{\circ} \text{C}$$

$$\Delta T_{lm,CF} = \frac{\Delta T_{1} - \Delta T_{2}}{\ln(\Delta T_{1} / \Delta T_{2})} = \frac{40 - 38}{\ln(40 / 38)} = 39^{\circ} \text{C}$$

$$P = \frac{t_{2} - t_{1}}{T_{1} - t_{1}} = \frac{60 - 110}{22 - 110} = 0.57$$

$$R = \frac{T_{1} - T_{2}}{t_{2} - t_{1}} = \frac{22 - 70}{60 - 110} = 0.96$$

$$F = 0.94$$



$$\& = U_j A_j F \Delta T_{lm,CF} \longrightarrow A_j = \underbrace{U_j F \Delta T_{lm,CF}}_{U_j F \Delta T_{lm,CF}} = \underbrace{160.5 \text{ kW}}_{(0.28 \text{ kW/m}^2.^{\circ}\text{C})(0.94)(39^{\circ}\text{C})} = 15.6 \text{ m}^2$$

"GIVEN"


 $\label{eq:total_continuous_cont$

"ANALYSIS"

Q_dot=m_dot_w*C_p_w*(T_w_out-T_w_in)
Q_dot=m_dot_glycol*C_p_glycol*(T_glycol_in-T_glycol_out)
DELTAT_1=T_glycol_in-T_w_out
DELTAT_2=T_glycol_out-T_w_in
DELTAT_Im_CF=(DELTAT_1-DELTAT_2)/In(DELTAT_1/DELTAT_2)
P=(T_glycol_out-T_glycol_in)/(T_w_in-T_glycol_in)
R=(T_w_in-T_w_out)/(T_glycol_out-T_glycol_in)
F=0.94 "from Fig. 23-18b of the text at the calculated P and R"
Q_dot=U*A*F*DELTAT_Im_CF

m _w [kg/s]	Q [kW]	A [m ²]
0.4	80.26	7.82
0.5	100.3	9.775
0.6	120.4	11.73
0.7	140.4	13.69
0.8	160.5	15.64
0.9	180.6	17.6
1	200.6	19.55
1.1	220.7	21.51
1.2	240.8	23.46
1.3	260.8	25.42
1.4	280.9	27.37
1.5	301	29.33
1.6	321	31.28
1.7	341.1	33.24
1.8	361.2	35.19
1.9	381.2	37.15
2	401.3	39.1
2.1	421.3	41.06
2.2	441.4	43.01



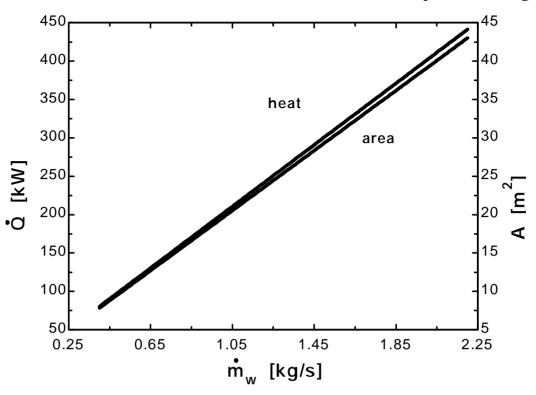

23-61E Steam is condensed by cooling water in a condenser. The rate of heat transfer, the rate of condensation of steam, and the mass flow rate of cold water are to be determined.

Assumptions 1 Steady operating conditions exist. **2** The heat exchanger is well-insulated so that heat loss to the surroundings is negligible and thus heat transfer from the hot fluid is equal to the heat transfer to the cold fluid. **3** Changes in the kinetic and potential energies of fluid streams are negligible. **4** There is no fouling. **5** Fluid properties are constant. **6** The thermal resistance of the inner tube is negligible since the tube is thinwalled and highly conductive.

Properties We take specific heat of water are given to be 1.0 Btu/lbm.°F. The heat of condensation of steam at 90°F is 1043 Btu/lbm.

Analysis (a) The log mean temperature difference is determined from

$$\Delta T_1 = T_{h.in} - T_{c.out} = 90^{\circ} \,\mathrm{F} - 73^{\circ} \,\mathrm{F} = 17^{\circ} \,\mathrm{F}$$

$$\Delta T_2 = T_{h.out} - T_{c.in} = 90^{\circ} \,\mathrm{F} - 60^{\circ} \,\mathrm{F} = 30^{\circ} \,\mathrm{F}$$

$$\Delta T_{lm,CF} = \frac{\Delta T_1 - \Delta T_2}{\ln(\Delta T_1 / \Delta T_2)} = \frac{17 - 30}{\ln(17/30)} = 22.9^{\circ} F$$

The heat transfer surface area is

$$A_s = 8m\pi DL = 8 \times 50 \times \pi (3/48 \text{ ft})(5 \text{ ft}) = 392.7 \text{ ft}^2$$

and

$$\mathcal{E} = UA_s \Delta T_{lm} = (600 \text{ Btu/h.ft}^2.\text{°F})(392.7 \text{ ft}^2)(22.9\text{°F}) = 5.396 \times 10^6 \text{ Btu/h}$$


(b) The rate of condensation of the steam is

$$\& = (\hbar h h_{fg})_{steam} \longrightarrow \hbar h_{steam} = \frac{\& 9}{h_{fg}} = \frac{5.396 \times 10^6 \text{ Btu/h}}{1043 \text{ Btu/lbm}} = 5173 \text{ lbm/h} = 1.44 \text{ lbm/s}$$

(c) Then the mass flow rate of cold water becomes

$$\mathcal{B} = [\mathcal{B}_{loc} C_{p} (T_{out} - T_{in})]_{\text{cold water}}$$


$$\mathcal{B}_{\text{cold water}} = \frac{\mathcal{B}_{loc} C_{p} (T_{out} - T_{in})}{C_{p} (T_{out} - T_{in})} = \frac{5.396 \times 10^{6} \text{ Btu/h}}{(1.0 \text{ Btu/lbm.}^{\circ}\text{F})(73^{\circ}\text{F} - 60^{\circ}\text{F})} = 4.15 \times 10^{5} \text{ lbm/h} = 115 \text{ lbm/s}$$




```
"GIVEN"
N_pass=8
N_tube=50
"T_steam=90 [F], parameter to be varied"
h_fg_steam=1043 "[Btu/lbm]"
T_w_in=60 "[F]"
T_w_out=73 "[F]"
C_p_w=1.0 "[Btu/lbm-F]"
D=3/4*1/12 "[ft]"
L=5 "[ft]"
U=600 "[Btu/h-ft^2-F]"
"ANALYSIS"
"(a)"
DELTAT_1=T_steam-T_w_out
DELTAT_2=T_steam-T_w_in
DELTAT_Im=(DELTAT_1-DELTAT_2)/In(DELTAT_1/DELTAT_2)
A=N_pass*N_tube*pi*D*L
Q_dot=U*A*DELTAT_Im*Convert(Btu/h, Btu/s)
"(b)"
Q_dot=m_dot_steam*h_fg_steam
"(c)"
Q\_dot = m\_dot\_w^*C\_p\_w^*(T\_w\_out\text{-}T\_w\_in)
```

T _{steam} [F]	Q [Btu/s]	m _{steam} [lbm/s]	m _w [lbm/s]
80	810.5	0.7771	62.34
82	951.9	0.9127	73.23
84	1091	1.046	83.89
86	1228	1.177	94.42
88	1363	1.307	104.9
90	1498	1.436	115.2
92	1632	1.565	125.6
94	1766	1.693	135.8
96	1899	1.821	146.1
98	2032	1.948	156.3
100	2165	2.076	166.5
102	2297	2.203	176.7
104	2430	2.329	186.9
106	2562	2.456	197.1
108	2694	2.583	207.2
110	2826	2.709	217.4
112	2958	2.836	227.5
114	3089	2.962	237.6
116	3221	3.088	247.8
118	3353	3.214	257.9
120	3484	3.341	268



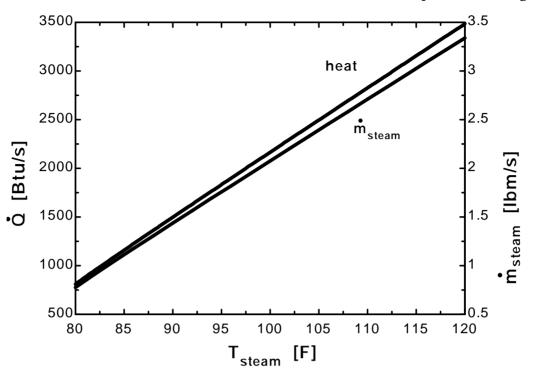

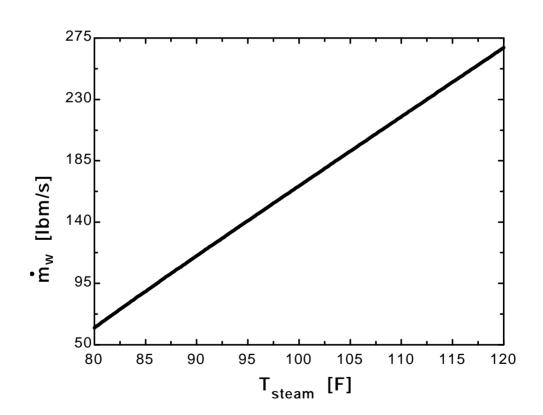

23-63 Glycerin is heated by hot water in a 1-shell pass and 10-tube passes heat exchanger. The mass flow rate of glycerin and the overall heat transfer coefficient of the heat exchanger are to be determined.

Assumptions 1 Steady operating conditions exist. **2** The heat exchanger is well-insulated so that heat loss to the surroundings is negligible and thus heat transfer from the hot fluid is equal to the heat transfer to the cold fluid. **3** Changes in the kinetic and potential energies of fluid streams are negligible. **4** There is no fouling. **5** Fluid properties are constant.

Properties The specific heats of water and glycerin are given to be 4.18 and 2.48 kJ/kg.°C, respectively.

Analysis The rate of heat transfer in this heat exchanger is

$$\mathcal{P} = [\mathcal{M} C_n (T_{in} - T_{out})]_{\text{water}} = (5 \text{ kg/s})(4.18 \text{ kJ/kg.}^{\circ}\text{C})(100^{\circ}\text{C} - 55^{\circ}\text{C}) = 940.5 \text{ kW}$$

The mass flow rate of the glycerin is determined from

$$\mathcal{E} = [\mathcal{E}_{D}(T_{out} - T_{in})]_{\text{glycerin}}$$

$$\mathcal{E}_{glycerin} = \frac{\mathcal{E}_{D}}{C_{D}(T_{out} - T_{in})} = \frac{940.5 \text{ kJ/s}}{(2.48 \text{ kJ/kg.}^{\circ}\text{C})[(55^{\circ}\text{C} - 15^{\circ}\text{C})]} = 9.5 \text{ kg/s}$$

The logarithmic mean temperature difference for counterflow arrangement and the correction factor F are

$$\Delta T_{1} = T_{h,in} - T_{c,out} = 100^{\circ} \text{C} - 55^{\circ} \text{C} = 45^{\circ} \text{C}$$

$$\Delta T_{2} = T_{h,out} - T_{c,in} = 55^{\circ} \text{C} - 15^{\circ} \text{C} = 40^{\circ} \text{C}$$

$$\Delta T_{lm,CF} = \frac{\Delta T_{1} - \Delta T_{2}}{\ln(\Delta T_{1} / \Delta T_{2})} = \frac{45 - 40}{\ln(45 / 40)} = 42.5^{\circ} \text{C}$$

$$P = \frac{C_{2} - C_{1}}{T_{1} - C_{1}} = \frac{55 - 100}{15 - 100} = 0.53$$

$$R = \frac{T_{1} - T_{2}}{C_{2} - C_{1}} = \frac{15 - 55}{55 - 100} = 0.89$$

The heat transfer surface area is

$$A_s = m\pi DL = 10\pi (0.015 \,\mathrm{m})(2 \,\mathrm{m}) = 0.94 \,\mathrm{m}^2$$

Glycerin
15°C

55°C

100°C

Hot Water
5 kg/s

Then the overall heat transfer coefficient of the heat exchanger is determined to be

$$\mathcal{E} = UA_s F\Delta T_{lm,CF} \longrightarrow U = \underbrace{\mathcal{E}}_{A_s F\Delta T_{lm,CF}} = \underbrace{940.5 \text{ kW}}_{(0.94 \text{ m}^2)(0.77)(42.5^{\circ}\text{C})} = 30.6 \text{ kW/m}^2.^{\circ}\text{C}$$

23-64 Isobutane is condensed by cooling air in the condenser of a power plant. The mass flow rate of air and the overall heat transfer coefficient are to be determined.

Assumptions 1 Steady operating conditions exist. **2** The heat exchanger is well-insulated so that heat loss to the surroundings is negligible and thus heat transfer from the hot fluid is equal to the heat transfer to the cold fluid. **3** Changes in the kinetic and potential energies of fluid streams are negligible. **4** There is no fouling. **5** Fluid properties are constant.

Properties The heat of vaporization of isobutane at 75°C is given to be $L_{fg} = 255.7$ kJ/kg and specific heat of air is given to be $C_p = 1005$ J/kg.°C.

Analysis First, the rate of heat transfer is determined from

$$\mathcal{Q} = (\mathcal{R}_{hf})_{\text{isobutane}} = (2.7 \text{ kg/s})(255.7 \text{ kJ/kg}) = 690.39 \text{ kW}$$

The mass flow rate of air is determined from

$$\mathcal{E} = [\mathcal{M}C_{\rho}(T_{\text{out}} - T_{\text{in}})]_{\text{air}}$$

$$\mathcal{M}_{\text{air}} = \frac{\mathcal{E}}{C_{\rho}(T_{\text{out}} - T_{\text{in}})}$$

$$= \frac{690.39 \text{ kJ/s}}{(1.005 \text{ kJ/kg.}^{\circ}\text{C})(28^{\circ}\text{C} - 21^{\circ}\text{C})}$$

$$= 98.14 \text{ kg/s}$$

The temperature differences between the isobutane and the air at the two ends of the condenser are

$$\Delta I_1 = I_{h,in} - I_{c,out} = 75^{\circ}\text{C} - 21^{\circ}\text{C} = 54^{\circ}\text{C}$$


 $\Delta I_2 = I_{h,out} - I_{c,in} = 75^{\circ}\text{C} - 28^{\circ}\text{C} = 47^{\circ}\text{C}$

and

$$\Delta I_{lm} = \frac{\Delta I_1 - \Delta I_2}{\ln(\Delta I_1 / \Delta I_2)} = \frac{54 - 47}{\ln(54 / 47)} = 50.4$$
°C

Then the overall heat transfer coefficient is determined from

$$\mathcal{P} = UA_s \Delta T_{lm} \longrightarrow 690,390 \text{ W} = U(24 \text{ m}^2)(50.4^{\circ}\text{C}) \longrightarrow U = 571 \text{ W/m}^2.^{\circ}\text{C}$$



550°F

Water

200°C

23-65 Water is evaporated by hot exhaust gases in an evaporator. The rate of heat transfer, the exit temperature of the exhaust gases, and the rate of evaporation of water are to be determined.

Assumptions 1 Steady operating conditions exist. 2 The heat exchanger is well-insulated so that heat loss to the surroundings is negligible and thus heat transfer from the hot fluid is equal to the heat transfer to the cold fluid. 3 Changes in the kinetic and potential energies of fluid streams are negligible. 4 There is no fouling. 5 Fluid properties are constant.

Properties The heat of vaporization of water at 200°C is given to be $\Delta_{fg} = 1941$ kJ/kg and specific heat of exhaust gases is given to be $C_p = 1051 \text{ J/kg.}^{\circ}\text{C}$.

Analysis The temperature differences between the water and the exhaust gases at the two ends of the evaporator are

$$\begin{split} \Delta \textit{T}_{1} &= \textit{T}_{h,in} - \textit{T}_{c,out} = 550^{\circ}\text{C} - 200^{\circ}\text{C} = 350^{\circ}\text{C} \\ \Delta \textit{T}_{2} &= \textit{T}_{h,out} - \textit{T}_{c,in} = (\textit{T}_{h,out} - 200)^{\circ}\text{C} \end{split}$$

and

$$\Delta T_{lm} = \frac{\Delta T_1 - \Delta T_2}{\ln(\Delta T_1 / \Delta T_2)} = \frac{350 - (I_{h,out} - 200)}{\ln[350 / (T_{h,out} - 200)]}$$

Then the rate of heat transfer can be expressed as

The rate of heat transfer can also be expressed as in the following forms

$$\mathcal{E} = [\text{Mar} C_{p} (I_{h,in} - I_{h,out})]_{\substack{\text{exhaust} \\ \text{gases}}} = (0.25 \text{ kg/s})(1.051 \text{ kJ/kg.}^{\circ}\text{C})(550^{\circ}\text{C} - I_{h,out}^{\prime})$$
 (Eq. 2)
$$\mathcal{E} = (\text{Mar} I_{f_{e}^{\prime}})_{\text{water}} = \text{Mar}_{\text{water}} (1941 \text{ kJ/kg})$$
 (Eq. 3)

We have three equations with three unknowns. Using an equation solver such as EES, the unknowns are determined to be

(Eq. 3)

$$\&= 88.85 \text{ kW}$$
 $I_{h,out}' = 211.8^{\circ}\text{C}$
 $M_{water}' = 0.0458 \text{ kg/s}$

"GIVEN"

"T_exhaust_in=550 [C], parameter to be varied"

C_p_exhaust=1.051 "[kJ/kg-C]"

m_dot_exhaust=0.25 "[kg/s]"

T_w=200 "[C]"

h_fg_w=1941 "[kJ/kg]"

A=0.5 "[m^2]"

U=1.780 "[kW/m^2-C]"

"ANALYSIS"

DELTAT_1=T_exhaust_in-T_w
DELTAT_2=T_exhaust_out-T_w

DELTAT_Im=(DELTAT_1-DELTAT_2)/In(DELTAT_1/DELTAT_2)


Q_dot=U*A*DELTAT_Im


 $Q_dot = m_dot_exhaust^*C_p_exhaust^*(T_exhaust_in-T_exhaust_out)$

Q_dot=m_dot_w*h_fg_w

T _{exhaust,in} [C]	Q [kW]	T _{exhaust,out} [C]	m _w [kg/s]
300	25.39	203.4	0.01308
320	30.46	204.1	0.0157
340	35.54	204.7	0.01831
360	40.62	205.4	0.02093
380	45.7	206.1	0.02354
400	50.77	206.8	0.02616
420	55.85	207.4	0.02877
440	60.93	208.1	0.03139
460	66.01	208.8	0.03401
480	71.08	209.5	0.03662
500	76.16	210.1	0.03924
520	81.24	210.8	0.04185
540	86.32	211.5	0.04447
560	91.39	212.2	0.04709
580	96.47	212.8	0.0497
600	101.5	213.5	0.05232



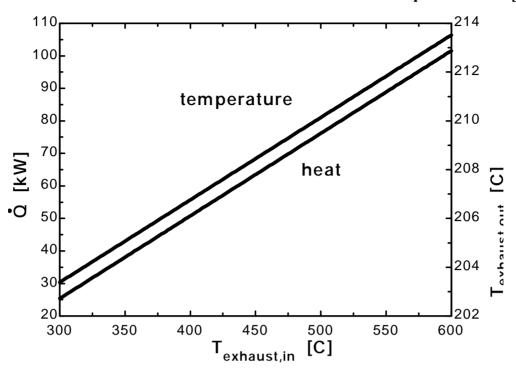

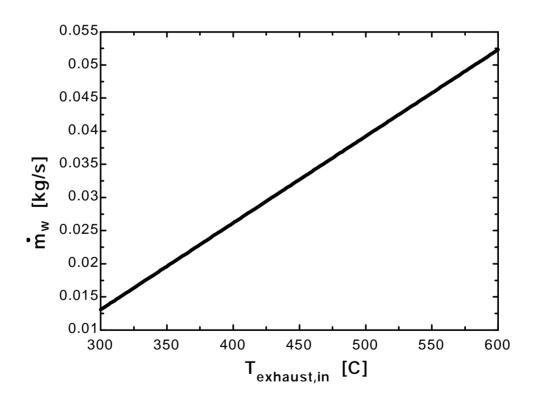

23-67 The waste dyeing water is to be used to preheat fresh water. The outlet temperatures of each fluid and the mass flow rate are to be determined.

Assumptions 1 Steady operating conditions exist. **2** The heat exchanger is well-insulated so that heat loss to the surroundings is negligible and thus heat transfer from the hot fluid is equal to the heat transfer to the cold fluid. **3** Changes in the kinetic and potential energies of fluid streams are negligible. **4** There is no fouling. **5** Fluid properties are constant.


Properties The specific heats of waste dyeing water and the fresh water are given to be $C_p = 4295$ J/kg.°C and $C_p = 4180$ J/kg.°C, respectively.

Analysis The temperature differences between the dyeing water and the fresh water at the two ends of the heat exchanger are

$$\begin{split} \Delta \textit{T}_1 &= \textit{T}_{h,in} - \textit{T}_{c,out} = 75 - \textit{T}_{c,out} \\ \Delta \textit{T}_2 &= \textit{T}_{h,out} - \textit{T}_{c,in} = \textit{T}_{h,out} - 15 \end{split}$$

and

$$\Delta Z_{\text{lm}} = \frac{\Delta Z_1 - \Delta Z_2}{\ln(\Delta Z_1 / \Delta Z_2)} = \frac{(75 - I_{\text{c,out}}) - (I_{\text{h,out}} - 15)}{\ln[(75 - I_{\text{c,out}}) / (I_{\text{h,out}} - 15)]}$$



Then the rate of heat transfer can be expressed as

$$\mathcal{E} = UA_s \Delta T_{lm}$$

$$35 \text{ kW} = (0.625 \text{ kW/m}^2.^{\circ}\text{C})(1.65 \text{ m}^2) \frac{(75 - T_{c,\text{out}}) - (T_{h,\text{out}} - 15)}{\ln[(75 - T_{c,\text{out}})/(T_{h,\text{out}} - 15)]}$$
(Eq. 1)

The rate of heat transfer can also be expressed as

$$\mathcal{E} = \left[\mathcal{H}C_{p} (T_{h,in} - T_{h,out}) \right]_{\substack{\text{dyeing} \\ \text{water}}} \longrightarrow 35 \text{ kW} = \mathcal{H}(4.295 \text{ kJ/kg.}^{\circ}\text{C}) (75^{\circ}\text{C} - T_{h,out})$$
 (Eq. 2)

$$\mathcal{P} = \left[\mathcal{M}C_{p}(T_{\text{h,in}} - T_{\text{h,out}}) \right]_{\substack{\text{dyeing} \\ \text{water}}} \longrightarrow 35 \text{ kW} = \mathcal{M}(4.18 \text{ kJ/kg.}^{\circ}\text{C})(T_{\text{c,out}} - 15^{\circ}\text{C})$$
 (Eq. 3)

We have three equations with three unknowns. Using an equation solver such as EES, the unknowns are determined to be

$$Z_{c,out} = 41.4^{\circ} C$$

 $Z_{h,out} = 49.3^{\circ} C$
 $M = 0.317 \text{ kg/s}$

The Effectiveness-NTU Method

23-68C When the heat transfer surface area A of the heat exchanger is known, but the outlet temperatures are not, the effectiveness-NTU method is definitely preferred.

23-69C The effectiveness of a heat exchanger is defined as the ratio of the actual heat transfer rate to the maximum possible heat transfer rate and represents how closely the heat transfer in the heat exchanger approaches to maximum possible heat transfer. Since the actual heat transfer rate can not be greater than maximum possible heat transfer rate, the effectiveness can not be greater than one. The effectiveness of a heat exchanger depends on the geometry of the heat exchanger as well as the flow arrangement.

23-70C For a specified fluid pair, inlet temperatures and mass flow rates, the counter-flow heat exchanger will have the highest effectiveness.

23-71C Once the effectiveness ε is known, the rate of heat transfer and the outlet temperatures of cold and hot fluids in a heat exchanger are determined from

$$\mathcal{Q} = \varepsilon \mathcal{Q}_{\text{max}} = \varepsilon C_{\text{min}} (T_{h,in} - T_{c,in})$$

$$\mathcal{Q} = \mathcal{M}_{c} C_{p,c} (T_{c,out} - T_{c,in})$$

$$\mathcal{D} = \mathcal{M}_h C_{p,h} (T_{h,in} - T_{h,out})$$

23-72C The heat transfer in a heat exchanger will reach its maximum value when the hot fluid is cooled to the inlet temperature of the cold fluid. Therefore, the temperature of the hot fluid cannot drop below the inlet temperature of the cold fluid at any location in a heat exchanger.

23-73C The heat transfer in a heat exchanger will reach its maximum value when the cold fluid is heated to the inlet temperature of the hot fluid. Therefore, the temperature of the cold fluid cannot rise above the inlet temperature of the hot fluid at any location in a heat exchanger.

23-74C The fluid with the lower mass flow rate will experience a larger temperature change. This is clear from the relation

$$\mathcal{D} = \mathcal{M}_c C_p \Delta T_{cold} = \mathcal{M}_h C_p \Delta T_{hot}$$

23-75C The maximum possible heat transfer rate is in a heat exchanger is determined from

$$\mathcal{D}_{\max} = C_{\min}(T_{h,in} - T_{c,in})$$

where C_{\min} is the smaller heat capacity rate. The value of \mathcal{E}_{\max} does not depend on the type of heat exchanger.

23-76C The longer heat exchanger is more likely to have a higher effectiveness.

23-77C The increase of effectiveness with NTU is not linear. The effectiveness increases rapidly with NTU for small values (up to abo ut NTU = 1.5), but rather slowly for larger values. Therefore, the effectiveness will not double when the length of heat exchanger is doubled.

23-78C A heat exchanger has the smallest effectiveness value when the heat capacity rates of two fluids are identical. Therefore, reducing the mass flow rate of cold fluid by half will increase its effectiveness.

23-79C When the capacity ratio is equal to zero and the number of transfer units value is greater than 5, a counter-flow heat exchanger has an effectiveness of one. In this case the exit temperature of the fluid with smaller capacity rate will equal to inlet temperature of the other fluid. For a parallel-flow heat exchanger the answer would be the same.

23-80C The NTU of a heat exchanger is defined as $NTU = \frac{UA_s}{C_{\min}} = \frac{UA_s}{(MC_p)_{\min}}$ where U is the overall heat

transfer coefficient and A_s is the heat transfer surface area of the heat exchanger. For specified values of U and C_{min} , the value of NTU is a measure of the heat exchanger surface area A_s . Because the effectiveness increases slowly for larger values of NTU, a large heat exchanger cannot be justified economically. Therefore, a heat exchanger with a very large NTU is not necessarily a good one to buy.

23-81C The value of effectiveness increases slowly with a large values of NTU (usually larger than 3). Therefore, doubling the size of the heat exchanger will not save much energy in this case since the increase in the effectiveness will be very small.

23-82C The value of effectiveness increases rapidly with a small values of NTU (up to about 1.5). Therefore, tripling the NTU will cause a rapid increase in the effectiveness of the heat exchanger, and thus saves energy. I would support this proposal.

23-83 Air is heated by a hot water stream in a cross-flow heat exchanger. The maximum heat transfer rate and the outlet temperatures of the cold and hot fluid streams are to be determined.

Assumptions 1 Steady operating conditions exist. **2** The heat exchanger is well-insulated so that heat loss to the surroundings is negligible and thus heat transfer from the hot fluid is equal to the heat transfer to the cold fluid. **3** Changes in the kinetic and potential energies of fluid streams are negligible. **4** Fluid properties are constant.

Properties The specific heats of water and air are given to be 4.19 and 1.005 kJ/kg.°C.


Analysis The heat capacity rates of the hot and cold fluids are

$$C_h = \hbar u_h C_{ph} = (1 \text{ kg/s})(4190 \text{ J/kg.}^{\circ}\text{C}) = 4190 \text{ W/}^{\circ}\text{C}$$

 $C_c = \hbar u_c C_{pc} = (3 \text{ kg/s})(1005 \text{ J/kg.}^{\circ}\text{C}) = 3015 \text{ W/}^{\circ}\text{C}$

Therefore

$$C_{\min} = C_c = 3015 \text{ W/}^{\circ}\text{C}$$



which is the smaller of the two heat capacity rates. Then the maximum heat transfer rate becomes

$$\mathcal{Q}_{\text{max}} = C_{\text{min}} (T_{h,in} - T_{c,in}) = (3015 \,\text{W/°C})(95^{\circ}\text{C} - 10^{\circ}\text{C}) = 256,275 \,\text{W} = 256.3 \,\text{kW}$$

The outlet temperatures of the cold and the hot streams in this limiting case are determined to be

$$\mathcal{E} = C_c (T_{c,out} - T_{c,in}) \longrightarrow T_{c,out} = T_{c,in} + \underbrace{\mathcal{E}}_{C_c} = 10^{\circ}\text{C} + \underbrace{\frac{256.275 \,\text{kW}}{3.015 \,\text{kW}/^{\circ}\text{C}}} = 95^{\circ}\text{C}$$

$$\mathcal{E} = C_h (T_{h,in} - T_{h,out}) \longrightarrow T_{h,out} = T_{h,in} - \underbrace{\mathcal{E}}_{C_h} = 95^{\circ}\text{C} - \underbrace{\frac{256.275 \,\text{kW}}{4.19 \,\text{kW}/^{\circ}\text{C}}} = 33.8^{\circ}\text{C}$$

23-84 Hot oil is to be cooled by water in a heat exchanger. The mass flow rates and the inlet temperatures are given. The rate of heat transfer and the outlet temperatures are to be determined. $\sqrt{}$

Assumptions 1 Steady operating conditions exist. **2** The heat exchanger is well-insulated so that heat loss to the surroundings is negligible and thus heat transfer from the hot fluid is equal to the heat transfer to the cold fluid. **3** Changes in the kinetic and potential energies of fluid streams are negligible. **4** The thickness of the tube is negligible since it is thin-walled. **5** The overall heat transfer coefficient is constant and uniform.

Properties The specific heats of the water and oil are given to be 4.18 and 2.2 kJ/kg.°C, respectively.

Analysis The heat capacity rates of the hot and cold fluids are

$$C_h = M_h C_{ph} = (0.2 \text{ kg/s})(2200 \text{ J/kg.}^{\circ}\text{C}) = 440 \text{ W/}^{\circ}\text{C}$$

 $C_c = M_c C_{pc} = (0.1 \text{ kg/s})(4180 \text{ J/kg.}^{\circ}\text{C}) = 418 \text{ W/}^{\circ}\text{C}$

Therefore,

$$C_{\min} = C_c = 418 \text{ W/}^{\circ}\text{C}$$

and

$$C = \frac{C_{\text{min}}}{C_{\text{max}}} = \frac{418}{440} = 0.95$$

Then the maximum heat transfer rate becomes

$$\mathcal{Q}_{\text{max}} = C_{\text{min}} (T_{h,in} - T_{c,in}) = (418 \text{ W/}^{\circ}\text{C})(160^{\circ}\text{C} - 18^{\circ}\text{C}) = 59.36 \text{ kW}$$

The heat transfer surface area is

$$A_s = n(\pi DL) = (12)(\pi)(0.018 \,\mathrm{m})(3 \,\mathrm{m}) = 2.04 \,\mathrm{m}^2$$

The NTU of this heat exchanger is

$$NTU = \frac{UA_s}{C_{\min}} = \frac{(340 \text{ W/m}^2.^{\circ}\text{C}) (2.04 \text{ m}^2)}{418 \text{ W/}^{\circ}\text{C}} = 1.659$$

Then the effectiveness of this heat exchanger corresponding to C = 0.95 and NTU = 1.659 is determined from Fig. 23-26d to be

$$\varepsilon = 0.61$$

Then the actual rate of heat transfer becomes

$$\mathcal{E} = \mathcal{E}_{\text{max}} = (0.61)(5936 \,\text{kW}) = 36.2 \,\text{kW}$$

Finally, the outlet temperatures of the cold and hot fluid streams are determined to be

$$\mathcal{E} = C_c (T_{c,out} - T_{c,in}) \longrightarrow T_{c,out} = T_{c,in} + \frac{\mathcal{E}}{C_c} = 18^{\circ}\text{C} + \frac{36.2 \text{ kW}}{0.418 \text{ kW} / {}^{\circ}\text{C}} = 104.6^{\circ}\text{C}$$

$$\mathcal{E} = C_h (T_{h,in} - T_{h,out}) \longrightarrow T_{h,out} = T_{h,in} - \mathcal{E}_h = 160^{\circ} \text{C} - \frac{36.2 \text{ kW}}{0.44 \text{ kW/}^{\circ} \text{C}} = 77.7^{\circ} \text{C}$$

Oil

160°C

0.2 kg/s

23-85 Inlet and outlet temperatures of the hot and cold fluids in a double-pipe heat exchanger are given. It is to be determined whether this is a parallel-flow or counter-flow heat exchanger and the effectiveness of it.

Analysis This is a counter-flow heat exchanger because in the parallel-flow heat exchangers the outlet temperature of the cold fluid (55°C in this case) cannot exceed the outlet temperature of the hot fluid, which is (45°C in this case). Noting that the mass flow rates of both hot and cold oil streams are the same, we have $C_{\min} = C_{\max} = C$. Then the effectiveness of this heat exchanger is determined from

$$\varepsilon = \underbrace{\frac{g}{g_{\text{max}}}}_{\text{max}} = \underbrace{\frac{C_{h}(T_{h,in} - T_{h,out})}{C_{\text{min}}(T_{h,in} - T_{c,in})}}_{C_{in}(T_{h,in} - T_{c,in})} = \underbrace{\frac{C_{h}(T_{h,in} - T_{h,out})}{C_{h}(T_{h,in} - T_{c,in})}}_{\text{80°C} - 20°C} = 0.583$$

23-86E Inlet and outlet temperatures of the hot and cold fluids in a double-pipe heat exchanger are given. It is to be determined the fluid, which has the smaller heat capacity rate and the effectiveness of the heat exchanger.

Analysis Hot water has the smaller heat capacity rate since it experiences a greater temperature change. The effectiveness of this heat exchanger is determined from

$$\varepsilon = \underbrace{\frac{C_{h}(T_{h,in} - T_{h,out})}{C_{min}(T_{h,in} - T_{C,in})}} = \underbrace{\frac{C_{h}(T_{h,in} - T_{h,out})}{C_{h}(T_{h,in} - T_{C,in})}} = \underbrace{\frac{220^{\circ} F - 100^{\circ} F}{220^{\circ} F - 70^{\circ} F}} = 0.8$$

23-87 A chemical is heated by water in a heat exchanger. The mass flow rates and the inlet temperatures are given. The outlet temperatures of both fluids are to be determined.


Assumptions 1 Steady operating conditions exist. **2** The heat exchanger is well-insulated so that heat loss to the surroundings is negligible and thus heat transfer from the hot fluid is equal to the heat transfer to the cold fluid. **3** Changes in the kinetic and potential energies of fluid streams are negligible. **4** The thickness of the tube is negligible since tube is thin-walled. **5** The overall heat transfer coefficient is constant and uniform.

Properties The specific heats of the water and chemical are given to be 4.18 and 1.8 kJ/kg.°C, respectively.

Analysis The heat capacity rates of the hot and cold fluids are

$$C_h = M_h C_{ph} = (2 \text{ kg/s})(4.18 \text{ kJ/kg.}^{\circ}\text{C}) = 8.36 \text{ kW/}^{\circ}\text{C}$$
 $C_c = M_c C_{pc} = (3 \text{ kg/s})(1.8 \text{ kJ/kg.}^{\circ}\text{C}) = 5.40 \text{ kW/}^{\circ}\text{C}$

Therefore,
$$C_{min} = C_c = 5.4 \text{ kW/}^{\circ}\text{C}$$
and
$$C = \frac{C_{min}}{C} = \frac{5.40}{8.36} = 0.646$$



Then the maximum heat transfer rate becomes

$$Q_{\text{max}} = C_{\text{min}} (T_{h,in} - T_{c,in}) = (5.4 \text{ kW/}^{\circ}\text{C})(110^{\circ}\text{C} - 20^{\circ}\text{C}) = 486 \text{ kW}$$

The NTU of this heat exchanger is

$$NTU = UA_s = (1.2 \text{ kW/m}^2.^{\circ}\text{C}) (7 \text{ m}^2) = 1.556$$

Then the effectiveness of this parallel-flow heat exchanger corresponding to C= 0.646 and NTU=1.556 is determined from

$$\epsilon = \underbrace{\frac{1 - \exp[-NTU(1 + C)]}{1 + C}}_{1 + C} = \underbrace{\frac{1 - \exp[-1.556(1 + 0.646)]}{1 + 0.646}}_{1 + 0.646} = 0.56$$

Then the actual rate of heat transfer rate becomes

$$\mathcal{P} = \mathcal{E}_{\text{max}} = (0.56)(486 \text{ kW}) = 272.2 \text{ kW}$$

Finally, the outlet temperatures of the cold and hot fluid streams are determined to be

$$\mathcal{E} = C_c (T_{c,out} - T_{c,in}) \longrightarrow T_{c,out} = T_{c,in} + \frac{\mathcal{E}}{C_c} = 20^{\circ}\text{C} + \frac{272.2 \text{ kW}}{5.4 \text{ kW}/^{\circ}\text{C}} = 70.4^{\circ}\text{C}$$

$$\mathcal{E} = C_h (T_{h,in} - T_{h,out}) \longrightarrow T_{h,out} = T_{h,in} - \frac{\mathcal{E}}{C_h} = 110^{\circ}\text{C} - \frac{272.2 \text{ kW}}{8.36 \text{ kW}/^{\circ}\text{C}} = 77.4^{\circ}\text{C}$$

"GIVEN"

T_chemical_in=20 "[C], parameter to be varied" C_p_chemical=1.8 "[kJ/kg-C]" m_dot_chemical=3 "[kg/s]" "T_w_in=110 [C], parameter to be varied" m_dot_w=2 "[kg/s]" C_p_w=4.18 "[kJ/kg-C]" A=7 "[m^2]" U=1.2 "[kW/m^2-C]"

"ANALYSIS"


"With EES, it is easier to solve this problem using LMTD method than NTU method. Below, we use LMTD method. Both methods give the same results."


DELTAT_1=T_w_in-T_chemical_in
DELTAT_2=T_w_out-T_chemical_out
DELTAT_Im=(DELTAT_1-DELTAT_2)/In(DELTAT_1/DELTAT_2)
Q_dot=U*A*DELTAT_Im
Q_dot=m_dot_chemical*C_p_chemical*(T_chemical_out-T_chemical_in)
Q_dot=m_dot_w*C_p_w*(T_w_in-T_w_out)

T _{chemical, in} [C]	T _{chemical, out} [C]
10	66.06
12	66.94
14	67.82
16	68.7
18	69.58
20	70.45
22	71.33
24	72.21
26	73.09
28	73.97
30	74.85
32	75.73
34	76.61
36	77.48
38	78.36
40	79.24
42	80.12
44	81
46	81.88
48	82.76
50	83.64

Chap 23 *Heat Exchangers*

T _{w, in} [C]	T _{w, out} [C]
80	58.27
85	61.46
90	64.65
95	67.84
100	71.03
105	74.22
110	77.41
115	80.6
120	83.79
125	86.98
130	90.17
135	93.36
140	96.55
145	99.74
150	102.9

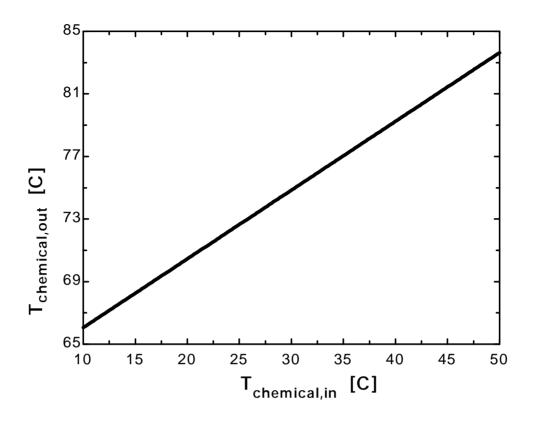

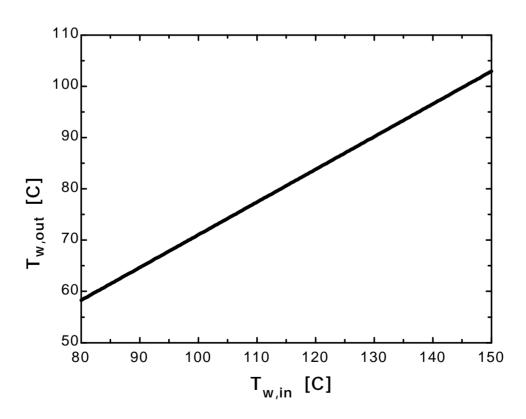

23-89 Water is heated by hot air in a heat exchanger. The mass flow rates and the inlet temperatures are given. The heat transfer surface area of the heat exchanger on the water side is to be determined.

Assumptions 1 Steady operating conditions exist. **2** The heat exchanger is well-insulated so that heat loss to the surroundings is negligible and thus heat transfer from the hot fluid is equal to the heat transfer to the cold fluid. **3** Changes in the kinetic and potential energies of fluid streams are negligible. **4** The overall heat transfer coefficient is constant and uniform.

Properties The specific heats of the water and air are given to be 4.18 and 1.01kJ/kg.°C, respectively.

Analysis The heat capacity rates of the hot and cold fluids are

$$C_h = R_{H_p} C_{ph} = (4 \text{ kg/s})(4.18 \text{ kJ/kg.}^{\circ}\text{C}) = 16.72 \text{ kW/}^{\circ}\text{C}$$

 $C_c = R_{H_c} C_{pc} = (9 \text{ kg/s})(1.01 \text{ kJ/kg.}^{\circ}\text{C}) = 9.09 \text{ kW/}^{\circ}\text{C}$

Therefore.

$$C_{\text{min}} = C_c = 9.09 \text{ kW/}^{\circ}\text{C}$$

and


$$C = \frac{C_{\text{min}}}{C_{\text{max}}} = \frac{9.09}{16.72} = 0.544$$

Then the NTU of this heat exchanger corresponding to C= 0.544 and ϵ = 0.65 is determined from Fig. 23-26 to be

$$NTU = 1.5$$

Then the surface area of this heat exchanger becomes

$$NTU = \frac{UA_s}{C_{min}} \rightarrow A_s = \frac{NTU C_{min}}{U} = \frac{(1.5)(9.09 \text{ kW/°C})}{0.260 \text{ kW/m}^2.°C} = 52.4 \text{ m}^2$$



120°C Steam

Water

17°C

80°C

23-90 Water is heated by steam condensing in a condenser. The required length of the tube is to be determined.

Assumptions 1 Steady operating conditions exist. **2** The heat exchanger is well-insulated so that heat loss to the surroundings is negligible and thus heat transfer from the hot fluid is equal to the heat transfer to the cold fluid. **3** Changes in the kinetic and potential energies of fluid streams are negligible. **4** The overall heat transfer coefficient is constant and uniform.

Properties The specific heat of the water is given to be 4.18 kJ/kg.°C. The heat of vaporization of water at 120°C is given to be 2203 kJ/kg.

Analysis(a) The temperature differences between the steam and the water at the two ends of the condenser are

$$\Delta T_1 = T_{h,in} - T_{c,out} = 120^{\circ} \text{C} - 80^{\circ} \text{C} = 40^{\circ} \text{C}$$

 $\Delta T_2 = T_{h,out} - T_{c,in} = 120^{\circ} \text{C} - 17^{\circ} \text{C} = 103^{\circ} \text{C}$

The logarithmic mean temperature difference is

$$\Delta T_{lm} = \frac{\Delta T_1 - \Delta T_2}{\ln(\Delta T_1 / \Delta T_2)} = \frac{40 - 103}{\ln(40/103)} = 66.6^{\circ}\text{C}$$

The rate of heat transfer is determined from

$$\mathcal{E} = \mathcal{R}_{C} C_{DC} (T_{C,OUT} - T_{C,DD}) = (3 \text{ kg/s})(4.18 \text{ kJ/kg.}^{\circ}\text{C})(80^{\circ}\text{C} - 17^{\circ}\text{C}) = 790.02 \text{ kW}$$

The surface area of heat transfer is

$$\mathcal{E} = UA_s \Delta T_{lm} \longrightarrow A_s = \frac{\mathcal{E}}{U\Delta T_{lm}} = \frac{790.02 \text{ kW}}{0.9 \text{ kW/m}^2 \cdot ^{\circ}\text{C})(66.6 ^{\circ}\text{C})} = 13.18 \text{ m}^2$$

The length of tube required then becomes

$$A_s = \pi DL \longrightarrow L = \frac{A_s}{\pi D} = \frac{13.18 \text{ m}^2}{\pi (0.025 \text{ m})} = 167.8 \text{ m}$$

(b) The rate of heat transfer is

$$\mathcal{Q} = \mathcal{M}_{C}C_{nc}(T_{Cout} - T_{Cin}) = (3 \text{ kg/s})(4.18 \text{ kJ/kg.}^{\circ}\text{C})(80^{\circ}\text{C} - 17^{\circ}\text{C}) = 790.02 \text{ kW}$$

and the maximum rate of heat transfer rate is

$$\mathcal{E}_{\text{max}} = C_{\text{min}} (T_{h,in} - T_{c,in}) = (12.54 \text{ W/}^{\circ}\text{C})(120^{\circ}\text{C} - 17^{\circ}\text{C}) = 1291.62 \text{ kW}$$

Then the effectiveness of this heat exchanger becomes

$$\varepsilon = \frac{Q}{Q_{\text{max}}} = \frac{790.02 \text{ kW}}{1291.62 \text{ kW}} = 0.61$$

The NTU of this heat exchanger is determined using the relation in Table 23-5 to be

$$NTU = -\ln(1 - \varepsilon) = -\ln(1 - 0.61) = 0.942$$

The surface area is

$$NTU = UA_s \longrightarrow A_s = NTU C_{min} = (0.942)(12.54 \text{ kW/°C}) = 13.12 \text{ m}^2$$

Finally, the length of tube required is

$$A_s = \pi D L \longrightarrow L = \frac{A_s}{\pi D} = \frac{13.12 \text{ m}^2}{\pi (0.025 \text{ m})} = 167 \text{ m}$$

120°C ▼

0.03 kg/s

23-91 Ethanol is vaporized by hot oil in a double-pipe parallel-flow heat exchanger. The outlet temperature and the mass flow rate of oil are to be determined using the LMTD and NTU methods.

Assumptions 1 Steady operating conditions exist. **2** The heat exchanger is well-insulated so that heat loss to the surroundings is negligible and thus heat transfer from the hot fluid is equal to the heat transfer to the cold fluid. **3** Changes in the kinetic and potential energies of fluid streams are negligible. **4** The overall heat transfer coefficient is constant and uniform.

Properties The specific heat of oil is given to be 2.2 kJ/kg.°C. The heat of vaporization of ethanol at 78°C is given to be 846 kJ/kg.

Analysis(a) The rate of heat transfer is

$$\mathcal{D} = \hbar h_{fo} = (0.03 \text{ kg/s})(846 \text{ kJ/kg}) = 25.38 \text{ kW}$$

The log mean temperature difference is

$$\&P = UA_s \Delta T_{lm} \longrightarrow \Delta T_{lm} = \underbrace{\&P}_{UA_s} = \underbrace{25,380 \text{ W}}_{(320 \text{ W/m}^2.^{\circ}\text{C})(6.2 \text{ m}^2)} = 12.8^{\circ}\text{C}$$

The outlet temperature of the hot fluid can be determined as follows

$$\Delta T_{1} = T_{h,in} - T_{c,in} = 120^{\circ} \text{C} - 78^{\circ} \text{C} = 42^{\circ} \text{C}$$

$$\Delta T_{2} = T_{h,out} - T_{c,out} = T_{h,out} - 78^{\circ} \text{C}$$

$$\Delta T_{lm} = \frac{\Delta T_{1} - \Delta T_{2}}{\ln(\Delta T_{1} / \Delta T_{2})} = \frac{42 - (T_{h,out} - 78)}{\ln[42 / (T_{h,out} - 78)]} = 12.8^{\circ} \text{C}$$

whose solution is

and

$$T_{h,out} = 79.8^{\circ} \text{C}$$

Then the mass flow rate of the hot oil becomes

$$\mathcal{E} = \text{Mr} C_p(T_{h,in} - T_{h,out}) - \cdots \rightarrow \mathcal{E}_{N} = \underbrace{\mathcal{E}_p(T_{h,in} - T_{h,out})}_{C_p(T_{h,in} - T_{h,out})} = \underbrace{\frac{25,380 \, \text{W}}{(2200 \, \text{J/kg.}^\circ\text{C})(120^\circ\text{C} - 79.8^\circ\text{C})}}_{= 0.287 \, \text{kg/s}} = 0.287 \, \text{kg/s}$$

(b) The heat capacity rate $C = \hbar u C_p$ of a fluid condensing or evaporating in a heat exchanger is infinity, and thus $C = C_{\min} / C_{\max} = 0$.

The efficiency in this case is determined from $\varepsilon = 1 - e^{-NTU}$

where
$$NTU = UA_s$$

$$C_{min} = \frac{(320 \text{ W/m}^2 \cdot ^\circ\text{C})(6.2 \text{ m}^2)}{(\text{Mz, kg/s})(2200 \text{ J/kg.}^\circ\text{C})}$$
and $C_{max} = C_{min} (T_{h,in} - T_{c,in})$

$$C_{min} (T_{h,in} - T_{c,in}) = \frac{120 - T_{h,out}}{120 - 78}$$

$$C_{min} (T_{h,in} - T_{c,in}) = 25,380 \text{ W}$$

$$C_{min} = \frac{120 - T_{h,out}}{120 - 78} = 1 - e^{\frac{6.2 \times 320}{h \times 2200}}$$
(2)

$$M_{h} = 0.287 \text{ kg/s} \text{ and } T_{h,out} = 79.8^{\circ}\text{C}$$

23-92 Water is heated by solar-heated hot air in a heat exchanger. The mass flow rates and the inlet temperatures are given. The outlet temperatures of the water and the air are to be determined.

Assumptions 1 Steady operating conditions exist. **2** The heat exchanger is well-insulated so that heat loss to the surroundings is negligible and thus heat transfer from the hot fluid is equal to the heat transfer to the cold fluid. **3** Changes in the kinetic and potential energies of fluid streams are negligible. **4** The overall heat transfer coefficient is constant and uniform.

Properties The specific heats of the water and air are given to be 4.18 and 1.01 kJ/kg.°C, respectively.

Analysis The heat capacity rates of the hot and cold fluids are

$$C_h = \hbar u_h C_{ph} = (0.3 \text{kg/s})(1010 \text{ J/kg.}^{\circ}\text{C}) = 303 \text{ W/}^{\circ}\text{C}$$

 $C_c = \hbar u_c C_{pc} = (0.1 \text{ kg/s})(4180 \text{ J/kg.}^{\circ}\text{C}) = 418 \text{ W/}^{\circ}\text{C}$

Therefore,
$$C_{\text{min}} = C_c = 303 \text{ W/}^{\circ}\text{C}$$
 and $C = \frac{C_{\text{min}}}{C_{\text{max}}} = \frac{303}{418} = 0.725$

Then the maximum heat transfer rate becomes

$$\mathcal{E}_{\text{max}} = C_{\text{min}} (T_{h,in} - T_{c,in})$$

= (303 W/°C)(90°C - 22°C) = 20,604 kW

The heat transfer surface area is

$$A_s = \pi D L = (\pi)(0.012 \,\mathrm{m})(12 \,\mathrm{m}) = 0.45 \,\mathrm{m}^2$$

Then the NTU of this heat exchanger becomes

$$NTU = \frac{UA_s}{C_{min}} = \frac{(80 \text{ W/m}^2.^{\circ}\text{C}) (0.45 \text{ m}^2)}{303 \text{ W/}^{\circ}\text{C}} = 0.119$$

Cold Water
22°C
0.1 kg/s

Hot Air
90°C
0.3 kg/s

The effectiveness of this counter-flow heat exchanger corresponding to C=0.725 and NTU=0.119 is determined using the relation in Table 23-5 to be

$$\epsilon = \underbrace{\frac{1 - \exp[-NTU(1 - C)]}{1 - C\exp[-NTU(1 - C)]}}_{1 - C\exp[-NTU(1 - C)]} = \underbrace{\frac{1 - \exp[-0.119(1 - 0.725)]}{1 - 0.725\exp[-0.119(1 - 0.725)]}}_{1 - 0.725\exp[-0.119(1 - 0.725)]} = 0.108$$

Then the actual rate of heat transfer becomes

$$\mathcal{P} = \varepsilon \mathcal{P}_{\text{max}} = (0.108)(20,604 \text{ W}) = 2225.2 \text{ W}$$

Finally, the outlet temperatures of the cold and hot fluid streams are determined to be

$$\mathcal{P} = C_c (T_{c,out} - T_{c,in}) \longrightarrow T_{c,out} = T_{c,in} + \frac{\mathcal{P}}{C_c} = 22^{\circ}\text{C} + \frac{2225.2 \text{ W}}{418 \text{ W} / {^{\circ}\text{C}}} = 27.3^{\circ}\text{C}$$

$$\mathcal{E} = C_h (T_{h,in} - T_{h,out}) \longrightarrow T_{h,out} = T_{h,in} - \mathcal{E}_h = 90^{\circ}\text{C} - \frac{2225.2 \text{ W}}{303 \text{ W/}^{\circ}\text{C}} = 82.7^{\circ}\text{C}$$

"GIVEN"

$$\label{eq:table_transform} \begin{split} &T_air_in=90 \text{ "[C]"} \\ &m_dot_air=0.3 \text{ "[kg/s]"} \\ &C_p_air=1.01 \text{ "[kJ/kg-C]"} \\ &T_w_in=22 \text{ "[C]"} \\ &m_dot_w=0.1 \text{ "[kg/s], parameter to be varied"} \\ &C_p_w=4.18 \text{ "[kJ/kg-C]"} \\ &U=0.080 \text{ "[kW/m^2-C]"} \\ &U=12 \text{ [m], parameter to be varied"} \\ &D=0.012 \text{ "[m]"} \end{split}$$

"ANALYSIS"


"With EES, it is easier to solve this problem using LMTD method than NTU method. Below, we use LMTD method. Both methods give the same results."

DELTAT_1=T_air_in-T_w_out
DELTAT_2=T_air_out-T_w_in
DELTAT_Im=(DELTAT_1-DELTAT_2)/In(DELTAT_1/DELTAT_2)
A=pi*D*L
Q_dot=U*A*DELTAT_Im
Q_dot=m_dot_air*C_p_air*(T_air_in-T_air_out)
Q_dot=m_dot_w*C_p_w*(T_w_out-T_w_in)


m _w [kg/s]	Tw, out [C]	Tair, out [C]
0.05	32.27	82.92
0.1	27.34	82.64
0.15	25.6	82.54
0.2	24.72	82.49
0.25	24.19	82.46
0.3	23.83	82.44
0.35	23.57	82.43
0.4	23.37	82.42
0.45	23.22	82.41
0.5	23.1	82.4
0.55	23	82.4
0.6	22.92	82.39
0.65	22.85	82.39
0.7	22.79	82.39
0.75	22.74	82.38
0.8	22.69	82.38
0.85	22.65	82.38
0.9	22.61	82.38
0.95	22.58	82.38
1	22.55	82.37

Chap 23 *Heat Exchangers*

L [m]	Tw, out [C]	Tair, out [C]
5	24.35	86.76
6	24.8	86.14
7	25.24	85.53
8	25.67	84.93
9	26.1	84.35
10	26.52	83.77
11	26.93	83.2
12	27.34	82.64
13	27.74	82.09
14	28.13	81.54
15	28.52	81.01
16	28.9	80.48
17	29.28	79.96
18	29.65	79.45
19	30.01	78.95
20	30.37	78.45
21	30.73	77.96
22	31.08	77.48
23	31.42	77
24	31.76	76.53
25	32.1	76.07

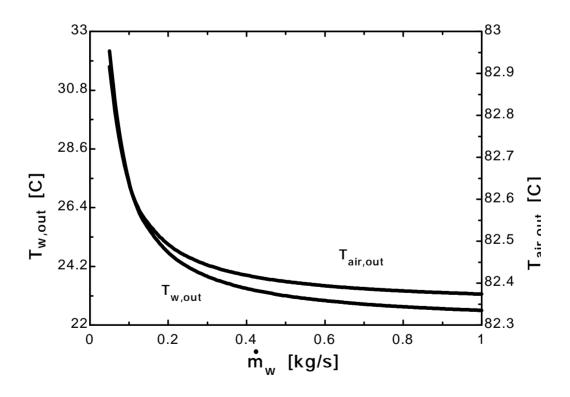



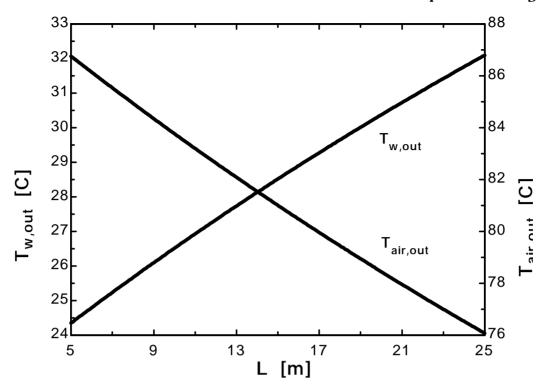

23-94E Oil is cooled by water in a double-pipe heat exchanger. The overall heat transfer coefficient of this heat exchanger is to be determined using both the LMTD and NTU methods.

Assumptions 1 Steady operating conditions exist. **2** The heat exchanger is well-insulated so that heat loss to the surroundings is negligible and thus heat transfer from the hot fluid is equal to the heat transfer to the cold fluid. **3** Changes in the kinetic and potential energies of fluid streams are negligible. **4** The thickness of the tube is negligible since it is thin-walled.

Properties The specific heats of the water and oil are given to be 1.0 and 0.525 Btu/lbm.°F, respectively. **Analysis** (a) The rate of heat transfer is

$$\mathcal{E} = \mathcal{E}_{h} C_{nh} (T_{h in} - T_{h out}) = (5 \text{ lbm/s})(0.525 \text{ Btu/lbm.}^{\circ}\text{F})(300 - 105^{\circ}\text{F}) = 511.9 \text{ Btu/s}$$

The outlet temperature of the cold fluid is

$$\mathcal{E} = \mathcal{R}_{c} C_{pc} (T_{c,out} - T_{c,in}) \longrightarrow T_{c,out} = T_{c,in} + \frac{\mathcal{E}}{\mathcal{R}_{c} C_{pc}} = 70^{\circ} \text{F} + \frac{511.9 \text{ Btu/s}}{(3 \text{ lbm/s})(1.0 \text{ Btu/lbm.}^{\circ} \text{F})} = 240.6^{\circ} \text{F}$$

The temperature differences between the two fluids at the two ends of the heat exchanger are


$$\Delta I_1^r = I_{h,in} - I_{c,out} = 300^{\circ} \text{ F} - 240.6^{\circ} \text{ F} = 59.4^{\circ} \text{ F}$$

 $\Delta I_2^r = I_{h,out} - I_{c,in} = 105^{\circ} \text{ F} - 70^{\circ} \text{ F} = 35^{\circ} \text{ F}$

The logarithmic mean temperature difference is

$$\Delta T_{lm} = \frac{\Delta T_1 - \Delta T_2}{\ln(\Delta T_1 / \Delta T_2)} = \frac{59.4 - 35}{\ln(59.4/35)} = 46.1$$
°F

Then the overall heat transfer coefficient becomes



$$\mathcal{E} = UA_s \Delta T_{lm} \longrightarrow U = \underbrace{\mathcal{E}}_{A_s \Delta T_{lm}} = \underbrace{\frac{511.9 \,\text{Btu/s}}{\pi (1/12 \,\text{m})(20 \,\text{ft})(46.1^{\circ}\text{F})}} = 2.12 \,\text{Btu/s.ft}^2. \,^{\circ}\text{F}$$

(b) The heat capacity rates of the hot and cold fluids are

$$C_h = \mathcal{R}_h C_{ph} = (5 \text{ lbm/s})(0.525 \text{ Btu/lbm.}^\circ \text{F}) = 2.625 \text{ Btu/s.}^\circ \text{F}$$

 $C_c = \mathcal{R}_c C_{pc} = (3 \text{ lbm/s})(1.0 \text{ Btu/lbm.}^\circ \text{F}) = 3.0 \text{ Btu/s.}^\circ \text{F}$

Therefore,
$$C_{\min} = C_h = 2.625 \text{ Btu/s.}^{\circ}\text{F}$$
 and $C = \frac{C_{\min}}{C_{\max}} = \frac{2.625}{3.0} = 0.875$

Then the maximum heat transfer rate becomes

$$\mathcal{E}_{\text{max}} = C_{\text{min}} (T_{h,in} - T_{c,in}) = (2.625 \text{ Btu / s.}^{\circ} \text{F})(300^{\circ} \text{F} - 70^{\circ} \text{F}) = 603.75 \text{ Btu / s.}^{\circ}$$

The actual rate of heat transfer and the effectiveness are

$$\mathcal{E} = C_h (T_{h,in} - T_{h,out}) = (2.625 \text{ Btu/s.}^\circ \text{F})(300^\circ \text{F-}105^\circ \text{F}) = 511.9 \text{ Btu/s}$$

$$\varepsilon = \frac{\mathcal{E}}{\mathcal{E}_{\text{max}}} = \frac{511.9}{603.75} = 0.85$$

The NTU of this heat exchanger is determined using the relation in Table 23-3 to be

$$NTU = \frac{1}{C-1} \ln \left(\frac{\varepsilon - 1}{\varepsilon C - 1} \right) = \frac{1}{0.875 - 1} \ln \left(\frac{0.85 - 1}{0.85 \times 0.875 - 1} \right) = 4.28$$

The heat transfer surface area of the heat exchanger is

$$A_s = \pi D L = \pi (1/12 \text{ ft})(20 \text{ ft}) = 5.24 \text{ ft}^2$$

and
$$NTU = UA_s \longrightarrow U = NTU C_{min} \longrightarrow U = (4.28)(2.625 \text{ Btu/s.}^\circ\text{F}) = 2.14 \text{ Btu/s.ft}^2.^\circ\text{F}$$

Cold Water

₹ 45°C

15°C 0.25 kg/s

23-95 Cold water is heated by hot water in a heat exchanger. The net rate of heat transfer and the heat transfer surface area of the heat exchanger are to be determined.

Assumptions 1 Steady operating conditions exist. **2** The heat exchanger is well-insulated so that heat loss to the surroundings is negligible and thus heat transfer from the hot fluid is equal to the heat transfer to the cold fluid. **3** Changes in the kinetic and potential energies of fluid streams are negligible. **4** The overall heat transfer coefficient is constant and uniform. **5** The thickness of the tube is negligible.

Properties The specific heats of the cold and hot water are given to be 4.18 and 4.19 kJ/kg.°C, respectively.

Analysis The heat capacity rates of the hot and cold fluids are

$$C_h = M_h C_{ph} = (0.25 \text{ kg/s})(4180 \text{ J/kg.}^{\circ}\text{C}) = 1045 \text{ W/}^{\circ}\text{C}$$
 $C_c = M_c C_{pc} = (3 \text{ kg/s})(4190 \text{ J/kg.}^{\circ}\text{C}) = 12,570 \text{ W/}^{\circ}\text{C}$

Therefore,
$$C_{min} = C_c = 1045 \text{ W/}^{\circ}\text{C}$$
and
$$C = \frac{C_{min}}{C} = \frac{1045}{12,570} = 0.083$$
Hot Water

Then the maximum heat transfer rate becomes

$$\mathcal{Q}_{\text{max}} = C_{\text{min}} (T_{h,in} - T_{c,in}) = (1045 \text{ W/}^{\circ}\text{C})(100^{\circ}\text{C} - 15^{\circ}\text{C}) = 88,825 \text{ W}$$

The actual rate of heat transfer is

$$\mathcal{D} = C_h(T_{h in} - T_{h out}) = (1045 \text{ W/°C})(45^{\circ}\text{C} - 15^{\circ}\text{C}) = 31,350 \text{ W}$$

Then the effectiveness of this heat exchanger becomes

$$\varepsilon = \frac{Q}{Q_{\text{max}}} = \frac{31,350}{88,825} = 0.35$$

The NTU of this heat exchanger is determined using the relation in Table 23-5 to be

$$NTU = \frac{1}{C-1} \ln \left(\frac{\varepsilon - 1}{\varepsilon C - 1} \right) = \frac{1}{0.083 - 1} \ln \left(\frac{0.35 - 1}{0.35 \times 0.083 - 1} \right) = 0.438$$

Then the surface area of the heat exchanger is determined from

$$NTU = UA \longrightarrow A = NTU C_{min} = \frac{(0.438)(1045 \text{ W/°C})}{950 \text{ W/m}^2.°\text{C}} = 0.482 \text{ m}^2$$

"GIVEN"

T_cw_in=15 "[C]"

T_cw_out=45 "[C]"

m_dot_cw=0.25 "[kg/s]"

C_p_cw=4.18 "[kJ/kg-C]"

T_hw_in=100 "[C], parameter to be varied"

m_dot_hw=3 "[kg/s]"

C_p_hw=4.19 "[kJ/kg-C]"

"U=0.95 [kW/m^2-C], parameter to be varied"

"ANALYSIS"

"With EES, it is easier to solve this problem using LMTD method than NTU method. Below, we use LMTD method. Both methods give the same results."

DELTAT_1=T_hw_in-T_cw_out

DELTAT_2=T_hw_out-T_cw_in

DELTAT_Im=(DELTAT_1-DELTAT_2)/In(DELTAT_1/DELTAT_2)

 $Q_dot=U^*A^*DELTAT_Im$


 $Q_dot=m_dot_hw^*C_p_hw^*(T_hw_in-T_hw_out)$


Q_dot=m_dot_cw*C_p_cw*(T_cw_out-T_cw_in)

T _{hw, in} [C]	Q [kW]	A [m ²]
60	31.35	1.25
65	31.35	1.038
70	31.35	0.8903
75	31.35	0.7807
80	31.35	0.6957
85	31.35	0.6279
90	31.35	0.5723
95	31.35	0.5259
100	31.35	0.4865
105	31.35	0.4527
110	31.35	0.4234
115	31.35	0.3976
120	31.35	0.3748

U [kW/m ² -C]	Q [kW]	A [m ²]
0.75	31.35	0.6163
0.8	31.35	0.5778
0.85	31.35	0.5438
0.9	31.35	0.5136
0.95	31.35	0.4865
1	31.35	0.4622
1.05	31.35	0.4402
1.1	31.35	0.4202
1.15	31.35	0.4019
1.2	31.35	0.3852
1.25	31.35	0.3698



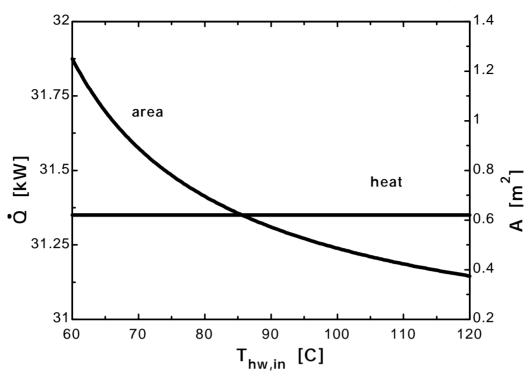

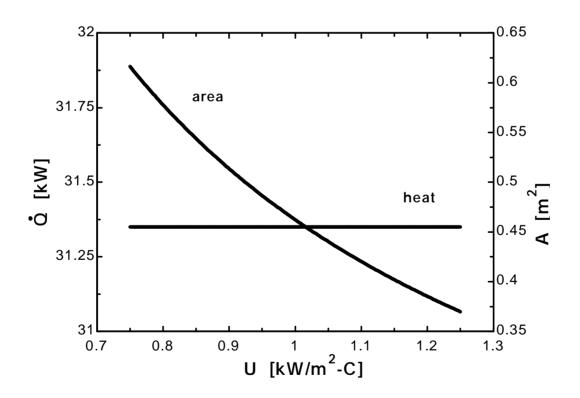

23-97 Glycerin is heated by ethylene glycol in a heat exchanger. Mass flow rates and inlet temperatures are given. The rate of heat transfer and the outlet temperatures are to be determined.

Assumptions 1 Steady operating conditions exist. **2** The heat exchanger is well-insulated so that heat loss to the surroundings is negligible and thus heat transfer from the hot fluid is equal to the heat transfer to the cold fluid. **3** Changes in the kinetic and potential energies of fluid streams are negligible. **4** The overall heat transfer coefficient is constant and uniform. **5** The thickness of the tube is negligible.

Properties The specific heats of the glycerin and ethylene glycol are given to be 2.4 and 2.5 kJ/kg.°C, respectively.

Analysis (a) The heat capacity rates of the hot and cold fluids are $C_h = \frac{\hbar u_h C_{ph}}{k_B C_{ph}} = (0.3 \text{ kg/s})(2400 \text{ J/kg.}^{\circ}\text{C}) = 720 \text{ W/}^{\circ}\text{C}$ $C_c = \frac{\hbar u_c C_{pc}}{k_B C_{pc}} = (0.3 \text{ kg/s})(2500 \text{ J/kg.}^{\circ}\text{C}) = 750 \text{ W/}^{\circ}\text{C}$ Therefore, $C_{min} = C_h = 720 \text{ W/}^{\circ}\text{C}$ and $C = \frac{C_{min}}{C_{max}} = \frac{720}{750} = 0.96$ Ethylene

Then the maximum heat transfer rate becomes

$$\mathcal{Q}_{\text{max}} = C_{\text{min}} (T_{h,in} - T_{c,in}) = (720 \text{ W/}^{\circ}\text{C})(60^{\circ}\text{C} - 20^{\circ}\text{C}) = 28.8 \text{ kW}$$

The NTU of this heat exchanger is

$$NTU = \frac{UA_s}{C_{\min}} = \frac{(380 \text{ W/m}^2.^{\circ}\text{C})(5.3 \text{ m}^2)}{720 \text{ W/}^{\circ}\text{C}} = 2.797$$

Effectiveness of this heat exchanger corresponding to C = 0.96 and NTU = 2.797 is determined using the proper relation in Table 23-4

$$\varepsilon = \frac{1 - \exp[-NTU(1+C)]}{1+C} = \frac{1 - \exp[-2.797(1+0.96)]}{1+0.96} = 0.508$$

Then the actual rate of heat transfer becomes

$$\mathcal{P} = \varepsilon \mathcal{P}_{\text{max}} = (0.508)(288 \text{ kW}) = 14.63 \text{ kW}$$

(A) Finally, the outlet temperatures of the cold and the hot fluid streams are determined from

$$\mathcal{E} = C_{c}(T_{c,out} - T_{c,in}) \longrightarrow T_{c,out} = T_{c,in} + \frac{\mathcal{E}}{C_{c}} = 20^{\circ}\text{C} + \frac{14.63 \text{ kW}}{0.72 \text{ kW}/^{\circ}\text{C}} = 40.3^{\circ}\text{C}$$

$$\mathcal{E} = C_{h}(T_{h,in} - T_{h,out}) \longrightarrow T_{h,out} = T_{h,in} - \frac{\mathcal{E}}{C_{h}} = 60^{\circ}\text{C} - \frac{14.63 \text{ kW}}{0.75 \text{ kW}/^{\circ}\text{C}} = 40.5^{\circ}\text{C}$$

23-98 Water is heated by hot air in a cross-flow heat exchanger. Mass flow rates and inlet temperatures are given. The rate of heat transfer and the outlet temperatures are to be determined.

Assumptions 1 Steady operating conditions exist. **2** The heat exchanger is well-insulated so that heat loss to the surroundings is negligible and thus heat transfer from the hot fluid is equal to the heat transfer to the cold fluid. **3** Changes in the kinetic and potential energies of fluid streams are negligible. **4** The overall heat transfer coefficient is constant and uniform. **5** The thickness of the tube is negligible.

Properties The specific heats of the water and air are given to be 4.18 and 1.01 kJ/kg.°C, respectively.

Analysis The mass flow rates of the hot and the cold fluids are

$$\hbar v_c = \rho V A_c = (1000 \text{ kg/m}^3)(3 \text{ m/s})[40\pi (0.01 \text{ m})^2 / 4] = 9.425 \text{ kg/s}$$

$$\rho_{air} = P = 105 \text{ kPa} = 0.908 \text{ kg/m}^3$$

 $(0.287 \text{ kPa.m}^3/\text{kg.K}) \times (130 + 273 \text{ K}) = 0.908 \text{ kg/m}^3$


$$\hbar u_h = \rho V A_c = (0.908 \text{ kg/m}^3)(12 \text{ m/s})(1 \text{ m})^2 = 10.90 \text{ kg/s}$$

The heat transfer surface area and the heat capacity rates are

$$A_s = m\pi DL = 80\pi (0.01 \,\mathrm{m})(1 \,\mathrm{m}) = 2.513 \,\mathrm{m}^2$$

$$C_h = k_h C_{ph} = (9.425 \text{ kg/s})(4.18 \text{ kJ/kg.}^{\circ}\text{C}) = 39.4 \text{ kW/}^{\circ}\text{C}$$

$$C_c = k \omega_c C_{DC} = (10.9 \text{ kg/s})(1.010 \text{ kJ/kg.}^{\circ}\text{C}) = 11.01 \text{ kW/}^{\circ}\text{C}$$



Therefore,
$$C_{\min} = C_c = 11.01 \text{ kW/}^{\circ}\text{C}$$
 and $C = \frac{C_{\min}}{C_{\max}} = \frac{11.01}{39.40} = 0.2794$

$$\mathcal{E}_{\text{max}} = C_{\text{min}} (T_{h,in} - T_{C,in}) = (11.01 \text{ kW/}^{\circ}\text{C})(30^{\circ}\text{C} - 18^{\circ}\text{C}) = 1233 \text{ kW}$$

The NTU of this heat exchanger is

$$NTU = UA_s = \frac{(130 \text{ W/m}^2.^{\circ}\text{C})(2.513 \text{ m}^2)}{11,010 \text{ W/}^{\circ}\text{C}} = 0.02967$$

Noting that this heat exchanger involves mixed cross-flow, the fluid with C_{min} is mixed, C_{max} unmixed, effectiveness of this heat exchanger corresponding to C = 0.2794 and NTU = 0.02967 is determined using the proper relation in Table 23-4 to be

$$\varepsilon = 1 - \exp \left[-\frac{1}{C} (1 - e^{-CNTU}) \right] = 1 - \exp \left[-\frac{1}{0.2794} (1 - e^{-0.2794 \times 0.02967}) \right] = 0.02912$$

Then the actual rate of heat transfer becomes

$$\mathcal{P} = \mathcal{E}_{\text{max}} = (0.02912)(1233 \text{ kW}) = 35.90 \text{ kW}$$

Finally, the outlet temperatures of the cold and the hot fluid streams are determined from

$$\mathcal{E} = C_c (T_{c,out} - T_{c,in}) \longrightarrow T_{c,out} = T_{c,in} + \underbrace{\mathcal{E}}_{C_c} = 18^{\circ}\text{C} + \underbrace{\frac{35.90 \text{ kW}}{39.40 \text{ kW}}}_{\circ} = 18.9^{\circ}\text{C}$$

$$\mathcal{E} = C_h (T_{h,in} - T_{h,out}) \longrightarrow T_{h,out} = T_{h,in} - \underbrace{\mathcal{E}}_{C_c} = 130^{\circ}\text{C} - \underbrace{\frac{35.90 \text{ kW}}{39.40 \text{ kW}}}_{\circ} = 126.7^{\circ}\text{C}$$

23-99 Ethyl alcohol is heated by water in a shell-and-tube heat exchanger. The heat transfer surface area of the heat exchanger is to be determined using both the LMTD and NTU methods.

Assumptions 1 Steady operating conditions exist. **2** The heat exchanger is well-insulated so that heat loss to the surroundings is negligible and thus heat transfer from the hot fluid is equal to the heat transfer to the cold fluid. **3** Changes in the kinetic and potential energies of fluid streams are negligible. **4** The overall heat transfer coefficient is constant and uniform.

Properties The specific heats of the ethyl alcohol and water are given to be 2.67 and 4.19 kJ/kg.°C, respectively.

Analysis(a) The temperature differences between the two fluids at the two ends of the heat exchanger are

$$\Delta T_1 = T_{h,in} - T_{c,out} = 95^{\circ}\text{C} - 70^{\circ}\text{C} = 25^{\circ}\text{C}$$


 $\Delta T_2 = T_{h,out} - T_{c,in} = 60^{\circ}\text{C} - 25^{\circ}\text{C} = 35^{\circ}\text{C}$

The logarithmic mean temperature difference and the correction factor are

$$\Delta T_{Im,CF} = \frac{\Delta T_1 - \Delta T_2}{\ln(\Delta T_1 / \Delta T_2)} = \frac{25 - 35}{\ln(25/35)} = 29.7^{\circ}\text{C}$$

$$P = \frac{t_2 - t_1}{T_1 - t_1} = \frac{70 - 25}{95 - 25} = 0.64$$

$$R = \frac{T_2 - T_1}{t_1 - t_1} = \frac{95 - 60}{70 - 25} = 0.78$$



The rate of heat transfer is determined from

$$\mathcal{D} = M_{C}C_{pc}(T_{C,out} - T_{C,in}) = (2.1 \text{ kg/s})(2.67 \text{ kJ/kg.}^{\circ}\text{C})(70^{\circ}\text{C} - 25^{\circ}\text{C}) = 252.3 \text{ kW}$$

The surface area of heat transfer is

$$\mathcal{E} = UA_s \Delta T_{lm} \longrightarrow A_s = \underbrace{UF_\Delta T_{lm}}_{O.8 \text{ kW/m}^2} = \underbrace{252.3 \text{ kW}}_{O.8 \text{ kW/m}^2} = 11.4 \text{ m}^2$$

(b) The rate of heat transfer is

$$\mathcal{E} = \hbar_{C} C_{pc} (T_{C,out} - T_{C,in}) = (2.1 \text{ kg/s})(2.67 \text{ kJ/kg.}^{\circ}\text{C})(70^{\circ}\text{C} - 25^{\circ}\text{C}) = 252.3 \text{ kW}$$

The mass flow rate of the hot fluid is

$$\mathcal{E} = \mathcal{H}_{h} C_{ph} (T_{h,in} - T_{h,out}) \rightarrow \mathcal{H}_{h} = \underbrace{C_{ph} (T_{h,in} - T_{h,out})}_{C_{ph} (T_{h,in} - T_{h,out})} = \underbrace{252.3 \, \text{kW}}_{(4.19 \, \text{kJ/kg.}^{\circ}\text{C})(95^{\circ}\text{C} - 60^{\circ}\text{C})} = 1.72 \, \text{kg/s}$$

The heat capacity rates of the hot and the cold fluids are

$$C_h = \hbar k_h C_{ph} = (1.72 \text{ kg/s})(4.19 \text{ kJ/kg.}^{\circ}\text{C}) = 7.21 \text{ kW/}^{\circ}\text{C}$$

 $C_c = \hbar k_c C_{pc} = (2.1 \text{ kg/s})(2.67 \text{ kJ/kg.}^{\circ}\text{C}) = 5.61 \text{ kW/}^{\circ}\text{C}$

Therefore,
$$C_{\text{min}} = C_c = 5.61 \text{ W/°C}$$
 and $C = \frac{C_{\text{min}}}{C_{\text{max}}} = \frac{5.61}{7.21} = 0.78$

Then the maximum heat transfer rate becomes

$$\mathcal{E}_{\text{max}} = C_{\text{min}} (T_{h,in} - T_{c,in}) = (5.61 \text{ W/°C})(95^{\circ}\text{C} - 25^{\circ}\text{C}) = 392.7 \text{ kW}$$

The effectiveness of this heat exchanger is

$$\varepsilon = \frac{Q}{Q_{\text{max}}} = \frac{252.3}{392.7} = 0.64$$

The NTU of this heat exchanger corresponding to this emissivity and C = 0.78 is determined from Fig. 23-26d to be NTU = 1.7. Then the surface area of heat exchanger is determined to be

$$NTU = UA_s \longrightarrow A_s = UTU C_{min} = \frac{(1.7)(5.61 \text{ kW/°C})}{0.8 \text{ kW/m}^2.°C} = 11.9 \text{ m}^2$$

The small difference between the two results is due to the reading error of the chart.

23-100 Steam is condensed by cooling water in a shell-and-tube heat exchanger. The rate of heat transfer and the rate of condensation of steam are to be determined.

Assumptions 1 Steady operating conditions exist. **2** The heat exchanger is well-insulated so that heat loss to the surroundings is negligible and thus heat transfer from the hot fluid is equal to the heat transfer to the cold fluid. **3** Changes in the kinetic and potential energies of fluid streams are negligible. **4** The overall heat transfer coefficient is constant and uniform. **5** The thickness of the tube is negligible.

Properties The specific heat of the water is given to be 4.18 kJ/kg.°C. The heat of condensation of steam at 30°C is given to be 2430 kJ/kg.

Analysis(a) The heat capacity rate of a fluid condensing in a heat exchanger is infinity. Therefore,

$$C_{\min} = C_c = \hbar R_c C_{pc} = (0.5 \text{ kg/s})(4.18 \text{ kJ/kg.}^{\circ}\text{C}) = 2.09 \text{ kW/}^{\circ}\text{C}$$

and C=0

Then the maximum heat transfer rate becomes

$$\mathcal{Q}_{\text{max}} = C_{\text{min}} (T_{h/n} - T_{C/n}) = (2.09 \text{ kW/}^{\circ}\text{C})(30^{\circ}\text{C} - 15^{\circ}\text{C}) = 31.35 \text{ kW}$$

and

$$A_s = 8 m\pi DL = 8 \times 50 \pi (0.015 \text{ m}) (2 \text{ m}) = 37.7 \text{ m}^2$$

The NTU of this heat exchanger

$$NTU = UA_s = \frac{(3 \text{ kW/m}^2.^{\circ}\text{C}) (37.7 \text{ m}^2)}{2.09 \text{ kW/}^{\circ}\text{C}} = 54.11$$

Then the effectiveness of this heat exchanger corresponding to C=0 and NTU = 6.76 is determined using the proper relation in Table 23-5


$$\varepsilon = 1 - \exp(-NTU) = 1 - \exp(-6.76) = 1$$

Then the actual heat transfer rate becomes

$$\mathcal{P} = \mathcal{E}_{\text{max}} = (1)(31.35 \text{kW}) = 31.35 \text{kW}$$

(1) Finally, the rate of condensation of the steam is determined from

$$\& = \& h_{fg} \longrightarrow \& = \frac{\&}{h_{fg}} = \frac{31.4 \text{ kJ/s}}{2430 \text{ kJ/kg}} = 0.0129 \text{ kg/s}$$



23-101

"GIVEN"

N pass=8

N_tube=50

T_steam=30 "[C], parameter to be varied"

h_fg_steam=2430 "[kJ/kg]"

T_w_in=15 "[C]"

m_dot_w=1800/Convert(kg/s, kg/h) "[kg/s]"

C_p_w=4.18 "[kJ/kg-C]"

D=1.5 "[cm], parameter to be varied"

L=2 "[m]"

U=3 "[kW/m^2-C]"

"ANALYSIS"

"With EES, it is easier to solve this problem using LMTD method than NTU method. Below, we use NTU method. Both methods give the same results."

"(a)"

 $C_min=m_dot_w*C_p_w$

C=0 "since the heat capacity rate of a fluid condensing is infinity"

Q_dot_max=C_min*(T_steam-T_w_in)

A=N_pass*N_tube*pi*D*L*Convert(cm, m)

NTU=(U*A)/C_min

epsilon=1-exp(-NTU) "from Table 23-4 of the text with C=0"

Q dot=epsilon*Q dot max


"(b)

Q_dot=m_dot_cond*h_fg_steam


T _{steam} [C]	Q [kW]	m _{cond} [kg/s]
20	10.45	0.0043
22.5	15.68	0.006451
25	20.9	0.008601
27.5	26.12	0.01075
30	31.35	0.0129
32.5	36.58	0.01505
35	41.8	0.0172
37.5	47.03	0.01935
40	52.25	0.0215
42.5	57.47	0.02365
45	62.7	0.0258
47.5	67.93	0.02795
50	73.15	0.0301
52.5	78.38	0.03225
55	83.6	0.0344
57.5	88.82	0.03655
60	94.05	0.0387
62.5	99.27	0.04085
65	104.5	0.043
67.5	109.7	0.04515
70	114.9	0.0473

Chap 23 *Heat Exchangers*

D [cm]	Q [kW]	m _{cond} [kg/s]
1	31.35	0.0129
1.05	31.35	0.0129
1.1	31.35	0.0129
1.15	31.35	0.0129
1.2	31.35	0.0129
1.25	31.35	0.0129
1.3	31.35	0.0129
1.35	31.35	0.0129
1.4	31.35	0.0129
1.45	31.35	0.0129
1.5	31.35	0.0129
1.55	31.35	0.0129
1.6	31.35	0.0129
1.65	31.35	0.0129
1.7	31.35	0.0129
1.75	31.35	0.0129
1.8	31.35	0.0129
1.85	31.35	0.0129
1.9	31.35	0.0129
1.95	31.35	0.0129
2	31.35	0.0129

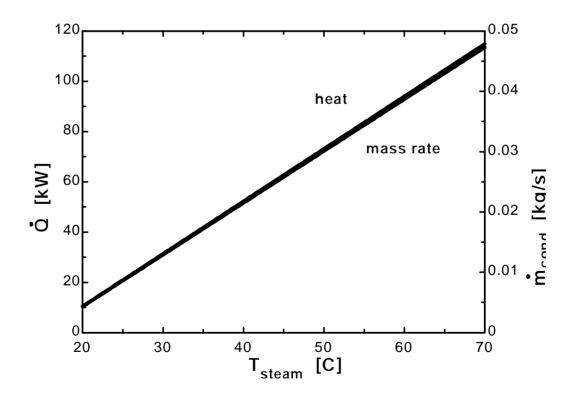

Chap 23 *Heat Exchangers*

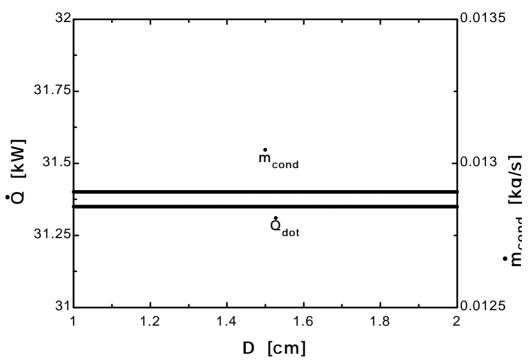

23-102 Cold water is heated by hot oil in a shell-and-tube heat exchanger. The rate of heat transfer is to be determined using both the LMTD and NTU methods.

Assumptions 1 Steady operating conditions exist. **2** The heat exchanger is well-insulated so that heat loss to the surroundings is negligible and thus heat transfer from the hot fluid is equal to the heat transfer to the cold fluid. **3** Changes in the kinetic and potential energies of fluid streams are negligible. **4** The overall heat transfer coefficient is constant and uniform.

Properties The specific heats of the water and oil are given to be 4.18 and 2.2 kJ/kg.°C, respectively.

Analysis (a) The LMTD method in this case involves iterations, which involves the following steps:

1) Choose $T_{h,out}$

2) Calculate
$$\mathcal{P}$$
 from $\mathcal{P} = \mathcal{M}_h C_p (T_{h,out} - T_{h,in})$

3) Calculate
$$T_{h,out}$$
 from $\mathcal{P} = \mathcal{M}_h C_p (T_{h,out} - T_{h,in})$

4) Calculate $\Delta I_{\text{ln},CF}$

5) Calculate
$$\mathcal{P}$$
 from $\mathcal{P} = UA_s F\Delta T_{\ln, CF}$

6) Compare to the & calculated at step 2, and repeat until reaching the same result

Result: 385 kW

(b) The heat capacity rates of the hot and the cold fluids are

$$C_h = \hbar u_h C_{ph} = (3 \text{ kg/s})(2.2 \text{ kJ/kg.}^{\circ}\text{C}) = 6.6 \text{ kW/}^{\circ}\text{C}$$

 $C_c = \hbar u_c C_{pc} = (3 \text{ kg/s})(4.18 \text{ kJ/kg.}^{\circ}\text{C}) = 12.54 \text{ kW/}^{\circ}\text{C}$

Therefore,
$$C_{\min} = C_h = 6.6 \text{ kW/}^{\circ}\text{C}$$
 and $C = \frac{C_{\min}}{C_{\max}} = \frac{6.6}{12.54} = 0.53$

Then the maximum heat transfer rate becomes

$$\mathcal{Q}_{\text{max}} = C_{\text{min}} (T_{h,in} - T_{c,in}) = (6.6 \text{ kW/}^{\circ} \text{C})(130^{\circ} \text{C} - 20^{\circ} \text{C}) = 726 \text{ kW}$$

The NTU of this heat exchanger is


$$NTU = UA_s$$
 = $\frac{(0.3 \text{ kW/m}^2.^{\circ}\text{C})(20 \text{ m}^2)}{6.6 \text{ kW/}^{\circ}\text{C}} = 0.91$

Then the effectiveness of this heat exchanger corresponding to C=0.53 and NTU=0.91 is determined from Fig. 23-26d to be

$$\varepsilon = 0.53$$

The actual rate of heat transfer then becomes

$$\mathcal{P} = \varepsilon \mathcal{P}_{\text{max}} = (0.53)(726 \text{kW}) = 385 \text{kW}$$



Selection of The Heat Exchangers

23-103C 1) Calculate heat transfer rate, 2) select a suitable type of heat exchanger, 3) select a suitable type of cooling fluid, and its temperature range, 4) calculate or select U, and 5) calculate the size (surface area) of heat exchanger

23-104C The first thing we need to do is determine the life expectancy of the system. Then we need to evaluate how much the larger will save in pumping cost, and compare it to the initial cost difference of the two units. If the larger system saves more than the cost difference in its lifetime, it should be preferred.

23-105C In the case of automotive and aerospace industry, where weight and size considerations are important, and in situations where the space availability is limited, we choose the smaller heat exchanger.

23-106 Oil is to be cooled by water in a heat exchanger. The heat transfer rating of the heat exchanger is to be determined and a suitable type is to be proposed.

Assumptions 1 Steady operating conditions exist. **2** The heat exchanger is well-insulated so that heat loss to the surroundings is negligible and thus heat transfer from the hot fluid is equal to the heat transfer to the cold fluid. **3** Changes in the kinetic and potential energies of fluid streams are negligible.

Properties The specific heat of the oil is given to be 2.2 kJ/kg.°C.

Analysis The heat transfer rate of this heat exchanger is

$$\mathcal{D} = \mathcal{M}_{C}C_{nC}(T_{C,out} - T_{C,in}) = (13 \text{ kg/s})(2.2 \text{ kJ/kg.}^{\circ}\text{C})(120^{\circ}\text{C} - 50^{\circ}\text{C}) = 2002 \text{ kW}$$

We propose a compact heat exchanger (like the car radiator) if air cooling is to be used., or a tube-and-shell or plate heat exchanger if water cooling is to be used.

3-107 Water is to be heated by steam in a shell-and-tube process heater. The number of tube passes need to be used is to be determined.

Assumptions 1 Steady operating conditions exist. **2** The heat exchanger is well-insulated so that heat loss to the surroundings is negligible and thus heat transfer from the hot fluid is equal to the heat transfer to the cold fluid. **3** Changes in the kinetic and potential energies of fluid streams are negligible.

Properties The specific heat of the water is given to be 4.19 kJ/kg.°C.

Analysis The mass flow rate of the water is


$$&P = M_{c}C_{pc}(T_{c,out} - T_{c,in})$$

$$&P = C_{pc}(T_{c,out} - T_{c,in})$$

$$= \frac{600 \text{ kW}}{(4.19 \text{ kJ/kg.}^{\circ}\text{C})(90^{\circ}\text{C} - 20^{\circ}\text{C})}$$

$$= 2.046 \text{ kg/s}$$

The total cross-section area of the tubes corresponding to this mass flow rate is



$$R_{V} = \rho \, V A_{c} \rightarrow A_{c} = \frac{R_{V}}{\rho \, V} = \frac{2.046 \, \text{kg/s}}{(1000 \, \text{kg/m}^{3})(3 \, \text{m/s})} = 6.82 \times 10^{-4} \, \text{m}^{2}$$

Then the number of tubes that need to be used becomes

$$A_s = n\frac{\pi D^2}{4}$$
 $\rightarrow n = \frac{4A_s}{\pi D^2} = \frac{4(6.82 \times 10^{-4} \text{ m}^2)}{\pi (0.01 \text{ m})^2} = 8.68 \cong 9$

Therefore, we need to use at least 9 tubes entering the heat exchanger.

23-108

"GIVEN"

C_p_w=4.19 "[kJ/kg-C]" T_w_in=20 "[C]" T_w_out=90 "[C]"

Q_dot=600 "[kW]"

D=0.01 "[m]"

"Vel=3 [m/s], parameter to be varied"


"PROPERTIES"

rho=density(water, T=T_ave, P=100) $T_ave=1/2*(T_w_in+T_w_out)$

"ANALYSIS"

 $Q_dot = m_dot_w^*C_p_w^*(T_w_out - T_w_in)$ m_dot_w=rho*A_c*Vel A_c=N_pass*pi*D^2/4

Vel [m/s]	N _{pass}	
1	26.42	
1.5	17.62	
2	13.21	
2.5	10.57	
3	8.808	
3.5	7.55	
4	6.606	
4.5	5.872	
5	5.285	
5.5	4.804	
6	4.404	
6.5	4.065	
7	3.775	
7.5	3.523	
8	3 303	

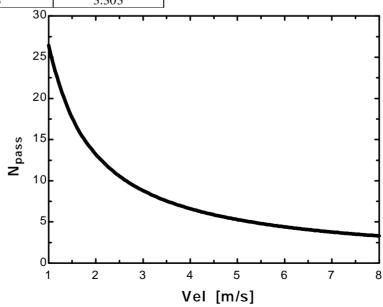

23-109 Cooling water is used to condense the steam in a power plant. The total length of the tubes required in the condenser is to be determined and a suitable HX type is to be proposed.

Assumptions 1 Steady operating conditions exist. **2** The heat exchanger is well-insulated so that heat loss to the surroundings is negligible and thus heat transfer from the hot fluid is equal to the heat transfer to the cold fluid. **3** Changes in the kinetic and potential energies of fluid streams are negligible. **4** The overall heat transfer coefficient is constant and uniform.

Properties The specific heat of the water is given to be 4.18 kJ/kg.°C. The heat of condensation of steam at 30°C is given to be 2430 kJ/kg.


Analysis The temperature differences between the steam and the water at the two ends of condenser are

$$\Delta T_1 = T_{h,in} - T_{c,out} = 30^{\circ} \text{ C} - 26^{\circ} \text{ C} = 4^{\circ} \text{ C}$$

 $\Delta T_2 = T_{h,out} - T_{c,in} = 30^{\circ} \text{ C} - 18^{\circ} \text{ C} = 12^{\circ} \text{ C}$

and the logarithmic mean temperature difference is

$$\Delta T_{lm} = \frac{\Delta T_1 - \Delta T_2}{\ln(\Delta T_1 / \Delta T_2)} = \frac{4 - 12}{\ln(4/12)} = 7.28^{\circ}\text{C}$$






The total length of the tubes required in this condenser then becomes

$$A_s = \pi DL \longrightarrow L = \frac{A_s}{\pi D} = \frac{1.96 \times 10^4 \text{ m}^2}{\pi (0.02 \text{ m})} = 3.123 \times 10^5 \text{ m} = 312.3 \text{ km}$$

A multi-pass shell-and-tube heat exchanger is suitable in this case.



23-110 Cold water is heated by hot water in a heat exchanger. The net rate of heat transfer and the heat transfer surface area of the heat exchanger are to be determined.

Assumptions 1 Steady operating conditions exist. **2** The heat exchanger is well-insulated so that heat loss to the surroundings is negligible and thus heat transfer from the hot fluid is equal to the heat transfer to the cold fluid. **3** Changes in the kinetic and potential energies of fluid streams are negligible. **4** The overall heat transfer coefficient is constant and uniform.

Properties The specific heats of the cold and hot water are given to be 4.18 and 4.19 kJ/kg.°C, respectively.

Analysis The temperature differences between the steam and the water at the two ends of condenser are

$$\Delta T_1 = T_{h,in} - T_{c,out} = 30^{\circ} \text{C} - 26^{\circ} \text{C} = 4^{\circ} \text{C}$$

 $\Delta T_2 = T_{h,out} - T_{c,in} = 30^{\circ} \text{C} - 18^{\circ} \text{C} = 12^{\circ} \text{C}$

and the logarithmic mean temperature difference is


$$\Delta T_{lm} = \frac{\Delta T_1 - \Delta T_2}{\ln(\Delta T_1 / \Delta T_2)} = \frac{4 - 12}{\ln(4/12)} = 7.28$$
°C

The heat transfer surface area is

The total length of the tubes required in this condenser then becomes

$$A_s = \pi DL \longrightarrow L = \frac{A_s}{\pi D} = \frac{1.177 \times 10^4 \text{ m}^2}{\pi (0.02 \text{ m})} = 1.874 \times 10^5 \text{ m} = 187.4 \text{ km}$$

A multi-pass shell-and-tube heat exchanger is suitable in this case.



Review Problems

23-111 Hot oil is cooled by water in a multi-pass shell-and-tube heat exchanger. The overall heat transfer coefficient based on the inner surface is to be determined.

Assumptions 1 Water flow is fully developed. 2 Properties of the water are constant.

Properties The properties of water at 25°C are (Table A-15)

$$k = 0.607 \text{ W/m.}^{\circ}\text{C}$$

 $v = \mu / \rho = 0.894 \times 10^{-6} \text{ m}^2/\text{s}$
 $Pr = 6.14$

Analysis The Reynolds number is

Re =
$$\frac{V_{m}D}{v}$$
 = $\frac{(3 \text{ m/s})(0.013 \text{ m})}{0.894 \times 10^{-6} \text{ m}^{2}/\text{s}}$ = 43,771

which is greater than 10,000. Therefore, we assume fully developed turbulent flow, and determine Nusselt number from

$$N_{V} = 0.023 \text{Re}^{0.8} \text{Pr}^{0.4} 0.023(43,771)^{0.8} (6.14)^{0.4} = 245$$



$$h_i = \frac{k}{L} Nu = \frac{0.607 \text{ W/m.}^{\circ}\text{C}}{0.013 \text{ m}} (245) = 11,440 \text{ W/m}^2.^{\circ}\text{C}$$

The inner and the outer surface areas of the tube are

$$A_f = \pi D_f L = \pi (0.013 \text{ m})(1 \text{ m}) = 0.04084 \text{ m}^2$$

 $A_g = \pi D_g L = \pi (0.015 \text{ m})(1 \text{ m}) = 0.04712 \text{ m}^2$

The total thermal resistance of this heat exchanger per unit length is


$$R = \frac{1}{h_{i}A_{i}} + \frac{\ln(D_{o}/D_{i})}{2\pi kL} + \frac{1}{h_{o}A_{o}}$$

$$= \frac{1}{(11,440 \text{ W/m}^{2}.^{\circ}\text{C})(0.04084 \text{ m}^{2})} + \frac{\ln(1.5/1.3)}{2\pi(110 \text{ W/m}.^{\circ}\text{C})(1 \text{ m})} + \frac{1}{(35 \text{ W/m}^{2}.^{\circ}\text{C})(0.04712 \text{ m}^{2})}$$

$$= 0.609^{\circ}\text{C/W}$$

Then the overall heat transfer coefficient of this heat exchanger based on the inner surface becomes

$$R = \frac{1}{U_i A_i} \longrightarrow U_i = \frac{1}{R A_i} = \frac{1}{(0.609^{\circ}\text{C/W})(0.04084 \text{ m}^2)} = 40.2 \text{ W/m}^2.^{\circ}\text{C}$$



23-112 Hot oil is cooled by water in a multi-pass shell-and-tube heat exchanger. The overall heat transfer coefficient based on the inner surface is to be determined.

Assumptions 1 Water flow is fully developed. **2** Properties of the water are constant.

Properties The properties of water at 25°C are (Table A-15)

$$k = 0.607 \text{ W/m.}^{\circ}\text{C}$$

 $v = \mu / \rho = 0.894 \times 10^{-6} \text{ m}^2/\text{s}$
 $Pr = 6.14$

Analysis The Reynolds number is

Re =
$$\frac{V_m D}{v}$$
 = $\frac{(3 \text{ m/s})(0.013 \text{ m})}{0.894 \times 10^{-6} \text{ m}^2/\text{s}}$ = 43,771

which is greater than 10,000. Therefore, we assume fully developed turbulent flow, and determine Nusselt number from

$$N_{V} = 0.023 \text{Re}^{0.8} \text{Pr}^{0.4} 0.023(43,771)^{0.8} (6.14)^{0.4} = 245$$

and

$$h_f = \frac{k}{L} N u = \frac{0.607 \text{ W/m.}^{\circ}\text{C}}{0.013 \text{ m}} (245) = 11,440 \text{ W/m}^{2}.^{\circ}\text{C}$$

The inner and the outer surface areas of the tube are

$$A_j = \pi D_j L = \pi (0.013 \text{ m})(1 \text{ m}) = 0.04084 \text{ m}^2$$

 $A_Q = \pi D_Q L = \pi (0.015 \text{ m})(1 \text{ m}) = 0.04712 \text{ m}^2$

The total thermal resistance of this heat exchanger per unit length of it with a fouling factor is

$$R = \frac{1}{h_{j}A_{j}} + \frac{\ln(D_{o}/D_{j})}{2\pi kL} + \frac{R_{f,o}}{A_{o}} + \frac{1}{h_{o}A_{o}}$$


$$= \frac{1}{(11,440 \text{ W/m}^{2}.^{\circ}\text{C})(0.04084 \text{ m}^{2})} + \frac{\ln(15/13)}{2\pi(110 \text{ W/m}.^{\circ}\text{C})(1 \text{ m})}$$

$$+ \frac{0.0004 \text{ m}^{2}.^{\circ}\text{C/W}}{0.04712 \text{ m}^{2}} + \frac{1}{(35 \text{ W/m}^{2}.^{\circ}\text{C})(0.04712 \text{ m}^{2})}$$

$$= 0.617^{\circ}\text{C/W}$$

Then the overall heat transfer coefficient of this heat exchanger based on the inner surface becomes

$$R = \frac{1}{U_i A_i} \longrightarrow U_i = \frac{1}{RA_i} = \frac{1}{(0.617^{\circ}\text{C/W})(0.04084 \text{ m}^2)} = 39.7 \text{ W/m}^2.^{\circ}\text{C}$$



23-113 Water is heated by hot oil in a multi-pass shell-and-tube heat exchanger. The rate of heat transfer and the heat transfer surface area on the outer side of the tube are to be determined. $\sqrt{}$

Assumptions 1 Steady operating conditions exist. **2** The heat exchanger is well-insulated so that heat loss to the surroundings is negligible and thus heat transfer from the hot fluid is equal to the heat transfer to the cold fluid. **3** Changes in the kinetic and potential energies of fluid streams are negligible. **4** The overall heat transfer coefficient is constant and uniform.

Properties The specific heats of the water and oil are given to be 4.18 and 2.2 kJ/kg.°C, respectively.

Analysis (a) The rate of heat transfer in this heat exchanger is

$$\mathcal{Q} = \mathcal{M}_h C_{nh} (T_{h,in} - T_{h,out}) = (3 \text{ kg/s})(2.2 \text{ kJ/kg.}^{\circ}\text{C})(130^{\circ}\text{C} - 60^{\circ}\text{C}) = 462 \text{ kW}$$

(b) The outlet temperature of the cold water is

$$\mathcal{E} = \mathcal{M}_{c}C_{pc}(T_{c,out} - T_{c,in}) \longrightarrow T_{c,out} = T_{c,in} + \mathcal{E}_{c,cpc} = 20^{\circ}\text{C} + \frac{462 \text{ kW}}{(3 \text{ kg/s})(4.18 \text{ kJ/kg.}^{\circ}\text{C})} = 56.8^{\circ}\text{C}$$

The temperature differences at the two ends are

$$\Delta T_1 = T_{h,in} - T_{c,out} = 130^{\circ}\text{C} - 56.8^{\circ}\text{C} = 73.2^{\circ}\text{C}$$

 $\Delta T_2 = T_{h,out} - T_{c,in} = 60^{\circ}\text{C} - 20^{\circ}\text{C} = 40^{\circ}\text{C}$


The logarithmic mean temperature difference is

$$\Delta T_{lm,CF} = \frac{\Delta T_1 - \Delta T_2}{\ln(\Delta T_1 / \Delta T_2)} = \frac{73.2 - 40}{\ln(73.2 / 40)} = 54.9^{\circ}\text{C}$$

and

$$P = \underbrace{\frac{I_2 - I_1}{I_1 - I_1}}_{120 - 100} = \underbrace{\frac{56.8 - 20}{130 - 20}}_{130 - 20} = 0.335$$

$$R = \underbrace{\frac{I_2 - I_1}{I_2 - I_1}}_{120 - 100} = \underbrace{\frac{130 - 60}{56.8 - 20}}_{130 - 100} = 1.90$$



The heat transfer surface area on the outer side of the tube is then determined from

$$\mathcal{E} = UA_s F \Delta T_{lm} \longrightarrow A_s = \mathcal{E}$$

$$UF \Delta T_{lm} = (0.3 \text{ kW/m}^2 \cdot ^{\circ}\text{C})(0.96)(54.9 ^{\circ}\text{C})$$

$$= 29.2 \text{ m}^2$$

23-114E Water is heated by solar-heated hot air in a double-pipe counter-flow heat exchanger. The required length of the tube is to be determined.

Assumptions 1 Steady operating conditions exist. **2** The heat exchanger is well-insulated so that heat loss to the surroundings is negligible and thus heat transfer from the hot fluid is equal to the heat transfer to the cold fluid. **3** Changes in the kinetic and potential energies of fluid streams are negligible. **4** The overall heat transfer coefficient is constant and uniform.

Properties The specific heats of the water and air are given to be 1.0 and 0.24 Btu/lbm.°F, respectively.

Analysis The rate of heat transfer in this heat exchanger is

$$\mathcal{P} = \mathcal{M}_h C_{ph} (T_{h.in} - T_{h.out}) = (0.7 \text{ lbm/s})(0.24 \text{ Btu/lbm.}^\circ\text{F})(190^\circ\text{F} - 135^\circ\text{F}) = 9.24 \text{ Btu/s}$$

The outlet temperature of the cold water is

$$\mathcal{E} = \mathcal{E}_{c} C_{pc} (T_{c,out} - T_{c,in}) \longrightarrow T_{c,out} = T_{c,in} + \frac{\mathcal{E}_{c}}{\mathcal{E}_{pc}} = 70^{\circ} F + \frac{9.24 \text{ Btu/s}}{(0.35 \text{ lbm/s})(1.0 \text{ Btu/lbm.}^{\circ} F)} = 96.4^{\circ} F$$

The temperature differences at the two ends are


$$\Delta T_1 = T_{h,in} - T_{c,out} = 190^{\circ}\text{F} - 96.4^{\circ}\text{F} = 93.6^{\circ}\text{F}$$

 $\Delta T_2 = T_{h,out} - T_{c,in} = 135^{\circ}\text{F} - 70^{\circ}\text{F} = 65^{\circ}\text{F}$

The logarithmic mean temperature difference is

$$\Delta T_{lm} = \frac{\Delta I_1 - \Delta I_2}{\ln(\Delta I_1 / \Delta I_2)} = \frac{93.6 - 65}{\ln(93.6 / 65)} = 78.43^{\circ} F$$

The heat transfer surface area on the outer side of the tube is determined from



Then the length of the tube required becomes

$$A_s = \pi DL \longrightarrow L = \frac{A_s}{\pi D} = \frac{21.21 \text{ ft}^2}{\pi (0.5/12 \text{ ft})} = 162.0 \text{ ft}$$

23-115 It is to be shown that when $\Delta T_1 = \Delta T_2$ for a heat exchanger, the ΔT_{lm} relation reduces to $\Delta T_{lm} = \Delta T_1 = \Delta T_2$.

Analysis When $\Delta T_1 = \Delta T_2$, we obtain

$$\Delta T_{lm} = \frac{\Delta Z_1 - \Delta Z_2}{\ln(\Delta Z_1 / \Delta Z_2)} = 0$$

This case can be handled by applying L'Hospital's rule (taking derivatives of nominator and denominator separately with respect to ΔZ or ΔZ). That is,

$$\Delta T_{lm} = \frac{d(\Delta T_1 - \Delta T_2) / d\Delta T_1}{d[\ln(\Delta T_1 / \Delta T_2)] / d\Delta T_1} = \frac{1}{1 / \Delta T_1} = \Delta T_1 = \Delta T_2$$

23-116 Refrigerant-134a is condensed by air in the condenser of a room air conditioner. The heat transfer area on the refrigerant side is to be determined.

Assumptions 1 Steady operating conditions exist. **2** The heat exchanger is well-insulated so that heat loss to the surroundings is negligible and thus heat transfer from the hot fluid is equal to the heat transfer to the cold fluid. **3** Changes in the kinetic and potential energies of fluid streams are negligible. **4** The overall heat transfer coefficient is constant and uniform.

Properties The specific heat of air is given to be 1.005 kJ/kg.°C.

Analysis The temperature differences at the two ends are


$$\Delta T_1 = T_{h,in} - T_{c,out} = 40^{\circ} \text{ C} - 35^{\circ} \text{ C} = 5^{\circ} \text{ C}$$

 $\Delta T_2 = T_{h,out} - T_{c,in} = 40^{\circ} \text{ C} - 25^{\circ} \text{ C} = 15^{\circ} \text{ C}$

The logarithmic mean temperature difference is

$$\Delta T_{lm} = \frac{\Delta T_1 - \Delta T_2}{\ln(\Delta T_1 / \Delta T_2)} = \frac{5 - 15}{\ln(5 / 15)} = 9.1^{\circ} \text{C}$$

The heat transfer surface area on the outer side of the tube is determined from



$$\mathcal{E} = UA_s \Delta T_{lm} \longrightarrow A_s = \underbrace{U\Delta T_{lm}}_{V\Delta T_{lm}} = \underbrace{(15,000/3600) \text{ kW}}_{(0.150 \text{ kW/m}^2.^{\circ}\text{C})(9.1^{\circ}\text{C})} = 3.05 \text{ m}^2$$

23-117 Air is preheated by hot exhaust gases in a cross-flow heat exchanger. The rate of heat transfer is to be determined.

Assumptions 1 Steady operating conditions exist. **2** The heat exchanger is well-insulated so that heat loss to the surroundings is negligible and thus heat transfer from the hot fluid is equal to the heat transfer to the cold fluid. **3** Changes in the kinetic and potential energies of fluid streams are negligible. **4** The overall heat transfer coefficient is constant and uniform.

Properties The specific heats of air and combustion gases are given to be 1.005 and 1.1 kJ/kg.°C, respectively.

Analysis The rate of heat transfer is simply

$$\mathcal{Q} = [\mathcal{M}C_n(T_{in} - T_{out})]_{gas.} = (1.1 \text{ kg/s})(1.1 \text{ kJ/kg.}^\circ\text{C})(180^\circ\text{C} - 95^\circ\text{C}) = 102.9 \text{ kW}$$

23-118 A water-to-water heat exchanger is proposed to preheat the incoming cold water by the drained hot water in a plant to save energy. The heat transfer rating of the heat exchanger and the amount of money this heat exchanger will save are to be determined.

Assumptions 1 Steady operating conditions exist. **2** The heat exchanger is well-insulated so that heat loss to the surroundings is negligible and thus heat transfer from the hot fluid is equal to the heat transfer to the cold fluid. **3** Changes in the kinetic and potential energies of fluid streams are negligible.


Properties The specific heat of the hot water is given to be 4.18 kJ/kg.°C.

Analysis The maximum rate of heat transfer is

$$\mathcal{E}_{\text{max}} = \mathcal{E}_{h} C_{ph} (T_{h,in} - T_{c,in})$$
= (8/60 kg/s)(4.18 kJ/kg.°C)(60°C - 14°C)
= 25.6 kW

Noting that the heat exchanger will recover 72% of it, the actual heat transfer rate becomes

$$\mathcal{P} = \varepsilon \mathcal{P}_{\text{max}} = (0.72)(25.6 \text{ kJ/s}) = 18.43 \text{ kW}$$



which is the heat transfer rating. The operating hours per year are

The annual operating hours = (8 h/day)(5 days/week)(52 week/year) = 2080 h/year

The energy saved during the entire year will be

Energy saved = (heat transfer rate)(operating time)
=
$$(18.43 \text{ kJ/s})(2080 \text{ h/year})(3600 \text{ s/h})$$

= $1.38 \times 10^8 \text{ kJ/year}$

Then amount of fuel and money saved will be

Fuel saved = Energy saved Furnace efficiency =
$$\frac{1.38 \times 10^8 \text{ kJ/year}}{0.78} \left(\frac{1 \text{ therm}}{105,500 \text{ kJ}}\right)$$
$$= 1677 \text{ therms/year}$$

Money saved = (fuel saved)(the price of fuel)

= (1677 therms/year)(\$ 0.54/therm) = \$906/year

23-119 A shell-and-tube heat exchanger is used to heat water with geothermal steam condensing. The rate of heat transfer, the rate of condensation of steam, and the overall heat transfer coefficient are to be determined.

Assumptions 1 Steady operating conditions exist. **2** The heat exchanger is well-insulated so that heat loss to the surroundings is negligible and thus heat transfer from the hot fluid is equal to the heat transfer to the cold fluid. **3** Changes in the kinetic and potential energies of fluid streams are negligible. **4** Fluid properties are constant.

Properties The heat of vaporization of geothermal water at 120°C is given to be $L_{fg} = 2203$ kJ/kg and specific heat of water is given to be $C_p = 4180$ J/kg.°C.

Analysis(a) The outlet temperature of the water is

$$I_{\text{c.out}} = I_{\text{h.out}} - 46 = 120^{\circ}\text{C} - 46^{\circ}\text{C} = 74^{\circ}\text{C}$$

Then the rate of heat transfer becomes

$$\mathcal{E} = [\mathcal{E}_{P}(I_{\text{out}} - I_{\text{in}})]_{\text{water}}$$
= (3.9 kg/s)(4.18 kJ/kg.°C)(74°C - 22°C)
= **847.7 kW**

(b) The rate of condensation of steam is determined from

$$\mathcal{D} = (\mathcal{M}h_{fg})_{\text{geothermal}}$$

$$847.7 \text{ kW} = 203 \text{ kJ/kg} \longrightarrow 200 \text{ kg/s}$$

(c) The heat transfer area is

$$A_i = m\pi D_i L = 14\pi (0.024 \text{ m})(3.2 \text{ m}) = 3.378 \text{ m}^2$$

The logarithmic mean temperature difference for counter-flow arrangement and the correction factor F are

$$\Delta T_{1} = T_{h,in} - T_{c,out} = 120^{\circ}\text{C} - 74^{\circ}\text{C} = 46^{\circ}\text{C}$$

$$\Delta T_{2} = T_{h,out} - T_{c,in} = 120^{\circ}\text{C} - 22^{\circ}\text{C} = 98^{\circ}\text{C}$$


$$\Delta T_{lm,CF} = \frac{\Delta T_{1} - \Delta T_{2}}{\ln(\Delta T_{1} / \Delta T_{2})} = \frac{46 - 98}{\ln(46 / 98)} = 68.8^{\circ}\text{C}$$

$$P = \frac{I_{2} - I_{1}}{I_{1} - I_{1}} = \frac{74 - 22}{120 - 22} = 0.53$$

$$R = \frac{I_{1} - I_{2}}{I_{2} - I_{1}} = \frac{120 - 120}{74 - 22} = 0$$

Then the overall heat transfer coefficient is determined to be

$$\mathcal{E} = U_j A_j F \Delta T_{\text{lm,CF}} \longrightarrow U_j = \underbrace{\mathcal{E}}_{A_j F \Delta T_{\text{lm,CF}}} = \underbrace{\frac{847,700 \text{ W}}{(3.378 \text{ m}^2)(1)(68.8^{\circ}\text{C})}} = 3648 \text{ W/m}^2.^{\circ}\text{C}$$



23-120 Water is heated by geothermal water in a double-pipe counter-flow heat exchanger. The mass flow rate of the geothermal water and the outlet temperatures of both fluids are to be determined.

Assumptions 1 Steady operating conditions exist. **2** The heat exchanger is well-insulated so that heat loss to the surroundings is negligible and thus heat transfer from the hot fluid is equal to the heat transfer to the cold fluid. **3** Changes in the kinetic and potential energies of fluid streams are negligible. **4** The overall heat transfer coefficient is constant and uniform.

Properties The specific heats of the geothermal water and the cold water are given to be 4.25 and 4.18 kJ/kg.°C, respectively.

Analysis The heat capacity rates of the hot and cold fluids are

$$C_{h} = \frac{\hbar k_{h} L_{ph}}{L_{ph}} = \frac{\hbar k_{h} (4.25 \text{ kJ/kg.}^{\circ}\text{C}) = 4.25 \frac{\hbar k_{h}}{L_{ph}}}{C_{c} = \frac{\hbar k_{c} C_{pc}}{L_{pc}} = (1.2 \text{ kg/s})(4.18 \text{ kJ/kg.}^{\circ}\text{C}) = 5.016 \text{ kW/}^{\circ}\text{C}}$$

$$C_{min} = C_{c} = 5.016 \text{ kW/}^{\circ}\text{C}$$

$$C_{min} = \frac{5.016}{L_{max}} = \frac{5.016}{4.25 \frac{\hbar k_{h}}{L_{ph}}} = \frac{1.1802}{\frac{\hbar k_{h}}{L_{ph}}}$$
The NTU of this heat exchanger is
$$NTU = \frac{UA_{s}}{C_{min}} = \frac{(0.480 \text{ kW/m}^{2}.^{\circ}\text{C})(25 \text{ m}^{2})}{5.016 \text{ kW/}^{\circ}\text{C}} = 2.392$$

Using the effectiveness relation, we find the capacity ratio

$$\varepsilon = \underbrace{\frac{1 - \exp[-\text{NTU}(1 - \mathcal{C})]}{1 - \mathcal{C}\exp[-\text{NTU}(1 - \mathcal{C})]}} \rightarrow 0.823 = \underbrace{\frac{1 - \exp[-2.392(1 - \mathcal{C})]}{1 - \mathcal{C}\exp[-2.392(1 - \mathcal{C})]}} \rightarrow \mathcal{C} = 0.494$$

Then the mass flow rate of geothermal water is determined from

$$C = \frac{1.1802}{8a_h} \longrightarrow 0.494 = \frac{1.1802}{8a_h} \longrightarrow 8a_h = 2.39 \text{ kg/s}$$

The maximum heat transfer rate is

$$\mathcal{E}_{\text{max}} = C_{\text{min}} (T_{\text{h,in}} - T_{\text{c,in}}) = (5.016 \,\text{kW/°C})(95^{\circ}\text{C} - 12^{\circ}\text{C}) = 416.328 \,\text{kW}$$

Then the actual rate of heat transfer rate becomes

$$\mathcal{P} = \mathcal{E}_{\text{max}} = (0.823)(416.328 \text{ kW}) = 342.64 \text{ kW}$$

The outlet temperatures of the geothermal and cold waters are determined to be

23-121 Air is to be heated by hot oil in a cross-flow heat exchanger with both fluids unmixed. The effectiveness of the heat exchanger, the mass flow rate of the cold fluid, and the rate of heat transfer are to be determined.

. Assumptions 1 Steady operating conditions exist. 2 The heat exchanger is well-insulated so that heat loss to the surroundings is negligible and thus heat transfer from the hot fluid is equal to the heat transfer to the cold fluid. 3 Changes in the kinetic and potential energies of fluid streams are negligible. 4 The overall heat transfer coefficient is constant and uniform.

Properties The specific heats of the air and the oil are given to be 1.006 and 2.15 kJ/kg.°C, respectively.

Analysis(a) The heat capacity rates of the hot and cold fluids are


$$\begin{split} \mathcal{C}_{h} &= \textit{Abs}_{h} \mathcal{C}_{\textit{ph}} = 0.5 \textit{Abs}_{\textit{c}}(2.15\,\text{kJ/kg.}^{\circ}\text{C}) = 1.075 \textit{Abs}_{\textit{c}} \\ \mathcal{C}_{\textit{c}} &= \textit{Abs}_{\textit{c}} \mathcal{C}_{\textit{pc}} = \textit{Abs}_{\textit{c}}(1.006\,\text{kJ/kg.}^{\circ}\text{C}) = 1.006 \textit{Abs}_{\textit{c}} \end{split}$$

Therefore, $C_{\min} = C_c = 1.006 \, \text{M}_c$

and
$$C = \frac{C_{\text{min}}}{C_{\text{max}}} = \frac{1.006 \, \text{Mg}}{1.075 \, \text{Mg}} = 0.936$$

The effectiveness of the heat exchanger is determined from

$$\varepsilon = \frac{\mathcal{E}}{\mathcal{E}_{\text{max}}} - \frac{C_c(T_{\text{c,out}} - T_{\text{c,in}})}{C_c(T_{\text{h,in}} - T_{\text{c,in}})} - \frac{58 - 18}{80 - 18} = 0.645$$



$$NTU = UA_s = \frac{(0.750 \text{ kW/°C})}{1.006 M_c} = \frac{0.7455}{M_c}$$

The NTU of this heat exchanger can also be determined from


$$NTU = -\frac{\ln[C\ln(1-\varepsilon)+1]}{C} = -\frac{\ln[0.936 \times \ln(1-0.645)+1]}{0.936} = 3.724$$

Then the mass flow rate of the air is determined to be

$$NTU = \underbrace{\mathcal{U}A_{\mathcal{S}}}_{C_{\min}} \longrightarrow 3.724 = \underbrace{(0.750 \text{ kW/°C})}_{1.006 \text{ Mg}_{\mathcal{C}}} \longrightarrow \text{Mg}_{\mathcal{C}} = \textbf{0.20 kg/s}$$

(c) The rate of heat transfer is determined from

$$\mathcal{B} = \mathcal{M}_c C_{pc} (T_{c,out} - T_{c,in}) = (0.20 \text{ kg/s})(1.006 \text{ kJ/kg.}^\circ\text{C})(58-18)^\circ\text{C} = 8.05 \text{ kW}$$



Cold

Water

20°C

23-122 A water-to-water counter-flow heat exchanger is considered. The outlet temperature of the cold water, the effectiveness of the heat exchanger, the mass flow rate of the cold water, and the heat transfer rate are to be determined.

. Assumptions 1 Steady operating conditions exist. 2 The heat exchanger is well-insulated so that heat loss to the surroundings is negligible and thus heat transfer from the hot fluid is equal to the heat transfer to the cold fluid. 3 Changes in the kinetic and potential energies of fluid streams are negligible. 4 The overall heat transfer coefficient is constant and uniform.

Hot water

Properties The specific heats of both the cold and the hot water are given to be 4.18 kJ/kg.°C.

Analysis(a) The heat capacity rates of the hot and cold fluids are

$$C_h = \hbar u_h C_{ph} = 1.5 \hbar u_c (4.18 \text{ kJ/kg.}^{\circ}\text{C}) = 6.27 \hbar u_c$$

 $C_c = \hbar u_c C_{pc} = \hbar u_c (4.18 \text{ kJ/kg.}^{\circ}\text{C}) = 4.18 \hbar u_c$

Therefore, $\mathcal{L}_{min} = \mathcal{L}_{c} = 4.18 \, \text{M}_{c}$

and $C = \frac{C_{\min}}{C_{\max}} = \frac{4.18 \, \text{Mg}}{6.27 \, \text{Mg}} = 0.667$

The rate of heat transfer can be expressed as

$$\mathcal{L} = C_c (T_{c,\text{out}} - T_{c,\text{in}}) = (4.18 \, \text{Mz}_c) (T_{c,\text{out}} - 20)$$

$$\mathcal{L} = C_d (T_{h,\text{in}} - T_{h,\text{out}}) = (6.27 \, \text{Mz}_c) [95 - (T_{c,\text{out}} + 15)] = (6.27 \, \text{Mz}_c) (80 - T_{c,\text{out}})$$

Setting the above two equations equal to each other we obtain the outlet temperature of the cold water

$$\mathcal{D} = 4.18 \, \text{Mz}_{c}(T_{c,\text{out}} - 20) = 6.27 \, \text{Mz}_{c}(80 - T_{c,\text{out}}) \longrightarrow T_{c,\text{out}} = 56 \, \text{°C}$$

(b) The effectiveness of the heat exchanger is determined from

$$\varepsilon = \frac{\mathcal{E}}{\mathcal{E}_{\text{max}}} = \frac{C_c(T_{\text{c,out}} - T_{\text{c,in}})}{C_c(T_{\text{h,in}} - T_{\text{c,in}})} = \frac{4.18 \, \text{Mg}_c(56 - 20)}{4.18 \, \text{Mg}_c(95 - 20)} = 0.48$$

(c) The NTU of this heat exchanger is determined from

$$NTU = \frac{1}{C-1} \ln \left(\frac{\varepsilon - 1}{\varepsilon C - 1} \right) = \frac{1}{0.667 - 1} \ln \left(\frac{0.48 - 1}{0.48 \times 0.667 - 1} \right) = 0.805$$

Then, from the definition of NTU, we obtain the mass flow rate of the cold fluid:

$$NTU = \underbrace{UA_s}_{C_{\min}} \longrightarrow 0.805 = \underbrace{1.400 \,\mathrm{kW/^{\circ}C}}_{4.18 \,\mathrm{M}_{C}} \longrightarrow \mathrm{M}_{C} = 0.416 \,\mathrm{kg/s}$$

(d) The rate of heat transfer is determined from

$$\mathcal{P} = \mathcal{M}_{C}C_{DC}(T_{C,out} - T_{c,in}) = (0.416 \text{ kg/s})(4.18 \text{ kJ/kg.}^{\circ}\text{C})(56 - 20)^{\circ}\text{C} = 62.6 \text{ kW}$$

23-123 . . . 23-129 Design and Essay Problems

hg