


NORTH ARROW



NOTES

DESIGN LOADS

Roof Loads

Snow + Rain Load - 1.92 kPa

Total Dead Load - 1.0 kPa

Uplift Load - 0.48 KPa

First Floor Loads

Live Load - 2.4 kPa

Partition Load - 1.0 kPa

Dead Load - 3.0 kPa

Note: All Loads are unfactored and to Part 4.0 of the O.B.C.
For roof areas subjected to snow drift refer to Drawings

- All design and workmanship on this project shall meet the requirements of the Ontario Building Code.

- All work shall be performed in accordance with the requirements of the Construction Safety Act (including latest amendments) and other local authorities having jurisdiction.

STEEL

- ASTM A325 bolts shall be used in all field connections unless otherwise noted.

- ASTM A307 bolts may be used for anchor bolt, girt connections and bolted joist bridging connections

- All wide flange sections with a nominal flange width of 100 mm (4") or greater, C Channels, S Beams, Angles and WWF Sections shall be CSA G40.21-350W unless otherwise noted.

- All Hollow Structural Sections and cold formed channels sections shall be CSA G40.21-350W unless otherwise noted.

- All solid round, square and hexagonal bars, bearing plates, lintel plates, column base plates and all wide flange beams with a nominal flange width of less than 100 mm (4") shall be ASTM A36 unless otherwise noted.

- All welding requirements on this project shall be undertaken by firms certified by the Canadian Welding Bureau to CSA W47.1, Division 1 or 2. the roof deck installer shall be certified for the deck welding.

PRELIMINARY
NOT FOR CONSTRUCTION

PROJECT TITLE

TWO STOREY
COMMERCIAL

PROJECT ADDRESS

1156 DUNDAS ST.

DRAWING TITLE

ROOF PLAN

CHECKED

S

DRAWN

AFNM

DATE


08/16/24

2401

PROJECT No.

S1

DRAWING

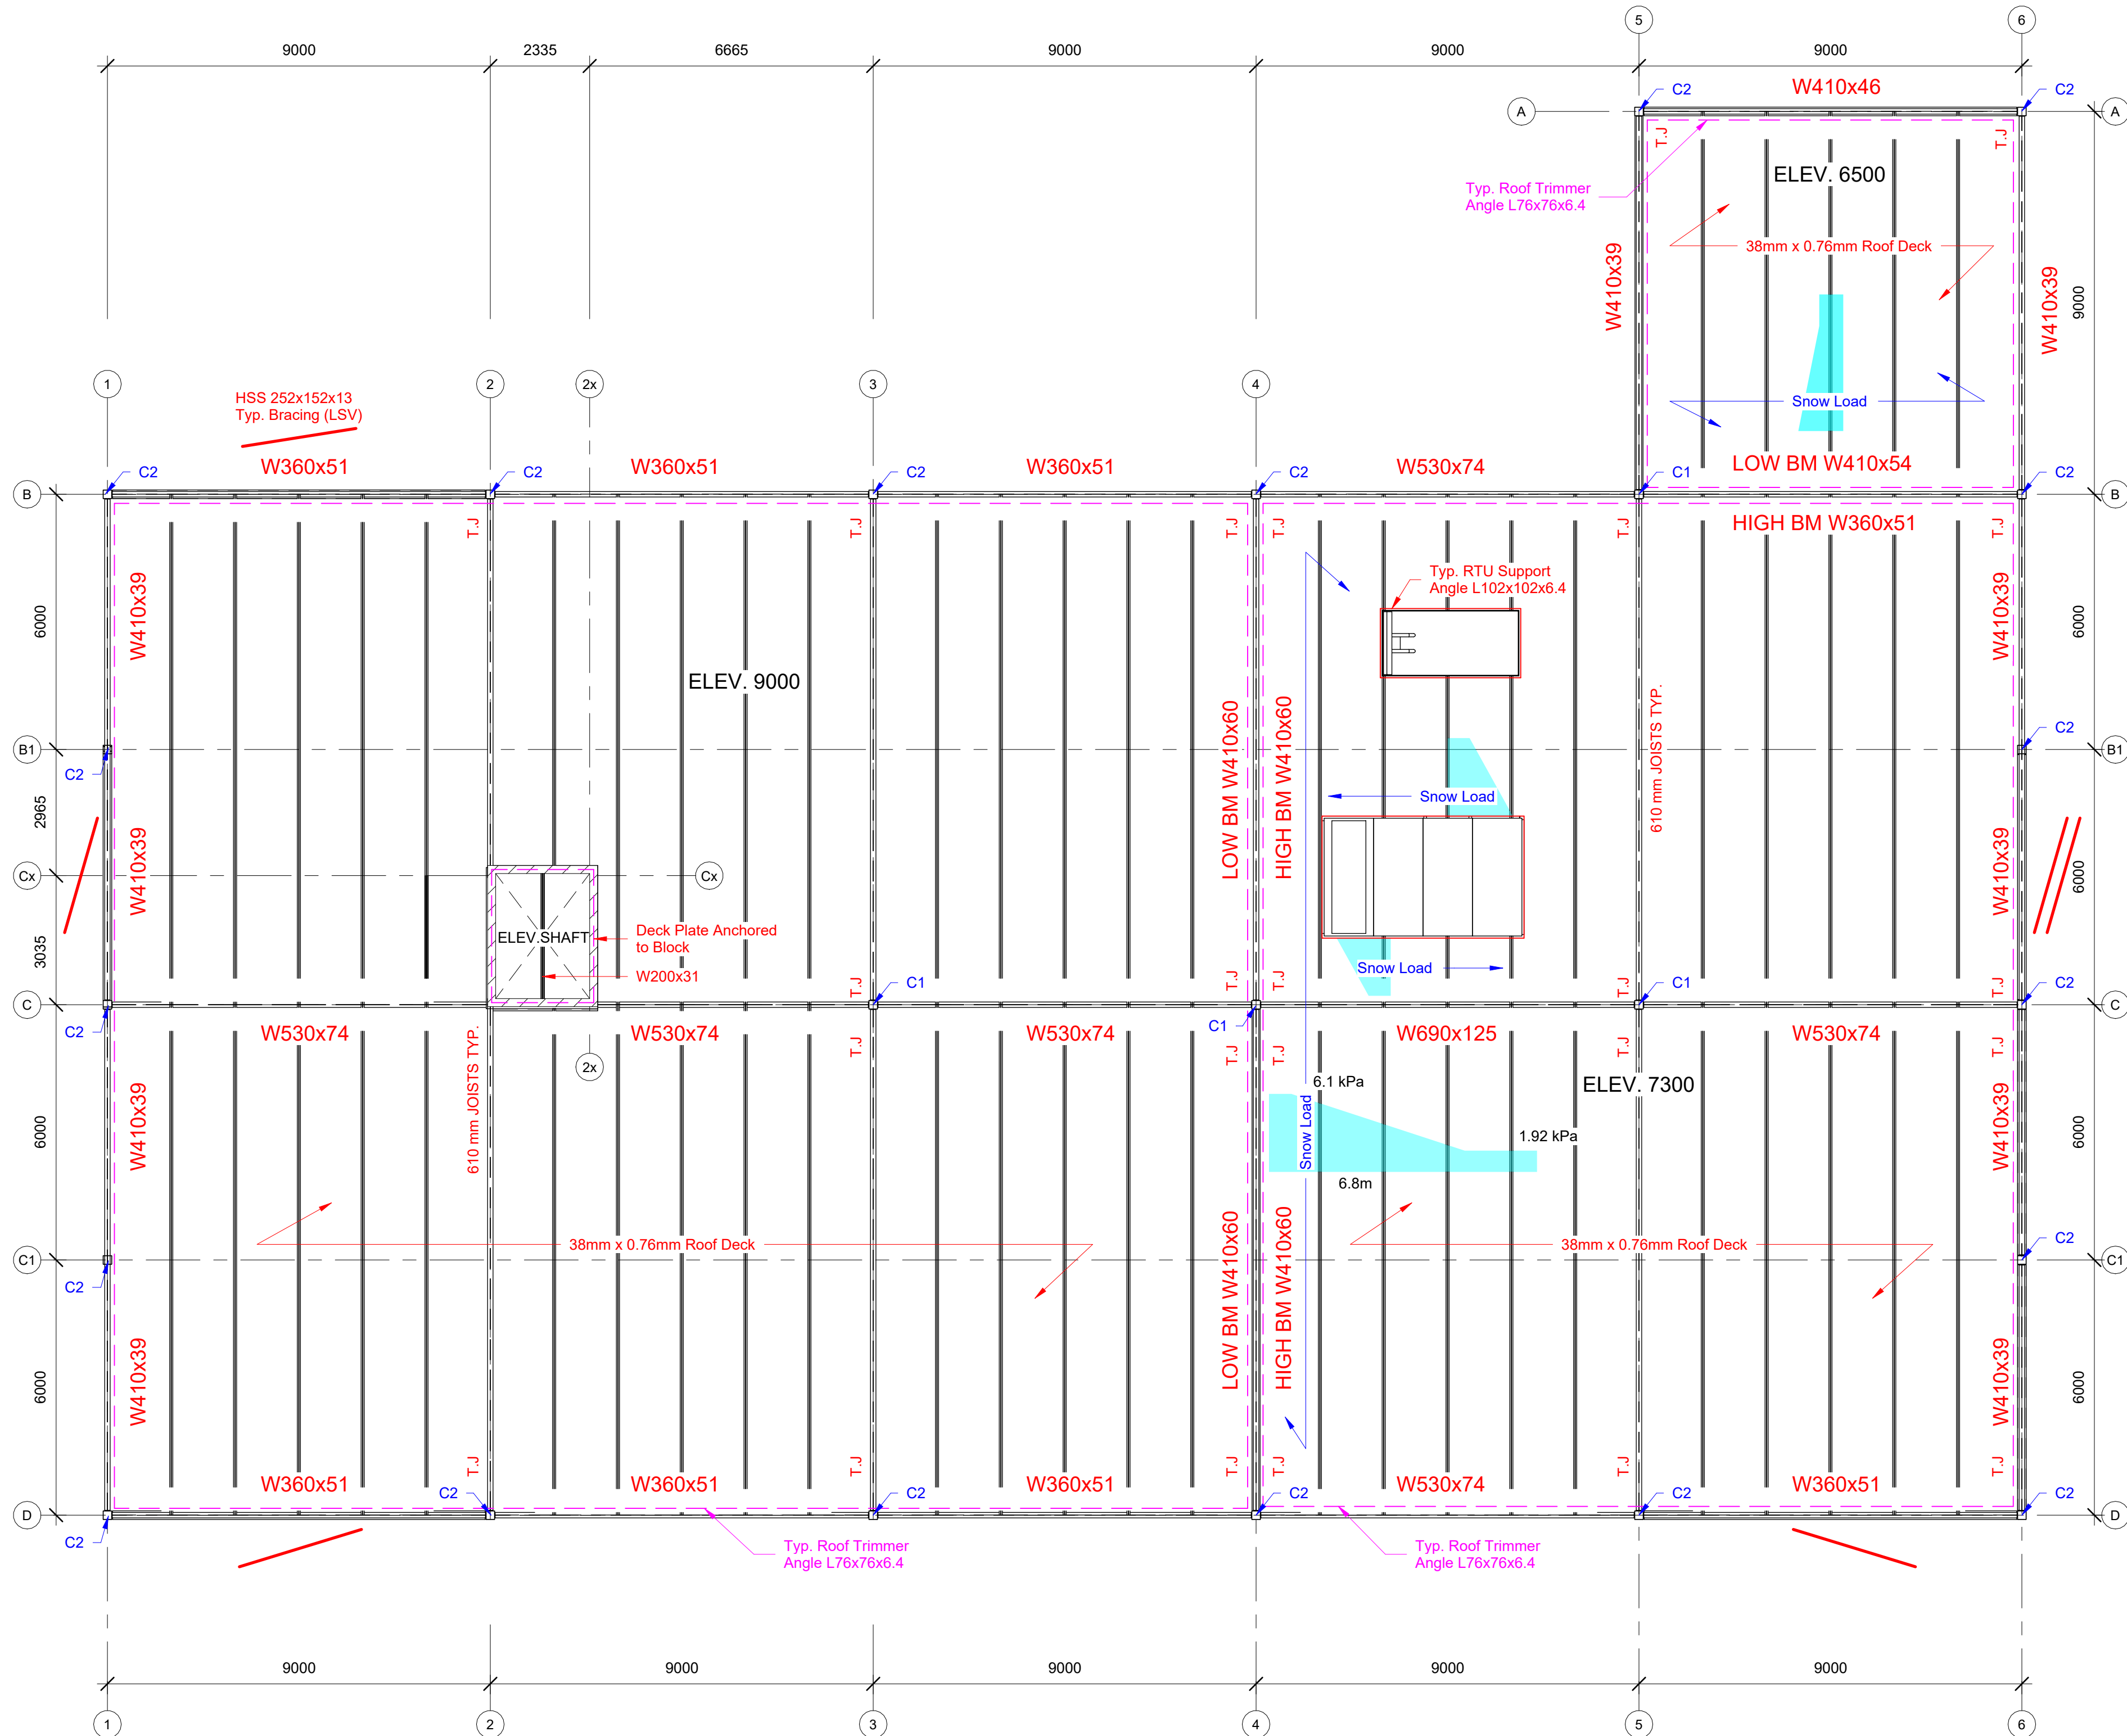


Loads:

LL - 1.92 kPa
+ Snow Drifts
DL - 1.0 kPa


Column Schedule:

C1- HSS 254254x254x6.4
C2- HSS 178x178x6.4

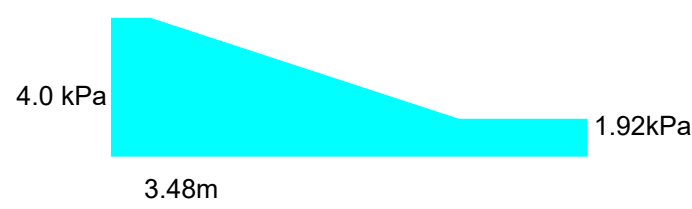

Typ. Snow Load at
High/Low and RTU
unless noted

NORTH ARROW



NOTES

DESIGN LOADS

Roof Loads

Snow + Rain Load - 1.92 kPa

Total Dead Load - 1.0 kPa

Uplift Load - 0.48 KPa

First Floor Loads

Live Load - 2.4 kPa

Partition Load - 1.0 kPa

Dead Load - 3.0 kPa

Note: All Loads are unfactored and to Part 4.0 of the O.B.C.
For roof areas subjected to snow drift refer to Drawings

- All design and workmanship on this project shall meet the requirements of the Ontario Building Code.

- All work shall be performed in accordance with the requirements of the Construction Safety Act (including latest amendments) and other local authorities having jurisdiction.

STEEL

- ASTM A325 bolts shall be used in all field connections unless otherwise noted.

- ASTM A307 bolts may be used for anchor bolt, girt connections and bolted joist bridging connections

- All wide flange sections with a nominal flange width of 100 mm (4") or greater, C Channels, S Beams, Angles and WWF Sections shall be CSA G40.21-350W unless otherwise noted.

- All Hollow Structural Sections and cold formed channels sections shall be CSA G40.21-350W unless otherwise noted.

- All solid round, square and hexagonal bars, bearing plates, lintel plates, column base plates and all wide flange beams with a nominal flange width of less than 100 mm (4") shall be ASTM A36 unless otherwise noted.

- All welding requirements on this project shall be undertaken by firms certified by the Canadian Welding Bureau to CSA W47.1, Division 1 or 2. the roof deck installer shall be certified for the deck welding.

PRELIMINARY
NOT FOR CONSTRUCTION

PROJECT TITLE

TWO STOREY
COMMERCIAL

PROJECT ADDRESS

1156 DUNDAS ST.

DRAWING TITLE

SECOND FLOOR PLAN

CHECKED

S

DRAWN

AFNM

DATE


08/16/24

2401

PROJECT No.

S2

DRAWING

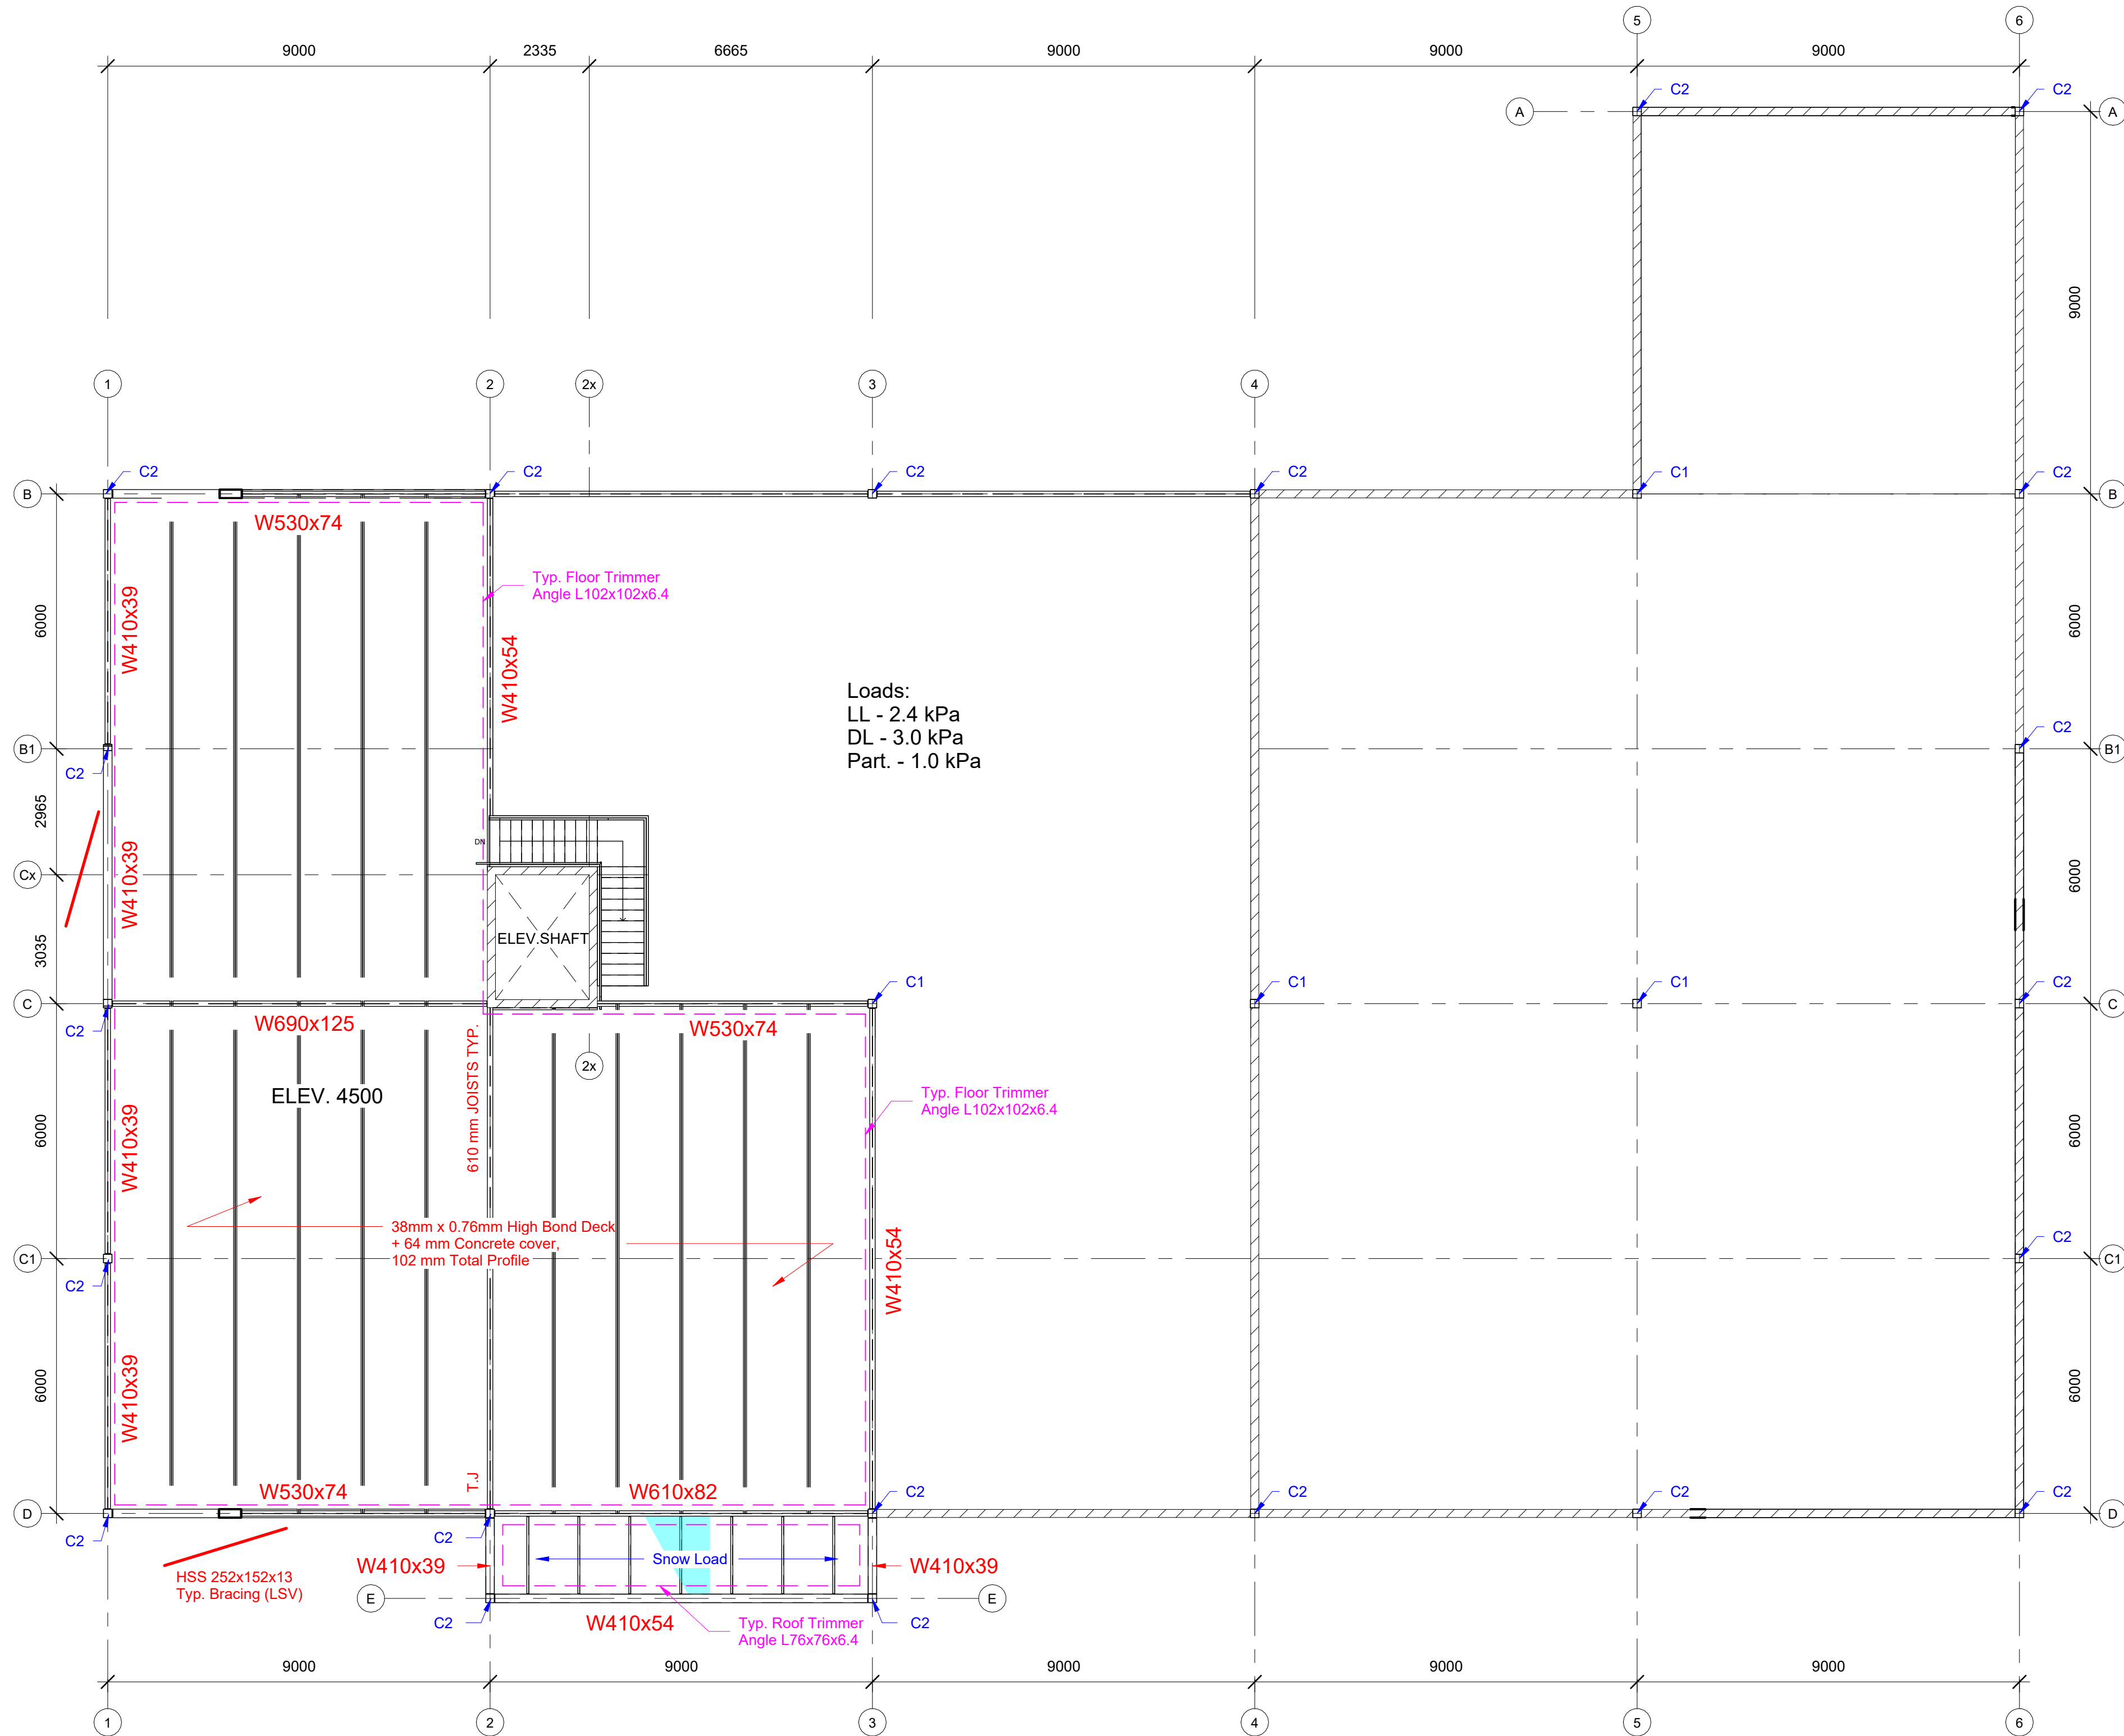

1 SECOND FLOOR PLAN

1 : 100

Loads:

LL - 1.92 kPa

+ Snow Drifts

DL - 1.0 kPa

Column Schedule:

C1- HSS 254254x254x6.4

C2- HSS 178x178x6.4