




1	2	3	4	5	6	7	8	9	10	11	12	13
---	---	---	---	---	---	---	---	---	----	----	----	----

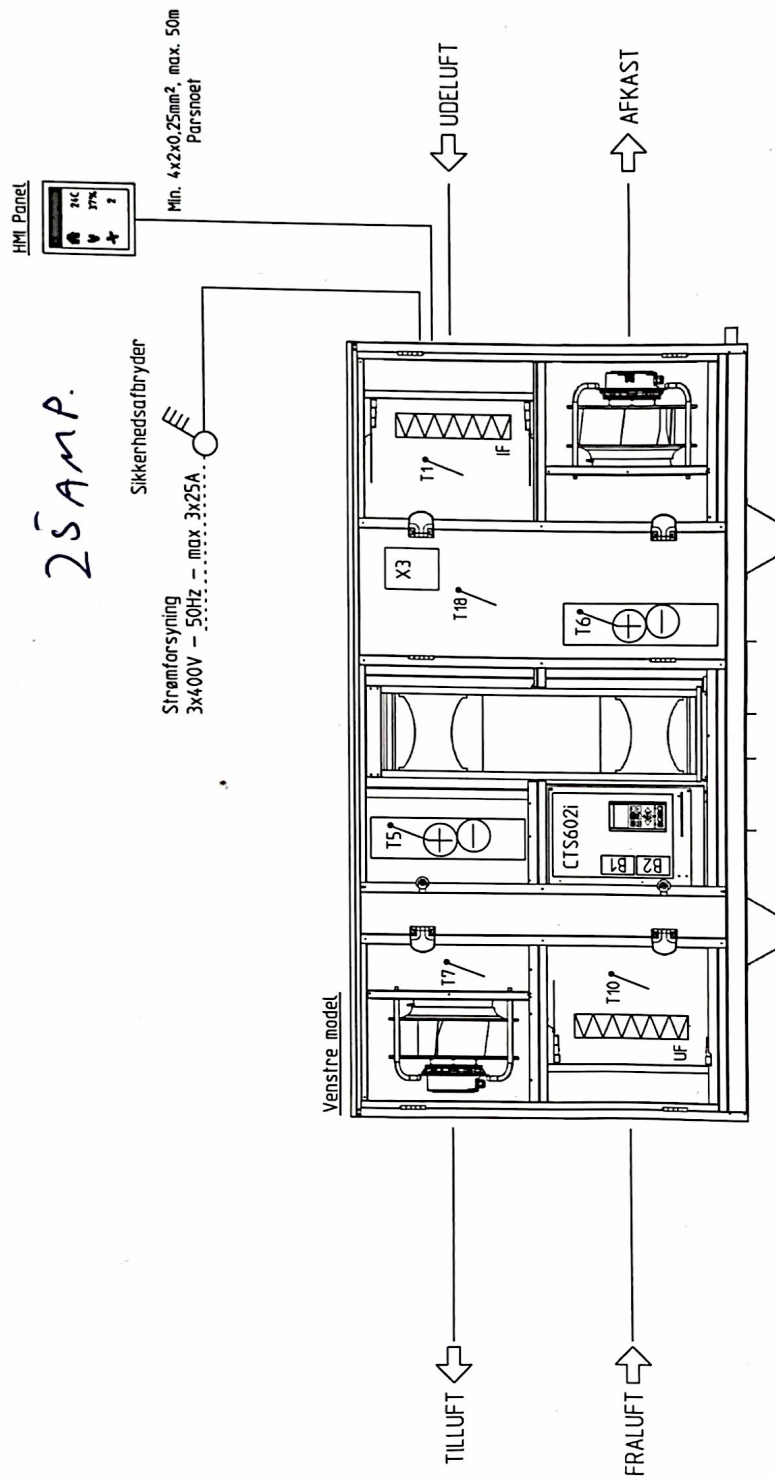


NILAN	NILAN A/S Nilsenvej 2 DK-8722 Hedensted Tlf. +4576752500 Fax +4576752525 http://www.nilan.dk Email: nilan@nilan.dk	Principdiagram VPR		Ordrenr. X56207	Revision 1.00	Initiater MD
		VPP560 m/CTS602i Varenr. 78125		Dato 26/08-2020	Nationalitet DK / N / S / SF	Side 1

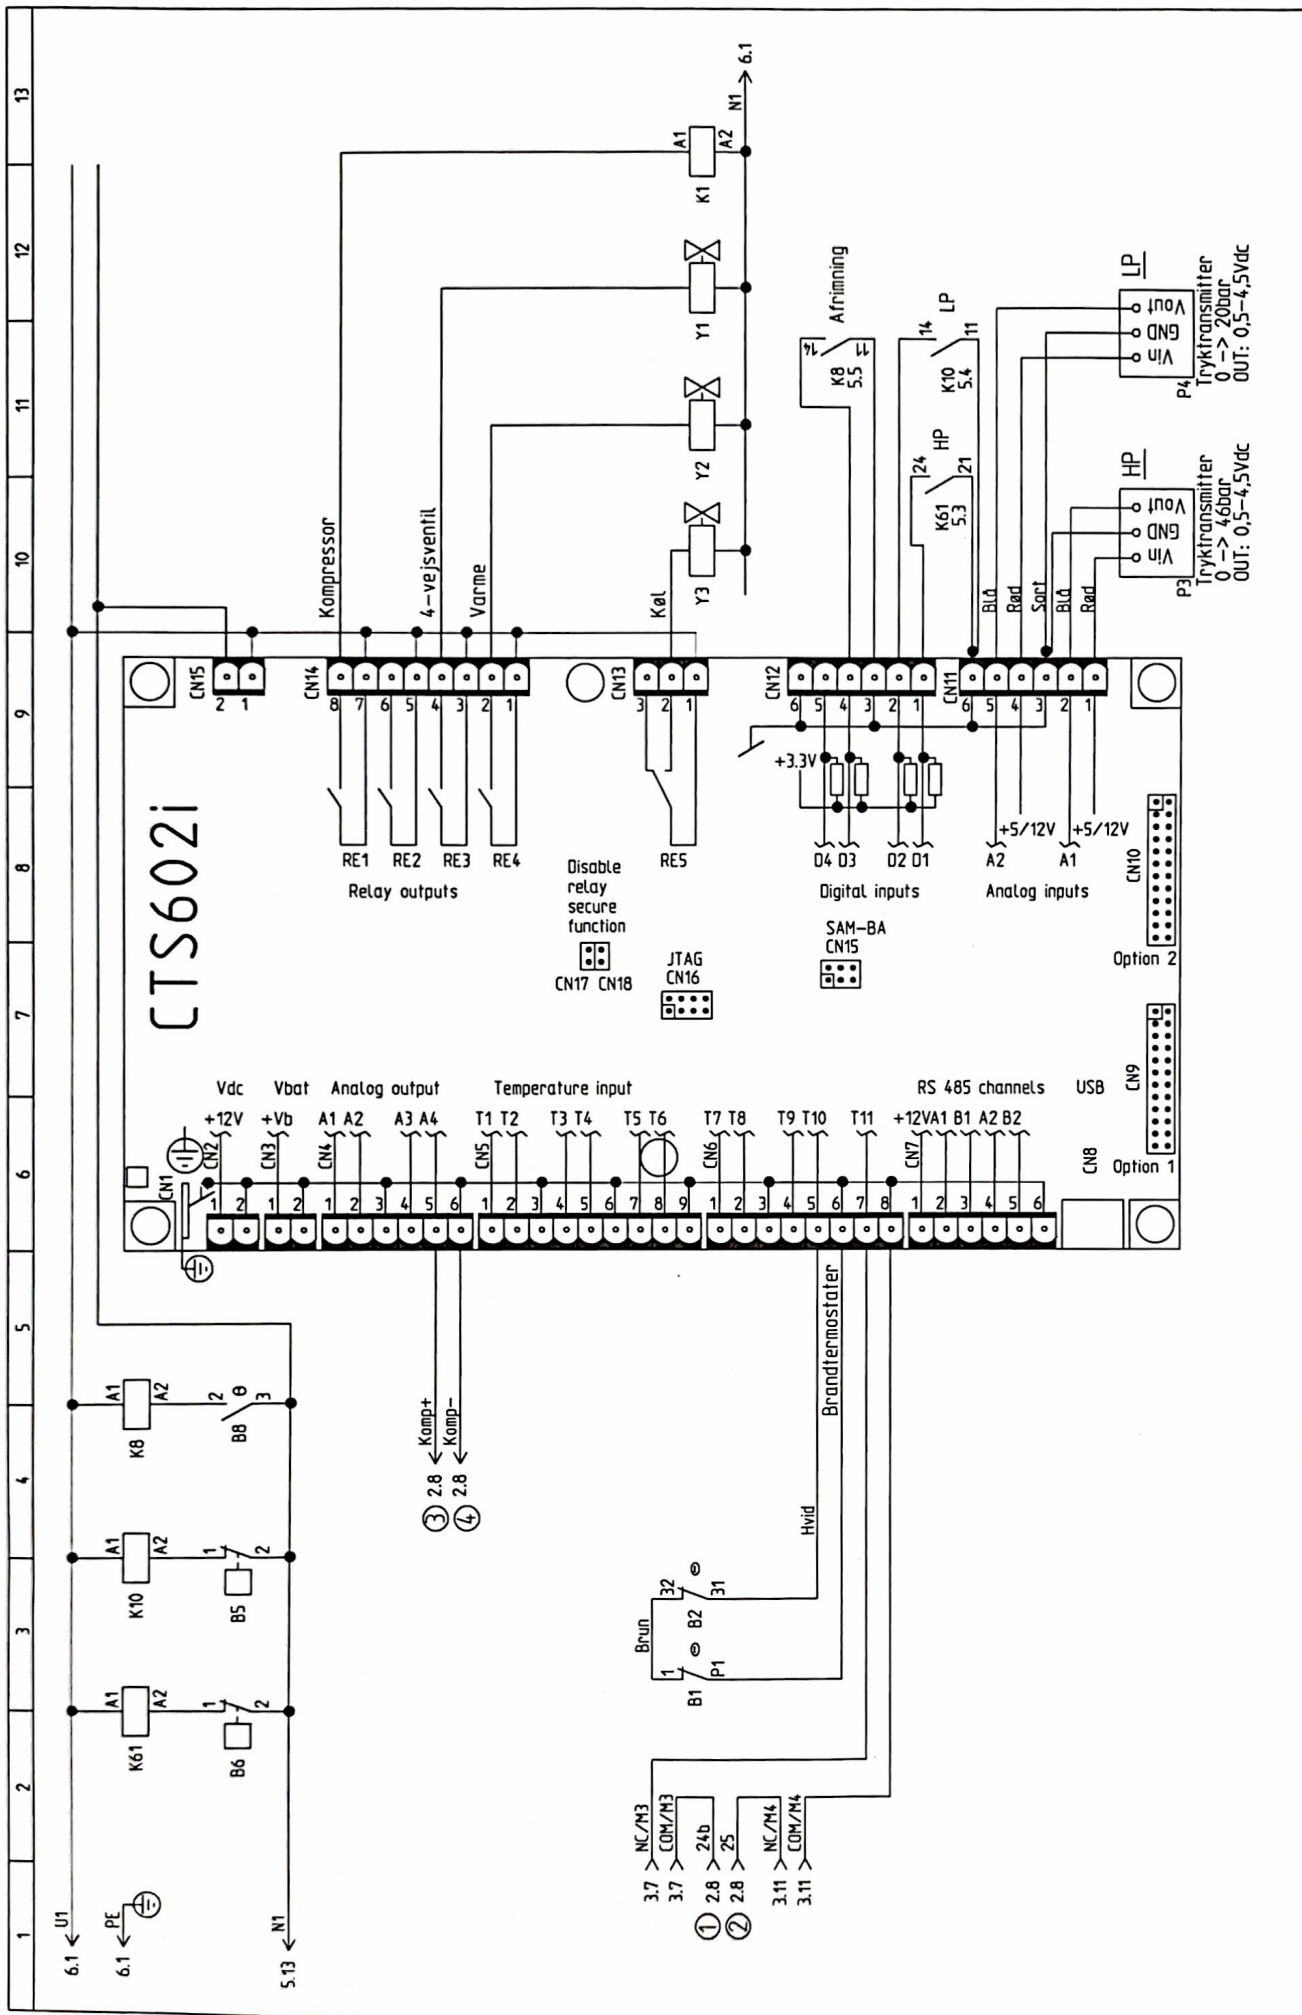

NILAN NILAN A/S Nilavej 2 DK-8722 Hedensted Tlf. +4576752500 Email: nilan@nilan.dk	CTS602i		Ordrenr. X56207 Date 26/08-2020	Revision 1.00 Nationalitet DK / N / S / SF	Initiator MD Side 5
	VPR560 m/CTS602i Varenr. 78125				

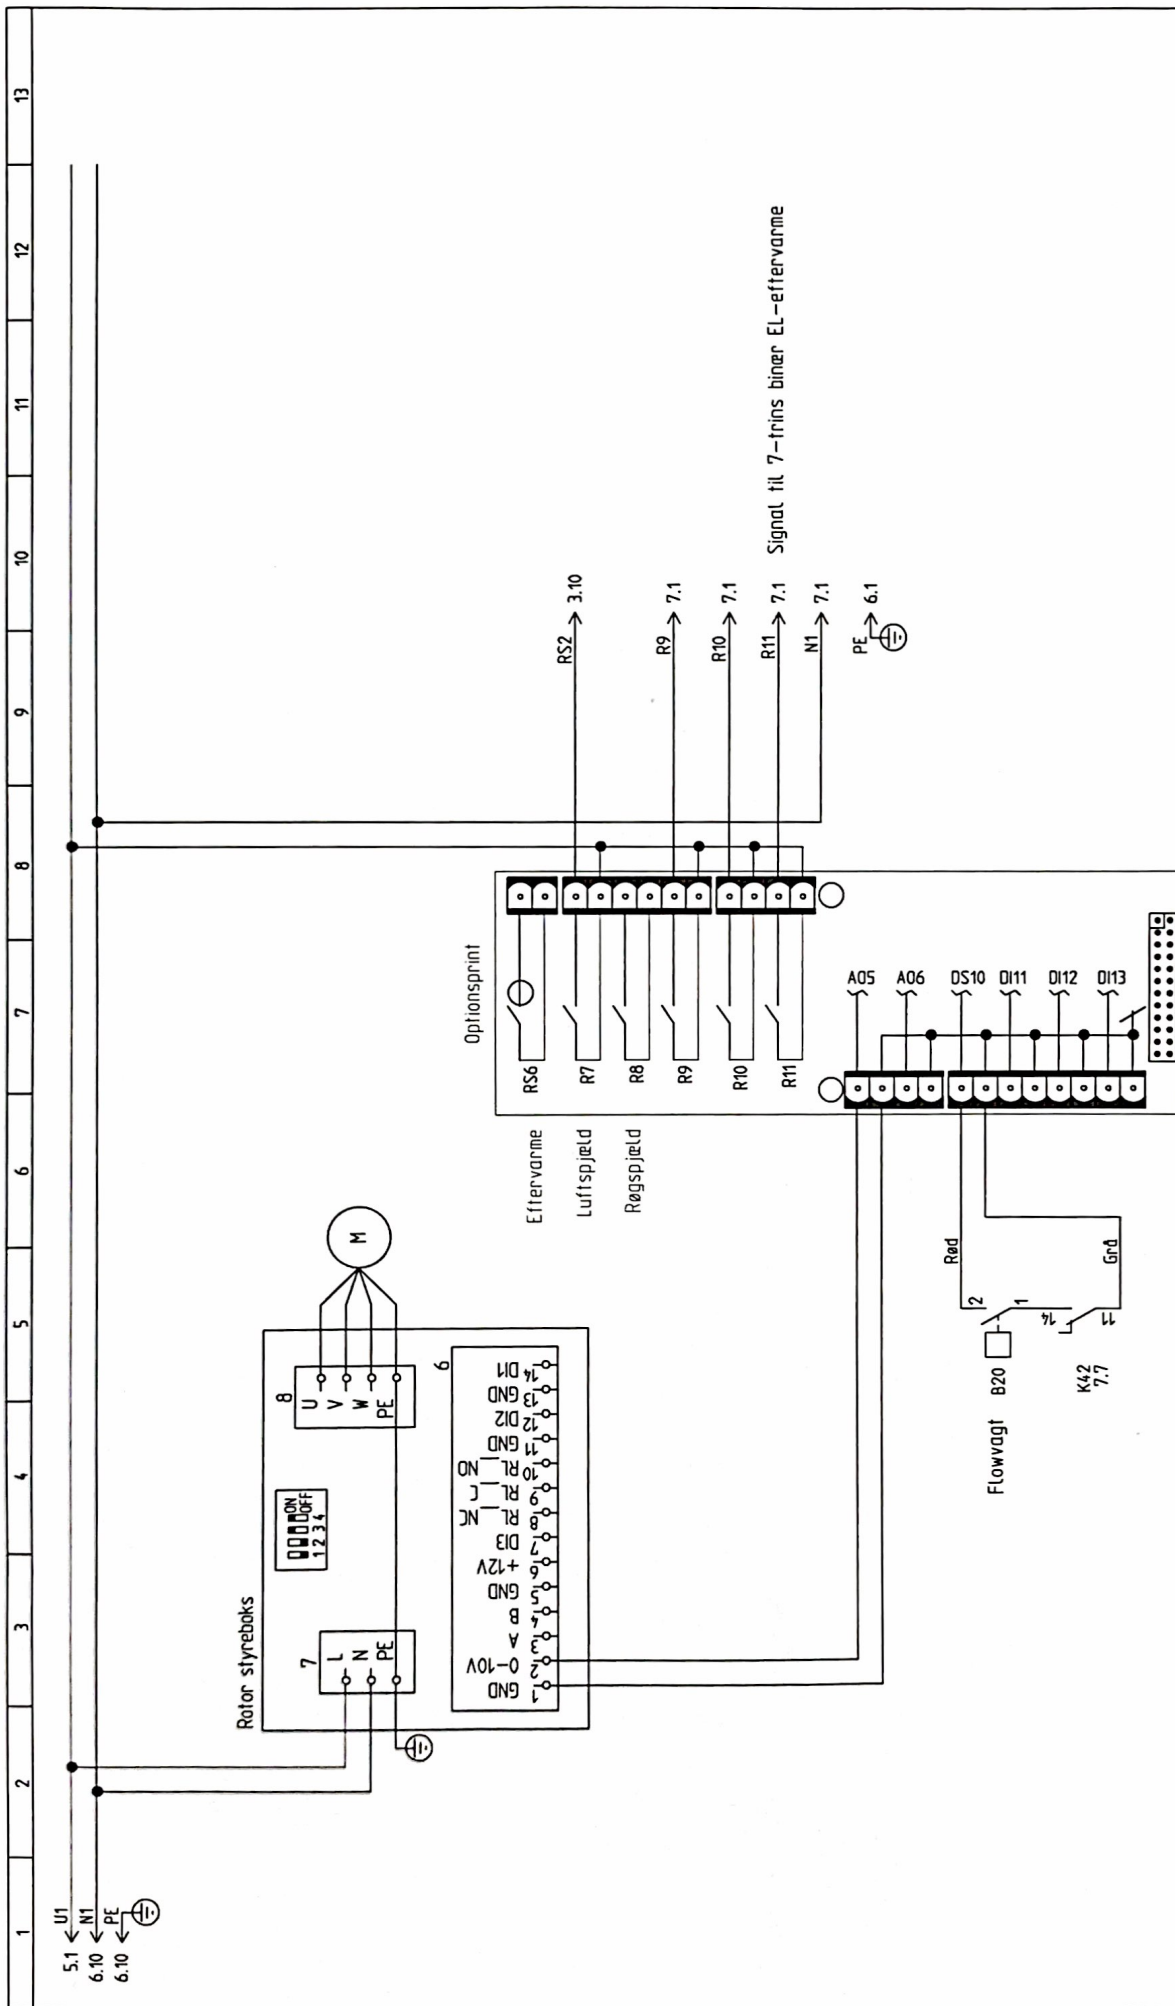

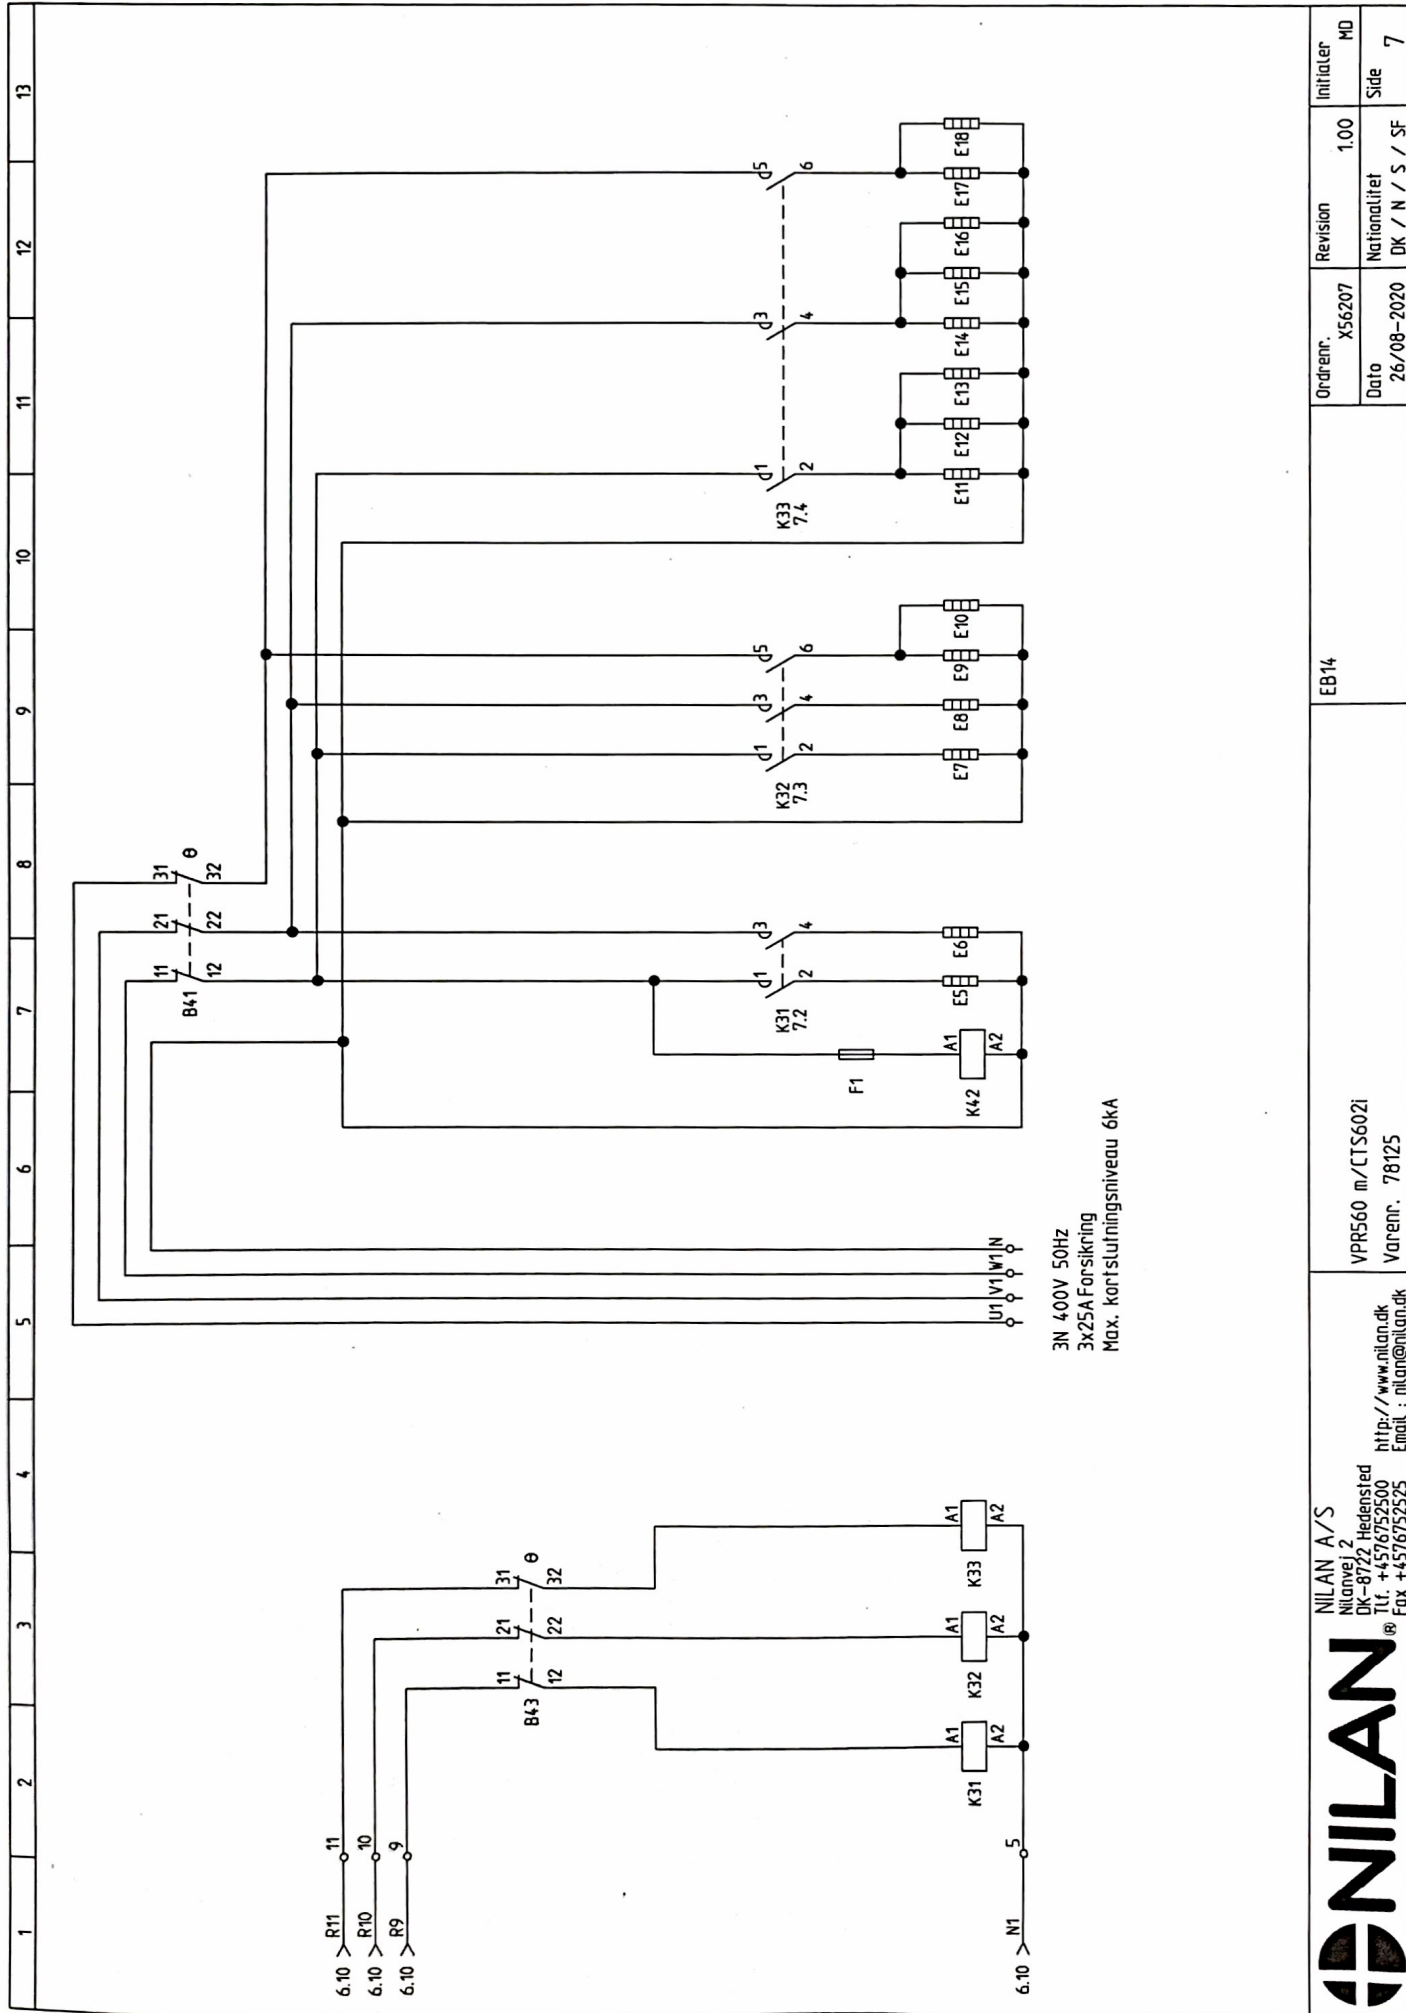

	NILAN A/S Nilanvej 2 DK-8722 Hedensted Tlf. +4576752500 Email : nilan@nilan.dk http://www.nilan.dk		VPR560 m/CTS6021 Varenr. 78125		EB14		Ordrenr. X56207	Revision 1.00	Initialer MD
							Dato 26/08-2020	Nationalitet DK / N / S / SF	Side 7

Produktliste

Produktliste					
Produkt	Type	Beskrivelse	Dokumenttype	Side	Strømvej
B1	EGO 55.31519.080 62-15°C, #1540	Brandtermostat Udsugning	Kredsskema	5	3
B2	EGO 55.33519.020 70-5°C, #15441	Brandtermostat Tilluft	Kredsskema	5	4
B5	Wilspec DMFK 1,1/2,5Bar, #15015	Lavtrykspressostat kompressor	Kredsskema	5	4
B6	Wilspec DMK 28/22Bar, #15025	Højtrykspressostat kompressor	Kredsskema	5	3
B8	Ranco K22 L2543 -3/+4,5 C, #15551	Afrimningstermostat	Kredsskema	5	5
B20	PS200 20-200Pa, #3633	Flowvagt	Kredsskema	6	5
B41	EGO 55.32512.050 100°C 30A, #1543	Sikkerhedstermostat	Kredsskema	7	8
B43	EGO 55.34309.020, #1567	Begrænsertermostat Styrestrøm	Kredsskema	7	3
CTS1	CTS602i, #239930	Styreprint	Kredsskema	1	7
E1	Danfoss PTC 35W 230V~, #1060	Kompressor 1 varmeløse	Kredsskema	3	3
F1	Werner 1.6A	Sikring sikkerhedstermostat	Kredsskema	7	7
F30	Mertin Gerin C60N-3P + N 10A C, #262181	Automatsikring styrestrøm	Kredsskema	3	2
F106	Mertin Gerin C60N-3P 16A C	Automatsikring Kompressor	Kredsskema	2	5
IF	HI-FLO F7 490x592x380, #3946	Tilluft filter	Kredsskema	1	10
K1	Finder 2C/O 8A 230V, #234506	Relæ kompressor	Kredsskema	5	13
K8	Finder 2C/O 8A 230V, #234506	Relæ Afrimningstermostat	Kredsskema	5	5
K10	Finder 2C/O 8A 230V, #234506	Relæ Lavtrykspressostat	Kredsskema	5	4
K31	Telemecanique LC1K0901 P7 230V~, #248131	Kontaktor varmetrin 1	Kredsskema	7	2
K32	Telemecanique LC1K0901 P7 230V~, #248131	Kontaktor varmetrin 2	Kredsskema	7	3
K33	Telemecanique LC1K0901 P7 230V~, #248131	Kontaktor varmetrin 3	Kredsskema	7	4
K42	Telemecanique RXL 2A2B12P7 230V~	Relæ sikkerhedstermostat	Kredsskema	7	7
K61	Finder 2C/O 8A 230V, #234506	Relæ safestop	Kredsskema	5	3
M3	EBM K3G355-P193-02 2,7kW 4,1A 3x400V, #411425	Fraluftmotor	Kredsskema	3	5
M4	EBM K3G355-P193-02 2,7kW 4,1A 3x400V, #411425	Tilluftmotor	Kredsskema	3	9
M6	Maneurop VTZ086-G 7,5kW 16,0A 3x400V	Kompressor	Kredsskema	2	5
P1	PTH3202, #17640	Tryktransmitter Fraluft	Kredsskema	3	7
P2	PTH3202, #17640	Tryktransmitter Tilluft	Kredsskema	3	11
P3	DYK-BA046-DV5-4,5, 0 -> 46bar, #17630	Tryktransmitter kølekreds HP	Kredsskema	5	10
P4	DYK-BA020-DV5-4,5, 0 -> 20bar, #17631	Tryktransmitter kølekreds LP	Kredsskema	5	12
Q1	OJ PRH1212, #176411	Trykregulator Fraluft	Kredsskema	3	6
 NILAN OUTSTANDING INDOOR CLIMATE Projekt X56207VPR560EBVAVVTZN_400V Dato 26-08-2020			Antal sider		2
			Land DK / N / S / SF		Næste side 2

[illegible]