


Air-Smart Controller

Air Quality

Rooms:

None

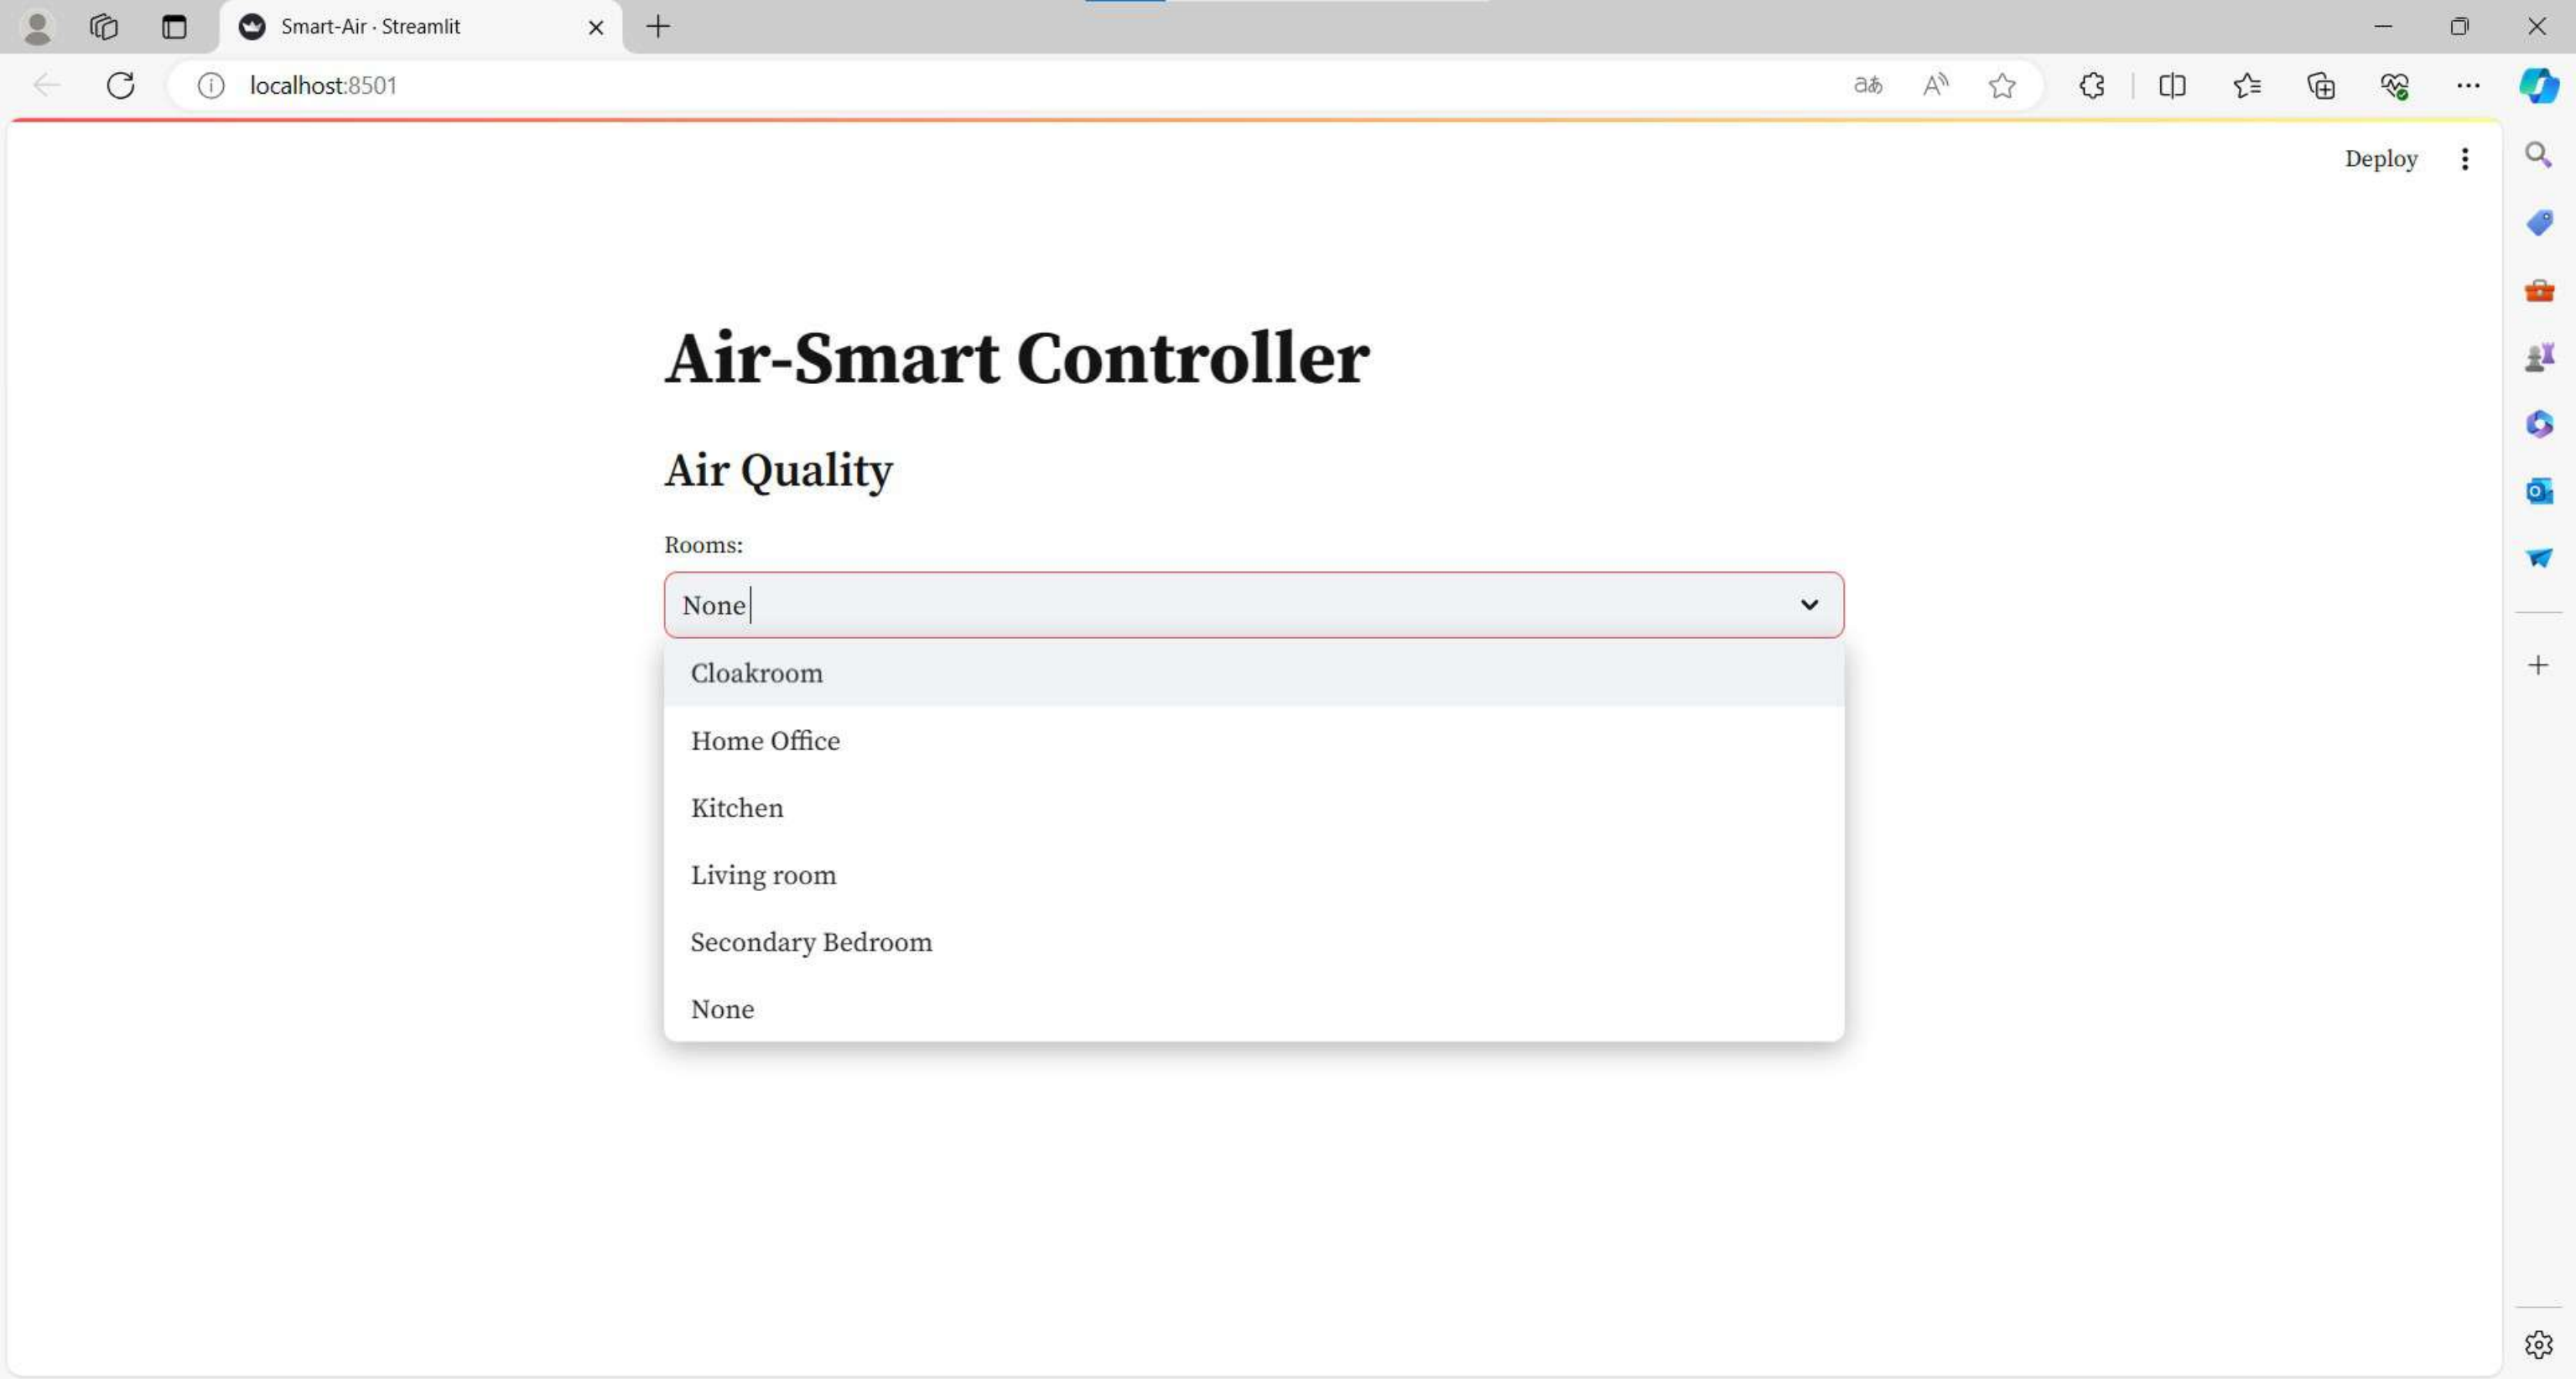

Air-Smart Controller

Air Quality

Rooms:

None

Cloakroom


Home Office

Kitchen

Living room

Secondary Bedroom

None

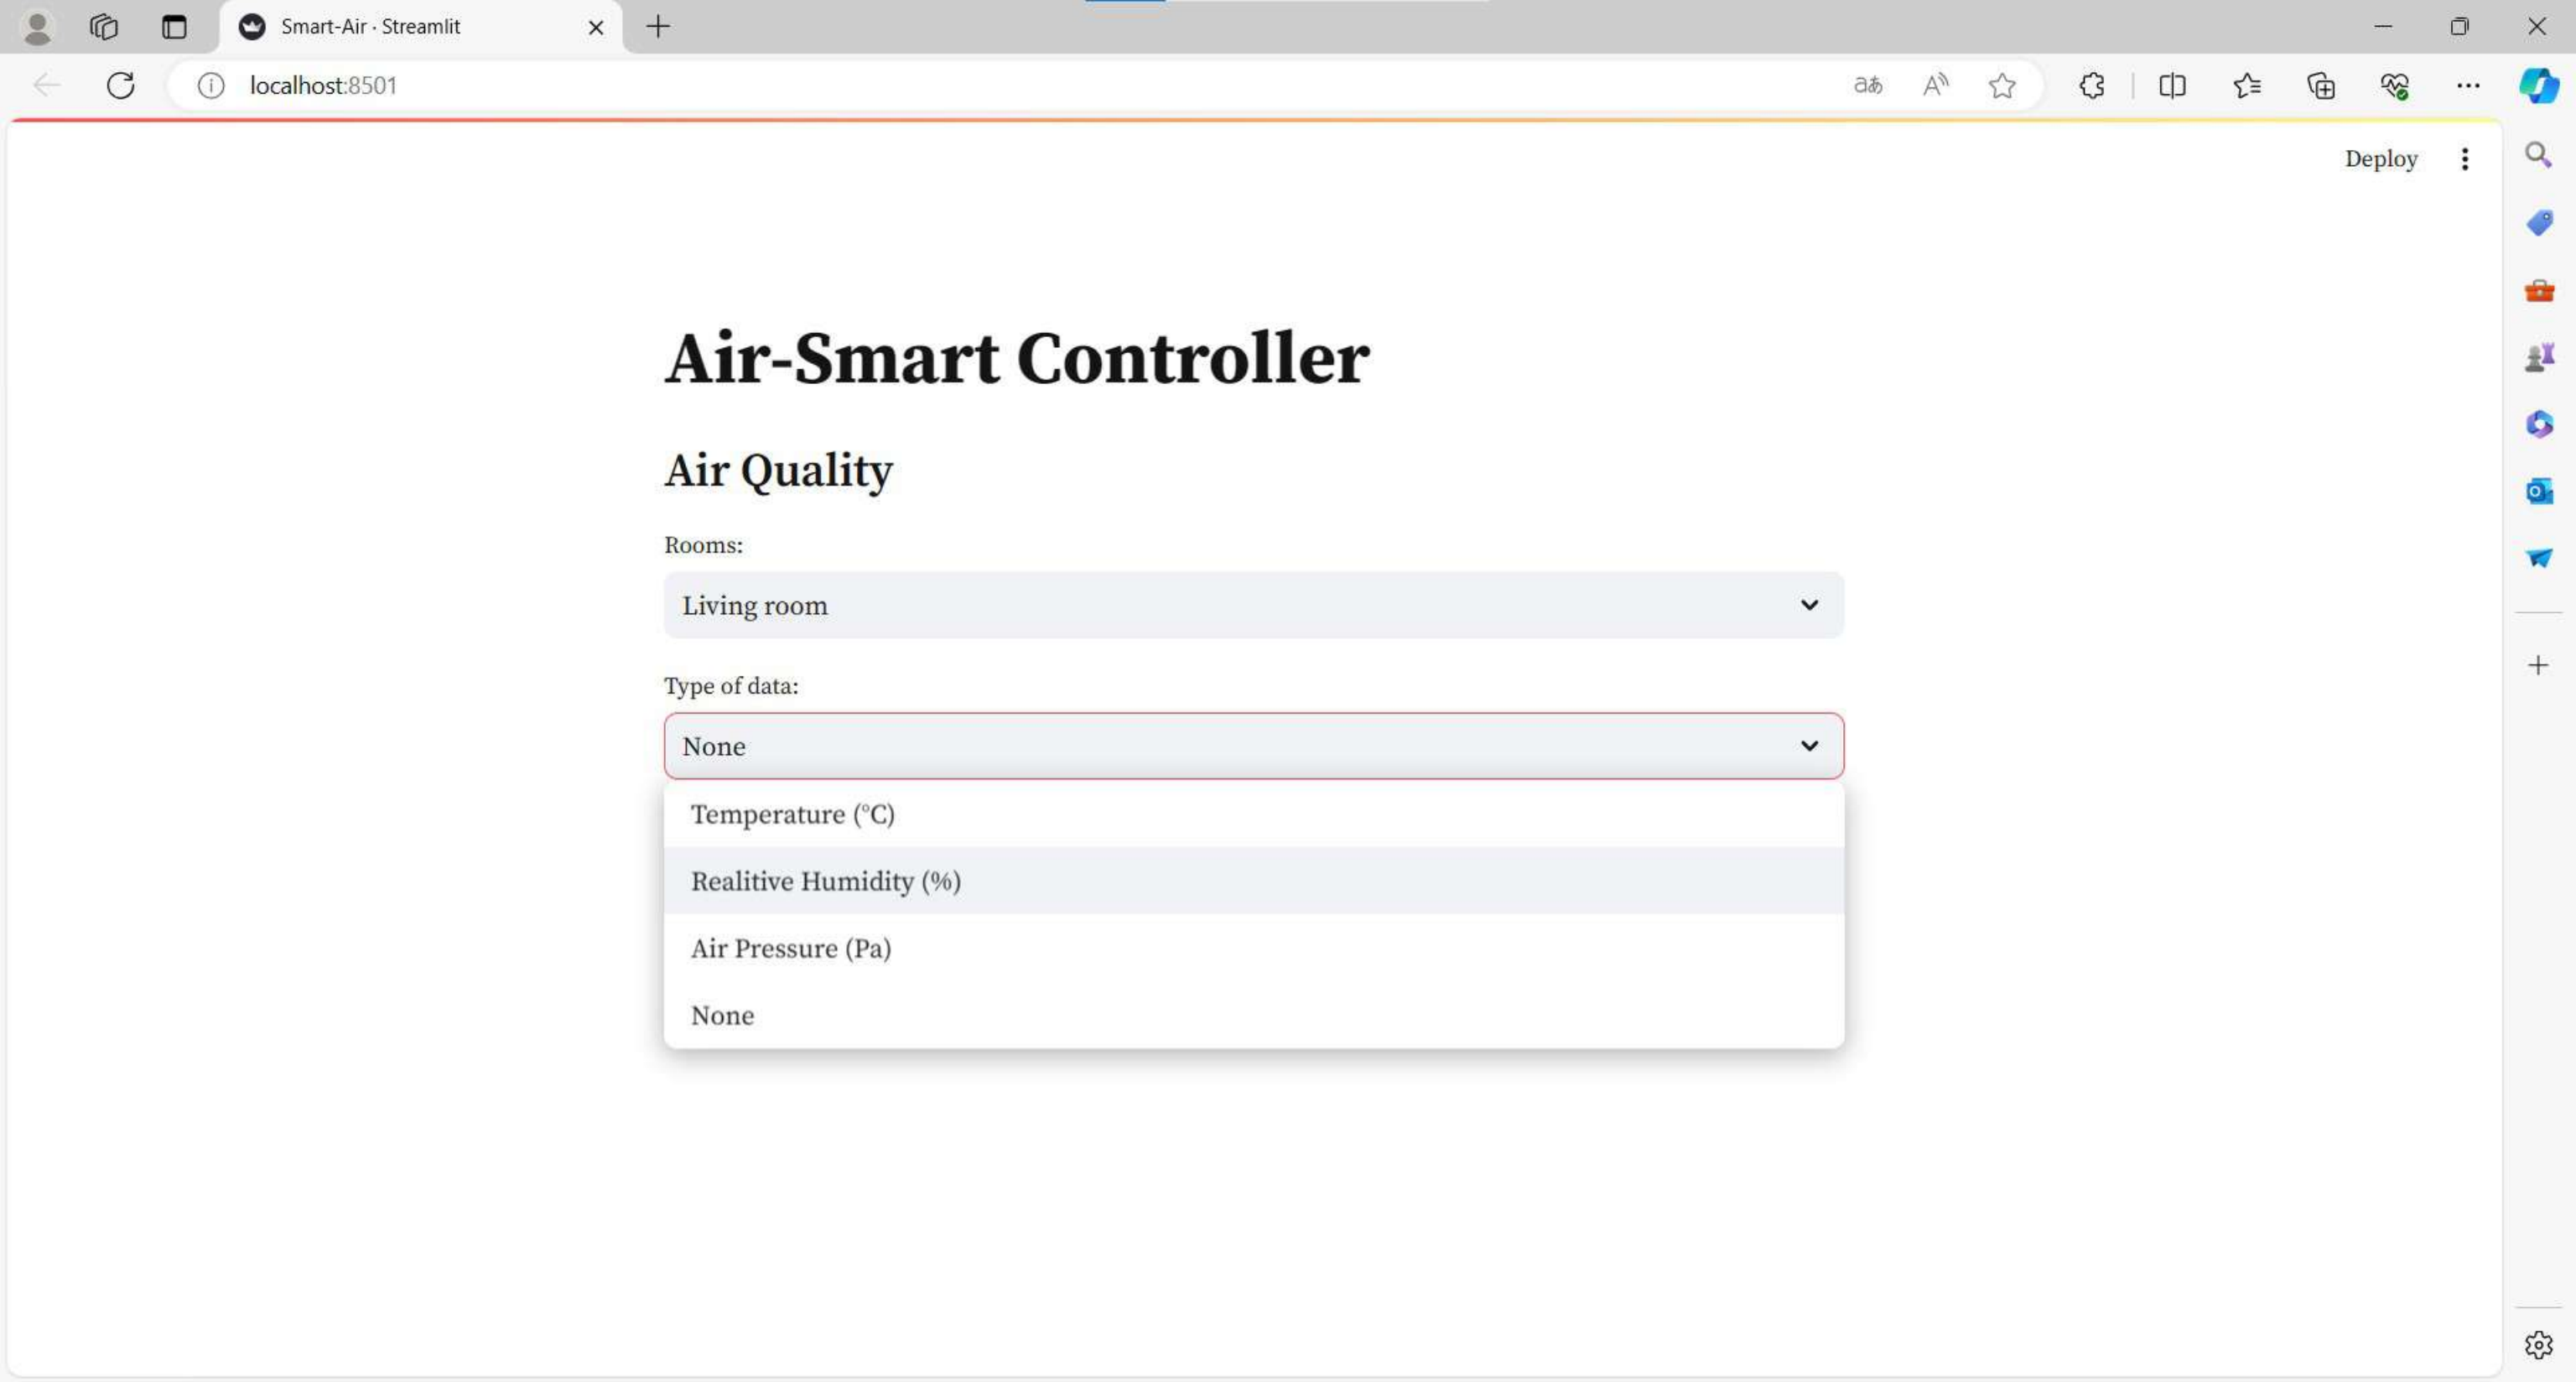

Air-Smart Controller

Air Quality

Rooms:

Living room

Type of data:

None


Temperature (°C)

Realitive Humidity (%)

Air Pressure (Pa)

None



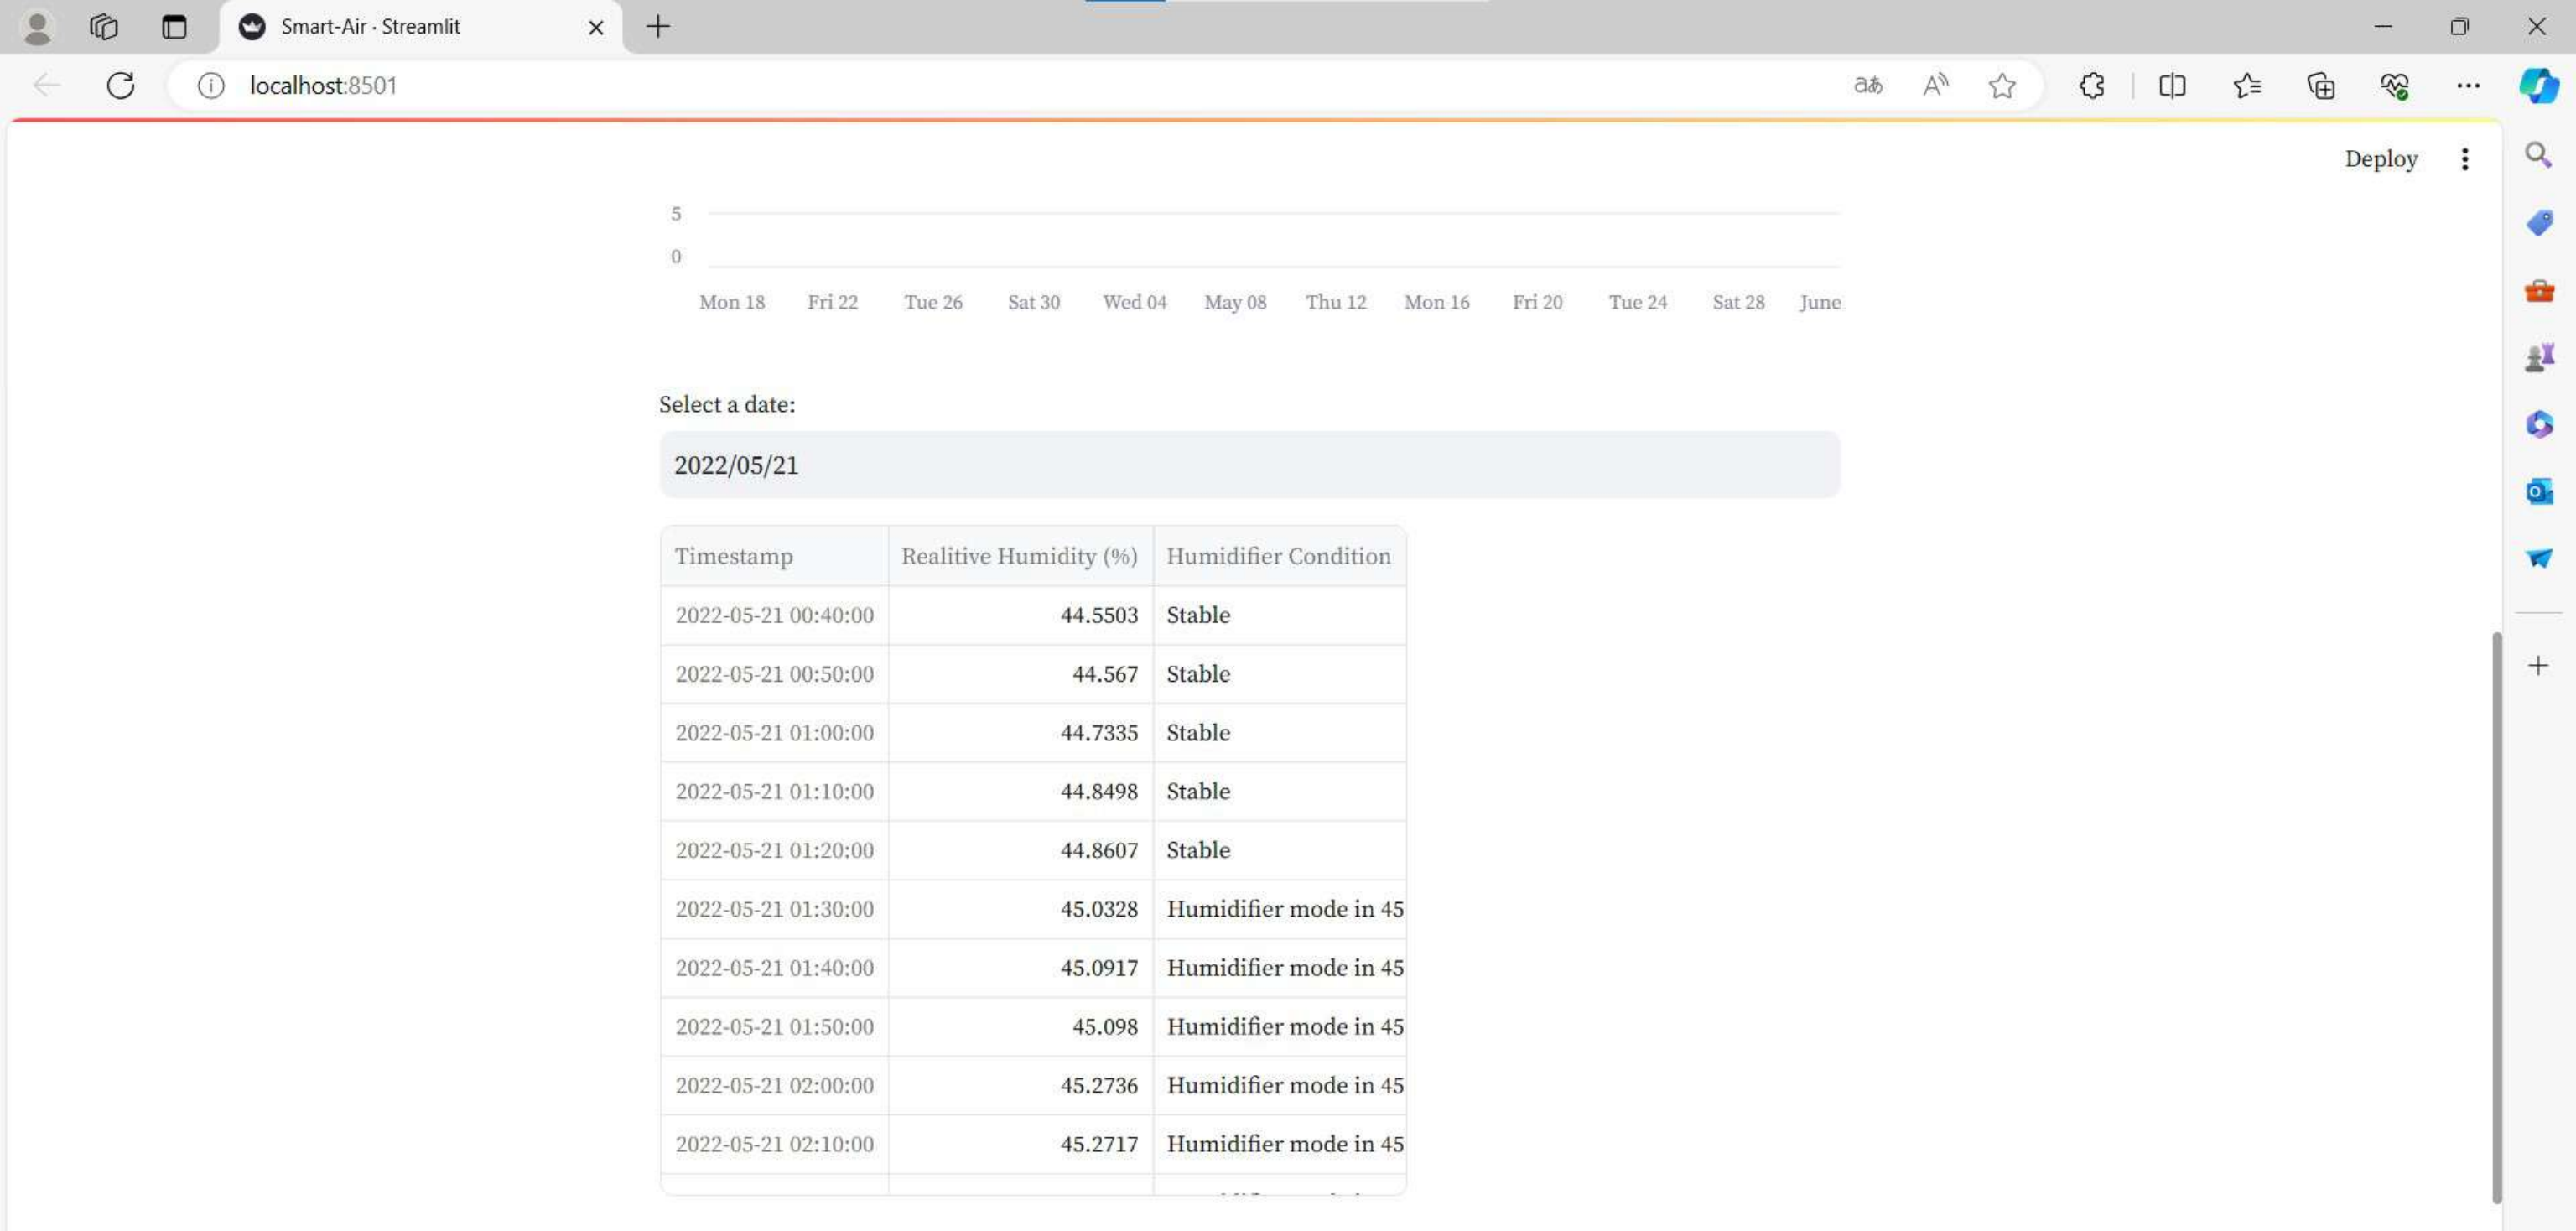

Smart-Air · Streamlit

localhost:8501

Deploy

2022-05-21 00:40:00	44.5503	Stable
2022-05-21 00:50:00	44.567	Stable
2022-05-21 01:00:00	44.7335	Stable
2022-05-21 01:10:00	44.8498	Stable
2022-05-21 01:20:00	44.8607	Stable
2022-05-21 01:30:00	45.0328	Humidifier mode in 45
2022-05-21 01:40:00	45.0917	Humidifier mode in 45
2022-05-21 01:50:00	45.098	Humidifier mode in 45
2022-05-21 02:00:00	45.2736	Humidifier mode in 45
2022-05-21 02:10:00	45.2717	Humidifier mode in 45

Select your choice:

None

Get Stable

Shedule

None

Smart-Air · Streamlit

localhost:8501

Deploy

2022-05-21 00:40:00	44.5503	Stable
2022-05-21 00:50:00	44.567	Stable
2022-05-21 01:00:00	44.7335	Stable
2022-05-21 01:10:00	44.8498	Stable
2022-05-21 01:20:00	44.8607	Stable
2022-05-21 01:30:00	45.0328	Humidifier mode in 45
2022-05-21 01:40:00	45.0917	Humidifier mode in 45
2022-05-21 01:50:00	45.098	Humidifier mode in 45
2022-05-21 02:00:00	45.2726	Humidifier mode in 45

Daily

Hourly

30 Minutes

10 Minutes

None

None

Smart-Air · Streamlit

localhost:8501

Deploy

Select the interval size for manipulation:

30 Minutes

Select starting time:

00:40:00

Manipulated Data:

Timestamp	Realitive Humidity (%)	Humidifier Condition
2022-05-21 00:40:00	44.5503	Scheduled
2022-05-21 00:50:00	44.567	Scheduled
2022-05-21 01:00:00	44.7335	Scheduled
2022-05-21 01:10:00	44.8498	Stable
2022-05-21 01:20:00	44.8607	Stable
2022-05-21 01:30:00	45.0328	Humidifier mode in 45 %
2022-05-21 01:40:00	45.0917	Humidifier mode in 45 %
2022-05-21 01:50:00	45.098	Humidifier mode in 45 %
2022-05-21 02:00:00	45.2736	Humidifier mode in 45 %
2022-05-21 02:10:00	45.2717	Humidifier mode in 45 %

Smart-Air · Streamlit

localhost:8501

Deploy

00:40:00

Manipulated Data:

Timestamp	Realitive Humidity (%)	Humidifier Condition
2022-05-21 00:40:00	44.5503	Scheduled
2022-05-21 00:50:00	44.567	Scheduled
2022-05-21 01:00:00	44.7335	Scheduled
2022-05-21 01:10:00	44.8498	Stable
2022-05-21 01:20:00	44.8607	Stable
2022-05-21 01:30:00	45.0328	Humidifier mode in 45 %
2022-05-21 01:40:00	45.0917	Humidifier mode in 45 %
2022-05-21 01:50:00	45.098	Humidifier mode in 45 %
2022-05-21 02:00:00	45.2736	Humidifier mode in 45 %
2022-05-21 02:10:00	45.2717	Humidifier mode in 45 %

Save Data

Data was saved!