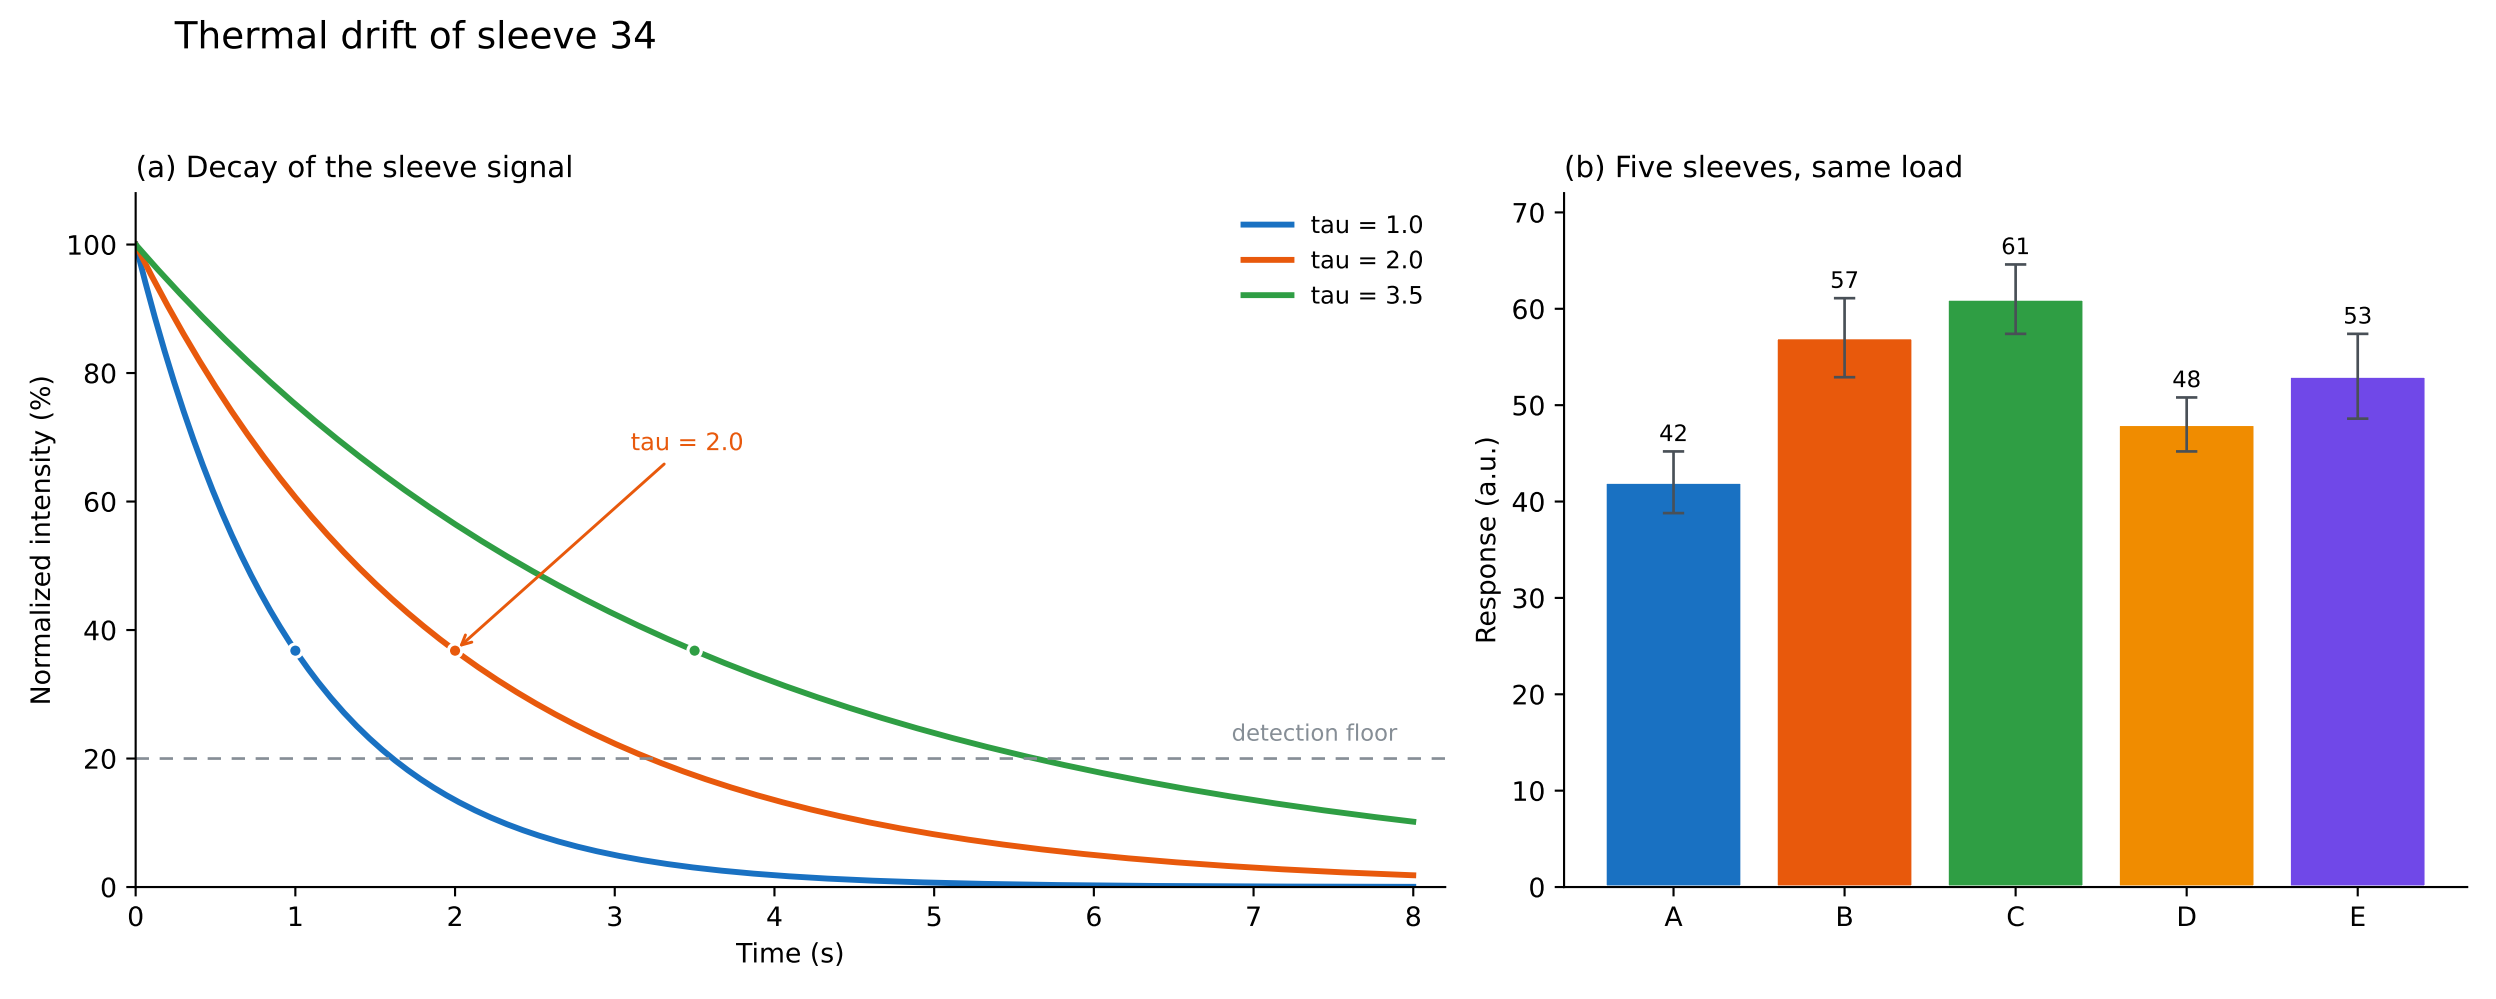
Thermal drift of sleeve 34
(a) Decay of the sleeve signal
tau = 1.0
tau = 2.0
tau = 3.5
tau = 2.0
detection floor
Normalized intensity (%)
Time (s)
(b) Five sleeves, same load
Response (a.u.)
42
57
61
48
53
A
B
C
D
E

(a) Signal path through the test rig

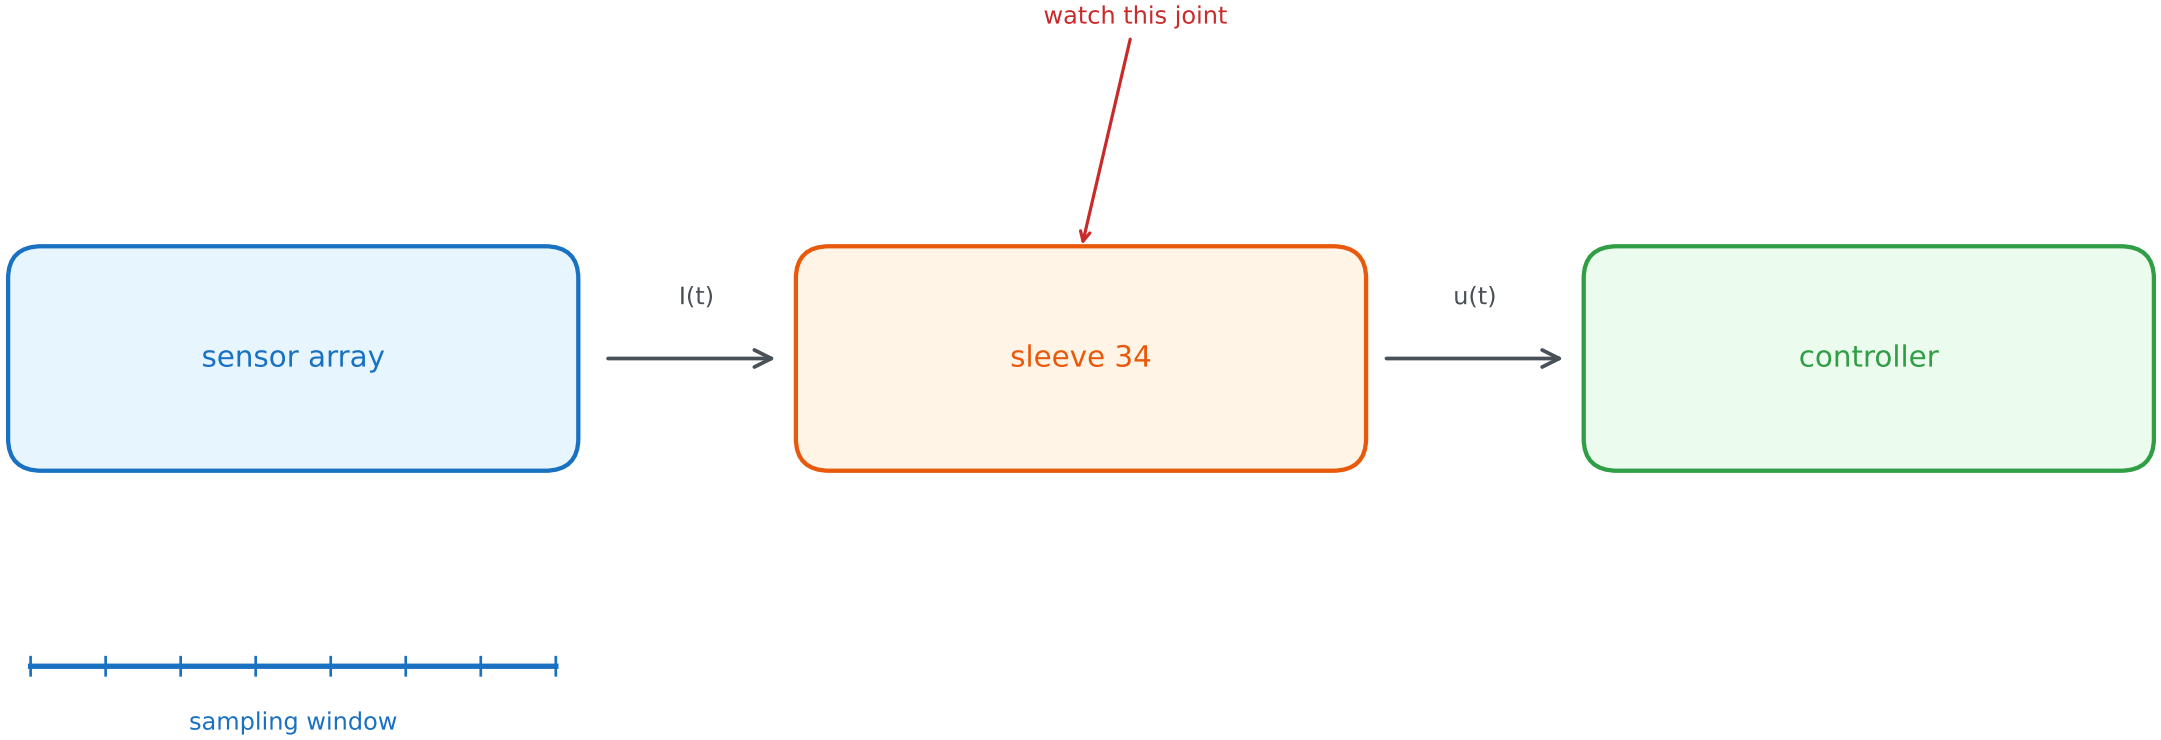

Notes on the sleeve-34 run

Three decay rates were fitted to the recorded signal. The 2.0 s trace sits closest to the manufacturer's curve; the 3.5 s trace flattens after 6 s and is treated as an outlier.

The detection floor was fixed at 20 % of the initial amplitude, which is where the dashed rule crosses the two slower traces.

Rows marked with a dagger were re-measured after the joint was reseated, and their error bars come from five repeats.

Run log

run	tau (s)	floor (%)	note
A-01	1.02	19.8	baseline
A-02	1.97	20.3	seated joint
A-03	2.05	20.1	repeat
B-01	3.48	21.0	outlier †

Figure 2 is the signal path; Figure 1 is the response.