Native formed-Cu network redistributes heat across TEC stages

Accepted 0.400 A / 300 K / 100 Pa Kr source solution; all three nets and contacts included

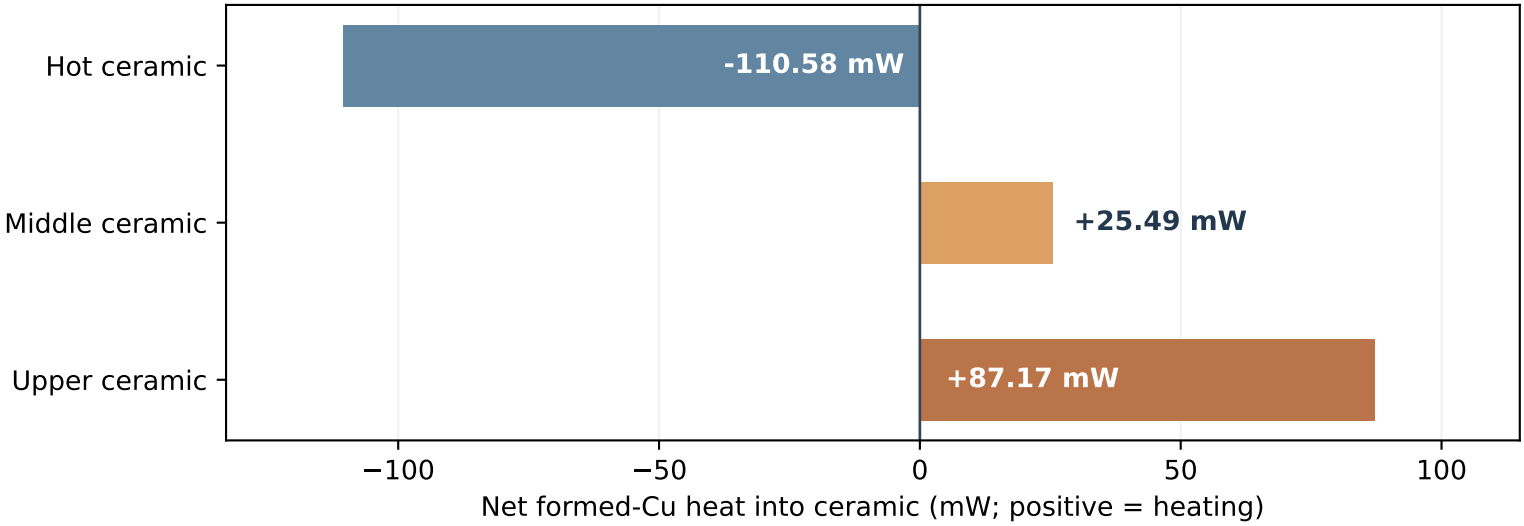

The signed total equals +2.082 mW copper Joule heat. The ~87 mW cold-stage input is NOT additional electrical power.