


TOLERANCE SYMBOLS IS:8000 (Pt-1)-1988.	STRAIGHTNESS		RUN OUT		NON TOLERANCED LINEAR MACHINED DIMENSIONS. IS:2102 (PL-1)-1993 MEDIUM CLASS	FROM UPTO & INCLUDING DEVIATION mm	0.5 - 3	3 - 6	6 - 30	30 - 120	120 - 400	400 - 1000	1000-2000	2000-4000
	FLATNESS		ANGULARITY											
	ROUNDNESS		POSITION											
	CYLINDRICITY		CONCENTRICITY											
	PROFILE OF A LINE		SYMMETRY											
	PROFILE OF A SURFACE		M.M.C.											
	PARALLELISM		TRUE POSITION											
	SQUARENESS		DATUM											
						IF IN DOUBT ASK				DO NOT SCALE THE DRAWING				

THIS DRAWING IS PROPERTY OF KALA GENSET PVT. LTD. AND
MUST BE RETURNED ON REQUEST. IT IS SUBMITTED AS CONFIDENTIAL
INFORMATION WITH OUR ENQUIRY, TENDER, ORDER OR CONTRACT NO.
IT IS NOT TO BE ISSUED FOR ANY OTHER PURPOSE OR ORDER NOR
MAY BE COPIED OR LENT WITHOUT OUR AUTHORITY IN WRITING.

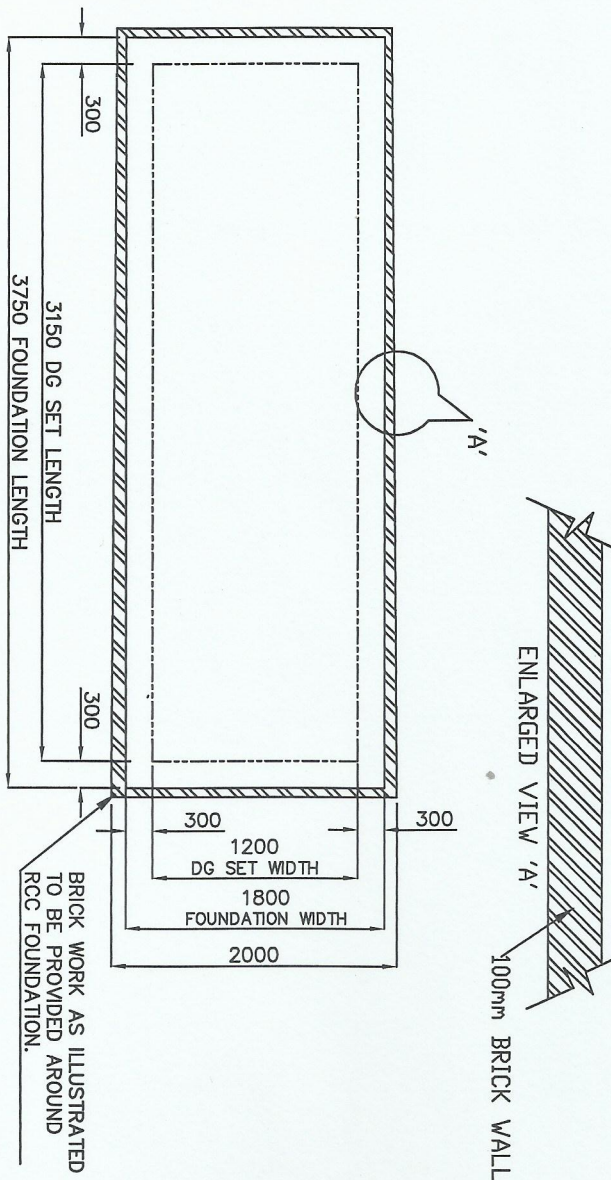


* IT IS RECOMMENDED TO HAVE FLOOR OF CEMENT FOUNDATION HEIGHT OF 200 mm CONCRETE BLOCK MUST BE IN WATER LEVEL.
EPOXY COAT (BETWEEN BASE PLATE & FOUNDATION TOP)

BRICK WORK AS ILLUSTRATED
TO BE PROVIDED AROUND
RCC FOUNDATION.

10mm FINISHED
RICK WORK

'D' = DEPTH IS DEPEND UP ON SOIL GRADE AS MENTIONED ABOVE.

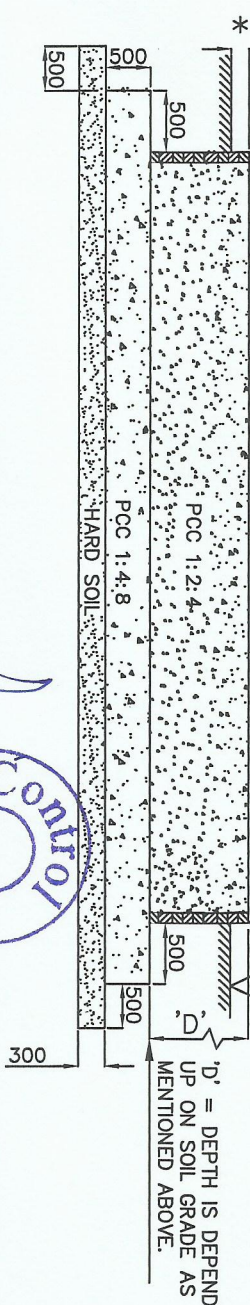

PRODUCT IMPROVEMENT IS A CONTINUOUS PROCESS. DIMENSION SPECIFICATION MAY CHANGE WITH IMPROVEMENT. KINDLY CONTACT KOEL FOR LATEST INFORMATION

PRINTS OF PREVIOUS
REVISION NO SHOULD
BE SCRAPPED

R02	FOUNDATION DRAINING REVISED AS PER KIEL LATEST RECOMMENDATIONS. EMAIL FROM THERR	
R01	FOUNDATION DRAINING REVISED.	
Rev. No.		REVISION

7/11/2011

UNLESS OTHERWISE SPECIFIED ALL DIMENSIONS ARE IN mm.	DATE	07.14.17	DOCS	MBT	MODIFIED BY
- UNFINISHED TO FINISHES - PER CO. STD. NO. 11001. - REMOVE ALL SHARP EDGES.	CO. STD. FILE MATERIAL	UNFINISHED FIN.	UNFINISHED FIN.	UNFINISHED FIN.	UNFINISHED FIN.
CHAMFER UNDERCUT	CHAMFER UNDERCUT	CHAMFER UNDERCUT	CHAMFER UNDERCUT	CHAMFER UNDERCUT	CHAMFER UNDERCUT
1000	1000	1000	1000	1000	1000
DATE	DATE	DATE	DATE	DATE	DATE



KALA GENSET PVT LTD.
PUNE 410501 (INDIA)

FOUNDATION PLAN DRAWING
FOR HA694TCI GT_52.5 IWA

FIRST ANGLE PROJECTION

The symbol for first angle projection, consisting of a circle with a crosshair and a truncated cone (frustum) superimposed on it.

NOTES:-1) FOUNDATION TO BE MADE ON A GOOD PREPARED SURFACE WITH SOIL STRATA BEARING CAPACITY ADEQUATE TO SUPPORT THE WEIGHT OF GINSET & FOUNDATION. REFER CHART FOR SOIL STRENGTH.

	SAFETY BEARING CAPACITY (kN/SM)
HAIRY (BY TEST)	9/75,400
REDUCED RIGIDITY	2/44,000 = 9/75,400
HARD ROCK GRANITE	9/7,600 = 1/6,400
REDUCED ROCK SHELL	7/3,100 = 9/7,600
HARD PAN	7/3,100 = 9/7,600
STIFF ROCK	48,800 = 59,600
HARD CLAY	39,400 = 48,800
GRAVEL AND COARSE SAND	39,400 = 48,800
LOOSE, MEDIUM GRAIN, AND OVERPACKED FINE SAND	29,200 = 39,000
MEDIUM CLAY	19,500 = 29,000
LOOSE FINE SAND	9,750 = 19,500
STIFF CLAY	9/750

- 2) THE LENGTH & WIDTH OF FOUNDATION SHOULD BE AT LEAST 300 mm MORE ON EACH SIDE THAN ACOUSTIC ENCLOSURE LENGTH & WIDTH RESPECTIVELY.
- 3) CHECK THE FOUNDATION LEVEL DIAGONALLY AS WELL AS ACROSS THE LENGTH & WIDTH FOR EVEN FLATNESS AND SAME SHOULD BE WITHIN 50mm IN HORIZONTAL PLANE IN ANY ONE DIRECTION ONLY.
- 4) ENSURE THAT THE CONCRETE IS COMPLETELY CURED BEFORE POSITIONING THE ENCLOSURE.
- 5) ENSURE THAT THE FOUNDATION TO SUPPORT 1.5 TIMES OF THE TOTAL VET WEIGHT OF THE SINGLE GENERATING SET INSTALLATION & 2 TIMES OF THE TOTAL VET WEIGHT FOR THE MULTIPLE GENERATING SET INSTALLATION.
- 6) FOR ROOF TOP INSTALLATION IT IS NECESSARY TO HAVE PLANNING AND STRUCTURAL DESIGN APPROVAL.
- 7) DO NOT INSTALL ACOUSTIC ENCLOSURE ON LOOSE SAND OR CLAY, AVOID HARD/SHARP PROJECTIONS SUCH AS STONE OR STEEL PARTS ON FOUNDATION SURFACE WHICH MAY DAMAGE FUEL TANK AT BOTTOM.
- 8) AVOID UNEVEN FOUNDATION WHICH MAY LEAD TO IMPROPER RESTING OF GENSET ON FOUNDATION, THERE BY LEADING TO LEAKAGE OF SOUND AND VIBRATION ON GENSET.
- 9) IF GENSET IS TO BE MOUNTED ON FOUNDATION HAVING UNEVEN SURFACE UNDER UNAVOIDABLE CIRCUMSTANCES, USE APPROPRIATE THICKNESS OF RUBBER MATTING ABOVE FOUNDATION FOR POSITIVE SEALING OF GENSET WITH BASE.