


DEVIATION ON NON TOLERANCED LINEAR MACHINED DIMENSIONS. IS: 2102 (Pt-1)-1993 MEDIUM CLASS	FROM UPTO & INCLUDING	0.5 - 3	3 - 6	6 - 30	30 - 120	120 - 400	400 - 1000	1000-2000	2000-4000
	DEVIATION mm	±0.1	±0.1	±0.2	±0.3	±0.5	±0.8	±1.2	±2

IF IN DOUBT ASK

DO NOT SCALE THE DRAWING

THIS DRAWING IS PROPERTY OF KALA GENSET PVT. LTD. AND
MUST BE RETURNED ON REQUEST. IT IS SUBMITTED AS CONFIDENTIAL
INFORMATION WITH OUR ENQUIRY, TENDER, ORDER OR CONTRACT NO.
IT IS NOT TO BE ISSUED FOR ANY OTHER PURPOSE OR ORDER NOR
MAY BE COPIED OR LENT WITHOUT OUR AUTHORITY IN WRITING.

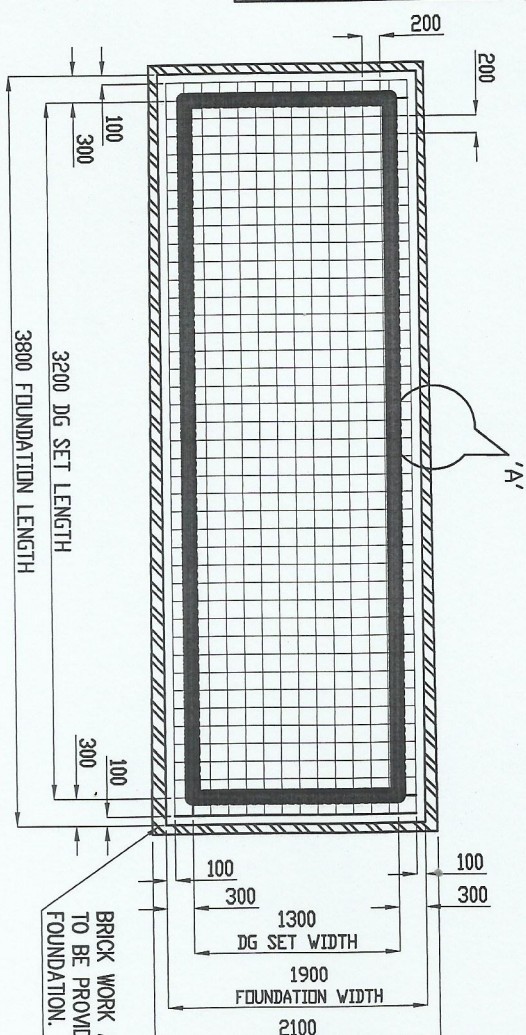

ENLARGED VIEW 'A'

100mm BRICK WALL

IT IS RECOMMENDED TO HAVE
FOUNDATION HEIGHT OF 200 mm
ABOVE GROUND LEVEL


EPOXY COAT (BETWEEN BASE
PLATE & FOUNDATION TOP)

FLOOR OF CEMENT
CONCRETE BLOCK MUST
BE IN WATER LEVEL.

100mm FINISHED
BRICK WORK

BRICK WORK AS ILLUSTRATED
TO BE PROVIDED AROUND RCC
FOUNDATION.

'D' = DEPTH IS DEPENDENT UP ON SOIL GRADE AS MENTIONED ABOVE.

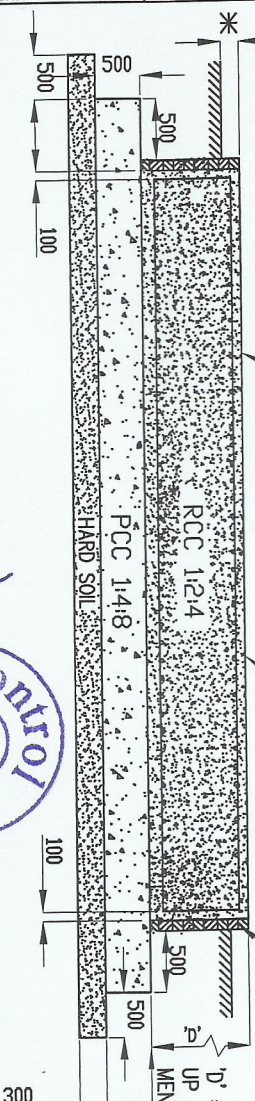

PRODUCT IMPROVEMENT IS A CONTINUOUS PROCESS. DIMENSION SPECIFICATION MAY CHANGE WITH IMPROVEMENT. KINDLY CONTACT KOEL FOR LATEST INFORMATION

FOUNDATION DRAWING REMISED AS PER KOEL LATEST RECOMMENDATIONS.

UNLESS OTHERWISE SPECIFIED	NAME
• ALL DIMENSIONS ARE IN MM.	
• UNMOUNTED TUBES ARE 1/8" PER COLD.D.M.D. 11001.	CAD DRG. FILE
• REMOTE ALL SHARP EDGES AND SHARP EDGES.	MATERIAL



KALA GENSET PVT LTD.
PUNE 410501 (INDIA)

DIADIA)

NOTES:-1) FOUNDATION TO BE MADE ON A GOOD PREPARED SURFACE WITH SOIL STRATA BEARING CAPACITY ADEQUATE TO SUPPORT THE WEIGHT OF GENSET & FOUNDATION. REFER CHART FOR SOIL STRENGTH.

[illegible]

- 2) THE LENGTH & WIDTH OF FOUNDATION SHOULD BE AT LEAST 300 mm MORE ON EACH SIDE THAN GENSET LENGTH & WIDTH RESPECTIVELY.
- 3) CHECK THE FOUNDATION LEVEL DIAGONALLY AS WELL AS ACROSS THE LENGTH & WIDTH FOR EVEN FLATNESS AND SAME SHOULD BE WITHIN ±50mm IN HORIZONTAL PLANE IN ANY ONE DIRECTION ONLY.
- 4) ENSURE THAT THE CONCRETE IS COMPLETELY CURED BEFORE POSTPONING THE GENSET.
- 5) ENSURE THAT THE FOUNDATION TO SUPPORT 1.5 TIMES (DYNAMIC LOAD) OF THE TOTAL NET WEIGHT OF THE SINGLE GENERATING SET INSTALLATION & 2 TIMES OF THE TOTAL NET WEIGHT FOR THE MULTIPLE GENERATING SET INSTALLATION.
- 6) FOR ROOFTOP INSTALLATION IT IS NECESSARY TO HAVE PLANNING AND STRUCTURAL DESIGN APPROVAL.
- 7) DO NOT INSTALL GENSET ON LOOSE SAND OR CLAY.
- 8) DO NOT HARSH PROTECTIONS SUCH AS STONE OR STEEL PARTS ON FOUNDATION SURFACE WHICH MAY DAMAGE THE CABLE LAY AT BOTTOM.
- 9) AVOID UNEVEN FOUNDATION WHICH MAY LEAD TO IMPROPER SETTING OF GENSET ON FOUNDATION, THERE BY LEADING TO LEAKAGE OF SOUND AND VIBRATION ON GENSET.
- 10) IF GENSET IS TO BE MOUNTED ON FOUNDATION HAVING UNEVEN SURFACE UNDER UNAVOIDABLE CIRCUMSTANCES, USE APPROPRIATE THICKNESS OF RUBBER MATTING ABOVE FOUNDATION FOR POSITIVE SEALING OF GENSET WITH BASE.
- 11) FOR CABLE TRENCH OPENING OPTION ON FOUNDATION, REFER TO GENSET GENERAL ARRANGEMENT DRAWING.

