



THIS DRAWING IS PROPERTY OF KALA GENSET PVT. LTD. AND
MUST BE RETURNED ON REQUEST. IT IS SUBMITTED AS CONFIDENTIAL
INFORMATION WITH OUR ENQUIRY, TENDER, ORDER OR CONTRACT NO.
IT IS NOT TO BE ISSUED FOR ANY OTHER PURPOSE OR ORDER NOR
MAY BE COPIED OR LENT WITHOUT OUR AUTHORITY IN WRITING.

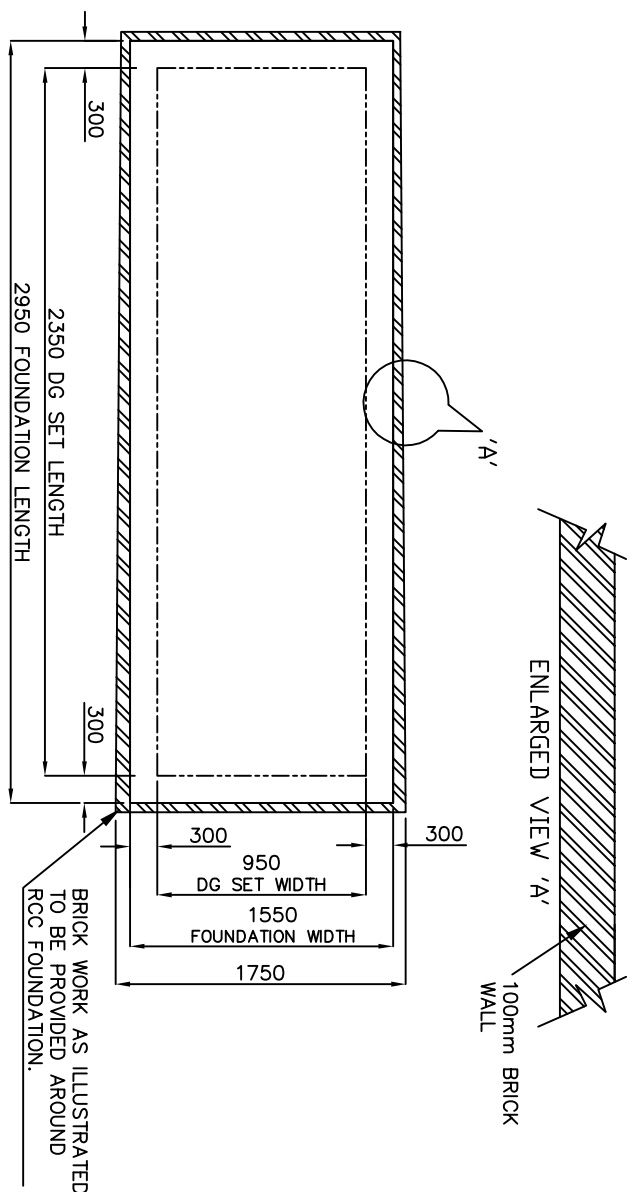

* IT IS RECOMMENDED TO HAVE EPOXY COAT (BETWEEN BASE FLOOR OF CEMENT FOUNDATION HEIGHT OF 200 mm PLATE & FOUNDATION TOP) CONCRETE BLOCK MUST BE IN WATER LEVEL.

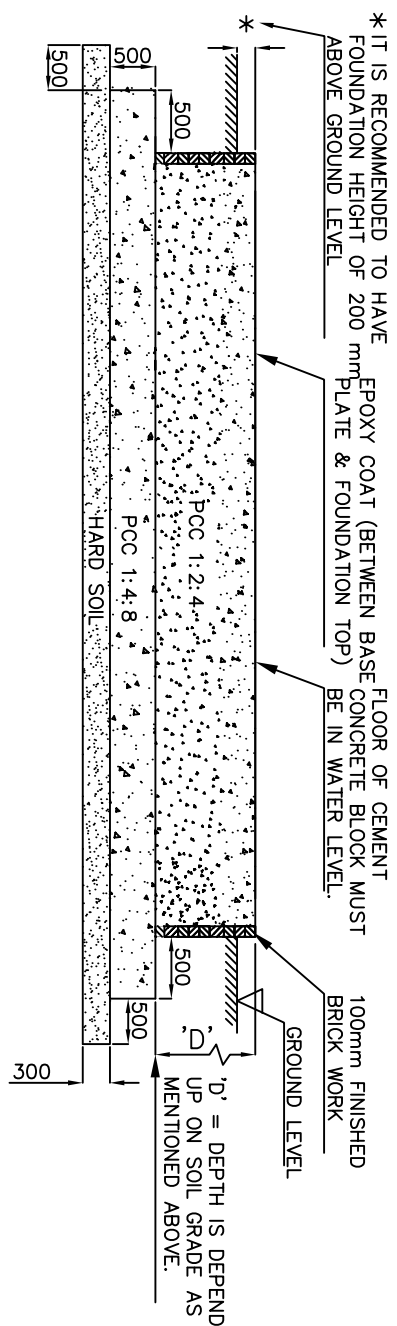

DES:-1) FOUNDATION TO BE MADE ON A GOOD PREPARED SURFACE WITH SOL STRAIN. BEARING CAPACITY ADEQUATE TO SUPPORT THE WEIGHT OF GENSET & FOUNDATION. REFER CHART FOR SOIL STRENGTH.

MATERIAL OR LOAD	SAFE BEARING CAPACITY (KGS/CM ²)
HARD ROCK	124,000 - 917,000
HARD ROCK GRANITE	17,000 - 146,400
HARD ROCK SELL	78,000 - 97,600
HARD TAIL	18,000 - 38,600
SOFT ROCK	48,000 - 58,600
HARD CLAY	39,000 - 48,800
GRAVEL AND COARSE SAND	39,000 - 48,800
LOOSE-MEDIUM COARSE SAND	69,300 - 89,000
COMPACTED THE SHALE	19,300 - 39,000
MEDIUM CLAY	19,300 - 39,000
LOOSE FINE SAND	9,750 - 39,300
SOFT CLAY	9,750

2) THE LENGTH & WIDTH OF FOUNDATION SHOULD BE AT LEAST 300 mm MORE ON EACH SIDE THAN GENSET LENGTH & WIDTH RESPECTIVELY.

3) CHECK THE FOUNDATION LEVEL DIAGONALLY AS WELL AS ACROSS THE LENGTH & WIDTH FOR EVEN FLATNESS AND SAME SHOULD BE WITHIN 150mm IN HORIZONTAL PLANE IN ANY ONE DIRECTION ONLY.

4) ENSURE THAT THE CONCRETE IS COMPLETELY CURED BEFORE POSITIONING THE GENSET.

5) ENSURE THAT THE FOUNDATION TO SUPPORT 1.5 TIMES (DYNAMIC LOAD) OF THE TOTAL NET WEIGHT OF THE SINGLE GENERATING SET INSTALLATION & 2 TIMES OF THE TOTAL NET WEIGHT FOR THE MULTIPLE GENERATING SET INSTALLATION.

6) FOR ROOFTOP INSTALLATION, IT IS NECESSARY TO HAVE PLANNING AND STRUCTURAL DESIGN APPROVAL.

7) DO NOT INSTALL GENSET ON LOOSE SAND OR CLAY.


8) AVOID HARD/SHARP PROJECTIONS SUCH AS STONE OR STEEL PARTS ON FOUNDATION SURFACE WHICH MAY DAMAGE FUEL TANK AT BOTTOM.

9) AVOID UNEVEN FOUNDATION WHICH MAY LEAD TO IMPROPER RESTING OF GENSET ON FOUNDATION, THERE BY LEADING TO LEAKAGE OF SOUND AND VIBRATION ON GENSET.

10) IF GENSET IS TO BE MOUNTED ON FOUNDATION HAVING UNEVEN SURFACE UNDER UNAVOIDABLE CIRCUMSTANCES, USE APPROPRIATE THICKNESS OF RUBBER MATTING ABOVE FOUNDATION FOR POSITIVE SEALING OF GENSET WITH BASE.

11) FOR CAVE TRENCH OPENING, OPTION ON FOUNDATION, REFER TO GENERAL ARRANGEMENT DRAWING.

WATER, IF LAND BEARING MATERIAL	SAFE BEARING CAPACITY KG/CM ²
HARD ROCK GRANITE	24,400 - 976,400
MEDIUM ROCK	97,600 - 397,600
HARD PAW	78,100 - 97,600
SOFT ROCK	48,800 - 59,600
HARD CLAY	39,000 - 48,800
GRAVEL, AND COARSE SAND	39,000 - 48,800
LOSS-JETTED CHARGE AND COMPACTED FINE SAND	29,300 - 39,000
MEDIUM CLAY	19,500 - 39,000
LOSS FINE SAND	9,750 - 39,200
SOFT CLAY	9,750

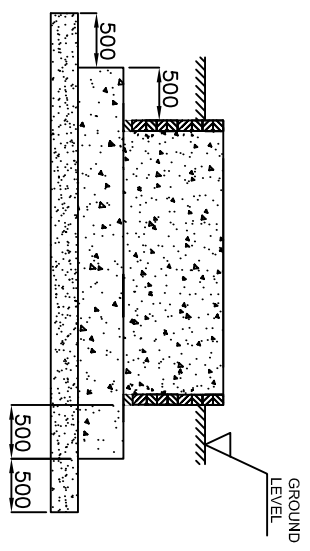[illegible]

KALA GENSET PVT LTD.
PUNE 410501 (INDIA)